



THIS DOCUMENT CONTAINS INFORMATION THAT IS CONFIDENTIAL AND/OR PROPRIETARY TO DONALDSON COMPANY, INC. ALL RIGHTS TO DISCLOSE, COPY, REPRODUCE, MANUFACTURE FROM OR DISPOSE OF THIS DOCUMENT OR ITS CONTENTS ARE RESERVED UNLESS SPECIFIED IN WRITING BY DONALDSON.

REVISIONS		
REV	DESCRIPTION	DWN/DATE



SPECIFICATIONS AUTO-LOK 2 X 3

RATED FLOW _____ 12000 CFM
 DIFFERENTIAL PRESSURE @ RATED FLOW _____ 3" WC (W/ FILTERS INSTALLED)
 HOUSING RATING _____ +10" WC
 FINISH _____ GALVANIZED STEEL
 APPROXIMATE WEIGHT _____ 500 POUNDS

- NOTES:
 1. DO NOT INSTALL OR OPERATE THIS EQUIPMENT UNTIL YOU HAVE READ AND UNDERSTOOD THE INSTRUCTIONS AND WARNINGS IN THE INSTALLATION AND OPERATION MANUAL. FOR A REPLACEMENT MANUAL CONTACT DONALDSON CO INC. (800-365-1331).
 2. ALLOW 24 INCHES ON EITHER SIDE OF COLLECTOR FOR FILTER REPLACEMENT.
 3. THIS UNIT INCLUDES A MAGNEHELIC GAUGE WHICH SHIPS LOOSE.

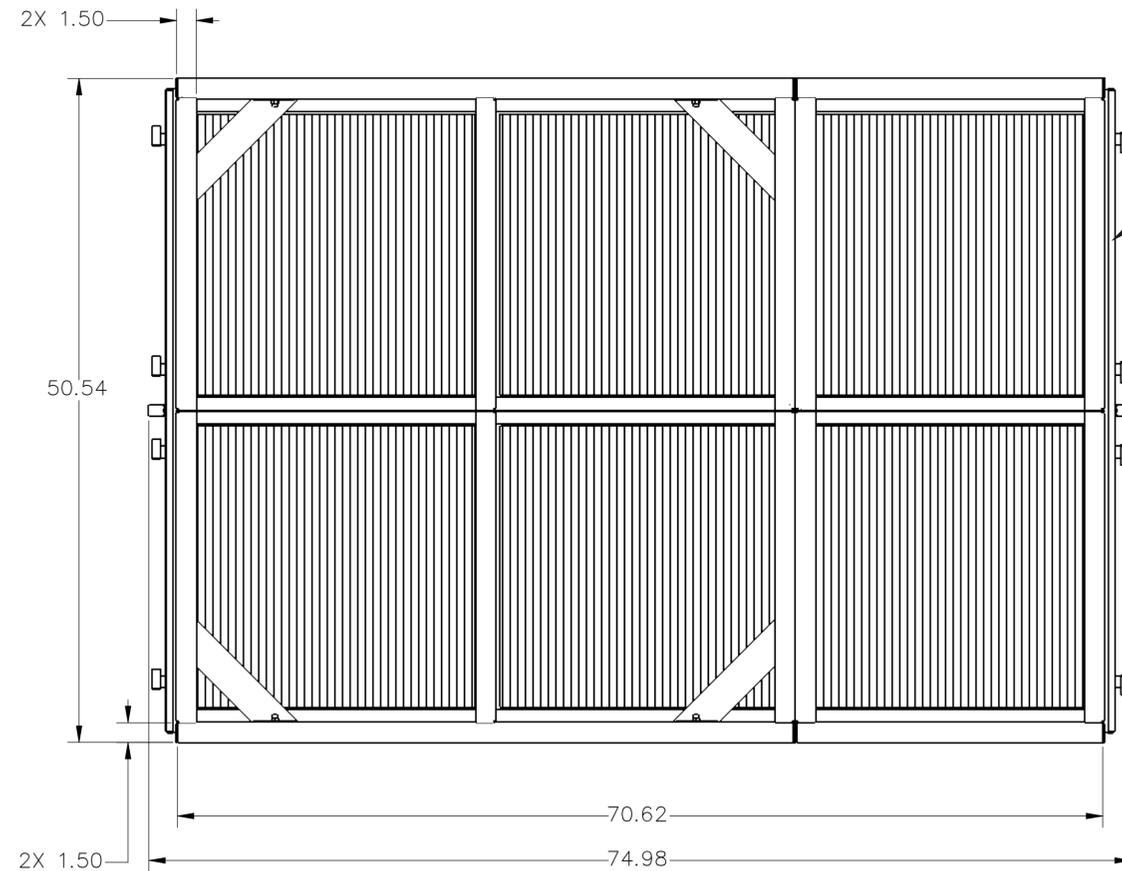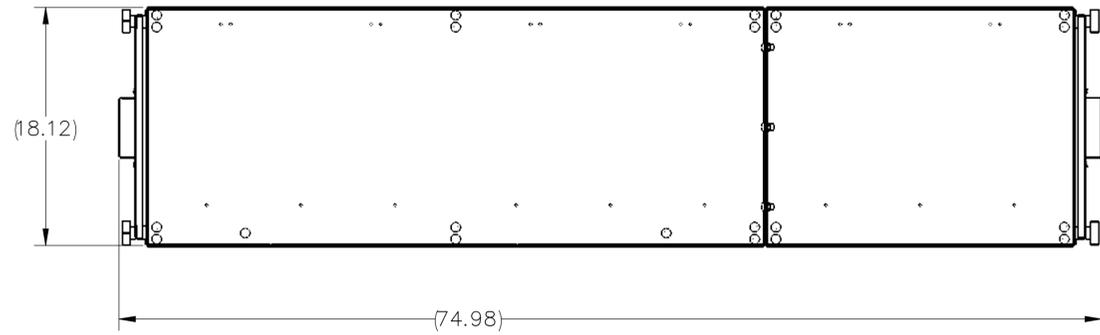

ALLOW 24.00 EITHER SIDE FOR FILTER REPLACEMENT

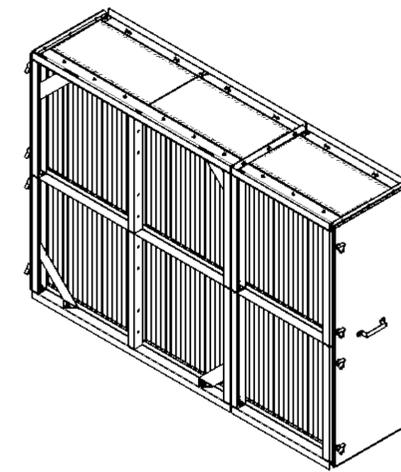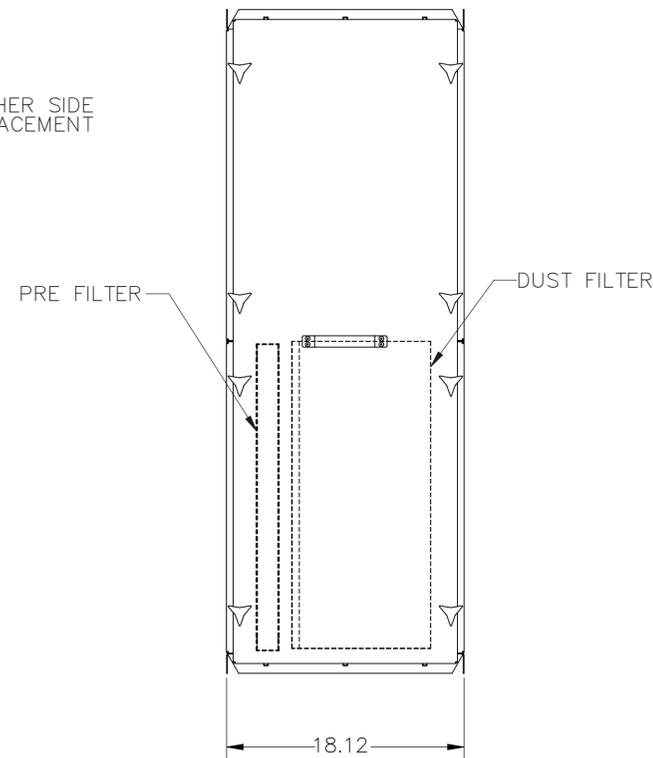

MATERIAL	RELEASE NO.	TITLE AUTO-LOK 2 X 3	
	DATE		
	EXP DATE		
	DWN DRIVEWORKS	NUMBER	
REFERENCE	DATE 1/17/2024	IG17695956L003	
	CHK T PEICKERT	SCALE NONE	SHEET 1 OF 1
	DATE 1/17/2024	C/C	REVISION
PREVIOUS DRAWING NO.	APVD	SECTIONAL SIZE	SW/CADD
	DATE	OUTLINE SIZE	0
DO NOT SCALE	TOLERANCES UNLESS OTHERWISE SPECIFIED	2 PL ±	3 PL ±
		ANGLES ± °	
	THIRD ANGLE PROJECTION	DESIGN CONTROL A501	DWG LOCATION A888
		COPYRIGHT © DONALDSON COMPANY, INC.	



IG17695956L003_A_SECT1.SLDDRW Wednesday, January 17, 2024 7:58:03 AM