



THIS DOCUMENT CONTAINS INFORMATION THAT IS CONFIDENTIAL AND/OR PROPRIETARY TO DONALDSON COMPANY, INC. ALL RIGHTS TO DISCLOSE, COPY, REPRODUCE, MANUFACTURE FROM OR DISPOSE OF THIS DOCUMENT OR ITS CONTENTS ARE RESERVED UNLESS SPECIFIED IN WRITING BY DONALDSON.

REVISIONS		
REV	DESCRIPTION	DWN/DATE

SPECIFICATIONS AUTO-LOK 2 X 4

RATED FLOW _____ 16000 CFM
 DIFFERENTIAL PRESSURE @ RATED FLOW _____ 3" WC (W/ FILTERS INSTALLED)
 HOUSING RATING _____ +10" WC
 FINISH _____ GALVANIZED STEEL
 APPROXIMATE WEIGHT _____ 600 POUNDS



- NOTES:
- DO NOT INSTALL OR OPERATE THIS EQUIPMENT UNTIL YOU HAVE READ AND UNDERSTOOD THE INSTRUCTIONS AND WARNINGS IN THE INSTALLATION AND OPERATION MANUAL. FOR A REPLACEMENT MANUAL CONTACT DONALDSON CO INC. (800-365-1331).
 - ALLOW 24 INCHES ON EITHER SIDE OF COLLECTOR FOR FILTER REPLACEMENT.
 - THIS UNIT INCLUDES A MAGNEHELIC GAUGE WHICH SHIPS LOOSE.
 - THIS PRINT IS NOT CERTIFIED FOR CONSTRUCTION PURPOSES. THIS DOCUMENT IS SUBJECT TO CHANGE WITHOUT NOTICE.

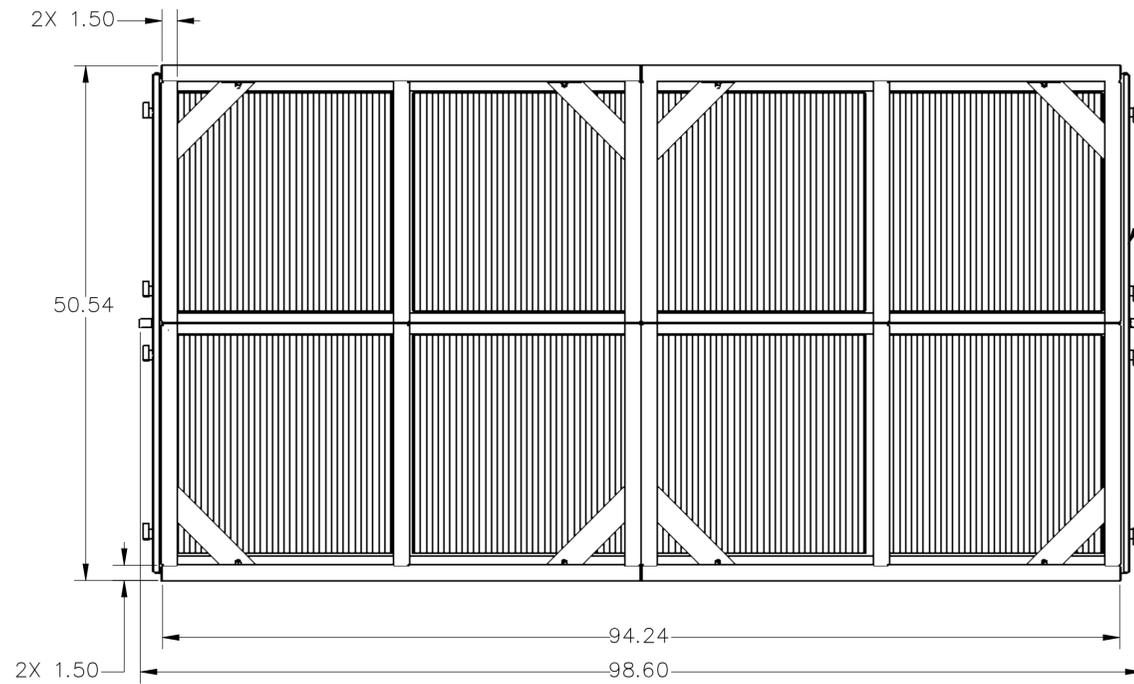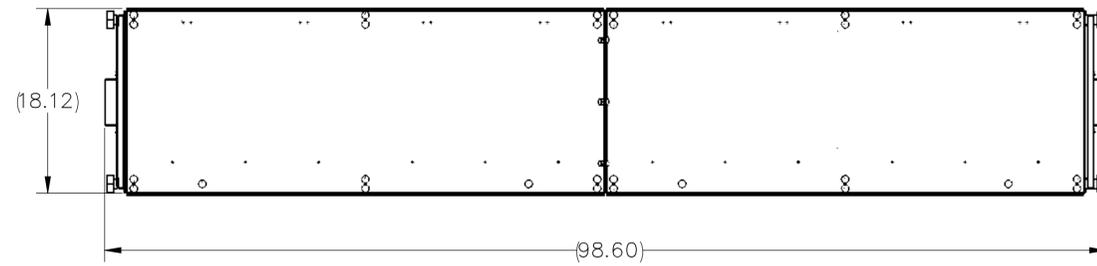

ALLOW 24.00 EITHER SIDE FOR FILTER REPLACEMENT

PRE FILTER

DUST FILTER

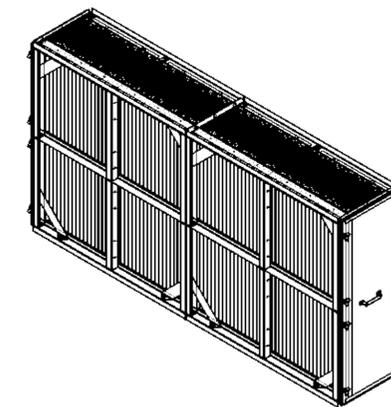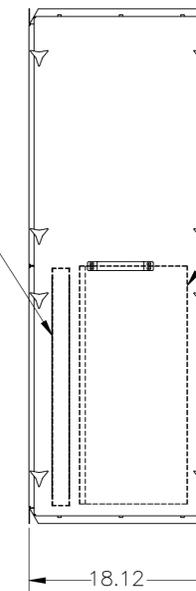

MATERIAL	RELEASE NO.	TITLE AUTO-LOK 2 X 4	
	DATE		
	EXP DATE		
	DWN DRIVEWORKS	NUMBER	
REFERENCE	DATE 4/18/2024	IG17991665L017	
	CHK N SMITH		
	DATE 4/18/2024	SCALE NONE	SHEET 1 OF 1
PREVIOUS DRAWING NO.	APVD	C/C	REVISION
	DATE	SW/CADD	
DO NOT SCALE	TOLERANCES UNLESS OTHERWISE SPECIFIED	SECTIONAL SIZE	OUTLINE SIZE
	2 PL ±		
	3 PL ±		
	ANGLES ± °		
	THIRD ANGLE PROJECTION	DESIGN CONTROL A501	DWG LOCATION A888
		COPYRIGHT © DONALDSON COMPANY, INC.	



IG17991665L017_A_SECT1.SLDDRW Thursday, April 25, 2024 9:16:54 AM