

June 19, 2025

Solarbank Corp.
803-505 Consumers Road
Toronto, ON M2J 4V8

Attention: Ina Lila

Re: GTR-23015113-A0 Response to Peer Review – Acoustic Assessment Report for Battery Energy Storage System
219 Peggs Mountain Road, Burk's Falls, Ontario

Dear Ina:

This letter is to respond to comments in the peer review report dated May 21, 2025 and prepared by Cambium Inc. for the Air and Acoustic Assessments for the proposed Battery Energy Storage System facility (BESS) at 219 Peggs Mountain Road in Burk's Falls. This letter focuses on the comments related to the Acoustic Assessment Report (AAR).

1 Responses for Peer Review Comments

1. *It would be preferred if the proponent could clarify which noise/acoustic study should be considered the most recent and most applicable.*

The latest version of the Acoustic Assessment Report is the version dated October 25, 2024.

2. *NPC-300 considered all noise sources located within one property boundary to be one "stationary source". The noise studies provided appear to address only the BESS noise sources.*

According to Schedule A in a Confirmation of Registration to MECP dated April 4, 2018 for the existing solar facility (Registration Number R-006-3110402578), there are 13 inverters and 1 transformer in the solar facility. All of them have a sound power level less than 65 dBA. An AAR was not prepared. Therefore, it is concluded that there is no significant stationary noise source associated with the existing solar facility.

3. *In Cambium's experience addressing BESS noise, the units typically have different noise levels depending on charge status and use states. Can it be confirmed that the test data relied on is the predictable worst-case scenario for these units?*

The sound data used in the AAR are from the Occupational Noise Exposure Test Report, which was in the appendix of the AAR. The supplier of the BESS equipment, EVLO, has confirmed that the sound level measurements were performed at maximum operation power level and is considered as the predictable worse-case scenario.

4. *It is unclear how transformer sound power was calculated. The manufacturer data provided does not indicate what type of sound rating is provide (IE NEMA, IEEE Methods etc.). The report does not lay out how dBA sound power was determined from this rating, which is listed in dB.*

The transformer supplier, Daelim Transformer, has confirmed that the sound rating of the transformer was measured to ensure that it meets the CSA C88 Standard. The sound levels are presented in A-weighted sound levels. According to CSA C88 Standard, the sound rating should be measured in accordance with IEEE C57.12.90.

5. *Supporting calculations indicate spectral data was used in assessment, however the supporting information is all single value noise measurement data. How was the spectrum of each source deteriorated?*

The spectral data of each source is from EXP past sound level measurements for similar noise sources, then adjusted to match the A-weighted sound levels in the Occupational noise Exposure Test Report in Appendix B.

6. *The noise studies do not seem to account for the vacant lot, or new residential development at 223 Peggs Mountain Road, directly to the west of the receptor location (POR1).*

The AAR has been updated with the latest site plan to include a noise receptor at the vacant lot at 223 Peggs Mountain Road.

7. *The noise studies do not seem to address the three future residential lots to be potentially severed from the northeast side of the property that are shown in the air emissions letter and noted in the planning justification report.*

The AAR has been updated with the latest site plan to include noise receptors at the three future residential lots.

8. *It is not clear where the barrier effect in the sample calculations is coming from. Is this from modelling structures on site or does the topography break line-of-site?*

No noise barrier or structures are in the CadnaA model. Only topography is included in the calculations.

9. *Calculation settings for the CADNA software are not provided, Cambium cannot fully review the results without knowing the software settings.*

CadnaA settings for the analysis are described in Section 6 of the AAR.

2 Closing

We trust that the information provided in this letter is satisfactory for your purposes. Should you have any questions or require more information, please do not hesitate to contact the undersigned.

Sincerely,

EXP Services Inc.



Pearlie Yung, M.Sc., P.Eng.
Senior Acoustical Engineer
Environmental Services



Ron Taylor, M.Sc., C.Chem., CIH
Discipline Lead, Air Quality & Industrial Hygiene
Environmental Services



RECEIVED
JULY 8, 2025
TOWNSHIP OF ARMOUR

219 Peggs Mountain Road, Burk's Falls, Ontario

Acoustic Assessment Report

Client:

Solarbank Corp.
505 Consumers Road, Suite 803, North York, ON M2J 4V8

Type of Document:

Final

Project Name:

Battery Energy Storage System Facility – 219 Peggs Mountain Road

Project Number:

GTR-23015113-A0

EXP Services Inc.
1595 Clark Boulevard
Brampton, ON, L6T 4V1
t: 905.793.9800
f: 905.793.0641

Date Submitted:

2025-6-19

Version Control

Rev.	Date	Description	Submitted by	Reviewed by
0.0	June 12, 2024	Final	Pearlie Yung	Ron Taylor
1.0	August 27, 2024	Final	Pearlie Yung	Ron Taylor
1.1	October 25, 2024	Final	Pearlie Yung	Ron Taylor
2.0	June 19, 2025	Final	Pearlie Yung	Ron Taylor

Table of Contents

1	Introduction	2
2	Site and Surrounding Area	2
3	Critical Points of Reception	2
4	Stationary Noise Sources	3
5	Noise Criteria	5
6	Predicted Sound Levels	5
7	Conclusions	11
8	General Limitations	11
9	Closure	12
10	References	13

List of Appendices

Figures

Appendix A – Site Plan

Appendix B – Equipment Sound Data

Appendix C – CadnaA Calculation Output

1 Introduction

EXP Services Inc. (EXP) was retained by Solarbank Corp. (“Client”) to complete an Acoustic Assessment Report (AAR) for a new Battery Energy Storage System (BESS) facility located at 219 Peggs Mountain Road in Burl’s Falls, Ontario (hereinafter referred to as “Site”). This AAR is an assessment of noise impact from the proposed BESS facility to nearby noise-sensitive developments in accordance with the Ministry of Environment, Conservation of Park (MECP) Publication NPC-300. This AAR is part of an Environmental Activity and Sector Registry (EASR) registration amendment for MECP. This report has been revised to address comments from the peer review report by Cambium Inc. dated May 21, 2025. The site plan for the BESS facility has been changed with the equipment being moved within the same property and points of reception for noise have been added for nearby vacant lots.

2 Site and Surrounding Area

The proposed BESS facility consists of 9 battery containers, 2 transformers, 5 Power Conversion System (PCS), and an electrical house for EMS panel and power panel. A site plan is provided in Appendix A. It is assumed that all equipment in the BESS facility may operate at any time during day or night.

The Site is located on the south side of Peggs Mountain Road between River Drive and Ferguson Road. The Site is currently zoned for industrial land use and there is an existing solar farm on site. The Site is surrounded by woods and grassland. The nearest noise sensitive land use is the residential properties along Peggs Mountain Road. An aerial image of the area is provided in Figure 1.

3 Critical Points of Reception

The critical Points of Reception (POR), where the noise impact is expected to be the greatest, occurs at the nearest noise sensitive land use such as residential properties. The nearest residential properties are along Peggs Mountain Road. Four nearest residences have been identified. The houses and their associated outdoor living area are considered as the critical noise receptors. They are listed in Table 1 and their locations are shown in Figure 1. The vacant lot at 223 Peggs Mountain Road and 3 vacant lots at 219 Peggs Mountain Road that will be severed from the property are included as points of reception.

Table 1. Critical Noise Receptors for Stationary Noise Sources

Receptor ID	Receptor Location	Receptor Height (m)
POR1	Bungalow at 221 Peggs Mountain Road	1.5
OLA1	Backyard of POR1, south of the bungalow	1.5
POR2	House at 135 Peggs Mountain Road	4.5
OLA2	Side yard of POR2, west of the house	1.5
POR3	House at 190 Peggs Mountain Road	4.5
OLA3	Front yard of POR3	1.5
POR4	Bungalow at 176 Peggs Mountain Road	1.5
OLA4	Front yard of POR4	1.5
POR5	219 Peggs Mountain Road Vacant Lot 1	4.5
POR6	219 Peggs Mountain Road Vacant Lot 2	4.5
POR7	219 Peggs Mountain Road Vacant Lot 3	4.5

Receptor ID	Receptor Location	Receptor Height (m)
POR8	223 Peggs Mountain Road Vacant Lot	4.5

4 Stationary Noise Sources

EXP understands that ELVO Flex energy storage system will be used in the proposed BESS facility. Significant stationary noise sources associated with a battery container include an HVAC on top of the container, PCS and UPS on the side of the container. Other stationary noise sources in the BESS facility include transformers and stand-alone PCS. The significant stationary noise sources are listed in Table 2 and their locations shown in Figure 2. Sound data of the noise sources associated the battery container have been obtained from an Occupational Noise Exposure Test Report dated December 19, 2023 and prepared by Mecanum Inc. Sound levels of the transformers were provided by EVLO Energy Storage Inc. It is assumed that the sound level of each transformer was measured in accordance with ANSI Standard C57.12.90. Sound data are provided in Appendix B. The sound power levels of all significant stationary noise sources based on sound pressure levels measured at specific distances are listed in Table 2. As noise from transformers is often tonal, a tonal penalty of 5 dB is added to the sound power level.

According to Schedule A in a Confirmation of Registration to MECP dated April 4, 2018 for the existing solar farm (Registration Number R-006-3110402578) in the same property as the BESS facility, there are 13 inverters and 1 transformer in the solar facility. All of them have a sound power level less than 65 dBA. An AAR was not prepared. Therefore, it is concluded that there is no significant stationary noise source associated with the existing solar farm.

Table 2. Noise Source Summary Table

Source ID	Source Description	Sound Power Level (dBA)	Source Location	Sound Attributes	Noise Control
HVAC_condenser1	HVAC ventilation grille for condenser coil	74	Outdoor	Steady	None
HVAC_condenser2	HVAC ventilation grille for condenser coil	74	Outdoor	Steady	None
HVAC_condenser3	HVAC ventilation grille for condenser coil	74	Outdoor	Steady	None
HVAC_condenser4	HVAC ventilation grille for condenser coil	74	Outdoor	Steady	None
HVAC_condenser5	HVAC ventilation grille for condenser coil	74	Outdoor	Steady	None
HVAC_condenser6	HVAC ventilation grille for condenser coil	74	Outdoor	Steady	None
HVAC_condenser7	HVAC ventilation grille for condenser coil	74	Outdoor	Steady	None
HVAC_condenser8	HVAC ventilation grille for condenser coil	74	Outdoor	Steady	None
HVAC_condenser9	HVAC ventilation grille for condenser coil	74	Outdoor	Steady	None

Source ID	Source Description	Sound Power Level (dBA)	Source Location	Sound Attributes	Noise Control
HVAC_hood1	HVAC ventilation grille and economizer hood	79	Outdoor	Steady	None
HVAC_hood2	HVAC ventilation grille and economizer hood	79	Outdoor	Steady	None
HVAC_hood3	HVAC ventilation grille and economizer hood	79	Outdoor	Steady	None
HVAC_hood4	HVAC ventilation grille and economizer hood	79	Outdoor	Steady	None
HVAC_hood5	HVAC ventilation grille and economizer hood	79	Outdoor	Steady	None
HVAC_hood6	HVAC ventilation grille and economizer hood	79	Outdoor	Steady	None
HVAC_hood7	HVAC ventilation grille and economizer hood	79	Outdoor	Steady	None
HVAC_hood8	HVAC ventilation grille and economizer hood	79	Outdoor	Steady	None
HVAC_hood9	HVAC ventilation grille and economizer hood	79	Outdoor	Steady	None
PCS1	PCS on the side of container	76	Outdoor	Steady	None
PCS2	PCS on the side of container	76	Outdoor	Steady	None
PCS3	PCS on the side of container	76	Outdoor	Steady	None
PCS4	PCS on the side of container	76	Outdoor	Steady	None
PCS5	PCS on the side of container	76	Outdoor	Steady	None
PCS6	PCS on the side of container	76	Outdoor	Steady	None
PCS7	PCS on the side of container	76	Outdoor	Steady	None
PCS8	PCS on the side of container	76	Outdoor	Steady	None
PCS9	PCS on the side of container	76	Outdoor	Steady	None
PCS10	Stand-alone PCS	76	Outdoor	Steady	None
PCS11	Stand-alone PCS	76	Outdoor	Steady	None
PCS12	Stand-alone PCS	76	Outdoor	Steady	None
PCS13	Stand-alone PCS	76	Outdoor	Steady	None
PCS14	Stand-alone PCS	76	Outdoor	Steady	None
UPS1	UPS on the side of containers	71	Outdoor	Steady	None
UPS2	UPS on the side of containers	71	Outdoor	Steady	None

Source ID	Source Description	Sound Power Level (dBA)	Source Location	Sound Attributes	Noise Control
UPS3	UPS on the side of containers	71	Outdoor	Steady	None
UPS4	UPS on the side of containers	71	Outdoor	Steady	None
UPS5	UPS on the side of containers	71	Outdoor	Steady	None
UPS6	UPS on the side of containers	71	Outdoor	Steady	None
UPS7	UPS on the side of containers	71	Outdoor	Steady	None
UPS8	UPS on the side of containers	71	Outdoor	Steady	None
UPS9	UPS on the side of containers	71	Outdoor	Steady	None
transformer_4MW	4 MW transformer	80*	Outdoor	Tonal	None
transformer_2MW	2 MW transformer	77*	Outdoor	Tonal	None

*Tonal penalty of 5 dB has been added.

5 Noise Criteria

The guidelines for assessing the noise impact of noise generating facilities on noise sensitive land uses in Ontario are given in MECP Publication NPC-300, Environmental Noise Guideline, Stationary and Transportation Sources – Approval and Planning. It states that:

“For sound from a stationary source..., the sound level limit at a point of reception, expressed in terms of the One Hour Equivalent Sound Level (Leq) is the higher of the applicable exclusion limit value given in Table 3, or the background sound level for that point of reception.”

The area is considered by EXP to be a Class 3 (Rural) Area. With 24 hours operation, the exclusionary sound level limits of 45 dBA for daytime; and 40 dBA for evening and night-time are used to assess compliance in this study.

Table 3. Exclusionary Limit Values of One-Hour Equivalent Sound Level for Class 3 (Rural) Area

Time Period	Plane of Window Point of Reception Leq(1hr) (dBA)	Outdoor Points of Reception Leq (1hr) (dBA)
Daytime (07:00 – 19:00)	45	45
Evening (19:00 – 23:00)	40	40
Night-time (23:00 – 07:00)	40	-

6 Predicted Sound Levels

Sound levels at the critical noise receptors due to the BESS facility were calculated using the software CadnaA in accordance with the methods described in ISO-9613-2 and the sound power levels listed in Table 2. The ground absorption is assumed to

be 0.8 except for roads where the ground absorption is taken to be 0.1. Topography has been included in the calculation. The worst-case scenario is assumed in the acoustic model, which is when all noise sources operate at the same time for a full hour during evening and night-time periods. The calculated unmitigated sound levels are summarised in Table 4a, Table 4b and Table 4c. The Acoustic Assessment Summary for unmitigated sound levels is provided in Table 5. CadnaA calculation output sheets are provided in Appendix C. The calculated unmitigated sound levels meet the exclusionary sound level limit at all critical noise receptors.

Table 4a. Point of Reception Noise Impact Table

Source ID	POR1		OLA1		POR2		OLA2	
	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)
HVAC_condenser1	329	9.3	296	7.4	426	4.3	401	4.5
HVAC_condenser2	327	6.4	298	7.3	433	4.2	407	4.4
HVAC_condenser3	323	9.4	292	10.4	412	4.6	387	4.9
HVAC_condenser4	325	9.3	294	10.3	418	4.5	393	4.7
HVAC_condenser5	331	6.3	300	7.2	422	4.4	397	4.6
HVAC_condenser6	333	6.3	302	7.2	428	4.2	403	4.4
HVAC_condenser7	328	9.3	297	10.2	408	4.7	383	4.9
HVAC_condenser8	337	6.2	306	7.1	417	4.5	392	4.7
HVAC_condenser9	338	6.1	307	7.0	423	4.4	399	4.6
HVAC_hood1	328	11.1	297	12.0	427	9.0	401	9.2
HVAC_hood2	327	11.1	296	12.1	432	8.9	407	9.1
HVAC_hood3	325	14.0	294	15.0	413	9.3	387	9.5
HVAC_hood4	324	14.1	293	15.0	418	9.2	392	9.4
HVAC_hood5	333	11.0	302	11.9	423	9.1	398	9.3
HVAC_hood6	331	11.0	300	11.9	428	9.0	403	9.2
HVAC_hood7	329	13.9	299	12.0	408	9.4	384	9.6
HVAC_hood8	338	10.8	307	11.7	417	9.2	393	9.4
HVAC_hood9	337	10.8	306	11.8	423	9.1	398	9.3
PCS1	326	7.0	295	7.9	428	4.8	402	4.9
PCS2	330	6.8	299	7.6	431	4.7	406	4.6
PCS3	322	7.2	291	8.2	413	5.2	388	5.3
PCS4	327	7.0	296	7.9	417	5.1	392	5.0
PCS5	330	6.8	299	7.7	424	4.9	398	4.8
PCS6	334	6.6	303	7.4	427	4.8	402	4.8
PCS7	326	7.0	295	8.0	409	5.3	384	5.3

Source ID	POR1		OLA1		POR2		OLA2	
	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)
PCS8	335	6.6	304	7.3	418	5.0	394	5.0
PCS9	340	6.3	309	7.0	422	4.9	398	4.9
PCS10	318	7.4	287	8.4	420	5.0	394	5.2
PCS11	319	7.3	288	8.4	422	5.0	396	5.1
PCS12	322	7.1	291	8.1	436	4.6	410	4.7
PCS13	323	7.1	293	8.0	437	4.6	411	4.6
PCS14	325	7.0	294	7.9	438	4.6	412	4.6
UPS1	324	2.4	293	3.3	429	0.1	403	0.2
UPS2	331	2.0	300	2.8	430	0.1	405	-0.1
UPS3	321	2.6	290	3.6	414	0.5	389	0.6
UPS4	328	2.3	297	3.2	416	0.4	391	0.5
UPS5	328	2.2	298	3.1	425	0.2	399	0.1
UPS6	335	1.8	304	2.6	426	0.1	401	0.1
UPS7	325	2.4	294	3.3	410	0.6	385	0.6
UPS8	334	1.9	303	2.7	419	0.3	394	0.3
UPS9	341	1.5	310	2.2	421	0.3	397	0.2
transformer_4MW	320	12.8	289	13.7	434	10.2	408	10.6
transformer_2MW	316	9.9	285	10.9	419	7.6	393	7.9

Table 4b. Point of Reception Noise Impact Table

Source ID	POR3		OLA3		POR4		OLA4	
	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)
HVAC_condenser1	400	9.7	385	8.3	417	7.6	397	8.0
HVAC_condenser2	405	9.6	389	8.2	422	7.5	402	7.9
HVAC_condenser3	392	9.9	376	8.5	407	7.8	387	8.3
HVAC_condenser4	396	9.8	380	8.4	411	7.7	392	8.2
HVAC_condenser5	402	9.7	386	8.3	417	7.5	397	8.0
HVAC_condenser6	406	9.6	390	8.2	422	7.4	402	7.9
HVAC_condenser7	393	9.9	378	8.5	408	7.8	388	8.3

Source ID	POR3		OLA3		POR4		OLA4	
	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)
HVAC_condenser8	404	9.6	388	5.1	418	4.4	398	4.8
HVAC_condenser9	408	9.5	392	5.0	423	4.3	403	4.7
HVAC_hood1	402	14.4	387	13.0	418	12.2	398	12.7
HVAC_hood2	403	14.3	388	12.9	420	12.2	401	12.7
HVAC_hood3	393	14.6	378	13.2	408	12.5	388	13.0
HVAC_hood4	394	14.6	379	13.2	410	12.4	390	12.9
HVAC_hood5	403	14.4	388	12.9	419	12.2	399	12.7
HVAC_hood6	404	14.3	389	12.9	421	12.2	401	12.7
HVAC_hood7	394	14.6	379	13.2	409	12.4	389	12.9
HVAC_hood8	405	14.3	390	9.7	420	9.1	400	9.5
HVAC_hood9	406	14.3	391	9.7	421	9.0	401	9.5
PCS1	400	5.5	385	5.5	417	4.7	397	5.2
PCS2	405	5.4	390	5.3	422	4.5	402	5.0
PCS3	391	5.8	376	5.7	407	4.9	387	5.5
PCS4	396	5.6	381	5.6	412	4.8	392	5.3
PCS5	401	5.5	386	5.5	417	4.6	397	5.2
PCS6	406	5.4	391	5.3	422	4.5	402	5.0
PCS7	393	5.7	377	5.7	407	4.9	387	5.4
PCS8	403	5.5	388	5.4	418	4.6	398	5.1
PCS9	408	5.3	393	5.2	423	4.5	403	5.0
PCS10	391	5.8	376	5.7	408	4.9	388	5.4
PCS11	393	5.7	377	5.7	409	4.9	389	5.4
PCS12	401	5.5	386	5.5	419	4.6	399	5.1
PCS13	403	5.5	388	5.4	420	4.6	401	5.1
PCS14	404	5.4	389	5.4	422	4.5	402	5.0
UPS1	400	0.8	385	0.8	417	0.0	397	0.5
UPS2	405	0.7	390	0.6	422	-0.2	402	0.3
UPS3	391	1.1	375	1.1	407	0.2	387	0.8
UPS4	396	0.9	381	0.9	412	0.1	392	0.6
UPS5	401	0.8	386	0.8	417	0.0	397	0.5

Source ID	POR3		OLA3		POR4		OLA4	
	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)
UPS6	406	0.7	391	0.6	422	0.0	402	0.3
UPS7	392	1.0	377	1.0	407	0.2	387	0.7
UPS8	403	0.8	387	0.7	418	0.0	398	0.4
UPS9	408	0.6	393	0.5	423	0.0	403	0.3
transformer_4MW	399	11.0	383	11.2	416	10.4	397	10.9
transformer_2MW	389	8.2	374	8.4	406	7.7	386	8.1

Table 4c. Point of Reception Noise Impact Table

Source ID	POR5		POR6		POR7		POR8	
	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)
HVAC_condenser1	249	14.0	254	13.8	281	8.3	278	8.3
HVAC_condenser2	254	13.8	260	9.0	287	8.1	278	8.3
HVAC_condenser3	239	14.4	242	14.2	267	8.7	280	12.9
HVAC_condenser4	243	14.2	248	14.0	273	8.5	280	8.3
HVAC_condenser5	249	14.0	253	9.2	278	8.4	284	8.1
HVAC_condenser6	254	9.2	259	9.0	284	8.2	284	8.1
HVAC_condenser7	239	14.3	241	14.3	265	8.8	287	8.0
HVAC_condenser8	250	9.3	252	9.3	275	8.5	293	7.9
HVAC_condenser9	254	9.2	257	9.1	281	8.3	292	7.9
HVAC_hood1	250	18.6	255	18.4	282	12.9	280	13.0
HVAC_hood2	253	18.5	259	18.3	286	12.8	276	13.1
HVAC_hood3	240	19.0	243	18.9	268	13.4	282	12.9
HVAC_hood4	242	18.9	247	18.8	273	13.2	278	13.0
HVAC_hood5	251	14.0	254	13.9	279	13.0	286	12.8
HVAC_hood6	253	13.9	258	13.8	283	12.9	282	12.9
HVAC_hood7	241	19.0	242	18.9	266	13.5	288	12.7
HVAC_hood8	251	14.0	253	14.0	276	13.1	294	12.5
HVAC_hood9	253	13.9	256	13.8	280	13.0	291	12.6
PCS1	249	10.3	255	10.1	282	9.0	276	8.8

Source ID	POR5		POR6		POR7		POR8	
	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)	Distance (m)	Sound Level (dBA)
PCS2	254	10.0	260	9.8	286	8.7	280	8.5
PCS3	238	10.8	242	10.6	268	9.5	278	9.1
PCS4	244	10.5	247	10.4	272	9.2	282	8.8
PCS5	249	10.2	253	10.1	279	8.9	282	8.5
PCS6	254	9.9	258	9.8	283	8.5	286	8.2
PCS7	239	10.7	241	10.6	266	9.4	285	8.8
PCS8	250	10.0	252	10.0	276	8.5	291	8.1
PCS9	255	9.7	257	9.7	280	8.1	294	7.8
PCS10	240	10.7	246	10.5	274	9.4	271	9.4
PCS11	241	10.7	248	10.4	275	9.3	272	9.3
PCS12	252	10.2	260	9.9	288	8.8	269	9.1
PCS13	253	10.2	261	9.9	289	8.8	270	9.0
PCS14	254	10.1	262	9.8	291	8.7	271	8.9
UPS1	249	5.6	255	5.4	282	4.3	275	4.2
UPS2	254	5.3	259	5.1	285	3.9	281	3.7
UPS3	238	6.1	243	5.9	269	4.8	277	4.4
UPS4	244	5.8	247	5.6	272	4.5	283	4.0
UPS5	249	5.5	254	5.4	280	4.2	281	3.9
UPS6	254	5.2	258	5.1	283	3.8	288	3.4
UPS7	239	6.0	242	5.9	266	4.7	283	4.2
UPS8	250	5.4	252	5.3	276	3.9	289	3.5
UPS9	255	5.0	256	5.0	280	3.3	296	3.1
transformer_4MW	249	15.4	257	15.1	286	14.1	268	14.5
transformer_2MW	238	12.8	244	12.6	271	11.6	270	11.6

Table 5. Acoustic Assessment Summary

Receptor ID	Calculated Unmitigated Sound Level (dBA)		Verified by Acoustic Audit	Performance Limit (dBA)		Compliance?
	Day	Evening/Night		Day	Evening/Night	
POR1	28	28	No	45	40	Yes

Receptor ID	Calculated Unmitigated Sound Level (dBA)		Verified by Acoustic Audit	Performance Limit (dBA)		Compliance?
	Day	Evening/Night		Day	Evening/Night	
OLA1	29	29	No	45	40	Yes
POR2	26	26	No	45	40	Yes
OLA2	25	25	No	45	40	Yes
POR3	28	28	No	45	40	Yes
OLA3	27	27	No	45	40	Yes
POR4	26	26	No	45	40	Yes
OLA4	27	27	No	45	40	Yes
POR5	30	30	No	45	40	Yes
POR6	29	29	No	45	40	Yes
POR7	26	26	No	45	40	Yes
POR8	26	26	No	45	40	Yes

7 Conclusions

A noise assessment was conducted for the BESS facility at 219 Peggs Mountain Road in Burl's Falls, Ontario. The stationary noise sources associated with the BESS facility include HVAC, PCS and UPS for battery containers, stand-alone PCS and transformers. The sound level limits are met at all critical noise receptors.

8 General Limitations

The information and conclusions in this report are considered to be privileged and confidential and have been prepared exclusively for Solarbank Corp. The purpose of this report is to provide Solarbank Corp with an assessment of the potential noise impacts from a BESS facility to noise sensitive land use surrounding the Site.

The information presented in this report is based on information provided by others and visual observations as identified herein. Achieving the objectives stated in this report has required us to arrive at conclusions based upon the best information presently known to us. No investigative method can completely eliminate the possibility of obtaining partially imprecise or incomplete information; it can only reduce the possibility to an acceptable level. Professional judgment was exercised in gathering and analyzing the information obtained and in the formulation of the conclusions. Like all professional persons rendering advice, we do not act as absolute insurers of the conclusions we reach, but we commit ourselves to care and competence in reaching those conclusions.

Any use which a third party makes of this report, or any part thereof, or any reliance on or decisions to be made based on it, are the responsibility of such third parties. EXP accepts no responsibility for damages, if any, suffered by any third party as a result of decisions made or actions based on this report.

Noise levels at various times may differ from those assessed. In addition, any changes to the proposed design or introduction of new processes and/or sources may render the conclusions of this report inaccurate or invalid. In the event of any such


changes, EXP should be contacted to re-evaluate the conditions within the assessed areas and make appropriate revisions to the original conclusions of this report.

8.1 Closure

We trust this report is satisfactory for your purposes. Should you have any questions, please do not hesitate to contact this office.

Yours truly,

EXP Services Inc.

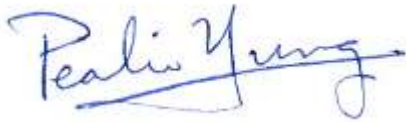

Pearlie Yung, M.Sc., P.Eng.
Senior Acoustic Engineer
Environmental Services



Ron Taylor, M.Sc., C.Chem., CIH
Discipline Lead, Air Quality & Industrial Hygiene
Environmental Services

9 References

- MECP Publication NPC-300. 2013. Environmental Noise Guideline, Stationary and Transportation Sources – Approval and Planning.
- ANSI Standard C57.12.90. 1987. Standard Test Code for Liquid-Immersed Distribution, Power, and Regulating Transformers and Guide for Short-circuit Testing of Distribution and Power Transformers.
- ISO-9613-2:1996. Acoustics – Attenuation of Sound During Propagation Outdoors – Part 2: General Method of Calculation.

Figures

Figure 1 – Aerial Image and Locations of Noise Receptors

Figure 2 – Locations of Noise Sources



Figure 1 Aerial Image and Locations of Noise Receptors




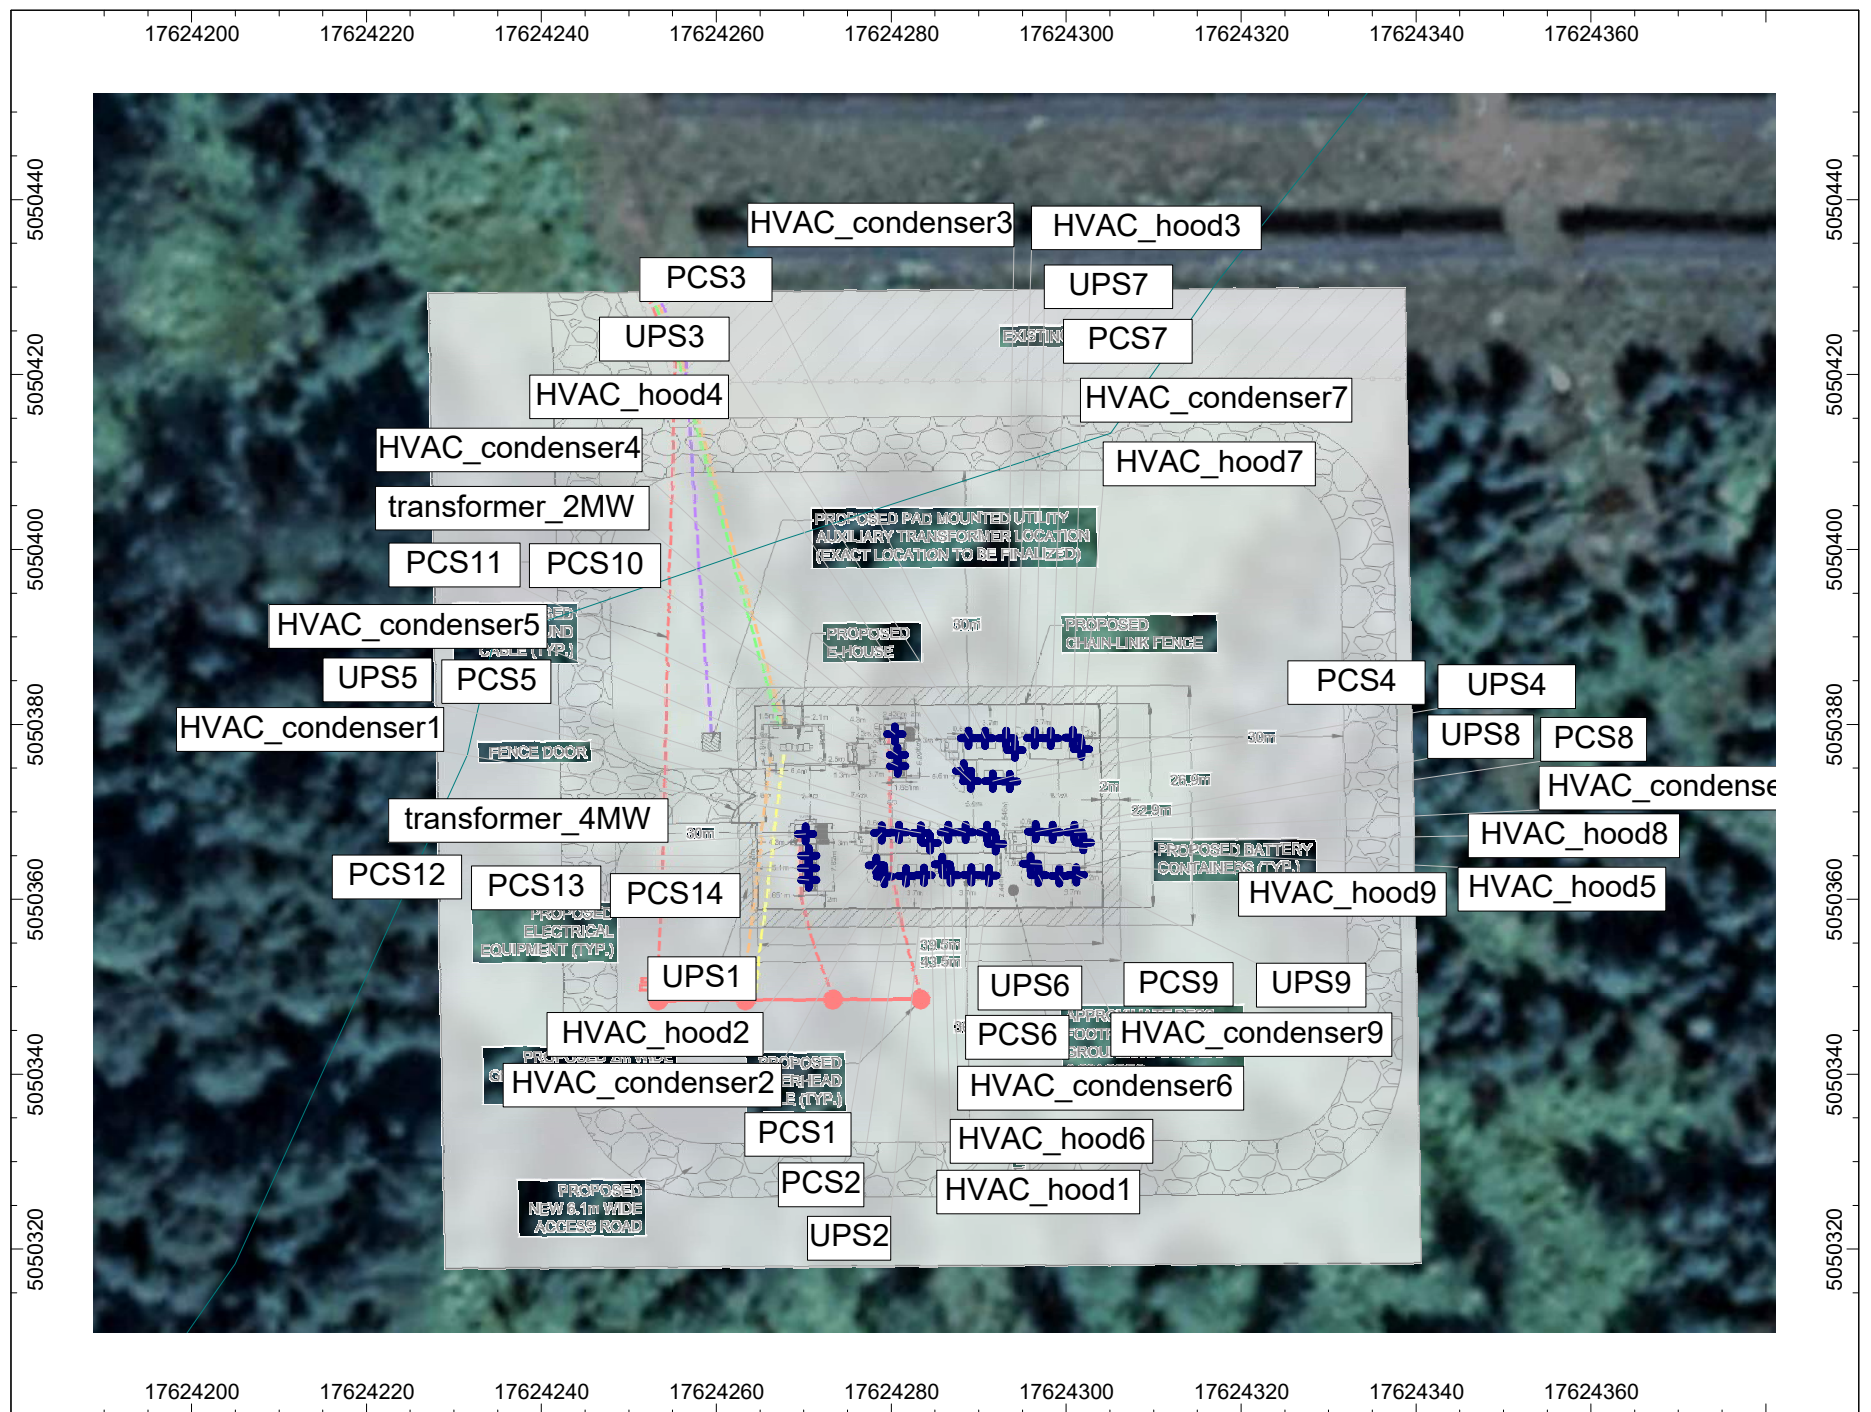


Figure 2 Locations of Noise Sources

Appendix A – Site Plan

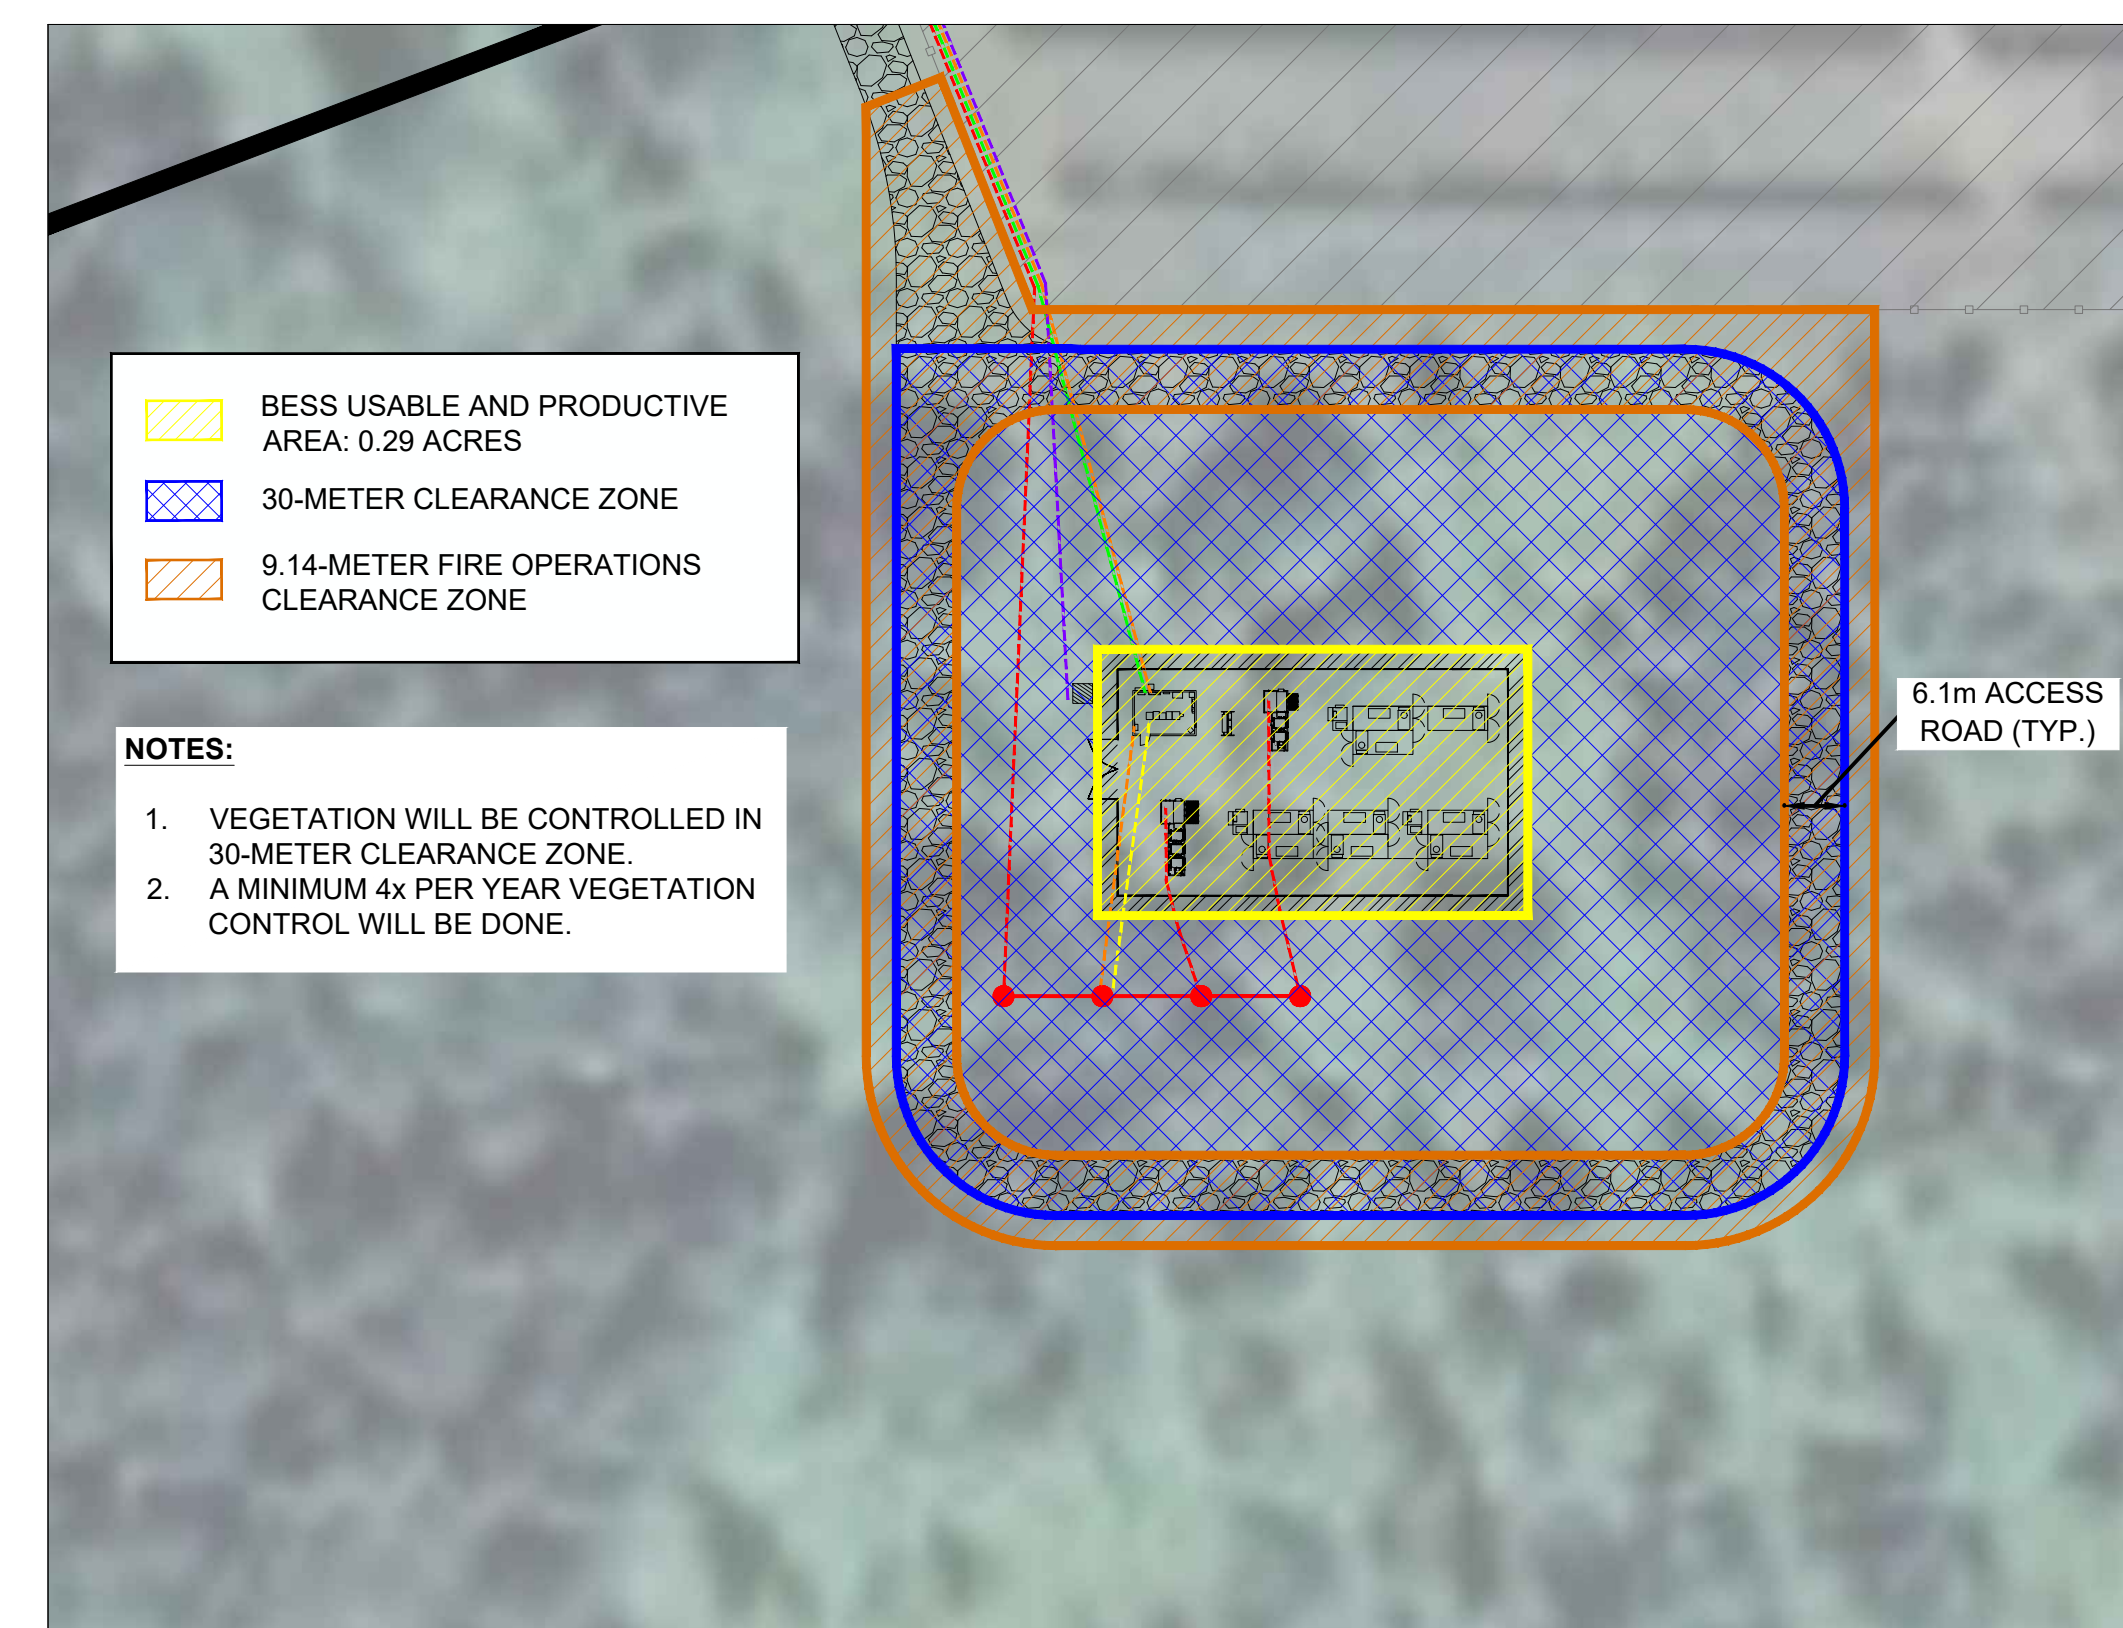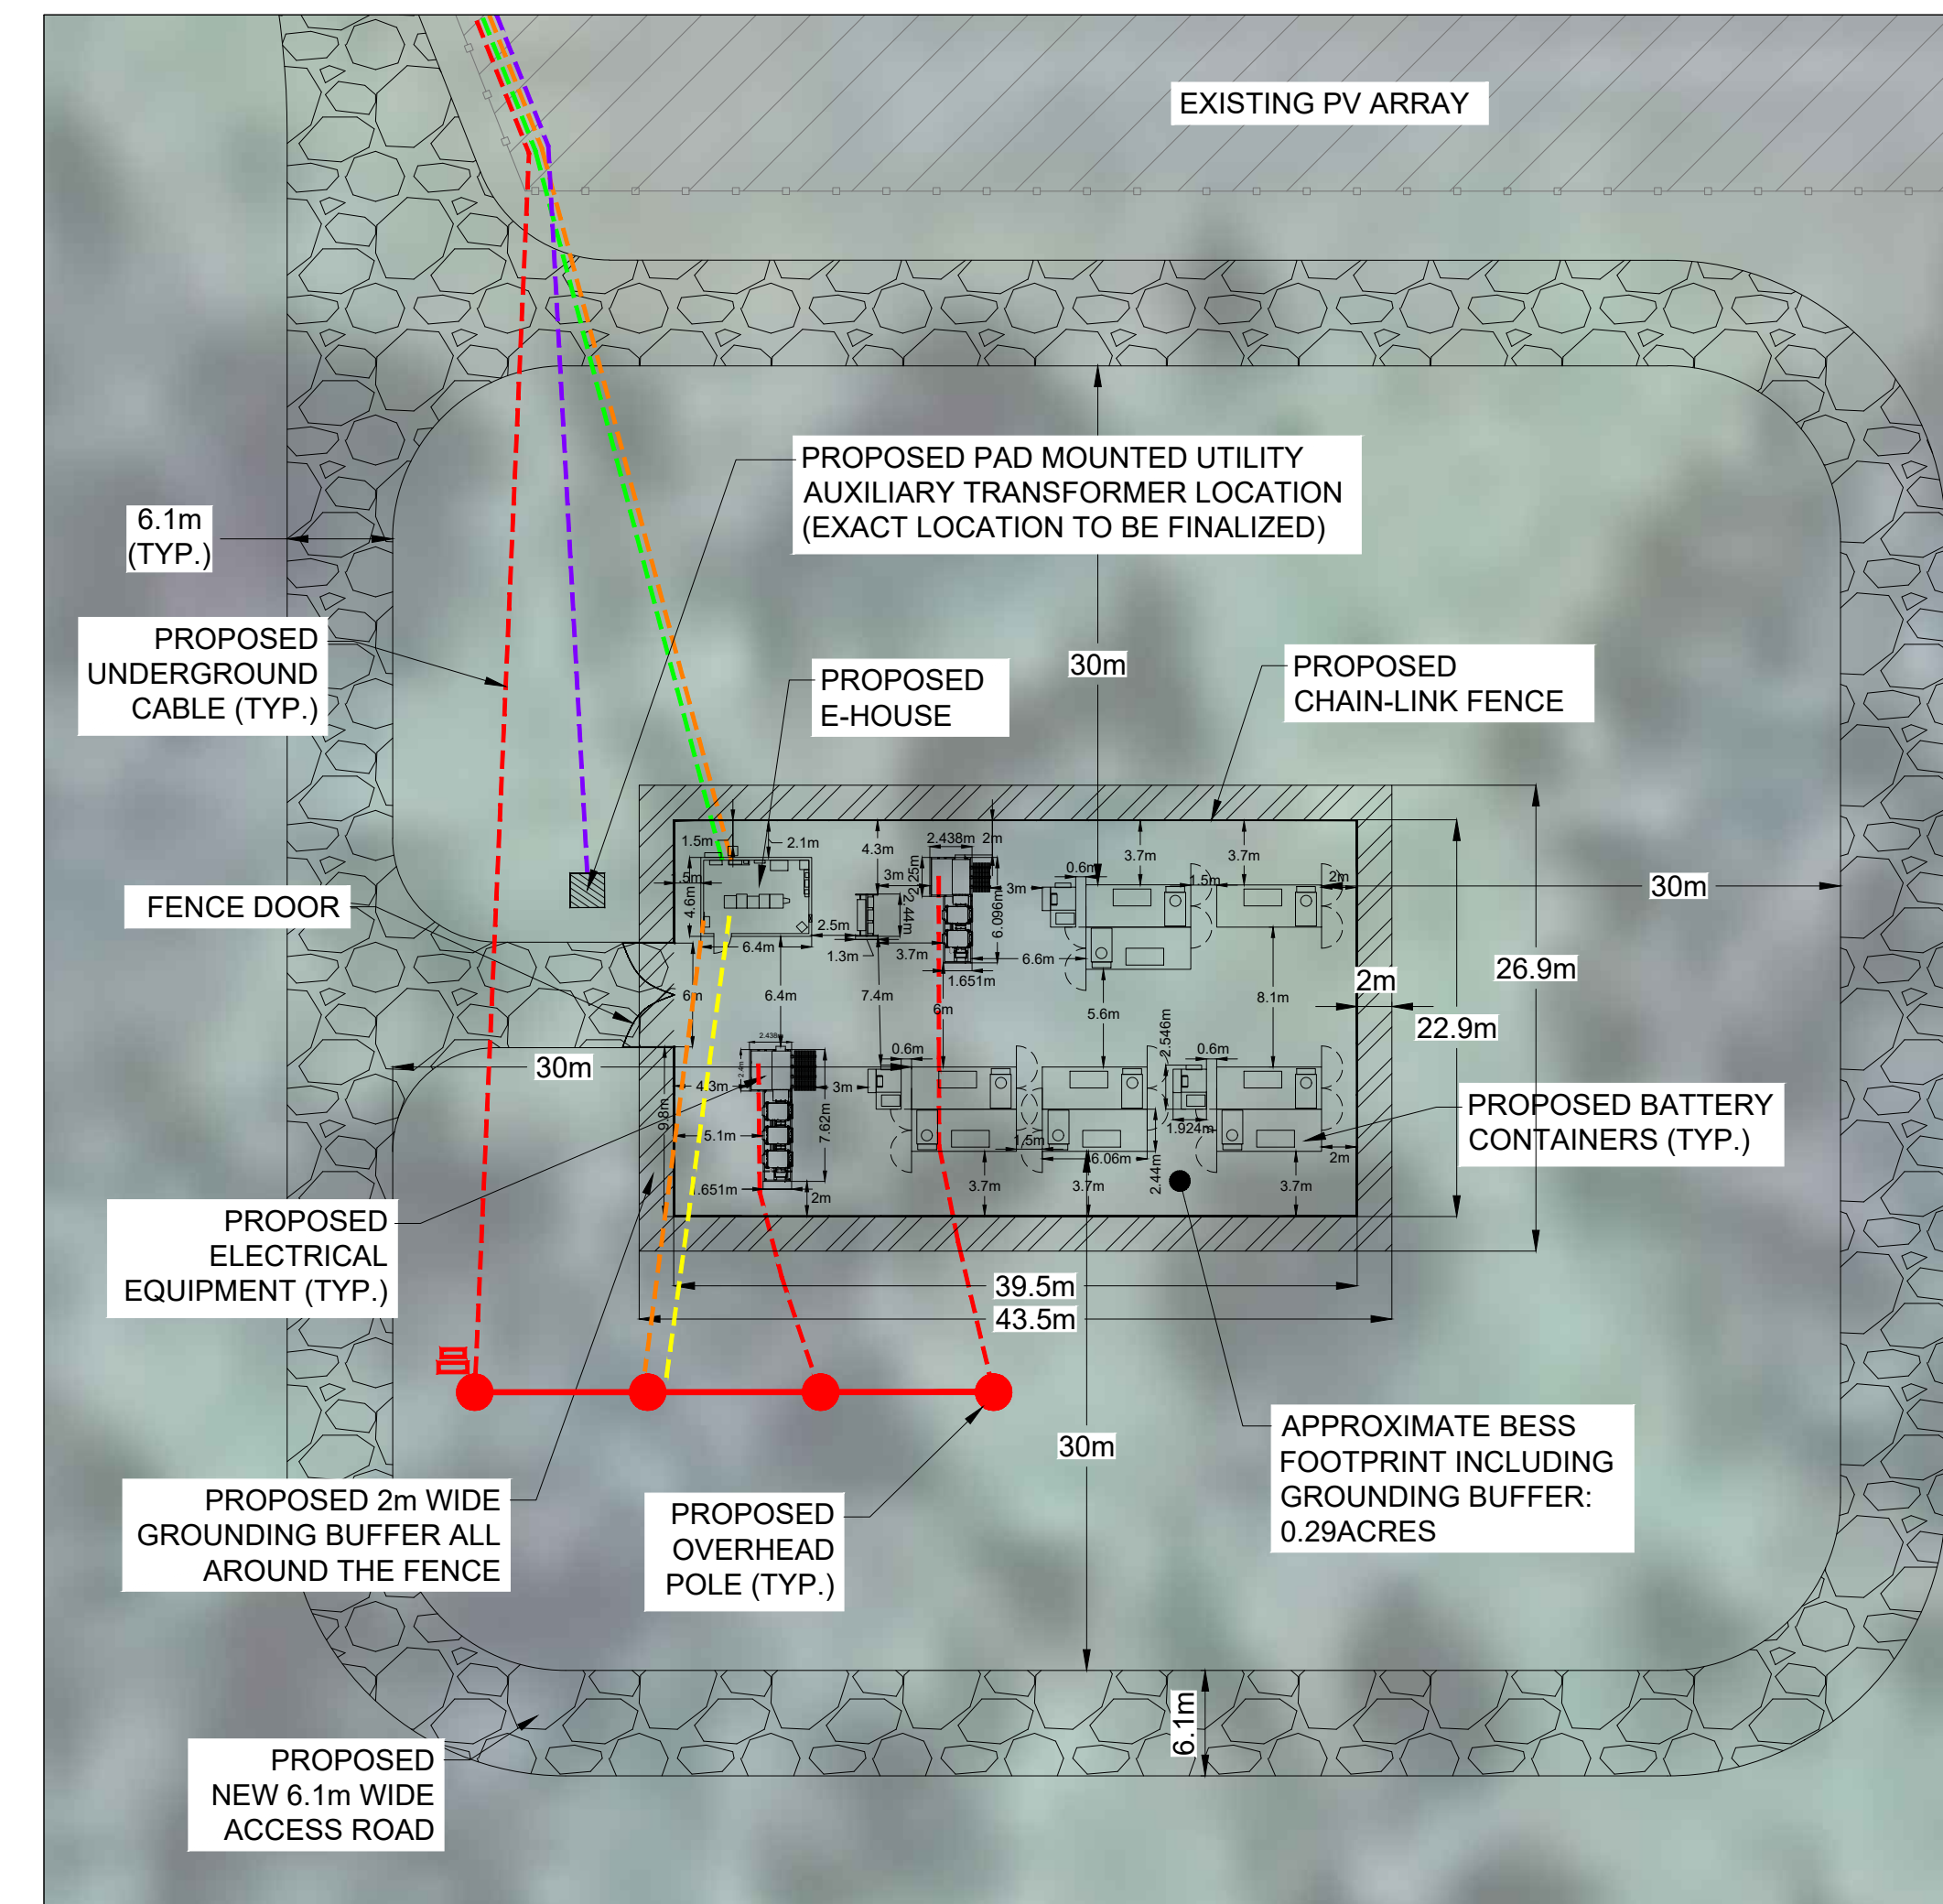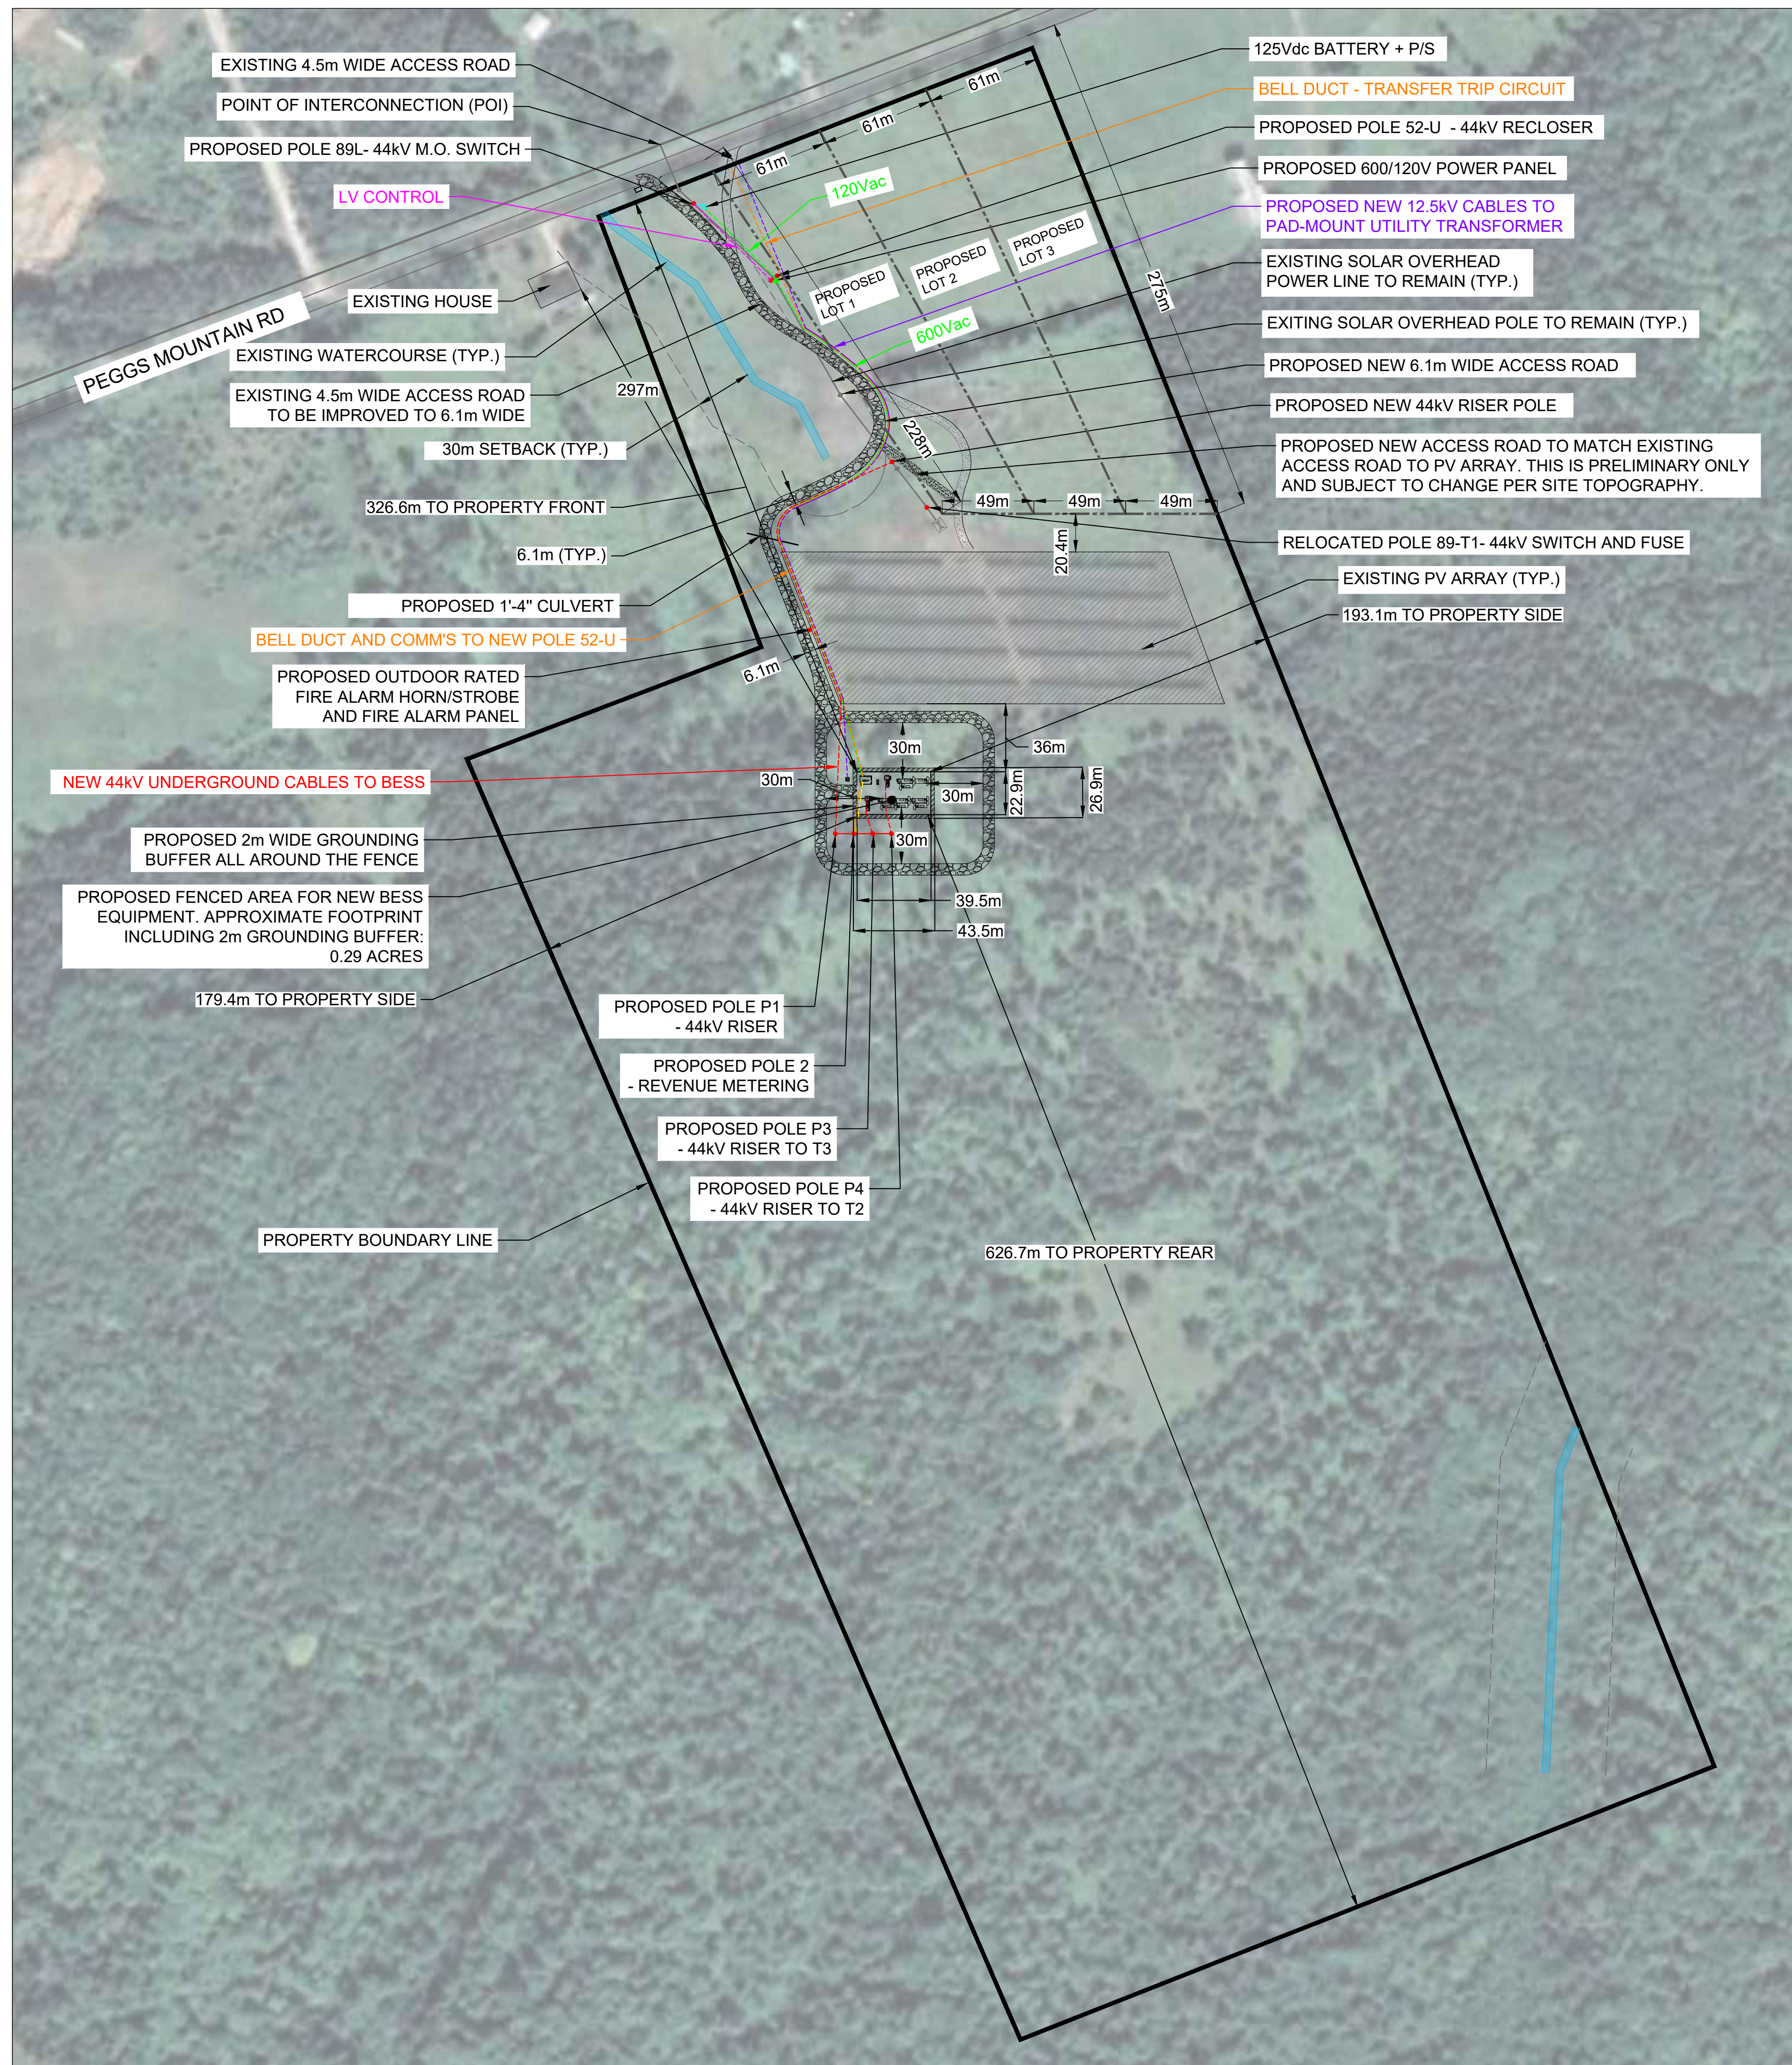

Suite 803, 505 Consumer Road,
North York M2J 4V8
T: 416 494 9559
www.solarbankcorp.com

ISSUE STAGE:

PERMIT

THIS DRAWING IS AN INSTRUMENT OF SERVICE, IS PROVIDED BY AND IS THE PROPERTY OF ABUNDANT SOLAR ENERGY INC. THIS DRAWING CANNOT BE MODIFIED AND/OR REPRODUCED WITHOUT THE CONSENT OF THIS OFFICE

ENGINEER'S SEAL

FOR PRELIMINARY ONLY
AND NOT FOR CONSTRUCTION

REV#	DESCRIPTION	DATE	D.B.	C.B.
06	ISSUED FOR PERMIT	2024-11-28	S.Z.	H.R.
05	ISSUED FOR REVIEW	2024-11-14	S.Z.	H.R.
04	ISSUED FOR REVIEW	2024-03-04	S.Z.	M.S.
03	ISSUED FOR REVIEW	2024-02-21	S.Z.	M.S.
02	ISSUED FOR REVIEW	2024-01-16	S.Z.	S.X.
01	ISSUED FOR CONSENT APPLICATION	2023-12-21	S.Z.	S.X.
00	ISSUED FOR CIA	2023-07-28	S.Z.	S.X.

DRAWING NAME:
SITE PLAN

DRAWN BY:
S.Z.

CHECKED BY:
H.R.

SCALE: AS NOTED	DATE: 2024-11-28
--------------------	---------------------

PROJECT ADDRESS:
903
219 PEGGS MOUNTAIN ROAD,
ARMOUR, ONTARIO, P0A 1C0

PROJECT NO.:
E-LT1-903

DRAWING NO:
E-1

REV. NO:
06

Appendix B – Equipment Sound Data

Pearlie Yung

From: Mila Simon <mila.simon@solarbankcorp.com>
Sent: Friday, March 15, 2024 4:34 PM
To: Pearlie Yung; Matt McGregor
Cc: Andrew van Doorn; Dennis Stainton; Justin Lam; Robyn Baspaly; Zenith Wong
Subject: RE: Ontario BESS Multi-Discipline Proposal

Follow Up Flag: Follow up
Flag Status: Flagged



CAUTION: This email originated from outside of the organization. Do not click links or open attachments unless you recognize the sender and know the content is safe.

Hi Pearlie,

Thank you for sending over. I have received the two below sheets from the transformer supplier. We are also following up with EVLO for an unlocked version of the document for their equipment.

THREE PHASE POWER TRANSFORMER				THREE PHASE POWER TRANSFORMER			
VOLTAGE RATING		RATED FREQUENCY		VOLTAGE RATING		RATED FREQUENCY	
H.V.	44,000 V DELTA	60Hz		H.V.	44,000 V DELTA	60Hz	
L.V.	690GPDY/398 V	K-FACTOR		L.V.	690GPDY/398 V	K-FACTOR	
INSULATION LEVEL(kV)		% IMPEDANCE		INSULATION LEVEL(kV)		% IMPEDANCE	
H.V. BL	250	H.V.-L.V.	7.50 %	H.V. BL	250	H.V.-L.V.	7.50 %
L.V. BL	30	A12,000 kVA		L.V. BL	30	A14,000 kVA	
L.VN. BL	30	SOUND LEVEL		L.VN. BL	30	SOUND LEVEL	
kVA RATING		2 MVA BASE		kVA RATING		4 MVA BASE	
KNAN		61 dB		KNAN		64 dB	
2,000		MATERIAL		4,000		MATERIAL	
CONDUCTOR		INSULATING OIL		CONDUCTOR		INSULATING OIL	
ALUMINUM		F33 VEGETABLE OIL		ALUMINUM		F33 VEGETABLE OIL	
POB FREE		POB FREE		POB FREE		POB FREE	
AMBIENT TEMPERATURE		TEMPERATURE RISE		AMBIENT TEMPERATURE		TEMPERATURE RISE	
MAX		OIL		MAX		OIL	
40°C		65°C		40°C		65°C	
MIN		WINDING		MIN		WINDING	
-40°C		65°C		-40°C		65°C	
WEIGHT		TEMPERATURE RISE		WEIGHT		TEMPERATURE RISE	
TOTAL		OIL		TOTAL		OIL	
9,490 kg		65°C		13,110 kg		65°C	
INSULATING OIL		WINDING		INSULATING OIL		WINDING	
3,050 L		65°C		4,040 L		65°C	

Best,
Mila

From: Pearlie Yung <Pearlie.Yung@exp.com>
Sent: Friday, March 15, 2024 3:38 PM

OCCUPATIONAL NOISE EXPOSURE TEST REPORT

For
EVLO Energy Storage Inc.

1804 Bd Lionel-Boulet, Varennes, Qc, J3X 1S1, Canada

Report NO°

R20231219-01

Type of measurement :	Occupational noise exposure certification (UL9540 / 29 CFR 1910.95)
Élément(s) testé(s) :	Energy Storage System (ESS) EVLO Flex
Date of report :	2023-12-19
Written by :	Jean-Philippe Regnard, B. Ing., MScA
Validate by :	Kevin Verdière, ing., Ph.D.  Signature : _____

Mecanum Inc.

2444 Rue Bonin, Sherbrooke (Qc) J1K 1C4, Canada

TEL: (819) 346-5666

FAX: 819-563-0649

E-mail: info@mecanum.com

Website: www.mecanum.com

Table of Contents

1 EXECUTIVE SUMMARY B

2 PROJECT OBJECTIVE 1

3 METHODOLOGY 1

4 MEASUREMENT RESULTS 5

5 CONCLUSION 6

6 REFERENCES 6

APPENDIX A 7

1 Executive Summary

Noise levels around one ESS EVLO Flex are below the permissible limit for worker noise exposure over an 8-hour period, i.e. 90 dBA.

Noise levels are also below 85 dBA over an 8-hour period, indicating that there's no need to set up a hearing conservation program for the workers.

One ESS EVLO Flex meets the requirements of the 29 CFR 1910.95 [1] and UL9540 [2] standards.

2 Project Objective

As part of the acoustic certification of the ESS EVLO Flex, Mecanum Inc. was mandated by EVLO to verify that workers' noise exposure was within the limits specified in 29 CFR 1910.95 [1], i.e. less than 85 dBA over an 8-hour period.

A unit of ESS EVLO Flex at Hydro-Québec's Varennes site is used for these tests. The measurements took place on Thursday December 7th, 2023.

3 Methodology

As described in 29 CFR 1910.95 standard, there are two ways to measure the sound pressure level used to determine the eight-hour time-weighted average sound level (TWA).

- Use a dosimeter that is placed on a worker working a normal shift.
- Use a sound level meter.

In the case of EVLO, there are no workers at the operating site on a normal basis. The presence of workers is occasional, for example during maintenance operations or breakdowns. Note that when a worker is working on a unit, the unit is turned off and therefore no noise is generated by it in the vicinity of the workers. Equipping one or several workers is therefore inadequate to assess the TWA.

The use of a sound level meter is more appropriate in this case for the following two reasons:

- ESS EVLO Flex 's different noise sources are all stable over time.
- There is no typical worker route in the area around and inside the ESS EVLO Flex.

For these reasons, 29 CFR 1910.95 standard states that TWA can be determined by measuring several fixed points in and around the area to be certified.

The sound level meter is placed at 1.6 meter above the ground, which is approximately the height of a human ear. As required by 29 CFR 1910.95 standard, the sound level meter is set to measure the sound pressure level in decibel with A-weighted and at a slow response.

The minimum measurement time is set at 30 consecutive seconds, but it has been extended to as close to one minute as possible. The variation in measurement time is due to passing vehicles and helicopter activity near the measurement site.

The measurement positions of the sound level meter are shown in Figure 1. Measurement points locations are concentrated near and in line with the different noise sources of the ESS EVLO Flex:

- HVAC model RAV090: There are three sources to consider (Figure 2): One ventilation grille (condenser coil) on the southwest side and two ventilations grilles on the northwest side (condenser coil and Economizer hood). Two measurement points (at 1 meter and 3 meter) are placed in the axis of the three ventilation grilles. These are pairs of points 3/4, 5/6 and 13/14 respectively in line with the southwest side condenser coil, the northwest side condenser coil, and the economizer hood (northwest side). For information, all three are intake zones.
- PCS: the northeast face of the PCS is the one which radiates noise. There is an intake grille in the center of this face, and a fan blowing outward on top of it (Figure 4). Measurement points 1 and 2 are in line with the face, at 1 meter and 3 meters respectively.

Other noise sources, designated as secondary because they are much less noisy, were also measured at a distance of 1 meter along the axis: the northeast face of the transformer, the southeast face of the UPS unit and the southwest face of the PCS at points 7, 9 and 10, respectively.

Concerning the others sound level meter's measurement positions, they were chosen on the test days to monitor noise levels in other, less critical areas. Given the levels measured (see Results section), it was not considered necessary to maximize this number of points.

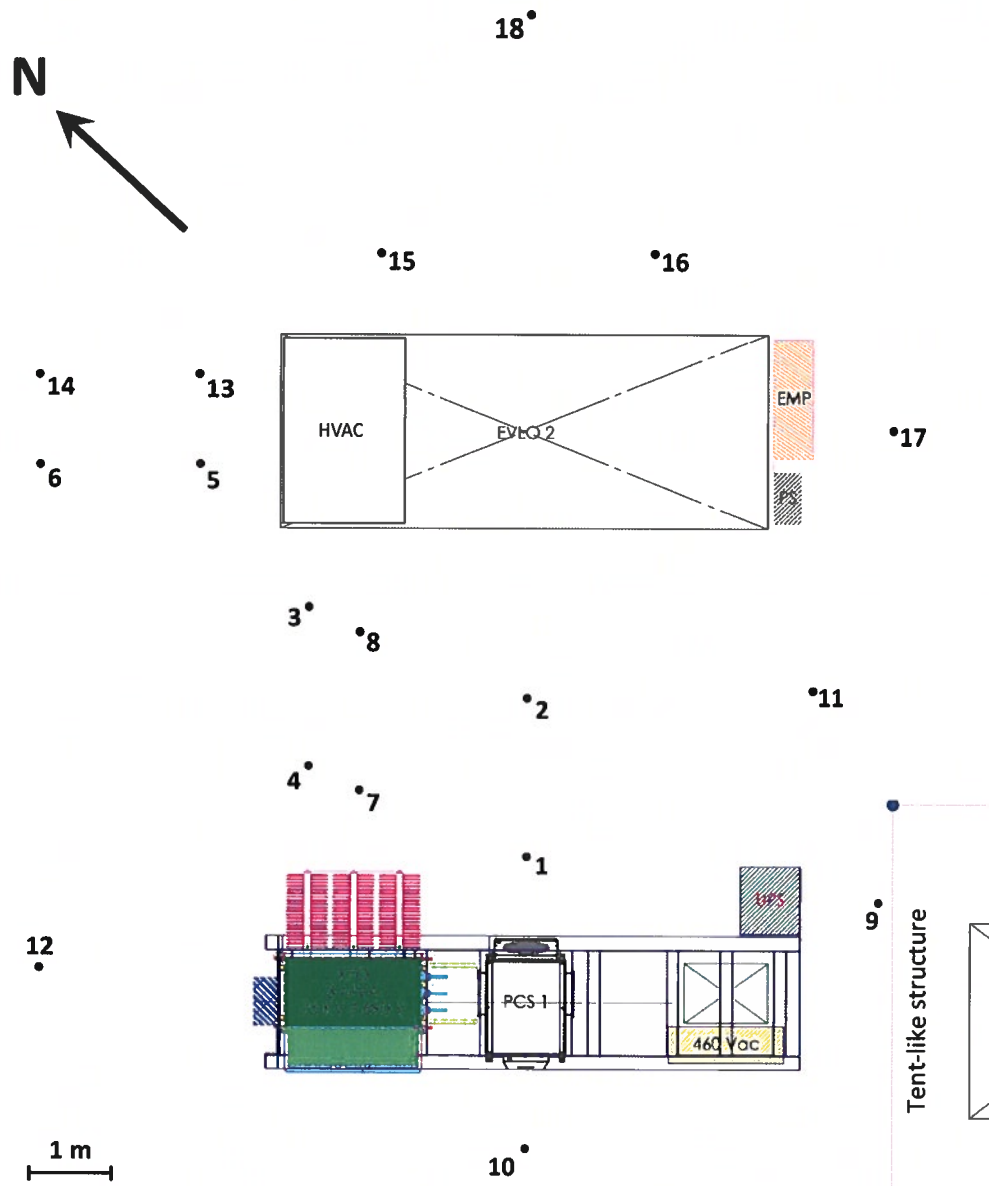


Figure 1 : Sound level meter measurement positions

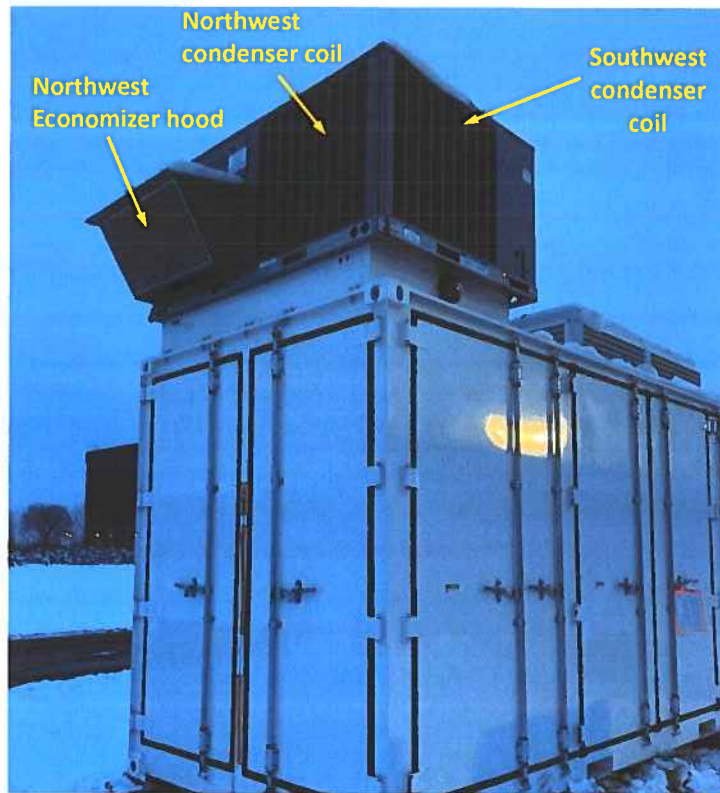


Figure 2 : HVAC noise sources

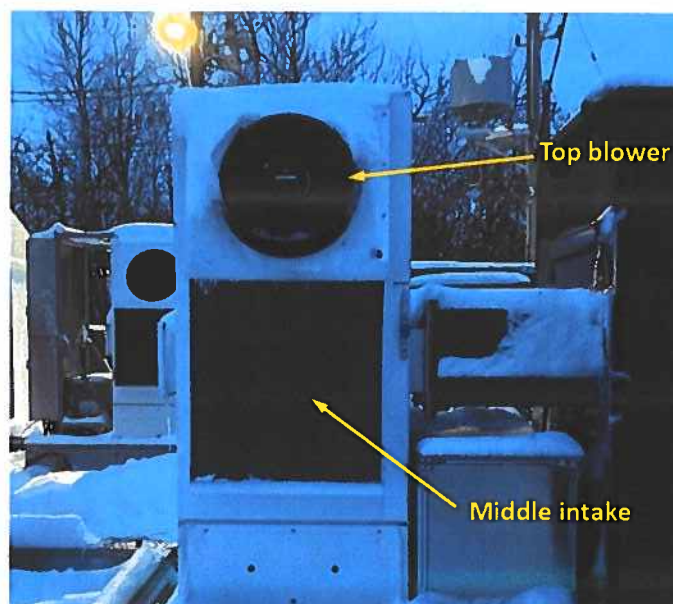


Figure 3 : PCS noise sources

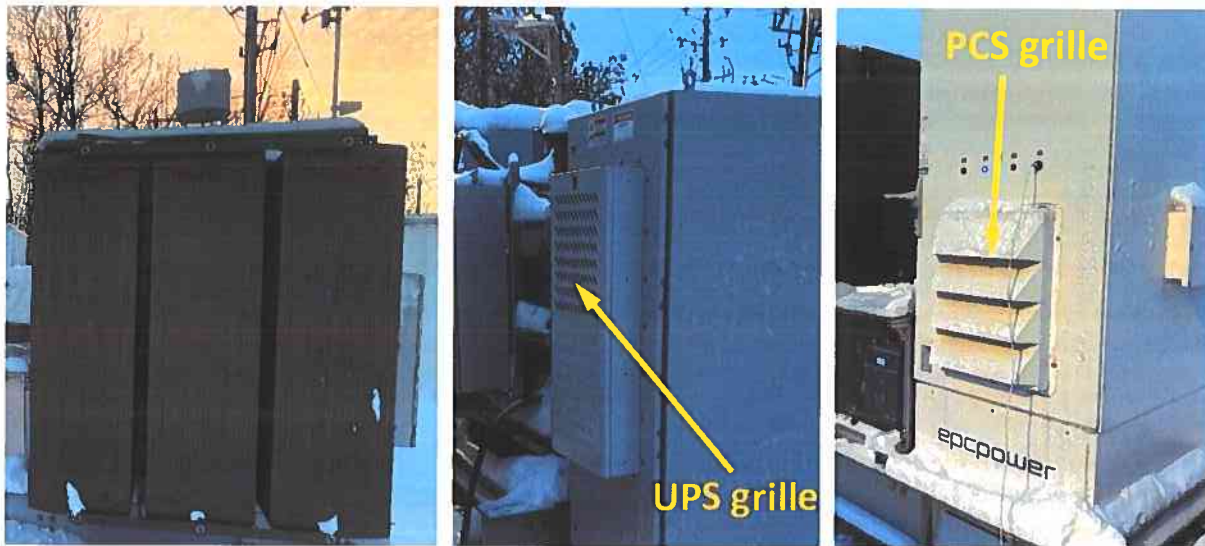


Figure 4 : Secondary noise sources; Transformer (left), UPS ventilation grille (middle) and PCS ventilation grille (right).

The equipment used for these tests meets the requirements of the UL9540 standards [2]. Measurement's equipment is tested annually by laboratories that meet the requirements of the ISO/IEC 17025. The concerned equipment is detailed in the Table 1. The annual calibration certificates for both equipment are presented in Appendix A.

Table 1 : Equipment used for the measurements.

Designation	Manufacturer	Model	Serial number
Sound level meter Class 1	Larson Davis	831C	11376
Sound calibrator Class 1	RION	NC-75	35192023

Measurements were taken on Thursday December 7th, 2023 between 3:30 pm and 5 pm. For the measurements, all the systems of the ESS EVLO Flex are configured at maximum operating level: HVAC with compressor on, PCS at 100%, and Economizer on (UPS and transformer always on).

4 Measurement Results

Table 2 shows the A-weighted sound level (TWA) measured at each measurement locations of Figure 1. Results show that for one ESS EVLO Flex for maximum operating level, there is no place where A-weighted sound level reach the limit of permissible noise exposure 90 dBA. In the same way, there is no place where A-weighted sound level reaches 85 dBA, the limit above which it is necessary to set up a program for monitoring workers' hearing (audiogram).

Table 2 : Measurement results (TWA), dose and maximal noise exposure calculation (Following 29 CFR 1910.95 standard).

Point de mesure	Measurement time (sec.)	A-weighted sound level TWA (dBA)	Dose for an unprotected worker over 8 hours (%)	Maximal unprotected exposure time (h)
1	69	70.7	6.9	116.2
2	66	64.8	3.0	263.2
3	64	61.1	1.8	439.6
4	66	62.8	2.3	347.3
5	42	67.1	4.2	191.3
6	62	66.9	4.1	196.7
7	68	62.7	2.3	352.1
6	70	61.4	1.9	421.7
9	54	66.0	3.6	222.9
10	67	62.2	2.1	347.3
11	53	60.7	1.7	464.6
12	45	57.9	1.2	685.0
13	33	67.5	4.4	181.0
14	70	67.5	4.4	181.0
15	32	58.0	1.2	675.6
16	34	53.5	0.6	1260.7
17	51	56.0	0.9	891.4
18	39	53.8	0.7	1209.3

5 Conclusion

With one ESS EVLO Flex with all noisy systems at maximum operating levels, noise levels all around are below the permissible limit for worker noise exposure over an 8-hour period, i.e. 90 dBA.

Noise levels are also below 85 dBA over an 8-hour period, so there's no need to implement a hearing conservation program for the workers.

In conclusion, one ESS EVLO Flex meets the requirements of the 29 CFR 1910.95 [1] and UL9540 [2] standards.

It's important to note that this conclusion is valid for a single ESS EVLO Flex and for the arrangement of the different systems (HVAC, PCS, ...) shown in the Figure 2 of this report.

6 References

- [1] 29 CFR 1910.95, Occupational noise exposure, Occupational Health and Environmental Control, Occupational Safety and Health Standards, Occupational Safety and Health Administration, Department of Labor, November 14th, 2023.
- [2] ANSI/CAN/UL 9540, Energy Storage Systems and Equipment, UL Standards, Edition 3, June 28th, 2023.

Appendix C – CadnaA Calculation Output



Receiver

Name: OLA1

ID: OLA1

X: 17624121.79 m

Y: 5050615.42 m

Z: 312.42 m

Point Source, ISO 9613, Name: "Transformer 4MW", ID: "transformer_4MW"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
1	17624270.19	5050367.48	342.00	0	DEN	32	41.6	0.0	0.0	0.0	0.0	60.3	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-23.5
1	17624270.19	5050367.48	342.00	0	DEN	63	62.8	0.0	0.0	0.0	0.0	60.3	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-2.3
1	17624270.19	5050367.48	342.00	0	DEN	125	76.9	0.0	0.0	0.0	0.0	60.3	0.1	1.8	0.0	0.0	3.0	0.0	0.0	11.7
1	17624270.19	5050367.48	342.00	0	DEN	250	68.4	0.0	0.0	0.0	0.0	60.3	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-1.6
1	17624270.19	5050367.48	342.00	0	DEN	500	69.8	0.0	0.0	0.0	0.0	60.3	0.6	4.8	0.0	0.0	0.1	0.0	0.0	4.1
1	17624270.19	5050367.48	342.00	0	DEN	1000	71.0	0.0	0.0	0.0	0.0	60.3	1.1	-0.3	0.0	0.0	5.3	0.0	0.0	4.8
1	17624270.19	5050367.48	342.00	0	DEN	2000	69.2	0.0	0.0	0.0	0.0	60.3	2.8	-1.0	0.0	0.0	6.0	0.0	0.0	1.1
1	17624270.19	5050367.48	342.00	0	DEN	4000	71.0	0.0	0.0	0.0	0.0	60.3	9.5	-1.0	0.0	0.0	6.3	0.0	0.0	-4.1
1	17624270.19	5050367.48	342.00	0	DEN	8000	51.9	0.0	0.0	0.0	0.0	60.3	34.0	-1.0	0.0	0.0	6.7	0.0	0.0	-48.1

Point Source, ISO 9613, Name: "HVAC Economizer Hood 4", ID: "HVAC_hood4"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
2	17624288.27	5050374.68	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	60.4	0.0	-4.3	0.0	0.0	0.0	0.0	0.0	-23.8
2	17624288.27	5050374.68	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	60.4	0.0	-4.3	0.0	0.0	0.0	0.0	0.0	-3.0
2	17624288.27	5050374.68	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	60.4	0.1	2.8	0.0	0.0	0.0	0.0	0.0	2.7
2	17624288.27	5050374.68	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	60.4	0.3	6.4	0.0	0.0	0.0	0.0	0.0	5.3
2	17624288.27	5050374.68	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	60.4	0.6	3.1	0.0	0.0	0.0	0.0	0.0	10.2
2	17624288.27	5050374.68	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	60.4	1.1	-0.3	0.0	0.0	0.0	0.0	0.0	10.5
2	17624288.27	5050374.68	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	60.4	2.8	-0.9	0.0	0.0	0.0	0.0	0.0	6.5
2	17624288.27	5050374.68	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	60.4	9.6	-0.9	0.0	0.0	0.0	0.0	0.0	-8.5
2	17624288.27	5050374.68	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	60.4	34.4	-0.9	0.0	0.0	0.0	0.0	0.0	-41.6

Point Source, ISO 9613, Name: "HVAC Economizer Hood 3", ID: "HVAC_hood3"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
3	17624294.15	5050377.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	60.4	0.0	-4.3	0.0	0.0	0.0	0.0	0.0	-23.8
3	17624294.15	5050377.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	60.4	0.0	-4.3	0.0	0.0	0.0	0.0	0.0	-3.0
3	17624294.15	5050377.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	60.4	0.1	2.8	0.0	0.0	0.0	0.0	0.0	2.7
3	17624294.15	5050377.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	60.4	0.3	6.4	0.0	0.0	0.0	0.0	0.0	5.2
3	17624294.15	5050377.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	60.4	0.6	3.1	0.0	0.0	0.0	0.0	0.0	10.1
3	17624294.15	5050377.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	60.4	1.1	-0.3	0.0	0.0	0.0	0.0	0.0	10.4
3	17624294.15	5050377.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	60.4	2.9	-0.9	0.0	0.0	0.0	0.0	0.0	6.4
3	17624294.15	5050377.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	60.4	9.7	-0.9	0.0	0.0	0.0	0.0	0.0	-8.6
3	17624294.15	5050377.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	60.4	34.6	-0.9	0.0	0.0	0.0	0.0	0.0	-41.8

Point Source, ISO 9613, Name: "HVAC Economizer Hood 2", ID: "HVAC_hood2"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
5	17624278.29	5050363.89	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	60.5	0.0	-4.3	0.0	0.0	9.1	0.0	0.0	-32.9
5	17624278.29	5050363.89	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	60.5	0.0	-4.3	0.0	0.0	9.1	0.0	0.0	-12.2
5	17624278.29	5050363.89	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	60.5	0.1	2.9	0.0	0.0	1.9	0.0	0.0	0.7
5	17624278.29	5050363.89	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	60.5	0.3	6.4	0.0	0.0	0.0	0.0	0.0	5.2
5	17624278.29	5050363.89	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	60.5	0.6	3.1	0.0	0.0	1.7	0.0	0.0	8.4
5	17624278.29	5050363.89	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	60.5	1.1	-0.3	0.0	0.0	5.1	0.0	0.0	5.3
5	17624278.29	5050363.89	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	60.5	2.9	-0.9	0.0	0.0	5.6	0.0	0.0	0.7
5	17624278.29	5050363.89	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	60.5	9.8	-0.9	0.0	0.0	5.6	0.0	0.0	-14.4
5	17624278.29	5050363.89	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	60.5	34.8	-0.9	0.0	0.0	5.6	0.0	0.0	-47.8

Point Source, ISO 9613, Name: "HVAC Economizer Hood 1", ID: "HVAC_hood1"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
7	17624284.42	5050366.44	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	60.5	0.0	-4.3	0.0	0.0	9.1	0.0	0.0	-33.0

Point Source, ISO 9613, Name: "HVAC Economizer Hood 1", ID: "HVAC_hood1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
7	17624284.42	5050366.44	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	60.5	0.0	-4.3	0.0	0.0	9.1	0.0	0.0	-12.2
7	17624284.42	5050366.44	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	60.5	0.1	2.9	0.0	0.0	1.9	0.0	0.0	0.7
7	17624284.42	5050366.44	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	60.5	0.3	6.4	0.0	0.0	0.0	0.0	0.0	5.2
7	17624284.42	5050366.44	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	60.5	0.6	3.1	0.0	0.0	1.7	0.0	0.0	8.4
7	17624284.42	5050366.44	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	60.5	1.1	-0.3	0.0	0.0	5.1	0.0	0.0	5.2
7	17624284.42	5050366.44	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	60.5	2.9	-0.9	0.0	0.0	5.6	0.0	0.0	0.6
7	17624284.42	5050366.44	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	60.5	9.8	-0.9	0.0	0.0	5.6	0.0	0.0	-14.5
7	17624284.42	5050366.44	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	60.5	35.0	-0.9	0.0	0.0	5.6	0.0	0.0	-47.9

Point Source, ISO 9613, Name: "HVAC Economizer Hood 7", ID: "HVAC_hood7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
9	17624301.74	5050377.18	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	60.5	0.0	-4.3	0.0	0.0	9.1	0.0	0.0	-33.0
9	17624301.74	5050377.18	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	60.5	0.0	-4.3	0.0	0.0	9.1	0.0	0.0	-12.3
9	17624301.74	5050377.18	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	60.5	0.1	2.9	0.0	0.0	1.9	0.0	0.0	0.6
9	17624301.74	5050377.18	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	60.5	0.3	6.4	0.0	0.0	0.0	0.0	0.0	5.1
9	17624301.74	5050377.18	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	60.5	0.6	3.1	0.0	0.0	1.7	0.0	0.0	8.3
9	17624301.74	5050377.18	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	60.5	1.1	-0.3	0.0	0.0	5.1	0.0	0.0	5.2
9	17624301.74	5050377.18	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	60.5	2.9	-0.9	0.0	0.0	5.6	0.0	0.0	0.6
9	17624301.74	5050377.18	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	60.5	9.8	-0.9	0.0	0.0	5.6	0.0	0.0	-14.5
9	17624301.74	5050377.18	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	60.5	35.1	-0.9	0.0	0.0	5.6	0.0	0.0	-48.1

Point Source, ISO 9613, Name: "HVAC Economizer Hood 6", ID: "HVAC_hood6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
11	17624285.84	5050363.98	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	60.6	0.0	-4.4	0.0	0.0	9.1	0.0	0.0	-33.1
11	17624285.84	5050363.98	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	60.6	0.0	-4.4	0.0	0.0	9.1	0.0	0.0	-12.3
11	17624285.84	5050363.98	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	60.6	0.1	2.9	0.0	0.0	1.9	0.0	0.0	0.6
11	17624285.84	5050363.98	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	60.6	0.3	6.4	0.0	0.0	0.0	0.0	0.0	5.1
11	17624285.84	5050363.98	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	60.6	0.6	3.1	0.0	0.0	1.7	0.0	0.0	8.3
11	17624285.84	5050363.98	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	60.6	1.1	-0.3	0.0	0.0	5.1	0.0	0.0	5.1
11	17624285.84	5050363.98	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	60.6	2.9	-0.9	0.0	0.0	5.6	0.0	0.0	0.5
11	17624285.84	5050363.98	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	60.6	9.9	-0.9	0.0	0.0	5.6	0.0	0.0	-14.6
11	17624285.84	5050363.98	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	60.6	35.3	-0.9	0.0	0.0	5.6	0.0	0.0	-48.3

Point Source, ISO 9613, Name: "HVAC Economizer Hood 5", ID: "HVAC_hood5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
13	17624291.94	5050366.35	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	60.6	0.0	-4.4	0.0	0.0	9.1	0.0	0.0	-33.1
13	17624291.94	5050366.35	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	60.6	0.0	-4.4	0.0	0.0	9.1	0.0	0.0	-12.4
13	17624291.94	5050366.35	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	60.6	0.1	2.9	0.0	0.0	1.9	0.0	0.0	0.5
13	17624291.94	5050366.35	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	60.6	0.3	6.4	0.0	0.0	0.0	0.0	0.0	5.0
13	17624291.94	5050366.35	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	60.6	0.6	3.1	0.0	0.0	1.7	0.0	0.0	8.3
13	17624291.94	5050366.35	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	60.6	1.1	-0.3	0.0	0.0	5.1	0.0	0.0	5.1
13	17624291.94	5050366.35	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	60.6	2.9	-0.9	0.0	0.0	5.6	0.0	0.0	0.5
13	17624291.94	5050366.35	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	60.6	9.9	-0.9	0.0	0.0	5.6	0.0	0.0	-14.7
13	17624291.94	5050366.35	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	60.6	35.4	-0.9	0.0	0.0	5.6	0.0	0.0	-48.5

Point Source, ISO 9613, Name: "HVAC Economizer Hood 9", ID: "HVAC_hood9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
15	17624295.94	5050364.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	60.8	0.0	-4.4	0.0	0.0	9.2	0.0	0.0	-33.2
15	17624295.94	5050364.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	60.8	0.0	-4.4	0.0	0.0	9.2	0.0	0.0	-12.5
15	17624295.94	5050364.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	60.8	0.1	2.9	0.0	0.0	1.9	0.0	0.0	0.4
15	17624295.94	5050364.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	60.8	0.3	6.4	0.0	0.0	0.0	0.0	0.0	4.9
15	17624295.94	5050364.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	60.8	0.6	3.1	0.0	0.0	1.7	0.0	0.0	8.1
15	17624295.94	5050364.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	60.8	1.1	-0.3	0.0	0.0	5.1	0.0	0.0	4.9
15	17624295.94	5050364.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	60.8	3.0	-0.9	0.0	0.0	5.6	0.0	0.0	0.3
15	17624295.94	5050364.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	60.8	10.1	-0.9	0.0	0.0	5.6	0.0	0.0	-15.0
15	17624295.94	5050364.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	60.8	35.9	-0.9	0.0	0.0	5.7	0.0	0.0	-49.1

Point Source, ISO 9613, Name: "HVAC Economizer Hood 8", ID: "HVAC_hood8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
17	17624301.95	5050366.49	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	60.8	0.0	-4.4	0.0	0.0	9.2	0.0	0.0	-33.3
17	17624301.95	5050366.49	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	60.8	0.0	-4.4	0.0	0.0	9.2	0.0	0.0	-12.5
17	17624301.95	5050366.49	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	60.8	0.1	2.9	0.0	0.0	1.9	0.0	0.0	0.4
17	17624301.95	5050366.49	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	60.8	0.3	6.4	0.0	0.0	0.0	0.0	0.0	4.9
17	17624301.95	5050366.49	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	60.8	0.6	3.1	0.0	0.0	1.7	0.0	0.0	8.1
17	17624301.95	5050366.49	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	60.8	1.1	-0.4	0.0	0.0	5.1	0.0	0.0	4.9
17	17624301.95	5050366.49	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	60.8	3.0	-0.9	0.0	0.0	5.7	0.0	0.0	0.3
17	17624301.95	5050366.49	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	60.8	10.1	-0.9	0.0	0.0	5.7	0.0	0.0	-15.1
17	17624301.95	5050366.49	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	60.8	36.1	-0.9	0.0	0.0	5.7	0.0	0.0	-49.4

Point Source, ISO 9613, Name: "Transformer 2MW", ID: "transformer_2MW"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
21	17624280.40	5050378.87	342.00	0	DEN	32	38.6	0.0	0.0	0.0	0.0	60.1	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-26.3
21	17624280.40	5050378.87	342.00	0	DEN	63	59.8	0.0	0.0	0.0	0.0	60.1	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-5.2
21	17624280.40	5050378.87	342.00	0	DEN	125	73.9	0.0	0.0	0.0	0.0	60.1	0.1	1.8	0.0	0.0	3.0	0.0	0.0	8.9
21	17624280.40	5050378.87	342.00	0	DEN	250	65.4	0.0	0.0	0.0	0.0	60.1	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-4.4
21	17624280.40	5050378.87	342.00	0	DEN	500	66.8	0.0	0.0	0.0	0.0	60.1	0.6	4.8	0.0	0.0	0.0	0.0	0.0	1.3
21	17624280.40	5050378.87	342.00	0	DEN	1000	68.0	0.0	0.0	0.0	0.0	60.1	1.0	-0.3	0.0	0.0	5.1	0.0	0.0	2.0
21	17624280.40	5050378.87	342.00	0	DEN	2000	66.2	0.0	0.0	0.0	0.0	60.1	2.8	-1.0	0.0	0.0	5.8	0.0	0.0	-1.5
21	17624280.40	5050378.87	342.00	0	DEN	4000	68.0	0.0	0.0	0.0	0.0	60.1	9.4	-1.0	0.0	0.0	5.8	0.0	0.0	-6.3
21	17624280.40	5050378.87	342.00	0	DEN	8000	48.9	0.0	0.0	0.0	0.0	60.1	33.5	-1.0	0.0	0.0	5.8	0.0	0.0	-49.5

Point Source, ISO 9613, Name: "PCS 10", ID: "PCS10"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
62	17624280.69	5050376.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.2	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-34.7
62	17624280.69	5050376.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.2	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-22.0
62	17624280.69	5050376.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.2	0.1	1.8	0.0	0.0	3.0	0.0	0.0	-2.0
62	17624280.69	5050376.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.2	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-3.4
62	17624280.69	5050376.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.2	0.6	4.8	0.0	0.0	0.0	0.0	0.0	0.3
62	17624280.69	5050376.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.2	1.1	-0.3	0.0	0.0	5.1	0.0	0.0	3.8
62	17624280.69	5050376.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.2	2.8	-1.0	0.0	0.0	5.8	0.0	0.0	3.4
62	17624280.69	5050376.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.2	9.5	-1.0	0.0	0.0	5.9	0.0	0.0	-7.8
62	17624280.69	5050376.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.2	33.7	-1.0	0.0	0.0	6.0	0.0	0.0	-43.5

Point Source, ISO 9613, Name: "PCS 11", ID: "PCS11"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
80	17624280.74	5050375.25	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.2	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-34.7
80	17624280.74	5050375.25	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.2	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-22.0
80	17624280.74	5050375.25	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.2	0.1	1.8	0.0	0.0	3.0	0.0	0.0	-2.0
80	17624280.74	5050375.25	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.2	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-3.5
80	17624280.74	5050375.25	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.2	0.6	4.8	0.0	0.0	0.0	0.0	0.0	0.3
80	17624280.74	5050375.25	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.2	1.1	-0.3	0.0	0.0	5.2	0.0	0.0	3.8
80	17624280.74	5050375.25	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.2	2.8	-1.0	0.0	0.0	5.8	0.0	0.0	3.3
80	17624280.74	5050375.25	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.2	9.5	-1.0	0.0	0.0	5.9	0.0	0.0	-7.9
80	17624280.74	5050375.25	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.2	33.8	-1.0	0.0	0.0	6.1	0.0	0.0	-43.8

Point Source, ISO 9613, Name: "PCS 3", ID: "PCS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
94	17624290.73	5050378.40	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.3	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-34.8
94	17624290.73	5050378.40	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.3	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-22.1
94	17624290.73	5050378.40	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.3	0.1	1.8	0.0	0.0	2.9	0.0	0.0	-2.1
94	17624290.73	5050378.40	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.3	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-3.6
94	17624290.73	5050378.40	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.3	0.6	4.8	0.0	0.0	0.0	0.0	0.0	0.2
94	17624290.73	5050378.40	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.3	1.1	-0.3	0.0	0.0	5.2	0.0	0.0	3.6
94	17624290.73	5050378.40	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.3	2.8	-1.0	0.0	0.0	5.9	0.0	0.0	3.2
94	17624290.73	5050378.40	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.3	9.6	-1.0	0.0	0.0	6.0	0.0	0.0	-8.2
94	17624290.73	5050378.40	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.3	34.2	-1.0	0.0	0.0	6.3	0.0	0.0	-44.5

Point Source, ISO 9613, Name: "PCS 12", ID: "PCS12"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
123	17624270.58	5050364.97	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.3	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-34.8
123	17624270.58	5050364.97	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.3	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-22.1
123	17624270.58	5050364.97	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.3	0.1	1.8	0.0	0.0	3.0	0.0	0.0	-2.1
123	17624270.58	5050364.97	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.3	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-3.6
123	17624270.58	5050364.97	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.3	0.6	4.8	0.0	0.0	0.1	0.0	0.0	0.1
123	17624270.58	5050364.97	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.3	1.1	-0.3	0.0	0.0	5.3	0.0	0.0	3.5
123	17624270.58	5050364.97	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.3	2.8	-1.0	0.0	0.0	6.2	0.0	0.0	2.9
123	17624270.58	5050364.97	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.3	9.6	-1.0	0.0	0.0	6.5	0.0	0.0	-8.7
123	17624270.58	5050364.97	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.3	34.2	-1.0	0.0	0.0	7.2	0.0	0.0	-45.4

Point Source, ISO 9613, Name: "PCS 13", ID: "PCS13"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
131	17624270.54	5050363.56	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.4	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-34.9
131	17624270.54	5050363.56	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.4	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-22.2
131	17624270.54	5050363.56	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.4	0.1	1.8	0.0	0.0	3.0	0.0	0.0	-2.2
131	17624270.54	5050363.56	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.4	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-3.6
131	17624270.54	5050363.56	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.4	0.6	4.8	0.0	0.0	0.1	0.0	0.0	0.0
131	17624270.54	5050363.56	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.4	1.1	-0.3	0.0	0.0	5.4	0.0	0.0	3.4
131	17624270.54	5050363.56	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.4	2.8	-1.0	0.0	0.0	6.3	0.0	0.0	2.8
131	17624270.54	5050363.56	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.4	9.6	-1.0	0.0	0.0	6.7	0.0	0.0	-8.9
131	17624270.54	5050363.56	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.4	34.4	-1.0	0.0	0.0	7.5	0.0	0.0	-45.9

Point Source, ISO 9613, Name: "PCS 14", ID: "PCS14"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
139	17624270.56	5050362.20	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.4	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-34.9
139	17624270.56	5050362.20	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.4	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-22.2
139	17624270.56	5050362.20	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.4	0.1	1.9	0.0	0.0	3.0	0.0	0.0	-2.2
139	17624270.56	5050362.20	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.4	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-3.7
139	17624270.56	5050362.20	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.4	0.6	4.8	0.0	0.0	0.2	0.0	0.0	-0.0
139	17624270.56	5050362.20	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.4	1.1	-0.4	0.0	0.0	5.4	0.0	0.0	3.3
139	17624270.56	5050362.20	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.4	2.9	-1.0	0.0	0.0	6.3	0.0	0.0	2.6
139	17624270.56	5050362.20	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.4	9.7	-1.0	0.0	0.0	6.9	0.0	0.0	-9.2
139	17624270.56	5050362.20	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.4	34.5	-1.0	0.0	0.0	7.8	0.0	0.0	-46.3

Point Source, ISO 9613, Name: "PCS 1", ID: "PCS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
172	17624280.88	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.4	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-34.9
172	17624280.88	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.4	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-22.2
172	17624280.88	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.4	0.1	1.9	0.0	0.0	2.9	0.0	0.0	-2.2
172	17624280.88	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.4	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-3.7
172	17624280.88	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.4	0.6	4.8	0.0	0.0	0.1	0.0	0.0	-0.0
172	17624280.88	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.4	1.1	-0.4	0.0	0.0	5.3	0.0	0.0	3.4
172	17624280.88	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.4	2.9	-1.0	0.0	0.0	6.2	0.0	0.0	2.7
172	17624280.88	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.4	9.7	-1.0	0.0	0.0	6.6	0.0	0.0	-9.0
172	17624280.88	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.4	34.6	-1.0	0.0	0.0	7.3	0.0	0.0	-46.0

Point Source, ISO 9613, Name: "PCS 7", ID: "PCS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
174	17624298.22	5050378.41	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.5	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-35.0
174	17624298.22	5050378.41	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.5	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-22.3
174	17624298.22	5050378.41	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.5	0.1	1.9	0.0	0.0	2.9	0.0	0.0	-2.2
174	17624298.22	5050378.41	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.5	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-3.7
174	17624298.22	5050378.41	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.5	0.6	4.8	0.0	0.0	0.1	0.0	0.0	-0.0
174	17624298.22	5050378.41	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.5	1.1	-0.4	0.0	0.0	5.3	0.0	0.0	3.4
174	17624298.22	5050378.41	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.5	2.9	-1.0	0.0	0.0	6.1	0.0	0.0	2.8
174	17624298.22	5050378.41	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.5	9.7	-1.0	0.0	0.0	6.3	0.0	0.0	-8.8
174	17624298.22	5050378.41	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.5	34.7	-1.0	0.0	0.0	6.9	0.0	0.0	-45.7

Point Source, ISO 9613, Name: "PCS 4", ID: "PCS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
187	17624291.60	5050373.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.5	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-35.0
187	17624291.60	5050373.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.5	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-22.3
187	17624291.60	5050373.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.5	0.1	1.9	0.0	0.0	2.9	0.0	0.0	-2.2
187	17624291.60	5050373.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.5	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-3.7
187	17624291.60	5050373.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.5	0.6	4.8	0.0	0.0	0.1	0.0	0.0	-0.0
187	17624291.60	5050373.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.5	1.1	-0.4	0.0	0.0	5.3	0.0	0.0	3.4
187	17624291.60	5050373.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.5	2.9	-1.0	0.0	0.0	6.1	0.0	0.0	2.8
187	17624291.60	5050373.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.5	9.7	-1.0	0.0	0.0	6.4	0.0	0.0	-8.9
187	17624291.60	5050373.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.5	34.7	-1.0	0.0	0.0	7.0	0.0	0.0	-45.9

Point Source, ISO 9613, Name: "PCS 5", ID: "PCS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
196	17624288.51	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.5	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-35.1
196	17624288.51	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.5	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-22.4
196	17624288.51	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.5	0.1	1.9	0.0	0.0	2.9	0.0	0.0	-2.3
196	17624288.51	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.5	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-3.8
196	17624288.51	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.5	0.6	4.8	0.0	0.0	0.2	0.0	0.0	-0.2
196	17624288.51	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.5	1.1	-0.4	0.0	0.0	5.4	0.0	0.0	3.2
196	17624288.51	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.5	2.9	-1.0	0.0	0.0	6.3	0.0	0.0	2.4
196	17624288.51	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.5	9.8	-1.0	0.0	0.0	6.9	0.0	0.0	-9.5
196	17624288.51	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.5	35.1	-1.0	0.0	0.0	7.8	0.0	0.0	-47.0

Point Source, ISO 9613, Name: "PCS 2", ID: "PCS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
205	17624281.69	5050362.69	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.6	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-35.1
205	17624281.69	5050362.69	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.6	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-22.4
205	17624281.69	5050362.69	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.6	0.1	1.9	0.0	0.0	2.9	0.0	0.0	-2.4
205	17624281.69	5050362.69	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.6	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-3.8
205	17624281.69	5050362.69	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.6	0.6	4.8	0.0	0.0	0.2	0.0	0.0	-0.3
205	17624281.69	5050362.69	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.6	1.1	-0.4	0.0	0.0	5.5	0.0	0.0	3.0
205	17624281.69	5050362.69	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.6	2.9	-1.0	0.0	0.0	6.6	0.0	0.0	2.2
205	17624281.69	5050362.69	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.6	9.8	-1.0	0.0	0.0	7.2	0.0	0.0	-9.9
205	17624281.69	5050362.69	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.6	35.1	-1.0	0.0	0.0	8.3	0.0	0.0	-47.6

Point Source, ISO 9613, Name: "PCS 6", ID: "PCS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
228	17624289.16	5050362.78	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.7	0.0	-5.0	0.0	0.0	9.7	0.0	0.0	-35.2
228	17624289.16	5050362.78	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.7	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-22.5
228	17624289.16	5050362.78	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.7	0.1	1.9	0.0	0.0	2.9	0.0	0.0	-2.5
228	17624289.16	5050362.78	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.7	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-3.9
228	17624289.16	5050362.78	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.7	0.6	4.8	0.0	0.0	0.3	0.0	0.0	-0.4
228	17624289.16	5050362.78	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.7	1.1	-0.4	0.0	0.0	5.6	0.0	0.0	2.8
228	17624289.16	5050362.78	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.7	2.9	-1.0	0.0	0.0	6.7	0.0	0.0	1.9
228	17624289.16	5050362.78	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.7	10.0	-1.0	0.0	0.0	7.5	0.0	0.0	-10.4
228	17624289.16	5050362.78	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.7	35.6	-1.0	0.0	0.0	8.7	0.0	0.0	-48.6

Point Source, ISO 9613, Name: "PCS 8", ID: "PCS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
230	17624298.45	5050367.65	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.7	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-35.2
230	17624298.45	5050367.65	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.7	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-22.5
230	17624298.45	5050367.65	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.7	0.1	1.9	0.0	0.0	2.9	0.0	0.0	-2.5
230	17624298.45	5050367.65	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.7	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-4.0
230	17624298.45	5050367.65	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.7	0.6	4.8	0.0	0.0	0.3	0.0	0.0	-0.5
230	17624298.45	5050367.65	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.7	1.1	-0.4	0.0	0.0	5.6	0.0	0.0	2.8
230	17624298.45	5050367.65	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.7	3.0	-1.0	0.0	0.0	6.7	0.0	0.0	1.9
230	17624298.45	5050367.65	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.7	10.0	-1.0	0.0	0.0	7.4	0.0	0.0	-10.4
230	17624298.45	5050367.65	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.7	35.7	-1.0	0.0	0.0	8.6	0.0	0.0	-48.7

Point Source, ISO 9613, Name: "PCS 9", ID: "PCS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
242	17624299.21	5050362.68	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.8	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-35.4
242	17624299.21	5050362.68	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.8	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-22.7
242	17624299.21	5050362.68	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.8	0.1	2.0	0.0	0.0	2.9	0.0	0.0	-2.7
242	17624299.21	5050362.68	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.8	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-4.1
242	17624299.21	5050362.68	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.8	0.6	4.7	0.0	0.0	0.4	0.0	0.0	-0.7
242	17624299.21	5050362.68	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.8	1.1	-0.4	0.0	0.0	5.8	0.0	0.0	2.5
242	17624299.21	5050362.68	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.8	3.0	-1.0	0.0	0.0	7.0	0.0	0.0	1.4
242	17624299.21	5050362.68	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.8	10.2	-1.0	0.0	0.0	8.0	0.0	0.0	-11.2
242	17624299.21	5050362.68	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.8	36.3	-1.0	0.0	0.0	9.4	0.0	0.0	-50.1

Point Source, ISO 9613, Name: "HVAC Condenser 3", ID: "HVAC_condenser3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
244	17624293.15	5050378.41	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	60.4	0.0	-4.3	0.0	0.0	0.0	0.0	0.0	-28.5
244	17624293.15	5050378.41	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	60.4	0.0	-4.3	0.0	0.0	0.0	0.0	0.0	-7.7
244	17624293.15	5050378.41	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	60.4	0.1	2.8	0.0	0.0	0.0	0.0	0.0	-1.9
244	17624293.15	5050378.41	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	60.4	0.3	6.4	0.0	0.0	0.0	0.0	0.0	0.6
244	17624293.15	5050378.41	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	60.4	0.6	3.1	0.0	0.0	0.0	0.0	0.0	5.5
244	17624293.15	5050378.41	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	60.4	1.1	-0.3	0.0	0.0	0.0	0.0	0.0	5.8
244	17624293.15	5050378.41	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	60.4	2.8	-0.9	0.0	0.0	0.0	0.0	0.0	1.8
244	17624293.15	5050378.41	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	60.4	9.6	-0.9	0.0	0.0	0.0	0.0	0.0	-13.2
244	17624293.15	5050378.41	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	60.4	34.4	-0.9	0.0	0.0	0.0	0.0	0.0	-46.3

Point Source, ISO 9613, Name: "HVAC Condenser 4", ID: "HVAC_condenser4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
306	17624289.10	5050373.50	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	60.4	0.0	-4.3	0.0	0.0	0.0	0.0	0.0	-28.5
306	17624289.10	5050373.50	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	60.4	0.0	-4.3	0.0	0.0	0.0	0.0	0.0	-7.7
306	17624289.10	5050373.50	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	60.4	0.1	2.8	0.0	0.0	0.0	0.0	0.0	-2.0
306	17624289.10	5050373.50	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	60.4	0.3	6.4	0.0	0.0	0.0	0.0	0.0	0.5
306	17624289.10	5050373.50	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	60.4	0.6	3.1	0.0	0.0	0.0	0.0	0.0	5.4
306	17624289.10	5050373.50	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	60.4	1.1	-0.3	0.0	0.0	0.0	0.0	0.0	5.7
306	17624289.10	5050373.50	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	60.4	2.9	-0.9	0.0	0.0	0.0	0.0	0.0	1.7
306	17624289.10	5050373.50	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	60.4	9.7	-0.9	0.0	0.0	0.0	0.0	0.0	-13.3
306	17624289.10	5050373.50	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	60.4	34.6	-0.9	0.0	0.0	0.0	0.0	0.0	-46.5

Point Source, ISO 9613, Name: "HVAC Condenser 1", ID: "HVAC_condenser1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
313	17624283.37	5050367.59	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	60.5	0.0	-4.3	0.0	0.0	9.1	0.0	0.0	-37.6
313	17624283.37	5050367.59	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	60.5	0.0	-4.3	0.0	0.0	9.1	0.0	0.0	-16.9
313	17624283.37	5050367.59	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	60.5	0.1	2.9	0.0	0.0	1.9	0.0	0.0	-4.0
313	17624283.37	5050367.59	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	60.5	0.3	6.4	0.0	0.0	0.0	0.0	0.0	0.5
313	17624283.37	5050367.59	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	60.5	0.6	3.1	0.0	0.0	1.7	0.0	0.0	3.7
313	17624283.37	5050367.59	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	60.5	1.1	-0.3	0.0	0.0	5.1	0.0	0.0	0.6
313	17624283.37	5050367.59	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	60.5	2.9	-0.9	0.0	0.0	5.6	0.0	0.0	-4.0
313	17624283.37	5050367.59	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	60.5	9.8	-0.9	0.0	0.0	5.6	0.0	0.0	-19.1
313	17624283.37	5050367.59	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	60.5	34.8	-0.9	0.0	0.0	5.6	0.0	0.0	-52.4

Point Source, ISO 9613, Name: "HVAC Condenser 7", ID: "HVAC_condenser7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
315	17624300.76	5050378.47	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	60.5	0.0	-4.3	0.0	0.0	0.0	0.0	0.0	-28.6
315	17624300.76	5050378.47	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	60.5	0.0	-4.3	0.0	0.0	0.0	0.0	0.0	-7.8
315	17624300.76	5050378.47	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	60.5	0.1	2.9	0.0	0.0	0.0	0.0	0.0	-2.1
315	17624300.76	5050378.47	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	60.5	0.3	6.4	0.0	0.0	0.0	0.0	0.0	0.5
315	17624300.76	5050378.47	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	60.5	0.6	3.1	0.0	0.0	0.0	0.0	0.0	5.4
315	17624300.76	5050378.47	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	60.5	1.1	-0.3	0.0	0.0	0.0	0.0	0.0	5.6
315	17624300.76	5050378.47	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	60.5	2.9	-0.9	0.0	0.0	0.0	0.0	0.0	1.6
315	17624300.76	5050378.47	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	60.5	9.8	-0.9	0.0	0.0	0.0	0.0	0.0	-13.5
315	17624300.76	5050378.47	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	60.5	34.9	-0.9	0.0	0.0	0.0	0.0	0.0	-46.9

Point Source, ISO 9613, Name: "HVAC Condenser 2", ID: "HVAC_condenser2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
317	17624279.21	5050362.61	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	60.5	0.0	-4.3	0.0	0.0	9.1	0.0	0.0	-37.7
317	17624279.21	5050362.61	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	60.5	0.0	-4.3	0.0	0.0	9.1	0.0	0.0	-16.9
317	17624279.21	5050362.61	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	60.5	0.1	2.9	0.0	0.0	1.9	0.0	0.0	-4.0
317	17624279.21	5050362.61	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	60.5	0.3	6.4	0.0	0.0	0.0	0.0	0.0	0.4
317	17624279.21	5050362.61	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	60.5	0.6	3.1	0.0	0.0	1.7	0.0	0.0	3.7
317	17624279.21	5050362.61	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	60.5	1.1	-0.3	0.0	0.0	5.1	0.0	0.0	0.5
317	17624279.21	5050362.61	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	60.5	2.9	-0.9	0.0	0.0	5.6	0.0	0.0	-4.1
317	17624279.21	5050362.61	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	60.5	9.8	-0.9	0.0	0.0	5.6	0.0	0.0	-19.2
317	17624279.21	5050362.61	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	60.5	35.0	-0.9	0.0	0.0	5.6	0.0	0.0	-52.7

Point Source, ISO 9613, Name: "HVAC Condenser 5", ID: "HVAC_condenser5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
318	17624290.96	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	60.6	0.0	-4.4	0.0	0.0	9.1	0.0	0.0	-37.8
318	17624290.96	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	60.6	0.0	-4.4	0.0	0.0	9.1	0.0	0.0	-17.0
318	17624290.96	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	60.6	0.1	2.9	0.0	0.0	1.9	0.0	0.0	-4.1
318	17624290.96	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	60.6	0.3	6.4	0.0	0.0	0.0	0.0	0.0	0.4
318	17624290.96	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	60.6	0.6	3.1	0.0	0.0	1.7	0.0	0.0	3.6
318	17624290.96	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	60.6	1.1	-0.3	0.0	0.0	5.1	0.0	0.0	0.4
318	17624290.96	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	60.6	2.9	-0.9	0.0	0.0	5.6	0.0	0.0	-4.2
318	17624290.96	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	60.6	9.9	-0.9	0.0	0.0	5.6	0.0	0.0	-19.3
318	17624290.96	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	60.6	35.3	-0.9	0.0	0.0	5.6	0.0	0.0	-53.0

Point Source, ISO 9613, Name: "HVAC Condenser 6", ID: "HVAC_condenser6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
320	17624286.79	5050362.77	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	60.6	0.0	-4.4	0.0	0.0	9.1	0.0	0.0	-37.8
320	17624286.79	5050362.77	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	60.6	0.0	-4.4	0.0	0.0	9.1	0.0	0.0	-17.1
320	17624286.79	5050362.77	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	60.6	0.1	2.9	0.0	0.0	1.9	0.0	0.0	-4.2
320	17624286.79	5050362.77	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	60.6	0.3	6.4	0.0	0.0	0.0	0.0	0.0	0.3
320	17624286.79	5050362.77	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	60.6	0.6	3.1	0.0	0.0	1.7	0.0	0.0	3.6
320	17624286.79	5050362.77	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	60.6	1.1	-0.3	0.0	0.0	5.1	0.0	0.0	0.4
320	17624286.79	5050362.77	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	60.6	2.9	-0.9	0.0	0.0	5.6	0.0	0.0	-4.2
320	17624286.79	5050362.77	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	60.6	9.9	-0.9	0.0	0.0	5.6	0.0	0.0	-19.4
320	17624286.79	5050362.77	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	60.6	35.5	-0.9	0.0	0.0	5.6	0.0	0.0	-53.3

Point Source, ISO 9613, Name: "HVAC Condenser 8", ID: "HVAC_condenser8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
321	17624300.95	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	60.8	0.0	-4.4	0.0	0.0	9.2	0.0	0.0	-37.9
321	17624300.95	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	60.8	0.0	-4.4	0.0	0.0	9.2	0.0	0.0	-17.2
321	17624300.95	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	60.8	0.1	2.9	0.0	0.0	1.9	0.0	0.0	-4.3
321	17624300.95	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	60.8	0.3	6.4	0.0	0.0	0.0	0.0	0.0	0.2
321	17624300.95	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	60.8	0.6	3.1	0.0	0.0	1.7	0.0	0.0	3.4
321	17624300.95	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	60.8	1.1	-0.3	0.0	0.0	5.1	0.0	0.0	0.3
321	17624300.95	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	60.8	3.0	-0.9	0.0	0.0	5.6	0.0	0.0	-4.4
321	17624300.95	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	60.8	10.1	-0.9	0.0	0.0	5.6	0.0	0.0	-19.7
321	17624300.95	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	60.8	35.9	-0.9	0.0	0.0	5.6	0.0	0.0	-53.8

Point Source, ISO 9613, Name: "HVAC Condenser 9", ID: "HVAC_condenser9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
330	17624296.83	5050362.76	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	60.8	0.0	-4.4	0.0	0.0	9.2	0.0	0.0	-38.0
330	17624296.83	5050362.76	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	60.8	0.0	-4.4	0.0	0.0	9.2	0.0	0.0	-17.2
330	17624296.83	5050362.76	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	60.8	0.1	2.9	0.0	0.0	1.9	0.0	0.0	-4.3
330	17624296.83	5050362.76	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	60.8	0.3	6.4	0.0	0.0	0.0	0.0	0.0	0.2
330	17624296.83	5050362.76	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	60.8	0.6	3.1	0.0	0.0	1.7	0.0	0.0	3.4
330	17624296.83	5050362.76	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	60.8	1.1	-0.4	0.0	0.0	5.1	0.0	0.0	0.2
330	17624296.83	5050362.76	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	60.8	3.0	-0.9	0.0	0.0	5.7	0.0	0.0	-4.4
330	17624296.83	5050362.76	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	60.8	10.1	-0.9	0.0	0.0	5.7	0.0	0.0	-19.8
330	17624296.83	5050362.76	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	60.8	36.1	-0.9	0.0	0.0	5.7	0.0	0.0	-54.1

Point Source, ISO 9613, Name: "UPS 3", ID: "UPS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
332	17624288.82	5050378.40	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.3	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-39.5
332	17624288.82	5050378.40	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.3	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-26.8
332	17624288.82	5050378.40	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.3	0.1	1.8	0.0	0.0	2.9	0.0	0.0	-6.7
332	17624288.82	5050378.40	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.3	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-8.2
332	17624288.82	5050378.40	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.3	0.6	4.8	0.0	0.0	0.0	0.0	0.0	-4.5
332	17624288.82	5050378.40	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.3	1.1	-0.3	0.0	0.0	5.2	0.0	0.0	-1.0
332	17624288.82	5050378.40	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.3	2.8	-1.0	0.0	0.0	5.9	0.0	0.0	-1.4
332	17624288.82	5050378.40	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.3	9.6	-1.0	0.0	0.0	6.0	0.0	0.0	-12.7
332	17624288.82	5050378.40	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.3	34.1	-1.0	0.0	0.0	6.2	0.0	0.0	-48.9

Point Source, ISO 9613, Name: "UPS 1", ID: "UPS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
335	17624278.90	5050367.58	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.4	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-39.6
335	17624278.90	5050367.58	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.4	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-26.9
335	17624278.90	5050367.58	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.4	0.1	1.9	0.0	0.0	2.9	0.0	0.0	-6.9
335	17624278.90	5050367.58	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.4	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-8.3
335	17624278.90	5050367.58	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.4	0.6	4.8	0.0	0.0	0.1	0.0	0.0	-4.7
335	17624278.90	5050367.58	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.4	1.1	-0.3	0.0	0.0	5.3	0.0	0.0	-1.3
335	17624278.90	5050367.58	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.4	2.9	-1.0	0.0	0.0	6.2	0.0	0.0	-1.9
335	17624278.90	5050367.58	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.4	9.7	-1.0	0.0	0.0	6.5	0.0	0.0	-13.5
335	17624278.90	5050367.58	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.4	34.5	-1.0	0.0	0.0	7.2	0.0	0.0	-50.4

Point Source, ISO 9613, Name: "UPS 7", ID: "UPS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
337	17624296.42	5050378.45	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.4	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-39.6
337	17624296.42	5050378.45	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.4	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-26.9
337	17624296.42	5050378.45	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.4	0.1	1.9	0.0	0.0	2.9	0.0	0.0	-6.9
337	17624296.42	5050378.45	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.4	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-8.4
337	17624296.42	5050378.45	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.4	0.6	4.8	0.0	0.0	0.1	0.0	0.0	-4.7
337	17624296.42	5050378.45	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.4	1.1	-0.4	0.0	0.0	5.3	0.0	0.0	-1.2
337	17624296.42	5050378.45	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.4	2.9	-1.0	0.0	0.0	6.0	0.0	0.0	-1.8
337	17624296.42	5050378.45	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.4	9.7	-1.0	0.0	0.0	6.3	0.0	0.0	-13.3
337	17624296.42	5050378.45	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.4	34.6	-1.0	0.0	0.0	6.7	0.0	0.0	-50.1

Point Source, ISO 9613, Name: "UPS 4", ID: "UPS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
339	17624293.53	5050373.46	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.5	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-39.7
339	17624293.53	5050373.46	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.5	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-27.0
339	17624293.53	5050373.46	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.5	0.1	1.9	0.0	0.0	2.9	0.0	0.0	-7.0
339	17624293.53	5050373.46	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.5	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-8.4
339	17624293.53	5050373.46	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.5	0.6	4.8	0.0	0.0	0.1	0.0	0.0	-4.8
339	17624293.53	5050373.46	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.5	1.1	-0.4	0.0	0.0	5.3	0.0	0.0	-1.4
339	17624293.53	5050373.46	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.5	2.9	-1.0	0.0	0.0	6.2	0.0	0.0	-2.0
339	17624293.53	5050373.46	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.5	9.8	-1.0	0.0	0.0	6.6	0.0	0.0	-13.7
339	17624293.53	5050373.46	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.5	34.9	-1.0	0.0	0.0	7.2	0.0	0.0	-50.9

Point Source, ISO 9613, Name: "UPS 5", ID: "UPS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
342	17624286.54	5050367.66	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.5	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-39.7
342	17624286.54	5050367.66	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.5	0.0	-4.9	0.0	0.0	9.7	0.0	0.0	-27.0
342	17624286.54	5050367.66	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.5	0.1	1.9	0.0	0.0	2.9	0.0	0.0	-7.0
342	17624286.54	5050367.66	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.5	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-8.5
342	17624286.54	5050367.66	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.5	0.6	4.8	0.0	0.0	0.2	0.0	0.0	-4.9
342	17624286.54	5050367.66	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.5	1.1	-0.4	0.0	0.0	5.4	0.0	0.0	-1.5
342	17624286.54	5050367.66	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.5	2.9	-1.0	0.0	0.0	6.3	0.0	0.0	-2.2
342	17624286.54	5050367.66	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.5	9.8	-1.0	0.0	0.0	6.8	0.0	0.0	-14.0
342	17624286.54	5050367.66	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.5	34.9	-1.0	0.0	0.0	7.6	0.0	0.0	-51.4

Point Source, ISO 9613, Name: "UPS 2", ID: "UPS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
344	17624283.74	5050362.73	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.6	0.0	-5.0	0.0	0.0	9.7	0.0	0.0	-39.8
344	17624283.74	5050362.73	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.6	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-27.1
344	17624283.74	5050362.73	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.6	0.1	1.9	0.0	0.0	2.9	0.0	0.0	-7.1
344	17624283.74	5050362.73	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.6	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-8.5
344	17624283.74	5050362.73	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.6	0.6	4.8	0.0	0.0	0.2	0.0	0.0	-5.0
344	17624283.74	5050362.73	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.6	1.1	-0.4	0.0	0.0	5.6	0.0	0.0	-1.7
344	17624283.74	5050362.73	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.6	2.9	-1.0	0.0	0.0	6.6	0.0	0.0	-2.6
344	17624283.74	5050362.73	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.6	9.9	-1.0	0.0	0.0	7.3	0.0	0.0	-14.7
344	17624283.74	5050362.73	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.6	35.2	-1.0	0.0	0.0	8.4	0.0	0.0	-52.6

Point Source, ISO 9613, Name: "UPS 8", ID: "UPS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
346	17624296.53	5050367.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.7	0.0	-5.0	0.0	0.0	9.7	0.0	0.0	-39.9
346	17624296.53	5050367.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.7	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-27.2
346	17624296.53	5050367.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.7	0.1	1.9	0.0	0.0	2.9	0.0	0.0	-7.2
346	17624296.53	5050367.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.7	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-8.6
346	17624296.53	5050367.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.7	0.6	4.8	0.0	0.0	0.2	0.0	0.0	-5.1
346	17624296.53	5050367.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.7	1.1	-0.4	0.0	0.0	5.6	0.0	0.0	-1.8
346	17624296.53	5050367.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.7	2.9	-1.0	0.0	0.0	6.6	0.0	0.0	-2.7
346	17624296.53	5050367.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.7	10.0	-1.0	0.0	0.0	7.3	0.0	0.0	-14.9
346	17624296.53	5050367.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.7	35.6	-1.0	0.0	0.0	8.4	0.0	0.0	-53.0

Point Source, ISO 9613, Name: "UPS 6", ID: "UPS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
353	17624291.19	5050362.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.7	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-39.9
353	17624291.19	5050362.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.7	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-27.2
353	17624291.19	5050362.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.7	0.1	1.9	0.0	0.0	2.9	0.0	0.0	-7.2
353	17624291.19	5050362.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.7	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-8.7
353	17624291.19	5050362.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.7	0.6	4.8	0.0	0.0	0.3	0.0	0.0	-5.2
353	17624291.19	5050362.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.7	1.1	-0.4	0.0	0.0	5.6	0.0	0.0	-1.9
353	17624291.19	5050362.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.7	3.0	-1.0	0.0	0.0	6.7	0.0	0.0	-2.9
353	17624291.19	5050362.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.7	10.0	-1.0	0.0	0.0	7.5	0.0	0.0	-15.2
353	17624291.19	5050362.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.7	35.7	-1.0	0.0	0.0	8.8	0.0	0.0	-53.6

Point Source, ISO 9613, Name: "UPS 9", ID: "UPS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
363	17624301.15	5050362.78	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.9	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-40.1
363	17624301.15	5050362.78	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.9	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-27.4
363	17624301.15	5050362.78	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.9	0.1	2.0	0.0	0.0	2.9	0.0	0.0	-7.4
363	17624301.15	5050362.78	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.9	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-8.8
363	17624301.15	5050362.78	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.9	0.6	4.7	0.0	0.0	0.4	0.0	0.0	-5.4
363	17624301.15	5050362.78	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.9	1.1	-0.4	0.0	0.0	5.8	0.0	0.0	-2.3
363	17624301.15	5050362.78	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.9	3.0	-1.0	0.0	0.0	7.1	0.0	0.0	-3.4
363	17624301.15	5050362.78	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.9	10.2	-1.0	0.0	0.0	8.0	0.0	0.0	-16.0
363	17624301.15	5050362.78	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.9	36.4	-1.0	0.0	0.0	9.5	0.0	0.0	-55.1

Receiver

Name: POR1

ID: POR1

X: 17624105.76 m

Y: 5050642.05 m

Z: 310.47 m

Point Source, ISO 9613, Name: "Transformer 4MW", ID: "transformer_4MW"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
4	17624270.19	5050367.48	342.00	0	DEN	32	41.6	0.0	0.0	0.0	0.0	61.1	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-24.3
4	17624270.19	5050367.48	342.00	0	DEN	63	62.8	0.0	0.0	0.0	0.0	61.1	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-3.2
4	17624270.19	5050367.48	342.00	0	DEN	125	76.9	0.0	0.0	0.0	0.0	61.1	0.1	2.1	0.0	0.0	2.7	0.0	0.0	10.8
4	17624270.19	5050367.48	342.00	0	DEN	250	68.4	0.0	0.0	0.0	0.0	61.1	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-2.5
4	17624270.19	5050367.48	342.00	0	DEN	500	69.8	0.0	0.0	0.0	0.0	61.1	0.6	4.7	0.0	0.0	0.1	0.0	0.0	3.2
4	17624270.19	5050367.48	342.00	0	DEN	1000	71.0	0.0	0.0	0.0	0.0	61.1	1.2	-0.4	0.0	0.0	5.2	0.0	0.0	3.8
4	17624270.19	5050367.48	342.00	0	DEN	2000	69.2	0.0	0.0	0.0	0.0	61.1	3.1	-1.0	0.0	0.0	5.9	0.0	0.0	0.1
4	17624270.19	5050367.48	342.00	0	DEN	4000	71.0	0.0	0.0	0.0	0.0	61.1	10.5	-1.0	0.0	0.0	6.0	0.0	0.0	-5.7
4	17624270.19	5050367.48	342.00	0	DEN	8000	51.9	0.0	0.0	0.0	0.0	61.1	37.6	-1.0	0.0	0.0	6.2	0.0	0.0	-52.0

Point Source, ISO 9613, Name: "HVAC Economizer Hood 4", ID: "HVAC_hood4"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
6	17624288.27	5050374.68	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	61.2	0.0	-4.5	0.0	0.0	0.0	0.0	0.0	-24.5
6	17624288.27	5050374.68	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	61.2	0.0	-4.5	0.0	0.0	0.0	0.0	0.0	-3.7
6	17624288.27	5050374.68	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	61.2	0.1	3.0	0.0	0.0	0.0	0.0	0.0	1.7
6	17624288.27	5050374.68	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	61.2	0.3	6.3	0.0	0.0	0.0	0.0	0.0	4.4
6	17624288.27	5050374.68	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	61.2	0.6	3.1	0.0	0.0	0.0	0.0	0.0	9.3
6	17624288.27	5050374.68	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	61.2	1.2	-0.4	0.0	0.0	0.0	0.0	0.0	9.5
6	17624288.27	5050374.68	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	61.2	3.1	-0.9	0.0	0.0	0.0	0.0	0.0	5.3
6	17624288.27	5050374.68	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	61.2	10.7	-0.9	0.0	0.0	0.0	0.0	0.0	-10.4
6	17624288.27	5050374.68	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	61.2	38.0	-0.9	0.0	0.0	0.0	0.0	0.0	-46.1

Point Source, ISO 9613, Name: "HVAC Economizer Hood 3", ID: "HVAC_hood3"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
8	17624294.15	5050377.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	61.3	0.0	-4.5	0.0	0.0	0.0	0.0	0.0	-24.5
8	17624294.15	5050377.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	61.3	0.0	-4.5	0.0	0.0	0.0	0.0	0.0	-3.8
8	17624294.15	5050377.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	61.3	0.1	3.0	0.0	0.0	0.0	0.0	0.0	1.6
8	17624294.15	5050377.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	61.3	0.3	6.3	0.0	0.0	0.0	0.0	0.0	4.4
8	17624294.15	5050377.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	61.3	0.6	3.1	0.0	0.0	0.0	0.0	0.0	9.2
8	17624294.15	5050377.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	61.3	1.2	-0.4	0.0	0.0	0.0	0.0	0.0	9.5
8	17624294.15	5050377.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	61.3	3.2	-0.9	0.0	0.0	0.0	0.0	0.0	5.3
8	17624294.15	5050377.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	61.3	10.7	-0.9	0.0	0.0	0.0	0.0	0.0	-10.5
8	17624294.15	5050377.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	61.3	38.2	-0.9	0.0	0.0	0.0	0.0	0.0	-46.3

Point Source, ISO 9613, Name: "HVAC Economizer Hood 2", ID: "HVAC_hood2"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
10	17624278.29	5050363.89	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	61.3	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-33.8
10	17624278.29	5050363.89	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	61.3	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-13.1
10	17624278.29	5050363.89	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	61.3	0.1	3.0	0.0	0.0	1.7	0.0	0.0	-0.2
10	17624278.29	5050363.89	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	61.3	0.3	6.3	0.0	0.0	0.0	0.0	0.0	4.3
10	17624278.29	5050363.89	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	61.3	0.6	3.1	0.0	0.0	1.7	0.0	0.0	7.5
10	17624278.29	5050363.89	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	61.3	1.2	-0.4	0.0	0.0	5.1	0.0	0.0	4.3
10	17624278.29	5050363.89	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	61.3	3.2	-0.9	0.0	0.0	5.7	0.0	0.0	-0.5
10	17624278.29	5050363.89	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	61.3	10.8	-0.9	0.0	0.0	5.7	0.0	0.0	-16.3
10	17624278.29	5050363.89	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	61.3	38.5	-0.9	0.0	0.0	5.7	0.0	0.0	-52.3

Point Source, ISO 9613, Name: "HVAC Economizer Hood 1", ID: "HVAC_hood1"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
12	17624284.42	5050366.44	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	61.4	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-33.8

Point Source, ISO 9613, Name: "HVAC Economizer Hood 1", ID: "HVAC_hood1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
12	17624284.42	5050366.44	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	61.4	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-13.1
12	17624284.42	5050366.44	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	61.4	0.1	3.0	0.0	0.0	1.7	0.0	0.0	-0.2
12	17624284.42	5050366.44	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	61.4	0.3	6.3	0.0	0.0	0.0	0.0	0.0	4.3
12	17624284.42	5050366.44	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	61.4	0.6	3.1	0.0	0.0	1.7	0.0	0.0	7.5
12	17624284.42	5050366.44	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	61.4	1.2	-0.4	0.0	0.0	5.1	0.0	0.0	4.2
12	17624284.42	5050366.44	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	61.4	3.2	-0.9	0.0	0.0	5.7	0.0	0.0	-0.5
12	17624284.42	5050366.44	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	61.4	10.8	-0.9	0.0	0.0	5.7	0.0	0.0	-16.4
12	17624284.42	5050366.44	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	61.4	38.6	-0.9	0.0	0.0	5.7	0.0	0.0	-52.4

Point Source, ISO 9613, Name: "HVAC Economizer Hood 7", ID: "HVAC_hood7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
14	17624301.74	5050377.18	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	61.4	0.0	-4.5	0.0	0.0	0.0	0.0	0.0	-24.6
14	17624301.74	5050377.18	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	61.4	0.0	-4.5	0.0	0.0	0.0	0.0	0.0	-3.9
14	17624301.74	5050377.18	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	61.4	0.1	3.0	0.0	0.0	0.0	0.0	0.0	1.5
14	17624301.74	5050377.18	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	61.4	0.3	6.3	0.0	0.0	0.0	0.0	0.0	4.3
14	17624301.74	5050377.18	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	61.4	0.6	3.1	0.0	0.0	0.0	0.0	0.0	9.1
14	17624301.74	5050377.18	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	61.4	1.2	-0.4	0.0	0.0	0.0	0.0	0.0	9.4
14	17624301.74	5050377.18	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	61.4	3.2	-0.9	0.0	0.0	0.0	0.0	0.0	5.1
14	17624301.74	5050377.18	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	61.4	10.9	-0.9	0.0	0.0	0.0	0.0	0.0	-10.7
14	17624301.74	5050377.18	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	61.4	38.7	-0.9	0.0	0.0	0.0	0.0	0.0	-46.9

Point Source, ISO 9613, Name: "HVAC Economizer Hood 6", ID: "HVAC_hood6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
16	17624285.84	5050363.98	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	61.4	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-33.9
16	17624285.84	5050363.98	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	61.4	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-13.2
16	17624285.84	5050363.98	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	61.4	0.1	3.0	0.0	0.0	1.7	0.0	0.0	-0.3
16	17624285.84	5050363.98	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	61.4	0.3	6.3	0.0	0.0	0.0	0.0	0.0	4.2
16	17624285.84	5050363.98	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	61.4	0.6	3.1	0.0	0.0	1.7	0.0	0.0	7.4
16	17624285.84	5050363.98	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	61.4	1.2	-0.4	0.0	0.0	5.1	0.0	0.0	4.2
16	17624285.84	5050363.98	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	61.4	3.2	-0.9	0.0	0.0	5.7	0.0	0.0	-0.6
16	17624285.84	5050363.98	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	61.4	10.9	-0.9	0.0	0.0	5.7	0.0	0.0	-16.5
16	17624285.84	5050363.98	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	61.4	38.9	-0.9	0.0	0.0	5.7	0.0	0.0	-52.8

Point Source, ISO 9613, Name: "HVAC Economizer Hood 5", ID: "HVAC_hood5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
18	17624291.94	5050366.35	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	61.5	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-33.9
18	17624291.94	5050366.35	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	61.5	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-13.2
18	17624291.94	5050366.35	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	61.5	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-0.3
18	17624291.94	5050366.35	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	61.5	0.3	6.3	0.0	0.0	0.0	0.0	0.0	4.2
18	17624291.94	5050366.35	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	61.5	0.6	3.1	0.0	0.0	1.7	0.0	0.0	7.3
18	17624291.94	5050366.35	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	61.5	1.2	-0.4	0.0	0.0	5.1	0.0	0.0	4.1
18	17624291.94	5050366.35	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	61.5	3.2	-0.9	0.0	0.0	5.7	0.0	0.0	-0.7
18	17624291.94	5050366.35	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	61.5	11.0	-0.9	0.0	0.0	5.7	0.0	0.0	-16.6
18	17624291.94	5050366.35	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	61.5	39.1	-0.9	0.0	0.0	5.7	0.0	0.0	-53.0

Point Source, ISO 9613, Name: "HVAC Economizer Hood 9", ID: "HVAC_hood9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
20	17624295.94	5050364.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	61.6	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-34.1
20	17624295.94	5050364.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	61.6	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-13.3
20	17624295.94	5050364.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	61.6	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-0.4
20	17624295.94	5050364.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	61.6	0.4	6.3	0.0	0.0	0.0	0.0	0.0	4.1
20	17624295.94	5050364.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	61.6	0.7	3.1	0.0	0.0	1.7	0.0	0.0	7.2
20	17624295.94	5050364.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	61.6	1.2	-0.4	0.0	0.0	5.1	0.0	0.0	4.0
20	17624295.94	5050364.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	61.6	3.3	-0.9	0.0	0.0	5.7	0.0	0.0	-0.8
20	17624295.94	5050364.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	61.6	11.1	-0.9	0.0	0.0	5.7	0.0	0.0	-16.8
20	17624295.94	5050364.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	61.6	39.6	-0.9	0.0	0.0	5.7	0.0	0.0	-53.6

Point Source, ISO 9613, Name: "HVAC Economizer Hood 8", ID: "HVAC_hood8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
28	17624301.95	5050366.49	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	61.6	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-34.1
28	17624301.95	5050366.49	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	61.6	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-13.3
28	17624301.95	5050366.49	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	61.6	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-0.5
28	17624301.95	5050366.49	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	61.6	0.4	6.3	0.0	0.0	0.0	0.0	0.0	4.0
28	17624301.95	5050366.49	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	61.6	0.7	3.1	0.0	0.0	1.7	0.0	0.0	7.2
28	17624301.95	5050366.49	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	61.6	1.2	-0.4	0.0	0.0	5.2	0.0	0.0	4.0
28	17624301.95	5050366.49	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	61.6	3.3	-0.9	0.0	0.0	5.7	0.0	0.0	-0.9
28	17624301.95	5050366.49	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	61.6	11.1	-0.9	0.0	0.0	5.7	0.0	0.0	-16.9
28	17624301.95	5050366.49	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	61.6	39.7	-0.9	0.0	0.0	5.7	0.0	0.0	-53.8

Point Source, ISO 9613, Name: "Transformer 2MW", ID: "transformer_2MW"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
29	17624280.40	5050378.87	342.00	0	DEN	32	38.6	0.0	0.0	0.0	0.0	61.0	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-27.2
29	17624280.40	5050378.87	342.00	0	DEN	63	59.8	0.0	0.0	0.0	0.0	61.0	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-6.1
29	17624280.40	5050378.87	342.00	0	DEN	125	73.9	0.0	0.0	0.0	0.0	61.0	0.1	2.0	0.0	0.0	2.7	0.0	0.0	8.0
29	17624280.40	5050378.87	342.00	0	DEN	250	65.4	0.0	0.0	0.0	0.0	61.0	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-5.4
29	17624280.40	5050378.87	342.00	0	DEN	500	66.8	0.0	0.0	0.0	0.0	61.0	0.6	4.7	0.0	0.0	0.0	0.0	0.0	0.4
29	17624280.40	5050378.87	342.00	0	DEN	1000	68.0	0.0	0.0	0.0	0.0	61.0	1.2	-0.4	0.0	0.0	5.1	0.0	0.0	1.0
29	17624280.40	5050378.87	342.00	0	DEN	2000	66.2	0.0	0.0	0.0	0.0	61.0	3.1	-1.0	0.0	0.0	5.8	0.0	0.0	-2.7
29	17624280.40	5050378.87	342.00	0	DEN	4000	68.0	0.0	0.0	0.0	0.0	61.0	10.4	-1.0	0.0	0.0	5.8	0.0	0.0	-8.2
29	17624280.40	5050378.87	342.00	0	DEN	8000	48.9	0.0	0.0	0.0	0.0	61.0	37.1	-1.0	0.0	0.0	5.8	0.0	0.0	-54.0

Point Source, ISO 9613, Name: "PCS 10", ID: "PCS10"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
30	17624280.69	5050376.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	61.1	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-35.6
30	17624280.69	5050376.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	61.1	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-22.9
30	17624280.69	5050376.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	61.1	0.1	2.1	0.0	0.0	2.7	0.0	0.0	-2.9
30	17624280.69	5050376.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	61.1	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-4.4
30	17624280.69	5050376.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	61.1	0.6	4.7	0.0	0.0	0.0	0.0	0.0	-0.6
30	17624280.69	5050376.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	61.1	1.2	-0.4	0.0	0.0	5.1	0.0	0.0	2.8
30	17624280.69	5050376.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	61.1	3.1	-1.0	0.0	0.0	5.8	0.0	0.0	2.3
30	17624280.69	5050376.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	61.1	10.5	-1.0	0.0	0.0	5.8	0.0	0.0	-9.6
30	17624280.69	5050376.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	61.1	37.3	-1.0	0.0	0.0	5.8	0.0	0.0	-47.9

Point Source, ISO 9613, Name: "PCS 11", ID: "PCS11"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
31	17624280.74	5050375.25	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	61.1	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-35.6
31	17624280.74	5050375.25	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	61.1	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-22.9
31	17624280.74	5050375.25	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	61.1	0.1	2.1	0.0	0.0	2.7	0.0	0.0	-2.9
31	17624280.74	5050375.25	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	61.1	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-4.4
31	17624280.74	5050375.25	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	61.1	0.6	4.7	0.0	0.0	0.0	0.0	0.0	-0.7
31	17624280.74	5050375.25	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	61.1	1.2	-0.4	0.0	0.0	5.2	0.0	0.0	2.8
31	17624280.74	5050375.25	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	61.1	3.1	-1.0	0.0	0.0	5.8	0.0	0.0	2.2
31	17624280.74	5050375.25	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	61.1	10.5	-1.0	0.0	0.0	5.8	0.0	0.0	-9.7
31	17624280.74	5050375.25	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	61.1	37.5	-1.0	0.0	0.0	5.9	0.0	0.0	-48.1

Point Source, ISO 9613, Name: "PCS 3", ID: "PCS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
33	17624290.73	5050378.40	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	61.2	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-35.7
33	17624290.73	5050378.40	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	61.2	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-23.0
33	17624290.73	5050378.40	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	61.2	0.1	2.1	0.0	0.0	2.7	0.0	0.0	-3.0
33	17624290.73	5050378.40	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	61.2	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-4.5
33	17624290.73	5050378.40	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	61.2	0.6	4.7	0.0	0.0	0.0	0.0	0.0	-0.8
33	17624290.73	5050378.40	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	61.2	1.2	-0.4	0.0	0.0	5.2	0.0	0.0	2.7
33	17624290.73	5050378.40	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	61.2	3.1	-1.0	0.0	0.0	5.8	0.0	0.0	2.1
33	17624290.73	5050378.40	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	61.2	10.6	-1.0	0.0	0.0	5.9	0.0	0.0	-9.9
33	17624290.73	5050378.40	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	61.2	37.8	-1.0	0.0	0.0	6.0	0.0	0.0	-48.6

Point Source, ISO 9613, Name: "PCS 12", ID: "PCS12"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
38	17624270.58	5050364.97	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	61.2	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-35.7
38	17624270.58	5050364.97	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	61.2	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-23.0
38	17624270.58	5050364.97	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	61.2	0.1	2.1	0.0	0.0	2.7	0.0	0.0	-3.0
38	17624270.58	5050364.97	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	61.2	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-4.5
38	17624270.58	5050364.97	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	61.2	0.6	4.7	0.0	0.0	0.1	0.0	0.0	-0.8
38	17624270.58	5050364.97	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	61.2	1.2	-0.4	0.0	0.0	5.2	0.0	0.0	2.6
38	17624270.58	5050364.97	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	61.2	3.1	-1.0	0.0	0.0	6.0	0.0	0.0	1.9
38	17624270.58	5050364.97	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	61.2	10.6	-1.0	0.0	0.0	6.1	0.0	0.0	-10.2
38	17624270.58	5050364.97	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	61.2	37.9	-1.0	0.0	0.0	6.5	0.0	0.0	-49.2

Point Source, ISO 9613, Name: "PCS 13", ID: "PCS13"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
40	17624270.54	5050363.56	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	61.2	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-35.8
40	17624270.54	5050363.56	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	61.2	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-23.1
40	17624270.54	5050363.56	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	61.2	0.1	2.1	0.0	0.0	2.7	0.0	0.0	-3.0
40	17624270.54	5050363.56	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	61.2	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-4.5
40	17624270.54	5050363.56	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	61.2	0.6	4.7	0.0	0.0	0.1	0.0	0.0	-0.8
40	17624270.54	5050363.56	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	61.2	1.2	-0.4	0.0	0.0	5.3	0.0	0.0	2.5
40	17624270.54	5050363.56	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	61.2	3.1	-1.0	0.0	0.0	6.0	0.0	0.0	1.8
40	17624270.54	5050363.56	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	61.2	10.7	-1.0	0.0	0.0	6.2	0.0	0.0	-10.4
40	17624270.54	5050363.56	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	61.2	38.0	-1.0	0.0	0.0	6.7	0.0	0.0	-49.5

Point Source, ISO 9613, Name: "PCS 14", ID: "PCS14"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
46	17624270.56	5050362.20	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	61.3	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-35.8
46	17624270.56	5050362.20	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	61.3	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-23.1
46	17624270.56	5050362.20	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	61.3	0.1	2.1	0.0	0.0	2.7	0.0	0.0	-3.1
46	17624270.56	5050362.20	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	61.3	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-4.5
46	17624270.56	5050362.20	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	61.3	0.6	4.7	0.0	0.0	0.1	0.0	0.0	-0.9
46	17624270.56	5050362.20	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	61.3	1.2	-0.4	0.0	0.0	5.3	0.0	0.0	2.5
46	17624270.56	5050362.20	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	61.3	3.2	-1.0	0.0	0.0	6.1	0.0	0.0	1.7
46	17624270.56	5050362.20	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	61.3	10.7	-1.0	0.0	0.0	6.4	0.0	0.0	-10.5
46	17624270.56	5050362.20	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	61.3	38.1	-1.0	0.0	0.0	6.9	0.0	0.0	-49.9

Point Source, ISO 9613, Name: "PCS 1", ID: "PCS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
47	17624280.88	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	61.3	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-35.8
47	17624280.88	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	61.3	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-23.1
47	17624280.88	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	61.3	0.1	2.1	0.0	0.0	2.7	0.0	0.0	-3.1
47	17624280.88	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	61.3	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-4.6
47	17624280.88	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	61.3	0.6	4.7	0.0	0.0	0.1	0.0	0.0	-0.9
47	17624280.88	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	61.3	1.2	-0.4	0.0	0.0	5.2	0.0	0.0	2.5
47	17624280.88	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	61.3	3.2	-1.0	0.0	0.0	6.0	0.0	0.0	1.8
47	17624280.88	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	61.3	10.7	-1.0	0.0	0.0	6.2	0.0	0.0	-10.4
47	17624280.88	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	61.3	38.2	-1.0	0.0	0.0	6.6	0.0	0.0	-49.7

Point Source, ISO 9613, Name: "PCS 7", ID: "PCS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
48	17624298.22	5050378.41	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	61.3	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-35.8
48	17624298.22	5050378.41	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	61.3	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-23.1
48	17624298.22	5050378.41	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	61.3	0.1	2.1	0.0	0.0	2.6	0.0	0.0	-3.1
48	17624298.22	5050378.41	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	61.3	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-4.6
48	17624298.22	5050378.41	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	61.3	0.6	4.7	0.0	0.0	0.1	0.0	0.0	-0.9
48	17624298.22	5050378.41	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	61.3	1.2	-0.4	0.0	0.0	5.2	0.0	0.0	2.5
48	17624298.22	5050378.41	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	61.3	3.2	-1.0	0.0	0.0	5.9	0.0	0.0	1.8
48	17624298.22	5050378.41	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	61.3	10.7	-1.0	0.0	0.0	6.0	0.0	0.0	-10.3
48	17624298.22	5050378.41	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	61.3	38.3	-1.0	0.0	0.0	6.3	0.0	0.0	-49.6

Point Source, ISO 9613, Name: "PCS 4", ID: "PCS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
49	17624291.60	5050373.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	61.3	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-35.8
49	17624291.60	5050373.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	61.3	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-23.1
49	17624291.60	5050373.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	61.3	0.1	2.1	0.0	0.0	2.6	0.0	0.0	-3.1
49	17624291.60	5050373.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	61.3	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-4.6
49	17624291.60	5050373.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	61.3	0.6	4.7	0.0	0.0	0.1	0.0	0.0	-0.9
49	17624291.60	5050373.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	61.3	1.2	-0.4	0.0	0.0	5.2	0.0	0.0	2.5
49	17624291.60	5050373.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	61.3	3.2	-1.0	0.0	0.0	5.9	0.0	0.0	1.8
49	17624291.60	5050373.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	61.3	10.8	-1.0	0.0	0.0	6.1	0.0	0.0	-10.4
49	17624291.60	5050373.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	61.3	38.3	-1.0	0.0	0.0	6.4	0.0	0.0	-49.7

Point Source, ISO 9613, Name: "PCS 5", ID: "PCS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
50	17624288.51	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	61.4	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-35.9
50	17624288.51	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	61.4	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-23.2
50	17624288.51	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	61.4	0.1	2.2	0.0	0.0	2.6	0.0	0.0	-3.2
50	17624288.51	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	61.4	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-4.7
50	17624288.51	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	61.4	0.6	4.7	0.0	0.0	0.1	0.0	0.0	-1.0
50	17624288.51	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	61.4	1.2	-0.4	0.0	0.0	5.3	0.0	0.0	2.3
50	17624288.51	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	61.4	3.2	-1.0	0.0	0.0	6.1	0.0	0.0	1.6
50	17624288.51	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	61.4	10.9	-1.0	0.0	0.0	6.4	0.0	0.0	-10.8
50	17624288.51	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	61.4	38.7	-1.0	0.0	0.0	6.9	0.0	0.0	-50.6

Point Source, ISO 9613, Name: "PCS 2", ID: "PCS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
51	17624281.69	5050362.69	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	61.4	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-35.9
51	17624281.69	5050362.69	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	61.4	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-23.2
51	17624281.69	5050362.69	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	61.4	0.1	2.2	0.0	0.0	2.6	0.0	0.0	-3.2
51	17624281.69	5050362.69	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	61.4	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-4.7
51	17624281.69	5050362.69	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	61.4	0.6	4.7	0.0	0.0	0.1	0.0	0.0	-1.1
51	17624281.69	5050362.69	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	61.4	1.2	-0.4	0.0	0.0	5.4	0.0	0.0	2.3
51	17624281.69	5050362.69	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	61.4	3.2	-1.0	0.0	0.0	6.2	0.0	0.0	1.4
51	17624281.69	5050362.69	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	61.4	10.9	-1.0	0.0	0.0	6.6	0.0	0.0	-11.1
51	17624281.69	5050362.69	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	61.4	38.8	-1.0	0.0	0.0	7.3	0.0	0.0	-51.1

Point Source, ISO 9613, Name: "PCS 6", ID: "PCS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
59	17624289.16	5050362.78	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	61.5	0.0	-5.1	0.0	0.0	9.8	0.0	0.0	-36.0
59	17624289.16	5050362.78	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	61.5	0.0	-5.1	0.0	0.0	9.8	0.0	0.0	-23.3
59	17624289.16	5050362.78	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	61.5	0.1	2.2	0.0	0.0	2.6	0.0	0.0	-3.3
59	17624289.16	5050362.78	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	61.5	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-4.8
59	17624289.16	5050362.78	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	61.5	0.6	4.7	0.0	0.0	0.2	0.0	0.0	-1.2
59	17624289.16	5050362.78	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	61.5	1.2	-0.4	0.0	0.0	5.4	0.0	0.0	2.1
59	17624289.16	5050362.78	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	61.5	3.2	-1.0	0.0	0.0	6.3	0.0	0.0	1.2
59	17624289.16	5050362.78	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	61.5	11.0	-1.0	0.0	0.0	6.8	0.0	0.0	-11.5
59	17624289.16	5050362.78	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	61.5	39.2	-1.0	0.0	0.0	7.6	0.0	0.0	-52.0

Point Source, ISO 9613, Name: "PCS 8", ID: "PCS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
92	17624298.45	5050367.65	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	61.5	0.0	-5.1	0.0	0.0	9.8	0.0	0.0	-36.1
92	17624298.45	5050367.65	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	61.5	0.0	-5.1	0.0	0.0	9.8	0.0	0.0	-23.4
92	17624298.45	5050367.65	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	61.5	0.1	2.2	0.0	0.0	2.6	0.0	0.0	-3.3
92	17624298.45	5050367.65	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	61.5	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-4.8
92	17624298.45	5050367.65	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	61.5	0.6	4.7	0.0	0.0	0.2	0.0	0.0	-1.2
92	17624298.45	5050367.65	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	61.5	1.2	-0.4	0.0	0.0	5.4	0.0	0.0	2.1
92	17624298.45	5050367.65	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	61.5	3.3	-1.0	0.0	0.0	6.3	0.0	0.0	1.2
92	17624298.45	5050367.65	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	61.5	11.0	-1.0	0.0	0.0	6.7	0.0	0.0	-11.5
92	17624298.45	5050367.65	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	61.5	39.4	-1.0	0.0	0.0	7.5	0.0	0.0	-52.1

Point Source, ISO 9613, Name: "PCS 9", ID: "PCS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
95	17624299.21	5050362.68	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	61.7	0.0	-5.1	0.0	0.0	9.9	0.0	0.0	-36.2
95	17624299.21	5050362.68	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	61.7	0.0	-5.1	0.0	0.0	9.9	0.0	0.0	-23.5
95	17624299.21	5050362.68	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	61.7	0.1	2.3	0.0	0.0	2.6	0.0	0.0	-3.5
95	17624299.21	5050362.68	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	61.7	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-4.9
95	17624299.21	5050362.68	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	61.7	0.7	4.7	0.0	0.0	0.2	0.0	0.0	-1.4
95	17624299.21	5050362.68	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	61.7	1.2	-0.4	0.0	0.0	5.5	0.0	0.0	1.8
95	17624299.21	5050362.68	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	61.7	3.3	-1.0	0.0	0.0	6.5	0.0	0.0	0.8
95	17624299.21	5050362.68	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	61.7	11.2	-1.0	0.0	0.0	7.2	0.0	0.0	-12.2
95	17624299.21	5050362.68	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	61.7	39.9	-1.0	0.0	0.0	8.2	0.0	0.0	-53.4

Point Source, ISO 9613, Name: "HVAC Condenser 3", ID: "HVAC_condenser3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
109	17624293.15	5050378.41	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	61.2	0.0	-4.5	0.0	0.0	0.0	0.0	0.0	-29.2
109	17624293.15	5050378.41	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	61.2	0.0	-4.5	0.0	0.0	0.0	0.0	0.0	-8.4
109	17624293.15	5050378.41	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	61.2	0.1	3.0	0.0	0.0	0.0	0.0	0.0	-3.0
109	17624293.15	5050378.41	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	61.2	0.3	6.3	0.0	0.0	0.0	0.0	0.0	-0.3
109	17624293.15	5050378.41	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	61.2	0.6	3.1	0.0	0.0	0.0	0.0	0.0	4.6
109	17624293.15	5050378.41	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	61.2	1.2	-0.4	0.0	0.0	0.0	0.0	0.0	4.8
109	17624293.15	5050378.41	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	61.2	3.1	-0.9	0.0	0.0	0.0	0.0	0.0	0.6
109	17624293.15	5050378.41	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	61.2	10.7	-0.9	0.0	0.0	0.0	0.0	0.0	-15.1
109	17624293.15	5050378.41	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	61.2	38.0	-0.9	0.0	0.0	0.0	0.0	0.0	-50.7

Point Source, ISO 9613, Name: "HVAC Condenser 4", ID: "HVAC_condenser4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
111	17624289.10	5050373.50	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	61.3	0.0	-4.5	0.0	0.0	0.0	0.0	0.0	-29.2
111	17624289.10	5050373.50	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	61.3	0.0	-4.5	0.0	0.0	0.0	0.0	0.0	-8.5
111	17624289.10	5050373.50	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	61.3	0.1	3.0	0.0	0.0	0.0	0.0	0.0	-3.1
111	17624289.10	5050373.50	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	61.3	0.3	6.3	0.0	0.0	0.0	0.0	0.0	-0.3
111	17624289.10	5050373.50	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	61.3	0.6	3.1	0.0	0.0	0.0	0.0	0.0	4.5
111	17624289.10	5050373.50	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	61.3	1.2	-0.4	0.0	0.0	0.0	0.0	0.0	4.8
111	17624289.10	5050373.50	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	61.3	3.2	-0.9	0.0	0.0	0.0	0.0	0.0	0.6
111	17624289.10	5050373.50	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	61.3	10.7	-0.9	0.0	0.0	0.0	0.0	0.0	-15.2
111	17624289.10	5050373.50	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	61.3	38.2	-0.9	0.0	0.0	0.0	0.0	0.0	-51.0

Point Source, ISO 9613, Name: "HVAC Condenser 1", ID: "HVAC_condenser1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
119	17624283.37	5050367.59	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	61.3	0.0	-4.5	0.0	0.0	0.0	0.0	0.0	-29.2
119	17624283.37	5050367.59	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	61.3	0.0	-4.5	0.0	0.0	0.0	0.0	0.0	-8.5
119	17624283.37	5050367.59	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	61.3	0.1	3.0	0.0	0.0	0.0	0.0	0.0	-3.1
119	17624283.37	5050367.59	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	61.3	0.3	6.3	0.0	0.0	0.0	0.0	0.0	-0.4
119	17624283.37	5050367.59	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	61.3	0.6	3.1	0.0	0.0	0.0	0.0	0.0	4.5
119	17624283.37	5050367.59	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	61.3	1.2	-0.4	0.0	0.0	0.0	0.0	0.0	4.7
119	17624283.37	5050367.59	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	61.3	3.2	-0.9	0.0	0.0	0.0	0.0	0.0	0.5
119	17624283.37	5050367.59	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	61.3	10.8	-0.9	0.0	0.0	0.0	0.0	0.0	-15.3
119	17624283.37	5050367.59	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	61.3	38.4	-0.9	0.0	0.0	0.0	0.0	0.0	-51.2

Point Source, ISO 9613, Name: "HVAC Condenser 7", ID: "HVAC_condenser7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
127	17624300.76	5050378.47	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	61.4	0.0	-4.5	0.0	0.0	0.0	0.0	0.0	-29.3
127	17624300.76	5050378.47	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	61.4	0.0	-4.5	0.0	0.0	0.0	0.0	0.0	-8.5
127	17624300.76	5050378.47	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	61.4	0.1	3.0	0.0	0.0	0.0	0.0	0.0	-3.1
127	17624300.76	5050378.47	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	61.4	0.3	6.3	0.0	0.0	0.0	0.0	0.0	-0.4
127	17624300.76	5050378.47	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	61.4	0.6	3.1	0.0	0.0	0.0	0.0	0.0	4.5
127	17624300.76	5050378.47	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	61.4	1.2	-0.4	0.0	0.0	0.0	0.0	0.0	4.7
127	17624300.76	5050378.47	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	61.4	3.2	-0.9	0.0	0.0	0.0	0.0	0.0	0.5
127	17624300.76	5050378.47	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	61.4	10.8	-0.9	0.0	0.0	0.0	0.0	0.0	-15.3
127	17624300.76	5050378.47	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	61.4	38.5	-0.9	0.0	0.0	0.0	0.0	0.0	-51.4

Point Source, ISO 9613, Name: "HVAC Condenser 2", ID: "HVAC_condenser2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
130	17624279.21	5050362.61	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	61.4	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-38.5
130	17624279.21	5050362.61	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	61.4	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-17.8
130	17624279.21	5050362.61	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	61.4	0.1	3.0	0.0	0.0	1.7	0.0	0.0	-4.9
130	17624279.21	5050362.61	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	61.4	0.3	6.3	0.0	0.0	0.0	0.0	0.0	-0.4
130	17624279.21	5050362.61	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	61.4	0.6	3.1	0.0	0.0	1.7	0.0	0.0	2.8
130	17624279.21	5050362.61	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	61.4	1.2	-0.4	0.0	0.0	5.1	0.0	0.0	-0.5
130	17624279.21	5050362.61	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	61.4	3.2	-0.9	0.0	0.0	5.7	0.0	0.0	-5.2
130	17624279.21	5050362.61	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	61.4	10.8	-0.9	0.0	0.0	5.7	0.0	0.0	-21.1
130	17624279.21	5050362.61	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	61.4	38.6	-0.9	0.0	0.0	5.7	0.0	0.0	-57.2

Point Source, ISO 9613, Name: "HVAC Condenser 5", ID: "HVAC_condenser5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
137	17624290.96	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	61.4	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-38.6
137	17624290.96	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	61.4	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-17.9
137	17624290.96	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	61.4	0.1	3.0	0.0	0.0	1.7	0.0	0.0	-5.0
137	17624290.96	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	61.4	0.3	6.3	0.0	0.0	0.0	0.0	0.0	-0.5
137	17624290.96	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	61.4	0.6	3.1	0.0	0.0	1.7	0.0	0.0	2.7
137	17624290.96	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	61.4	1.2	-0.4	0.0	0.0	5.1	0.0	0.0	-0.5
137	17624290.96	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	61.4	3.2	-0.9	0.0	0.0	5.7	0.0	0.0	-5.3
137	17624290.96	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	61.4	10.9	-0.9	0.0	0.0	5.7	0.0	0.0	-21.2
137	17624290.96	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	61.4	38.9	-0.9	0.0	0.0	5.7	0.0	0.0	-57.5

Point Source, ISO 9613, Name: "HVAC Condenser 6", ID: "HVAC_condenser6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
203	17624286.79	5050362.77	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	61.5	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-38.6
203	17624286.79	5050362.77	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	61.5	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-17.9
203	17624286.79	5050362.77	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	61.5	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-5.0
203	17624286.79	5050362.77	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	61.5	0.3	6.3	0.0	0.0	0.0	0.0	0.0	-0.5
203	17624286.79	5050362.77	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	61.5	0.6	3.1	0.0	0.0	1.7	0.0	0.0	2.6
203	17624286.79	5050362.77	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	61.5	1.2	-0.4	0.0	0.0	5.1	0.0	0.0	-0.6
203	17624286.79	5050362.77	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	61.5	3.2	-0.9	0.0	0.0	5.7	0.0	0.0	-5.4
203	17624286.79	5050362.77	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	61.5	11.0	-0.9	0.0	0.0	5.7	0.0	0.0	-21.3
203	17624286.79	5050362.77	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	61.5	39.1	-0.9	0.0	0.0	5.7	0.0	0.0	-57.7

Point Source, ISO 9613, Name: "HVAC Condenser 8", ID: "HVAC_condenser8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
213	17624300.95	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	61.6	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-38.7
213	17624300.95	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	61.6	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-18.0
213	17624300.95	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	61.6	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-5.1
213	17624300.95	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	61.6	0.4	6.3	0.0	0.0	0.0	0.0	0.0	-0.6
213	17624300.95	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	61.6	0.7	3.1	0.0	0.0	1.7	0.0	0.0	2.5
213	17624300.95	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	61.6	1.2	-0.4	0.0	0.0	5.1	0.0	0.0	-0.7
213	17624300.95	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	61.6	3.3	-0.9	0.0	0.0	5.7	0.0	0.0	-5.5
213	17624300.95	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	61.6	11.1	-0.9	0.0	0.0	5.7	0.0	0.0	-21.5
213	17624300.95	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	61.6	39.6	-0.9	0.0	0.0	5.7	0.0	0.0	-58.3

Point Source, ISO 9613, Name: "HVAC Condenser 9", ID: "HVAC_condenser9"																				
Nr.	X	Y	Z	Ref.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
215	17624296.83	5050362.76	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	61.6	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-38.8
215	17624296.83	5050362.76	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	61.6	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-18.0
215	17624296.83	5050362.76	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	61.6	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-5.2
215	17624296.83	5050362.76	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	61.6	0.4	6.3	0.0	0.0	0.0	0.0	0.0	-0.7
215	17624296.83	5050362.76	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	61.6	0.7	3.1	0.0	0.0	1.7	0.0	0.0	2.5
215	17624296.83	5050362.76	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	61.6	1.2	-0.4	0.0	0.0	5.2	0.0	0.0	-0.7
215	17624296.83	5050362.76	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	61.6	3.3	-0.9	0.0	0.0	5.7	0.0	0.0	-5.6
215	17624296.83	5050362.76	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	61.6	11.1	-0.9	0.0	0.0	5.7	0.0	0.0	-21.6
215	17624296.83	5050362.76	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	61.6	39.7	-0.9	0.0	0.0	5.7	0.0	0.0	-58.5

Point Source, ISO 9613, Name: "UPS 3", ID: "UPS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
217	17624288.82	5050378.40	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	61.2	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-40.4
217	17624288.82	5050378.40	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	61.2	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-27.7
217	17624288.82	5050378.40	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	61.2	0.1	2.1	0.0	0.0	2.7	0.0	0.0	-7.6
217	17624288.82	5050378.40	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	61.2	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-9.1
217	17624288.82	5050378.40	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	61.2	0.6	4.7	0.0	0.0	0.0	0.0	0.0	-5.4
217	17624288.82	5050378.40	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	61.2	1.2	-0.4	0.0	0.0	5.2	0.0	0.0	-2.0
217	17624288.82	5050378.40	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	61.2	3.1	-1.0	0.0	0.0	5.8	0.0	0.0	-2.6
217	17624288.82	5050378.40	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	61.2	10.6	-1.0	0.0	0.0	5.8	0.0	0.0	-14.5
217	17624288.82	5050378.40	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	61.2	37.7	-1.0	0.0	0.0	5.9	0.0	0.0	-53.1

Point Source, ISO 9613, Name: "UPS 1", ID: "UPS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
219	17624278.90	5050367.58	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	61.3	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-40.5
219	17624278.90	5050367.58	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	61.3	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-27.8
219	17624278.90	5050367.58	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	61.3	0.1	2.1	0.0	0.0	2.7	0.0	0.0	-7.7
219	17624278.90	5050367.58	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	61.3	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-9.2
219	17624278.90	5050367.58	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	61.3	0.6	4.7	0.0	0.0	0.1	0.0	0.0	-5.6
219	17624278.90	5050367.58	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	61.3	1.2	-0.4	0.0	0.0	5.2	0.0	0.0	-2.2
219	17624278.90	5050367.58	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	61.3	3.2	-1.0	0.0	0.0	6.0	0.0	0.0	-2.8
219	17624278.90	5050367.58	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	61.3	10.7	-1.0	0.0	0.0	6.1	0.0	0.0	-15.0
219	17624278.90	5050367.58	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	61.3	38.1	-1.0	0.0	0.0	6.5	0.0	0.0	-54.2

Point Source, ISO 9613, Name: "UPS 7", ID: "UPS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
221	17624296.42	5050378.45	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	61.3	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-40.5
221	17624296.42	5050378.45	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	61.3	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-27.8
221	17624296.42	5050378.45	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	61.3	0.1	2.1	0.0	0.0	2.6	0.0	0.0	-7.8
221	17624296.42	5050378.45	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	61.3	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-9.3
221	17624296.42	5050378.45	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	61.3	0.6	4.7	0.0	0.0	0.1	0.0	0.0	-5.6
221	17624296.42	5050378.45	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	61.3	1.2	-0.4	0.0	0.0	5.2	0.0	0.0	-2.1
221	17624296.42	5050378.45	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	61.3	3.2	-1.0	0.0	0.0	5.9	0.0	0.0	-2.8
221	17624296.42	5050378.45	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	61.3	10.7	-1.0	0.0	0.0	6.0	0.0	0.0	-14.9
221	17624296.42	5050378.45	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	61.3	38.2	-1.0	0.0	0.0	6.2	0.0	0.0	-54.0

Point Source, ISO 9613, Name: "UPS 4", ID: "UPS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
223	17624293.53	5050373.46	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	61.4	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-40.6
223	17624293.53	5050373.46	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	61.4	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-27.9
223	17624293.53	5050373.46	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	61.4	0.1	2.2	0.0	0.0	2.6	0.0	0.0	-7.8
223	17624293.53	5050373.46	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	61.4	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-9.3
223	17624293.53	5050373.46	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	61.4	0.6	4.7	0.0	0.0	0.1	0.0	0.0	-5.7
223	17624293.53	5050373.46	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	61.4	1.2	-0.4	0.0	0.0	5.2	0.0	0.0	-2.3
223	17624293.53	5050373.46	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	61.4	3.2	-1.0	0.0	0.0	6.0	0.0	0.0	-3.0
223	17624293.53	5050373.46	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	61.4	10.8	-1.0	0.0	0.0	6.2	0.0	0.0	-15.2
223	17624293.53	5050373.46	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	61.4	38.5	-1.0	0.0	0.0	6.5	0.0	0.0	-54.7

Point Source, ISO 9613, Name: "UPS 5", ID: "UPS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
253	17624286.54	5050367.66	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	61.4	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-40.6
253	17624286.54	5050367.66	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	61.4	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-27.9
253	17624286.54	5050367.66	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	61.4	0.1	2.2	0.0	0.0	2.6	0.0	0.0	-7.9
253	17624286.54	5050367.66	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	61.4	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-9.4
253	17624286.54	5050367.66	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	61.4	0.6	4.7	0.0	0.0	0.1	0.0	0.0	-5.7
253	17624286.54	5050367.66	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	61.4	1.2	-0.4	0.0	0.0	5.3	0.0	0.0	-2.3
253	17624286.54	5050367.66	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	61.4	3.2	-1.0	0.0	0.0	6.1	0.0	0.0	-3.1
253	17624286.54	5050367.66	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	61.4	10.8	-1.0	0.0	0.0	6.3	0.0	0.0	-15.4
253	17624286.54	5050367.66	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	61.4	38.6	-1.0	0.0	0.0	6.8	0.0	0.0	-55.1

Point Source, ISO 9613, Name: "UPS 2", ID: "UPS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
255	17624283.74	5050362.73	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	61.4	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-40.7
255	17624283.74	5050362.73	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	61.4	0.0	-5.0	0.0	0.0	9.8	0.0	0.0	-28.0
255	17624283.74	5050362.73	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	61.4	0.1	2.2	0.0	0.0	2.6	0.0	0.0	-7.9
255	17624283.74	5050362.73	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	61.4	0.3	9.4	0.0	0.0	0.0	0.0	0.0	-9.4
255	17624283.74	5050362.73	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	61.4	0.6	4.7	0.0	0.0	0.1	0.0	0.0	-5.8
255	17624283.74	5050362.73	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	61.4	1.2	-0.4	0.0	0.0	5.4	0.0	0.0	-2.5
255	17624283.74	5050362.73	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	61.4	3.2	-1.0	0.0	0.0	6.2	0.0	0.0	-3.3
255	17624283.74	5050362.73	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	61.4	10.9	-1.0	0.0	0.0	6.6	0.0	0.0	-15.9
255	17624283.74	5050362.73	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	61.4	38.9	-1.0	0.0	0.0	7.4	0.0	0.0	-56.0

Point Source, ISO 9613, Name: "UPS 8", ID: "UPS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
272	17624296.53	5050367.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	61.5	0.0	-5.1	0.0	0.0	9.8	0.0	0.0	-40.7
272	17624296.53	5050367.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	61.5	0.0	-5.1	0.0	0.0	9.8	0.0	0.0	-28.0
272	17624296.53	5050367.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	61.5	0.1	2.2	0.0	0.0	2.6	0.0	0.0	-8.0
272	17624296.53	5050367.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	61.5	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-9.5
272	17624296.53	5050367.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	61.5	0.6	4.7	0.0	0.0	0.2	0.0	0.0	-5.9
272	17624296.53	5050367.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	61.5	1.2	-0.4	0.0	0.0	5.4	0.0	0.0	-2.6
272	17624296.53	5050367.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	61.5	3.2	-1.0	0.0	0.0	6.2	0.0	0.0	-3.5
272	17624296.53	5050367.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	61.5	11.0	-1.0	0.0	0.0	6.7	0.0	0.0	-16.1
272	17624296.53	5050367.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	61.5	39.2	-1.0	0.0	0.0	7.4	0.0	0.0	-56.5

Point Source, ISO 9613, Name: "UPS 6", ID: "UPS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
277	17624291.19	5050362.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	61.5	0.0	-5.1	0.0	0.0	9.8	0.0	0.0	-40.8
277	17624291.19	5050362.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	61.5	0.0	-5.1	0.0	0.0	9.9	0.0	0.0	-28.1
277	17624291.19	5050362.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	61.5	0.1	2.2	0.0	0.0	2.6	0.0	0.0	-8.1
277	17624291.19	5050362.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	61.5	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-9.5
277	17624291.19	5050362.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	61.5	0.6	4.7	0.0	0.0	0.2	0.0	0.0	-6.0
277	17624291.19	5050362.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	61.5	1.2	-0.4	0.0	0.0	5.4	0.0	0.0	-2.7
277	17624291.19	5050362.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	61.5	3.3	-1.0	0.0	0.0	6.3	0.0	0.0	-3.6
277	17624291.19	5050362.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	61.5	11.0	-1.0	0.0	0.0	6.8	0.0	0.0	-16.3
277	17624291.19	5050362.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	61.5	39.4	-1.0	0.0	0.0	7.7	0.0	0.0	-56.9

Point Source, ISO 9613, Name: "UPS 9", ID: "UPS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
279	17624301.15	5050362.78	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	61.7	0.0	-5.1	0.0	0.0	9.9	0.0	0.0	-40.9
279	17624301.15	5050362.78	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	61.7	0.0	-5.1	0.0	0.0	9.9	0.0	0.0	-28.2
279	17624301.15	5050362.78	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	61.7	0.1	2.3	0.0	0.0	2.6	0.0	0.0	-8.2
279	17624301.15	5050362.78	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	61.7	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-9.7
279	17624301.15	5050362.78	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	61.7	0.7	4.7	0.0	0.0	0.2	0.0	0.0	-6.2
279	17624301.15	5050362.78	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	61.7	1.3	-0.4	0.0	0.0	5.6	0.0	0.0	-2.9
279	17624301.15	5050362.78	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	61.7	3.3	-1.0	0.0	0.0	6.6	0.0	0.0	-4.0
279	17624301.15	5050362.78	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	61.7	11.2	-1.0	0.0	0.0	7.2	0.0	0.0	-17.0
279	17624301.15	5050362.78	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	61.7	40.0	-1.0	0.0	0.0	8.3	0.0	0.0	-58.3

Receiver

Name: POR2

ID: POR2

X: 17624519.84 m

Y: 5050722.48 m

Z: 323.81 m

Point Source, ISO 9613, Name: "Transformer 4MW", ID: "transformer_4MW"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
45	17624270.19	5050367.48	342.00	0	DEN	32	41.6	0.0	0.0	0.0	0.0	63.8	0.0	-4.7	0.0	0.0	9.4	0.0	0.0	-27.0
45	17624270.19	5050367.48	342.00	0	DEN	63	62.8	0.0	0.0	0.0	0.0	63.8	0.1	-4.7	0.0	0.0	9.4	0.0	0.0	-5.8
45	17624270.19	5050367.48	342.00	0	DEN	125	76.9	0.0	0.0	0.0	0.0	63.8	0.2	3.8	0.0	0.0	1.0	0.0	0.0	8.2
45	17624270.19	5050367.48	342.00	0	DEN	250	68.4	0.0	0.0	0.0	0.0	63.8	0.5	5.0	0.0	0.0	0.0	0.0	0.0	-0.8
45	17624270.19	5050367.48	342.00	0	DEN	500	69.8	0.0	0.0	0.0	0.0	63.8	0.8	0.8	0.0	0.0	3.9	0.0	0.0	0.4
45	17624270.19	5050367.48	342.00	0	DEN	1000	71.0	0.0	0.0	0.0	0.0	63.8	1.6	-0.8	0.0	0.0	5.6	0.0	0.0	0.9
45	17624270.19	5050367.48	342.00	0	DEN	2000	69.2	0.0	0.0	0.0	0.0	63.8	4.2	-0.9	0.0	0.0	5.7	0.0	0.0	-3.5
45	17624270.19	5050367.48	342.00	0	DEN	4000	71.0	0.0	0.0	0.0	0.0	63.8	14.2	-0.9	0.0	0.0	5.7	0.0	0.0	-11.8
45	17624270.19	5050367.48	342.00	0	DEN	8000	51.9	0.0	0.0	0.0	0.0	63.8	50.8	-0.9	0.0	0.0	5.7	0.0	0.0	-67.4

Point Source, ISO 9613, Name: "HVAC Economizer Hood 7", ID: "HVAC_hood7"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
58	17624301.74	5050377.18	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.2	0.0	-4.1	0.0	0.0	8.9	0.0	0.0	-35.7
58	17624301.74	5050377.18	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.2	0.0	-4.1	0.0	0.0	8.9	0.0	0.0	-15.0
58	17624301.74	5050377.18	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.2	0.2	4.3	0.0	0.0	0.5	0.0	0.0	-2.1
58	17624301.74	5050377.18	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.2	0.4	1.9	0.0	0.0	2.9	0.0	0.0	3.9
58	17624301.74	5050377.18	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.2	0.8	-0.8	0.0	0.0	5.6	0.0	0.0	5.5
58	17624301.74	5050377.18	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.2	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	2.1
58	17624301.74	5050377.18	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.2	4.0	-0.8	0.0	0.0	5.6	0.0	0.0	-3.1
58	17624301.74	5050377.18	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.2	13.4	-0.8	0.0	0.0	5.6	0.0	0.0	-20.8
58	17624301.74	5050377.18	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.2	47.8	-0.8	0.0	0.0	5.6	0.0	0.0	-63.5

Point Source, ISO 9613, Name: "HVAC Economizer Hood 3", ID: "HVAC_hood3"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
135	17624294.15	5050377.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.3	0.0	-4.1	0.0	0.0	8.9	0.0	0.0	-35.8
135	17624294.15	5050377.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.3	0.1	-4.1	0.0	0.0	8.9	0.0	0.0	-15.0
135	17624294.15	5050377.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.3	0.2	4.3	0.0	0.0	0.5	0.0	0.0	-2.2
135	17624294.15	5050377.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.3	0.4	1.9	0.0	0.0	2.9	0.0	0.0	3.8
135	17624294.15	5050377.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.3	0.8	-0.8	0.0	0.0	5.6	0.0	0.0	5.4
135	17624294.15	5050377.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.3	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	2.0
135	17624294.15	5050377.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.3	4.0	-0.8	0.0	0.0	5.6	0.0	0.0	-3.3
135	17624294.15	5050377.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.3	13.5	-0.8	0.0	0.0	5.6	0.0	0.0	-21.0
135	17624294.15	5050377.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.3	48.3	-0.8	0.0	0.0	5.6	0.0	0.0	-64.1

Point Source, ISO 9613, Name: "HVAC Economizer Hood 8", ID: "HVAC_hood8"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
143	17624301.95	5050366.49	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.4	0.0	-4.2	0.0	0.0	8.9	0.0	0.0	-35.9
143	17624301.95	5050366.49	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.4	0.1	-4.2	0.0	0.0	8.9	0.0	0.0	-15.1
143	17624301.95	5050366.49	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.4	0.2	4.3	0.0	0.0	0.4	0.0	0.0	-2.3
143	17624301.95	5050366.49	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.4	0.4	1.9	0.0	0.0	2.9	0.0	0.0	3.7
143	17624301.95	5050366.49	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.4	0.8	-0.8	0.0	0.0	5.6	0.0	0.0	5.3
143	17624301.95	5050366.49	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.4	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	1.9
143	17624301.95	5050366.49	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.4	4.0	-0.8	0.0	0.0	5.6	0.0	0.0	-3.4
143	17624301.95	5050366.49	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.4	13.7	-0.8	0.0	0.0	5.6	0.0	0.0	-21.3
143	17624301.95	5050366.49	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.4	48.8	-0.8	0.0	0.0	5.6	0.0	0.0	-64.7

Point Source, ISO 9613, Name: "HVAC Economizer Hood 4", ID: "HVAC_hood4"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
145	17624288.27	5050374.68	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.4	0.0	-4.2	0.0	0.0	8.9	0.0	0.0	-35.9

Point Source, ISO 9613, Name: "HVAC Economizer Hood 4", ID: "HVAC_hood4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
145	17624288.27	5050374.68	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.4	0.1	-4.2	0.0	0.0	8.9	0.0	0.0	-15.2
145	17624288.27	5050374.68	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.4	0.2	4.3	0.0	0.0	0.4	0.0	0.0	-2.3
145	17624288.27	5050374.68	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.4	0.4	1.9	0.0	0.0	2.9	0.0	0.0	3.7
145	17624288.27	5050374.68	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.4	0.8	-0.8	0.0	0.0	5.6	0.0	0.0	5.2
145	17624288.27	5050374.68	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.4	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	1.9
145	17624288.27	5050374.68	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.4	4.0	-0.8	0.0	0.0	5.6	0.0	0.0	-3.4
145	17624288.27	5050374.68	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.4	13.7	-0.8	0.0	0.0	5.6	0.0	0.0	-21.3
145	17624288.27	5050374.68	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.4	48.9	-0.8	0.0	0.0	5.6	0.0	0.0	-64.8

Point Source, ISO 9613, Name: "HVAC Economizer Hood 9", ID: "HVAC_hood9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
147	17624295.94	5050364.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.5	0.0	-4.2	0.0	0.0	9.0	0.0	0.0	-36.0
147	17624295.94	5050364.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.5	0.1	-4.2	0.0	0.0	9.0	0.0	0.0	-15.3
147	17624295.94	5050364.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.5	0.2	4.3	0.0	0.0	0.4	0.0	0.0	-2.4
147	17624295.94	5050364.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.5	0.4	1.9	0.0	0.0	2.9	0.0	0.0	3.6
147	17624295.94	5050364.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.5	0.8	-0.8	0.0	0.0	5.6	0.0	0.0	5.1
147	17624295.94	5050364.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.5	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	1.8
147	17624295.94	5050364.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.5	4.1	-0.8	0.0	0.0	5.6	0.0	0.0	-3.6
147	17624295.94	5050364.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.5	13.9	-0.8	0.0	0.0	5.6	0.0	0.0	-21.6
147	17624295.94	5050364.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.5	49.5	-0.8	0.0	0.0	5.6	0.0	0.0	-65.4

Point Source, ISO 9613, Name: "HVAC Economizer Hood 5", ID: "HVAC_hood5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
149	17624291.94	5050366.35	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.5	0.0	-4.2	0.0	0.0	9.0	0.0	0.0	-36.0
149	17624291.94	5050366.35	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.5	0.1	-4.2	0.0	0.0	9.0	0.0	0.0	-15.3
149	17624291.94	5050366.35	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.5	0.2	4.3	0.0	0.0	0.4	0.0	0.0	-2.4
149	17624291.94	5050366.35	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.5	0.4	1.9	0.0	0.0	2.9	0.0	0.0	3.6
149	17624291.94	5050366.35	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.5	0.8	-0.8	0.0	0.0	5.6	0.0	0.0	5.1
149	17624291.94	5050366.35	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.5	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	1.7
149	17624291.94	5050366.35	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.5	4.1	-0.8	0.0	0.0	5.6	0.0	0.0	-3.6
149	17624291.94	5050366.35	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.5	13.9	-0.8	0.0	0.0	5.6	0.0	0.0	-21.6
149	17624291.94	5050366.35	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.5	49.5	-0.8	0.0	0.0	5.6	0.0	0.0	-65.5

Point Source, ISO 9613, Name: "HVAC Economizer Hood 1", ID: "HVAC_hood1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
151	17624284.42	5050366.44	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.6	0.0	-4.2	0.0	0.0	9.0	0.0	0.0	-36.1
151	17624284.42	5050366.44	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.6	0.1	-4.2	0.0	0.0	9.0	0.0	0.0	-15.3
151	17624284.42	5050366.44	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.6	0.2	4.3	0.0	0.0	0.4	0.0	0.0	-2.5
151	17624284.42	5050366.44	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.6	0.4	1.9	0.0	0.0	2.9	0.0	0.0	3.5
151	17624284.42	5050366.44	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.6	0.8	-0.8	0.0	0.0	5.6	0.0	0.0	5.0
151	17624284.42	5050366.44	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.6	1.6	-0.8	0.0	0.0	5.6	0.0	0.0	1.7
151	17624284.42	5050366.44	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.6	4.1	-0.8	0.0	0.0	5.6	0.0	0.0	-3.7
151	17624284.42	5050366.44	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.6	14.0	-0.8	0.0	0.0	5.6	0.0	0.0	-21.8
151	17624284.42	5050366.44	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.6	49.9	-0.8	0.0	0.0	5.6	0.0	0.0	-66.0

Point Source, ISO 9613, Name: "HVAC Economizer Hood 6", ID: "HVAC_hood6"																				
Nr.	X	Y	Z	Ref.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
156	17624285.84	5050363.98	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.6	0.0	-4.2	0.0	0.0	9.0	0.0	0.0	-36.1
156	17624285.84	5050363.98	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.6	0.1	-4.2	0.0	0.0	9.0	0.0	0.0	-15.4
156	17624285.84	5050363.98	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.6	0.2	4.3	0.0	0.0	0.4	0.0	0.0	-2.5
156	17624285.84	5050363.98	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.6	0.4	1.9	0.0	0.0	2.9	0.0	0.0	3.5
156	17624285.84	5050363.98	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.6	0.8	-0.8	0.0	0.0	5.6	0.0	0.0	5.0
156	17624285.84	5050363.98	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.6	1.6	-0.8	0.0	0.0	5.6	0.0	0.0	1.6
156	17624285.84	5050363.98	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.6	4.1	-0.8	0.0	0.0	5.6	0.0	0.0	-3.7
156	17624285.84	5050363.98	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.6	14.0	-0.8	0.0	0.0	5.6	0.0	0.0	-21.8
156	17624285.84	5050363.98	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.6	50.1	-0.8	0.0	0.0	5.6	0.0	0.0	-66.2

Point Source, ISO 9613, Name: "HVAC Economizer Hood 2", ID: "HVAC_hood2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
159	17624278.29	5050363.89	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.7	0.0	-4.2	0.0	0.0	9.0	0.0	0.0	-36.2
159	17624278.29	5050363.89	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.7	0.1	-4.2	0.0	0.0	9.0	0.0	0.0	-15.5
159	17624278.29	5050363.89	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.7	0.2	4.4	0.0	0.0	0.4	0.0	0.0	-2.6
159	17624278.29	5050363.89	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.7	0.5	1.9	0.0	0.0	2.9	0.0	0.0	3.4
159	17624278.29	5050363.89	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.7	0.8	-0.8	0.0	0.0	5.6	0.0	0.0	4.9
159	17624278.29	5050363.89	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.7	1.6	-0.8	0.0	0.0	5.6	0.0	0.0	1.5
159	17624278.29	5050363.89	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.7	4.2	-0.8	0.0	0.0	5.6	0.0	0.0	-3.9
159	17624278.29	5050363.89	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.7	14.2	-0.8	0.0	0.0	5.6	0.0	0.0	-22.1
159	17624278.29	5050363.89	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.7	50.6	-0.8	0.0	0.0	5.6	0.0	0.0	-66.8

Point Source, ISO 9613, Name: "Transformer 2MW", ID: "transformer_2MW"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
161	17624280.40	5050378.87	342.00	0	DEN	32	38.6	0.0	0.0	0.0	0.0	63.4	0.0	-4.6	0.0	0.0	9.4	0.0	0.0	-29.6
161	17624280.40	5050378.87	342.00	0	DEN	63	59.8	0.0	0.0	0.0	0.0	63.4	0.1	-4.6	0.0	0.0	9.4	0.0	0.0	-8.5
161	17624280.40	5050378.87	342.00	0	DEN	125	73.9	0.0	0.0	0.0	0.0	63.4	0.2	3.7	0.0	0.0	1.0	0.0	0.0	5.5
161	17624280.40	5050378.87	342.00	0	DEN	250	65.4	0.0	0.0	0.0	0.0	63.4	0.4	5.0	0.0	0.0	0.0	0.0	0.0	-3.5
161	17624280.40	5050378.87	342.00	0	DEN	500	66.8	0.0	0.0	0.0	0.0	63.4	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-2.2
161	17624280.40	5050378.87	342.00	0	DEN	1000	68.0	0.0	0.0	0.0	0.0	63.4	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	-1.8
161	17624280.40	5050378.87	342.00	0	DEN	2000	66.2	0.0	0.0	0.0	0.0	63.4	4.1	-0.9	0.0	0.0	5.7	0.0	0.0	-6.1
161	17624280.40	5050378.87	342.00	0	DEN	4000	68.0	0.0	0.0	0.0	0.0	63.4	13.7	-0.9	0.0	0.0	5.7	0.0	0.0	-14.0
161	17624280.40	5050378.87	342.00	0	DEN	8000	48.9	0.0	0.0	0.0	0.0	63.4	49.0	-0.9	0.0	0.0	5.7	0.0	0.0	-68.3

Point Source, ISO 9613, Name: "PCS 7", ID: "PCS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
169	17624298.22	5050378.41	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.2	0.0	-4.6	0.0	0.0	9.3	0.0	0.0	-37.8
169	17624298.22	5050378.41	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.2	0.0	-4.6	0.0	0.0	9.3	0.0	0.0	-25.1
169	17624298.22	5050378.41	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.2	0.2	3.7	0.0	0.0	1.1	0.0	0.0	-5.0
169	17624298.22	5050378.41	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.2	0.4	5.0	0.0	0.0	0.0	0.0	0.0	-2.2
169	17624298.22	5050378.41	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.2	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-3.0
169	17624298.22	5050378.41	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.2	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	0.3
169	17624298.22	5050378.41	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.2	4.0	-0.9	0.0	0.0	5.7	0.0	0.0	-0.8
169	17624298.22	5050378.41	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.2	13.4	-0.9	0.0	0.0	5.7	0.0	0.0	-14.7
169	17624298.22	5050378.41	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.2	47.9	-0.9	0.0	0.0	5.8	0.0	0.0	-60.6

Point Source, ISO 9613, Name: "PCS 3", ID: "PCS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
171	17624290.73	5050378.40	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.3	0.0	-4.6	0.0	0.0	9.4	0.0	0.0	-37.9
171	17624290.73	5050378.40	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.3	0.1	-4.6	0.0	0.0	9.4	0.0	0.0	-25.2
171	17624290.73	5050378.40	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.3	0.2	3.7	0.0	0.0	1.1	0.0	0.0	-5.1
171	17624290.73	5050378.40	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.3	0.4	5.0	0.0	0.0	0.0	0.0	0.0	-2.3
171	17624290.73	5050378.40	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.3	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-3.1
171	17624290.73	5050378.40	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.3	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	0.2
171	17624290.73	5050378.40	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.3	4.0	-0.9	0.0	0.0	5.7	0.0	0.0	-0.9
171	17624290.73	5050378.40	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.3	13.6	-0.9	0.0	0.0	5.7	0.0	0.0	-14.9
171	17624290.73	5050378.40	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.3	48.4	-0.9	0.0	0.0	5.7	0.0	0.0	-61.2

Point Source, ISO 9613, Name: "PCS 4", ID: "PCS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
184	17624291.60	5050373.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.4	0.0	-4.6	0.0	0.0	9.4	0.0	0.0	-37.9
184	17624291.60	5050373.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.4	0.1	-4.6	0.0	0.0	9.4	0.0	0.0	-25.2
184	17624291.60	5050373.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.4	0.2	3.7	0.0	0.0	1.0	0.0	0.0	-5.2
184	17624291.60	5050373.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.4	0.4	5.0	0.0	0.0	0.0	0.0	0.0	-2.4
184	17624291.60	5050373.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.4	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-3.1
184	17624291.60	5050373.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.4	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	0.2
184	17624291.60	5050373.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.4	4.0	-0.9	0.0	0.0	5.7	0.0	0.0	-1.0
184	17624291.60	5050373.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.4	13.7	-0.9	0.0	0.0	5.7	0.0	0.0	-15.1
184	17624291.60	5050373.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.4	48.8	-0.9	0.0	0.0	5.8	0.0	0.0	-61.7

Point Source, ISO 9613, Name: "PCS 8", ID: "PCS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
185	17624298.45	5050367.65	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.4	0.0	-4.6	0.0	0.0	9.4	0.0	0.0	-38.0
185	17624298.45	5050367.65	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.4	0.1	-4.6	0.0	0.0	9.4	0.0	0.0	-25.3
185	17624298.45	5050367.65	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.4	0.2	3.7	0.0	0.0	1.0	0.0	0.0	-5.2
185	17624298.45	5050367.65	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.4	0.4	5.0	0.0	0.0	0.0	0.0	0.0	-2.4
185	17624298.45	5050367.65	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.4	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-3.2
185	17624298.45	5050367.65	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.4	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	0.1
185	17624298.45	5050367.65	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.4	4.0	-0.9	0.0	0.0	5.7	0.0	0.0	-1.1
185	17624298.45	5050367.65	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.4	13.7	-0.9	0.0	0.0	5.8	0.0	0.0	-15.3
185	17624298.45	5050367.65	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.4	48.9	-0.9	0.0	0.0	5.9	0.0	0.0	-62.0

Point Source, ISO 9613, Name: "PCS 10", ID: "PCS10"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
193	17624280.69	5050376.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.5	0.0	-4.6	0.0	0.0	9.4	0.0	0.0	-38.0
193	17624280.69	5050376.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.5	0.1	-4.6	0.0	0.0	9.4	0.0	0.0	-25.3
193	17624280.69	5050376.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.5	0.2	3.8	0.0	0.0	1.0	0.0	0.0	-5.3
193	17624280.69	5050376.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.5	0.4	5.0	0.0	0.0	0.0	0.0	0.0	-2.5
193	17624280.69	5050376.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.5	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-3.2
193	17624280.69	5050376.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.5	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	0.1
193	17624280.69	5050376.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.5	4.1	-0.9	0.0	0.0	5.7	0.0	0.0	-1.1
193	17624280.69	5050376.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.5	13.8	-0.9	0.0	0.0	5.7	0.0	0.0	-15.3
193	17624280.69	5050376.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.5	49.2	-0.9	0.0	0.0	5.7	0.0	0.0	-62.1

Point Source, ISO 9613, Name: "PCS 11", ID: "PCS11"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
195	17624280.74	5050375.25	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.5	0.0	-4.6	0.0	0.0	9.4	0.0	0.0	-38.0
195	17624280.74	5050375.25	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.5	0.1	-4.6	0.0	0.0	9.4	0.0	0.0	-25.3
195	17624280.74	5050375.25	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.5	0.2	3.8	0.0	0.0	1.0	0.0	0.0	-5.3
195	17624280.74	5050375.25	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.5	0.4	5.0	0.0	0.0	0.0	0.0	0.0	-2.5
195	17624280.74	5050375.25	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.5	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-3.2
195	17624280.74	5050375.25	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.5	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	0.0
195	17624280.74	5050375.25	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.5	4.1	-0.9	0.0	0.0	5.7	0.0	0.0	-1.1
195	17624280.74	5050375.25	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.5	13.8	-0.9	0.0	0.0	5.7	0.0	0.0	-15.3
195	17624280.74	5050375.25	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.5	49.3	-0.9	0.0	0.0	5.7	0.0	0.0	-62.3

Point Source, ISO 9613, Name: "PCS 9", ID: "PCS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
224	17624299.21	5050362.68	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.5	0.0	-4.6	0.0	0.0	9.4	0.0	0.0	-38.0
224	17624299.21	5050362.68	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.5	0.1	-4.6	0.0	0.0	9.4	0.0	0.0	-25.3
224	17624299.21	5050362.68	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.5	0.2	3.8	0.0	0.0	1.0	0.0	0.0	-5.3
224	17624299.21	5050362.68	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.5	0.4	5.0	0.0	0.0	0.0	0.0	0.0	-2.5
224	17624299.21	5050362.68	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.5	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-3.3
224	17624299.21	5050362.68	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.5	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	-0.0
224	17624299.21	5050362.68	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.5	4.1	-0.9	0.0	0.0	5.8	0.0	0.0	-1.2
224	17624299.21	5050362.68	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.5	13.8	-0.9	0.0	0.0	5.8	0.0	0.0	-15.5
224	17624299.21	5050362.68	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.5	49.4	-0.9	0.0	0.0	6.0	0.0	0.0	-62.6

Point Source, ISO 9613, Name: "PCS 5", ID: "PCS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
238	17624288.51	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.5	0.0	-4.6	0.0	0.0	9.4	0.0	0.0	-38.1
238	17624288.51	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.5	0.1	-4.6	0.0	0.0	9.4	0.0	0.0	-25.4
238	17624288.51	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.5	0.2	3.8	0.0	0.0	1.0	0.0	0.0	-5.4
238	17624288.51	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.5	0.4	5.0	0.0	0.0	0.0	0.0	0.0	-2.5
238	17624288.51	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.5	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-3.3
238	17624288.51	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.5	1.6	-0.8	0.0	0.0	5.6	0.0	0.0	-0.0
238	17624288.51	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.5	4.1	-0.9	0.0	0.0	5.7	0.0	0.0	-1.2
238	17624288.51	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.5	13.9	-0.9	0.0	0.0	5.8	0.0	0.0	-15.5
238	17624288.51	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.5	49.6	-0.9	0.0	0.0	5.8	0.0	0.0	-62.6

Point Source, ISO 9613, Name: "PCS 6", ID: "PCS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
256	17624289.16	5050362.78	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.6	0.0	-4.6	0.0	0.0	9.4	0.0	0.0	-38.1
256	17624289.16	5050362.78	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.6	0.1	-4.6	0.0	0.0	9.4	0.0	0.0	-25.4
256	17624289.16	5050362.78	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.6	0.2	3.8	0.0	0.0	1.0	0.0	0.0	-5.4
256	17624289.16	5050362.78	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.6	0.4	5.0	0.0	0.0	0.0	0.0	0.0	-2.6
256	17624289.16	5050362.78	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.6	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-3.4
256	17624289.16	5050362.78	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.6	1.6	-0.8	0.0	0.0	5.6	0.0	0.0	-0.1
256	17624289.16	5050362.78	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.6	4.1	-0.9	0.0	0.0	5.7	0.0	0.0	-1.3
256	17624289.16	5050362.78	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.6	14.0	-0.9	0.0	0.0	5.8	0.0	0.0	-15.7
256	17624289.16	5050362.78	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.6	50.0	-0.9	0.0	0.0	5.9	0.0	0.0	-63.2

Point Source, ISO 9613, Name: "PCS 1", ID: "PCS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
258	17624280.88	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.6	0.0	-4.6	0.0	0.0	9.4	0.0	0.0	-38.1
258	17624280.88	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.6	0.1	-4.6	0.0	0.0	9.4	0.0	0.0	-25.5
258	17624280.88	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.6	0.2	3.8	0.0	0.0	1.0	0.0	0.0	-5.4
258	17624280.88	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.6	0.4	5.0	0.0	0.0	0.0	0.0	0.0	-2.6
258	17624280.88	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.6	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-3.4
258	17624280.88	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.6	1.6	-0.8	0.0	0.0	5.6	0.0	0.0	-0.1
258	17624280.88	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.6	4.1	-0.9	0.0	0.0	5.7	0.0	0.0	-1.3
258	17624280.88	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.6	14.0	-0.9	0.0	0.0	5.7	0.0	0.0	-15.7
258	17624280.88	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.6	50.0	-0.9	0.0	0.0	5.8	0.0	0.0	-63.2

Point Source, ISO 9613, Name: "PCS 2", ID: "PCS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
260	17624281.69	5050362.69	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.7	0.0	-4.6	0.0	0.0	9.4	0.0	0.0	-38.2
260	17624281.69	5050362.69	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.7	0.1	-4.6	0.0	0.0	9.4	0.0	0.0	-25.5
260	17624281.69	5050362.69	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.7	0.2	3.8	0.0	0.0	1.0	0.0	0.0	-5.5
260	17624281.69	5050362.69	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.7	0.5	5.0	0.0	0.0	0.0	0.0	0.0	-2.7
260	17624281.69	5050362.69	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.7	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-3.5
260	17624281.69	5050362.69	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.7	1.6	-0.8	0.0	0.0	5.6	0.0	0.0	-0.2
260	17624281.69	5050362.69	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.7	4.2	-0.9	0.0	0.0	5.7	0.0	0.0	-1.4
260	17624281.69	5050362.69	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.7	14.2	-0.9	0.0	0.0	5.8	0.0	0.0	-15.9
260	17624281.69	5050362.69	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.7	50.5	-0.9	0.0	0.0	5.8	0.0	0.0	-63.7

Point Source, ISO 9613, Name: "PCS 12", ID: "PCS12"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
262	17624270.58	5050364.97	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.8	0.0	-4.7	0.0	0.0	9.4	0.0	0.0	-38.3
262	17624270.58	5050364.97	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.8	0.1	-4.7	0.0	0.0	9.4	0.0	0.0	-25.6
262	17624270.58	5050364.97	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.8	0.2	3.8	0.0	0.0	0.9	0.0	0.0	-5.6
262	17624270.58	5050364.97	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.8	0.5	5.0	0.0	0.0	0.0	0.0	0.0	-2.8
262	17624270.58	5050364.97	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.8	0.8	0.8	0.0	0.0	3.9	0.0	0.0	-3.6
262	17624270.58	5050364.97	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.8	1.6	-0.8	0.0	0.0	5.6	0.0	0.0	-0.3
262	17624270.58	5050364.97	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.8	4.2	-0.9	0.0	0.0	5.7	0.0	0.0	-1.5
262	17624270.58	5050364.97	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.8	14.3	-0.9	0.0	0.0	5.7	0.0	0.0	-16.1
262	17624270.58	5050364.97	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.8	51.0	-0.9	0.0	0.0	5.7	0.0	0.0	-64.2

Point Source, ISO 9613, Name: "PCS 13", ID: "PCS13"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
294	17624270.54	5050363.56	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.8	0.0	-4.7	0.0	0.0	9.4	0.0	0.0	-38.3
294	17624270.54	5050363.56	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.8	0.1	-4.7	0.0	0.0	9.4	0.0	0.0	-25.6
294	17624270.54	5050363.56	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.8	0.2	3.8	0.0	0.0	0.9	0.0	0.0	-5.6
294	17624270.54	5050363.56	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.8	0.5	5.0	0.0	0.0	0.0	0.0	0.0	-2.8
294	17624270.54	5050363.56	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.8	0.8	0.8	0.0	0.0	3.9	0.0	0.0	-3.6
294	17624270.54	5050363.56	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.8	1.6	-0.8	0.0	0.0	5.6	0.0	0.0	-0.3
294	17624270.54	5050363.56	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.8	4.2	-0.9	0.0	0.0	5.7	0.0	0.0	-1.6
294	17624270.54	5050363.56	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.8	14.3	-0.9	0.0	0.0	5.7	0.0	0.0	-16.2
294	17624270.54	5050363.56	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.8	51.1	-0.9	0.0	0.0	5.7	0.0	0.0	-64.4

Point Source, ISO 9613, Name: "PCS 14", ID: "PCS14"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
296	17624270.56	5050362.20	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.8	0.0	-4.7	0.0	0.0	9.4	0.0	0.0	-38.4
296	17624270.56	5050362.20	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.8	0.1	-4.7	0.0	0.0	9.4	0.0	0.0	-25.7
296	17624270.56	5050362.20	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.8	0.2	3.8	0.0	0.0	0.9	0.0	0.0	-5.7
296	17624270.56	5050362.20	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.8	0.5	5.0	0.0	0.0	0.0	0.0	0.0	-2.8
296	17624270.56	5050362.20	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.8	0.8	0.8	0.0	0.0	3.9	0.0	0.0	-3.6
296	17624270.56	5050362.20	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.8	1.6	-0.8	0.0	0.0	5.6	0.0	0.0	-0.3
296	17624270.56	5050362.20	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.8	4.2	-0.9	0.0	0.0	5.7	0.0	0.0	-1.6
296	17624270.56	5050362.20	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.8	14.4	-0.9	0.0	0.0	5.7	0.0	0.0	-16.2
296	17624270.56	5050362.20	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.8	51.3	-0.9	0.0	0.0	5.8	0.0	0.0	-64.6

Point Source, ISO 9613, Name: "HVAC Condenser 7", ID: "HVAC_condenser7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
375	17624300.76	5050378.47	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.2	0.0	-4.1	0.0	0.0	8.9	0.0	0.0	-40.4
375	17624300.76	5050378.47	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.2	0.0	-4.1	0.0	0.0	8.9	0.0	0.0	-19.6
375	17624300.76	5050378.47	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.2	0.2	4.3	0.0	0.0	0.5	0.0	0.0	-6.8
375	17624300.76	5050378.47	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.2	0.4	1.9	0.0	0.0	2.9	0.0	0.0	-0.8
375	17624300.76	5050378.47	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.2	0.8	-0.8	0.0	0.0	5.6	0.0	0.0	0.8
375	17624300.76	5050378.47	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.2	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	-2.6
375	17624300.76	5050378.47	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.2	3.9	-0.8	0.0	0.0	5.6	0.0	0.0	-7.8
375	17624300.76	5050378.47	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.2	13.4	-0.8	0.0	0.0	5.6	0.0	0.0	-25.5
375	17624300.76	5050378.47	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.2	47.7	-0.8	0.0	0.0	5.6	0.0	0.0	-68.1

Point Source, ISO 9613, Name: "HVAC Condenser 3", ID: "HVAC_condenser3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
382	17624293.15	5050378.41	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.3	0.0	-4.1	0.0	0.0	8.9	0.0	0.0	-40.5
382	17624293.15	5050378.41	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.3	0.1	-4.1	0.0	0.0	8.9	0.0	0.0	-19.7
382	17624293.15	5050378.41	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.3	0.2	4.3	0.0	0.0	0.5	0.0	0.0	-6.9
382	17624293.15	5050378.41	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.3	0.4	1.9	0.0	0.0	2.9	0.0	0.0	-0.9
382	17624293.15	5050378.41	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.3	0.8	-0.8	0.0	0.0	5.6	0.0	0.0	0.7
382	17624293.15	5050378.41	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.3	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	-2.7
382	17624293.15	5050378.41	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.3	4.0	-0.8	0.0	0.0	5.6	0.0	0.0	-7.9
382	17624293.15	5050378.41	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.3	13.5	-0.8	0.0	0.0	5.6	0.0	0.0	-25.7
382	17624293.15	5050378.41	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.3	48.2	-0.8	0.0	0.0	5.6	0.0	0.0	-68.7

Point Source, ISO 9613, Name: "HVAC Condenser 8", ID: "HVAC_condenser8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
384	17624300.95	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.4	0.0	-4.2	0.0	0.0	8.9	0.0	0.0	-40.6
384	17624300.95	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.4	0.1	-4.2	0.0	0.0	8.9	0.0	0.0	-19.8
384	17624300.95	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.4	0.2	4.3	0.0	0.0	0.4	0.0	0.0	-7.0
384	17624300.95	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.4	0.4	1.9	0.0	0.0	2.9	0.0	0.0	-1.0
384	17624300.95	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.4	0.8	-0.8	0.0	0.0	5.6	0.0	0.0	0.6
384	17624300.95	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.4	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	-2.8
384	17624300.95	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.4	4.0	-0.8	0.0	0.0	5.6	0.0	0.0	-8.1
384	17624300.95	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.4	13.7	-0.8	0.0	0.0	5.6	0.0	0.0	-25.9
384	17624300.95	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.4	48.8	-0.8	0.0	0.0	5.6	0.0	0.0	-69.3

Point Source, ISO 9613, Name: "HVAC Condenser 4", ID: "HVAC_condenser4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
386	17624289.10	5050373.50	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.4	0.0	-4.2	0.0	0.0	8.9	0.0	0.0	-40.6
386	17624289.10	5050373.50	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.4	0.1	-4.2	0.0	0.0	8.9	0.0	0.0	-19.9
386	17624289.10	5050373.50	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.4	0.2	4.3	0.0	0.0	0.4	0.0	0.0	-7.0
386	17624289.10	5050373.50	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.4	0.4	1.9	0.0	0.0	2.9	0.0	0.0	-1.0
386	17624289.10	5050373.50	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.4	0.8	-0.8	0.0	0.0	5.6	0.0	0.0	0.5
386	17624289.10	5050373.50	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.4	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	-2.8
386	17624289.10	5050373.50	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.4	4.0	-0.8	0.0	0.0	5.6	0.0	0.0	-8.1
386	17624289.10	5050373.50	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.4	13.7	-0.8	0.0	0.0	5.6	0.0	0.0	-26.0
386	17624289.10	5050373.50	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.4	49.0	-0.8	0.0	0.0	5.6	0.0	0.0	-69.5

Point Source, ISO 9613, Name: "HVAC Condenser 5", ID: "HVAC_condenser5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
388	17624290.96	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.5	0.0	-4.2	0.0	0.0	9.0	0.0	0.0	-40.7
388	17624290.96	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.5	0.1	-4.2	0.0	0.0	9.0	0.0	0.0	-19.9
388	17624290.96	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.5	0.2	4.3	0.0	0.0	0.4	0.0	0.0	-7.1
388	17624290.96	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.5	0.4	1.9	0.0	0.0	2.9	0.0	0.0	-1.1
388	17624290.96	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.5	0.8	-0.8	0.0	0.0	5.6	0.0	0.0	0.4
388	17624290.96	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.5	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	-2.9
388	17624290.96	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.5	4.1	-0.8	0.0	0.0	5.6	0.0	0.0	-8.3
388	17624290.96	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.5	13.9	-0.8	0.0	0.0	5.6	0.0	0.0	-26.2
388	17624290.96	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.5	49.4	-0.8	0.0	0.0	5.6	0.0	0.0	-70.1

Point Source, ISO 9613, Name: "HVAC Condenser 9", ID: "HVAC_condenser9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
390	17624296.83	5050362.76	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.5	0.0	-4.2	0.0	0.0	9.0	0.0	0.0	-40.7
390	17624296.83	5050362.76	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.5	0.1	-4.2	0.0	0.0	9.0	0.0	0.0	-20.0
390	17624296.83	5050362.76	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.5	0.2	4.3	0.0	0.0	0.4	0.0	0.0	-7.1
390	17624296.83	5050362.76	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.5	0.4	1.9	0.0	0.0	2.9	0.0	0.0	-1.1
390	17624296.83	5050362.76	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.5	0.8	-0.8	0.0	0.0	5.6	0.0	0.0	0.4
390	17624296.83	5050362.76	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.5	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	-3.0
390	17624296.83	5050362.76	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.5	4.1	-0.8	0.0	0.0	5.6	0.0	0.0	-8.3
390	17624296.83	5050362.76	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.5	13.9	-0.8	0.0	0.0	5.6	0.0	0.0	-26.3
390	17624296.83	5050362.76	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.5	49.5	-0.8	0.0	0.0	5.6	0.0	0.0	-70.2

Point Source, ISO 9613, Name: "HVAC Condenser 1", ID: "HVAC_condenser1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
392	17624283.37	5050367.59	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.6	0.0	-4.2	0.0	0.0	9.0	0.0	0.0	-40.8
392	17624283.37	5050367.59	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.6	0.1	-4.2	0.0	0.0	9.0	0.0	0.0	-20.0
392	17624283.37	5050367.59	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.6	0.2	4.3	0.0	0.0	0.4	0.0	0.0	-7.2
392	17624283.37	5050367.59	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.6	0.4	1.9	0.0	0.0	2.9	0.0	0.0	-1.2
392	17624283.37	5050367.59	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.6	0.8	-0.8	0.0	0.0	5.6	0.0	0.0	0.3
392	17624283.37	5050367.59	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.6	1.6	-0.8	0.0	0.0	5.6	0.0	0.0	-3.0
392	17624283.37	5050367.59	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.6	4.1	-0.8	0.0	0.0	5.6	0.0	0.0	-8.4
392	17624283.37	5050367.59	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.6	14.0	-0.8	0.0	0.0	5.6	0.0	0.0	-26.5
392	17624283.37	5050367.59	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.6	49.9	-0.8	0.0	0.0	5.6	0.0	0.0	-70.7

Point Source, ISO 9613, Name: "HVAC Condenser 6", ID: "HVAC_condenser6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
394	17624286.79	5050362.77	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.7	0.0	-4.2	0.0	0.0	9.0	0.0	0.0	-40.8
394	17624286.79	5050362.77	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.7	0.1	-4.2	0.0	0.0	9.0	0.0	0.0	-20.1
394	17624286.79	5050362.77	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.7	0.2	4.3	0.0	0.0	0.4	0.0	0.0	-7.2
394	17624286.79	5050362.77	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.7	0.4	1.9	0.0	0.0	2.9	0.0	0.0	-1.2
394	17624286.79	5050362.77	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.7	0.8	-0.8	0.0	0.0	5.6	0.0	0.0	0.3
394	17624286.79	5050362.77	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.7	1.6	-0.8	0.0	0.0	5.6	0.0	0.0	-3.1
394	17624286.79	5050362.77	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.7	4.1	-0.8	0.0	0.0	5.6	0.0	0.0	-8.4
394	17624286.79	5050362.77	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.7	14.1	-0.8	0.0	0.0	5.6	0.0	0.0	-26.6
394	17624286.79	5050362.77	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.7	50.2	-0.8	0.0	0.0	5.6	0.0	0.0	-71.0

Point Source, ISO 9613, Name: "HVAC Condenser 2", ID: "HVAC_condenser2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
396	17624279.21	5050362.61	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.7	0.0	-4.2	0.0	0.0	9.0	0.0	0.0	-40.9
396	17624279.21	5050362.61	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.7	0.1	-4.2	0.0	0.0	9.0	0.0	0.0	-20.2
396	17624279.21	5050362.61	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.7	0.2	4.4	0.0	0.0	0.4	0.0	0.0	-7.3
396	17624279.21	5050362.61	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.7	0.5	1.9	0.0	0.0	2.9	0.0	0.0	-1.3
396	17624279.21	5050362.61	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.7	0.8	-0.8	0.0	0.0	5.6	0.0	0.0	0.2
396	17624279.21	5050362.61	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.7	1.6	-0.8	0.0	0.0	5.6	0.0	0.0	-3.2
396	17624279.21	5050362.61	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.7	4.2	-0.8	0.0	0.0	5.6	0.0	0.0	-8.6
396	17624279.21	5050362.61	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.7	14.2	-0.8	0.0	0.0	5.6	0.0	0.0	-26.8
396	17624279.21	5050362.61	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.7	50.7	-0.8	0.0	0.0	5.6	0.0	0.0	-71.5

Point Source, ISO 9613, Name: "UPS 7", ID: "UPS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
398	17624296.42	5050378.45	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.3	0.0	-4.6	0.0	0.0	9.3	0.0	0.0	-42.5
398	17624296.42	5050378.45	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.3	0.0	-4.6	0.0	0.0	9.3	0.0	0.0	-29.8
398	17624296.42	5050378.45	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.3	0.2	3.7	0.0	0.0	1.1	0.0	0.0	-9.8
398	17624296.42	5050378.45	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.3	0.4	5.0	0.0	0.0	0.0	0.0	0.0	-6.9
398	17624296.42	5050378.45	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.3	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-7.7
398	17624296.42	5050378.45	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.3	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	-4.4
398	17624296.42	5050378.45	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.3	4.0	-0.9	0.0	0.0	5.7	0.0	0.0	-5.5
398	17624296.42	5050378.45	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.3	13.5	-0.9	0.0	0.0	5.7	0.0	0.0	-19.5
398	17624296.42	5050378.45	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.3	48.0	-0.9	0.0	0.0	5.8	0.0	0.0	-65.5

Point Source, ISO 9613, Name: "UPS 3", ID: "UPS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
400	17624288.82	5050378.40	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.4	0.0	-4.6	0.0	0.0	9.4	0.0	0.0	-42.6
400	17624288.82	5050378.40	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.4	0.1	-4.6	0.0	0.0	9.4	0.0	0.0	-29.9
400	17624288.82	5050378.40	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.4	0.2	3.7	0.0	0.0	1.1	0.0	0.0	-9.9
400	17624288.82	5050378.40	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.4	0.4	5.0	0.0	0.0	0.0	0.0	0.0	-7.0
400	17624288.82	5050378.40	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.4	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-7.8
400	17624288.82	5050378.40	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.4	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	-4.5
400	17624288.82	5050378.40	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.4	4.0	-0.9	0.0	0.0	5.7	0.0	0.0	-5.6
400	17624288.82	5050378.40	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.4	13.6	-0.9	0.0	0.0	5.7	0.0	0.0	-19.7
400	17624288.82	5050378.40	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.4	48.5	-0.9	0.0	0.0	5.7	0.0	0.0	-66.0

Point Source, ISO 9613, Name: "UPS 4", ID: "UPS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
402	17624293.53	5050373.46	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.4	0.0	-4.6	0.0	0.0	9.4	0.0	0.0	-42.6
402	17624293.53	5050373.46	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.4	0.1	-4.6	0.0	0.0	9.4	0.0	0.0	-29.9
402	17624293.53	5050373.46	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.4	0.2	3.7	0.0	0.0	1.0	0.0	0.0	-9.9
402	17624293.53	5050373.46	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.4	0.4	5.0	0.0	0.0	0.0	0.0	0.0	-7.1
402	17624293.53	5050373.46	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.4	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-7.8
402	17624293.53	5050373.46	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.4	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	-4.5
402	17624293.53	5050373.46	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.4	4.0	-0.9	0.0	0.0	5.7	0.0	0.0	-5.7
402	17624293.53	5050373.46	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.4	13.6	-0.9	0.0	0.0	5.7	0.0	0.0	-19.8
402	17624293.53	5050373.46	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.4	48.7	-0.9	0.0	0.0	5.8	0.0	0.0	-66.3

Point Source, ISO 9613, Name: "UPS 8", ID: "UPS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
404	17624296.53	5050367.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.5	0.0	-4.6	0.0	0.0	9.4	0.0	0.0	-42.7
404	17624296.53	5050367.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.5	0.1	-4.6	0.0	0.0	9.4	0.0	0.0	-30.0
404	17624296.53	5050367.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.5	0.2	3.7	0.0	0.0	1.0	0.0	0.0	-10.0
404	17624296.53	5050367.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.5	0.4	5.0	0.0	0.0	0.0	0.0	0.0	-7.1
404	17624296.53	5050367.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.5	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-7.9
404	17624296.53	5050367.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.5	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	-4.6
404	17624296.53	5050367.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.5	4.1	-0.9	0.0	0.0	5.7	0.0	0.0	-5.8
404	17624296.53	5050367.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.5	13.7	-0.9	0.0	0.0	5.8	0.0	0.0	-20.0
404	17624296.53	5050367.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.5	49.0	-0.9	0.0	0.0	5.9	0.0	0.0	-66.8

Point Source, ISO 9613, Name: "UPS 9", ID: "UPS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
410	17624301.15	5050362.78	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.5	0.0	-4.6	0.0	0.0	9.4	0.0	0.0	-42.7
410	17624301.15	5050362.78	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.5	0.1	-4.6	0.0	0.0	9.4	0.0	0.0	-30.0
410	17624301.15	5050362.78	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.5	0.2	3.8	0.0	0.0	1.0	0.0	0.0	-10.0
410	17624301.15	5050362.78	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.5	0.4	5.0	0.0	0.0	0.0	0.0	0.0	-7.2
410	17624301.15	5050362.78	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.5	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-7.9
410	17624301.15	5050362.78	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.5	1.5	-0.8	0.0	0.0	5.6	0.0	0.0	-4.7
410	17624301.15	5050362.78	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.5	4.1	-0.9	0.0	0.0	5.8	0.0	0.0	-5.9
410	17624301.15	5050362.78	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.5	13.8	-0.9	0.0	0.0	5.9	0.0	0.0	-20.2
410	17624301.15	5050362.78	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.5	49.2	-0.9	0.0	0.0	6.0	0.0	0.0	-67.2

Point Source, ISO 9613, Name: "UPS 5", ID: "UPS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
423	17624286.54	5050367.66	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.6	0.0	-4.6	0.0	0.0	9.4	0.0	0.0	-42.8
423	17624286.54	5050367.66	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.6	0.1	-4.6	0.0	0.0	9.4	0.0	0.0	-30.1
423	17624286.54	5050367.66	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.6	0.2	3.8	0.0	0.0	1.0	0.0	0.0	-10.1
423	17624286.54	5050367.66	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.6	0.4	5.0	0.0	0.0	0.0	0.0	0.0	-7.2
423	17624286.54	5050367.66	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.6	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-8.0
423	17624286.54	5050367.66	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.6	1.6	-0.8	0.0	0.0	5.6	0.0	0.0	-4.7
423	17624286.54	5050367.66	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.6	4.1	-0.9	0.0	0.0	5.7	0.0	0.0	-5.9
423	17624286.54	5050367.66	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.6	13.9	-0.9	0.0	0.0	5.7	0.0	0.0	-20.2
423	17624286.54	5050367.66	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.6	49.7	-0.9	0.0	0.0	5.8	0.0	0.0	-67.5

Point Source, ISO 9613, Name: "UPS 6", ID: "UPS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
434	17624291.19	5050362.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.6	0.0	-4.6	0.0	0.0	9.4	0.0	0.0	-42.8
434	17624291.19	5050362.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.6	0.1	-4.6	0.0	0.0	9.4	0.0	0.0	-30.1
434	17624291.19	5050362.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.6	0.2	3.8	0.0	0.0	1.0	0.0	0.0	-10.1
434	17624291.19	5050362.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.6	0.4	5.0	0.0	0.0	0.0	0.0	0.0	-7.3
434	17624291.19	5050362.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.6	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-8.1
434	17624291.19	5050362.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.6	1.6	-0.8	0.0	0.0	5.6	0.0	0.0	-4.8
434	17624291.19	5050362.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.6	4.1	-0.9	0.0	0.0	5.7	0.0	0.0	-6.0
434	17624291.19	5050362.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.6	14.0	-0.9	0.0	0.0	5.8	0.0	0.0	-20.4
434	17624291.19	5050362.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.6	49.9	-0.9	0.0	0.0	5.9	0.0	0.0	-67.8

Point Source, ISO 9613, Name: "UPS 1", ID: "UPS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
436	17624278.90	5050367.58	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.7	0.0	-4.6	0.0	0.0	9.4	0.0	0.0	-42.9
436	17624278.90	5050367.58	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.7	0.1	-4.6	0.0	0.0	9.4	0.0	0.0	-30.2
436	17624278.90	5050367.58	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.7	0.2	3.8	0.0	0.0	1.0	0.0	0.0	-10.2
436	17624278.90	5050367.58	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.7	0.4	5.0	0.0	0.0	0.0	0.0	0.0	-7.3
436	17624278.90	5050367.58	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.7	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-8.1
436	17624278.90	5050367.58	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.7	1.6	-0.8	0.0	0.0	5.6	0.0	0.0	-4.8
436	17624278.90	5050367.58	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.7	4.1	-0.9	0.0	0.0	5.7	0.0	0.0	-6.1
436	17624278.90	5050367.58	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.7	14.1	-0.9	0.0	0.0	5.7	0.0	0.0	-20.4
436	17624278.90	5050367.58	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.7	50.2	-0.9	0.0	0.0	5.8	0.0	0.0	-68.0

Point Source, ISO 9613, Name: "UPS 2", ID: "UPS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
460	17624283.74	5050362.73	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.7	0.0	-4.6	0.0	0.0	9.4	0.0	0.0	-42.9
460	17624283.74	5050362.73	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.7	0.1	-4.6	0.0	0.0	9.4	0.0	0.0	-30.2
460	17624283.74	5050362.73	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.7	0.2	3.8	0.0	0.0	1.0	0.0	0.0	-10.2
460	17624283.74	5050362.73	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.7	0.4	5.0	0.0	0.0	0.0	0.0	0.0	-7.4
460	17624283.74	5050362.73	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.7	0.8	0.9	0.0	0.0	3.9	0.0	0.0	-8.1
460	17624283.74	5050362.73	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.7	1.6	-0.8	0.0	0.0	5.6	0.0	0.0	-4.9
460	17624283.74	5050362.73	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.7	4.2	-0.9	0.0	0.0	5.7	0.0	0.0	-6.1
460	17624283.74	5050362.73	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.7	14.1	-0.9	0.0	0.0	5.8	0.0	0.0	-20.5
460	17624283.74	5050362.73	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.7	50.3	-0.9	0.0	0.0	5.8	0.0	0.0	-68.3

Receiver

Name: POR3

ID: POR3

X: 17624219.97 m

Y: 5050763.09 m

Z: 312.88 m

Point Source, ISO 9613, Name: "Transformer 4MW", ID: "transformer_4MW"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
19	17624270.19	5050367.48	342.00	0	DEN	32	41.6	0.0	0.0	0.0	0.0	63.0	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-26.2
19	17624270.19	5050367.48	342.00	0	DEN	63	62.8	0.0	0.0	0.0	0.0	63.0	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-5.1
19	17624270.19	5050367.48	342.00	0	DEN	125	76.9	0.0	0.0	0.0	0.0	63.0	0.2	3.4	0.0	0.0	1.3	0.0	0.0	8.9
19	17624270.19	5050367.48	342.00	0	DEN	250	68.4	0.0	0.0	0.0	0.0	63.0	0.4	4.9	0.0	0.0	0.0	0.0	0.0	0.1
19	17624270.19	5050367.48	342.00	0	DEN	500	69.8	0.0	0.0	0.0	0.0	63.0	0.8	0.8	0.0	0.0	4.0	0.0	0.0	1.2
19	17624270.19	5050367.48	342.00	0	DEN	1000	71.0	0.0	0.0	0.0	0.0	63.0	1.5	-0.9	0.0	0.0	5.6	0.0	0.0	1.7
19	17624270.19	5050367.48	342.00	0	DEN	2000	69.2	0.0	0.0	0.0	0.0	63.0	3.9	-1.0	0.0	0.0	5.7	0.0	0.0	-2.5
19	17624270.19	5050367.48	342.00	0	DEN	4000	71.0	0.0	0.0	0.0	0.0	63.0	13.1	-1.0	0.0	0.0	5.7	0.0	0.0	-9.9
19	17624270.19	5050367.48	342.00	0	DEN	8000	51.9	0.0	0.0	0.0	0.0	63.0	46.7	-1.0	0.0	0.0	5.7	0.0	0.0	-62.7

Point Source, ISO 9613, Name: "HVAC Economizer Hood 3", ID: "HVAC_hood3"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
22	17624294.15	5050377.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	62.9	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-26.6
22	17624294.15	5050377.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	62.9	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-5.8
22	17624294.15	5050377.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	62.9	0.2	4.1	0.0	0.0	0.0	0.0	0.0	-1.1
22	17624294.15	5050377.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	62.9	0.4	1.8	0.0	0.0	0.0	0.0	0.0	7.2
22	17624294.15	5050377.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	62.9	0.8	-0.9	0.0	0.0	0.0	0.0	0.0	11.4
22	17624294.15	5050377.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	62.9	1.4	-0.9	0.0	0.0	0.0	0.0	0.0	8.1
22	17624294.15	5050377.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	62.9	3.8	-0.9	0.0	0.0	0.0	0.0	0.0	3.0
22	17624294.15	5050377.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	62.9	12.9	-0.9	0.0	0.0	0.0	0.0	0.0	-14.3
22	17624294.15	5050377.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	62.9	46.1	-0.9	0.0	0.0	0.0	0.0	0.0	-55.8

Point Source, ISO 9613, Name: "HVAC Economizer Hood 4", ID: "HVAC_hood4"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
23	17624288.27	5050374.68	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	62.9	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-26.6
23	17624288.27	5050374.68	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	62.9	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-5.8
23	17624288.27	5050374.68	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	62.9	0.2	4.1	0.0	0.0	0.0	0.0	0.0	-1.1
23	17624288.27	5050374.68	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	62.9	0.4	1.8	0.0	0.0	0.0	0.0	0.0	7.2
23	17624288.27	5050374.68	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	62.9	0.8	-0.9	0.0	0.0	0.0	0.0	0.0	11.4
23	17624288.27	5050374.68	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	62.9	1.4	-0.9	0.0	0.0	0.0	0.0	0.0	8.1
23	17624288.27	5050374.68	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	62.9	3.8	-0.9	0.0	0.0	0.0	0.0	0.0	2.9
23	17624288.27	5050374.68	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	62.9	13.0	-0.9	0.0	0.0	0.0	0.0	0.0	-14.4
23	17624288.27	5050374.68	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	62.9	46.2	-0.9	0.0	0.0	0.0	0.0	0.0	-56.0

Point Source, ISO 9613, Name: "HVAC Economizer Hood 7", ID: "HVAC_hood7"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
24	17624301.74	5050377.18	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	62.9	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-26.6
24	17624301.74	5050377.18	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	62.9	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-5.8
24	17624301.74	5050377.18	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	62.9	0.2	4.1	0.0	0.0	0.0	0.0	0.0	-1.1
24	17624301.74	5050377.18	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	62.9	0.4	1.8	0.0	0.0	0.0	0.0	0.0	7.2
24	17624301.74	5050377.18	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	62.9	0.8	-0.9	0.0	0.0	0.0	0.0	0.0	11.4
24	17624301.74	5050377.18	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	62.9	1.4	-0.9	0.0	0.0	0.0	0.0	0.0	8.1
24	17624301.74	5050377.18	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	62.9	3.8	-0.9	0.0	0.0	0.0	0.0	0.0	2.9
24	17624301.74	5050377.18	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	62.9	13.0	-0.9	0.0	0.0	0.0	0.0	0.0	-14.4
24	17624301.74	5050377.18	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	62.9	46.3	-0.9	0.0	0.0	0.0	0.0	0.0	-56.0

Point Source, ISO 9613, Name: "HVAC Economizer Hood 1", ID: "HVAC_hood1"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
25	17624284.42	5050366.44	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.1	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-26.7

Point Source, ISO 9613, Name: "HVAC Economizer Hood 1", ID: "HVAC_hood1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
25	17624284.42	5050366.44	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.1	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-6.0
25	17624284.42	5050366.44	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.1	0.2	4.1	0.0	0.0	0.0	0.0	0.0	-1.3
25	17624284.42	5050366.44	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.1	0.4	1.8	0.0	0.0	0.0	0.0	0.0	7.0
25	17624284.42	5050366.44	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.1	0.8	-0.9	0.0	0.0	0.0	0.0	0.0	11.2
25	17624284.42	5050366.44	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.1	1.5	-0.9	0.0	0.0	0.0	0.0	0.0	7.9
25	17624284.42	5050366.44	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.1	3.9	-0.9	0.0	0.0	0.0	0.0	0.0	2.7
25	17624284.42	5050366.44	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.1	13.2	-0.9	0.0	0.0	0.0	0.0	0.0	-14.8
25	17624284.42	5050366.44	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.1	47.1	-0.9	0.0	0.0	0.0	0.0	0.0	-57.0

Point Source, ISO 9613, Name: "HVAC Economizer Hood 5", ID: "HVAC_hood5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
26	17624291.94	5050366.35	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.1	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-26.7
26	17624291.94	5050366.35	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.1	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-6.0
26	17624291.94	5050366.35	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.1	0.2	4.1	0.0	0.0	0.0	0.0	0.0	-1.3
26	17624291.94	5050366.35	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.1	0.4	1.8	0.0	0.0	0.0	0.0	0.0	7.0
26	17624291.94	5050366.35	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.1	0.8	-0.9	0.0	0.0	0.0	0.0	0.0	11.2
26	17624291.94	5050366.35	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.1	1.5	-0.9	0.0	0.0	0.0	0.0	0.0	7.9
26	17624291.94	5050366.35	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.1	3.9	-0.9	0.0	0.0	0.0	0.0	0.0	2.7
26	17624291.94	5050366.35	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.1	13.3	-0.9	0.0	0.0	0.0	0.0	0.0	-14.9
26	17624291.94	5050366.35	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.1	47.3	-0.9	0.0	0.0	0.0	0.0	0.0	-57.2

Point Source, ISO 9613, Name: "HVAC Economizer Hood 2", ID: "HVAC_hood2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
27	17624278.29	5050363.89	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.1	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-26.7
27	17624278.29	5050363.89	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.1	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-6.0
27	17624278.29	5050363.89	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.1	0.2	4.1	0.0	0.0	0.0	0.0	0.0	-1.3
27	17624278.29	5050363.89	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.1	0.4	1.8	0.0	0.0	0.0	0.0	0.0	7.0
27	17624278.29	5050363.89	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.1	0.8	-0.9	0.0	0.0	0.0	0.0	0.0	11.2
27	17624278.29	5050363.89	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.1	1.5	-0.9	0.0	0.0	0.0	0.0	0.0	7.9
27	17624278.29	5050363.89	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.1	3.9	-0.9	0.0	0.0	0.0	0.0	0.0	2.7
27	17624278.29	5050363.89	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.1	13.3	-0.9	0.0	0.0	0.0	0.0	0.0	-14.9
27	17624278.29	5050363.89	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.1	47.3	-0.9	0.0	0.0	0.0	0.0	0.0	-57.2

Point Source, ISO 9613, Name: "HVAC Economizer Hood 6", ID: "HVAC_hood6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
32	17624285.84	5050363.98	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.2	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-26.7
32	17624285.84	5050363.98	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.2	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-6.0
32	17624285.84	5050363.98	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.2	0.2	4.1	0.0	0.0	0.0	0.0	0.0	-1.3
32	17624285.84	5050363.98	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.2	0.4	1.8	0.0	0.0	0.0	0.0	0.0	7.0
32	17624285.84	5050363.98	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.2	0.8	-0.9	0.0	0.0	0.0	0.0	0.0	11.2
32	17624285.84	5050363.98	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.2	1.5	-0.9	0.0	0.0	0.0	0.0	0.0	7.8
32	17624285.84	5050363.98	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.2	3.9	-0.9	0.0	0.0	0.0	0.0	0.0	2.6
32	17624285.84	5050363.98	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.2	13.3	-0.9	0.0	0.0	0.0	0.0	0.0	-15.0
32	17624285.84	5050363.98	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.2	47.4	-0.9	0.0	0.0	0.0	0.0	0.0	-57.4

Point Source, ISO 9613, Name: "HVAC Economizer Hood 8", ID: "HVAC_hood8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
34	17624301.95	5050366.49	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.2	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-26.8
34	17624301.95	5050366.49	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.2	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-6.0
34	17624301.95	5050366.49	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.2	0.2	4.1	0.0	0.0	0.0	0.0	0.0	-1.3
34	17624301.95	5050366.49	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.2	0.4	1.8	0.0	0.0	0.0	0.0	0.0	7.0
34	17624301.95	5050366.49	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.2	0.8	-0.9	0.0	0.0	0.0	0.0	0.0	11.2
34	17624301.95	5050366.49	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.2	1.5	-0.9	0.0	0.0	0.0	0.0	0.0	7.8
34	17624301.95	5050366.49	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.2	3.9	-0.9	0.0	0.0	0.0	0.0	0.0	2.6
34	17624301.95	5050366.49	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.2	13.3	-0.9	0.0	0.0	0.0	0.0	0.0	-15.0
34	17624301.95	5050366.49	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.2	47.5	-0.9	0.0	0.0	0.0	0.0	0.0	-57.4

Point Source, ISO 9613, Name: "HVAC Economizer Hood 9", ID: "HVAC_hood9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
39	17624295.94	5050364.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.2	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-26.8
39	17624295.94	5050364.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.2	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-6.0
39	17624295.94	5050364.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.2	0.2	4.1	0.0	0.0	0.0	0.0	0.0	-1.4
39	17624295.94	5050364.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.2	0.4	1.8	0.0	0.0	0.0	0.0	0.0	6.9
39	17624295.94	5050364.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.2	0.8	-0.9	0.0	0.0	0.0	0.0	0.0	11.1
39	17624295.94	5050364.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.2	1.5	-0.9	0.0	0.0	0.0	0.0	0.0	7.8
39	17624295.94	5050364.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.2	3.9	-0.9	0.0	0.0	0.0	0.0	0.0	2.6
39	17624295.94	5050364.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.2	13.3	-0.9	0.0	0.0	0.0	0.0	0.0	-15.0
39	17624295.94	5050364.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.2	47.6	-0.9	0.0	0.0	0.0	0.0	0.0	-57.6

Point Source, ISO 9613, Name: "Transformer 2MW", ID: "transformer_2MW"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
42	17624280.40	5050378.87	342.00	0	DEN	32	38.6	0.0	0.0	0.0	0.0	62.8	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-29.0
42	17624280.40	5050378.87	342.00	0	DEN	63	59.8	0.0	0.0	0.0	0.0	62.8	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-7.8
42	17624280.40	5050378.87	342.00	0	DEN	125	73.9	0.0	0.0	0.0	0.0	62.8	0.2	3.4	0.0	0.0	1.4	0.0	0.0	6.1
42	17624280.40	5050378.87	342.00	0	DEN	250	65.4	0.0	0.0	0.0	0.0	62.8	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-2.7
42	17624280.40	5050378.87	342.00	0	DEN	500	66.8	0.0	0.0	0.0	0.0	62.8	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-1.6
42	17624280.40	5050378.87	342.00	0	DEN	1000	68.0	0.0	0.0	0.0	0.0	62.8	1.4	-0.9	0.0	0.0	5.6	0.0	0.0	-1.0
42	17624280.40	5050378.87	342.00	0	DEN	2000	66.2	0.0	0.0	0.0	0.0	62.8	3.8	-1.0	0.0	0.0	5.7	0.0	0.0	-5.2
42	17624280.40	5050378.87	342.00	0	DEN	4000	68.0	0.0	0.0	0.0	0.0	62.8	12.8	-1.0	0.0	0.0	5.7	0.0	0.0	-12.4
42	17624280.40	5050378.87	342.00	0	DEN	8000	48.9	0.0	0.0	0.0	0.0	62.8	45.6	-1.0	0.0	0.0	5.7	0.0	0.0	-64.3

Point Source, ISO 9613, Name: "PCS 3", ID: "PCS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
53	17624290.73	5050378.40	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.9	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-37.4
53	17624290.73	5050378.40	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.9	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-24.7
53	17624290.73	5050378.40	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.9	0.2	3.4	0.0	0.0	1.4	0.0	0.0	-4.7
53	17624290.73	5050378.40	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.9	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-1.7
53	17624290.73	5050378.40	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.9	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-2.5
53	17624290.73	5050378.40	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.9	1.4	-0.9	0.0	0.0	5.6	0.0	0.0	0.8
53	17624290.73	5050378.40	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.9	3.8	-1.0	0.0	0.0	5.7	0.0	0.0	-0.2
53	17624290.73	5050378.40	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.9	12.9	-1.0	0.0	0.0	5.7	0.0	0.0	-13.7
53	17624290.73	5050378.40	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.9	45.8	-1.0	0.0	0.0	5.7	0.0	0.0	-58.1

Point Source, ISO 9613, Name: "PCS 10", ID: "PCS10"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
61	17624280.69	5050376.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.9	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-37.4
61	17624280.69	5050376.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.9	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-24.7
61	17624280.69	5050376.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.9	0.2	3.4	0.0	0.0	1.4	0.0	0.0	-4.7
61	17624280.69	5050376.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.9	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-1.7
61	17624280.69	5050376.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.9	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-2.6
61	17624280.69	5050376.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.9	1.4	-0.9	0.0	0.0	5.6	0.0	0.0	0.8
61	17624280.69	5050376.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.9	3.8	-1.0	0.0	0.0	5.7	0.0	0.0	-0.2
61	17624280.69	5050376.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.9	12.9	-1.0	0.0	0.0	5.7	0.0	0.0	-13.7
61	17624280.69	5050376.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.9	45.9	-1.0	0.0	0.0	5.7	0.0	0.0	-58.2

Point Source, ISO 9613, Name: "PCS 7", ID: "PCS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
81	17624298.22	5050378.41	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.9	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-37.4
81	17624298.22	5050378.41	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.9	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-24.7
81	17624298.22	5050378.41	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.9	0.2	3.4	0.0	0.0	1.4	0.0	0.0	-4.7
81	17624298.22	5050378.41	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.9	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-1.7
81	17624298.22	5050378.41	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.9	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-2.6
81	17624298.22	5050378.41	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.9	1.4	-0.9	0.0	0.0	5.6	0.0	0.0	0.8
81	17624298.22	5050378.41	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.9	3.8	-1.0	0.0	0.0	5.7	0.0	0.0	-0.2
81	17624298.22	5050378.41	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.9	12.9	-1.0	0.0	0.0	5.7	0.0	0.0	-13.8
81	17624298.22	5050378.41	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.9	46.0	-1.0	0.0	0.0	5.7	0.0	0.0	-58.3

Point Source, ISO 9613, Name: "PCS 11", ID: "PCS11"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
87	17624280.74	5050375.25	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.9	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-37.4
87	17624280.74	5050375.25	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.9	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-24.7
87	17624280.74	5050375.25	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.9	0.2	3.4	0.0	0.0	1.4	0.0	0.0	-4.7
87	17624280.74	5050375.25	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.9	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-1.7
87	17624280.74	5050375.25	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.9	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-2.6
87	17624280.74	5050375.25	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.9	1.4	-0.9	0.0	0.0	5.6	0.0	0.0	0.8
87	17624280.74	5050375.25	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.9	3.8	-1.0	0.0	0.0	5.7	0.0	0.0	-0.2
87	17624280.74	5050375.25	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.9	12.9	-1.0	0.0	0.0	5.7	0.0	0.0	-13.8
87	17624280.74	5050375.25	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.9	46.0	-1.0	0.0	0.0	5.7	0.0	0.0	-58.3

Point Source, ISO 9613, Name: "PCS 4", ID: "PCS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
90	17624291.60	5050373.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.0	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-37.5
90	17624291.60	5050373.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.0	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-24.8
90	17624291.60	5050373.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.0	0.2	3.4	0.0	0.0	1.4	0.0	0.0	-4.8
90	17624291.60	5050373.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.0	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-1.8
90	17624291.60	5050373.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.0	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-2.7
90	17624291.60	5050373.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.0	1.5	-0.9	0.0	0.0	5.6	0.0	0.0	0.7
90	17624291.60	5050373.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.0	3.8	-1.0	0.0	0.0	5.7	0.0	0.0	-0.4
90	17624291.60	5050373.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.0	13.0	-1.0	0.0	0.0	5.7	0.0	0.0	-14.0
90	17624291.60	5050373.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.0	46.4	-1.0	0.0	0.0	5.7	0.0	0.0	-58.8

Point Source, ISO 9613, Name: "PCS 1", ID: "PCS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
110	17624280.88	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.1	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-37.6
110	17624280.88	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.1	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-24.9
110	17624280.88	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.1	0.2	3.4	0.0	0.0	1.3	0.0	0.0	-4.9
110	17624280.88	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.1	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-1.9
110	17624280.88	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.1	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-2.8
110	17624280.88	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.9	0.0	0.0	5.6	0.0	0.0	0.6
110	17624280.88	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.1	3.9	-1.0	0.0	0.0	5.7	0.0	0.0	-0.5
110	17624280.88	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.1	13.1	-1.0	0.0	0.0	5.7	0.0	0.0	-14.2
110	17624280.88	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.1	46.9	-1.0	0.0	0.0	5.7	0.0	0.0	-59.4

Point Source, ISO 9613, Name: "PCS 12", ID: "PCS12"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
114	17624270.58	5050364.97	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.1	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-37.6
114	17624270.58	5050364.97	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.1	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-24.9
114	17624270.58	5050364.97	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.1	0.2	3.4	0.0	0.0	1.3	0.0	0.0	-4.9
114	17624270.58	5050364.97	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.1	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-1.9
114	17624270.58	5050364.97	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.1	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-2.8
114	17624270.58	5050364.97	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.9	0.0	0.0	5.6	0.0	0.0	0.5
114	17624270.58	5050364.97	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.1	3.9	-1.0	0.0	0.0	5.7	0.0	0.0	-0.5
114	17624270.58	5050364.97	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.1	13.2	-1.0	0.0	0.0	5.7	0.0	0.0	-14.3
114	17624270.58	5050364.97	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.1	47.0	-1.0	0.0	0.0	5.7	0.0	0.0	-59.5

Point Source, ISO 9613, Name: "PCS 5", ID: "PCS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
117	17624288.51	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.1	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-37.6
117	17624288.51	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.1	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-24.9
117	17624288.51	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.1	0.2	3.4	0.0	0.0	1.3	0.0	0.0	-4.9
117	17624288.51	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.1	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-1.9
117	17624288.51	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.1	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-2.8
117	17624288.51	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.9	0.0	0.0	5.6	0.0	0.0	0.5
117	17624288.51	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.1	3.9	-1.0	0.0	0.0	5.7	0.0	0.0	-0.5
117	17624288.51	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.1	13.2	-1.0	0.0	0.0	5.8	0.0	0.0	-14.3
117	17624288.51	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.1	47.0	-1.0	0.0	0.0	5.8	0.0	0.0	-59.5

Point Source, ISO 9613, Name: "PCS 13", ID: "PCS13"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
124	17624270.54	5050363.56	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.1	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-37.6
124	17624270.54	5050363.56	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.1	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-24.9
124	17624270.54	5050363.56	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.1	0.2	3.4	0.0	0.0	1.3	0.0	0.0	-4.9
124	17624270.54	5050363.56	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.1	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-2.0
124	17624270.54	5050363.56	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.1	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-2.8
124	17624270.54	5050363.56	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.9	0.0	0.0	5.6	0.0	0.0	0.5
124	17624270.54	5050363.56	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.1	3.9	-1.0	0.0	0.0	5.7	0.0	0.0	-0.6
124	17624270.54	5050363.56	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.1	13.2	-1.0	0.0	0.0	5.7	0.0	0.0	-14.3
124	17624270.54	5050363.56	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.1	47.2	-1.0	0.0	0.0	5.7	0.0	0.0	-59.7

Point Source, ISO 9613, Name: "PCS 8", ID: "PCS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
125	17624298.45	5050367.65	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.1	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-37.6
125	17624298.45	5050367.65	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.1	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-24.9
125	17624298.45	5050367.65	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.1	0.2	3.5	0.0	0.0	1.3	0.0	0.0	-4.9
125	17624298.45	5050367.65	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.1	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-2.0
125	17624298.45	5050367.65	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.1	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-2.8
125	17624298.45	5050367.65	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.9	0.0	0.0	5.6	0.0	0.0	0.5
125	17624298.45	5050367.65	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.1	3.9	-1.0	0.0	0.0	5.8	0.0	0.0	-0.6
125	17624298.45	5050367.65	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.1	13.2	-1.0	0.0	0.0	5.8	0.0	0.0	-14.4
125	17624298.45	5050367.65	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.1	47.2	-1.0	0.0	0.0	5.8	0.0	0.0	-59.8

Point Source, ISO 9613, Name: "PCS 14", ID: "PCS14"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
132	17624270.56	5050362.20	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.2	0.0	-4.6	0.0	0.0	9.3	0.0	0.0	-37.7
132	17624270.56	5050362.20	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.2	0.0	-4.6	0.0	0.0	9.3	0.0	0.0	-25.0
132	17624270.56	5050362.20	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.2	0.2	3.5	0.0	0.0	1.3	0.0	0.0	-4.9
132	17624270.56	5050362.20	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.2	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-2.0
132	17624270.56	5050362.20	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.2	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-2.9
132	17624270.56	5050362.20	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.2	1.5	-0.9	0.0	0.0	5.6	0.0	0.0	0.5
132	17624270.56	5050362.20	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.2	3.9	-1.0	0.0	0.0	5.8	0.0	0.0	-0.6
132	17624270.56	5050362.20	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.2	13.3	-1.0	0.0	0.0	5.8	0.0	0.0	-14.4
132	17624270.56	5050362.20	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.2	47.4	-1.0	0.0	0.0	5.8	0.0	0.0	-59.9

Point Source, ISO 9613, Name: "PCS 2", ID: "PCS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
133	17624281.69	5050362.69	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.2	0.0	-4.6	0.0	0.0	9.3	0.0	0.0	-37.7
133	17624281.69	5050362.69	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.2	0.0	-4.6	0.0	0.0	9.3	0.0	0.0	-25.0
133	17624281.69	5050362.69	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.2	0.2	3.5	0.0	0.0	1.3	0.0	0.0	-5.0
133	17624281.69	5050362.69	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.2	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-2.0
133	17624281.69	5050362.69	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.2	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-2.9
133	17624281.69	5050362.69	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.2	1.5	-0.9	0.0	0.0	5.6	0.0	0.0	0.4
133	17624281.69	5050362.69	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.2	3.9	-1.0	0.0	0.0	5.8	0.0	0.0	-0.6
133	17624281.69	5050362.69	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.2	13.3	-1.0	0.0	0.0	5.8	0.0	0.0	-14.5
133	17624281.69	5050362.69	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.2	47.5	-1.0	0.0	0.0	5.8	0.0	0.0	-60.1

Point Source, ISO 9613, Name: "PCS 6", ID: "PCS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
141	17624289.16	5050362.78	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.2	0.0	-4.6	0.0	0.0	9.3	0.0	0.0	-37.7
141	17624289.16	5050362.78	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.2	0.0	-4.6	0.0	0.0	9.3	0.0	0.0	-25.0
141	17624289.16	5050362.78	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.2	0.2	3.5	0.0	0.0	1.3	0.0	0.0	-5.0
141	17624289.16	5050362.78	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.2	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-2.0
141	17624289.16	5050362.78	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.2	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-2.9
141	17624289.16	5050362.78	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.2	1.5	-0.9	0.0	0.0	5.6	0.0	0.0	0.4
141	17624289.16	5050362.78	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.2	3.9	-1.0	0.0	0.0	5.8	0.0	0.0	-0.7
141	17624289.16	5050362.78	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.2	13.3	-1.0	0.0	0.0	5.8	0.0	0.0	-14.6
141	17624289.16	5050362.78	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.2	47.6	-1.0	0.0	0.0	5.8	0.0	0.0	-60.2

Point Source, ISO 9613, Name: "PCS 9", ID: "PCS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
158	17624299.21	5050362.68	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.2	0.0	-4.6	0.0	0.0	9.3	0.0	0.0	-37.8
158	17624299.21	5050362.68	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.2	0.0	-4.6	0.0	0.0	9.3	0.0	0.0	-25.1
158	17624299.21	5050362.68	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.2	0.2	3.5	0.0	0.0	1.3	0.0	0.0	-5.0
158	17624299.21	5050362.68	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.2	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-2.1
158	17624299.21	5050362.68	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.2	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-3.0
158	17624299.21	5050362.68	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.2	1.5	-0.9	0.0	0.0	5.7	0.0	0.0	0.4
158	17624299.21	5050362.68	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.2	4.0	-1.0	0.0	0.0	5.8	0.0	0.0	-0.8
158	17624299.21	5050362.68	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.2	13.4	-1.0	0.0	0.0	5.8	0.0	0.0	-14.7
158	17624299.21	5050362.68	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.2	47.8	-1.0	0.0	0.0	5.8	0.0	0.0	-60.6

Point Source, ISO 9613, Name: "HVAC Condenser 3", ID: "HVAC_condenser3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
176	17624293.15	5050378.41	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	62.9	0.0	-4.0	0.0	0.0	0.0	0.0	0.0	-31.2
176	17624293.15	5050378.41	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	62.9	0.0	-4.0	0.0	0.0	0.0	0.0	0.0	-10.5
176	17624293.15	5050378.41	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	62.9	0.2	4.1	0.0	0.0	0.0	0.0	0.0	-5.7
176	17624293.15	5050378.41	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	62.9	0.4	1.8	0.0	0.0	0.0	0.0	0.0	2.5
176	17624293.15	5050378.41	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	62.9	0.8	-0.9	0.0	0.0	0.0	0.0	0.0	6.8
176	17624293.15	5050378.41	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	62.9	1.4	-0.9	0.0	0.0	0.0	0.0	0.0	3.5
176	17624293.15	5050378.41	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	62.9	3.8	-0.9	0.0	0.0	0.0	0.0	0.0	-1.7
176	17624293.15	5050378.41	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	62.9	12.9	-0.9	0.0	0.0	0.0	0.0	0.0	-19.0
176	17624293.15	5050378.41	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	62.9	45.9	-0.9	0.0	0.0	0.0	0.0	0.0	-60.3

Point Source, ISO 9613, Name: "HVAC Condenser 7", ID: "HVAC_condenser7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
178	17624300.76	5050378.47	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	62.9	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-31.3
178	17624300.76	5050378.47	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	62.9	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-10.5
178	17624300.76	5050378.47	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	62.9	0.2	4.1	0.0	0.0	0.0	0.0	0.0	-5.8
178	17624300.76	5050378.47	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	62.9	0.4	1.8	0.0	0.0	0.0	0.0	0.0	2.5
178	17624300.76	5050378.47	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	62.9	0.8	-0.9	0.0	0.0	0.0	0.0	0.0	6.7
178	17624300.76	5050378.47	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	62.9	1.4	-0.9	0.0	0.0	0.0	0.0	0.0	3.4
178	17624300.76	5050378.47	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	62.9	3.8	-0.9	0.0	0.0	0.0	0.0	0.0	-1.7
178	17624300.76	5050378.47	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	62.9	12.9	-0.9	0.0	0.0	0.0	0.0	0.0	-19.0
178	17624300.76	5050378.47	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	62.9	46.1	-0.9	0.0	0.0	0.0	0.0	0.0	-60.5

Point Source, ISO 9613, Name: "HVAC Condenser 4", ID: "HVAC_condenser4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
180	17624289.10	5050373.50	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.0	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-31.3
180	17624289.10	5050373.50	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.0	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-10.6
180	17624289.10	5050373.50	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.0	0.2	4.1	0.0	0.0	0.0	0.0	0.0	-5.8
180	17624289.10	5050373.50	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.0	0.4	1.8	0.0	0.0	0.0	0.0	0.0	2.5
180	17624289.10	5050373.50	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.0	0.8	-0.9	0.0	0.0	0.0	0.0	0.0	6.7
180	17624289.10	5050373.50	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.0	1.5	-0.9	0.0	0.0	0.0	0.0	0.0	3.4
180	17624289.10	5050373.50	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.0	3.8	-0.9	0.0	0.0	0.0	0.0	0.0	-1.8
180	17624289.10	5050373.50	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.0	13.0	-0.9	0.0	0.0	0.0	0.0	0.0	-19.2
180	17624289.10	5050373.50	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.0	46.4	-0.9	0.0	0.0	0.0	0.0	0.0	-60.9

Point Source, ISO 9613, Name: "HVAC Condenser 1", ID: "HVAC_condenser1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
182	17624283.37	5050367.59	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.1	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-31.4
182	17624283.37	5050367.59	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.1	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-10.6
182	17624283.37	5050367.59	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.1	0.2	4.1	0.0	0.0	0.0	0.0	0.0	-5.9
182	17624283.37	5050367.59	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.1	0.4	1.8	0.0	0.0	0.0	0.0	0.0	2.4
182	17624283.37	5050367.59	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.1	0.8	-0.9	0.0	0.0	0.0	0.0	0.0	6.6
182	17624283.37	5050367.59	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.9	0.0	0.0	0.0	0.0	0.0	3.2
182	17624283.37	5050367.59	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.1	3.9	-0.9	0.0	0.0	0.0	0.0	0.0	-2.0
182	17624283.37	5050367.59	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.1	13.2	-0.9	0.0	0.0	0.0	0.0	0.0	-19.4
182	17624283.37	5050367.59	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.1	47.0	-0.9	0.0	0.0	0.0	0.0	0.0	-61.5

Point Source, ISO 9613, Name: "HVAC Condenser 5", ID: "HVAC_condenser5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
189	17624290.96	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.1	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-31.4
189	17624290.96	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.1	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-10.7
189	17624290.96	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.1	0.2	4.1	0.0	0.0	0.0	0.0	0.0	-6.0
189	17624290.96	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.1	0.4	1.8	0.0	0.0	0.0	0.0	0.0	2.3
189	17624290.96	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.1	0.8	-0.9	0.0	0.0	0.0	0.0	0.0	6.5
189	17624290.96	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.9	0.0	0.0	0.0	0.0	0.0	3.2
189	17624290.96	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.1	3.9	-0.9	0.0	0.0	0.0	0.0	0.0	-2.0
189	17624290.96	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.1	13.2	-0.9	0.0	0.0	0.0	0.0	0.0	-19.5
189	17624290.96	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.1	47.1	-0.9	0.0	0.0	0.0	0.0	0.0	-61.7

Point Source, ISO 9613, Name: "HVAC Condenser 8", ID: "HVAC_condenser8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
198	17624300.95	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.1	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-31.4
198	17624300.95	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.1	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-10.7
198	17624300.95	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.1	0.2	4.1	0.0	0.0	0.0	0.0	0.0	-6.0
198	17624300.95	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.1	0.4	1.8	0.0	0.0	0.0	0.0	0.0	2.3
198	17624300.95	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.1	0.8	-0.9	0.0	0.0	0.0	0.0	0.0	6.5
198	17624300.95	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.9	0.0	0.0	0.0	0.0	0.0	3.2
198	17624300.95	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.1	3.9	-0.9	0.0	0.0	0.0	0.0	0.0	-2.0
198	17624300.95	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.1	13.3	-0.9	0.0	0.0	0.0	0.0	0.0	-19.6
198	17624300.95	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.1	47.3	-0.9	0.0	0.0	0.0	0.0	0.0	-62.0

Point Source, ISO 9613, Name: "HVAC Condenser 2", ID: "HVAC_condenser2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
206	17624279.21	5050362.61	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.2	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-31.5
206	17624279.21	5050362.61	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.2	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-10.7
206	17624279.21	5050362.61	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.2	0.2	4.1	0.0	0.0	0.0	0.0	0.0	-6.0
206	17624279.21	5050362.61	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.2	0.4	1.8	0.0	0.0	0.0	0.0	0.0	2.3
206	17624279.21	5050362.61	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.2	0.8	-0.9	0.0	0.0	0.0	0.0	0.0	6.5
206	17624279.21	5050362.61	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.2	1.5	-0.9	0.0	0.0	0.0	0.0	0.0	3.1
206	17624279.21	5050362.61	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.2	3.9	-0.9	0.0	0.0	0.0	0.0	0.0	-2.1
206	17624279.21	5050362.61	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.2	13.3	-0.9	0.0	0.0	0.0	0.0	0.0	-19.7
206	17624279.21	5050362.61	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.2	47.5	-0.9	0.0	0.0	0.0	0.0	0.0	-62.1

Point Source, ISO 9613, Name: "HVAC Condenser 6", ID: "HVAC_condenser6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
208	17624286.79	5050362.77	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.2	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-31.5
208	17624286.79	5050362.77	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.2	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-10.7
208	17624286.79	5050362.77	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.2	0.2	4.1	0.0	0.0	0.0	0.0	0.0	-6.1
208	17624286.79	5050362.77	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.2	0.4	1.8	0.0	0.0	0.0	0.0	0.0	2.2
208	17624286.79	5050362.77	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.2	0.8	-0.9	0.0	0.0	0.0	0.0	0.0	6.5
208	17624286.79	5050362.77	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.2	1.5	-0.9	0.0	0.0	0.0	0.0	0.0	3.1
208	17624286.79	5050362.77	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.2	3.9	-0.9	0.0	0.0	0.0	0.0	0.0	-2.1
208	17624286.79	5050362.77	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.2	13.3	-0.9	0.0	0.0	0.0	0.0	0.0	-19.7
208	17624286.79	5050362.77	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.2	47.6	-0.9	0.0	0.0	0.0	0.0	0.0	-62.3

Point Source, ISO 9613, Name: "HVAC Condenser 9", ID: "HVAC_condenser9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
216	17624296.83	5050362.76	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.2	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-31.5
216	17624296.83	5050362.76	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.2	0.0	-4.1	0.0	0.0	0.0	0.0	0.0	-10.8
216	17624296.83	5050362.76	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.2	0.2	4.1	0.0	0.0	0.0	0.0	0.0	-6.1
216	17624296.83	5050362.76	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.2	0.4	1.8	0.0	0.0	0.0	0.0	0.0	2.2
216	17624296.83	5050362.76	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.2	0.8	-0.9	0.0	0.0	0.0	0.0	0.0	6.4
216	17624296.83	5050362.76	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.2	1.5	-0.9	0.0	0.0	0.0	0.0	0.0	3.1
216	17624296.83	5050362.76	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.2	4.0	-0.9	0.0	0.0	0.0	0.0	0.0	-2.2
216	17624296.83	5050362.76	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.2	13.4	-0.9	0.0	0.0	0.0	0.0	0.0	-19.8
216	17624296.83	5050362.76	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.2	47.8	-0.9	0.0	0.0	0.0	0.0	0.0	-62.5

Point Source, ISO 9613, Name: "UPS 3", ID: "UPS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
225	17624288.82	5050378.40	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	62.9	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-42.1
225	17624288.82	5050378.40	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	62.9	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-29.4
225	17624288.82	5050378.40	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	62.9	0.2	3.4	0.0	0.0	1.4	0.0	0.0	-9.4
225	17624288.82	5050378.40	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	62.9	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-6.4
225	17624288.82	5050378.40	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	62.9	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-7.2
225	17624288.82	5050378.40	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	62.9	1.4	-0.9	0.0	0.0	5.6	0.0	0.0	-3.9
225	17624288.82	5050378.40	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	62.9	3.8	-1.0	0.0	0.0	5.7	0.0	0.0	-4.9
225	17624288.82	5050378.40	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	62.9	12.8	-1.0	0.0	0.0	5.7	0.0	0.0	-18.4
225	17624288.82	5050378.40	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	62.9	45.8	-1.0	0.0	0.0	5.7	0.0	0.0	-62.8

Point Source, ISO 9613, Name: "UPS 7", ID: "UPS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
227	17624296.42	5050378.45	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	62.9	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-42.1
227	17624296.42	5050378.45	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	62.9	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-29.4
227	17624296.42	5050378.45	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	62.9	0.2	3.4	0.0	0.0	1.4	0.0	0.0	-9.4
227	17624296.42	5050378.45	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	62.9	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-6.4
227	17624296.42	5050378.45	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	62.9	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-7.3
227	17624296.42	5050378.45	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	62.9	1.4	-0.9	0.0	0.0	5.6	0.0	0.0	-3.9
227	17624296.42	5050378.45	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	62.9	3.8	-1.0	0.0	0.0	5.7	0.0	0.0	-4.9
227	17624296.42	5050378.45	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	62.9	12.9	-1.0	0.0	0.0	5.7	0.0	0.0	-18.5
227	17624296.42	5050378.45	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	62.9	46.0	-1.0	0.0	0.0	5.7	0.0	0.0	-63.0

Point Source, ISO 9613, Name: "UPS 4", ID: "UPS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
240	17624293.53	5050373.46	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.0	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-42.2
240	17624293.53	5050373.46	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.0	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-29.5
240	17624293.53	5050373.46	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.0	0.2	3.4	0.0	0.0	1.4	0.0	0.0	-9.5
240	17624293.53	5050373.46	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.0	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-6.5
240	17624293.53	5050373.46	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.0	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-7.4
240	17624293.53	5050373.46	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.0	1.5	-0.9	0.0	0.0	5.6	0.0	0.0	-4.0
240	17624293.53	5050373.46	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.0	3.8	-1.0	0.0	0.0	5.7	0.0	0.0	-5.1
240	17624293.53	5050373.46	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.0	13.0	-1.0	0.0	0.0	5.7	0.0	0.0	-18.7
240	17624293.53	5050373.46	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.0	46.5	-1.0	0.0	0.0	5.7	0.0	0.0	-63.6

Point Source, ISO 9613, Name: "UPS 1", ID: "UPS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
251	17624278.90	5050367.58	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.1	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-42.3
251	17624278.90	5050367.58	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.1	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-29.6
251	17624278.90	5050367.58	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.1	0.2	3.4	0.0	0.0	1.3	0.0	0.0	-9.6
251	17624278.90	5050367.58	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.1	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-6.6
251	17624278.90	5050367.58	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.1	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-7.5
251	17624278.90	5050367.58	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.1	1.5	-0.9	0.0	0.0	5.6	0.0	0.0	-4.1
251	17624278.90	5050367.58	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.1	3.9	-1.0	0.0	0.0	5.7	0.0	0.0	-5.2
251	17624278.90	5050367.58	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.1	13.1	-1.0	0.0	0.0	5.7	0.0	0.0	-18.9
251	17624278.90	5050367.58	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.1	46.9	-1.0	0.0	0.0	5.7	0.0	0.0	-64.0

Point Source, ISO 9613, Name: "UPS 5", ID: "UPS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
252	17624286.54	5050367.66	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.1	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-42.3
252	17624286.54	5050367.66	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.1	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-29.6
252	17624286.54	5050367.66	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.1	0.2	3.4	0.0	0.0	1.3	0.0	0.0	-9.6
252	17624286.54	5050367.66	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.1	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-6.6
252	17624286.54	5050367.66	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.1	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-7.5
252	17624286.54	5050367.66	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.1	1.5	-0.9	0.0	0.0	5.6	0.0	0.0	-4.2
252	17624286.54	5050367.66	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.1	3.9	-1.0	0.0	0.0	5.7	0.0	0.0	-5.2
252	17624286.54	5050367.66	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.1	13.2	-1.0	0.0	0.0	5.7	0.0	0.0	-19.0
252	17624286.54	5050367.66	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.1	47.0	-1.0	0.0	0.0	5.8	0.0	0.0	-64.2

Point Source, ISO 9613, Name: "UPS 8", ID: "UPS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
254	17624296.53	5050367.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.1	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-42.3
254	17624296.53	5050367.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.1	0.0	-4.5	0.0	0.0	9.3	0.0	0.0	-29.6
254	17624296.53	5050367.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.1	0.2	3.4	0.0	0.0	1.3	0.0	0.0	-9.6
254	17624296.53	5050367.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.1	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-6.7
254	17624296.53	5050367.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.1	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-7.5
254	17624296.53	5050367.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.1	1.5	-0.9	0.0	0.0	5.6	0.0	0.0	-4.2
254	17624296.53	5050367.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.1	3.9	-1.0	0.0	0.0	5.8	0.0	0.0	-5.3
254	17624296.53	5050367.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.1	13.2	-1.0	0.0	0.0	5.8	0.0	0.0	-19.1
254	17624296.53	5050367.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.1	47.2	-1.0	0.0	0.0	5.8	0.0	0.0	-64.5

Point Source, ISO 9613, Name: "UPS 2", ID: "UPS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
267	17624283.74	5050362.73	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.2	0.0	-4.6	0.0	0.0	9.3	0.0	0.0	-42.4
267	17624283.74	5050362.73	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.2	0.0	-4.6	0.0	0.0	9.3	0.0	0.0	-29.7
267	17624283.74	5050362.73	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.2	0.2	3.5	0.0	0.0	1.3	0.0	0.0	-9.7
267	17624283.74	5050362.73	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.2	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-6.7
267	17624283.74	5050362.73	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.2	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-7.6
267	17624283.74	5050362.73	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.2	1.5	-0.9	0.0	0.0	5.6	0.0	0.0	-4.3
267	17624283.74	5050362.73	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.2	3.9	-1.0	0.0	0.0	5.8	0.0	0.0	-5.3
267	17624283.74	5050362.73	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.2	13.3	-1.0	0.0	0.0	5.8	0.0	0.0	-19.2
267	17624283.74	5050362.73	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.2	47.5	-1.0	0.0	0.0	5.8	0.0	0.0	-64.8

Point Source, ISO 9613, Name: "UPS 6", ID: "UPS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
269	17624291.19	5050362.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.2	0.0	-4.6	0.0	0.0	9.3	0.0	0.0	-42.4
269	17624291.19	5050362.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.2	0.0	-4.6	0.0	0.0	9.3	0.0	0.0	-29.7
269	17624291.19	5050362.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.2	0.2	3.5	0.0	0.0	1.3	0.0	0.0	-9.7
269	17624291.19	5050362.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.2	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-6.7
269	17624291.19	5050362.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.2	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-7.6
269	17624291.19	5050362.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.2	1.5	-0.9	0.0	0.0	5.6	0.0	0.0	-4.3
269	17624291.19	5050362.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.2	3.9	-1.0	0.0	0.0	5.8	0.0	0.0	-5.4
269	17624291.19	5050362.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.2	13.4	-1.0	0.0	0.0	5.8	0.0	0.0	-19.3
269	17624291.19	5050362.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.2	47.7	-1.0	0.0	0.0	5.8	0.0	0.0	-65.0

Point Source, ISO 9613, Name: "UPS 9", ID: "UPS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
270	17624301.15	5050362.78	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.2	0.0	-4.6	0.0	0.0	9.3	0.0	0.0	-42.5
270	17624301.15	5050362.78	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.2	0.0	-4.6	0.0	0.0	9.3	0.0	0.0	-29.8
270	17624301.15	5050362.78	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.2	0.2	3.5	0.0	0.0	1.3	0.0	0.0	-9.7
270	17624301.15	5050362.78	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.2	0.4	4.9	0.0	0.0	0.0	0.0	0.0	-6.8
270	17624301.15	5050362.78	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.2	0.8	0.8	0.0	0.0	4.0	0.0	0.0	-7.7
270	17624301.15	5050362.78	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.2	1.5	-0.9	0.0	0.0	5.7	0.0	0.0	-4.4
270	17624301.15	5050362.78	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.2	4.0	-1.0	0.0	0.0	5.8	0.0	0.0	-5.5
270	17624301.15	5050362.78	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.2	13.4	-1.0	0.0	0.0	5.8	0.0	0.0	-19.4
270	17624301.15	5050362.78	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.2	47.9	-1.0	0.0	0.0	5.9	0.0	0.0	-65.3

Receiver

Name: OLA2
 ID: OLA2
 X: 17624480.92 m
 Y: 5050716.50 m
 Z: 320.49 m

Point Source, ISO 9613, Name: "Transformer 4MW", ID: "transformer_4MW"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
63	17624270.19	5050367.48	342.00	0	DEN	32	41.6	0.0	0.0	0.0	0.0	63.2	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-26.4
63	17624270.19	5050367.48	342.00	0	DEN	63	62.8	0.0	0.0	0.0	0.0	63.2	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-5.2
63	17624270.19	5050367.48	342.00	0	DEN	125	76.9	0.0	0.0	0.0	0.0	63.2	0.2	2.9	0.0	0.0	1.9	0.0	0.0	8.7
63	17624270.19	5050367.48	342.00	0	DEN	250	68.4	0.0	0.0	0.0	0.0	63.2	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-4.6
63	17624270.19	5050367.48	342.00	0	DEN	500	69.8	0.0	0.0	0.0	0.0	63.2	0.8	4.7	0.0	0.0	0.1	0.0	0.0	1.0
63	17624270.19	5050367.48	342.00	0	DEN	1000	71.0	0.0	0.0	0.0	0.0	63.2	1.5	-0.4	0.0	0.0	5.2	0.0	0.0	1.5
63	17624270.19	5050367.48	342.00	0	DEN	2000	69.2	0.0	0.0	0.0	0.0	63.2	3.9	-1.0	0.0	0.0	5.9	0.0	0.0	-2.8
63	17624270.19	5050367.48	342.00	0	DEN	4000	71.0	0.0	0.0	0.0	0.0	63.2	13.4	-1.0	0.0	0.0	6.0	0.0	0.0	-10.5
63	17624270.19	5050367.48	342.00	0	DEN	8000	51.9	0.0	0.0	0.0	0.0	63.2	47.7	-1.0	0.0	0.0	6.1	0.0	0.0	-64.1

Point Source, ISO 9613, Name: "HVAC Economizer Hood 7", ID: "HVAC_hood7"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
82	17624301.74	5050377.18	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	62.7	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-35.2
82	17624301.74	5050377.18	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	62.7	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-14.4
82	17624301.74	5050377.18	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	62.7	0.2	3.4	0.0	0.0	1.4	0.0	0.0	-1.5
82	17624301.74	5050377.18	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	62.7	0.4	6.3	0.0	0.0	0.0	0.0	0.0	2.9
82	17624301.74	5050377.18	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	62.7	0.7	3.0	0.0	0.0	1.7	0.0	0.0	6.0
82	17624301.74	5050377.18	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	62.7	1.4	-0.4	0.0	0.0	5.2	0.0	0.0	2.7
82	17624301.74	5050377.18	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	62.7	3.7	-0.9	0.0	0.0	5.7	0.0	0.0	-2.4
82	17624301.74	5050377.18	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	62.7	12.6	-0.9	0.0	0.0	5.7	0.0	0.0	-19.5
82	17624301.74	5050377.18	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	62.7	44.9	-0.9	0.0	0.0	5.7	0.0	0.0	-60.1

Point Source, ISO 9613, Name: "HVAC Economizer Hood 3", ID: "HVAC_hood3"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
84	17624294.15	5050377.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-35.2
84	17624294.15	5050377.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-14.5
84	17624294.15	5050377.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	62.8	0.2	3.4	0.0	0.0	1.4	0.0	0.0	-1.6
84	17624294.15	5050377.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	62.8	0.4	6.3	0.0	0.0	0.0	0.0	0.0	2.9
84	17624294.15	5050377.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	62.8	0.7	3.0	0.0	0.0	1.7	0.0	0.0	5.9
84	17624294.15	5050377.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	62.8	1.4	-0.4	0.0	0.0	5.2	0.0	0.0	2.6
84	17624294.15	5050377.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	62.8	3.8	-0.9	0.0	0.0	5.7	0.0	0.0	-2.5
84	17624294.15	5050377.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	62.8	12.7	-0.9	0.0	0.0	5.7	0.0	0.0	-19.7
84	17624294.15	5050377.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	62.8	45.4	-0.9	0.0	0.0	5.7	0.0	0.0	-60.6

Point Source, ISO 9613, Name: "HVAC Economizer Hood 4", ID: "HVAC_hood4"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
89	17624288.27	5050374.68	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	62.9	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-35.4
89	17624288.27	5050374.68	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	62.9	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-14.6
89	17624288.27	5050374.68	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	62.9	0.2	3.4	0.0	0.0	1.4	0.0	0.0	-1.7
89	17624288.27	5050374.68	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	62.9	0.4	6.3	0.0	0.0	0.0	0.0	0.0	2.7
89	17624288.27	5050374.68	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	62.9	0.8	3.0	0.0	0.0	1.7	0.0	0.0	5.8
89	17624288.27	5050374.68	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	62.9	1.4	-0.4	0.0	0.0	5.2	0.0	0.0	2.5
89	17624288.27	5050374.68	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	62.9	3.8	-0.9	0.0	0.0	5.7	0.0	0.0	-2.6
89	17624288.27	5050374.68	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	62.9	12.9	-0.9	0.0	0.0	5.7	0.0	0.0	-19.9
89	17624288.27	5050374.68	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	62.9	45.9	-0.9	0.0	0.0	5.7	0.0	0.0	-61.3

Point Source, ISO 9613, Name: "HVAC Economizer Hood 8", ID: "HVAC_hood8"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
91	17624301.95	5050366.49	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	62.9	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-35.4

Point Source, ISO 9613, Name: "HVAC Economizer Hood 8", ID: "HVAC_hood8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
91	17624301.95	5050366.49	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	62.9	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-14.6
91	17624301.95	5050366.49	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	62.9	0.2	3.4	0.0	0.0	1.4	0.0	0.0	-1.8
91	17624301.95	5050366.49	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	62.9	0.4	6.3	0.0	0.0	0.0	0.0	0.0	2.7
91	17624301.95	5050366.49	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	62.9	0.8	3.0	0.0	0.0	1.7	0.0	0.0	5.8
91	17624301.95	5050366.49	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	62.9	1.4	-0.4	0.0	0.0	5.2	0.0	0.0	2.5
91	17624301.95	5050366.49	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	62.9	3.8	-0.9	0.0	0.0	5.7	0.0	0.0	-2.7
91	17624301.95	5050366.49	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	62.9	12.9	-0.9	0.0	0.0	5.8	0.0	0.0	-20.0
91	17624301.95	5050366.49	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	62.9	46.0	-0.9	0.0	0.0	5.8	0.0	0.0	-61.5

Point Source, ISO 9613, Name: "HVAC Economizer Hood 5", ID: "HVAC_hood5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
93	17624291.94	5050366.35	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.0	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-35.5
93	17624291.94	5050366.35	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.0	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-14.7
93	17624291.94	5050366.35	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.0	0.2	3.4	0.0	0.0	1.3	0.0	0.0	-1.9
93	17624291.94	5050366.35	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.0	0.4	6.3	0.0	0.0	0.0	0.0	0.0	2.6
93	17624291.94	5050366.35	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.0	0.8	3.0	0.0	0.0	1.7	0.0	0.0	5.7
93	17624291.94	5050366.35	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.0	1.5	-0.4	0.0	0.0	5.2	0.0	0.0	2.4
93	17624291.94	5050366.35	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.0	3.9	-1.0	0.0	0.0	5.7	0.0	0.0	-2.8
93	17624291.94	5050366.35	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.0	13.1	-1.0	0.0	0.0	5.7	0.0	0.0	-20.2
93	17624291.94	5050366.35	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.0	46.6	-1.0	0.0	0.0	5.8	0.0	0.0	-62.1

Point Source, ISO 9613, Name: "HVAC Economizer Hood 9", ID: "HVAC_hood9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
98	17624295.94	5050364.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.0	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-35.5
98	17624295.94	5050364.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.0	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-14.7
98	17624295.94	5050364.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.0	0.2	3.4	0.0	0.0	1.3	0.0	0.0	-1.9
98	17624295.94	5050364.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.0	0.4	6.3	0.0	0.0	0.0	0.0	0.0	2.6
98	17624295.94	5050364.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.0	0.8	3.0	0.0	0.0	1.7	0.0	0.0	5.7
98	17624295.94	5050364.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.0	1.5	-0.4	0.0	0.0	5.2	0.0	0.0	2.3
98	17624295.94	5050364.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.0	3.9	-1.0	0.0	0.0	5.7	0.0	0.0	-2.8
98	17624295.94	5050364.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.0	13.1	-1.0	0.0	0.0	5.8	0.0	0.0	-20.3
98	17624295.94	5050364.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.0	46.6	-1.0	0.0	0.0	5.8	0.0	0.0	-62.1

Point Source, ISO 9613, Name: "HVAC Economizer Hood 1", ID: "HVAC_hood1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
100	17624284.42	5050366.44	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-35.6
100	17624284.42	5050366.44	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-14.8
100	17624284.42	5050366.44	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.1	0.2	3.5	0.0	0.0	1.3	0.0	0.0	-1.9
100	17624284.42	5050366.44	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.1	0.4	6.3	0.0	0.0	0.0	0.0	0.0	2.5
100	17624284.42	5050366.44	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.1	0.8	3.0	0.0	0.0	1.7	0.0	0.0	5.6
100	17624284.42	5050366.44	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.1	1.5	-0.4	0.0	0.0	5.2	0.0	0.0	2.3
100	17624284.42	5050366.44	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.1	3.9	-1.0	0.0	0.0	5.7	0.0	0.0	-2.9
100	17624284.42	5050366.44	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.1	13.2	-1.0	0.0	0.0	5.7	0.0	0.0	-20.4
100	17624284.42	5050366.44	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.1	47.0	-1.0	0.0	0.0	5.7	0.0	0.0	-62.5

Point Source, ISO 9613, Name: "HVAC Economizer Hood 6", ID: "HVAC_hood6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
102	17624285.84	5050363.98	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-35.6
102	17624285.84	5050363.98	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-14.8
102	17624285.84	5050363.98	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.1	0.2	3.5	0.0	0.0	1.3	0.0	0.0	-2.0
102	17624285.84	5050363.98	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.1	0.4	6.3	0.0	0.0	0.0	0.0	0.0	2.5
102	17624285.84	5050363.98	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.1	0.8	3.0	0.0	0.0	1.7	0.0	0.0	5.6
102	17624285.84	5050363.98	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.1	1.5	-0.4	0.0	0.0	5.2	0.0	0.0	2.2
102	17624285.84	5050363.98	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.1	3.9	-1.0	0.0	0.0	5.7	0.0	0.0	-3.0
102	17624285.84	5050363.98	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.1	13.2	-1.0	0.0	0.0	5.7	0.0	0.0	-20.5
102	17624285.84	5050363.98	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.1	47.2	-1.0	0.0	0.0	5.8	0.0	0.0	-62.8

Point Source, ISO 9613, Name: "HVAC Economizer Hood 2", ID: "HVAC_hood2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
104	17624278.29	5050363.89	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.2	0.0	-4.8	0.0	0.0	9.6	0.0	0.0	-35.7
104	17624278.29	5050363.89	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.2	0.0	-4.8	0.0	0.0	9.6	0.0	0.0	-14.9
104	17624278.29	5050363.89	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.2	0.2	3.5	0.0	0.0	1.3	0.0	0.0	-2.1
104	17624278.29	5050363.89	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.2	0.4	6.3	0.0	0.0	0.0	0.0	0.0	2.4
104	17624278.29	5050363.89	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.2	0.8	3.0	0.0	0.0	1.7	0.0	0.0	5.5
104	17624278.29	5050363.89	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.2	1.5	-0.4	0.0	0.0	5.2	0.0	0.0	2.1
104	17624278.29	5050363.89	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.2	3.9	-1.0	0.0	0.0	5.7	0.0	0.0	-3.1
104	17624278.29	5050363.89	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.2	13.3	-1.0	0.0	0.0	5.7	0.0	0.0	-20.7
104	17624278.29	5050363.89	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.2	47.6	-1.0	0.0	0.0	5.7	0.0	0.0	-63.3

Point Source, ISO 9613, Name: "Transformer 2MW", ID: "transformer_2MW"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
106	17624280.40	5050378.87	342.00	0	DEN	32	38.6	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.1
106	17624280.40	5050378.87	342.00	0	DEN	63	59.8	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-7.9
106	17624280.40	5050378.87	342.00	0	DEN	125	73.9	0.0	0.0	0.0	0.0	62.9	0.2	2.7	0.0	0.0	2.0	0.0	0.0	6.1
106	17624280.40	5050378.87	342.00	0	DEN	250	65.4	0.0	0.0	0.0	0.0	62.9	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-7.3
106	17624280.40	5050378.87	342.00	0	DEN	500	66.8	0.0	0.0	0.0	0.0	62.9	0.8	4.7	0.0	0.0	0.1	0.0	0.0	-1.6
106	17624280.40	5050378.87	342.00	0	DEN	1000	68.0	0.0	0.0	0.0	0.0	62.9	1.4	-0.4	0.0	0.0	5.2	0.0	0.0	-1.1
106	17624280.40	5050378.87	342.00	0	DEN	2000	66.2	0.0	0.0	0.0	0.0	62.9	3.8	-1.0	0.0	0.0	5.8	0.0	0.0	-5.3
106	17624280.40	5050378.87	342.00	0	DEN	4000	68.0	0.0	0.0	0.0	0.0	62.9	12.9	-1.0	0.0	0.0	5.8	0.0	0.0	-12.6
106	17624280.40	5050378.87	342.00	0	DEN	8000	48.9	0.0	0.0	0.0	0.0	62.9	46.0	-1.0	0.0	0.0	5.9	0.0	0.0	-64.8

Point Source, ISO 9613, Name: "PCS 7", ID: "PCS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
108	17624298.22	5050378.41	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.7	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.2
108	17624298.22	5050378.41	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.7	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.5
108	17624298.22	5050378.41	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.7	0.2	2.7	0.0	0.0	2.1	0.0	0.0	-4.5
108	17624298.22	5050378.41	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.7	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-6.0
108	17624298.22	5050378.41	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.7	0.7	4.7	0.0	0.0	0.1	0.0	0.0	-2.4
108	17624298.22	5050378.41	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.7	1.4	-0.4	0.0	0.0	5.3	0.0	0.0	0.9
108	17624298.22	5050378.41	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.7	3.7	-1.0	0.0	0.0	6.0	0.0	0.0	-0.2
108	17624298.22	5050378.41	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.7	12.6	-1.0	0.0	0.0	6.2	0.0	0.0	-13.7
108	17624298.22	5050378.41	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.7	45.0	-1.0	0.0	0.0	6.5	0.0	0.0	-57.8

Point Source, ISO 9613, Name: "PCS 3", ID: "PCS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
112	17624290.73	5050378.40	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.3
112	17624290.73	5050378.40	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.6
112	17624290.73	5050378.40	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.8	0.2	2.7	0.0	0.0	2.1	0.0	0.0	-4.6
112	17624290.73	5050378.40	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.8	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-6.1
112	17624290.73	5050378.40	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.8	0.7	4.7	0.0	0.0	0.1	0.0	0.0	-2.5
112	17624290.73	5050378.40	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.8	1.4	-0.4	0.0	0.0	5.2	0.0	0.0	0.9
112	17624290.73	5050378.40	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.8	3.8	-1.0	0.0	0.0	5.9	0.0	0.0	-0.2
112	17624290.73	5050378.40	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.8	12.7	-1.0	0.0	0.0	6.1	0.0	0.0	-13.8
112	17624290.73	5050378.40	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.8	45.4	-1.0	0.0	0.0	6.5	0.0	0.0	-58.3

Point Source, ISO 9613, Name: "PCS 4", ID: "PCS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
121	17624291.60	5050373.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.4
121	17624291.60	5050373.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.7
121	17624291.60	5050373.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.9	0.2	2.7	0.0	0.0	2.0	0.0	0.0	-4.7
121	17624291.60	5050373.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.9	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-6.2
121	17624291.60	5050373.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.9	0.8	4.7	0.0	0.0	0.2	0.0	0.0	-2.6
121	17624291.60	5050373.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.9	1.4	-0.4	0.0	0.0	5.4	0.0	0.0	0.6
121	17624291.60	5050373.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.9	3.8	-1.0	0.0	0.0	6.3	0.0	0.0	-0.7
121	17624291.60	5050373.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.9	12.9	-1.0	0.0	0.0	6.8	0.0	0.0	-14.7
121	17624291.60	5050373.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.9	45.9	-1.0	0.0	0.0	7.5	0.0	0.0	-59.9

Point Source, ISO 9613, Name: "PCS 8", ID: "PCS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
129	17624298.45	5050367.65	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.4
129	17624298.45	5050367.65	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.7
129	17624298.45	5050367.65	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.9	0.2	2.8	0.0	0.0	2.0	0.0	0.0	-4.7
129	17624298.45	5050367.65	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.9	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-6.2
129	17624298.45	5050367.65	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.9	0.8	4.7	0.0	0.0	0.1	0.0	0.0	-2.7
129	17624298.45	5050367.65	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.9	1.4	-0.4	0.0	0.0	5.3	0.0	0.0	0.6
129	17624298.45	5050367.65	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.9	3.8	-1.0	0.0	0.0	6.1	0.0	0.0	-0.6
129	17624298.45	5050367.65	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.9	12.9	-1.0	0.0	0.0	6.5	0.0	0.0	-14.5
129	17624298.45	5050367.65	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.9	46.1	-1.0	0.0	0.0	7.0	0.0	0.0	-59.6

Point Source, ISO 9613, Name: "PCS 10", ID: "PCS10"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
138	17624280.69	5050376.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.4
138	17624280.69	5050376.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.8
138	17624280.69	5050376.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.9	0.2	2.8	0.0	0.0	2.0	0.0	0.0	-4.7
138	17624280.69	5050376.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.9	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-6.3
138	17624280.69	5050376.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.9	0.8	4.7	0.0	0.0	0.1	0.0	0.0	-2.6
138	17624280.69	5050376.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.9	1.4	-0.4	0.0	0.0	5.2	0.0	0.0	0.7
138	17624280.69	5050376.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.9	3.8	-1.0	0.0	0.0	5.8	0.0	0.0	-0.3
138	17624280.69	5050376.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.9	12.9	-1.0	0.0	0.0	5.9	0.0	0.0	-13.9
138	17624280.69	5050376.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.9	46.2	-1.0	0.0	0.0	5.9	0.0	0.0	-58.6

Point Source, ISO 9613, Name: "PCS 11", ID: "PCS11"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
150	17624280.74	5050375.25	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.5
150	17624280.74	5050375.25	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.8
150	17624280.74	5050375.25	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.0	0.2	2.8	0.0	0.0	2.0	0.0	0.0	-4.8
150	17624280.74	5050375.25	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.0	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-6.3
150	17624280.74	5050375.25	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.0	0.8	4.7	0.0	0.0	0.1	0.0	0.0	-2.6
150	17624280.74	5050375.25	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.0	1.4	-0.4	0.0	0.0	5.2	0.0	0.0	0.7
150	17624280.74	5050375.25	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.0	3.8	-1.0	0.0	0.0	5.8	0.0	0.0	-0.3
150	17624280.74	5050375.25	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.0	13.0	-1.0	0.0	0.0	5.9	0.0	0.0	-14.0
150	17624280.74	5050375.25	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.0	46.3	-1.0	0.0	0.0	5.9	0.0	0.0	-58.8

Point Source, ISO 9613, Name: "PCS 9", ID: "PCS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
163	17624299.21	5050362.68	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.5
163	17624299.21	5050362.68	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.8
163	17624299.21	5050362.68	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.0	0.2	2.8	0.0	0.0	2.0	0.0	0.0	-4.8
163	17624299.21	5050362.68	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.0	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-6.3
163	17624299.21	5050362.68	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.0	0.8	4.7	0.0	0.0	0.2	0.0	0.0	-2.8
163	17624299.21	5050362.68	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.0	1.5	-0.4	0.0	0.0	5.4	0.0	0.0	0.4
163	17624299.21	5050362.68	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.0	3.8	-1.0	0.0	0.0	6.2	0.0	0.0	-0.8
163	17624299.21	5050362.68	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.0	13.1	-1.0	0.0	0.0	6.6	0.0	0.0	-14.9
163	17624299.21	5050362.68	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.0	46.6	-1.0	0.0	0.0	7.3	0.0	0.0	-60.5

Point Source, ISO 9613, Name: "PCS 5", ID: "PCS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
167	17624288.51	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.5
167	17624288.51	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.8
167	17624288.51	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.0	0.2	2.8	0.0	0.0	2.0	0.0	0.0	-4.8
167	17624288.51	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.0	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-6.3
167	17624288.51	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.0	0.8	4.7	0.0	0.0	0.2	0.0	0.0	-2.8
167	17624288.51	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.0	1.5	-0.4	0.0	0.0	5.4	0.0	0.0	0.3
167	17624288.51	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.0	3.9	-1.0	0.0	0.0	6.4	0.0	0.0	-1.0
167	17624288.51	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.0	13.1	-1.0	0.0	0.0	6.9	0.0	0.0	-15.2
167	17624288.51	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.0	46.6	-1.0	0.0	0.0	7.8	0.0	0.0	-61.0

Point Source, ISO 9613, Name: "PCS 1", ID: "PCS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
170	17624280.88	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.6
170	17624280.88	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.9
170	17624280.88	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.1	0.2	2.8	0.0	0.0	1.9	0.0	0.0	-4.9
170	17624280.88	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.1	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-6.4
170	17624280.88	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.1	0.8	4.7	0.0	0.0	0.1	0.0	0.0	-2.8
170	17624280.88	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.4	0.0	0.0	5.2	0.0	0.0	0.5
170	17624280.88	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.1	3.9	-1.0	0.0	0.0	5.9	0.0	0.0	-0.6
170	17624280.88	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.1	13.2	-1.0	0.0	0.0	6.1	0.0	0.0	-14.5
170	17624280.88	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.1	47.1	-1.0	0.0	0.0	6.3	0.0	0.0	-60.1

Point Source, ISO 9613, Name: "PCS 6", ID: "PCS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
177	17624289.16	5050362.78	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.6
177	17624289.16	5050362.78	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.9
177	17624289.16	5050362.78	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.1	0.2	2.8	0.0	0.0	1.9	0.0	0.0	-4.9
177	17624289.16	5050362.78	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.1	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-6.4
177	17624289.16	5050362.78	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.1	0.8	4.7	0.0	0.0	0.1	0.0	0.0	-2.9
177	17624289.16	5050362.78	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.4	0.0	0.0	5.3	0.0	0.0	0.4
177	17624289.16	5050362.78	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.1	3.9	-1.0	0.0	0.0	6.1	0.0	0.0	-0.8
177	17624289.16	5050362.78	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.1	13.2	-1.0	0.0	0.0	6.3	0.0	0.0	-14.8
177	17624289.16	5050362.78	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.1	47.1	-1.0	0.0	0.0	6.8	0.0	0.0	-60.6

Point Source, ISO 9613, Name: "PCS 2", ID: "PCS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
179	17624281.69	5050362.69	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.2	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.7
179	17624281.69	5050362.69	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.2	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-25.0
179	17624281.69	5050362.69	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.2	0.2	2.9	0.0	0.0	1.9	0.0	0.0	-5.0
179	17624281.69	5050362.69	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.2	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-6.5
179	17624281.69	5050362.69	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.2	0.8	4.7	0.0	0.0	0.2	0.0	0.0	-3.0
179	17624281.69	5050362.69	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.2	1.5	-0.4	0.0	0.0	5.4	0.0	0.0	0.2
179	17624281.69	5050362.69	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.2	3.9	-1.0	0.0	0.0	6.3	0.0	0.0	-1.2
179	17624281.69	5050362.69	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.2	13.3	-1.0	0.0	0.0	6.8	0.0	0.0	-15.5
179	17624281.69	5050362.69	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.2	47.5	-1.0	0.0	0.0	7.6	0.0	0.0	-61.9

Point Source, ISO 9613, Name: "PCS 12", ID: "PCS12"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
186	17624270.58	5050364.97	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.3	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.8
186	17624270.58	5050364.97	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.3	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-25.1
186	17624270.58	5050364.97	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.3	0.2	2.9	0.0	0.0	1.9	0.0	0.0	-5.1
186	17624270.58	5050364.97	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.3	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-6.6
186	17624270.58	5050364.97	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.3	0.8	4.7	0.0	0.0	0.1	0.0	0.0	-3.0
186	17624270.58	5050364.97	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.3	1.5	-0.4	0.0	0.0	5.2	0.0	0.0	0.3
186	17624270.58	5050364.97	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.3	4.0	-1.0	0.0	0.0	5.9	0.0	0.0	-0.9
186	17624270.58	5050364.97	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.3	13.4	-1.0	0.0	0.0	6.1	0.0	0.0	-14.9
186	17624270.58	5050364.97	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.3	47.9	-1.0	0.0	0.0	6.3	0.0	0.0	-61.1

Point Source, ISO 9613, Name: "PCS 13", ID: "PCS13"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
188	17624270.54	5050363.56	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.3	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.8
188	17624270.54	5050363.56	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.3	0.1	-5.2	0.0	0.0	10.0	0.0	0.0	-25.1
188	17624270.54	5050363.56	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.3	0.2	2.9	0.0	0.0	1.9	0.0	0.0	-5.1
188	17624270.54	5050363.56	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.3	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-6.6
188	17624270.54	5050363.56	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.3	0.8	4.7	0.0	0.0	0.1	0.0	0.0	-3.0
188	17624270.54	5050363.56	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.3	1.5	-0.4	0.0	0.0	5.3	0.0	0.0	0.2
188	17624270.54	5050363.56	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.3	4.0	-1.0	0.0	0.0	6.0	0.0	0.0	-0.9
188	17624270.54	5050363.56	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.3	13.5	-1.0	0.0	0.0	6.1	0.0	0.0	-15.1
188	17624270.54	5050363.56	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.3	48.1	-1.0	0.0	0.0	6.4	0.0	0.0	-61.4

Point Source, ISO 9613, Name: "PCS 14", ID: "PCS14"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
197	17624270.56	5050362.20	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.3	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.8
197	17624270.56	5050362.20	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.3	0.1	-5.2	0.0	0.0	10.0	0.0	0.0	-25.1
197	17624270.56	5050362.20	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.3	0.2	2.9	0.0	0.0	1.8	0.0	0.0	-5.1
197	17624270.56	5050362.20	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.3	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-6.6
197	17624270.56	5050362.20	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.3	0.8	4.7	0.0	0.0	0.1	0.0	0.0	-3.1
197	17624270.56	5050362.20	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.3	1.5	-0.4	0.0	0.0	5.3	0.0	0.0	0.2
197	17624270.56	5050362.20	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.3	4.0	-1.0	0.0	0.0	6.0	0.0	0.0	-1.0
197	17624270.56	5050362.20	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.3	13.5	-1.0	0.0	0.0	6.2	0.0	0.0	-15.2
197	17624270.56	5050362.20	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.3	48.2	-1.0	0.0	0.0	6.5	0.0	0.0	-61.6

Point Source, ISO 9613, Name: "HVAC Condenser 7", ID: "HVAC_condenser7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
199	17624300.76	5050378.47	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	62.7	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-39.8
199	17624300.76	5050378.47	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	62.7	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-19.1
199	17624300.76	5050378.47	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	62.7	0.2	3.4	0.0	0.0	1.4	0.0	0.0	-6.2
199	17624300.76	5050378.47	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	62.7	0.4	6.3	0.0	0.0	0.0	0.0	0.0	-1.7
199	17624300.76	5050378.47	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	62.7	0.7	3.0	0.0	0.0	1.7	0.0	0.0	1.4
199	17624300.76	5050378.47	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	62.7	1.4	-0.4	0.0	0.0	5.2	0.0	0.0	-2.0
199	17624300.76	5050378.47	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	62.7	3.7	-0.9	0.0	0.0	5.7	0.0	0.0	-7.0
199	17624300.76	5050378.47	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	62.7	12.6	-0.9	0.0	0.0	5.7	0.0	0.0	-24.1
199	17624300.76	5050378.47	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	62.7	44.9	-0.9	0.0	0.0	5.7	0.0	0.0	-64.7

Point Source, ISO 9613, Name: "HVAC Condenser 3", ID: "HVAC_condenser3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
207	17624293.15	5050378.41	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-39.9
207	17624293.15	5050378.41	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-19.2
207	17624293.15	5050378.41	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	62.8	0.2	3.4	0.0	0.0	1.4	0.0	0.0	-6.3
207	17624293.15	5050378.41	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	62.8	0.4	6.3	0.0	0.0	0.0	0.0	0.0	-1.8
207	17624293.15	5050378.41	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	62.8	0.7	3.0	0.0	0.0	1.7	0.0	0.0	1.3
207	17624293.15	5050378.41	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	62.8	1.4	-0.4	0.0	0.0	5.2	0.0	0.0	-2.1
207	17624293.15	5050378.41	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	62.8	3.7	-0.9	0.0	0.0	5.7	0.0	0.0	-7.2
207	17624293.15	5050378.41	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	62.8	12.7	-0.9	0.0	0.0	5.7	0.0	0.0	-24.3
207	17624293.15	5050378.41	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	62.8	45.3	-0.9	0.0	0.0	5.7	0.0	0.0	-65.2

Point Source, ISO 9613, Name: "HVAC Condenser 8", ID: "HVAC_condenser8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
209	17624300.95	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	62.9	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-40.1
209	17624300.95	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	62.9	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-19.3
209	17624300.95	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	62.9	0.2	3.4	0.0	0.0	1.4	0.0	0.0	-6.4
209	17624300.95	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	62.9	0.4	6.3	0.0	0.0	0.0	0.0	0.0	-2.0
209	17624300.95	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	62.9	0.8	3.0	0.0	0.0	1.7	0.0	0.0	1.1
209	17624300.95	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	62.9	1.4	-0.4	0.0	0.0	5.2	0.0	0.0	-2.2
209	17624300.95	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	62.9	3.8	-0.9	0.0	0.0	5.7	0.0	0.0	-7.4
209	17624300.95	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	62.9	12.9	-0.9	0.0	0.0	5.8	0.0	0.0	-24.7
209	17624300.95	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	62.9	46.0	-0.9	0.0	0.0	5.8	0.0	0.0	-66.1

Point Source, ISO 9613, Name: "HVAC Condenser 4", ID: "HVAC_condenser4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
211	17624289.10	5050373.50	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	62.9	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-40.1
211	17624289.10	5050373.50	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	62.9	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-19.3
211	17624289.10	5050373.50	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	62.9	0.2	3.4	0.0	0.0	1.4	0.0	0.0	-6.5
211	17624289.10	5050373.50	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	62.9	0.4	6.3	0.0	0.0	0.0	0.0	0.0	-2.0
211	17624289.10	5050373.50	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	62.9	0.8	3.0	0.0	0.0	1.7	0.0	0.0	1.1
211	17624289.10	5050373.50	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	62.9	1.4	-0.4	0.0	0.0	5.2	0.0	0.0	-2.2
211	17624289.10	5050373.50	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	62.9	3.8	-0.9	0.0	0.0	5.7	0.0	0.0	-7.4
211	17624289.10	5050373.50	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	62.9	12.9	-0.9	0.0	0.0	5.7	0.0	0.0	-24.7
211	17624289.10	5050373.50	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	62.9	46.0	-0.9	0.0	0.0	5.7	0.0	0.0	-66.1

Point Source, ISO 9613, Name: "HVAC Condenser 5", ID: "HVAC_condenser5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
226	17624290.96	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.0	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-40.2
226	17624290.96	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.0	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-19.4
226	17624290.96	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.0	0.2	3.4	0.0	0.0	1.3	0.0	0.0	-6.5
226	17624290.96	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.0	0.4	6.3	0.0	0.0	0.0	0.0	0.0	-2.1
226	17624290.96	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.0	0.8	3.0	0.0	0.0	1.7	0.0	0.0	1.0
226	17624290.96	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.0	1.5	-0.4	0.0	0.0	5.2	0.0	0.0	-2.3
226	17624290.96	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.0	3.8	-1.0	0.0	0.0	5.7	0.0	0.0	-7.5
226	17624290.96	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.0	13.0	-1.0	0.0	0.0	5.7	0.0	0.0	-24.9
226	17624290.96	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.0	46.5	-1.0	0.0	0.0	5.7	0.0	0.0	-66.7

Point Source, ISO 9613, Name: "HVAC Condenser 9", ID: "HVAC_condenser9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
246	17624296.83	5050362.76	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.0	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-40.2
246	17624296.83	5050362.76	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.0	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-19.5
246	17624296.83	5050362.76	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.0	0.2	3.5	0.0	0.0	1.3	0.0	0.0	-6.6
246	17624296.83	5050362.76	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.0	0.4	6.3	0.0	0.0	0.0	0.0	0.0	-2.1
246	17624296.83	5050362.76	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.0	0.8	3.0	0.0	0.0	1.7	0.0	0.0	1.0
246	17624296.83	5050362.76	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.0	1.5	-0.4	0.0	0.0	5.2	0.0	0.0	-2.4
246	17624296.83	5050362.76	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.0	3.9	-1.0	0.0	0.0	5.7	0.0	0.0	-7.6
246	17624296.83	5050362.76	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.0	13.1	-1.0	0.0	0.0	5.8	0.0	0.0	-25.0
246	17624296.83	5050362.76	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.0	46.7	-1.0	0.0	0.0	5.8	0.0	0.0	-67.0

Point Source, ISO 9613, Name: "HVAC Condenser 1", ID: "HVAC_condenser1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
248	17624283.37	5050367.59	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-40.2
248	17624283.37	5050367.59	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-19.5
248	17624283.37	5050367.59	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.1	0.2	3.5	0.0	0.0	1.3	0.0	0.0	-6.6
248	17624283.37	5050367.59	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.1	0.4	6.3	0.0	0.0	0.0	0.0	0.0	-2.1
248	17624283.37	5050367.59	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.1	0.8	3.0	0.0	0.0	1.7	0.0	0.0	0.9
248	17624283.37	5050367.59	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.4	0.0	0.0	5.2	0.0	0.0	-2.4
248	17624283.37	5050367.59	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.1	3.9	-1.0	0.0	0.0	5.7	0.0	0.0	-7.6
248	17624283.37	5050367.59	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.1	13.2	-1.0	0.0	0.0	5.7	0.0	0.0	-25.1
248	17624283.37	5050367.59	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.1	46.9	-1.0	0.0	0.0	5.7	0.0	0.0	-67.2

Point Source, ISO 9613, Name: "HVAC Condenser 6", ID: "HVAC_condenser6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
249	17624286.79	5050362.77	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-40.3
249	17624286.79	5050362.77	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-19.6
249	17624286.79	5050362.77	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.1	0.2	3.5	0.0	0.0	1.3	0.0	0.0	-6.7
249	17624286.79	5050362.77	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.1	0.4	6.3	0.0	0.0	0.0	0.0	0.0	-2.2
249	17624286.79	5050362.77	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.1	0.8	3.0	0.0	0.0	1.7	0.0	0.0	0.9
249	17624286.79	5050362.77	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.4	0.0	0.0	5.2	0.0	0.0	-2.5
249	17624286.79	5050362.77	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.1	3.9	-1.0	0.0	0.0	5.7	0.0	0.0	-7.7
249	17624286.79	5050362.77	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.1	13.2	-1.0	0.0	0.0	5.7	0.0	0.0	-25.2
249	17624286.79	5050362.77	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.1	47.2	-1.0	0.0	0.0	5.8	0.0	0.0	-67.6

Point Source, ISO 9613, Name: "HVAC Condenser 2", ID: "HVAC_condenser2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
250	17624279.21	5050362.61	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.2	0.0	-4.8	0.0	0.0	9.6	0.0	0.0	-40.4
250	17624279.21	5050362.61	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.2	0.0	-4.8	0.0	0.0	9.6	0.0	0.0	-19.6
250	17624279.21	5050362.61	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.2	0.2	3.5	0.0	0.0	1.3	0.0	0.0	-6.8
250	17624279.21	5050362.61	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.2	0.4	6.3	0.0	0.0	0.0	0.0	0.0	-2.3
250	17624279.21	5050362.61	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.2	0.8	3.0	0.0	0.0	1.7	0.0	0.0	0.8
250	17624279.21	5050362.61	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.2	1.5	-0.4	0.0	0.0	5.2	0.0	0.0	-2.6
250	17624279.21	5050362.61	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.2	3.9	-1.0	0.0	0.0	5.7	0.0	0.0	-7.8
250	17624279.21	5050362.61	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.2	13.4	-1.0	0.0	0.0	5.7	0.0	0.0	-25.4
250	17624279.21	5050362.61	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.2	47.7	-1.0	0.0	0.0	5.7	0.0	0.0	-68.1

Point Source, ISO 9613, Name: "UPS 7", ID: "UPS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
257	17624296.42	5050378.45	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	62.7	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-41.9
257	17624296.42	5050378.45	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	62.7	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.2
257	17624296.42	5050378.45	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	62.7	0.2	2.7	0.0	0.0	2.1	0.0	0.0	-9.2
257	17624296.42	5050378.45	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	62.7	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-10.7
257	17624296.42	5050378.45	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	62.7	0.7	4.7	0.0	0.0	0.1	0.0	0.0	-7.1
257	17624296.42	5050378.45	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	62.7	1.4	-0.4	0.0	0.0	5.3	0.0	0.0	-3.8
257	17624296.42	5050378.45	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	62.7	3.7	-1.0	0.0	0.0	6.0	0.0	0.0	-4.9
257	17624296.42	5050378.45	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	62.7	12.6	-1.0	0.0	0.0	6.1	0.0	0.0	-18.4
257	17624296.42	5050378.45	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	62.7	45.1	-1.0	0.0	0.0	6.5	0.0	0.0	-62.6

Point Source, ISO 9613, Name: "UPS 3", ID: "UPS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
259	17624288.82	5050378.40	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.0
259	17624288.82	5050378.40	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.3
259	17624288.82	5050378.40	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	62.8	0.2	2.7	0.0	0.0	2.1	0.0	0.0	-9.3
259	17624288.82	5050378.40	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	62.8	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-10.8
259	17624288.82	5050378.40	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	62.8	0.8	4.7	0.0	0.0	0.1	0.0	0.0	-7.2
259	17624288.82	5050378.40	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	62.8	1.4	-0.4	0.0	0.0	5.2	0.0	0.0	-3.9
259	17624288.82	5050378.40	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	62.8	3.8	-1.0	0.0	0.0	5.9	0.0	0.0	-4.9
259	17624288.82	5050378.40	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	62.8	12.8	-1.0	0.0	0.0	6.0	0.0	0.0	-18.5
259	17624288.82	5050378.40	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	62.8	45.5	-1.0	0.0	0.0	6.3	0.0	0.0	-62.9

Point Source, ISO 9613, Name: "UPS 4", ID: "UPS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
261	17624293.53	5050373.46	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.1
261	17624293.53	5050373.46	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.4
261	17624293.53	5050373.46	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	62.9	0.2	2.7	0.0	0.0	2.1	0.0	0.0	-9.4
261	17624293.53	5050373.46	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	62.9	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-10.9
261	17624293.53	5050373.46	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	62.9	0.8	4.7	0.0	0.0	0.1	0.0	0.0	-7.3
261	17624293.53	5050373.46	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	62.9	1.4	-0.4	0.0	0.0	5.3	0.0	0.0	-4.0
261	17624293.53	5050373.46	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	62.9	3.8	-1.0	0.0	0.0	6.0	0.0	0.0	-5.1
261	17624293.53	5050373.46	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	62.9	12.8	-1.0	0.0	0.0	6.2	0.0	0.0	-18.8
261	17624293.53	5050373.46	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	62.9	45.8	-1.0	0.0	0.0	6.6	0.0	0.0	-63.5

Point Source, ISO 9613, Name: "UPS 8", ID: "UPS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
263	17624296.53	5050367.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.2
263	17624296.53	5050367.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.5
263	17624296.53	5050367.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	62.9	0.2	2.8	0.0	0.0	2.0	0.0	0.0	-9.4
263	17624296.53	5050367.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	62.9	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-11.0
263	17624296.53	5050367.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	62.9	0.8	4.7	0.0	0.0	0.1	0.0	0.0	-7.4
263	17624296.53	5050367.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	62.9	1.4	-0.4	0.0	0.0	5.3	0.0	0.0	-4.1
263	17624296.53	5050367.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	62.9	3.8	-1.0	0.0	0.0	6.1	0.0	0.0	-5.3
263	17624296.53	5050367.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	62.9	12.9	-1.0	0.0	0.0	6.4	0.0	0.0	-19.2
263	17624296.53	5050367.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	62.9	46.2	-1.0	0.0	0.0	6.9	0.0	0.0	-64.4

Point Source, ISO 9613, Name: "UPS 9", ID: "UPS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
265	17624301.15	5050362.78	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.2
265	17624301.15	5050362.78	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.5
265	17624301.15	5050362.78	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.0	0.2	2.8	0.0	0.0	2.0	0.0	0.0	-9.5
265	17624301.15	5050362.78	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.0	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-11.0
265	17624301.15	5050362.78	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.0	0.8	4.7	0.0	0.0	0.2	0.0	0.0	-7.5
265	17624301.15	5050362.78	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.0	1.5	-0.4	0.0	0.0	5.4	0.0	0.0	-4.3
265	17624301.15	5050362.78	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.0	3.8	-1.0	0.0	0.0	6.3	0.0	0.0	-5.5
265	17624301.15	5050362.78	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.0	13.0	-1.0	0.0	0.0	6.7	0.0	0.0	-19.6
265	17624301.15	5050362.78	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.0	46.4	-1.0	0.0	0.0	7.4	0.0	0.0	-65.1

Point Source, ISO 9613, Name: "UPS 5", ID: "UPS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
271	17624286.54	5050367.66	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.3
271	17624286.54	5050367.66	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.6
271	17624286.54	5050367.66	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.0	0.2	2.8	0.0	0.0	2.0	0.0	0.0	-9.6
271	17624286.54	5050367.66	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.0	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-11.1
271	17624286.54	5050367.66	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.0	0.8	4.7	0.0	0.0	0.2	0.0	0.0	-7.6
271	17624286.54	5050367.66	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.0	1.5	-0.4	0.0	0.0	5.4	0.0	0.0	-4.4
271	17624286.54	5050367.66	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.0	3.9	-1.0	0.0	0.0	6.3	0.0	0.0	-5.7
271	17624286.54	5050367.66	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.0	13.1	-1.0	0.0	0.0	6.8	0.0	0.0	-19.8
271	17624286.54	5050367.66	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.0	46.7	-1.0	0.0	0.0	7.6	0.0	0.0	-65.7

Point Source, ISO 9613, Name: "UPS 6", ID: "UPS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
280	17624291.19	5050362.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.3
280	17624291.19	5050362.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.6
280	17624291.19	5050362.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.1	0.2	2.8	0.0	0.0	2.0	0.0	0.0	-9.6
280	17624291.19	5050362.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.1	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-11.1
280	17624291.19	5050362.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.1	0.8	4.7	0.0	0.0	0.1	0.0	0.0	-7.6
280	17624291.19	5050362.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.1	1.5	-0.4	0.0	0.0	5.3	0.0	0.0	-4.3
280	17624291.19	5050362.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.1	3.9	-1.0	0.0	0.0	6.1	0.0	0.0	-5.5
280	17624291.19	5050362.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.1	13.2	-1.0	0.0	0.0	6.4	0.0	0.0	-19.5
280	17624291.19	5050362.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.1	47.0	-1.0	0.0	0.0	6.9	0.0	0.0	-65.3

Point Source, ISO 9613, Name: "UPS 1", ID: "UPS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
282	17624278.90	5050367.58	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.3
282	17624278.90	5050367.58	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.6
282	17624278.90	5050367.58	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.1	0.2	2.8	0.0	0.0	1.9	0.0	0.0	-9.6
282	17624278.90	5050367.58	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.1	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-11.2
282	17624278.90	5050367.58	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.1	0.8	4.7	0.0	0.0	0.1	0.0	0.0	-7.5
282	17624278.90	5050367.58	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.1	1.5	-0.4	0.0	0.0	5.2	0.0	0.0	-4.2
282	17624278.90	5050367.58	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.1	3.9	-1.0	0.0	0.0	5.9	0.0	0.0	-5.3
282	17624278.90	5050367.58	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.1	13.2	-1.0	0.0	0.0	6.0	0.0	0.0	-19.2
282	17624278.90	5050367.58	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.1	47.2	-1.0	0.0	0.0	6.2	0.0	0.0	-64.8

Point Source, ISO 9613, Name: "UPS 2", ID: "UPS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
284	17624283.74	5050362.73	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.2	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.4
284	17624283.74	5050362.73	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.2	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.7
284	17624283.74	5050362.73	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.2	0.2	2.9	0.0	0.0	1.9	0.0	0.0	-9.7
284	17624283.74	5050362.73	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.2	0.4	9.4	0.0	0.0	0.0	0.0	0.0	-11.2
284	17624283.74	5050362.73	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.2	0.8	4.7	0.0	0.0	0.2	0.0	0.0	-7.7
284	17624283.74	5050362.73	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.2	1.5	-0.4	0.0	0.0	5.5	0.0	0.0	-4.5
284	17624283.74	5050362.73	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.2	3.9	-1.0	0.0	0.0	6.4	0.0	0.0	-5.9
284	17624283.74	5050362.73	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.2	13.3	-1.0	0.0	0.0	6.9	0.0	0.0	-20.2
284	17624283.74	5050362.73	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.2	47.4	-1.0	0.0	0.0	7.8	0.0	0.0	-66.6

Receiver

Name: OLA3
 ID: OLA3
 X: 17624223.91 m
 Y: 5050748.28 m
 Z: 310.69 m

Point Source, ISO 9613, Name: "Transformer 4MW", ID: "transformer_4MW"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
36	17624270.19	5050367.48	342.00	0	DEN	32	41.6	0.0	0.0	0.0	0.0	62.7	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-25.9
36	17624270.19	5050367.48	342.00	0	DEN	63	62.8	0.0	0.0	0.0	0.0	62.7	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-4.7
36	17624270.19	5050367.48	342.00	0	DEN	125	76.9	0.0	0.0	0.0	0.0	62.7	0.2	2.1	0.0	0.0	2.6	0.0	0.0	9.3
36	17624270.19	5050367.48	342.00	0	DEN	250	68.4	0.0	0.0	0.0	0.0	62.7	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-2.9
36	17624270.19	5050367.48	342.00	0	DEN	500	69.8	0.0	0.0	0.0	0.0	62.7	0.7	3.8	0.0	0.0	0.9	0.0	0.0	1.6
36	17624270.19	5050367.48	342.00	0	DEN	1000	71.0	0.0	0.0	0.0	0.0	62.7	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	2.1
36	17624270.19	5050367.48	342.00	0	DEN	2000	69.2	0.0	0.0	0.0	0.0	62.7	3.7	-1.2	0.0	0.0	6.0	0.0	0.0	-2.0
36	17624270.19	5050367.48	342.00	0	DEN	4000	71.0	0.0	0.0	0.0	0.0	62.7	12.6	-1.2	0.0	0.0	6.0	0.0	0.0	-9.1
36	17624270.19	5050367.48	342.00	0	DEN	8000	51.9	0.0	0.0	0.0	0.0	62.7	45.0	-1.2	0.0	0.0	6.0	0.0	0.0	-60.6

Point Source, ISO 9613, Name: "HVAC Economizer Hood 3", ID: "HVAC_hood3"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
41	17624294.15	5050377.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	62.6	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-25.6
41	17624294.15	5050377.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	62.6	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-4.8
41	17624294.15	5050377.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	62.6	0.2	2.8	0.0	0.0	0.0	0.0	0.0	0.5
41	17624294.15	5050377.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	62.6	0.4	5.2	0.0	0.0	0.0	0.0	0.0	4.2
41	17624294.15	5050377.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	62.6	0.7	2.2	0.0	0.0	0.0	0.0	0.0	8.8
41	17624294.15	5050377.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	62.6	1.4	-0.7	0.0	0.0	0.0	0.0	0.0	8.3
41	17624294.15	5050377.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	62.6	3.7	-1.1	0.0	0.0	0.0	0.0	0.0	3.7
41	17624294.15	5050377.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	62.6	12.4	-1.1	0.0	0.0	0.0	0.0	0.0	-13.3
41	17624294.15	5050377.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	62.6	44.3	-1.1	0.0	0.0	0.0	0.0	0.0	-53.4

Point Source, ISO 9613, Name: "HVAC Economizer Hood 4", ID: "HVAC_hood4"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
52	17624288.27	5050374.68	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	62.6	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-25.6
52	17624288.27	5050374.68	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	62.6	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-4.9
52	17624288.27	5050374.68	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	62.6	0.2	2.8	0.0	0.0	0.0	0.0	0.0	0.5
52	17624288.27	5050374.68	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	62.6	0.4	5.1	0.0	0.0	0.0	0.0	0.0	4.2
52	17624288.27	5050374.68	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	62.6	0.7	2.2	0.0	0.0	0.0	0.0	0.0	8.7
52	17624288.27	5050374.68	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	62.6	1.4	-0.7	0.0	0.0	0.0	0.0	0.0	8.3
52	17624288.27	5050374.68	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	62.6	3.7	-1.1	0.0	0.0	0.0	0.0	0.0	3.7
52	17624288.27	5050374.68	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	62.6	12.5	-1.1	0.0	0.0	0.0	0.0	0.0	-13.3
52	17624288.27	5050374.68	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	62.6	44.5	-1.1	0.0	0.0	0.0	0.0	0.0	-53.6

Point Source, ISO 9613, Name: "HVAC Economizer Hood 7", ID: "HVAC_hood7"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
60	17624301.74	5050377.18	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	62.6	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-25.6
60	17624301.74	5050377.18	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	62.6	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-4.9
60	17624301.74	5050377.18	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	62.6	0.2	2.8	0.0	0.0	0.0	0.0	0.0	0.5
60	17624301.74	5050377.18	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	62.6	0.4	5.2	0.0	0.0	0.0	0.0	0.0	4.2
60	17624301.74	5050377.18	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	62.6	0.7	2.2	0.0	0.0	0.0	0.0	0.0	8.7
60	17624301.74	5050377.18	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	62.6	1.4	-0.7	0.0	0.0	0.0	0.0	0.0	8.3
60	17624301.74	5050377.18	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	62.6	3.7	-1.1	0.0	0.0	0.0	0.0	0.0	3.7
60	17624301.74	5050377.18	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	62.6	12.5	-1.1	0.0	0.0	0.0	0.0	0.0	-13.3
60	17624301.74	5050377.18	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	62.6	44.5	-1.1	0.0	0.0	0.0	0.0	0.0	-53.6

Point Source, ISO 9613, Name: "HVAC Economizer Hood 1", ID: "HVAC_hood1"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
96	17624284.42	5050366.44	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-25.7

Point Source, ISO 9613, Name: "HVAC Economizer Hood 1", ID: "HVAC_hood1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
96	17624284.42	5050366.44	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-5.0
96	17624284.42	5050366.44	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	62.8	0.2	2.9	0.0	0.0	0.0	0.0	0.0	0.3
96	17624284.42	5050366.44	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	62.8	0.4	5.1	0.0	0.0	0.0	0.0	0.0	4.0
96	17624284.42	5050366.44	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	62.8	0.7	2.2	0.0	0.0	0.0	0.0	0.0	8.6
96	17624284.42	5050366.44	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	0.0	0.0	0.0	8.1
96	17624284.42	5050366.44	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	62.8	3.7	-1.1	0.0	0.0	0.0	0.0	0.0	3.4
96	17624284.42	5050366.44	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	62.8	12.7	-1.1	0.0	0.0	0.0	0.0	0.0	-13.7
96	17624284.42	5050366.44	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	62.8	45.4	-1.1	0.0	0.0	0.0	0.0	0.0	-54.7

Point Source, ISO 9613, Name: "HVAC Economizer Hood 5", ID: "HVAC_hood5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
113	17624291.94	5050366.35	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-25.8
113	17624291.94	5050366.35	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-5.0
113	17624291.94	5050366.35	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	62.8	0.2	2.9	0.0	0.0	0.0	0.0	0.0	0.2
113	17624291.94	5050366.35	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	62.8	0.4	5.1	0.0	0.0	0.0	0.0	0.0	4.0
113	17624291.94	5050366.35	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	62.8	0.8	2.2	0.0	0.0	0.0	0.0	0.0	8.5
113	17624291.94	5050366.35	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	0.0	0.0	0.0	8.1
113	17624291.94	5050366.35	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	62.8	3.8	-1.1	0.0	0.0	0.0	0.0	0.0	3.4
113	17624291.94	5050366.35	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	62.8	12.8	-1.1	0.0	0.0	0.0	0.0	0.0	-13.8
113	17624291.94	5050366.35	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	62.8	45.5	-1.1	0.0	0.0	0.0	0.0	0.0	-54.8

Point Source, ISO 9613, Name: "HVAC Economizer Hood 2", ID: "HVAC_hood2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
115	17624278.29	5050363.89	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-25.8
115	17624278.29	5050363.89	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-5.0
115	17624278.29	5050363.89	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	62.8	0.2	2.9	0.0	0.0	0.0	0.0	0.0	0.2
115	17624278.29	5050363.89	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	62.8	0.4	5.1	0.0	0.0	0.0	0.0	0.0	4.0
115	17624278.29	5050363.89	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	62.8	0.8	2.2	0.0	0.0	0.0	0.0	0.0	8.5
115	17624278.29	5050363.89	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	0.0	0.0	0.0	8.1
115	17624278.29	5050363.89	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	62.8	3.8	-1.2	0.0	0.0	0.0	0.0	0.0	3.4
115	17624278.29	5050363.89	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	62.8	12.8	-1.2	0.0	0.0	0.0	0.0	0.0	-13.8
115	17624278.29	5050363.89	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	62.8	45.5	-1.2	0.0	0.0	0.0	0.0	0.0	-54.9

Point Source, ISO 9613, Name: "HVAC Economizer Hood 6", ID: "HVAC_hood6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
122	17624285.84	5050363.98	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-25.8
122	17624285.84	5050363.98	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-5.1
122	17624285.84	5050363.98	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	62.8	0.2	2.9	0.0	0.0	0.0	0.0	0.0	0.2
122	17624285.84	5050363.98	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	62.8	0.4	5.1	0.0	0.0	0.0	0.0	0.0	4.0
122	17624285.84	5050363.98	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	62.8	0.8	2.2	0.0	0.0	0.0	0.0	0.0	8.5
122	17624285.84	5050363.98	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	0.0	0.0	0.0	8.0
122	17624285.84	5050363.98	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	62.8	3.8	-1.2	0.0	0.0	0.0	0.0	0.0	3.4
122	17624285.84	5050363.98	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	62.8	12.8	-1.2	0.0	0.0	0.0	0.0	0.0	-13.9
122	17624285.84	5050363.98	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	62.8	45.7	-1.2	0.0	0.0	0.0	0.0	0.0	-55.0

Point Source, ISO 9613, Name: "HVAC Economizer Hood 8", ID: "HVAC_hood8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
152	17624301.95	5050366.49	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-35.3
152	17624301.95	5050366.49	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-14.6
152	17624301.95	5050366.49	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	62.8	0.2	2.9	0.0	0.0	1.9	0.0	0.0	-1.7
152	17624301.95	5050366.49	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	62.8	0.4	5.1	0.0	0.0	0.0	0.0	0.0	3.9
152	17624301.95	5050366.49	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	62.8	0.8	2.2	0.0	0.0	2.6	0.0	0.0	5.9
152	17624301.95	5050366.49	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	2.6
152	17624301.95	5050366.49	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	62.8	3.8	-1.1	0.0	0.0	5.9	0.0	0.0	-2.6
152	17624301.95	5050366.49	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	62.8	12.8	-1.1	0.0	0.0	5.9	0.0	0.0	-19.8
152	17624301.95	5050366.49	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	62.8	45.7	-1.1	0.0	0.0	5.9	0.0	0.0	-61.0

Point Source, ISO 9613, Name: "HVAC Economizer Hood 9", ID: "HVAC_hood9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
153	17624295.94	5050364.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	62.9	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-35.3
153	17624295.94	5050364.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	62.9	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-14.6
153	17624295.94	5050364.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	62.9	0.2	2.9	0.0	0.0	1.9	0.0	0.0	-1.7
153	17624295.94	5050364.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	62.9	0.4	5.1	0.0	0.0	0.0	0.0	0.0	3.9
153	17624295.94	5050364.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	62.9	0.8	2.2	0.0	0.0	2.6	0.0	0.0	5.8
153	17624295.94	5050364.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	62.9	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	2.5
153	17624295.94	5050364.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	62.9	3.8	-1.1	0.0	0.0	5.9	0.0	0.0	-2.6
153	17624295.94	5050364.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	62.9	12.9	-1.1	0.0	0.0	5.9	0.0	0.0	-19.9
153	17624295.94	5050364.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	62.9	45.9	-1.1	0.0	0.0	5.9	0.0	0.0	-61.2

Point Source, ISO 9613, Name: "Transformer 2MW", ID: "transformer_2MW"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
155	17624280.40	5050378.87	342.00	0	DEN	32	38.6	0.0	0.0	0.0	0.0	62.5	0.0	-5.2	0.0	0.0	9.9	0.0	0.0	-28.7
155	17624280.40	5050378.87	342.00	0	DEN	63	59.8	0.0	0.0	0.0	0.0	62.5	0.0	-5.2	0.0	0.0	9.9	0.0	0.0	-7.5
155	17624280.40	5050378.87	342.00	0	DEN	125	73.9	0.0	0.0	0.0	0.0	62.5	0.2	2.1	0.0	0.0	2.7	0.0	0.0	6.5
155	17624280.40	5050378.87	342.00	0	DEN	250	65.4	0.0	0.0	0.0	0.0	62.5	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.7
155	17624280.40	5050378.87	342.00	0	DEN	500	66.8	0.0	0.0	0.0	0.0	62.5	0.7	3.8	0.0	0.0	0.9	0.0	0.0	-1.2
155	17624280.40	5050378.87	342.00	0	DEN	1000	68.0	0.0	0.0	0.0	0.0	62.5	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	-0.6
155	17624280.40	5050378.87	342.00	0	DEN	2000	66.2	0.0	0.0	0.0	0.0	62.5	3.6	-1.2	0.0	0.0	6.0	0.0	0.0	-4.7
155	17624280.40	5050378.87	342.00	0	DEN	4000	68.0	0.0	0.0	0.0	0.0	62.5	12.3	-1.2	0.0	0.0	6.0	0.0	0.0	-11.5
155	17624280.40	5050378.87	342.00	0	DEN	8000	48.9	0.0	0.0	0.0	0.0	62.5	43.8	-1.2	0.0	0.0	6.0	0.0	0.0	-62.2

Point Source, ISO 9613, Name: "PCS 3", ID: "PCS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
157	17624290.73	5050378.40	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.5	0.0	-5.2	0.0	0.0	9.9	0.0	0.0	-37.0
157	17624290.73	5050378.40	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.5	0.0	-5.2	0.0	0.0	9.9	0.0	0.0	-24.3
157	17624290.73	5050378.40	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.5	0.2	2.1	0.0	0.0	2.7	0.0	0.0	-4.3
157	17624290.73	5050378.40	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.5	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-4.7
157	17624290.73	5050378.40	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.5	0.7	3.8	0.0	0.0	0.9	0.0	0.0	-2.2
157	17624290.73	5050378.40	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.5	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	1.2
157	17624290.73	5050378.40	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.5	3.6	-1.2	0.0	0.0	6.0	0.0	0.0	0.3
157	17624290.73	5050378.40	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.5	12.4	-1.2	0.0	0.0	6.0	0.0	0.0	-12.9
157	17624290.73	5050378.40	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.5	44.1	-1.2	0.0	0.0	6.0	0.0	0.0	-56.0

Point Source, ISO 9613, Name: "PCS 10", ID: "PCS10"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
165	17624280.69	5050376.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.5	0.0	-5.2	0.0	0.0	9.9	0.0	0.0	-37.0
165	17624280.69	5050376.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.5	0.0	-5.2	0.0	0.0	9.9	0.0	0.0	-24.4
165	17624280.69	5050376.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.5	0.2	2.1	0.0	0.0	2.7	0.0	0.0	-4.3
165	17624280.69	5050376.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.5	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-4.7
165	17624280.69	5050376.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.5	0.7	3.8	0.0	0.0	0.9	0.0	0.0	-2.2
165	17624280.69	5050376.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.5	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	1.2
165	17624280.69	5050376.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.5	3.6	-1.2	0.0	0.0	6.0	0.0	0.0	0.3
165	17624280.69	5050376.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.5	12.4	-1.2	0.0	0.0	6.0	0.0	0.0	-12.9
165	17624280.69	5050376.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.5	44.1	-1.2	0.0	0.0	6.0	0.0	0.0	-56.1

Point Source, ISO 9613, Name: "PCS 7", ID: "PCS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
168	17624298.22	5050378.41	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.6	0.0	-5.2	0.0	0.0	9.9	0.0	0.0	-37.1
168	17624298.22	5050378.41	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.6	0.0	-5.2	0.0	0.0	9.9	0.0	0.0	-24.4
168	17624298.22	5050378.41	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.6	0.2	2.1	0.0	0.0	2.7	0.0	0.0	-4.3
168	17624298.22	5050378.41	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.6	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-4.7
168	17624298.22	5050378.41	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.6	0.7	3.8	0.0	0.0	0.9	0.0	0.0	-2.2
168	17624298.22	5050378.41	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.6	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	1.1
168	17624298.22	5050378.41	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.6	3.7	-1.2	0.0	0.0	6.0	0.0	0.0	0.2
168	17624298.22	5050378.41	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.6	12.4	-1.2	0.0	0.0	6.0	0.0	0.0	-13.0
168	17624298.22	5050378.41	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.6	44.2	-1.2	0.0	0.0	6.0	0.0	0.0	-56.3

Point Source, ISO 9613, Name: "PCS 11", ID: "PCS11"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
181	17624280.74	5050375.25	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.6	0.0	-5.2	0.0	0.0	9.9	0.0	0.0	-37.1
181	17624280.74	5050375.25	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.6	0.0	-5.2	0.0	0.0	9.9	0.0	0.0	-24.4
181	17624280.74	5050375.25	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.6	0.2	2.1	0.0	0.0	2.7	0.0	0.0	-4.4
181	17624280.74	5050375.25	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.6	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-4.7
181	17624280.74	5050375.25	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.6	0.7	3.8	0.0	0.0	0.9	0.0	0.0	-2.2
181	17624280.74	5050375.25	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.6	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	1.2
181	17624280.74	5050375.25	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.6	3.7	-1.2	0.0	0.0	6.0	0.0	0.0	0.2
181	17624280.74	5050375.25	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.6	12.4	-1.2	0.0	0.0	6.0	0.0	0.0	-13.0
181	17624280.74	5050375.25	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.6	44.3	-1.2	0.0	0.0	6.0	0.0	0.0	-56.2

Point Source, ISO 9613, Name: "PCS 4", ID: "PCS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
202	17624291.60	5050373.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.6	0.0	-5.2	0.0	0.0	9.9	0.0	0.0	-37.2
202	17624291.60	5050373.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.6	0.0	-5.2	0.0	0.0	9.9	0.0	0.0	-24.5
202	17624291.60	5050373.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.6	0.2	2.1	0.0	0.0	2.6	0.0	0.0	-4.4
202	17624291.60	5050373.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.6	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-4.8
202	17624291.60	5050373.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.6	0.7	3.8	0.0	0.0	0.9	0.0	0.0	-2.3
202	17624291.60	5050373.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.6	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	1.1
202	17624291.60	5050373.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.6	3.7	-1.2	0.0	0.0	6.0	0.0	0.0	0.1
202	17624291.60	5050373.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.6	12.5	-1.2	0.0	0.0	6.0	0.0	0.0	-13.2
202	17624291.60	5050373.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.6	44.7	-1.2	0.0	0.0	6.1	0.0	0.0	-56.8

Point Source, ISO 9613, Name: "PCS 1", ID: "PCS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
204	17624280.88	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.7	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.2
204	17624280.88	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.7	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.6
204	17624280.88	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.7	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-4.5
204	17624280.88	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.7	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-4.9
204	17624280.88	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.7	0.7	3.8	0.0	0.0	0.9	0.0	0.0	-2.4
204	17624280.88	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.7	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	0.9
204	17624280.88	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.7	3.7	-1.2	0.0	0.0	6.0	0.0	0.0	-0.0
204	17624280.88	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.7	12.7	-1.2	0.0	0.0	6.0	0.0	0.0	-13.4
204	17624280.88	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.7	45.1	-1.2	0.0	0.0	6.0	0.0	0.0	-57.3

Point Source, ISO 9613, Name: "PCS 5", ID: "PCS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
212	17624288.51	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.3
212	17624288.51	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.6
212	17624288.51	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.8	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-4.6
212	17624288.51	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.8	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-4.9
212	17624288.51	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.8	0.7	3.8	0.0	0.0	0.9	0.0	0.0	-2.4
212	17624288.51	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	0.9
212	17624288.51	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.8	3.7	-1.2	0.0	0.0	6.0	0.0	0.0	-0.1
212	17624288.51	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.8	12.7	-1.2	0.0	0.0	6.1	0.0	0.0	-13.5
212	17624288.51	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.8	45.3	-1.2	0.0	0.0	6.1	0.0	0.0	-57.6

Point Source, ISO 9613, Name: "PCS 12", ID: "PCS12"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
214	17624270.58	5050364.97	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.3
214	17624270.58	5050364.97	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.6
214	17624270.58	5050364.97	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.8	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-4.6
214	17624270.58	5050364.97	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.8	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-4.9
214	17624270.58	5050364.97	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.8	0.7	3.8	0.0	0.0	0.9	0.0	0.0	-2.4
214	17624270.58	5050364.97	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	0.9
214	17624270.58	5050364.97	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.8	3.7	-1.2	0.0	0.0	6.0	0.0	0.0	-0.0
214	17624270.58	5050364.97	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.8	12.7	-1.2	0.0	0.0	6.0	0.0	0.0	-13.5
214	17624270.58	5050364.97	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.8	45.3	-1.2	0.0	0.0	6.0	0.0	0.0	-57.5

Point Source, ISO 9613, Name: "PCS 13", ID: "PCS13"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
229	17624270.54	5050363.56	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.3
229	17624270.54	5050363.56	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.6
229	17624270.54	5050363.56	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.8	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-4.6
229	17624270.54	5050363.56	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.8	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-4.9
229	17624270.54	5050363.56	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.8	0.7	3.8	0.0	0.0	0.9	0.0	0.0	-2.5
229	17624270.54	5050363.56	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	0.9
229	17624270.54	5050363.56	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.8	3.8	-1.2	0.0	0.0	6.0	0.0	0.0	-0.1
229	17624270.54	5050363.56	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.8	12.7	-1.2	0.0	0.0	6.0	0.0	0.0	-13.5
229	17624270.54	5050363.56	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.8	45.4	-1.2	0.0	0.0	6.0	0.0	0.0	-57.7

Point Source, ISO 9613, Name: "PCS 8", ID: "PCS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
273	17624298.45	5050367.65	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.3
273	17624298.45	5050367.65	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.6
273	17624298.45	5050367.65	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.8	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-4.6
273	17624298.45	5050367.65	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.8	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.0
273	17624298.45	5050367.65	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.8	0.8	3.8	0.0	0.0	0.9	0.0	0.0	-2.5
273	17624298.45	5050367.65	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	0.8
273	17624298.45	5050367.65	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.8	3.8	-1.2	0.0	0.0	6.1	0.0	0.0	-0.2
273	17624298.45	5050367.65	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.8	12.8	-1.2	0.0	0.0	6.2	0.0	0.0	-13.7
273	17624298.45	5050367.65	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.8	45.5	-1.2	0.0	0.0	6.3	0.0	0.0	-58.0

Point Source, ISO 9613, Name: "PCS 14", ID: "PCS14"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
275	17624270.56	5050362.20	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.3
275	17624270.56	5050362.20	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.6
275	17624270.56	5050362.20	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.8	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-4.6
275	17624270.56	5050362.20	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.8	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.0
275	17624270.56	5050362.20	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.8	0.8	3.8	0.0	0.0	0.9	0.0	0.0	-2.5
275	17624270.56	5050362.20	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	0.8
275	17624270.56	5050362.20	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.8	3.8	-1.2	0.0	0.0	6.0	0.0	0.0	-0.1
275	17624270.56	5050362.20	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.8	12.8	-1.2	0.0	0.0	6.0	0.0	0.0	-13.6
275	17624270.56	5050362.20	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.8	45.6	-1.2	0.0	0.0	6.0	0.0	0.0	-57.9

Point Source, ISO 9613, Name: "PCS 2", ID: "PCS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
276	17624281.69	5050362.69	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.4
276	17624281.69	5050362.69	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.7
276	17624281.69	5050362.69	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.8	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-4.6
276	17624281.69	5050362.69	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.8	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.0
276	17624281.69	5050362.69	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.8	0.8	3.8	0.0	0.0	0.9	0.0	0.0	-2.5
276	17624281.69	5050362.69	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	0.8
276	17624281.69	5050362.69	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.8	3.8	-1.2	0.0	0.0	6.0	0.0	0.0	-0.2
276	17624281.69	5050362.69	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.8	12.8	-1.2	0.0	0.0	6.1	0.0	0.0	-13.7
276	17624281.69	5050362.69	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.8	45.7	-1.2	0.0	0.0	6.1	0.0	0.0	-58.1

Point Source, ISO 9613, Name: "PCS 6", ID: "PCS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
278	17624289.16	5050362.78	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.4
278	17624289.16	5050362.78	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.7
278	17624289.16	5050362.78	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.9	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-4.7
278	17624289.16	5050362.78	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.9	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.0
278	17624289.16	5050362.78	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.9	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-2.6
278	17624289.16	5050362.78	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.9	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	0.8
278	17624289.16	5050362.78	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.9	3.8	-1.2	0.0	0.0	6.1	0.0	0.0	-0.3
278	17624289.16	5050362.78	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.9	12.9	-1.2	0.0	0.0	6.1	0.0	0.0	-13.8
278	17624289.16	5050362.78	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.9	45.8	-1.2	0.0	0.0	6.3	0.0	0.0	-58.4

Point Source, ISO 9613, Name: "PCS 9", ID: "PCS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
293	17624299.21	5050362.68	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.4
293	17624299.21	5050362.68	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.7
293	17624299.21	5050362.68	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.9	0.2	2.2	0.0	0.0	2.5	0.0	0.0	-4.7
293	17624299.21	5050362.68	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.9	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.1
293	17624299.21	5050362.68	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.9	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-2.6
293	17624299.21	5050362.68	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.9	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	0.7
293	17624299.21	5050362.68	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.9	3.8	-1.2	0.0	0.0	6.2	0.0	0.0	-0.4
293	17624299.21	5050362.68	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.9	12.9	-1.2	0.0	0.0	6.3	0.0	0.0	-14.1
293	17624299.21	5050362.68	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.9	46.1	-1.2	0.0	0.0	6.5	0.0	0.0	-58.9

Point Source, ISO 9613, Name: "HVAC Condenser 3", ID: "HVAC_condenser3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
295	17624293.15	5050378.41	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	62.5	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-30.3
295	17624293.15	5050378.41	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	62.5	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-9.5
295	17624293.15	5050378.41	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	62.5	0.2	2.8	0.0	0.0	0.0	0.0	0.0	-4.1
295	17624293.15	5050378.41	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	62.5	0.4	5.2	0.0	0.0	0.0	0.0	0.0	-0.5
295	17624293.15	5050378.41	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	62.5	0.7	2.2	0.0	0.0	0.0	0.0	0.0	4.1
295	17624293.15	5050378.41	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	62.5	1.4	-0.7	0.0	0.0	0.0	0.0	0.0	3.7
295	17624293.15	5050378.41	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	62.5	3.7	-1.1	0.0	0.0	0.0	0.0	0.0	-0.9
295	17624293.15	5050378.41	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	62.5	12.4	-1.1	0.0	0.0	0.0	0.0	0.0	-17.9
295	17624293.15	5050378.41	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	62.5	44.2	-1.1	0.0	0.0	0.0	0.0	0.0	-57.9

Point Source, ISO 9613, Name: "HVAC Condenser 7", ID: "HVAC_condenser7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
301	17624300.76	5050378.47	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	62.6	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-30.3
301	17624300.76	5050378.47	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	62.6	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-9.5
301	17624300.76	5050378.47	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	62.6	0.2	2.8	0.0	0.0	0.0	0.0	0.0	-4.2
301	17624300.76	5050378.47	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	62.6	0.4	5.2	0.0	0.0	0.0	0.0	0.0	-0.5
301	17624300.76	5050378.47	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	62.6	0.7	2.2	0.0	0.0	0.0	0.0	0.0	4.1
301	17624300.76	5050378.47	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	62.6	1.4	-0.7	0.0	0.0	0.0	0.0	0.0	3.6
301	17624300.76	5050378.47	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	62.6	3.7	-1.1	0.0	0.0	0.0	0.0	0.0	-1.0
301	17624300.76	5050378.47	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	62.6	12.4	-1.1	0.0	0.0	0.0	0.0	0.0	-17.9
301	17624300.76	5050378.47	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	62.6	44.3	-1.1	0.0	0.0	0.0	0.0	0.0	-58.1

Point Source, ISO 9613, Name: "HVAC Condenser 4", ID: "HVAC_condenser4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
308	17624289.10	5050373.50	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	62.6	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-30.3
308	17624289.10	5050373.50	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	62.6	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-9.6
308	17624289.10	5050373.50	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	62.6	0.2	2.8	0.0	0.0	0.0	0.0	0.0	-4.2
308	17624289.10	5050373.50	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	62.6	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-0.5
308	17624289.10	5050373.50	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	62.6	0.7	2.2	0.0	0.0	0.0	0.0	0.0	4.0
308	17624289.10	5050373.50	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	62.6	1.4	-0.7	0.0	0.0	0.0	0.0	0.0	3.6
308	17624289.10	5050373.50	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	62.6	3.7	-1.1	0.0	0.0	0.0	0.0	0.0	-1.1
308	17624289.10	5050373.50	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	62.6	12.5	-1.1	0.0	0.0	0.0	0.0	0.0	-18.1
308	17624289.10	5050373.50	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	62.6	44.6	-1.1	0.0	0.0	0.0	0.0	0.0	-58.5

Point Source, ISO 9613, Name: "HVAC Condenser 1", ID: "HVAC_condenser1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
310	17624283.37	5050367.59	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	62.7	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-30.4
310	17624283.37	5050367.59	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	62.7	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-9.7
310	17624283.37	5050367.59	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	62.7	0.2	2.9	0.0	0.0	0.0	0.0	0.0	-4.4
310	17624283.37	5050367.59	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	62.7	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-0.7
310	17624283.37	5050367.59	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	62.7	0.7	2.2	0.0	0.0	0.0	0.0	0.0	3.9
310	17624283.37	5050367.59	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	62.7	1.4	-0.7	0.0	0.0	0.0	0.0	0.0	3.4
310	17624283.37	5050367.59	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	62.7	3.7	-1.1	0.0	0.0	0.0	0.0	0.0	-1.2
310	17624283.37	5050367.59	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	62.7	12.7	-1.1	0.0	0.0	0.0	0.0	0.0	-18.4
310	17624283.37	5050367.59	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	62.7	45.2	-1.1	0.0	0.0	0.0	0.0	0.0	-59.2

Point Source, ISO 9613, Name: "HVAC Condenser 5", ID: "HVAC_condenser5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
312	17624290.96	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-30.4
312	17624290.96	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-9.7
312	17624290.96	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	62.8	0.2	2.9	0.0	0.0	0.0	0.0	0.0	-4.4
312	17624290.96	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	62.8	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-0.7
312	17624290.96	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	62.8	0.7	2.2	0.0	0.0	0.0	0.0	0.0	3.9
312	17624290.96	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	0.0	0.0	0.0	3.4
312	17624290.96	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	62.8	3.7	-1.1	0.0	0.0	0.0	0.0	0.0	-1.3
312	17624290.96	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	62.8	12.7	-1.1	0.0	0.0	0.0	0.0	0.0	-18.4
312	17624290.96	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	62.8	45.3	-1.1	0.0	0.0	0.0	0.0	0.0	-59.3

Point Source, ISO 9613, Name: "HVAC Condenser 8", ID: "HVAC_condenser8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
336	17624300.95	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-40.0
336	17624300.95	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-19.2
336	17624300.95	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	62.8	0.2	2.9	0.0	0.0	1.9	0.0	0.0	-6.4
336	17624300.95	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	62.8	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-0.7
336	17624300.95	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	62.8	0.8	2.2	0.0	0.0	2.6	0.0	0.0	1.2
336	17624300.95	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	-2.1
336	17624300.95	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	62.8	3.8	-1.1	0.0	0.0	5.9	0.0	0.0	-7.2
336	17624300.95	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	62.8	12.8	-1.1	0.0	0.0	5.9	0.0	0.0	-24.4
336	17624300.95	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	62.8	45.6	-1.1	0.0	0.0	5.9	0.0	0.0	-65.5

Point Source, ISO 9613, Name: "HVAC Condenser 2", ID: "HVAC_condenser2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
338	17624279.21	5050362.61	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-30.5
338	17624279.21	5050362.61	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-9.8
338	17624279.21	5050362.61	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	62.8	0.2	2.9	0.0	0.0	0.0	0.0	0.0	-4.5
338	17624279.21	5050362.61	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	62.8	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-0.7
338	17624279.21	5050362.61	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	62.8	0.8	2.2	0.0	0.0	0.0	0.0	0.0	3.8
338	17624279.21	5050362.61	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	0.0	0.0	0.0	3.3
338	17624279.21	5050362.61	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	62.8	3.8	-1.2	0.0	0.0	0.0	0.0	0.0	-1.3
338	17624279.21	5050362.61	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	62.8	12.8	-1.2	0.0	0.0	0.0	0.0	0.0	-18.6
338	17624279.21	5050362.61	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	62.8	45.7	-1.2	0.0	0.0	0.0	0.0	0.0	-59.8

Point Source, ISO 9613, Name: "HVAC Condenser 6", ID: "HVAC_condenser6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
340	17624286.79	5050362.77	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	62.9	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-30.5
340	17624286.79	5050362.77	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	62.9	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-9.8
340	17624286.79	5050362.77	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	62.9	0.2	2.9	0.0	0.0	0.0	0.0	0.0	-4.5
340	17624286.79	5050362.77	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	62.9	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-0.8
340	17624286.79	5050362.77	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	62.9	0.8	2.2	0.0	0.0	0.0	0.0	0.0	3.8
340	17624286.79	5050362.77	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	62.9	1.4	-0.7	0.0	0.0	0.0	0.0	0.0	3.3
340	17624286.79	5050362.77	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	62.9	3.8	-1.2	0.0	0.0	0.0	0.0	0.0	-1.4
340	17624286.79	5050362.77	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	62.9	12.8	-1.2	0.0	0.0	0.0	0.0	0.0	-18.6
340	17624286.79	5050362.77	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	62.9	45.8	-1.2	0.0	0.0	0.0	0.0	0.0	-59.9

Point Source, ISO 9613, Name: "HVAC Condenser 9", ID: "HVAC_condenser9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
349	17624296.83	5050362.76	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	62.9	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-40.1
349	17624296.83	5050362.76	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	62.9	0.0	-4.7	0.0	0.0	9.5	0.0	0.0	-19.3
349	17624296.83	5050362.76	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	62.9	0.2	2.9	0.0	0.0	1.9	0.0	0.0	-6.5
349	17624296.83	5050362.76	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	62.9	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-0.8
349	17624296.83	5050362.76	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	62.9	0.8	2.2	0.0	0.0	2.6	0.0	0.0	1.1
349	17624296.83	5050362.76	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	62.9	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	-2.2
349	17624296.83	5050362.76	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	62.9	3.8	-1.2	0.0	0.0	5.9	0.0	0.0	-7.4
349	17624296.83	5050362.76	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	62.9	12.9	-1.2	0.0	0.0	5.9	0.0	0.0	-24.7
349	17624296.83	5050362.76	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	62.9	46.0	-1.2	0.0	0.0	5.9	0.0	0.0	-66.1

Point Source, ISO 9613, Name: "UPS 3", ID: "UPS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
357	17624288.82	5050378.40	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	62.5	0.0	-5.2	0.0	0.0	9.9	0.0	0.0	-41.7
357	17624288.82	5050378.40	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	62.5	0.0	-5.2	0.0	0.0	9.9	0.0	0.0	-29.0
357	17624288.82	5050378.40	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	62.5	0.2	2.1	0.0	0.0	2.7	0.0	0.0	-9.0
357	17624288.82	5050378.40	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	62.5	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-9.4
357	17624288.82	5050378.40	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	62.5	0.7	3.8	0.0	0.0	0.9	0.0	0.0	-6.9
357	17624288.82	5050378.40	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	62.5	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	-3.5
357	17624288.82	5050378.40	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	62.5	3.6	-1.2	0.0	0.0	6.0	0.0	0.0	-4.4
357	17624288.82	5050378.40	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	62.5	12.3	-1.2	0.0	0.0	6.0	0.0	0.0	-17.6
357	17624288.82	5050378.40	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	62.5	44.0	-1.2	0.0	0.0	6.0	0.0	0.0	-60.7

Point Source, ISO 9613, Name: "UPS 7", ID: "UPS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
359	17624296.42	5050378.45	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	62.6	0.0	-5.2	0.0	0.0	9.9	0.0	0.0	-41.8
359	17624296.42	5050378.45	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	62.6	0.0	-5.2	0.0	0.0	9.9	0.0	0.0	-29.1
359	17624296.42	5050378.45	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	62.6	0.2	2.1	0.0	0.0	2.7	0.0	0.0	-9.0
359	17624296.42	5050378.45	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	62.6	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-9.4
359	17624296.42	5050378.45	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	62.6	0.7	3.8	0.0	0.0	0.9	0.0	0.0	-6.9
359	17624296.42	5050378.45	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	62.6	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	-3.5
359	17624296.42	5050378.45	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	62.6	3.7	-1.2	0.0	0.0	6.0	0.0	0.0	-4.4
359	17624296.42	5050378.45	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	62.6	12.4	-1.2	0.0	0.0	6.0	0.0	0.0	-17.7
359	17624296.42	5050378.45	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	62.6	44.2	-1.2	0.0	0.0	6.0	0.0	0.0	-60.9

Point Source, ISO 9613, Name: "UPS 4", ID: "UPS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
372	17624293.53	5050373.46	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	62.7	0.0	-5.2	0.0	0.0	9.9	0.0	0.0	-41.9
372	17624293.53	5050373.46	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	62.7	0.0	-5.2	0.0	0.0	9.9	0.0	0.0	-29.2
372	17624293.53	5050373.46	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	62.7	0.2	2.1	0.0	0.0	2.6	0.0	0.0	-9.1
372	17624293.53	5050373.46	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	62.7	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-9.5
372	17624293.53	5050373.46	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	62.7	0.7	3.8	0.0	0.0	0.9	0.0	0.0	-7.0
372	17624293.53	5050373.46	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	62.7	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	-3.7
372	17624293.53	5050373.46	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	62.7	3.7	-1.2	0.0	0.0	6.0	0.0	0.0	-4.6
372	17624293.53	5050373.46	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	62.7	12.5	-1.2	0.0	0.0	6.0	0.0	0.0	-17.9
372	17624293.53	5050373.46	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	62.7	44.7	-1.2	0.0	0.0	6.1	0.0	0.0	-61.5

Point Source, ISO 9613, Name: "UPS 1", ID: "UPS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
374	17624278.90	5050367.58	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	62.7	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-41.9
374	17624278.90	5050367.58	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	62.7	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.2
374	17624278.90	5050367.58	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	62.7	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-9.2
374	17624278.90	5050367.58	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	62.7	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-9.6
374	17624278.90	5050367.58	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	62.7	0.7	3.8	0.0	0.0	0.9	0.0	0.0	-7.1
374	17624278.90	5050367.58	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	62.7	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	-3.7
374	17624278.90	5050367.58	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	62.7	3.7	-1.2	0.0	0.0	6.0	0.0	0.0	-4.7
374	17624278.90	5050367.58	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	62.7	12.6	-1.2	0.0	0.0	6.0	0.0	0.0	-18.1
374	17624278.90	5050367.58	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	62.7	45.1	-1.2	0.0	0.0	6.0	0.0	0.0	-62.0

Point Source, ISO 9613, Name: "UPS 5", ID: "UPS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
376	17624286.54	5050367.66	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.0
376	17624286.54	5050367.66	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.3
376	17624286.54	5050367.66	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	62.8	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-9.2
376	17624286.54	5050367.66	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	62.8	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-9.6
376	17624286.54	5050367.66	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	62.8	0.7	3.8	0.0	0.0	0.9	0.0	0.0	-7.1
376	17624286.54	5050367.66	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	-3.8
376	17624286.54	5050367.66	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	62.8	3.7	-1.2	0.0	0.0	6.0	0.0	0.0	-4.7
376	17624286.54	5050367.66	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	62.8	12.7	-1.2	0.0	0.0	6.1	0.0	0.0	-18.2
376	17624286.54	5050367.66	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	62.8	45.2	-1.2	0.0	0.0	6.1	0.0	0.0	-62.2

Point Source, ISO 9613, Name: "UPS 8", ID: "UPS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
408	17624296.53	5050367.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.0
408	17624296.53	5050367.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.3
408	17624296.53	5050367.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	62.8	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-9.3
408	17624296.53	5050367.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	62.8	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-9.7
408	17624296.53	5050367.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	62.8	0.7	3.8	0.0	0.0	0.9	0.0	0.0	-7.2
408	17624296.53	5050367.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	-3.8
408	17624296.53	5050367.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	62.8	3.8	-1.2	0.0	0.0	6.1	0.0	0.0	-4.8
408	17624296.53	5050367.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	62.8	12.7	-1.2	0.0	0.0	6.1	0.0	0.0	-18.4
408	17624296.53	5050367.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	62.8	45.4	-1.2	0.0	0.0	6.3	0.0	0.0	-62.6

Point Source, ISO 9613, Name: "UPS 2", ID: "UPS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
411	17624283.74	5050362.73	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.1
411	17624283.74	5050362.73	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.4
411	17624283.74	5050362.73	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	62.9	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-9.3
411	17624283.74	5050362.73	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	62.9	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-9.7
411	17624283.74	5050362.73	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	62.9	0.8	3.8	0.0	0.0	0.9	0.0	0.0	-7.2
411	17624283.74	5050362.73	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	62.9	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	-3.9
411	17624283.74	5050362.73	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	62.9	3.8	-1.2	0.0	0.0	6.1	0.0	0.0	-4.9
411	17624283.74	5050362.73	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	62.9	12.8	-1.2	0.0	0.0	6.1	0.0	0.0	-18.4
411	17624283.74	5050362.73	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	62.9	45.7	-1.2	0.0	0.0	6.2	0.0	0.0	-62.9

Point Source, ISO 9613, Name: "UPS 6", ID: "UPS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
413	17624291.19	5050362.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.1
413	17624291.19	5050362.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.4
413	17624291.19	5050362.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	62.9	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-9.4
413	17624291.19	5050362.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	62.9	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-9.7
413	17624291.19	5050362.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	62.9	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-7.3
413	17624291.19	5050362.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	62.9	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	-4.0
413	17624291.19	5050362.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	62.9	3.8	-1.2	0.0	0.0	6.1	0.0	0.0	-5.0
413	17624291.19	5050362.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	62.9	12.9	-1.2	0.0	0.0	6.2	0.0	0.0	-18.6
413	17624291.19	5050362.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	62.9	45.9	-1.2	0.0	0.0	6.3	0.0	0.0	-63.2

Point Source, ISO 9613, Name: "UPS 9", ID: "UPS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
415	17624301.15	5050362.78	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.1
415	17624301.15	5050362.78	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.4
415	17624301.15	5050362.78	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	62.9	0.2	2.2	0.0	0.0	2.5	0.0	0.0	-9.4
415	17624301.15	5050362.78	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	62.9	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-9.8
415	17624301.15	5050362.78	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	62.9	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-7.3
415	17624301.15	5050362.78	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	62.9	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	-4.0
415	17624301.15	5050362.78	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	62.9	3.8	-1.2	0.0	0.0	6.2	0.0	0.0	-5.1
415	17624301.15	5050362.78	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	62.9	12.9	-1.2	0.0	0.0	6.3	0.0	0.0	-18.8
415	17624301.15	5050362.78	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	62.9	46.1	-1.2	0.0	0.0	6.6	0.0	0.0	-63.7

Receiver

Name: POR4

ID: POR4

X: 17624257.53 m

Y: 5050783.67 m

Z: 310.40 m

Point Source, ISO 9613, Name: "Transformer 4MW", ID: "transformer_4MW"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
35	17624270.19	5050367.48	342.00	0	DEN	32	41.6	0.0	0.0	0.0	0.0	63.4	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-26.6
35	17624270.19	5050367.48	342.00	0	DEN	63	62.8	0.0	0.0	0.0	0.0	63.4	0.1	-5.2	0.0	0.0	10.0	0.0	0.0	-5.4
35	17624270.19	5050367.48	342.00	0	DEN	125	76.9	0.0	0.0	0.0	0.0	63.4	0.2	2.4	0.0	0.0	2.4	0.0	0.0	8.5
35	17624270.19	5050367.48	342.00	0	DEN	250	68.4	0.0	0.0	0.0	0.0	63.4	0.4	8.1	0.0	0.0	0.0	0.0	0.0	-3.6
35	17624270.19	5050367.48	342.00	0	DEN	500	69.8	0.0	0.0	0.0	0.0	63.4	0.8	3.8	0.0	0.0	1.0	0.0	0.0	0.8
35	17624270.19	5050367.48	342.00	0	DEN	1000	71.0	0.0	0.0	0.0	0.0	63.4	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	1.3
35	17624270.19	5050367.48	342.00	0	DEN	2000	69.2	0.0	0.0	0.0	0.0	63.4	4.0	-1.3	0.0	0.0	6.0	0.0	0.0	-3.0
35	17624270.19	5050367.48	342.00	0	DEN	4000	71.0	0.0	0.0	0.0	0.0	63.4	13.7	-1.3	0.0	0.0	6.0	0.0	0.0	-10.9
35	17624270.19	5050367.48	342.00	0	DEN	8000	51.9	0.0	0.0	0.0	0.0	63.4	48.8	-1.3	0.0	0.0	6.0	0.0	0.0	-65.1

Point Source, ISO 9613, Name: "HVAC Economizer Hood 3", ID: "HVAC_hood3"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
44	17624294.15	5050377.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.2	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-26.2
44	17624294.15	5050377.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.2	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-5.4
44	17624294.15	5050377.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.2	0.2	3.0	0.0	0.0	0.0	0.0	0.0	-0.3
44	17624294.15	5050377.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.2	0.4	5.1	0.0	0.0	0.0	0.0	0.0	3.6
44	17624294.15	5050377.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.2	0.8	2.1	0.0	0.0	0.0	0.0	0.0	8.1
44	17624294.15	5050377.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.2	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	7.6
44	17624294.15	5050377.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.2	4.0	-1.2	0.0	0.0	0.0	0.0	0.0	2.8
44	17624294.15	5050377.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.2	13.4	-1.2	0.0	0.0	0.0	0.0	0.0	-14.9
44	17624294.15	5050377.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.2	47.9	-1.2	0.0	0.0	0.0	0.0	0.0	-57.6

Point Source, ISO 9613, Name: "HVAC Economizer Hood 7", ID: "HVAC_hood7"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
55	17624301.74	5050377.18	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.3	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-26.2
55	17624301.74	5050377.18	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.3	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-5.4
55	17624301.74	5050377.18	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.3	0.2	3.0	0.0	0.0	0.0	0.0	0.0	-0.3
55	17624301.74	5050377.18	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.3	0.4	5.1	0.0	0.0	0.0	0.0	0.0	3.6
55	17624301.74	5050377.18	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.3	0.8	2.1	0.0	0.0	0.0	0.0	0.0	8.1
55	17624301.74	5050377.18	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.3	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	7.6
55	17624301.74	5050377.18	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.3	4.0	-1.2	0.0	0.0	0.0	0.0	0.0	2.8
55	17624301.74	5050377.18	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.3	13.4	-1.2	0.0	0.0	0.0	0.0	0.0	-14.9
55	17624301.74	5050377.18	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.3	48.0	-1.2	0.0	0.0	0.0	0.0	0.0	-57.7

Point Source, ISO 9613, Name: "HVAC Economizer Hood 4", ID: "HVAC_hood4"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
57	17624288.27	5050374.68	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.3	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-26.2
57	17624288.27	5050374.68	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.3	0.1	-4.8	0.0	0.0	0.0	0.0	0.0	-5.5
57	17624288.27	5050374.68	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.3	0.2	3.0	0.0	0.0	0.0	0.0	0.0	-0.3
57	17624288.27	5050374.68	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.3	0.4	5.1	0.0	0.0	0.0	0.0	0.0	3.5
57	17624288.27	5050374.68	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.3	0.8	2.1	0.0	0.0	0.0	0.0	0.0	8.1
57	17624288.27	5050374.68	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.3	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	7.5
57	17624288.27	5050374.68	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.3	4.0	-1.2	0.0	0.0	0.0	0.0	0.0	2.7
57	17624288.27	5050374.68	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.3	13.5	-1.2	0.0	0.0	0.0	0.0	0.0	-15.0
57	17624288.27	5050374.68	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.3	48.1	-1.2	0.0	0.0	0.0	0.0	0.0	-57.9

Point Source, ISO 9613, Name: "HVAC Economizer Hood 1", ID: "HVAC_hood1"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
65	17624284.42	5050366.44	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.5	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-26.3

Point Source, ISO 9613, Name: "HVAC Economizer Hood 1", ID: "HVAC_hood1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
65	17624284.42	5050366.44	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.5	0.1	-4.8	0.0	0.0	0.0	0.0	0.0	-5.6
65	17624284.42	5050366.44	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.5	0.2	3.0	0.0	0.0	0.0	0.0	0.0	-0.6
65	17624284.42	5050366.44	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.5	0.4	5.1	0.0	0.0	0.0	0.0	0.0	3.4
65	17624284.42	5050366.44	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.5	0.8	2.1	0.0	0.0	0.0	0.0	0.0	7.9
65	17624284.42	5050366.44	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.5	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	7.4
65	17624284.42	5050366.44	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.5	4.1	-1.2	0.0	0.0	0.0	0.0	0.0	2.5
65	17624284.42	5050366.44	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.5	13.7	-1.2	0.0	0.0	0.0	0.0	0.0	-15.4
65	17624284.42	5050366.44	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.5	49.0	-1.2	0.0	0.0	0.0	0.0	0.0	-59.0

Point Source, ISO 9613, Name: "HVAC Economizer Hood 5", ID: "HVAC_hood5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
67	17624291.94	5050366.35	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.5	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-26.3
67	17624291.94	5050366.35	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.5	0.1	-4.8	0.0	0.0	0.0	0.0	0.0	-5.6
67	17624291.94	5050366.35	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.5	0.2	3.0	0.0	0.0	0.0	0.0	0.0	-0.6
67	17624291.94	5050366.35	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.5	0.4	5.1	0.0	0.0	0.0	0.0	0.0	3.4
67	17624291.94	5050366.35	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.5	0.8	2.1	0.0	0.0	0.0	0.0	0.0	7.9
67	17624291.94	5050366.35	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.5	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	7.3
67	17624291.94	5050366.35	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.5	4.1	-1.2	0.0	0.0	0.0	0.0	0.0	2.5
67	17624291.94	5050366.35	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.5	13.8	-1.2	0.0	0.0	0.0	0.0	0.0	-15.4
67	17624291.94	5050366.35	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.5	49.1	-1.2	0.0	0.0	0.0	0.0	0.0	-59.1

Point Source, ISO 9613, Name: "HVAC Economizer Hood 8", ID: "HVAC_hood8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
69	17624301.95	5050366.49	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.5	0.0	-4.8	0.0	0.0	9.6	0.0	0.0	-35.9
69	17624301.95	5050366.49	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.5	0.1	-4.8	0.0	0.0	9.6	0.0	0.0	-15.2
69	17624301.95	5050366.49	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.5	0.2	3.0	0.0	0.0	1.7	0.0	0.0	-2.3
69	17624301.95	5050366.49	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.5	0.4	5.1	0.0	0.0	0.0	0.0	0.0	3.3
69	17624301.95	5050366.49	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.5	0.8	2.1	0.0	0.0	2.7	0.0	0.0	5.2
69	17624301.95	5050366.49	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.5	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	1.8
69	17624301.95	5050366.49	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.5	4.1	-1.2	0.0	0.0	5.9	0.0	0.0	-3.5
69	17624301.95	5050366.49	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.5	13.8	-1.2	0.0	0.0	5.9	0.0	0.0	-21.4
69	17624301.95	5050366.49	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.5	49.2	-1.2	0.0	0.0	5.9	0.0	0.0	-65.1

Point Source, ISO 9613, Name: "HVAC Economizer Hood 2", ID: "HVAC_hood2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
71	17624278.29	5050363.89	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.5	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-26.4
71	17624278.29	5050363.89	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.5	0.1	-4.8	0.0	0.0	0.0	0.0	0.0	-5.6
71	17624278.29	5050363.89	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.5	0.2	3.0	0.0	0.0	0.0	0.0	0.0	-0.6
71	17624278.29	5050363.89	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.5	0.4	5.1	0.0	0.0	0.0	0.0	0.0	3.3
71	17624278.29	5050363.89	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.5	0.8	2.1	0.0	0.0	0.0	0.0	0.0	7.8
71	17624278.29	5050363.89	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.5	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	7.3
71	17624278.29	5050363.89	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.5	4.1	-1.2	0.0	0.0	0.0	0.0	0.0	2.4
71	17624278.29	5050363.89	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.5	13.8	-1.2	0.0	0.0	0.0	0.0	0.0	-15.5
71	17624278.29	5050363.89	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.5	49.3	-1.2	0.0	0.0	0.0	0.0	0.0	-59.3

Point Source, ISO 9613, Name: "HVAC Economizer Hood 6", ID: "HVAC_hood6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
73	17624285.84	5050363.98	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.5	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-26.4
73	17624285.84	5050363.98	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.5	0.1	-4.8	0.0	0.0	0.0	0.0	0.0	-5.6
73	17624285.84	5050363.98	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.5	0.2	3.0	0.0	0.0	0.0	0.0	0.0	-0.6
73	17624285.84	5050363.98	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.5	0.4	5.1	0.0	0.0	0.0	0.0	0.0	3.3
73	17624285.84	5050363.98	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.5	0.8	2.1	0.0	0.0	0.0	0.0	0.0	7.8
73	17624285.84	5050363.98	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.5	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	7.3
73	17624285.84	5050363.98	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.5	4.1	-1.2	0.0	0.0	0.0	0.0	0.0	2.4
73	17624285.84	5050363.98	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.5	13.8	-1.2	0.0	0.0	0.0	0.0	0.0	-15.5
73	17624285.84	5050363.98	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.5	49.3	-1.2	0.0	0.0	0.0	0.0	0.0	-59.3

Point Source, ISO 9613, Name: "HVAC Economizer Hood 9", ID: "HVAC_hood9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
75	17624295.94	5050364.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.5	0.0	-4.8	0.0	0.0	9.6	0.0	0.0	-36.0
75	17624295.94	5050364.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.5	0.1	-4.8	0.0	0.0	9.6	0.0	0.0	-15.2
75	17624295.94	5050364.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.5	0.2	3.0	0.0	0.0	1.7	0.0	0.0	-2.4
75	17624295.94	5050364.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.5	0.4	5.1	0.0	0.0	0.0	0.0	0.0	3.3
75	17624295.94	5050364.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.5	0.8	2.1	0.0	0.0	2.7	0.0	0.0	5.1
75	17624295.94	5050364.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.5	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	1.8
75	17624295.94	5050364.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.5	4.1	-1.2	0.0	0.0	5.9	0.0	0.0	-3.6
75	17624295.94	5050364.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.5	13.9	-1.2	0.0	0.0	5.9	0.0	0.0	-21.5
75	17624295.94	5050364.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.5	49.4	-1.2	0.0	0.0	5.9	0.0	0.0	-65.4

Point Source, ISO 9613, Name: "Transformer 2MW", ID: "transformer_2MW"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
77	17624280.40	5050378.87	342.00	0	DEN	32	38.6	0.0	0.0	0.0	0.0	63.2	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.4
77	17624280.40	5050378.87	342.00	0	DEN	63	59.8	0.0	0.0	0.0	0.0	63.2	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-8.2
77	17624280.40	5050378.87	342.00	0	DEN	125	73.9	0.0	0.0	0.0	0.0	63.2	0.2	2.3	0.0	0.0	2.5	0.0	0.0	5.8
77	17624280.40	5050378.87	342.00	0	DEN	250	65.4	0.0	0.0	0.0	0.0	63.2	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-6.4
77	17624280.40	5050378.87	342.00	0	DEN	500	66.8	0.0	0.0	0.0	0.0	63.2	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-1.9
77	17624280.40	5050378.87	342.00	0	DEN	1000	68.0	0.0	0.0	0.0	0.0	63.2	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	-1.5
77	17624280.40	5050378.87	342.00	0	DEN	2000	66.2	0.0	0.0	0.0	0.0	63.2	3.9	-1.3	0.0	0.0	6.0	0.0	0.0	-5.7
77	17624280.40	5050378.87	342.00	0	DEN	4000	68.0	0.0	0.0	0.0	0.0	63.2	13.3	-1.3	0.0	0.0	6.0	0.0	0.0	-13.3
77	17624280.40	5050378.87	342.00	0	DEN	8000	48.9	0.0	0.0	0.0	0.0	63.2	47.5	-1.3	0.0	0.0	6.0	0.0	0.0	-66.6

Point Source, ISO 9613, Name: "PCS 3", ID: "PCS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
79	17624290.73	5050378.40	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.2	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.7
79	17624290.73	5050378.40	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.2	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-25.0
79	17624290.73	5050378.40	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.2	0.2	2.3	0.0	0.0	2.4	0.0	0.0	-5.0
79	17624290.73	5050378.40	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.2	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.3
79	17624290.73	5050378.40	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.2	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-2.9
79	17624290.73	5050378.40	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.2	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.4
79	17624290.73	5050378.40	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.2	3.9	-1.3	0.0	0.0	6.0	0.0	0.0	-0.7
79	17624290.73	5050378.40	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.2	13.4	-1.3	0.0	0.0	6.0	0.0	0.0	-14.6
79	17624290.73	5050378.40	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.2	47.7	-1.3	0.0	0.0	6.0	0.0	0.0	-60.3

Point Source, ISO 9613, Name: "PCS 7", ID: "PCS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
140	17624298.22	5050378.41	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.2	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.7
140	17624298.22	5050378.41	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.2	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-25.0
140	17624298.22	5050378.41	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.2	0.2	2.3	0.0	0.0	2.4	0.0	0.0	-5.0
140	17624298.22	5050378.41	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.2	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.4
140	17624298.22	5050378.41	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.2	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-2.9
140	17624298.22	5050378.41	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.2	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.4
140	17624298.22	5050378.41	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.2	3.9	-1.3	0.0	0.0	6.0	0.0	0.0	-0.7
140	17624298.22	5050378.41	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.2	13.4	-1.3	0.0	0.0	6.0	0.0	0.0	-14.6
140	17624298.22	5050378.41	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.2	47.7	-1.3	0.0	0.0	6.0	0.0	0.0	-60.4

Point Source, ISO 9613, Name: "PCS 10", ID: "PCS10"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
142	17624280.69	5050376.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.2	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.7
142	17624280.69	5050376.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.2	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-25.1
142	17624280.69	5050376.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.2	0.2	2.3	0.0	0.0	2.4	0.0	0.0	-5.0
142	17624280.69	5050376.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.2	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.4
142	17624280.69	5050376.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.2	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-2.9
142	17624280.69	5050376.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.2	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.4
142	17624280.69	5050376.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.2	4.0	-1.3	0.0	0.0	6.0	0.0	0.0	-0.7
142	17624280.69	5050376.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.2	13.4	-1.3	0.0	0.0	6.0	0.0	0.0	-14.6
142	17624280.69	5050376.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.2	47.8	-1.3	0.0	0.0	6.0	0.0	0.0	-60.5

Point Source, ISO 9613, Name: "PCS 11", ID: "PCS11"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
144	17624280.74	5050375.25	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.3	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.8
144	17624280.74	5050375.25	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.3	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-25.1
144	17624280.74	5050375.25	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.3	0.2	2.3	0.0	0.0	2.4	0.0	0.0	-5.1
144	17624280.74	5050375.25	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.3	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.4
144	17624280.74	5050375.25	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.3	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-3.0
144	17624280.74	5050375.25	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.3	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.3
144	17624280.74	5050375.25	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.3	4.0	-1.3	0.0	0.0	6.0	0.0	0.0	-0.8
144	17624280.74	5050375.25	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.3	13.4	-1.3	0.0	0.0	6.0	0.0	0.0	-14.7
144	17624280.74	5050375.25	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.3	48.0	-1.3	0.0	0.0	6.0	0.0	0.0	-60.6

Point Source, ISO 9613, Name: "PCS 4", ID: "PCS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
146	17624291.60	5050373.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.3	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.8
146	17624291.60	5050373.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.3	0.1	-5.2	0.0	0.0	10.0	0.0	0.0	-25.1
146	17624291.60	5050373.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.3	0.2	2.4	0.0	0.0	2.4	0.0	0.0	-5.1
146	17624291.60	5050373.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.3	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.4
146	17624291.60	5050373.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.3	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-3.0
146	17624291.60	5050373.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.3	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.3
146	17624291.60	5050373.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.3	4.0	-1.3	0.0	0.0	6.0	0.0	0.0	-0.8
146	17624291.60	5050373.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.3	13.5	-1.3	0.0	0.0	6.0	0.0	0.0	-14.8
146	17624291.60	5050373.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.3	48.2	-1.3	0.0	0.0	6.0	0.0	0.0	-61.0

Point Source, ISO 9613, Name: "PCS 1", ID: "PCS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
148	17624280.88	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.4	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.9
148	17624280.88	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.4	0.1	-5.2	0.0	0.0	10.0	0.0	0.0	-25.2
148	17624280.88	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.4	0.2	2.4	0.0	0.0	2.4	0.0	0.0	-5.2
148	17624280.88	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.4	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.5
148	17624280.88	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.4	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-3.1
148	17624280.88	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.4	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.1
148	17624280.88	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.4	4.0	-1.3	0.0	0.0	6.0	0.0	0.0	-1.0
148	17624280.88	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.4	13.7	-1.3	0.0	0.0	6.0	0.0	0.0	-15.1
148	17624280.88	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.4	48.8	-1.3	0.0	0.0	6.0	0.0	0.0	-61.7

Point Source, ISO 9613, Name: "PCS 5", ID: "PCS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
154	17624288.51	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.4	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.9
154	17624288.51	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.4	0.1	-5.2	0.0	0.0	10.0	0.0	0.0	-25.3
154	17624288.51	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.4	0.2	2.4	0.0	0.0	2.4	0.0	0.0	-5.2
154	17624288.51	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.4	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.6
154	17624288.51	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.4	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-3.2
154	17624288.51	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.4	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.1
154	17624288.51	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.4	4.0	-1.3	0.0	0.0	6.0	0.0	0.0	-1.0
154	17624288.51	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.4	13.7	-1.3	0.0	0.0	6.0	0.0	0.0	-15.2
154	17624288.51	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.4	48.9	-1.3	0.0	0.0	6.1	0.0	0.0	-61.8

Point Source, ISO 9613, Name: "PCS 8", ID: "PCS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
173	17624298.45	5050367.65	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.4	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-38.0
173	17624298.45	5050367.65	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.4	0.1	-5.2	0.0	0.0	10.0	0.0	0.0	-25.3
173	17624298.45	5050367.65	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.4	0.2	2.4	0.0	0.0	2.3	0.0	0.0	-5.3
173	17624298.45	5050367.65	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.4	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.6
173	17624298.45	5050367.65	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.4	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-3.2
173	17624298.45	5050367.65	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.4	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.1
173	17624298.45	5050367.65	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.4	4.1	-1.3	0.0	0.0	6.1	0.0	0.0	-1.1
173	17624298.45	5050367.65	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.4	13.7	-1.3	0.0	0.0	6.1	0.0	0.0	-15.2
173	17624298.45	5050367.65	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.4	49.0	-1.3	0.0	0.0	6.1	0.0	0.0	-62.0

Point Source, ISO 9613, Name: "PCS 12", ID: "PCS12"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
175	17624270.58	5050364.97	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.5	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-38.0
175	17624270.58	5050364.97	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.5	0.1	-5.2	0.0	0.0	10.0	0.0	0.0	-25.3
175	17624270.58	5050364.97	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.5	0.2	2.4	0.0	0.0	2.3	0.0	0.0	-5.3
175	17624270.58	5050364.97	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.5	0.4	8.1	0.0	0.0	0.0	0.0	0.0	-5.6
175	17624270.58	5050364.97	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.5	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-3.2
175	17624270.58	5050364.97	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.5	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.1
175	17624270.58	5050364.97	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.5	4.1	-1.3	0.0	0.0	6.0	0.0	0.0	-1.1
175	17624270.58	5050364.97	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.5	13.8	-1.3	0.0	0.0	6.0	0.0	0.0	-15.2
175	17624270.58	5050364.97	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.5	49.1	-1.3	0.0	0.0	6.0	0.0	0.0	-62.0

Point Source, ISO 9613, Name: "PCS 13", ID: "PCS13"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
183	17624270.54	5050363.56	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.5	0.0	-5.3	0.0	0.0	10.0	0.0	0.0	-38.0
183	17624270.54	5050363.56	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.5	0.1	-5.3	0.0	0.0	10.0	0.0	0.0	-25.3
183	17624270.54	5050363.56	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.5	0.2	2.4	0.0	0.0	2.3	0.0	0.0	-5.3
183	17624270.54	5050363.56	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.5	0.4	8.1	0.0	0.0	0.0	0.0	0.0	-5.6
183	17624270.54	5050363.56	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.5	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-3.2
183	17624270.54	5050363.56	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.5	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.1
183	17624270.54	5050363.56	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.5	4.1	-1.3	0.0	0.0	6.0	0.0	0.0	-1.1
183	17624270.54	5050363.56	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.5	13.8	-1.3	0.0	0.0	6.0	0.0	0.0	-15.3
183	17624270.54	5050363.56	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.5	49.3	-1.3	0.0	0.0	6.0	0.0	0.0	-62.2

Point Source, ISO 9613, Name: "PCS 2", ID: "PCS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
190	17624281.69	5050362.69	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.5	0.0	-5.3	0.0	0.0	10.0	0.0	0.0	-38.0
190	17624281.69	5050362.69	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.5	0.1	-5.3	0.0	0.0	10.0	0.0	0.0	-25.3
190	17624281.69	5050362.69	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.5	0.2	2.5	0.0	0.0	2.3	0.0	0.0	-5.3
190	17624281.69	5050362.69	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.5	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.7
190	17624281.69	5050362.69	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.5	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-3.3
190	17624281.69	5050362.69	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.5	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.0
190	17624281.69	5050362.69	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.5	4.1	-1.3	0.0	0.0	6.0	0.0	0.0	-1.2
190	17624281.69	5050362.69	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.5	13.9	-1.3	0.0	0.0	6.1	0.0	0.0	-15.4
190	17624281.69	5050362.69	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.5	49.4	-1.3	0.0	0.0	6.1	0.0	0.0	-62.4

Point Source, ISO 9613, Name: "PCS 14", ID: "PCS14"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
191	17624270.56	5050362.20	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.5	0.0	-5.3	0.0	0.0	10.0	0.0	0.0	-38.0
191	17624270.56	5050362.20	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.5	0.1	-5.3	0.0	0.0	10.0	0.0	0.0	-25.3
191	17624270.56	5050362.20	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.5	0.2	2.4	0.0	0.0	2.3	0.0	0.0	-5.3
191	17624270.56	5050362.20	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.5	0.4	8.1	0.0	0.0	0.0	0.0	0.0	-5.6
191	17624270.56	5050362.20	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.5	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-3.3
191	17624270.56	5050362.20	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.5	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.0
191	17624270.56	5050362.20	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.5	4.1	-1.3	0.0	0.0	6.0	0.0	0.0	-1.1
191	17624270.56	5050362.20	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.5	13.9	-1.3	0.0	0.0	6.0	0.0	0.0	-15.4
191	17624270.56	5050362.20	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.5	49.4	-1.3	0.0	0.0	6.0	0.0	0.0	-62.4

Point Source, ISO 9613, Name: "PCS 6", ID: "PCS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
192	17624289.16	5050362.78	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.5	0.0	-5.3	0.0	0.0	10.0	0.0	0.0	-38.0
192	17624289.16	5050362.78	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.5	0.1	-5.3	0.0	0.0	10.0	0.0	0.0	-25.4
192	17624289.16	5050362.78	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.5	0.2	2.5	0.0	0.0	2.3	0.0	0.0	-5.3
192	17624289.16	5050362.78	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.5	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.7
192	17624289.16	5050362.78	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.5	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-3.3
192	17624289.16	5050362.78	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.5	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.0
192	17624289.16	5050362.78	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.5	4.1	-1.3	0.0	0.0	6.1	0.0	0.0	-1.2
192	17624289.16	5050362.78	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.5	13.9	-1.3	0.0	0.0	6.1	0.0	0.0	-15.4
192	17624289.16	5050362.78	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.5	49.5	-1.3	0.0	0.0	6.1	0.0	0.0	-62.5

Point Source, ISO 9613, Name: "PCS 9", ID: "PCS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
194	17624299.21	5050362.68	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.6	0.0	-5.3	0.0	0.0	10.0	0.0	0.0	-38.1
194	17624299.21	5050362.68	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.6	0.1	-5.3	0.0	0.0	10.0	0.0	0.0	-25.4
194	17624299.21	5050362.68	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.6	0.2	2.5	0.0	0.0	2.3	0.0	0.0	-5.4
194	17624299.21	5050362.68	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.6	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.7
194	17624299.21	5050362.68	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.6	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-3.3
194	17624299.21	5050362.68	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.6	1.6	-0.7	0.0	0.0	5.5	0.0	0.0	-0.0
194	17624299.21	5050362.68	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.6	4.1	-1.3	0.0	0.0	6.1	0.0	0.0	-1.2
194	17624299.21	5050362.68	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.6	13.9	-1.3	0.0	0.0	6.1	0.0	0.0	-15.6
194	17624299.21	5050362.68	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.6	49.6	-1.3	0.0	0.0	6.3	0.0	0.0	-62.8

Point Source, ISO 9613, Name: "HVAC Condenser 3", ID: "HVAC_condenser3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
201	17624293.15	5050378.41	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.2	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-30.8
201	17624293.15	5050378.41	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.2	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-10.1
201	17624293.15	5050378.41	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.2	0.2	3.0	0.0	0.0	0.0	0.0	0.0	-5.0
201	17624293.15	5050378.41	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.2	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-1.1
201	17624293.15	5050378.41	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.2	0.8	2.1	0.0	0.0	0.0	0.0	0.0	3.4
201	17624293.15	5050378.41	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.2	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	2.9
201	17624293.15	5050378.41	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.2	3.9	-1.2	0.0	0.0	0.0	0.0	0.0	-1.9
201	17624293.15	5050378.41	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.2	13.4	-1.2	0.0	0.0	0.0	0.0	0.0	-19.5
201	17624293.15	5050378.41	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.2	47.7	-1.2	0.0	0.0	0.0	0.0	0.0	-62.1

Point Source, ISO 9613, Name: "HVAC Condenser 7", ID: "HVAC_condenser7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
210	17624300.76	5050378.47	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.2	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-30.8
210	17624300.76	5050378.47	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.2	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-10.1
210	17624300.76	5050378.47	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.2	0.2	3.0	0.0	0.0	0.0	0.0	0.0	-5.0
210	17624300.76	5050378.47	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.2	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-1.1
210	17624300.76	5050378.47	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.2	0.8	2.1	0.0	0.0	0.0	0.0	0.0	3.4
210	17624300.76	5050378.47	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.2	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	2.9
210	17624300.76	5050378.47	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.2	4.0	-1.2	0.0	0.0	0.0	0.0	0.0	-1.9
210	17624300.76	5050378.47	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.2	13.4	-1.2	0.0	0.0	0.0	0.0	0.0	-19.5
210	17624300.76	5050378.47	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.2	47.8	-1.2	0.0	0.0	0.0	0.0	0.0	-62.2

Point Source, ISO 9613, Name: "HVAC Condenser 4", ID: "HVAC_condenser4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
218	17624289.10	5050373.50	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.3	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-30.9
218	17624289.10	5050373.50	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.3	0.1	-4.8	0.0	0.0	0.0	0.0	0.0	-10.2
218	17624289.10	5050373.50	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.3	0.2	3.0	0.0	0.0	0.0	0.0	0.0	-5.1
218	17624289.10	5050373.50	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.3	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-1.2
218	17624289.10	5050373.50	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.3	0.8	2.1	0.0	0.0	0.0	0.0	0.0	3.3
218	17624289.10	5050373.50	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.3	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	2.8
218	17624289.10	5050373.50	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.3	4.0	-1.2	0.0	0.0	0.0	0.0	0.0	-2.0
218	17624289.10	5050373.50	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.3	13.5	-1.2	0.0	0.0	0.0	0.0	0.0	-19.8
218	17624289.10	5050373.50	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.3	48.2	-1.2	0.0	0.0	0.0	0.0	0.0	-62.8

Point Source, ISO 9613, Name: "HVAC Condenser 1", ID: "HVAC_condenser1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
220	17624283.37	5050367.59	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.4	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-31.0
220	17624283.37	5050367.59	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.4	0.1	-4.8	0.0	0.0	0.0	0.0	0.0	-10.3
220	17624283.37	5050367.59	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.4	0.2	3.0	0.0	0.0	0.0	0.0	0.0	-5.2
220	17624283.37	5050367.59	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.4	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-1.3
220	17624283.37	5050367.59	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.4	0.8	2.1	0.0	0.0	0.0	0.0	0.0	3.2
220	17624283.37	5050367.59	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.4	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	2.7
220	17624283.37	5050367.59	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.4	4.0	-1.2	0.0	0.0	0.0	0.0	0.0	-2.2
220	17624283.37	5050367.59	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.4	13.7	-1.2	0.0	0.0	0.0	0.0	0.0	-20.0
220	17624283.37	5050367.59	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.4	48.9	-1.2	0.0	0.0	0.0	0.0	0.0	-63.5

Point Source, ISO 9613, Name: "HVAC Condenser 5", ID: "HVAC_condenser5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
222	17624290.96	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.4	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-31.0
222	17624290.96	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.4	0.1	-4.8	0.0	0.0	0.0	0.0	0.0	-10.3
222	17624290.96	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.4	0.2	3.0	0.0	0.0	0.0	0.0	0.0	-5.2
222	17624290.96	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.4	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-1.3
222	17624290.96	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.4	0.8	2.1	0.0	0.0	0.0	0.0	0.0	3.2
222	17624290.96	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.4	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	2.7
222	17624290.96	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.4	4.0	-1.2	0.0	0.0	0.0	0.0	0.0	-2.2
222	17624290.96	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.4	13.7	-1.2	0.0	0.0	0.0	0.0	0.0	-20.1
222	17624290.96	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.4	48.9	-1.2	0.0	0.0	0.0	0.0	0.0	-63.6

Point Source, ISO 9613, Name: "HVAC Condenser 8", ID: "HVAC_condenser8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
232	17624300.95	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.5	0.0	-4.8	0.0	0.0	9.6	0.0	0.0	-40.6
232	17624300.95	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.5	0.1	-4.8	0.0	0.0	9.6	0.0	0.0	-19.9
232	17624300.95	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.5	0.2	3.0	0.0	0.0	1.8	0.0	0.0	-7.0
232	17624300.95	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.5	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-1.3
232	17624300.95	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.5	0.8	2.1	0.0	0.0	2.7	0.0	0.0	0.5
232	17624300.95	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.5	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	-2.9
232	17624300.95	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.5	4.1	-1.2	0.0	0.0	5.9	0.0	0.0	-8.2
232	17624300.95	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.5	13.8	-1.2	0.0	0.0	5.9	0.0	0.0	-26.1
232	17624300.95	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.5	49.0	-1.2	0.0	0.0	5.9	0.0	0.0	-69.7

Point Source, ISO 9613, Name: "HVAC Condenser 2", ID: "HVAC_condenser2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
234	17624279.21	5050362.61	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.5	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-31.1
234	17624279.21	5050362.61	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.5	0.1	-4.8	0.0	0.0	0.0	0.0	0.0	-10.4
234	17624279.21	5050362.61	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.5	0.2	3.0	0.0	0.0	0.0	0.0	0.0	-5.3
234	17624279.21	5050362.61	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.5	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-1.4
234	17624279.21	5050362.61	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.5	0.8	2.1	0.0	0.0	0.0	0.0	0.0	3.1
234	17624279.21	5050362.61	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.5	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	2.6
234	17624279.21	5050362.61	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.5	4.1	-1.2	0.0	0.0	0.0	0.0	0.0	-2.3
234	17624279.21	5050362.61	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.5	13.9	-1.2	0.0	0.0	0.0	0.0	0.0	-20.3
234	17624279.21	5050362.61	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.5	49.4	-1.2	0.0	0.0	0.0	0.0	0.0	-64.2

Point Source, ISO 9613, Name: "HVAC Condenser 6", ID: "HVAC_condenser6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
236	17624286.79	5050362.77	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.5	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-31.1
236	17624286.79	5050362.77	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.5	0.1	-4.8	0.0	0.0	0.0	0.0	0.0	-10.4
236	17624286.79	5050362.77	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.5	0.2	3.0	0.0	0.0	0.0	0.0	0.0	-5.4
236	17624286.79	5050362.77	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.5	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-1.4
236	17624286.79	5050362.77	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.5	0.8	2.1	0.0	0.0	0.0	0.0	0.0	3.1
236	17624286.79	5050362.77	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.5	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	2.6
236	17624286.79	5050362.77	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.5	4.1	-1.2	0.0	0.0	0.0	0.0	0.0	-2.3
236	17624286.79	5050362.77	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.5	13.9	-1.2	0.0	0.0	0.0	0.0	0.0	-20.3
236	17624286.79	5050362.77	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.5	49.5	-1.2	0.0	0.0	0.0	0.0	0.0	-64.2

Point Source, ISO 9613, Name: "HVAC Condenser 9", ID: "HVAC_condenser9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
264	17624296.83	5050362.76	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.5	0.0	-4.8	0.0	0.0	9.6	0.0	0.0	-40.7
264	17624296.83	5050362.76	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.5	0.1	-4.8	0.0	0.0	9.6	0.0	0.0	-20.0
264	17624296.83	5050362.76	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.5	0.2	3.0	0.0	0.0	1.7	0.0	0.0	-7.1
264	17624296.83	5050362.76	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.5	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-1.4
264	17624296.83	5050362.76	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.5	0.8	2.1	0.0	0.0	2.7	0.0	0.0	0.4
264	17624296.83	5050362.76	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.5	1.6	-0.7	0.0	0.0	5.5	0.0	0.0	-3.0
264	17624296.83	5050362.76	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.5	4.1	-1.2	0.0	0.0	5.9	0.0	0.0	-8.3
264	17624296.83	5050362.76	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.5	13.9	-1.2	0.0	0.0	5.9	0.0	0.0	-26.3
264	17624296.83	5050362.76	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.5	49.6	-1.2	0.0	0.0	5.9	0.0	0.0	-70.3

Point Source, ISO 9613, Name: "UPS 3", ID: "UPS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
266	17624288.82	5050378.40	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.2	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.4
266	17624288.82	5050378.40	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.2	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.7
266	17624288.82	5050378.40	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.2	0.2	2.3	0.0	0.0	2.4	0.0	0.0	-9.7
266	17624288.82	5050378.40	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.2	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-10.0
266	17624288.82	5050378.40	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.2	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-7.6
266	17624288.82	5050378.40	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.2	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	-4.3
266	17624288.82	5050378.40	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.2	3.9	-1.3	0.0	0.0	6.0	0.0	0.0	-5.4
266	17624288.82	5050378.40	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.2	13.4	-1.3	0.0	0.0	6.0	0.0	0.0	-19.3
266	17624288.82	5050378.40	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.2	47.7	-1.3	0.0	0.0	6.0	0.0	0.0	-65.0

Point Source, ISO 9613, Name: "UPS 7", ID: "UPS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
268	17624296.42	5050378.45	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.2	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.4
268	17624296.42	5050378.45	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.2	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.7
268	17624296.42	5050378.45	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.2	0.2	2.3	0.0	0.0	2.4	0.0	0.0	-9.7
268	17624296.42	5050378.45	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.2	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-10.1
268	17624296.42	5050378.45	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.2	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-7.6
268	17624296.42	5050378.45	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.2	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	-4.3
268	17624296.42	5050378.45	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.2	3.9	-1.3	0.0	0.0	6.0	0.0	0.0	-5.4
268	17624296.42	5050378.45	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.2	13.4	-1.3	0.0	0.0	6.0	0.0	0.0	-19.3
268	17624296.42	5050378.45	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.2	47.7	-1.3	0.0	0.0	6.0	0.0	0.0	-65.1

Point Source, ISO 9613, Name: "UPS 4", ID: "UPS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
283	17624293.53	5050373.46	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.3	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.5
283	17624293.53	5050373.46	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.3	0.1	-5.2	0.0	0.0	10.0	0.0	0.0	-29.8
283	17624293.53	5050373.46	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.3	0.2	2.4	0.0	0.0	2.4	0.0	0.0	-9.8
283	17624293.53	5050373.46	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.3	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-10.2
283	17624293.53	5050373.46	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.3	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-7.7
283	17624293.53	5050373.46	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.3	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	-4.4
283	17624293.53	5050373.46	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.3	4.0	-1.3	0.0	0.0	6.0	0.0	0.0	-5.5
283	17624293.53	5050373.46	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.3	13.5	-1.3	0.0	0.0	6.0	0.0	0.0	-19.6
283	17624293.53	5050373.46	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.3	48.3	-1.3	0.0	0.0	6.0	0.0	0.0	-65.7

Point Source, ISO 9613, Name: "UPS 1", ID: "UPS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
285	17624278.90	5050367.58	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.4	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.6
285	17624278.90	5050367.58	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.4	0.1	-5.2	0.0	0.0	10.0	0.0	0.0	-29.9
285	17624278.90	5050367.58	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.4	0.2	2.4	0.0	0.0	2.4	0.0	0.0	-9.9
285	17624278.90	5050367.58	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.4	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-10.2
285	17624278.90	5050367.58	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.4	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-7.8
285	17624278.90	5050367.58	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.4	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	-4.5
285	17624278.90	5050367.58	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.4	4.0	-1.3	0.0	0.0	6.0	0.0	0.0	-5.7
285	17624278.90	5050367.58	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.4	13.7	-1.3	0.0	0.0	6.0	0.0	0.0	-19.8
285	17624278.90	5050367.58	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.4	48.8	-1.3	0.0	0.0	6.0	0.0	0.0	-66.4

Point Source, ISO 9613, Name: "UPS 5", ID: "UPS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
287	17624286.54	5050367.66	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.4	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.6
287	17624286.54	5050367.66	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.4	0.1	-5.2	0.0	0.0	10.0	0.0	0.0	-29.9
287	17624286.54	5050367.66	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.4	0.2	2.4	0.0	0.0	2.4	0.0	0.0	-9.9
287	17624286.54	5050367.66	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.4	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-10.3
287	17624286.54	5050367.66	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.4	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-7.9
287	17624286.54	5050367.66	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.4	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	-4.6
287	17624286.54	5050367.66	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.4	4.0	-1.3	0.0	0.0	6.0	0.0	0.0	-5.7
287	17624286.54	5050367.66	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.4	13.7	-1.3	0.0	0.0	6.0	0.0	0.0	-19.8
287	17624286.54	5050367.66	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.4	48.9	-1.3	0.0	0.0	6.1	0.0	0.0	-66.4

Point Source, ISO 9613, Name: "UPS 8", ID: "UPS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
289	17624296.53	5050367.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.4	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.7
289	17624296.53	5050367.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.4	0.1	-5.2	0.0	0.0	10.0	0.0	0.0	-30.0
289	17624296.53	5050367.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.4	0.2	2.4	0.0	0.0	2.3	0.0	0.0	-9.9
289	17624296.53	5050367.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.4	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-10.3
289	17624296.53	5050367.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.4	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-7.9
289	17624296.53	5050367.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.4	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	-4.6
289	17624296.53	5050367.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.4	4.0	-1.3	0.0	0.0	6.1	0.0	0.0	-5.7
289	17624296.53	5050367.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.4	13.7	-1.3	0.0	0.0	6.1	0.0	0.0	-19.9
289	17624296.53	5050367.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.4	49.0	-1.3	0.0	0.0	6.1	0.0	0.0	-66.6

Point Source, ISO 9613, Name: "UPS 2", ID: "UPS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
290	17624283.74	5050362.73	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.5	0.0	-5.3	0.0	0.0	10.0	0.0	0.0	-42.7
290	17624283.74	5050362.73	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.5	0.1	-5.3	0.0	0.0	10.0	0.0	0.0	-30.0
290	17624283.74	5050362.73	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.5	0.2	2.5	0.0	0.0	2.3	0.0	0.0	-10.0
290	17624283.74	5050362.73	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.5	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-10.4
290	17624283.74	5050362.73	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.5	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-8.0
290	17624283.74	5050362.73	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.5	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	-4.7
290	17624283.74	5050362.73	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.5	4.1	-1.3	0.0	0.0	6.0	0.0	0.0	-5.9
290	17624283.74	5050362.73	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.5	13.9	-1.3	0.0	0.0	6.1	0.0	0.0	-20.1
290	17624283.74	5050362.73	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.5	49.4	-1.3	0.0	0.0	6.1	0.0	0.0	-67.1

Point Source, ISO 9613, Name: "UPS 6", ID: "UPS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
299	17624291.19	5050362.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.5	0.0	-5.3	0.0	0.0	10.0	0.0	0.0	-42.8
299	17624291.19	5050362.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.5	0.1	-5.3	0.0	0.0	10.0	0.0	0.0	-30.1
299	17624291.19	5050362.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.5	0.2	2.5	0.0	0.0	2.3	0.0	0.0	-10.0
299	17624291.19	5050362.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.5	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-10.4
299	17624291.19	5050362.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.5	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-8.0
299	17624291.19	5050362.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.5	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	-4.7
299	17624291.19	5050362.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.5	4.1	-1.3	0.0	0.0	6.1	0.0	0.0	-5.9
299	17624291.19	5050362.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.5	13.9	-1.3	0.0	0.0	6.1	0.0	0.0	-20.2
299	17624291.19	5050362.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.5	49.5	-1.3	0.0	0.0	6.1	0.0	0.0	-67.3

Point Source, ISO 9613, Name: "UPS 9", ID: "UPS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
305	17624301.15	5050362.78	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.6	0.0	-5.3	0.0	0.0	10.0	0.0	0.0	-42.8
305	17624301.15	5050362.78	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.6	0.1	-5.3	0.0	0.0	10.0	0.0	0.0	-30.1
305	17624301.15	5050362.78	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.6	0.2	2.5	0.0	0.0	2.3	0.0	0.0	-10.1
305	17624301.15	5050362.78	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.6	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-10.4
305	17624301.15	5050362.78	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.6	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-8.0
305	17624301.15	5050362.78	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.6	1.6	-0.7	0.0	0.0	5.5	0.0	0.0	-4.7
305	17624301.15	5050362.78	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.6	4.1	-1.3	0.0	0.0	6.1	0.0	0.0	-6.0
305	17624301.15	5050362.78	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.6	13.9	-1.3	0.0	0.0	6.2	0.0	0.0	-20.3
305	17624301.15	5050362.78	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.6	49.6	-1.3	0.0	0.0	6.3	0.0	0.0	-67.5

Receiver

Name: OLA4
ID: OLA4
X: 17624263.33 m
Y: 5050764.20 m
Z: 311.48 m

Point Source, ISO 9613, Name: "Transformer 4MW", ID: "transformer_4MW"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
37	17624270.19	5050367.48	342.00	0	DEN	32	41.6	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-26.2
37	17624270.19	5050367.48	342.00	0	DEN	63	62.8	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-5.0
37	17624270.19	5050367.48	342.00	0	DEN	125	76.9	0.0	0.0	0.0	0.0	63.0	0.2	2.2	0.0	0.0	2.5	0.0	0.0	9.0
37	17624270.19	5050367.48	342.00	0	DEN	250	68.4	0.0	0.0	0.0	0.0	63.0	0.4	8.1	0.0	0.0	0.0	0.0	0.0	-3.2
37	17624270.19	5050367.48	342.00	0	DEN	500	69.8	0.0	0.0	0.0	0.0	63.0	0.8	3.8	0.0	0.0	1.0	0.0	0.0	1.3
37	17624270.19	5050367.48	342.00	0	DEN	1000	71.0	0.0	0.0	0.0	0.0	63.0	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	1.8
37	17624270.19	5050367.48	342.00	0	DEN	2000	69.2	0.0	0.0	0.0	0.0	63.0	3.8	-1.3	0.0	0.0	6.0	0.0	0.0	-2.4
37	17624270.19	5050367.48	342.00	0	DEN	4000	71.0	0.0	0.0	0.0	0.0	63.0	13.0	-1.3	0.0	0.0	6.0	0.0	0.0	-9.8
37	17624270.19	5050367.48	342.00	0	DEN	8000	51.9	0.0	0.0	0.0	0.0	63.0	46.5	-1.3	0.0	0.0	6.0	0.0	0.0	-62.4

Point Source, ISO 9613, Name: "HVAC Economizer Hood 3", ID: "HVAC_hood3"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
43	17624294.15	5050377.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-25.8
43	17624294.15	5050377.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-5.0
43	17624294.15	5050377.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	62.8	0.2	2.9	0.0	0.0	0.0	0.0	0.0	0.3
43	17624294.15	5050377.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	62.8	0.4	5.1	0.0	0.0	0.0	0.0	0.0	4.0
43	17624294.15	5050377.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	62.8	0.8	2.1	0.0	0.0	0.0	0.0	0.0	8.6
43	17624294.15	5050377.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	0.0	0.0	0.0	8.1
43	17624294.15	5050377.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	62.8	3.8	-1.2	0.0	0.0	0.0	0.0	0.0	3.4
43	17624294.15	5050377.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	62.8	12.8	-1.2	0.0	0.0	0.0	0.0	0.0	-13.8
43	17624294.15	5050377.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	62.8	45.6	-1.2	0.0	0.0	0.0	0.0	0.0	-54.9

Point Source, ISO 9613, Name: "HVAC Economizer Hood 7", ID: "HVAC_hood7"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
54	17624301.74	5050377.18	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-25.8
54	17624301.74	5050377.18	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-5.1
54	17624301.74	5050377.18	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	62.8	0.2	2.9	0.0	0.0	0.0	0.0	0.0	0.2
54	17624301.74	5050377.18	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	62.8	0.4	5.1	0.0	0.0	0.0	0.0	0.0	4.0
54	17624301.74	5050377.18	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	62.8	0.8	2.1	0.0	0.0	0.0	0.0	0.0	8.5
54	17624301.74	5050377.18	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	0.0	0.0	0.0	8.1
54	17624301.74	5050377.18	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	62.8	3.8	-1.2	0.0	0.0	0.0	0.0	0.0	3.4
54	17624301.74	5050377.18	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	62.8	12.8	-1.2	0.0	0.0	0.0	0.0	0.0	-13.8
54	17624301.74	5050377.18	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	62.8	45.6	-1.2	0.0	0.0	0.0	0.0	0.0	-55.0

Point Source, ISO 9613, Name: "HVAC Economizer Hood 4", ID: "HVAC_hood4"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
56	17624288.27	5050374.68	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	62.9	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-25.8
56	17624288.27	5050374.68	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	62.9	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-5.1
56	17624288.27	5050374.68	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	62.9	0.2	2.9	0.0	0.0	0.0	0.0	0.0	0.2
56	17624288.27	5050374.68	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	62.9	0.4	5.1	0.0	0.0	0.0	0.0	0.0	4.0
56	17624288.27	5050374.68	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	62.9	0.8	2.1	0.0	0.0	0.0	0.0	0.0	8.5
56	17624288.27	5050374.68	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	62.9	1.4	-0.7	0.0	0.0	0.0	0.0	0.0	8.0
56	17624288.27	5050374.68	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	62.9	3.8	-1.2	0.0	0.0	0.0	0.0	0.0	3.3
56	17624288.27	5050374.68	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	62.9	12.8	-1.2	0.0	0.0	0.0	0.0	0.0	-13.9
56	17624288.27	5050374.68	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	62.9	45.8	-1.2	0.0	0.0	0.0	0.0	0.0	-55.2

Point Source, ISO 9613, Name: "HVAC Economizer Hood 1", ID: "HVAC_hood1"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
64	17624284.42	5050366.44	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.0	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-26.0

Point Source, ISO 9613, Name: "HVAC Economizer Hood 1", ID: "HVAC_hood1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
64	17624284.42	5050366.44	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.0	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-5.2
64	17624284.42	5050366.44	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.0	0.2	2.9	0.0	0.0	0.0	0.0	0.0	-0.0
64	17624284.42	5050366.44	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.0	0.4	5.1	0.0	0.0	0.0	0.0	0.0	3.8
64	17624284.42	5050366.44	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.0	0.8	2.1	0.0	0.0	0.0	0.0	0.0	8.3
64	17624284.42	5050366.44	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.0	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	7.8
64	17624284.42	5050366.44	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.0	3.9	-1.2	0.0	0.0	0.0	0.0	0.0	3.1
64	17624284.42	5050366.44	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.0	13.1	-1.2	0.0	0.0	0.0	0.0	0.0	-14.3
64	17624284.42	5050366.44	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.0	46.7	-1.2	0.0	0.0	0.0	0.0	0.0	-56.3

Point Source, ISO 9613, Name: "HVAC Economizer Hood 5", ID: "HVAC_hood5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
66	17624291.94	5050366.35	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.0	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-26.0
66	17624291.94	5050366.35	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.0	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-5.2
66	17624291.94	5050366.35	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.0	0.2	2.9	0.0	0.0	0.0	0.0	0.0	-0.0
66	17624291.94	5050366.35	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.0	0.4	5.1	0.0	0.0	0.0	0.0	0.0	3.8
66	17624291.94	5050366.35	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.0	0.8	2.1	0.0	0.0	0.0	0.0	0.0	8.3
66	17624291.94	5050366.35	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.0	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	7.8
66	17624291.94	5050366.35	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.0	3.9	-1.2	0.0	0.0	0.0	0.0	0.0	3.1
66	17624291.94	5050366.35	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.0	13.1	-1.2	0.0	0.0	0.0	0.0	0.0	-14.4
66	17624291.94	5050366.35	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.0	46.8	-1.2	0.0	0.0	0.0	0.0	0.0	-56.3

Point Source, ISO 9613, Name: "HVAC Economizer Hood 8", ID: "HVAC_hood8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
68	17624301.95	5050366.49	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-35.5
68	17624301.95	5050366.49	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-14.8
68	17624301.95	5050366.49	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.1	0.2	2.9	0.0	0.0	1.9	0.0	0.0	-1.9
68	17624301.95	5050366.49	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.1	0.4	5.1	0.0	0.0	0.0	0.0	0.0	3.8
68	17624301.95	5050366.49	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.1	0.8	2.1	0.0	0.0	2.7	0.0	0.0	5.6
68	17624301.95	5050366.49	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.1	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	2.3
68	17624301.95	5050366.49	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.1	3.9	-1.2	0.0	0.0	5.9	0.0	0.0	-2.9
68	17624301.95	5050366.49	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.1	13.1	-1.2	0.0	0.0	5.9	0.0	0.0	-20.4
68	17624301.95	5050366.49	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.1	46.9	-1.2	0.0	0.0	5.9	0.0	0.0	-62.4

Point Source, ISO 9613, Name: "HVAC Economizer Hood 2", ID: "HVAC_hood2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
70	17624278.29	5050363.89	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-26.0
70	17624278.29	5050363.89	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-5.3
70	17624278.29	5050363.89	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.1	0.2	2.9	0.0	0.0	0.0	0.0	0.0	-0.1
70	17624278.29	5050363.89	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.1	0.4	5.1	0.0	0.0	0.0	0.0	0.0	3.8
70	17624278.29	5050363.89	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.1	0.8	2.1	0.0	0.0	0.0	0.0	0.0	8.3
70	17624278.29	5050363.89	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.1	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	7.8
70	17624278.29	5050363.89	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.1	3.9	-1.2	0.0	0.0	0.0	0.0	0.0	3.0
70	17624278.29	5050363.89	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.1	13.2	-1.2	0.0	0.0	0.0	0.0	0.0	-14.5
70	17624278.29	5050363.89	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.1	47.0	-1.2	0.0	0.0	0.0	0.0	0.0	-56.6

Point Source, ISO 9613, Name: "HVAC Economizer Hood 6", ID: "HVAC_hood6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
72	17624285.84	5050363.98	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-26.0
72	17624285.84	5050363.98	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-5.3
72	17624285.84	5050363.98	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.1	0.2	2.9	0.0	0.0	0.0	0.0	0.0	-0.1
72	17624285.84	5050363.98	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.1	0.4	5.1	0.0	0.0	0.0	0.0	0.0	3.8
72	17624285.84	5050363.98	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.1	0.8	2.1	0.0	0.0	0.0	0.0	0.0	8.3
72	17624285.84	5050363.98	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.1	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	7.8
72	17624285.84	5050363.98	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.1	3.9	-1.2	0.0	0.0	0.0	0.0	0.0	3.0
72	17624285.84	5050363.98	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.1	13.2	-1.2	0.0	0.0	0.0	0.0	0.0	-14.5
72	17624285.84	5050363.98	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.1	47.0	-1.2	0.0	0.0	0.0	0.0	0.0	-56.6

Point Source, ISO 9613, Name: "HVAC Economizer Hood 9", ID: "HVAC_hood9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
74	17624295.94	5050364.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-35.6
74	17624295.94	5050364.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-14.8
74	17624295.94	5050364.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	63.1	0.2	2.9	0.0	0.0	1.9	0.0	0.0	-2.0
74	17624295.94	5050364.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	63.1	0.4	5.1	0.0	0.0	0.0	0.0	0.0	3.7
74	17624295.94	5050364.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	63.1	0.8	2.1	0.0	0.0	2.7	0.0	0.0	5.6
74	17624295.94	5050364.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	63.1	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	2.3
74	17624295.94	5050364.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	63.1	3.9	-1.2	0.0	0.0	5.9	0.0	0.0	-2.9
74	17624295.94	5050364.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	63.1	13.2	-1.2	0.0	0.0	5.9	0.0	0.0	-20.5
74	17624295.94	5050364.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	63.1	47.1	-1.2	0.0	0.0	5.9	0.0	0.0	-62.6

Point Source, ISO 9613, Name: "Transformer 2MW", ID: "transformer_2MW"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
76	17624280.40	5050378.87	342.00	0	DEN	32	38.6	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-28.9
76	17624280.40	5050378.87	342.00	0	DEN	63	59.8	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-7.8
76	17624280.40	5050378.87	342.00	0	DEN	125	73.9	0.0	0.0	0.0	0.0	62.8	0.2	2.1	0.0	0.0	2.6	0.0	0.0	6.2
76	17624280.40	5050378.87	342.00	0	DEN	250	65.4	0.0	0.0	0.0	0.0	62.8	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.9
76	17624280.40	5050378.87	342.00	0	DEN	500	66.8	0.0	0.0	0.0	0.0	62.8	0.7	3.8	0.0	0.0	1.0	0.0	0.0	-1.5
76	17624280.40	5050378.87	342.00	0	DEN	1000	68.0	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	-0.9
76	17624280.40	5050378.87	342.00	0	DEN	2000	66.2	0.0	0.0	0.0	0.0	62.8	3.7	-1.3	0.0	0.0	6.0	0.0	0.0	-5.1
76	17624280.40	5050378.87	342.00	0	DEN	4000	68.0	0.0	0.0	0.0	0.0	62.8	12.7	-1.3	0.0	0.0	6.0	0.0	0.0	-12.2
76	17624280.40	5050378.87	342.00	0	DEN	8000	48.9	0.0	0.0	0.0	0.0	62.8	45.2	-1.3	0.0	0.0	6.0	0.0	0.0	-63.9

Point Source, ISO 9613, Name: "PCS 3", ID: "PCS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
78	17624290.73	5050378.40	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.3
78	17624290.73	5050378.40	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.6
78	17624290.73	5050378.40	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.8	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-4.6
78	17624290.73	5050378.40	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.8	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-4.9
78	17624290.73	5050378.40	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.8	0.7	3.8	0.0	0.0	1.0	0.0	0.0	-2.4
78	17624290.73	5050378.40	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	0.9
78	17624290.73	5050378.40	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.8	3.7	-1.3	0.0	0.0	6.0	0.0	0.0	-0.1
78	17624290.73	5050378.40	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.8	12.7	-1.3	0.0	0.0	6.0	0.0	0.0	-13.5
78	17624290.73	5050378.40	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.8	45.3	-1.3	0.0	0.0	6.0	0.0	0.0	-57.5

Point Source, ISO 9613, Name: "PCS 7", ID: "PCS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
83	17624298.22	5050378.41	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.3
83	17624298.22	5050378.41	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.6
83	17624298.22	5050378.41	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.8	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-4.6
83	17624298.22	5050378.41	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.8	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-4.9
83	17624298.22	5050378.41	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.8	0.7	3.8	0.0	0.0	1.0	0.0	0.0	-2.5
83	17624298.22	5050378.41	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	0.9
83	17624298.22	5050378.41	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.8	3.8	-1.2	0.0	0.0	6.0	0.0	0.0	-0.1
83	17624298.22	5050378.41	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.8	12.7	-1.2	0.0	0.0	6.0	0.0	0.0	-13.5
83	17624298.22	5050378.41	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.8	45.4	-1.2	0.0	0.0	6.0	0.0	0.0	-57.6

Point Source, ISO 9613, Name: "PCS 10", ID: "PCS10"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
85	17624280.69	5050376.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.3
85	17624280.69	5050376.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.6
85	17624280.69	5050376.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.8	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-4.6
85	17624280.69	5050376.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.8	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-4.9
85	17624280.69	5050376.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.8	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-2.5
85	17624280.69	5050376.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	0.9
85	17624280.69	5050376.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.8	3.8	-1.3	0.0	0.0	6.0	0.0	0.0	-0.1
85	17624280.69	5050376.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.8	12.8	-1.3	0.0	0.0	6.0	0.0	0.0	-13.6
85	17624280.69	5050376.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.8	45.5	-1.3	0.0	0.0	6.0	0.0	0.0	-57.7

Point Source, ISO 9613, Name: "PCS 11", ID: "PCS11"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
86	17624280.74	5050375.25	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.3
86	17624280.74	5050375.25	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.6
86	17624280.74	5050375.25	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.8	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-4.6
86	17624280.74	5050375.25	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.8	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-4.9
86	17624280.74	5050375.25	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.8	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-2.5
86	17624280.74	5050375.25	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	0.8
86	17624280.74	5050375.25	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.8	3.8	-1.3	0.0	0.0	6.0	0.0	0.0	-0.1
86	17624280.74	5050375.25	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.8	12.8	-1.3	0.0	0.0	6.0	0.0	0.0	-13.6
86	17624280.74	5050375.25	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.8	45.6	-1.3	0.0	0.0	6.0	0.0	0.0	-57.9

Point Source, ISO 9613, Name: "PCS 4", ID: "PCS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
88	17624291.60	5050373.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.4
88	17624291.60	5050373.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.7
88	17624291.60	5050373.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	62.9	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-4.7
88	17624291.60	5050373.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	62.9	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.0
88	17624291.60	5050373.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	62.9	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-2.6
88	17624291.60	5050373.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	62.9	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	0.8
88	17624291.60	5050373.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	62.9	3.8	-1.3	0.0	0.0	6.0	0.0	0.0	-0.2
88	17624291.60	5050373.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	62.9	12.9	-1.3	0.0	0.0	6.0	0.0	0.0	-13.8
88	17624291.60	5050373.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	62.9	45.9	-1.3	0.0	0.0	6.0	0.0	0.0	-58.2

Point Source, ISO 9613, Name: "PCS 1", ID: "PCS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
97	17624280.88	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.5
97	17624280.88	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.8
97	17624280.88	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.0	0.2	2.2	0.0	0.0	2.5	0.0	0.0	-4.8
97	17624280.88	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.0	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.1
97	17624280.88	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.0	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-2.7
97	17624280.88	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.0	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.6
97	17624280.88	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.0	3.8	-1.3	0.0	0.0	6.0	0.0	0.0	-0.4
97	17624280.88	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.0	13.0	-1.3	0.0	0.0	6.0	0.0	0.0	-14.0
97	17624280.88	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.0	46.5	-1.3	0.0	0.0	6.0	0.0	0.0	-59.0

Point Source, ISO 9613, Name: "PCS 5", ID: "PCS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
99	17624288.51	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.5
99	17624288.51	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.8
99	17624288.51	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.0	0.2	2.2	0.0	0.0	2.5	0.0	0.0	-4.8
99	17624288.51	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.0	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.1
99	17624288.51	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.0	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-2.7
99	17624288.51	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.0	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.6
99	17624288.51	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.0	3.9	-1.3	0.0	0.0	6.0	0.0	0.0	-0.4
99	17624288.51	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.0	13.1	-1.3	0.0	0.0	6.1	0.0	0.0	-14.1
99	17624288.51	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.0	46.6	-1.3	0.0	0.0	6.1	0.0	0.0	-59.1

Point Source, ISO 9613, Name: "PCS 8", ID: "PCS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
101	17624298.45	5050367.65	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.5
101	17624298.45	5050367.65	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.8
101	17624298.45	5050367.65	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.0	0.2	2.3	0.0	0.0	2.5	0.0	0.0	-4.8
101	17624298.45	5050367.65	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.0	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.1
101	17624298.45	5050367.65	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.0	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-2.7
101	17624298.45	5050367.65	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.0	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.6
101	17624298.45	5050367.65	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.0	3.9	-1.3	0.0	0.0	6.1	0.0	0.0	-0.5
101	17624298.45	5050367.65	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.0	13.1	-1.3	0.0	0.0	6.1	0.0	0.0	-14.2
101	17624298.45	5050367.65	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.0	46.7	-1.3	0.0	0.0	6.2	0.0	0.0	-59.3

Point Source, ISO 9613, Name: "PCS 12", ID: "PCS12"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
103	17624270.58	5050364.97	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.6
103	17624270.58	5050364.97	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.9
103	17624270.58	5050364.97	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.1	0.2	2.3	0.0	0.0	2.5	0.0	0.0	-4.8
103	17624270.58	5050364.97	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.1	0.4	8.1	0.0	0.0	0.0	0.0	0.0	-5.1
103	17624270.58	5050364.97	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.1	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-2.7
103	17624270.58	5050364.97	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.6
103	17624270.58	5050364.97	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.1	3.9	-1.3	0.0	0.0	6.0	0.0	0.0	-0.5
103	17624270.58	5050364.97	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.1	13.1	-1.3	0.0	0.0	6.0	0.0	0.0	-14.2
103	17624270.58	5050364.97	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.1	46.8	-1.3	0.0	0.0	6.0	0.0	0.0	-59.3

Point Source, ISO 9613, Name: "PCS 13", ID: "PCS13"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
105	17624270.54	5050363.56	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.6
105	17624270.54	5050363.56	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.9
105	17624270.54	5050363.56	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.1	0.2	2.3	0.0	0.0	2.5	0.0	0.0	-4.9
105	17624270.54	5050363.56	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.1	0.4	8.1	0.0	0.0	0.0	0.0	0.0	-5.2
105	17624270.54	5050363.56	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.1	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-2.8
105	17624270.54	5050363.56	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.5
105	17624270.54	5050363.56	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.1	3.9	-1.3	0.0	0.0	6.0	0.0	0.0	-0.5
105	17624270.54	5050363.56	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.1	13.2	-1.3	0.0	0.0	6.0	0.0	0.0	-14.2
105	17624270.54	5050363.56	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.1	47.0	-1.3	0.0	0.0	6.0	0.0	0.0	-59.5

Point Source, ISO 9613, Name: "PCS 2", ID: "PCS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
107	17624281.69	5050362.69	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.6
107	17624281.69	5050362.69	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.9
107	17624281.69	5050362.69	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.1	0.2	2.3	0.0	0.0	2.5	0.0	0.0	-4.9
107	17624281.69	5050362.69	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.1	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.2
107	17624281.69	5050362.69	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.1	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-2.8
107	17624281.69	5050362.69	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.5
107	17624281.69	5050362.69	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.1	3.9	-1.3	0.0	0.0	6.0	0.0	0.0	-0.6
107	17624281.69	5050362.69	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.1	13.2	-1.3	0.0	0.0	6.1	0.0	0.0	-14.3
107	17624281.69	5050362.69	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.1	47.1	-1.3	0.0	0.0	6.1	0.0	0.0	-59.7

Point Source, ISO 9613, Name: "PCS 14", ID: "PCS14"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
116	17624270.56	5050362.20	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.6
116	17624270.56	5050362.20	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.9
116	17624270.56	5050362.20	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.1	0.2	2.3	0.0	0.0	2.5	0.0	0.0	-4.9
116	17624270.56	5050362.20	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.1	0.4	8.1	0.0	0.0	0.0	0.0	0.0	-5.2
116	17624270.56	5050362.20	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.1	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-2.8
116	17624270.56	5050362.20	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.5
116	17624270.56	5050362.20	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.1	3.9	-1.3	0.0	0.0	6.0	0.0	0.0	-0.5
116	17624270.56	5050362.20	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.1	13.2	-1.3	0.0	0.0	6.0	0.0	0.0	-14.3
116	17624270.56	5050362.20	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.1	47.1	-1.3	0.0	0.0	6.0	0.0	0.0	-59.7

Point Source, ISO 9613, Name: "PCS 6", ID: "PCS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
118	17624289.16	5050362.78	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.6
118	17624289.16	5050362.78	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-24.9
118	17624289.16	5050362.78	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.1	0.2	2.3	0.0	0.0	2.5	0.0	0.0	-4.9
118	17624289.16	5050362.78	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.1	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.2
118	17624289.16	5050362.78	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.1	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-2.8
118	17624289.16	5050362.78	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.5
118	17624289.16	5050362.78	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.1	3.9	-1.3	0.0	0.0	6.1	0.0	0.0	-0.6
118	17624289.16	5050362.78	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.1	13.2	-1.3	0.0	0.0	6.1	0.0	0.0	-14.4
118	17624289.16	5050362.78	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.1	47.2	-1.3	0.0	0.0	6.2	0.0	0.0	-59.8

Point Source, ISO 9613, Name: "PCS 9", ID: "PCS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
120	17624299.21	5050362.68	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-37.6
120	17624299.21	5050362.68	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-25.0
120	17624299.21	5050362.68	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	63.1	0.2	2.3	0.0	0.0	2.5	0.0	0.0	-4.9
120	17624299.21	5050362.68	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	63.1	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-5.3
120	17624299.21	5050362.68	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	63.1	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-2.9
120	17624299.21	5050362.68	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	0.4
120	17624299.21	5050362.68	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	63.1	3.9	-1.3	0.0	0.0	6.1	0.0	0.0	-0.7
120	17624299.21	5050362.68	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	63.1	13.2	-1.3	0.0	0.0	6.2	0.0	0.0	-14.6
120	17624299.21	5050362.68	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	63.1	47.3	-1.3	0.0	0.0	6.4	0.0	0.0	-60.1

Point Source, ISO 9613, Name: "HVAC Condenser 3", ID: "HVAC_condenser3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
126	17624293.15	5050378.41	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-30.5
126	17624293.15	5050378.41	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-9.7
126	17624293.15	5050378.41	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	62.8	0.2	2.8	0.0	0.0	0.0	0.0	0.0	-4.4
126	17624293.15	5050378.41	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	62.8	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-0.6
126	17624293.15	5050378.41	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	62.8	0.7	2.1	0.0	0.0	0.0	0.0	0.0	3.9
126	17624293.15	5050378.41	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	0.0	0.0	0.0	3.4
126	17624293.15	5050378.41	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	62.8	3.8	-1.2	0.0	0.0	0.0	0.0	0.0	-1.3
126	17624293.15	5050378.41	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	62.8	12.7	-1.2	0.0	0.0	0.0	0.0	0.0	-18.4
126	17624293.15	5050378.41	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	62.8	45.4	-1.2	0.0	0.0	0.0	0.0	0.0	-59.4

Point Source, ISO 9613, Name: "HVAC Condenser 7", ID: "HVAC_condenser7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
128	17624300.76	5050378.47	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-30.5
128	17624300.76	5050378.47	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	62.8	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-9.7
128	17624300.76	5050378.47	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	62.8	0.2	2.8	0.0	0.0	0.0	0.0	0.0	-4.4
128	17624300.76	5050378.47	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	62.8	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-0.7
128	17624300.76	5050378.47	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	62.8	0.7	2.1	0.0	0.0	0.0	0.0	0.0	3.9
128	17624300.76	5050378.47	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	0.0	0.0	0.0	3.4
128	17624300.76	5050378.47	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	62.8	3.8	-1.2	0.0	0.0	0.0	0.0	0.0	-1.3
128	17624300.76	5050378.47	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	62.8	12.7	-1.2	0.0	0.0	0.0	0.0	0.0	-18.5
128	17624300.76	5050378.47	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	62.8	45.5	-1.2	0.0	0.0	0.0	0.0	0.0	-59.5

Point Source, ISO 9613, Name: "HVAC Condenser 4", ID: "HVAC_condenser4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
134	17624289.10	5050373.50	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	62.9	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-30.5
134	17624289.10	5050373.50	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	62.9	0.0	-4.7	0.0	0.0	0.0	0.0	0.0	-9.8
134	17624289.10	5050373.50	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	62.9	0.2	2.9	0.0	0.0	0.0	0.0	0.0	-4.5
134	17624289.10	5050373.50	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	62.9	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-0.7
134	17624289.10	5050373.50	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	62.9	0.8	2.1	0.0	0.0	0.0	0.0	0.0	3.8
134	17624289.10	5050373.50	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	62.9	1.4	-0.7	0.0	0.0	0.0	0.0	0.0	3.3
134	17624289.10	5050373.50	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	62.9	3.8	-1.2	0.0	0.0	0.0	0.0	0.0	-1.4
134	17624289.10	5050373.50	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	62.9	12.9	-1.2	0.0	0.0	0.0	0.0	0.0	-18.7
134	17624289.10	5050373.50	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	62.9	45.9	-1.2	0.0	0.0	0.0	0.0	0.0	-60.0

Point Source, ISO 9613, Name: "HVAC Condenser 1", ID: "HVAC_condenser1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
136	17624283.37	5050367.59	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.0	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-30.6
136	17624283.37	5050367.59	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.0	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-9.9
136	17624283.37	5050367.59	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.0	0.2	2.9	0.0	0.0	0.0	0.0	0.0	-4.7
136	17624283.37	5050367.59	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.0	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-0.9
136	17624283.37	5050367.59	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.0	0.8	2.1	0.0	0.0	0.0	0.0	0.0	3.7
136	17624283.37	5050367.59	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.0	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	3.2
136	17624283.37	5050367.59	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.0	3.9	-1.2	0.0	0.0	0.0	0.0	0.0	-1.6
136	17624283.37	5050367.59	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.0	13.1	-1.2	0.0	0.0	0.0	0.0	0.0	-19.0
136	17624283.37	5050367.59	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.0	46.6	-1.2	0.0	0.0	0.0	0.0	0.0	-60.8

Point Source, ISO 9613, Name: "HVAC Condenser 5", ID: "HVAC_condenser5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
160	17624290.96	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.0	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-30.7
160	17624290.96	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.0	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-9.9
160	17624290.96	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.0	0.2	2.9	0.0	0.0	0.0	0.0	0.0	-4.7
160	17624290.96	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.0	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-0.9
160	17624290.96	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.0	0.8	2.1	0.0	0.0	0.0	0.0	0.0	3.7
160	17624290.96	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.0	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	3.2
160	17624290.96	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.0	3.9	-1.2	0.0	0.0	0.0	0.0	0.0	-1.6
160	17624290.96	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.0	13.1	-1.2	0.0	0.0	0.0	0.0	0.0	-19.0
160	17624290.96	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.0	46.6	-1.2	0.0	0.0	0.0	0.0	0.0	-60.8

Point Source, ISO 9613, Name: "HVAC Condenser 8", ID: "HVAC_condenser8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
162	17624300.95	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.0	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-40.2
162	17624300.95	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.0	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-19.5
162	17624300.95	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.0	0.2	2.9	0.0	0.0	1.9	0.0	0.0	-6.6
162	17624300.95	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.0	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-0.9
162	17624300.95	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.0	0.8	2.1	0.0	0.0	2.7	0.0	0.0	1.0
162	17624300.95	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.0	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	-2.4
162	17624300.95	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.0	3.9	-1.2	0.0	0.0	5.9	0.0	0.0	-7.5
162	17624300.95	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.0	13.1	-1.2	0.0	0.0	5.9	0.0	0.0	-25.0
162	17624300.95	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.0	46.7	-1.2	0.0	0.0	5.9	0.0	0.0	-66.9

Point Source, ISO 9613, Name: "HVAC Condenser 2", ID: "HVAC_condenser2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
164	17624279.21	5050362.61	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-30.7
164	17624279.21	5050362.61	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-10.0
164	17624279.21	5050362.61	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.1	0.2	2.9	0.0	0.0	0.0	0.0	0.0	-4.8
164	17624279.21	5050362.61	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.1	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-1.0
164	17624279.21	5050362.61	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.1	0.8	2.1	0.0	0.0	0.0	0.0	0.0	3.6
164	17624279.21	5050362.61	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	3.1
164	17624279.21	5050362.61	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.1	3.9	-1.2	0.0	0.0	0.0	0.0	0.0	-1.7
164	17624279.21	5050362.61	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.1	13.2	-1.2	0.0	0.0	0.0	0.0	0.0	-19.2
164	17624279.21	5050362.61	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.1	47.1	-1.2	0.0	0.0	0.0	0.0	0.0	-61.4

Point Source, ISO 9613, Name: "HVAC Condenser 6", ID: "HVAC_condenser6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
166	17624286.79	5050362.77	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-30.7
166	17624286.79	5050362.77	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	0.0	0.0	0.0	-10.0
166	17624286.79	5050362.77	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.1	0.2	2.9	0.0	0.0	0.0	0.0	0.0	-4.8
166	17624286.79	5050362.77	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.1	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-1.0
166	17624286.79	5050362.77	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.1	0.8	2.1	0.0	0.0	0.0	0.0	0.0	3.5
166	17624286.79	5050362.77	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.7	0.0	0.0	0.0	0.0	0.0	3.0
166	17624286.79	5050362.77	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.1	3.9	-1.2	0.0	0.0	0.0	0.0	0.0	-1.7
166	17624286.79	5050362.77	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.1	13.2	-1.2	0.0	0.0	0.0	0.0	0.0	-19.3
166	17624286.79	5050362.77	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.1	47.2	-1.2	0.0	0.0	0.0	0.0	0.0	-61.5

Point Source, ISO 9613, Name: "HVAC Condenser 9", ID: "HVAC_condenser9"																				
Nr.	X	Y	Z	Ref.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
200	17624296.83	5050362.76	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-40.3
200	17624296.83	5050362.76	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	63.1	0.0	-4.8	0.0	0.0	9.5	0.0	0.0	-19.6
200	17624296.83	5050362.76	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	63.1	0.2	2.9	0.0	0.0	1.8	0.0	0.0	-6.7
200	17624296.83	5050362.76	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	63.1	0.4	5.1	0.0	0.0	0.0	0.0	0.0	-1.0
200	17624296.83	5050362.76	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	63.1	0.8	2.1	0.0	0.0	2.7	0.0	0.0	0.9
200	17624296.83	5050362.76	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	63.1	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	-2.5
200	17624296.83	5050362.76	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	63.1	3.9	-1.2	0.0	0.0	5.9	0.0	0.0	-7.7
200	17624296.83	5050362.76	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	63.1	13.2	-1.2	0.0	0.0	5.9	0.0	0.0	-25.2
200	17624296.83	5050362.76	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	63.1	47.2	-1.2	0.0	0.0	5.9	0.0	0.0	-67.5

Point Source, ISO 9613, Name: "UPS 3", ID: "UPS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
231	17624288.82	5050378.40	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.0
231	17624288.82	5050378.40	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.3
231	17624288.82	5050378.40	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	62.8	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-9.3
231	17624288.82	5050378.40	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	62.8	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-9.6
231	17624288.82	5050378.40	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	62.8	0.7	3.8	0.0	0.0	1.0	0.0	0.0	-7.1
231	17624288.82	5050378.40	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	-3.8
231	17624288.82	5050378.40	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	62.8	3.7	-1.3	0.0	0.0	6.0	0.0	0.0	-4.8
231	17624288.82	5050378.40	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	62.8	12.7	-1.3	0.0	0.0	6.0	0.0	0.0	-18.2
231	17624288.82	5050378.40	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	62.8	45.3	-1.3	0.0	0.0	6.0	0.0	0.0	-62.2

Point Source, ISO 9613, Name: "UPS 7", ID: "UPS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
233	17624296.42	5050378.45	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.0
233	17624296.42	5050378.45	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	62.8	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.3
233	17624296.42	5050378.45	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	62.8	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-9.3
233	17624296.42	5050378.45	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	62.8	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-9.6
233	17624296.42	5050378.45	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	62.8	0.7	3.8	0.0	0.0	1.0	0.0	0.0	-7.2
233	17624296.42	5050378.45	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	62.8	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	-3.8
233	17624296.42	5050378.45	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	62.8	3.8	-1.2	0.0	0.0	6.0	0.0	0.0	-4.8
233	17624296.42	5050378.45	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	62.8	12.7	-1.2	0.0	0.0	6.0	0.0	0.0	-18.2
233	17624296.42	5050378.45	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	62.8	45.4	-1.2	0.0	0.0	6.0	0.0	0.0	-62.3

Point Source, ISO 9613, Name: "UPS 4", ID: "UPS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
235	17624293.53	5050373.46	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.1
235	17624293.53	5050373.46	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	62.9	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.4
235	17624293.53	5050373.46	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	62.9	0.2	2.2	0.0	0.0	2.6	0.0	0.0	-9.4
235	17624293.53	5050373.46	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	62.9	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-9.7
235	17624293.53	5050373.46	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	62.9	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-7.3
235	17624293.53	5050373.46	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	62.9	1.4	-0.7	0.0	0.0	5.5	0.0	0.0	-3.9
235	17624293.53	5050373.46	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	62.9	3.8	-1.3	0.0	0.0	6.0	0.0	0.0	-4.9
235	17624293.53	5050373.46	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	62.9	12.9	-1.3	0.0	0.0	6.0	0.0	0.0	-18.5
235	17624293.53	5050373.46	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	62.9	45.9	-1.3	0.0	0.0	6.1	0.0	0.0	-63.0

Point Source, ISO 9613, Name: "UPS 1", ID: "UPS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
237	17624278.90	5050367.58	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.2
237	17624278.90	5050367.58	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.5
237	17624278.90	5050367.58	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.0	0.2	2.2	0.0	0.0	2.5	0.0	0.0	-9.5
237	17624278.90	5050367.58	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.0	0.4	8.1	0.0	0.0	0.0	0.0	0.0	-9.8
237	17624278.90	5050367.58	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.0	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-7.4
237	17624278.90	5050367.58	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.0	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	-4.1
237	17624278.90	5050367.58	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.0	3.8	-1.3	0.0	0.0	6.0	0.0	0.0	-5.1
237	17624278.90	5050367.58	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.0	13.0	-1.3	0.0	0.0	6.0	0.0	0.0	-18.7
237	17624278.90	5050367.58	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.0	46.5	-1.3	0.0	0.0	6.0	0.0	0.0	-63.7

Point Source, ISO 9613, Name: "UPS 5", ID: "UPS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
239	17624286.54	5050367.66	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.2
239	17624286.54	5050367.66	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.5
239	17624286.54	5050367.66	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.0	0.2	2.2	0.0	0.0	2.5	0.0	0.0	-9.5
239	17624286.54	5050367.66	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.0	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-9.8
239	17624286.54	5050367.66	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.0	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-7.4
239	17624286.54	5050367.66	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.0	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	-4.1
239	17624286.54	5050367.66	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.0	3.8	-1.3	0.0	0.0	6.0	0.0	0.0	-5.1
239	17624286.54	5050367.66	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.0	13.1	-1.3	0.0	0.0	6.1	0.0	0.0	-18.8
239	17624286.54	5050367.66	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.0	46.6	-1.3	0.0	0.0	6.1	0.0	0.0	-63.7

Point Source, ISO 9613, Name: "UPS 8", ID: "UPS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
241	17624296.53	5050367.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.2
241	17624296.53	5050367.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.0	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.5
241	17624296.53	5050367.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.0	0.2	2.3	0.0	0.0	2.5	0.0	0.0	-9.5
241	17624296.53	5050367.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.0	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-9.8
241	17624296.53	5050367.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.0	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-7.4
241	17624296.53	5050367.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.0	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	-4.1
241	17624296.53	5050367.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.0	3.9	-1.3	0.0	0.0	6.1	0.0	0.0	-5.2
241	17624296.53	5050367.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.0	13.1	-1.3	0.0	0.0	6.1	0.0	0.0	-18.9
241	17624296.53	5050367.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.0	46.6	-1.3	0.0	0.0	6.2	0.0	0.0	-63.9

Point Source, ISO 9613, Name: "UPS 2", ID: "UPS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
243	17624283.74	5050362.73	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.3
243	17624283.74	5050362.73	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.6
243	17624283.74	5050362.73	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.1	0.2	2.3	0.0	0.0	2.5	0.0	0.0	-9.6
243	17624283.74	5050362.73	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.1	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-9.9
243	17624283.74	5050362.73	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.1	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-7.5
243	17624283.74	5050362.73	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.1	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	-4.2
243	17624283.74	5050362.73	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.1	3.9	-1.3	0.0	0.0	6.1	0.0	0.0	-5.3
243	17624283.74	5050362.73	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.1	13.2	-1.3	0.0	0.0	6.1	0.0	0.0	-19.1
243	17624283.74	5050362.73	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.1	47.1	-1.3	0.0	0.0	6.1	0.0	0.0	-64.4

Point Source, ISO 9613, Name: "UPS 6", ID: "UPS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
245	17624291.19	5050362.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.3
245	17624291.19	5050362.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.6
245	17624291.19	5050362.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.1	0.2	2.3	0.0	0.0	2.5	0.0	0.0	-9.6
245	17624291.19	5050362.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.1	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-9.9
245	17624291.19	5050362.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.1	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-7.5
245	17624291.19	5050362.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.1	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	-4.2
245	17624291.19	5050362.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.1	3.9	-1.3	0.0	0.0	6.1	0.0	0.0	-5.3
245	17624291.19	5050362.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.1	13.2	-1.3	0.0	0.0	6.1	0.0	0.0	-19.1
245	17624291.19	5050362.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.1	47.2	-1.3	0.0	0.0	6.2	0.0	0.0	-64.6

Point Source, ISO 9613, Name: "UPS 9", ID: "UPS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
247	17624301.15	5050362.78	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-42.4
247	17624301.15	5050362.78	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	63.1	0.0	-5.2	0.0	0.0	10.0	0.0	0.0	-29.7
247	17624301.15	5050362.78	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	63.1	0.2	2.3	0.0	0.0	2.5	0.0	0.0	-9.6
247	17624301.15	5050362.78	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	63.1	0.4	8.2	0.0	0.0	0.0	0.0	0.0	-10.0
247	17624301.15	5050362.78	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	63.1	0.8	3.8	0.0	0.0	1.0	0.0	0.0	-7.6
247	17624301.15	5050362.78	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	63.1	1.5	-0.7	0.0	0.0	5.5	0.0	0.0	-4.3
247	17624301.15	5050362.78	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	63.1	3.9	-1.3	0.0	0.0	6.1	0.0	0.0	-5.4
247	17624301.15	5050362.78	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	63.1	13.3	-1.3	0.0	0.0	6.2	0.0	0.0	-19.3
247	17624301.15	5050362.78	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	63.1	47.3	-1.3	0.0	0.0	6.4	0.0	0.0	-64.9

Receiver

Name: POR5

ID: POR5

X: 17624276.99 m

Y: 5050616.50 m

Z: 322.43 m

Point Source, ISO 9613, Name: "Transformer 4MW", ID: "transformer_4MW"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
274	17624270.19	5050367.48	342.00	0	DEN	32	41.6	0.0	0.0	0.0	0.0	59.0	0.0	-3.7	0.0	0.0	8.4	0.0	0.0	-22.1
274	17624270.19	5050367.48	342.00	0	DEN	63	62.8	0.0	0.0	0.0	0.0	59.0	0.0	-3.7	0.0	0.0	8.4	0.0	0.0	-1.0
274	17624270.19	5050367.48	342.00	0	DEN	125	76.9	0.0	0.0	0.0	0.0	59.0	0.1	3.0	0.0	0.0	1.8	0.0	0.0	13.1
274	17624270.19	5050367.48	342.00	0	DEN	250	68.4	0.0	0.0	0.0	0.0	59.0	0.3	5.1	0.0	0.0	0.0	0.0	0.0	4.0
274	17624270.19	5050367.48	342.00	0	DEN	500	69.8	0.0	0.0	0.0	0.0	59.0	0.5	1.0	0.0	0.0	3.7	0.0	0.0	5.6
274	17624270.19	5050367.48	342.00	0	DEN	1000	71.0	0.0	0.0	0.0	0.0	59.0	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	6.3
274	17624270.19	5050367.48	342.00	0	DEN	2000	69.2	0.0	0.0	0.0	0.0	59.0	2.4	-0.7	0.0	0.0	5.5	0.0	0.0	3.0
274	17624270.19	5050367.48	342.00	0	DEN	4000	71.0	0.0	0.0	0.0	0.0	59.0	8.2	-0.7	0.0	0.0	5.5	0.0	0.0	-1.0
274	17624270.19	5050367.48	342.00	0	DEN	8000	51.9	0.0	0.0	0.0	0.0	59.0	29.2	-0.7	0.0	0.0	5.6	0.0	0.0	-41.1

Point Source, ISO 9613, Name: "HVAC Economizer Hood 3", ID: "HVAC_hood3"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
302	17624294.15	5050377.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	58.6	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-23.3
302	17624294.15	5050377.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	58.6	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-2.6
302	17624294.15	5050377.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	58.6	0.1	4.1	0.0	0.0	0.0	0.0	0.0	3.3
302	17624294.15	5050377.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	58.6	0.3	2.1	0.0	0.0	0.0	0.0	0.0	11.3
302	17624294.15	5050377.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	58.6	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	15.7
302	17624294.15	5050377.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	58.6	0.9	-0.6	0.0	0.0	0.0	0.0	0.0	12.7
302	17624294.15	5050377.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	58.6	2.3	-0.6	0.0	0.0	0.0	0.0	0.0	8.5
302	17624294.15	5050377.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	58.6	7.9	-0.6	0.0	0.0	0.0	0.0	0.0	-5.3
302	17624294.15	5050377.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	58.6	28.2	-0.6	0.0	0.0	0.0	0.0	0.0	-33.9

Point Source, ISO 9613, Name: "HVAC Economizer Hood 7", ID: "HVAC_hood7"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
314	17624301.74	5050377.18	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	58.7	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-23.3
314	17624301.74	5050377.18	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	58.7	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-2.6
314	17624301.74	5050377.18	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	58.7	0.1	4.1	0.0	0.0	0.0	0.0	0.0	3.2
314	17624301.74	5050377.18	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	58.7	0.3	2.1	0.0	0.0	0.0	0.0	0.0	11.3
314	17624301.74	5050377.18	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	58.7	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	15.7
314	17624301.74	5050377.18	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	58.7	0.9	-0.6	0.0	0.0	0.0	0.0	0.0	12.7
314	17624301.74	5050377.18	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	58.7	2.3	-0.6	0.0	0.0	0.0	0.0	0.0	8.4
314	17624301.74	5050377.18	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	58.7	7.9	-0.6	0.0	0.0	0.0	0.0	0.0	-5.4
314	17624301.74	5050377.18	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	58.7	28.2	-0.6	0.0	0.0	0.0	0.0	0.0	-34.0

Point Source, ISO 9613, Name: "HVAC Economizer Hood 4", ID: "HVAC_hood4"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
323	17624288.27	5050374.68	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	58.7	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-23.4
323	17624288.27	5050374.68	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	58.7	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-2.6
323	17624288.27	5050374.68	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	58.7	0.1	4.1	0.0	0.0	0.0	0.0	0.0	3.2
323	17624288.27	5050374.68	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	58.7	0.3	2.1	0.0	0.0	0.0	0.0	0.0	11.3
323	17624288.27	5050374.68	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	58.7	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	15.7
323	17624288.27	5050374.68	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	58.7	0.9	-0.6	0.0	0.0	0.0	0.0	0.0	12.6
323	17624288.27	5050374.68	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	58.7	2.3	-0.6	0.0	0.0	0.0	0.0	0.0	8.4
323	17624288.27	5050374.68	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	58.7	8.0	-0.6	0.0	0.0	0.0	0.0	0.0	-5.5
323	17624288.27	5050374.68	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	58.7	28.4	-0.6	0.0	0.0	0.0	0.0	0.0	-34.2

Point Source, ISO 9613, Name: "HVAC Economizer Hood 1", ID: "HVAC_hood1"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
325	17624284.42	5050366.44	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	59.0	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-23.7

Point Source, ISO 9613, Name: "HVAC Economizer Hood 1", ID: "HVAC_hood1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
325	17624284.42	5050366.44	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	59.0	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-2.9
325	17624284.42	5050366.44	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	59.0	0.1	4.1	0.0	0.0	0.0	0.0	0.0	2.9
325	17624284.42	5050366.44	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	59.0	0.3	2.1	0.0	0.0	0.0	0.0	0.0	11.0
325	17624284.42	5050366.44	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	59.0	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	15.4
325	17624284.42	5050366.44	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	59.0	0.9	-0.6	0.0	0.0	0.0	0.0	0.0	12.3
325	17624284.42	5050366.44	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	59.0	2.4	-0.6	0.0	0.0	0.0	0.0	0.0	8.0
325	17624284.42	5050366.44	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	59.0	8.2	-0.6	0.0	0.0	0.0	0.0	0.0	-6.0
325	17624284.42	5050366.44	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	59.0	29.3	-0.6	0.0	0.0	0.0	0.0	0.0	-35.4

Point Source, ISO 9613, Name: "HVAC Economizer Hood 5", ID: "HVAC_hood5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
327	17624291.94	5050366.35	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	59.0	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-31.5
327	17624291.94	5050366.35	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	59.0	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-10.7
327	17624291.94	5050366.35	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	59.0	0.1	4.1	0.0	0.0	0.7	0.0	0.0	2.2
327	17624291.94	5050366.35	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	59.0	0.3	2.1	0.0	0.0	2.6	0.0	0.0	8.3
327	17624291.94	5050366.35	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	59.0	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	10.0
327	17624291.94	5050366.35	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	59.0	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	6.9
327	17624291.94	5050366.35	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	59.0	2.4	-0.6	0.0	0.0	5.4	0.0	0.0	2.6
327	17624291.94	5050366.35	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	59.0	8.2	-0.6	0.0	0.0	5.4	0.0	0.0	-11.4
327	17624291.94	5050366.35	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	59.0	29.4	-0.6	0.0	0.0	5.4	0.0	0.0	-40.9

Point Source, ISO 9613, Name: "HVAC Economizer Hood 8", ID: "HVAC_hood8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
329	17624301.95	5050366.49	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	59.0	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-31.5
329	17624301.95	5050366.49	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	59.0	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-10.7
329	17624301.95	5050366.49	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	59.0	0.1	4.1	0.0	0.0	0.6	0.0	0.0	2.2
329	17624301.95	5050366.49	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	59.0	0.3	2.1	0.0	0.0	2.6	0.0	0.0	8.3
329	17624301.95	5050366.49	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	59.0	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	10.0
329	17624301.95	5050366.49	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	59.0	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	6.9
329	17624301.95	5050366.49	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	59.0	2.4	-0.6	0.0	0.0	5.4	0.0	0.0	2.6
329	17624301.95	5050366.49	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	59.0	8.3	-0.6	0.0	0.0	5.4	0.0	0.0	-11.5
329	17624301.95	5050366.49	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	59.0	29.5	-0.6	0.0	0.0	5.4	0.0	0.0	-41.0

Point Source, ISO 9613, Name: "HVAC Economizer Hood 2", ID: "HVAC_hood2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
345	17624278.29	5050363.89	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	59.1	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-23.8
345	17624278.29	5050363.89	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	59.1	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-3.0
345	17624278.29	5050363.89	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	59.1	0.1	4.1	0.0	0.0	0.0	0.0	0.0	2.8
345	17624278.29	5050363.89	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	59.1	0.3	2.1	0.0	0.0	0.0	0.0	0.0	10.9
345	17624278.29	5050363.89	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	59.1	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	15.3
345	17624278.29	5050363.89	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	0.0	0.0	0.0	12.2
345	17624278.29	5050363.89	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	59.1	2.5	-0.6	0.0	0.0	0.0	0.0	0.0	7.9
345	17624278.29	5050363.89	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	59.1	8.3	-0.6	0.0	0.0	0.0	0.0	0.0	-6.2
345	17624278.29	5050363.89	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	59.1	29.6	-0.6	0.0	0.0	0.0	0.0	0.0	-35.8

Point Source, ISO 9613, Name: "HVAC Economizer Hood 6", ID: "HVAC_hood6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
347	17624285.84	5050363.98	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	59.1	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-31.5
347	17624285.84	5050363.98	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	59.1	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-10.8
347	17624285.84	5050363.98	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	59.1	0.1	4.1	0.0	0.0	0.6	0.0	0.0	2.1
347	17624285.84	5050363.98	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	59.1	0.3	2.1	0.0	0.0	2.6	0.0	0.0	8.2
347	17624285.84	5050363.98	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	59.1	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	9.9
347	17624285.84	5050363.98	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	6.8
347	17624285.84	5050363.98	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	59.1	2.5	-0.6	0.0	0.0	5.4	0.0	0.0	2.5
347	17624285.84	5050363.98	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	59.1	8.3	-0.6	0.0	0.0	5.4	0.0	0.0	-11.5
347	17624285.84	5050363.98	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	59.1	29.6	-0.6	0.0	0.0	5.4	0.0	0.0	-41.2

Point Source, ISO 9613, Name: "HVAC Economizer Hood 9", ID: "HVAC_hood9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
352	17624295.94	5050364.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	59.1	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-31.6
352	17624295.94	5050364.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	59.1	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-10.8
352	17624295.94	5050364.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	59.1	0.1	4.1	0.0	0.0	0.6	0.0	0.0	2.1
352	17624295.94	5050364.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	59.1	0.3	2.1	0.0	0.0	2.6	0.0	0.0	8.2
352	17624295.94	5050364.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	59.1	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	9.9
352	17624295.94	5050364.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	6.8
352	17624295.94	5050364.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	59.1	2.5	-0.6	0.0	0.0	5.4	0.0	0.0	2.5
352	17624295.94	5050364.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	59.1	8.3	-0.6	0.0	0.0	5.4	0.0	0.0	-11.6
352	17624295.94	5050364.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	59.1	29.7	-0.6	0.0	0.0	5.4	0.0	0.0	-41.2

Point Source, ISO 9613, Name: "Transformer 2MW", ID: "transformer_2MW"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
354	17624280.40	5050378.87	342.00	0	DEN	32	38.6	0.0	0.0	0.0	0.0	58.5	0.0	-3.5	0.0	0.0	8.3	0.0	0.0	-24.7
354	17624280.40	5050378.87	342.00	0	DEN	63	59.8	0.0	0.0	0.0	0.0	58.5	0.0	-3.5	0.0	0.0	8.3	0.0	0.0	-3.6
354	17624280.40	5050378.87	342.00	0	DEN	125	73.9	0.0	0.0	0.0	0.0	58.5	0.1	3.0	0.0	0.0	1.8	0.0	0.0	10.5
354	17624280.40	5050378.87	342.00	0	DEN	250	65.4	0.0	0.0	0.0	0.0	58.5	0.2	5.2	0.0	0.0	0.0	0.0	0.0	1.4
354	17624280.40	5050378.87	342.00	0	DEN	500	66.8	0.0	0.0	0.0	0.0	58.5	0.5	1.1	0.0	0.0	3.7	0.0	0.0	3.0
354	17624280.40	5050378.87	342.00	0	DEN	1000	68.0	0.0	0.0	0.0	0.0	58.5	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	3.8
354	17624280.40	5050378.87	342.00	0	DEN	2000	66.2	0.0	0.0	0.0	0.0	58.5	2.3	-0.7	0.0	0.0	5.5	0.0	0.0	0.6
354	17624280.40	5050378.87	342.00	0	DEN	4000	68.0	0.0	0.0	0.0	0.0	58.5	7.8	-0.7	0.0	0.0	5.5	0.0	0.0	-3.1
354	17624280.40	5050378.87	342.00	0	DEN	8000	48.9	0.0	0.0	0.0	0.0	58.5	27.9	-0.7	0.0	0.0	5.5	0.0	0.0	-42.3

Point Source, ISO 9613, Name: "PCS 3", ID: "PCS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
365	17624290.73	5050378.40	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	58.6	0.0	-3.5	0.0	0.0	8.3	0.0	0.0	-33.1
365	17624290.73	5050378.40	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	58.6	0.0	-3.5	0.0	0.0	8.3	0.0	0.0	-20.4
365	17624290.73	5050378.40	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	58.6	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-0.3
365	17624290.73	5050378.40	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	58.6	0.2	5.2	0.0	0.0	0.0	0.0	0.0	2.5
365	17624290.73	5050378.40	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	58.6	0.5	1.1	0.0	0.0	3.7	0.0	0.0	2.0
365	17624290.73	5050378.40	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	58.6	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	5.6
365	17624290.73	5050378.40	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	58.6	2.3	-0.7	0.0	0.0	5.5	0.0	0.0	5.5
365	17624290.73	5050378.40	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	58.6	7.8	-0.7	0.0	0.0	5.6	0.0	0.0	-4.5
365	17624290.73	5050378.40	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	58.6	28.0	-0.7	0.0	0.0	5.6	0.0	0.0	-36.1

Point Source, ISO 9613, Name: "PCS 7", ID: "PCS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
373	17624298.22	5050378.41	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	58.6	0.0	-3.6	0.0	0.0	8.3	0.0	0.0	-33.1
373	17624298.22	5050378.41	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	58.6	0.0	-3.6	0.0	0.0	8.3	0.0	0.0	-20.4
373	17624298.22	5050378.41	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	58.6	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-0.3
373	17624298.22	5050378.41	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	58.6	0.3	5.2	0.0	0.0	0.0	0.0	0.0	2.5
373	17624298.22	5050378.41	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	58.6	0.5	1.1	0.0	0.0	3.8	0.0	0.0	2.0
373	17624298.22	5050378.41	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	58.6	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	5.6
373	17624298.22	5050378.41	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	58.6	2.3	-0.7	0.0	0.0	5.6	0.0	0.0	5.4
373	17624298.22	5050378.41	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	58.6	7.9	-0.7	0.0	0.0	5.7	0.0	0.0	-4.7
373	17624298.22	5050378.41	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	58.6	28.0	-0.7	0.0	0.0	6.0	0.0	0.0	-36.6

Point Source, ISO 9613, Name: "PCS 10", ID: "PCS10"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
380	17624280.69	5050376.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	58.6	0.0	-3.6	0.0	0.0	8.3	0.0	0.0	-33.1
380	17624280.69	5050376.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	58.6	0.0	-3.6	0.0	0.0	8.3	0.0	0.0	-20.4
380	17624280.69	5050376.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	58.6	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-0.4
380	17624280.69	5050376.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	58.6	0.3	5.2	0.0	0.0	0.0	0.0	0.0	2.4
380	17624280.69	5050376.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	58.6	0.5	1.1	0.0	0.0	3.7	0.0	0.0	2.0
380	17624280.69	5050376.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	58.6	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	5.6
380	17624280.69	5050376.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	58.6	2.3	-0.7	0.0	0.0	5.5	0.0	0.0	5.5
380	17624280.69	5050376.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	58.6	7.9	-0.7	0.0	0.0	5.5	0.0	0.0	-4.5
380	17624280.69	5050376.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	58.6	28.1	-0.7	0.0	0.0	5.5	0.0	0.0	-36.2

Point Source, ISO 9613, Name: "PCS 11", ID: "PCS11"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
407	17624280.74	5050375.25	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	58.7	0.0	-3.6	0.0	0.0	8.3	0.0	0.0	-33.2
407	17624280.74	5050375.25	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	58.7	0.0	-3.6	0.0	0.0	8.3	0.0	0.0	-20.5
407	17624280.74	5050375.25	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	58.7	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-0.4
407	17624280.74	5050375.25	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	58.7	0.3	5.1	0.0	0.0	0.0	0.0	0.0	2.4
407	17624280.74	5050375.25	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	58.7	0.5	1.1	0.0	0.0	3.7	0.0	0.0	1.9
407	17624280.74	5050375.25	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	58.7	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	5.5
407	17624280.74	5050375.25	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	58.7	2.3	-0.7	0.0	0.0	5.5	0.0	0.0	5.4
407	17624280.74	5050375.25	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	58.7	7.9	-0.7	0.0	0.0	5.5	0.0	0.0	-4.6
407	17624280.74	5050375.25	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	58.7	28.3	-0.7	0.0	0.0	5.5	0.0	0.0	-36.4

Point Source, ISO 9613, Name: "PCS 4", ID: "PCS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
409	17624291.60	5050373.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	58.8	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-33.3
409	17624291.60	5050373.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	58.8	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-20.6
409	17624291.60	5050373.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	58.8	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-0.5
409	17624291.60	5050373.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	58.8	0.3	5.1	0.0	0.0	0.0	0.0	0.0	2.3
409	17624291.60	5050373.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	58.8	0.5	1.0	0.0	0.0	3.8	0.0	0.0	1.8
409	17624291.60	5050373.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	58.8	0.9	-0.6	0.0	0.0	5.5	0.0	0.0	5.4
409	17624291.60	5050373.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	58.8	2.4	-0.7	0.0	0.0	5.6	0.0	0.0	5.2
409	17624291.60	5050373.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	58.8	8.0	-0.7	0.0	0.0	5.8	0.0	0.0	-5.0
409	17624291.60	5050373.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	58.8	28.5	-0.7	0.0	0.0	6.0	0.0	0.0	-37.3

Point Source, ISO 9613, Name: "PCS 1", ID: "PCS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
421	17624280.88	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	58.9	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-33.5
421	17624280.88	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	58.9	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-20.7
421	17624280.88	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	58.9	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-0.7
421	17624280.88	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	58.9	0.3	5.1	0.0	0.0	0.0	0.0	0.0	2.1
421	17624280.88	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	58.9	0.5	1.0	0.0	0.0	3.8	0.0	0.0	1.6
421	17624280.88	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	58.9	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	5.2
421	17624280.88	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	58.9	2.4	-0.7	0.0	0.0	5.6	0.0	0.0	5.0
421	17624280.88	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	58.9	8.2	-0.7	0.0	0.0	5.7	0.0	0.0	-5.3
421	17624280.88	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	58.9	29.2	-0.7	0.0	0.0	5.9	0.0	0.0	-38.0

Point Source, ISO 9613, Name: "PCS 5", ID: "PCS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
422	17624288.51	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.0	0.0	-3.7	0.0	0.0	8.4	0.0	0.0	-33.5
422	17624288.51	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.0	0.0	-3.7	0.0	0.0	8.4	0.0	0.0	-20.8
422	17624288.51	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.0	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-0.7
422	17624288.51	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.0	0.3	5.1	0.0	0.0	0.0	0.0	0.0	2.1
422	17624288.51	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.0	0.5	1.0	0.0	0.0	3.8	0.0	0.0	1.6
422	17624288.51	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.0	0.9	-0.6	0.0	0.0	5.5	0.0	0.0	5.1
422	17624288.51	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.0	2.4	-0.7	0.0	0.0	5.7	0.0	0.0	4.8
422	17624288.51	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.0	8.2	-0.7	0.0	0.0	6.0	0.0	0.0	-5.6
422	17624288.51	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.0	29.2	-0.7	0.0	0.0	6.4	0.0	0.0	-38.5

Point Source, ISO 9613, Name: "PCS 8", ID: "PCS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
424	17624298.45	5050367.65	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.0	0.0	-3.7	0.0	0.0	8.4	0.0	0.0	-33.5
424	17624298.45	5050367.65	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.0	0.0	-3.7	0.0	0.0	8.4	0.0	0.0	-20.8
424	17624298.45	5050367.65	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.0	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-0.7
424	17624298.45	5050367.65	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.0	0.3	5.1	0.0	0.0	0.0	0.0	0.0	2.1
424	17624298.45	5050367.65	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.0	0.5	1.0	0.0	0.0	3.9	0.0	0.0	1.5
424	17624298.45	5050367.65	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.0	0.9	-0.6	0.0	0.0	5.6	0.0	0.0	4.9
424	17624298.45	5050367.65	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.0	2.4	-0.7	0.0	0.0	6.0	0.0	0.0	4.6
424	17624298.45	5050367.65	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.0	8.2	-0.7	0.0	0.0	6.4	0.0	0.0	-6.1
424	17624298.45	5050367.65	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.0	29.3	-0.7	0.0	0.0	7.2	0.0	0.0	-39.4

Point Source, ISO 9613, Name: "PCS 12", ID: "PCS12"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
437	17624270.58	5050364.97	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.0	0.0	-3.7	0.0	0.0	8.4	0.0	0.0	-33.6
437	17624270.58	5050364.97	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.0	0.0	-3.7	0.0	0.0	8.4	0.0	0.0	-20.8
437	17624270.58	5050364.97	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.0	0.1	3.0	0.0	0.0	1.7	0.0	0.0	-0.8
437	17624270.58	5050364.97	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.0	0.3	5.1	0.0	0.0	0.0	0.0	0.0	2.0
437	17624270.58	5050364.97	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.0	0.5	1.0	0.0	0.0	3.7	0.0	0.0	1.5
437	17624270.58	5050364.97	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.0	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	5.1
437	17624270.58	5050364.97	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.0	2.4	-0.7	0.0	0.0	5.5	0.0	0.0	4.9
437	17624270.58	5050364.97	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.0	8.3	-0.7	0.0	0.0	5.6	0.0	0.0	-5.4
437	17624270.58	5050364.97	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.0	29.5	-0.7	0.0	0.0	5.7	0.0	0.0	-38.1

Point Source, ISO 9613, Name: "PCS 13", ID: "PCS13"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
439	17624270.54	5050363.56	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-33.6
439	17624270.54	5050363.56	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-20.9
439	17624270.54	5050363.56	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.1	0.1	3.0	0.0	0.0	1.7	0.0	0.0	-0.8
439	17624270.54	5050363.56	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.1	0.3	5.1	0.0	0.0	0.0	0.0	0.0	2.0
439	17624270.54	5050363.56	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.1	0.5	1.0	0.0	0.0	3.8	0.0	0.0	1.5
439	17624270.54	5050363.56	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	5.1
439	17624270.54	5050363.56	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.1	2.5	-0.7	0.0	0.0	5.6	0.0	0.0	4.9
439	17624270.54	5050363.56	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.1	8.3	-0.7	0.0	0.0	5.6	0.0	0.0	-5.5
439	17624270.54	5050363.56	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.1	29.7	-0.7	0.0	0.0	5.7	0.0	0.0	-38.4

Point Source, ISO 9613, Name: "PCS 2", ID: "PCS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
441	17624281.69	5050362.69	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-33.6
441	17624281.69	5050362.69	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-20.9
441	17624281.69	5050362.69	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.1	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-0.9
441	17624281.69	5050362.69	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.1	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.9
441	17624281.69	5050362.69	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.1	0.5	1.0	0.0	0.0	3.8	0.0	0.0	1.4
441	17624281.69	5050362.69	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	5.5	0.0	0.0	4.9
441	17624281.69	5050362.69	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.1	2.5	-0.7	0.0	0.0	5.8	0.0	0.0	4.6
441	17624281.69	5050362.69	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.1	8.3	-0.7	0.0	0.0	6.0	0.0	0.0	-5.9
441	17624281.69	5050362.69	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.1	29.8	-0.7	0.0	0.0	6.4	0.0	0.0	-39.2

Point Source, ISO 9613, Name: "PCS 6", ID: "PCS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
447	17624289.16	5050362.78	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-33.6
447	17624289.16	5050362.78	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-20.9
447	17624289.16	5050362.78	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.1	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-0.9
447	17624289.16	5050362.78	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.1	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.9
447	17624289.16	5050362.78	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.1	0.5	1.0	0.0	0.0	3.9	0.0	0.0	1.4
447	17624289.16	5050362.78	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	5.6	0.0	0.0	4.8
447	17624289.16	5050362.78	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.1	2.5	-0.7	0.0	0.0	5.9	0.0	0.0	4.5
447	17624289.16	5050362.78	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.1	8.3	-0.7	0.0	0.0	6.3	0.0	0.0	-6.3
447	17624289.16	5050362.78	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.1	29.8	-0.7	0.0	0.0	7.0	0.0	0.0	-39.8

Point Source, ISO 9613, Name: "PCS 14", ID: "PCS14"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
450	17624270.56	5050362.20	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-33.6
450	17624270.56	5050362.20	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-20.9
450	17624270.56	5050362.20	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.1	0.1	3.0	0.0	0.0	1.7	0.0	0.0	-0.9
450	17624270.56	5050362.20	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.1	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.9
450	17624270.56	5050362.20	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.1	0.5	1.0	0.0	0.0	3.8	0.0	0.0	1.4
450	17624270.56	5050362.20	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	5.0
450	17624270.56	5050362.20	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.1	2.5	-0.7	0.0	0.0	5.6	0.0	0.0	4.8
450	17624270.56	5050362.20	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.1	8.4	-0.7	0.0	0.0	5.7	0.0	0.0	-5.6
450	17624270.56	5050362.20	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.1	29.8	-0.7	0.0	0.0	5.8	0.0	0.0	-38.7

Point Source, ISO 9613, Name: "PCS 9", ID: "PCS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
455	17624299.21	5050362.68	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-33.7
455	17624299.21	5050362.68	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-21.0
455	17624299.21	5050362.68	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.1	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-0.9
455	17624299.21	5050362.68	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.1	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.9
455	17624299.21	5050362.68	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.1	0.5	1.0	0.0	0.0	3.9	0.0	0.0	1.2
455	17624299.21	5050362.68	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	5.8	0.0	0.0	4.6
455	17624299.21	5050362.68	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.1	2.5	-0.7	0.0	0.0	6.2	0.0	0.0	4.1
455	17624299.21	5050362.68	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.1	8.4	-0.7	0.0	0.0	6.8	0.0	0.0	-6.8
455	17624299.21	5050362.68	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.1	29.9	-0.7	0.0	0.0	7.9	0.0	0.0	-40.8

Point Source, ISO 9613, Name: "HVAC Condenser 3", ID: "HVAC_condenser3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
461	17624293.15	5050378.41	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	58.6	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-28.0
461	17624293.15	5050378.41	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	58.6	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-7.2
461	17624293.15	5050378.41	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	58.6	0.1	4.1	0.0	0.0	0.0	0.0	0.0	-1.4
461	17624293.15	5050378.41	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	58.6	0.3	2.1	0.0	0.0	0.0	0.0	0.0	6.7
461	17624293.15	5050378.41	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	58.6	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	11.1
461	17624293.15	5050378.41	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	58.6	0.9	-0.6	0.0	0.0	0.0	0.0	0.0	8.0
461	17624293.15	5050378.41	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	58.6	2.3	-0.6	0.0	0.0	0.0	0.0	0.0	3.8
461	17624293.15	5050378.41	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	58.6	7.9	-0.6	0.0	0.0	0.0	0.0	0.0	-9.9
461	17624293.15	5050378.41	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	58.6	28.0	-0.6	0.0	0.0	0.0	0.0	0.0	-38.4

Point Source, ISO 9613, Name: "HVAC Condenser 7", ID: "HVAC_condenser7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
463	17624300.76	5050378.47	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	58.6	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-28.0
463	17624300.76	5050378.47	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	58.6	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-7.2
463	17624300.76	5050378.47	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	58.6	0.1	4.1	0.0	0.0	0.0	0.0	0.0	-1.4
463	17624300.76	5050378.47	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	58.6	0.3	2.1	0.0	0.0	0.0	0.0	0.0	6.7
463	17624300.76	5050378.47	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	58.6	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	11.1
463	17624300.76	5050378.47	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	58.6	0.9	-0.6	0.0	0.0	0.0	0.0	0.0	8.0
463	17624300.76	5050378.47	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	58.6	2.3	-0.6	0.0	0.0	0.0	0.0	0.0	3.8
463	17624300.76	5050378.47	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	58.6	7.9	-0.6	0.0	0.0	0.0	0.0	0.0	-10.0
463	17624300.76	5050378.47	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	58.6	28.1	-0.6	0.0	0.0	0.0	0.0	0.0	-38.5

Point Source, ISO 9613, Name: "HVAC Condenser 4", ID: "HVAC_condenser4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
464	17624289.10	5050373.50	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	58.8	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-28.1
464	17624289.10	5050373.50	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	58.8	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-7.4
464	17624289.10	5050373.50	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	58.8	0.1	4.1	0.0	0.0	0.0	0.0	0.0	-1.6
464	17624289.10	5050373.50	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	58.8	0.3	2.1	0.0	0.0	0.0	0.0	0.0	6.5
464	17624289.10	5050373.50	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	58.8	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	10.9
464	17624289.10	5050373.50	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	58.8	0.9	-0.6	0.0	0.0	0.0	0.0	0.0	7.8
464	17624289.10	5050373.50	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	58.8	2.4	-0.6	0.0	0.0	0.0	0.0	0.0	3.6
464	17624289.10	5050373.50	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	58.8	8.0	-0.6	0.0	0.0	0.0	0.0	0.0	-10.2
464	17624289.10	5050373.50	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	58.8	28.5	-0.6	0.0	0.0	0.0	0.0	0.0	-39.1

Point Source, ISO 9613, Name: "HVAC Condenser 1", ID: "HVAC_condenser1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
468	17624283.37	5050367.59	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	59.0	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-28.3
468	17624283.37	5050367.59	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	59.0	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-7.6
468	17624283.37	5050367.59	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	59.0	0.1	4.1	0.0	0.0	0.0	0.0	0.0	-1.8
468	17624283.37	5050367.59	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	59.0	0.3	2.1	0.0	0.0	0.0	0.0	0.0	6.3
468	17624283.37	5050367.59	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	59.0	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	10.7
468	17624283.37	5050367.59	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	59.0	0.9	-0.6	0.0	0.0	0.0	0.0	0.0	7.6
468	17624283.37	5050367.59	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	59.0	2.4	-0.6	0.0	0.0	0.0	0.0	0.0	3.4
468	17624283.37	5050367.59	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	59.0	8.2	-0.6	0.0	0.0	0.0	0.0	0.0	-10.6
468	17624283.37	5050367.59	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	59.0	29.2	-0.6	0.0	0.0	0.0	0.0	0.0	-39.9

Point Source, ISO 9613, Name: "HVAC Condenser 5", ID: "HVAC_condenser5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
471	17624290.96	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	59.0	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-28.4
471	17624290.96	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	59.0	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-7.6
471	17624290.96	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	59.0	0.1	4.1	0.0	0.0	0.0	0.0	0.0	-1.8
471	17624290.96	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	59.0	0.3	2.1	0.0	0.0	0.0	0.0	0.0	6.3
471	17624290.96	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	59.0	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	10.7
471	17624290.96	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	59.0	0.9	-0.6	0.0	0.0	0.0	0.0	0.0	7.6
471	17624290.96	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	59.0	2.4	-0.6	0.0	0.0	0.0	0.0	0.0	3.3
471	17624290.96	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	59.0	8.2	-0.6	0.0	0.0	0.0	0.0	0.0	-10.6
471	17624290.96	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	59.0	29.2	-0.6	0.0	0.0	0.0	0.0	0.0	-40.0

Point Source, ISO 9613, Name: "HVAC Condenser 8", ID: "HVAC_condenser8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
473	17624300.95	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	59.0	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-36.1
473	17624300.95	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	59.0	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-15.4
473	17624300.95	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	59.0	0.1	4.1	0.0	0.0	0.7	0.0	0.0	-2.5
473	17624300.95	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	59.0	0.3	2.1	0.0	0.0	2.6	0.0	0.0	3.6
473	17624300.95	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	59.0	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	5.3
473	17624300.95	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	59.0	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	2.2
473	17624300.95	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	59.0	2.4	-0.6	0.0	0.0	5.4	0.0	0.0	-2.1
473	17624300.95	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	59.0	8.2	-0.6	0.0	0.0	5.4	0.0	0.0	-16.1
473	17624300.95	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	59.0	29.3	-0.6	0.0	0.0	5.4	0.0	0.0	-45.5

Point Source, ISO 9613, Name: "HVAC Condenser 2", ID: "HVAC_condenser2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
476	17624279.21	5050362.61	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	59.1	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-28.5
476	17624279.21	5050362.61	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	59.1	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-7.8
476	17624279.21	5050362.61	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	59.1	0.1	4.1	0.0	0.0	0.0	0.0	0.0	-2.0
476	17624279.21	5050362.61	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	59.1	0.3	2.1	0.0	0.0	0.0	0.0	0.0	6.1
476	17624279.21	5050362.61	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	59.1	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	10.5
476	17624279.21	5050362.61	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	0.0	0.0	0.0	7.4
476	17624279.21	5050362.61	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	59.1	2.5	-0.6	0.0	0.0	0.0	0.0	0.0	3.1
476	17624279.21	5050362.61	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	59.1	8.4	-0.6	0.0	0.0	0.0	0.0	0.0	-11.0
476	17624279.21	5050362.61	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	59.1	29.8	-0.6	0.0	0.0	0.0	0.0	0.0	-40.7

Point Source, ISO 9613, Name: "HVAC Condenser 6", ID: "HVAC_condenser6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
479	17624286.79	5050362.77	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	59.1	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-36.3
479	17624286.79	5050362.77	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	59.1	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-15.5
479	17624286.79	5050362.77	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	59.1	0.1	4.1	0.0	0.0	0.6	0.0	0.0	-2.6
479	17624286.79	5050362.77	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	59.1	0.3	2.1	0.0	0.0	2.6	0.0	0.0	3.5
479	17624286.79	5050362.77	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	59.1	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	5.2
479	17624286.79	5050362.77	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	2.1
479	17624286.79	5050362.77	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	59.1	2.5	-0.6	0.0	0.0	5.4	0.0	0.0	-2.2
479	17624286.79	5050362.77	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	59.1	8.4	-0.6	0.0	0.0	5.4	0.0	0.0	-16.3
479	17624286.79	5050362.77	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	59.1	29.8	-0.6	0.0	0.0	5.4	0.0	0.0	-46.1

Point Source, ISO 9613, Name: "HVAC Condenser 9", ID: "HVAC_condenser9"																				
Nr.	X	Y	Z	Ref.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
481	17624296.83	5050362.76	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	59.1	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-36.3
481	17624296.83	5050362.76	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	59.1	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-15.6
481	17624296.83	5050362.76	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	59.1	0.1	4.1	0.0	0.0	0.6	0.0	0.0	-2.6
481	17624296.83	5050362.76	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	59.1	0.3	2.1	0.0	0.0	2.6	0.0	0.0	3.5
481	17624296.83	5050362.76	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	59.1	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	5.1
481	17624296.83	5050362.76	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	2.0
481	17624296.83	5050362.76	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	59.1	2.5	-0.6	0.0	0.0	5.4	0.0	0.0	-2.3
481	17624296.83	5050362.76	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	59.1	8.4	-0.6	0.0	0.0	5.4	0.0	0.0	-16.4
481	17624296.83	5050362.76	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	59.1	29.9	-0.6	0.0	0.0	5.4	0.0	0.0	-46.1

Point Source, ISO 9613, Name: "UPS 3", ID: "UPS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
483	17624288.82	5050378.40	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	58.6	0.0	-3.5	0.0	0.0	8.3	0.0	0.0	-37.8
483	17624288.82	5050378.40	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	58.6	0.0	-3.5	0.0	0.0	8.3	0.0	0.0	-25.1
483	17624288.82	5050378.40	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	58.6	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-5.0
483	17624288.82	5050378.40	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	58.6	0.2	5.2	0.0	0.0	0.0	0.0	0.0	-2.2
483	17624288.82	5050378.40	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	58.6	0.5	1.1	0.0	0.0	3.7	0.0	0.0	-2.7
483	17624288.82	5050378.40	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	58.6	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	0.9
483	17624288.82	5050378.40	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	58.6	2.3	-0.7	0.0	0.0	5.5	0.0	0.0	0.9
483	17624288.82	5050378.40	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	58.6	7.8	-0.7	0.0	0.0	5.5	0.0	0.0	-9.2
483	17624288.82	5050378.40	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	58.6	28.0	-0.7	0.0	0.0	5.6	0.0	0.0	-40.8

Point Source, ISO 9613, Name: "UPS 7", ID: "UPS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
486	17624296.42	5050378.45	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	58.6	0.0	-3.6	0.0	0.0	8.3	0.0	0.0	-37.8
486	17624296.42	5050378.45	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	58.6	0.0	-3.6	0.0	0.0	8.3	0.0	0.0	-25.1
486	17624296.42	5050378.45	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	58.6	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-5.0
486	17624296.42	5050378.45	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	58.6	0.3	5.2	0.0	0.0	0.0	0.0	0.0	-2.2
486	17624296.42	5050378.45	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	58.6	0.5	1.1	0.0	0.0	3.7	0.0	0.0	-2.7
486	17624296.42	5050378.45	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	58.6	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	0.9
486	17624296.42	5050378.45	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	58.6	2.3	-0.7	0.0	0.0	5.6	0.0	0.0	0.8
486	17624296.42	5050378.45	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	58.6	7.9	-0.7	0.0	0.0	5.7	0.0	0.0	-9.3
486	17624296.42	5050378.45	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	58.6	28.0	-0.7	0.0	0.0	5.9	0.0	0.0	-41.1

Point Source, ISO 9613, Name: "UPS 4", ID: "UPS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
488	17624293.53	5050373.46	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	58.8	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-38.0
488	17624293.53	5050373.46	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	58.8	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-25.3
488	17624293.53	5050373.46	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	58.8	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-5.2
488	17624293.53	5050373.46	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	58.8	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-2.4
488	17624293.53	5050373.46	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	58.8	0.5	1.0	0.0	0.0	3.8	0.0	0.0	-2.9
488	17624293.53	5050373.46	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	58.8	0.9	-0.6	0.0	0.0	5.5	0.0	0.0	0.7
488	17624293.53	5050373.46	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	58.8	2.4	-0.7	0.0	0.0	5.7	0.0	0.0	0.5
488	17624293.53	5050373.46	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	58.8	8.0	-0.7	0.0	0.0	5.8	0.0	0.0	-9.8
488	17624293.53	5050373.46	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	58.8	28.6	-0.7	0.0	0.0	6.2	0.0	0.0	-42.1

Point Source, ISO 9613, Name: "UPS 1", ID: "UPS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
489	17624278.90	5050367.58	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	58.9	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-38.2
489	17624278.90	5050367.58	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	58.9	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-25.4
489	17624278.90	5050367.58	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	58.9	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-5.4
489	17624278.90	5050367.58	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	58.9	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-2.6
489	17624278.90	5050367.58	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	58.9	0.5	1.0	0.0	0.0	3.8	0.0	0.0	-3.1
489	17624278.90	5050367.58	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	58.9	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	0.5
489	17624278.90	5050367.58	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	58.9	2.4	-0.7	0.0	0.0	5.6	0.0	0.0	0.3
489	17624278.90	5050367.58	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	58.9	8.2	-0.7	0.0	0.0	5.7	0.0	0.0	-10.0
489	17624278.90	5050367.58	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	58.9	29.2	-0.7	0.0	0.0	5.8	0.0	0.0	-42.6

Point Source, ISO 9613, Name: "UPS 5", ID: "UPS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
493	17624286.54	5050367.66	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	59.0	0.0	-3.7	0.0	0.0	8.4	0.0	0.0	-38.2
493	17624286.54	5050367.66	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	59.0	0.0	-3.7	0.0	0.0	8.4	0.0	0.0	-25.5
493	17624286.54	5050367.66	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	59.0	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-5.4
493	17624286.54	5050367.66	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	59.0	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-2.6
493	17624286.54	5050367.66	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	59.0	0.5	1.0	0.0	0.0	3.8	0.0	0.0	-3.1
493	17624286.54	5050367.66	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	59.0	0.9	-0.6	0.0	0.0	5.5	0.0	0.0	0.4
493	17624286.54	5050367.66	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	59.0	2.4	-0.7	0.0	0.0	5.7	0.0	0.0	0.2
493	17624286.54	5050367.66	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	59.0	8.2	-0.7	0.0	0.0	5.9	0.0	0.0	-10.2
493	17624286.54	5050367.66	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	59.0	29.2	-0.7	0.0	0.0	6.3	0.0	0.0	-43.0

Point Source, ISO 9613, Name: "UPS 8", ID: "UPS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
496	17624296.53	5050367.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	59.0	0.0	-3.7	0.0	0.0	8.4	0.0	0.0	-38.2
496	17624296.53	5050367.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	59.0	0.0	-3.7	0.0	0.0	8.4	0.0	0.0	-25.5
496	17624296.53	5050367.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	59.0	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-5.4
496	17624296.53	5050367.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	59.0	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-2.6
496	17624296.53	5050367.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	59.0	0.5	1.0	0.0	0.0	3.8	0.0	0.0	-3.2
496	17624296.53	5050367.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	59.0	0.9	-0.6	0.0	0.0	5.6	0.0	0.0	0.3
496	17624296.53	5050367.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	59.0	2.4	-0.7	0.0	0.0	5.9	0.0	0.0	-0.1
496	17624296.53	5050367.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	59.0	8.2	-0.7	0.0	0.0	6.3	0.0	0.0	-10.7
496	17624296.53	5050367.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	59.0	29.3	-0.7	0.0	0.0	7.0	0.0	0.0	-43.9

Point Source, ISO 9613, Name: "UPS 2", ID: "UPS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
498	17624283.74	5050362.73	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-38.3
498	17624283.74	5050362.73	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-25.6
498	17624283.74	5050362.73	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	59.1	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-5.6
498	17624283.74	5050362.73	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	59.1	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-2.8
498	17624283.74	5050362.73	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	59.1	0.5	1.0	0.0	0.0	3.8	0.0	0.0	-3.3
498	17624283.74	5050362.73	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	5.5	0.0	0.0	0.2
498	17624283.74	5050362.73	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	59.1	2.5	-0.7	0.0	0.0	5.8	0.0	0.0	-0.1
498	17624283.74	5050362.73	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	59.1	8.3	-0.7	0.0	0.0	6.1	0.0	0.0	-10.7
498	17624283.74	5050362.73	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	59.1	29.8	-0.7	0.0	0.0	6.6	0.0	0.0	-44.1

Point Source, ISO 9613, Name: "UPS 6", ID: "UPS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
500	17624291.19	5050362.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-38.3
500	17624291.19	5050362.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-25.6
500	17624291.19	5050362.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	59.1	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-5.6
500	17624291.19	5050362.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	59.1	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-2.8
500	17624291.19	5050362.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	59.1	0.5	1.0	0.0	0.0	3.9	0.0	0.0	-3.4
500	17624291.19	5050362.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	5.6	0.0	0.0	0.1
500	17624291.19	5050362.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	59.1	2.5	-0.7	0.0	0.0	6.0	0.0	0.0	-0.3
500	17624291.19	5050362.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	59.1	8.4	-0.7	0.0	0.0	6.4	0.0	0.0	-11.1
500	17624291.19	5050362.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	59.1	29.8	-0.7	0.0	0.0	7.2	0.0	0.0	-44.7

Point Source, ISO 9613, Name: "UPS 9", ID: "UPS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
503	17624301.15	5050362.78	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	59.2	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-38.4
503	17624301.15	5050362.78	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	59.2	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-25.7
503	17624301.15	5050362.78	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	59.2	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-5.6
503	17624301.15	5050362.78	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	59.2	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-2.8
503	17624301.15	5050362.78	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	59.2	0.5	1.0	0.0	0.0	3.9	0.0	0.0	-3.5
503	17624301.15	5050362.78	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	59.2	0.9	-0.6	0.0	0.0	5.8	0.0	0.0	-0.1
503	17624301.15	5050362.78	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	59.2	2.5	-0.7	0.0	0.0	6.3	0.0	0.0	-0.6
503	17624301.15	5050362.78	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	59.2	8.4	-0.7	0.0	0.0	6.9	0.0	0.0	-11.6
503	17624301.15	5050362.78	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	59.2	29.9	-0.7	0.0	0.0	8.0	0.0	0.0	-45.6

Receiver

Name: POR6
ID: POR6
X: 17624331.46 m
Y: 5050617.34 m
Z: 324.16 m

Point Source, ISO 9613, Name: "Transformer 4MW", ID: "transformer_4MW"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
281	17624270.19	5050367.48	342.00	0	DEN	32	41.6	0.0	0.0	0.0	0.0	59.2	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-22.4
281	17624270.19	5050367.48	342.00	0	DEN	63	62.8	0.0	0.0	0.0	0.0	59.2	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-1.2
281	17624270.19	5050367.48	342.00	0	DEN	125	76.9	0.0	0.0	0.0	0.0	59.2	0.1	3.0	0.0	0.0	1.7	0.0	0.0	12.8
281	17624270.19	5050367.48	342.00	0	DEN	250	68.4	0.0	0.0	0.0	0.0	59.2	0.3	5.1	0.0	0.0	0.0	0.0	0.0	3.8
281	17624270.19	5050367.48	342.00	0	DEN	500	69.8	0.0	0.0	0.0	0.0	59.2	0.5	1.0	0.0	0.0	3.8	0.0	0.0	5.3
281	17624270.19	5050367.48	342.00	0	DEN	1000	71.0	0.0	0.0	0.0	0.0	59.2	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	6.0
281	17624270.19	5050367.48	342.00	0	DEN	2000	69.2	0.0	0.0	0.0	0.0	59.2	2.5	-0.7	0.0	0.0	5.5	0.0	0.0	2.7
281	17624270.19	5050367.48	342.00	0	DEN	4000	71.0	0.0	0.0	0.0	0.0	59.2	8.5	-0.7	0.0	0.0	5.5	0.0	0.0	-1.5
281	17624270.19	5050367.48	342.00	0	DEN	8000	51.9	0.0	0.0	0.0	0.0	59.2	30.1	-0.7	0.0	0.0	5.6	0.0	0.0	-42.3

Point Source, ISO 9613, Name: "HVAC Economizer Hood 7", ID: "HVAC_hood7"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
304	17624301.74	5050377.18	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	58.7	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-23.4
304	17624301.74	5050377.18	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	58.7	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-2.6
304	17624301.74	5050377.18	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	58.7	0.1	4.1	0.0	0.0	0.0	0.0	0.0	3.2
304	17624301.74	5050377.18	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	58.7	0.3	2.1	0.0	0.0	0.0	0.0	0.0	11.3
304	17624301.74	5050377.18	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	58.7	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	15.7
304	17624301.74	5050377.18	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	58.7	0.9	-0.6	0.0	0.0	0.0	0.0	0.0	12.6
304	17624301.74	5050377.18	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	58.7	2.3	-0.6	0.0	0.0	0.0	0.0	0.0	8.4
304	17624301.74	5050377.18	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	58.7	8.0	-0.6	0.0	0.0	0.0	0.0	0.0	-5.4
304	17624301.74	5050377.18	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	58.7	28.4	-0.6	0.0	0.0	0.0	0.0	0.0	-34.2

Point Source, ISO 9613, Name: "HVAC Economizer Hood 3", ID: "HVAC_hood3"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
311	17624294.15	5050377.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	58.7	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-23.4
311	17624294.15	5050377.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	58.7	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-2.7
311	17624294.15	5050377.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	58.7	0.1	4.1	0.0	0.0	0.0	0.0	0.0	3.1
311	17624294.15	5050377.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	58.7	0.3	2.1	0.0	0.0	0.0	0.0	0.0	11.2
311	17624294.15	5050377.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	58.7	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	15.6
311	17624294.15	5050377.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	58.7	0.9	-0.6	0.0	0.0	0.0	0.0	0.0	12.6
311	17624294.15	5050377.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	58.7	2.4	-0.6	0.0	0.0	0.0	0.0	0.0	8.3
311	17624294.15	5050377.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	58.7	8.0	-0.6	0.0	0.0	0.0	0.0	0.0	-5.5
311	17624294.15	5050377.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	58.7	28.5	-0.6	0.0	0.0	0.0	0.0	0.0	-34.3

Point Source, ISO 9613, Name: "HVAC Economizer Hood 4", ID: "HVAC_hood4"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
319	17624288.27	5050374.68	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	58.9	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-23.6
319	17624288.27	5050374.68	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	58.9	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-2.8
319	17624288.27	5050374.68	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	58.9	0.1	4.1	0.0	0.0	0.0	0.0	0.0	3.0
319	17624288.27	5050374.68	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	58.9	0.3	2.1	0.0	0.0	0.0	0.0	0.0	11.1
319	17624288.27	5050374.68	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	58.9	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	15.5
319	17624288.27	5050374.68	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	58.9	0.9	-0.6	0.0	0.0	0.0	0.0	0.0	12.4
319	17624288.27	5050374.68	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	58.9	2.4	-0.6	0.0	0.0	0.0	0.0	0.0	8.2
319	17624288.27	5050374.68	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	58.9	8.1	-0.6	0.0	0.0	0.0	0.0	0.0	-5.8
319	17624288.27	5050374.68	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	58.9	28.9	-0.6	0.0	0.0	0.0	0.0	0.0	-34.8

Point Source, ISO 9613, Name: "HVAC Economizer Hood 8", ID: "HVAC_hood8"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
364	17624301.95	5050366.49	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	59.1	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-31.5

Point Source, ISO 9613, Name: "HVAC Economizer Hood 8", ID: "HVAC_hood8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
364	17624301.95	5050366.49	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	59.1	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-10.8
364	17624301.95	5050366.49	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	59.1	0.1	4.1	0.0	0.0	0.6	0.0	0.0	2.1
364	17624301.95	5050366.49	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	59.1	0.3	2.1	0.0	0.0	2.6	0.0	0.0	8.2
364	17624301.95	5050366.49	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	59.1	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	9.9
364	17624301.95	5050366.49	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	6.8
364	17624301.95	5050366.49	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	59.1	2.4	-0.6	0.0	0.0	5.4	0.0	0.0	2.5
364	17624301.95	5050366.49	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	59.1	8.3	-0.6	0.0	0.0	5.4	0.0	0.0	-11.5
364	17624301.95	5050366.49	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	59.1	29.6	-0.6	0.0	0.0	5.4	0.0	0.0	-41.1

Point Source, ISO 9613, Name: "HVAC Economizer Hood 5", ID: "HVAC_hood5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
366	17624291.94	5050366.35	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	59.1	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-31.6
366	17624291.94	5050366.35	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	59.1	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-10.8
366	17624291.94	5050366.35	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	59.1	0.1	4.1	0.0	0.0	0.6	0.0	0.0	2.1
366	17624291.94	5050366.35	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	59.1	0.3	2.1	0.0	0.0	2.6	0.0	0.0	8.2
366	17624291.94	5050366.35	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	59.1	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	9.9
366	17624291.94	5050366.35	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	6.8
366	17624291.94	5050366.35	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	59.1	2.5	-0.6	0.0	0.0	5.4	0.0	0.0	2.5
366	17624291.94	5050366.35	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	59.1	8.4	-0.6	0.0	0.0	5.4	0.0	0.0	-11.6
366	17624291.94	5050366.35	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	59.1	29.8	-0.6	0.0	0.0	5.4	0.0	0.0	-41.4

Point Source, ISO 9613, Name: "HVAC Economizer Hood 1", ID: "HVAC_hood1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
367	17624284.42	5050366.44	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	59.2	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-23.9
367	17624284.42	5050366.44	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	59.2	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-3.1
367	17624284.42	5050366.44	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	59.2	0.1	4.1	0.0	0.0	0.0	0.0	0.0	2.7
367	17624284.42	5050366.44	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	59.2	0.3	2.1	0.0	0.0	0.0	0.0	0.0	10.8
367	17624284.42	5050366.44	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	59.2	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	15.2
367	17624284.42	5050366.44	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	59.2	0.9	-0.6	0.0	0.0	0.0	0.0	0.0	12.1
367	17624284.42	5050366.44	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	59.2	2.5	-0.6	0.0	0.0	0.0	0.0	0.0	7.8
367	17624284.42	5050366.44	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	59.2	8.4	-0.6	0.0	0.0	0.0	0.0	0.0	-6.3
367	17624284.42	5050366.44	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	59.2	29.9	-0.6	0.0	0.0	0.0	0.0	0.0	-36.2

Point Source, ISO 9613, Name: "HVAC Economizer Hood 9", ID: "HVAC_hood9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
368	17624295.94	5050364.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	59.2	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-31.6
368	17624295.94	5050364.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	59.2	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-10.9
368	17624295.94	5050364.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	59.2	0.1	4.1	0.0	0.0	0.6	0.0	0.0	2.0
368	17624295.94	5050364.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	59.2	0.3	2.1	0.0	0.0	2.6	0.0	0.0	8.1
368	17624295.94	5050364.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	59.2	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	9.8
368	17624295.94	5050364.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	59.2	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	6.7
368	17624295.94	5050364.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	59.2	2.5	-0.6	0.0	0.0	5.4	0.0	0.0	2.4
368	17624295.94	5050364.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	59.2	8.4	-0.6	0.0	0.0	5.4	0.0	0.0	-11.7
368	17624295.94	5050364.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	59.2	30.0	-0.6	0.0	0.0	5.4	0.0	0.0	-41.6

Point Source, ISO 9613, Name: "HVAC Economizer Hood 6", ID: "HVAC_hood6"																				
Nr.	X	Y	Z	Ref.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
369	17624285.84	5050363.98	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	59.2	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-31.7
369	17624285.84	5050363.98	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	59.2	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-10.9
369	17624285.84	5050363.98	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	59.2	0.1	4.1	0.0	0.0	0.6	0.0	0.0	2.0
369	17624285.84	5050363.98	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	59.2	0.3	2.1	0.0	0.0	2.7	0.0	0.0	8.1
369	17624285.84	5050363.98	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	59.2	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	9.7
369	17624285.84	5050363.98	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	59.2	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	6.6
369	17624285.84	5050363.98	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	59.2	2.5	-0.6	0.0	0.0	5.4	0.0	0.0	2.3
369	17624285.84	5050363.98	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	59.2	8.5	-0.6	0.0	0.0	5.4	0.0	0.0	-11.9
369	17624285.84	5050363.98	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	59.2	30.2	-0.6	0.0	0.0	5.4	0.0	0.0	-41.9

Point Source, ISO 9613, Name: "HVAC Economizer Hood 2", ID: "HVAC_hood2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
381	17624278.29	5050363.89	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	59.3	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-23.9
381	17624278.29	5050363.89	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	59.3	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-3.2
381	17624278.29	5050363.89	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	59.3	0.1	4.1	0.0	0.0	0.0	0.0	0.0	2.6
381	17624278.29	5050363.89	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	59.3	0.3	2.1	0.0	0.0	0.0	0.0	0.0	10.7
381	17624278.29	5050363.89	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	59.3	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	15.1
381	17624278.29	5050363.89	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	59.3	1.0	-0.6	0.0	0.0	0.0	0.0	0.0	12.0
381	17624278.29	5050363.89	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	59.3	2.5	-0.6	0.0	0.0	0.0	0.0	0.0	7.6
381	17624278.29	5050363.89	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	59.3	8.5	-0.6	0.0	0.0	0.0	0.0	0.0	-6.6
381	17624278.29	5050363.89	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	59.3	30.4	-0.6	0.0	0.0	0.0	0.0	0.0	-36.7

Point Source, ISO 9613, Name: "Transformer 2MW", ID: "transformer_2MW"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
383	17624280.40	5050378.87	342.00	0	DEN	32	38.6	0.0	0.0	0.0	0.0	58.8	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-25.0
383	17624280.40	5050378.87	342.00	0	DEN	63	59.8	0.0	0.0	0.0	0.0	58.8	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-3.8
383	17624280.40	5050378.87	342.00	0	DEN	125	73.9	0.0	0.0	0.0	0.0	58.8	0.1	3.0	0.0	0.0	1.8	0.0	0.0	10.3
383	17624280.40	5050378.87	342.00	0	DEN	250	65.4	0.0	0.0	0.0	0.0	58.8	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.2
383	17624280.40	5050378.87	342.00	0	DEN	500	66.8	0.0	0.0	0.0	0.0	58.8	0.5	1.0	0.0	0.0	3.7	0.0	0.0	2.8
383	17624280.40	5050378.87	342.00	0	DEN	1000	68.0	0.0	0.0	0.0	0.0	58.8	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	3.6
383	17624280.40	5050378.87	342.00	0	DEN	2000	66.2	0.0	0.0	0.0	0.0	58.8	2.4	-0.7	0.0	0.0	5.5	0.0	0.0	0.3
383	17624280.40	5050378.87	342.00	0	DEN	4000	68.0	0.0	0.0	0.0	0.0	58.8	8.0	-0.7	0.0	0.0	5.5	0.0	0.0	-3.6
383	17624280.40	5050378.87	342.00	0	DEN	8000	48.9	0.0	0.0	0.0	0.0	58.8	28.6	-0.7	0.0	0.0	5.5	0.0	0.0	-43.2

Point Source, ISO 9613, Name: "PCS 7", ID: "PCS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
385	17624298.22	5050378.41	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	58.7	0.0	-3.6	0.0	0.0	8.3	0.0	0.0	-33.2
385	17624298.22	5050378.41	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	58.7	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-20.5
385	17624298.22	5050378.41	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	58.7	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-0.4
385	17624298.22	5050378.41	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	58.7	0.3	5.1	0.0	0.0	0.0	0.0	0.0	2.4
385	17624298.22	5050378.41	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	58.7	0.5	1.1	0.0	0.0	3.8	0.0	0.0	1.9
385	17624298.22	5050378.41	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	58.7	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	5.5
385	17624298.22	5050378.41	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	58.7	2.3	-0.7	0.0	0.0	5.6	0.0	0.0	5.3
385	17624298.22	5050378.41	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	58.7	7.9	-0.7	0.0	0.0	5.8	0.0	0.0	-4.9
385	17624298.22	5050378.41	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	58.7	28.3	-0.7	0.0	0.0	6.0	0.0	0.0	-36.9

Point Source, ISO 9613, Name: "PCS 3", ID: "PCS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
387	17624290.73	5050378.40	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	58.7	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-33.2
387	17624290.73	5050378.40	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	58.7	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-20.5
387	17624290.73	5050378.40	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	58.7	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-0.4
387	17624290.73	5050378.40	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	58.7	0.3	5.1	0.0	0.0	0.0	0.0	0.0	2.3
387	17624290.73	5050378.40	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	58.7	0.5	1.0	0.0	0.0	3.7	0.0	0.0	1.9
387	17624290.73	5050378.40	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	58.7	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	5.5
387	17624290.73	5050378.40	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	58.7	2.3	-0.7	0.0	0.0	5.5	0.0	0.0	5.4
387	17624290.73	5050378.40	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	58.7	8.0	-0.7	0.0	0.0	5.6	0.0	0.0	-4.8
387	17624290.73	5050378.40	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	58.7	28.4	-0.7	0.0	0.0	5.7	0.0	0.0	-36.7

Point Source, ISO 9613, Name: "PCS 10", ID: "PCS10"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
389	17624280.69	5050376.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	58.8	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-33.4
389	17624280.69	5050376.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	58.8	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-20.6
389	17624280.69	5050376.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	58.8	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-0.6
389	17624280.69	5050376.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	58.8	0.3	5.1	0.0	0.0	0.0	0.0	0.0	2.2
389	17624280.69	5050376.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	58.8	0.5	1.0	0.0	0.0	3.7	0.0	0.0	1.8
389	17624280.69	5050376.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	58.8	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	5.3
389	17624280.69	5050376.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	58.8	2.4	-0.7	0.0	0.0	5.5	0.0	0.0	5.2
389	17624280.69	5050376.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	58.8	8.1	-0.7	0.0	0.0	5.5	0.0	0.0	-4.9
389	17624280.69	5050376.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	58.8	28.8	-0.7	0.0	0.0	5.5	0.0	0.0	-37.1

Point Source, ISO 9613, Name: "PCS 4", ID: "PCS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
391	17624291.60	5050373.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	58.9	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-33.4
391	17624291.60	5050373.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	58.9	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-20.7
391	17624291.60	5050373.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	58.9	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-0.6
391	17624291.60	5050373.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	58.9	0.3	5.1	0.0	0.0	0.0	0.0	0.0	2.2
391	17624291.60	5050373.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	58.9	0.5	1.0	0.0	0.0	3.8	0.0	0.0	1.7
391	17624291.60	5050373.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	58.9	0.9	-0.6	0.0	0.0	5.5	0.0	0.0	5.2
391	17624291.60	5050373.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	58.9	2.4	-0.7	0.0	0.0	5.6	0.0	0.0	5.0
391	17624291.60	5050373.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	58.9	8.1	-0.7	0.0	0.0	5.8	0.0	0.0	-5.3
391	17624291.60	5050373.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	58.9	29.0	-0.7	0.0	0.0	6.0	0.0	0.0	-37.8

Point Source, ISO 9613, Name: "PCS 11", ID: "PCS11"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
393	17624280.74	5050375.25	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	58.9	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-33.4
393	17624280.74	5050375.25	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	58.9	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-20.7
393	17624280.74	5050375.25	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	58.9	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-0.6
393	17624280.74	5050375.25	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	58.9	0.3	5.1	0.0	0.0	0.0	0.0	0.0	2.2
393	17624280.74	5050375.25	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	58.9	0.5	1.0	0.0	0.0	3.7	0.0	0.0	1.7
393	17624280.74	5050375.25	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	58.9	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	5.3
393	17624280.74	5050375.25	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	58.9	2.4	-0.7	0.0	0.0	5.5	0.0	0.0	5.2
393	17624280.74	5050375.25	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	58.9	8.1	-0.7	0.0	0.0	5.5	0.0	0.0	-5.0
393	17624280.74	5050375.25	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	58.9	29.0	-0.7	0.0	0.0	5.6	0.0	0.0	-37.3

Point Source, ISO 9613, Name: "PCS 8", ID: "PCS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
395	17624298.45	5050367.65	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.0	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-33.6
395	17624298.45	5050367.65	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.0	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-20.9
395	17624298.45	5050367.65	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.0	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-0.8
395	17624298.45	5050367.65	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.0	0.3	5.1	0.0	0.0	0.0	0.0	0.0	2.0
395	17624298.45	5050367.65	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.0	0.5	1.0	0.0	0.0	3.9	0.0	0.0	1.4
395	17624298.45	5050367.65	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.0	0.9	-0.6	0.0	0.0	5.6	0.0	0.0	4.9
395	17624298.45	5050367.65	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.0	2.4	-0.7	0.0	0.0	6.0	0.0	0.0	4.5
395	17624298.45	5050367.65	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.0	8.3	-0.7	0.0	0.0	6.4	0.0	0.0	-6.2
395	17624298.45	5050367.65	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.0	29.5	-0.7	0.0	0.0	7.1	0.0	0.0	-39.6

Point Source, ISO 9613, Name: "PCS 5", ID: "PCS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
397	17624288.51	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-33.6
397	17624288.51	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-20.9
397	17624288.51	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.1	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-0.8
397	17624288.51	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.1	0.3	5.1	0.0	0.0	0.0	0.0	0.0	2.0
397	17624288.51	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.1	0.5	1.0	0.0	0.0	3.8	0.0	0.0	1.4
397	17624288.51	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	5.5	0.0	0.0	5.0
397	17624288.51	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.1	2.5	-0.7	0.0	0.0	5.7	0.0	0.0	4.7
397	17624288.51	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.1	8.3	-0.7	0.0	0.0	6.0	0.0	0.0	-5.9
397	17624288.51	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.1	29.7	-0.7	0.0	0.0	6.4	0.0	0.0	-39.0

Point Source, ISO 9613, Name: "PCS 1", ID: "PCS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
399	17624280.88	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-33.7
399	17624280.88	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-20.9
399	17624280.88	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.1	0.1	3.0	0.0	0.0	1.7	0.0	0.0	-0.9
399	17624280.88	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.1	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.9
399	17624280.88	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.1	0.5	1.0	0.0	0.0	3.8	0.0	0.0	1.4
399	17624280.88	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	5.5	0.0	0.0	5.0
399	17624280.88	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.1	2.5	-0.7	0.0	0.0	5.6	0.0	0.0	4.8
399	17624280.88	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.1	8.4	-0.7	0.0	0.0	5.7	0.0	0.0	-5.7
399	17624280.88	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.1	29.9	-0.7	0.0	0.0	5.9	0.0	0.0	-38.8

Point Source, ISO 9613, Name: "PCS 9", ID: "PCS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
401	17624299.21	5050362.68	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.2	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-33.7
401	17624299.21	5050362.68	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.2	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-21.0
401	17624299.21	5050362.68	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.2	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-1.0
401	17624299.21	5050362.68	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.2	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.9
401	17624299.21	5050362.68	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.2	0.5	1.0	0.0	0.0	3.9	0.0	0.0	1.2
401	17624299.21	5050362.68	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.2	0.9	-0.6	0.0	0.0	5.8	0.0	0.0	4.6
401	17624299.21	5050362.68	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.2	2.5	-0.7	0.0	0.0	6.2	0.0	0.0	4.1
401	17624299.21	5050362.68	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.2	8.4	-0.7	0.0	0.0	6.8	0.0	0.0	-6.9
401	17624299.21	5050362.68	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.2	30.1	-0.7	0.0	0.0	7.7	0.0	0.0	-40.9

Point Source, ISO 9613, Name: "PCS 6", ID: "PCS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
403	17624289.16	5050362.78	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.3	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-33.8
403	17624289.16	5050362.78	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.3	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-21.1
403	17624289.16	5050362.78	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.3	0.1	3.0	0.0	0.0	1.7	0.0	0.0	-1.0
403	17624289.16	5050362.78	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.3	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.8
403	17624289.16	5050362.78	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.3	0.5	1.0	0.0	0.0	3.8	0.0	0.0	1.2
403	17624289.16	5050362.78	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.3	0.9	-0.6	0.0	0.0	5.6	0.0	0.0	4.7
403	17624289.16	5050362.78	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.3	2.5	-0.7	0.0	0.0	5.9	0.0	0.0	4.3
403	17624289.16	5050362.78	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.3	8.5	-0.7	0.0	0.0	6.2	0.0	0.0	-6.5
403	17624289.16	5050362.78	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.3	30.2	-0.7	0.0	0.0	6.9	0.0	0.0	-40.2

Point Source, ISO 9613, Name: "PCS 2", ID: "PCS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
405	17624281.69	5050362.69	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.3	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-33.8
405	17624281.69	5050362.69	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.3	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-21.1
405	17624281.69	5050362.69	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.3	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-1.1
405	17624281.69	5050362.69	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.3	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.8
405	17624281.69	5050362.69	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.3	0.5	1.0	0.0	0.0	3.8	0.0	0.0	1.2
405	17624281.69	5050362.69	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.3	1.0	-0.6	0.0	0.0	5.5	0.0	0.0	4.7
405	17624281.69	5050362.69	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.3	2.5	-0.7	0.0	0.0	5.7	0.0	0.0	4.4
405	17624281.69	5050362.69	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.3	8.5	-0.7	0.0	0.0	5.9	0.0	0.0	-6.2
405	17624281.69	5050362.69	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.3	30.4	-0.7	0.0	0.0	6.3	0.0	0.0	-39.9

Point Source, ISO 9613, Name: "PCS 12", ID: "PCS12"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
412	17624270.58	5050364.97	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.3	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-33.8
412	17624270.58	5050364.97	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.3	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-21.1
412	17624270.58	5050364.97	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.3	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-1.0
412	17624270.58	5050364.97	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.3	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.8
412	17624270.58	5050364.97	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.3	0.5	1.0	0.0	0.0	3.8	0.0	0.0	1.3
412	17624270.58	5050364.97	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.3	1.0	-0.6	0.0	0.0	5.4	0.0	0.0	4.8
412	17624270.58	5050364.97	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.3	2.5	-0.7	0.0	0.0	5.6	0.0	0.0	4.6
412	17624270.58	5050364.97	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.3	8.5	-0.7	0.0	0.0	5.6	0.0	0.0	-5.9
412	17624270.58	5050364.97	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.3	30.4	-0.7	0.0	0.0	5.7	0.0	0.0	-39.3

Point Source, ISO 9613, Name: "PCS 13", ID: "PCS13"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
414	17624270.54	5050363.56	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.4	0.0	-3.8	0.0	0.0	8.5	0.0	0.0	-33.9
414	17624270.54	5050363.56	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.4	0.0	-3.8	0.0	0.0	8.5	0.0	0.0	-21.2
414	17624270.54	5050363.56	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.4	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-1.1
414	17624270.54	5050363.56	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.4	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.7
414	17624270.54	5050363.56	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.4	0.5	1.0	0.0	0.0	3.8	0.0	0.0	1.2
414	17624270.54	5050363.56	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.4	1.0	-0.6	0.0	0.0	5.4	0.0	0.0	4.8
414	17624270.54	5050363.56	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.4	2.5	-0.8	0.0	0.0	5.6	0.0	0.0	4.5
414	17624270.54	5050363.56	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.4	8.6	-0.8	0.0	0.0	5.6	0.0	0.0	-6.0
414	17624270.54	5050363.56	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.4	30.6	-0.8	0.0	0.0	5.7	0.0	0.0	-39.5

Point Source, ISO 9613, Name: "PCS 14", ID: "PCS14"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
416	17624270.56	5050362.20	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.4	0.0	-3.8	0.0	0.0	8.5	0.0	0.0	-33.9
416	17624270.56	5050362.20	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.4	0.0	-3.8	0.0	0.0	8.5	0.0	0.0	-21.2
416	17624270.56	5050362.20	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.4	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-1.1
416	17624270.56	5050362.20	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.4	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.7
416	17624270.56	5050362.20	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.4	0.5	1.0	0.0	0.0	3.8	0.0	0.0	1.2
416	17624270.56	5050362.20	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.4	1.0	-0.6	0.0	0.0	5.5	0.0	0.0	4.7
416	17624270.56	5050362.20	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.4	2.5	-0.8	0.0	0.0	5.6	0.0	0.0	4.5
416	17624270.56	5050362.20	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.4	8.6	-0.8	0.0	0.0	5.7	0.0	0.0	-6.1
416	17624270.56	5050362.20	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.4	30.7	-0.8	0.0	0.0	5.8	0.0	0.0	-39.8

Point Source, ISO 9613, Name: "HVAC Condenser 7", ID: "HVAC_condenser7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
417	17624300.76	5050378.47	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	58.7	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-28.1
417	17624300.76	5050378.47	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	58.7	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-7.3
417	17624300.76	5050378.47	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	58.7	0.1	4.1	0.0	0.0	0.0	0.0	0.0	-1.5
417	17624300.76	5050378.47	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	58.7	0.3	2.1	0.0	0.0	0.0	0.0	0.0	6.6
417	17624300.76	5050378.47	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	58.7	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	11.0
417	17624300.76	5050378.47	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	58.7	0.9	-0.6	0.0	0.0	0.0	0.0	0.0	8.0
417	17624300.76	5050378.47	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	58.7	2.3	-0.6	0.0	0.0	0.0	0.0	0.0	3.7
417	17624300.76	5050378.47	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	58.7	7.9	-0.6	0.0	0.0	0.0	0.0	0.0	-10.1
417	17624300.76	5050378.47	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	58.7	28.2	-0.6	0.0	0.0	0.0	0.0	0.0	-38.7

Point Source, ISO 9613, Name: "HVAC Condenser 3", ID: "HVAC_condenser3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
418	17624293.15	5050378.41	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	58.7	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-28.1
418	17624293.15	5050378.41	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	58.7	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-7.3
418	17624293.15	5050378.41	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	58.7	0.1	4.1	0.0	0.0	0.0	0.0	0.0	-1.5
418	17624293.15	5050378.41	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	58.7	0.3	2.1	0.0	0.0	0.0	0.0	0.0	6.6
418	17624293.15	5050378.41	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	58.7	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	11.0
418	17624293.15	5050378.41	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	58.7	0.9	-0.6	0.0	0.0	0.0	0.0	0.0	7.9
418	17624293.15	5050378.41	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	58.7	2.3	-0.6	0.0	0.0	0.0	0.0	0.0	3.7
418	17624293.15	5050378.41	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	58.7	8.0	-0.6	0.0	0.0	0.0	0.0	0.0	-10.1
418	17624293.15	5050378.41	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	58.7	28.4	-0.6	0.0	0.0	0.0	0.0	0.0	-38.9

Point Source, ISO 9613, Name: "HVAC Condenser 4", ID: "HVAC_condenser4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
419	17624289.10	5050373.50	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	58.9	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-28.3
419	17624289.10	5050373.50	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	58.9	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-7.5
419	17624289.10	5050373.50	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	58.9	0.1	4.1	0.0	0.0	0.0	0.0	0.0	-1.7
419	17624289.10	5050373.50	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	58.9	0.3	2.1	0.0	0.0	0.0	0.0	0.0	6.4
419	17624289.10	5050373.50	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	58.9	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	10.8
419	17624289.10	5050373.50	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	58.9	0.9	-0.6	0.0	0.0	0.0	0.0	0.0	7.7
419	17624289.10	5050373.50	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	58.9	2.4	-0.6	0.0	0.0	0.0	0.0	0.0	3.4
419	17624289.10	5050373.50	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	58.9	8.1	-0.6	0.0	0.0	0.0	0.0	0.0	-10.5
419	17624289.10	5050373.50	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	58.9	29.0	-0.6	0.0	0.0	0.0	0.0	0.0	-39.7

Point Source, ISO 9613, Name: "HVAC Condenser 8", ID: "HVAC_condenser8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
425	17624300.95	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	59.0	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-36.2
425	17624300.95	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	59.0	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-15.4
425	17624300.95	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	59.0	0.1	4.1	0.0	0.0	0.6	0.0	0.0	-2.5
425	17624300.95	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	59.0	0.3	2.1	0.0	0.0	2.6	0.0	0.0	3.6
425	17624300.95	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	59.0	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	5.3
425	17624300.95	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	59.0	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	2.2
425	17624300.95	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	59.0	2.4	-0.6	0.0	0.0	5.4	0.0	0.0	-2.1
425	17624300.95	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	59.0	8.3	-0.6	0.0	0.0	5.4	0.0	0.0	-16.2
425	17624300.95	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	59.0	29.5	-0.6	0.0	0.0	5.4	0.0	0.0	-45.7

Point Source, ISO 9613, Name: "HVAC Condenser 5", ID: "HVAC_condenser5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
426	17624290.96	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	59.1	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-36.2
426	17624290.96	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	59.1	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-15.5
426	17624290.96	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	59.1	0.1	4.1	0.0	0.0	0.6	0.0	0.0	-2.6
426	17624290.96	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	59.1	0.3	2.1	0.0	0.0	2.6	0.0	0.0	3.5
426	17624290.96	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	59.1	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	5.2
426	17624290.96	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	2.1
426	17624290.96	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	59.1	2.5	-0.6	0.0	0.0	5.4	0.0	0.0	-2.2
426	17624290.96	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	59.1	8.3	-0.6	0.0	0.0	5.4	0.0	0.0	-16.3
426	17624290.96	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	59.1	29.7	-0.6	0.0	0.0	5.4	0.0	0.0	-45.9

Point Source, ISO 9613, Name: "HVAC Condenser 1", ID: "HVAC_condenser1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
427	17624283.37	5050367.59	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	59.1	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-28.5
427	17624283.37	5050367.59	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	59.1	0.0	-3.0	0.0	0.0	0.0	0.0	0.0	-7.8
427	17624283.37	5050367.59	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	59.1	0.1	4.1	0.0	0.0	0.0	0.0	0.0	-2.0
427	17624283.37	5050367.59	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	59.1	0.3	2.1	0.0	0.0	0.0	0.0	0.0	6.1
427	17624283.37	5050367.59	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	59.1	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	10.5
427	17624283.37	5050367.59	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	0.0	0.0	0.0	7.4
427	17624283.37	5050367.59	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	59.1	2.5	-0.6	0.0	0.0	0.0	0.0	0.0	3.1
427	17624283.37	5050367.59	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	59.1	8.4	-0.6	0.0	0.0	0.0	0.0	0.0	-11.0
427	17624283.37	5050367.59	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	59.1	29.8	-0.6	0.0	0.0	0.0	0.0	0.0	-40.7

Point Source, ISO 9613, Name: "HVAC Condenser 9", ID: "HVAC_condenser9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
428	17624296.83	5050362.76	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	59.2	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-36.4
428	17624296.83	5050362.76	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	59.2	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-15.6
428	17624296.83	5050362.76	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	59.2	0.1	4.1	0.0	0.0	0.6	0.0	0.0	-2.7
428	17624296.83	5050362.76	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	59.2	0.3	2.1	0.0	0.0	2.6	0.0	0.0	3.4
428	17624296.83	5050362.76	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	59.2	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	5.1
428	17624296.83	5050362.76	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	59.2	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	2.0
428	17624296.83	5050362.76	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	59.2	2.5	-0.6	0.0	0.0	5.4	0.0	0.0	-2.4
428	17624296.83	5050362.76	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	59.2	8.4	-0.6	0.0	0.0	5.4	0.0	0.0	-16.5
428	17624296.83	5050362.76	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	59.2	30.1	-0.6	0.0	0.0	5.4	0.0	0.0	-46.5

Point Source, ISO 9613, Name: "HVAC Condenser 6", ID: "HVAC_condenser6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
429	17624286.79	5050362.77	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	59.3	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-36.4
429	17624286.79	5050362.77	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	59.3	0.0	-3.0	0.0	0.0	7.8	0.0	0.0	-15.7
429	17624286.79	5050362.77	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	59.3	0.1	4.1	0.0	0.0	0.6	0.0	0.0	-2.8
429	17624286.79	5050362.77	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	59.3	0.3	2.1	0.0	0.0	2.7	0.0	0.0	3.3
429	17624286.79	5050362.77	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	59.3	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	5.0
429	17624286.79	5050362.77	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	59.3	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	1.9
429	17624286.79	5050362.77	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	59.3	2.5	-0.6	0.0	0.0	5.4	0.0	0.0	-2.4
429	17624286.79	5050362.77	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	59.3	8.5	-0.6	0.0	0.0	5.4	0.0	0.0	-16.6
429	17624286.79	5050362.77	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	59.3	30.3	-0.6	0.0	0.0	5.4	0.0	0.0	-46.7

Point Source, ISO 9613, Name: "HVAC Condenser 2", ID: "HVAC_condenser2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
430	17624279.21	5050362.61	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	59.3	0.0	-3.1	0.0	0.0	7.8	0.0	0.0	-36.5
430	17624279.21	5050362.61	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	59.3	0.0	-3.1	0.0	0.0	7.8	0.0	0.0	-15.7
430	17624279.21	5050362.61	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	59.3	0.1	4.1	0.0	0.0	0.6	0.0	0.0	-2.8
430	17624279.21	5050362.61	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	59.3	0.3	2.1	0.0	0.0	2.7	0.0	0.0	3.3
430	17624279.21	5050362.61	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	59.3	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	4.9
430	17624279.21	5050362.61	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	59.3	1.0	-0.6	0.0	0.0	5.4	0.0	0.0	1.8
430	17624279.21	5050362.61	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	59.3	2.5	-0.6	0.0	0.0	5.4	0.0	0.0	-2.5
430	17624279.21	5050362.61	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	59.3	8.5	-0.6	0.0	0.0	5.4	0.0	0.0	-16.7
430	17624279.21	5050362.61	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	59.3	30.5	-0.6	0.0	0.0	5.4	0.0	0.0	-47.0

Point Source, ISO 9613, Name: "UPS 7", ID: "UPS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
431	17624296.42	5050378.45	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	58.7	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-37.9
431	17624296.42	5050378.45	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	58.7	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-25.2
431	17624296.42	5050378.45	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	58.7	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-5.1
431	17624296.42	5050378.45	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	58.7	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-2.3
431	17624296.42	5050378.45	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	58.7	0.5	1.1	0.0	0.0	3.7	0.0	0.0	-2.8
431	17624296.42	5050378.45	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	58.7	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	0.8
431	17624296.42	5050378.45	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	58.7	2.3	-0.7	0.0	0.0	5.6	0.0	0.0	0.6
431	17624296.42	5050378.45	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	58.7	7.9	-0.7	0.0	0.0	5.7	0.0	0.0	-9.5
431	17624296.42	5050378.45	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	58.7	28.3	-0.7	0.0	0.0	5.9	0.0	0.0	-41.5

Point Source, ISO 9613, Name: "UPS 3", ID: "UPS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
432	17624288.82	5050378.40	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	58.7	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-37.9
432	17624288.82	5050378.40	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	58.7	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-25.2
432	17624288.82	5050378.40	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	58.7	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-5.2
432	17624288.82	5050378.40	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	58.7	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-2.4
432	17624288.82	5050378.40	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	58.7	0.5	1.0	0.0	0.0	3.7	0.0	0.0	-2.8
432	17624288.82	5050378.40	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	58.7	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	0.8
432	17624288.82	5050378.40	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	58.7	2.4	-0.7	0.0	0.0	5.5	0.0	0.0	0.7
432	17624288.82	5050378.40	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	58.7	8.0	-0.7	0.0	0.0	5.6	0.0	0.0	-9.5
432	17624288.82	5050378.40	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	58.7	28.4	-0.7	0.0	0.0	5.6	0.0	0.0	-41.4

Point Source, ISO 9613, Name: "UPS 4", ID: "UPS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
440	17624293.53	5050373.46	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	58.9	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-38.1
440	17624293.53	5050373.46	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	58.9	0.0	-3.6	0.0	0.0	8.4	0.0	0.0	-25.4
440	17624293.53	5050373.46	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	58.9	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-5.3
440	17624293.53	5050373.46	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	58.9	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-2.5
440	17624293.53	5050373.46	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	58.9	0.5	1.0	0.0	0.0	3.8	0.0	0.0	-3.0
440	17624293.53	5050373.46	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	58.9	0.9	-0.6	0.0	0.0	5.5	0.0	0.0	0.5
440	17624293.53	5050373.46	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	58.9	2.4	-0.7	0.0	0.0	5.7	0.0	0.0	0.3
440	17624293.53	5050373.46	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	58.9	8.1	-0.7	0.0	0.0	5.8	0.0	0.0	-10.0
440	17624293.53	5050373.46	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	58.9	28.9	-0.7	0.0	0.0	6.2	0.0	0.0	-42.6

Point Source, ISO 9613, Name: "UPS 8", ID: "UPS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
442	17624296.53	5050367.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-38.3
442	17624296.53	5050367.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-25.6
442	17624296.53	5050367.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	59.1	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-5.5
442	17624296.53	5050367.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	59.1	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-2.7
442	17624296.53	5050367.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	59.1	0.5	1.0	0.0	0.0	3.8	0.0	0.0	-3.3
442	17624296.53	5050367.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	5.6	0.0	0.0	0.2
442	17624296.53	5050367.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	59.1	2.4	-0.7	0.0	0.0	5.9	0.0	0.0	-0.1
442	17624296.53	5050367.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	59.1	8.3	-0.7	0.0	0.0	6.3	0.0	0.0	-10.8
442	17624296.53	5050367.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	59.1	29.5	-0.7	0.0	0.0	7.0	0.0	0.0	-44.2

Point Source, ISO 9613, Name: "UPS 5", ID: "UPS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
444	17624286.54	5050367.66	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-38.3
444	17624286.54	5050367.66	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	59.1	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-25.6
444	17624286.54	5050367.66	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	59.1	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-5.6
444	17624286.54	5050367.66	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	59.1	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-2.7
444	17624286.54	5050367.66	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	59.1	0.5	1.0	0.0	0.0	3.8	0.0	0.0	-3.3
444	17624286.54	5050367.66	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	59.1	0.9	-0.6	0.0	0.0	5.5	0.0	0.0	0.3
444	17624286.54	5050367.66	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	59.1	2.5	-0.7	0.0	0.0	5.7	0.0	0.0	0.0
444	17624286.54	5050367.66	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	59.1	8.3	-0.7	0.0	0.0	5.9	0.0	0.0	-10.5
444	17624286.54	5050367.66	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	59.1	29.7	-0.7	0.0	0.0	6.2	0.0	0.0	-43.7

Point Source, ISO 9613, Name: "UPS 1", ID: "UPS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
452	17624278.90	5050367.58	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	59.2	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-38.4
452	17624278.90	5050367.58	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	59.2	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-25.7
452	17624278.90	5050367.58	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	59.2	0.1	3.0	0.0	0.0	1.7	0.0	0.0	-5.6
452	17624278.90	5050367.58	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	59.2	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-2.8
452	17624278.90	5050367.58	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	59.2	0.5	1.0	0.0	0.0	3.8	0.0	0.0	-3.3
452	17624278.90	5050367.58	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	59.2	0.9	-0.6	0.0	0.0	5.4	0.0	0.0	0.3
452	17624278.90	5050367.58	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	59.2	2.5	-0.7	0.0	0.0	5.6	0.0	0.0	0.1
452	17624278.90	5050367.58	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	59.2	8.4	-0.7	0.0	0.0	5.7	0.0	0.0	-10.4
452	17624278.90	5050367.58	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	59.2	29.9	-0.7	0.0	0.0	5.8	0.0	0.0	-43.5

Point Source, ISO 9613, Name: "UPS 9", ID: "UPS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
454	17624301.15	5050362.78	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	59.2	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-38.4
454	17624301.15	5050362.78	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	59.2	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-25.7
454	17624301.15	5050362.78	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	59.2	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-5.7
454	17624301.15	5050362.78	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	59.2	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-2.8
454	17624301.15	5050362.78	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	59.2	0.5	1.0	0.0	0.0	3.9	0.0	0.0	-3.5
454	17624301.15	5050362.78	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	59.2	0.9	-0.6	0.0	0.0	5.8	0.0	0.0	-0.1
454	17624301.15	5050362.78	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	59.2	2.5	-0.7	0.0	0.0	6.2	0.0	0.0	-0.6
454	17624301.15	5050362.78	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	59.2	8.4	-0.7	0.0	0.0	6.9	0.0	0.0	-11.7
454	17624301.15	5050362.78	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	59.2	30.0	-0.7	0.0	0.0	7.9	0.0	0.0	-45.7

Point Source, ISO 9613, Name: "UPS 6", ID: "UPS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
458	17624291.19	5050362.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	59.2	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-38.5
458	17624291.19	5050362.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	59.2	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-25.8
458	17624291.19	5050362.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	59.2	0.1	3.0	0.0	0.0	1.8	0.0	0.0	-5.7
458	17624291.19	5050362.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	59.2	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-2.9
458	17624291.19	5050362.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	59.2	0.5	1.0	0.0	0.0	3.9	0.0	0.0	-3.5
458	17624291.19	5050362.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	59.2	0.9	-0.6	0.0	0.0	5.6	0.0	0.0	-0.0
458	17624291.19	5050362.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	59.2	2.5	-0.7	0.0	0.0	5.9	0.0	0.0	-0.4
458	17624291.19	5050362.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	59.2	8.5	-0.7	0.0	0.0	6.3	0.0	0.0	-11.2
458	17624291.19	5050362.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	59.2	30.2	-0.7	0.0	0.0	7.0	0.0	0.0	-45.1

Point Source, ISO 9613, Name: "UPS 2", ID: "UPS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
459	17624283.74	5050362.73	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	59.3	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-38.5
459	17624283.74	5050362.73	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	59.3	0.0	-3.7	0.0	0.0	8.5	0.0	0.0	-25.8
459	17624283.74	5050362.73	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	59.3	0.1	3.0	0.0	0.0	1.7	0.0	0.0	-5.7
459	17624283.74	5050362.73	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	59.3	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-2.9
459	17624283.74	5050362.73	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	59.3	0.5	1.0	0.0	0.0	3.8	0.0	0.0	-3.5
459	17624283.74	5050362.73	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	59.3	0.9	-0.6	0.0	0.0	5.5	0.0	0.0	0.0
459	17624283.74	5050362.73	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	59.3	2.5	-0.7	0.0	0.0	5.8	0.0	0.0	-0.3
459	17624283.74	5050362.73	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	59.3	8.5	-0.7	0.0	0.0	6.0	0.0	0.0	-11.0
459	17624283.74	5050362.73	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	59.3	30.3	-0.7	0.0	0.0	6.5	0.0	0.0	-44.7

Receiver

Name: POR7

ID: POR7

X: 17624382.52 m

Y: 5050630.50 m

Z: 325.12 m

Point Source, ISO 9613, Name: "Transformer 4MW", ID: "transformer_4MW"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
286	17624270.19	5050367.48	342.00	0	DEN	32	41.6	0.0	0.0	0.0	0.0	60.1	0.0	-4.0	0.0	0.0	8.7	0.0	0.0	-23.3
286	17624270.19	5050367.48	342.00	0	DEN	63	62.8	0.0	0.0	0.0	0.0	60.1	0.0	-4.0	0.0	0.0	8.7	0.0	0.0	-2.2
286	17624270.19	5050367.48	342.00	0	DEN	125	76.9	0.0	0.0	0.0	0.0	60.1	0.1	3.1	0.0	0.0	1.6	0.0	0.0	11.9
286	17624270.19	5050367.48	342.00	0	DEN	250	68.4	0.0	0.0	0.0	0.0	60.1	0.3	5.1	0.0	0.0	0.0	0.0	0.0	2.8
286	17624270.19	5050367.48	342.00	0	DEN	500	69.8	0.0	0.0	0.0	0.0	60.1	0.6	1.0	0.0	0.0	3.8	0.0	0.0	4.3
286	17624270.19	5050367.48	342.00	0	DEN	1000	71.0	0.0	0.0	0.0	0.0	60.1	1.0	-0.7	0.0	0.0	5.5	0.0	0.0	5.0
286	17624270.19	5050367.48	342.00	0	DEN	2000	69.2	0.0	0.0	0.0	0.0	60.1	2.8	-0.8	0.0	0.0	5.6	0.0	0.0	1.5
286	17624270.19	5050367.48	342.00	0	DEN	4000	71.0	0.0	0.0	0.0	0.0	60.1	9.4	-0.8	0.0	0.0	5.7	0.0	0.0	-3.4
286	17624270.19	5050367.48	342.00	0	DEN	8000	51.9	0.0	0.0	0.0	0.0	60.1	33.5	-0.8	0.0	0.0	5.8	0.0	0.0	-46.7

Point Source, ISO 9613, Name: "HVAC Economizer Hood 7", ID: "HVAC_hood7"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
288	17624301.74	5050377.18	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	59.5	0.0	-3.1	0.0	0.0	7.9	0.0	0.0	-32.0
288	17624301.74	5050377.18	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	59.5	0.0	-3.1	0.0	0.0	7.9	0.0	0.0	-11.2
288	17624301.74	5050377.18	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	59.5	0.1	4.1	0.0	0.0	0.6	0.0	0.0	1.7
288	17624301.74	5050377.18	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	59.5	0.3	2.1	0.0	0.0	2.7	0.0	0.0	7.8
288	17624301.74	5050377.18	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	59.5	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	9.4
288	17624301.74	5050377.18	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	59.5	1.0	-0.6	0.0	0.0	5.4	0.0	0.0	6.3
288	17624301.74	5050377.18	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	59.5	2.6	-0.6	0.0	0.0	5.4	0.0	0.0	2.0
288	17624301.74	5050377.18	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	59.5	8.7	-0.6	0.0	0.0	5.4	0.0	0.0	-12.4
288	17624301.74	5050377.18	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	59.5	31.2	-0.6	0.0	0.0	5.4	0.0	0.0	-43.1

Point Source, ISO 9613, Name: "HVAC Economizer Hood 3", ID: "HVAC_hood3"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
292	17624294.15	5050377.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	59.6	0.0	-3.1	0.0	0.0	7.9	0.0	0.0	-32.1
292	17624294.15	5050377.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	59.6	0.0	-3.1	0.0	0.0	7.9	0.0	0.0	-11.3
292	17624294.15	5050377.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	59.6	0.1	4.1	0.0	0.0	0.6	0.0	0.0	1.6
292	17624294.15	5050377.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	59.6	0.3	2.1	0.0	0.0	2.7	0.0	0.0	7.7
292	17624294.15	5050377.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	59.6	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	9.4
292	17624294.15	5050377.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	59.6	1.0	-0.6	0.0	0.0	5.4	0.0	0.0	6.2
292	17624294.15	5050377.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	59.6	2.6	-0.6	0.0	0.0	5.4	0.0	0.0	1.9
292	17624294.15	5050377.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	59.6	8.8	-0.6	0.0	0.0	5.4	0.0	0.0	-12.6
292	17624294.15	5050377.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	59.6	31.4	-0.6	0.0	0.0	5.4	0.0	0.0	-43.5

Point Source, ISO 9613, Name: "HVAC Economizer Hood 4", ID: "HVAC_hood4"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
298	17624288.27	5050374.68	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	59.7	0.0	-3.2	0.0	0.0	8.0	0.0	0.0	-32.2
298	17624288.27	5050374.68	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	59.7	0.0	-3.2	0.0	0.0	8.0	0.0	0.0	-11.4
298	17624288.27	5050374.68	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	59.7	0.1	4.1	0.0	0.0	0.6	0.0	0.0	1.5
298	17624288.27	5050374.68	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	59.7	0.3	2.1	0.0	0.0	2.7	0.0	0.0	7.6
298	17624288.27	5050374.68	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	59.7	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	9.2
298	17624288.27	5050374.68	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	59.7	1.0	-0.6	0.0	0.0	5.4	0.0	0.0	6.1
298	17624288.27	5050374.68	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	59.7	2.6	-0.6	0.0	0.0	5.4	0.0	0.0	1.7
298	17624288.27	5050374.68	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	59.7	9.0	-0.6	0.0	0.0	5.4	0.0	0.0	-12.8
298	17624288.27	5050374.68	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	59.7	31.9	-0.6	0.0	0.0	5.4	0.0	0.0	-44.1

Point Source, ISO 9613, Name: "HVAC Economizer Hood 8", ID: "HVAC_hood8"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
300	17624301.95	5050366.49	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	59.8	0.0	-3.2	0.0	0.0	8.0	0.0	0.0	-32.3

Point Source, ISO 9613, Name: "HVAC Economizer Hood 8", ID: "HVAC_hood8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
300	17624301.95	5050366.49	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	59.8	0.0	-3.2	0.0	0.0	8.0	0.0	0.0	-11.6
300	17624301.95	5050366.49	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	59.8	0.1	4.1	0.0	0.0	0.6	0.0	0.0	1.4
300	17624301.95	5050366.49	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	59.8	0.3	2.1	0.0	0.0	2.7	0.0	0.0	7.4
300	17624301.95	5050366.49	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	59.8	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	9.1
300	17624301.95	5050366.49	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	59.8	1.0	-0.6	0.0	0.0	5.5	0.0	0.0	5.9
300	17624301.95	5050366.49	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	59.8	2.7	-0.6	0.0	0.0	5.5	0.0	0.0	1.5
300	17624301.95	5050366.49	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	59.8	9.1	-0.6	0.0	0.0	5.6	0.0	0.0	-13.2
300	17624301.95	5050366.49	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	59.8	32.3	-0.6	0.0	0.0	5.7	0.0	0.0	-44.9

Point Source, ISO 9613, Name: "HVAC Economizer Hood 5", ID: "HVAC_hood5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
307	17624291.94	5050366.35	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	59.9	0.0	-3.3	0.0	0.0	8.0	0.0	0.0	-32.4
307	17624291.94	5050366.35	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	59.9	0.0	-3.3	0.0	0.0	8.0	0.0	0.0	-11.7
307	17624291.94	5050366.35	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	59.9	0.1	4.1	0.0	0.0	0.6	0.0	0.0	1.3
307	17624291.94	5050366.35	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	59.9	0.3	2.1	0.0	0.0	2.7	0.0	0.0	7.3
307	17624291.94	5050366.35	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	59.9	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	9.0
307	17624291.94	5050366.35	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	59.9	1.0	-0.7	0.0	0.0	5.4	0.0	0.0	5.9
307	17624291.94	5050366.35	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	59.9	2.7	-0.7	0.0	0.0	5.4	0.0	0.0	1.4
307	17624291.94	5050366.35	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	59.9	9.2	-0.7	0.0	0.0	5.4	0.0	0.0	-13.3
307	17624291.94	5050366.35	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	59.9	32.7	-0.7	0.0	0.0	5.4	0.0	0.0	-45.1

Point Source, ISO 9613, Name: "HVAC Economizer Hood 9", ID: "HVAC_hood9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
309	17624295.94	5050364.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	60.0	0.0	-3.3	0.0	0.0	8.0	0.0	0.0	-32.4
309	17624295.94	5050364.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	60.0	0.0	-3.3	0.0	0.0	8.0	0.0	0.0	-11.7
309	17624295.94	5050364.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	60.0	0.1	4.1	0.0	0.0	0.6	0.0	0.0	1.2
309	17624295.94	5050364.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	60.0	0.3	2.1	0.0	0.0	2.7	0.0	0.0	7.3
309	17624295.94	5050364.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	60.0	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	9.0
309	17624295.94	5050364.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	60.0	1.0	-0.7	0.0	0.0	5.4	0.0	0.0	5.8
309	17624295.94	5050364.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	60.0	2.7	-0.7	0.0	0.0	5.4	0.0	0.0	1.4
309	17624295.94	5050364.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	60.0	9.2	-0.7	0.0	0.0	5.4	0.0	0.0	-13.3
309	17624295.94	5050364.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	60.0	32.8	-0.7	0.0	0.0	5.4	0.0	0.0	-45.2

Point Source, ISO 9613, Name: "HVAC Economizer Hood 1", ID: "HVAC_hood1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
322	17624284.42	5050366.44	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	60.0	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-32.5
322	17624284.42	5050366.44	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	60.0	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-11.7
322	17624284.42	5050366.44	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	60.0	0.1	4.1	0.0	0.0	0.6	0.0	0.0	1.2
322	17624284.42	5050366.44	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	60.0	0.3	2.1	0.0	0.0	2.7	0.0	0.0	7.3
322	17624284.42	5050366.44	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	60.0	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	8.9
322	17624284.42	5050366.44	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	60.0	1.0	-0.7	0.0	0.0	5.4	0.0	0.0	5.8
322	17624284.42	5050366.44	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	60.0	2.7	-0.7	0.0	0.0	5.4	0.0	0.0	1.3
322	17624284.42	5050366.44	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	60.0	9.3	-0.7	0.0	0.0	5.4	0.0	0.0	-13.4
322	17624284.42	5050366.44	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	60.0	33.0	-0.7	0.0	0.0	5.4	0.0	0.0	-45.5

Point Source, ISO 9613, Name: "HVAC Economizer Hood 6", ID: "HVAC_hood6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
324	17624285.84	5050363.98	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	60.1	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-32.5
324	17624285.84	5050363.98	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	60.1	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-11.8
324	17624285.84	5050363.98	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	60.1	0.1	4.1	0.0	0.0	0.6	0.0	0.0	1.1
324	17624285.84	5050363.98	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	60.1	0.3	2.1	0.0	0.0	2.7	0.0	0.0	7.2
324	17624285.84	5050363.98	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	60.1	0.5	-0.7	0.0	0.0	5.4	0.0	0.0	8.9
324	17624285.84	5050363.98	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	60.1	1.0	-0.7	0.0	0.0	5.4	0.0	0.0	5.7
324	17624285.84	5050363.98	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	60.1	2.7	-0.7	0.0	0.0	5.4	0.0	0.0	1.2
324	17624285.84	5050363.98	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	60.1	9.3	-0.7	0.0	0.0	5.4	0.0	0.0	-13.5
324	17624285.84	5050363.98	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	60.1	33.2	-0.7	0.0	0.0	5.4	0.0	0.0	-45.7

Point Source, ISO 9613, Name: "HVAC Economizer Hood 2", ID: "HVAC_hood2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
326	17624278.29	5050363.89	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	60.2	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-32.6
326	17624278.29	5050363.89	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	60.2	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-11.9
326	17624278.29	5050363.89	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	60.2	0.1	4.2	0.0	0.0	0.6	0.0	0.0	1.0
326	17624278.29	5050363.89	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	60.2	0.3	2.1	0.0	0.0	2.7	0.0	0.0	7.1
326	17624278.29	5050363.89	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	60.2	0.6	-0.7	0.0	0.0	5.4	0.0	0.0	8.8
326	17624278.29	5050363.89	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	60.2	1.0	-0.7	0.0	0.0	5.4	0.0	0.0	5.6
326	17624278.29	5050363.89	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	60.2	2.8	-0.7	0.0	0.0	5.4	0.0	0.0	1.1
326	17624278.29	5050363.89	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	60.2	9.4	-0.7	0.0	0.0	5.4	0.0	0.0	-13.7
326	17624278.29	5050363.89	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	60.2	33.5	-0.7	0.0	0.0	5.4	0.0	0.0	-46.1

Point Source, ISO 9613, Name: "Transformer 2MW", ID: "transformer_2MW"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
328	17624280.40	5050378.87	342.00	0	DEN	32	38.6	0.0	0.0	0.0	0.0	59.7	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-25.9
328	17624280.40	5050378.87	342.00	0	DEN	63	59.8	0.0	0.0	0.0	0.0	59.7	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-4.7
328	17624280.40	5050378.87	342.00	0	DEN	125	73.9	0.0	0.0	0.0	0.0	59.7	0.1	3.1	0.0	0.0	1.7	0.0	0.0	9.3
328	17624280.40	5050378.87	342.00	0	DEN	250	65.4	0.0	0.0	0.0	0.0	59.7	0.3	5.1	0.0	0.0	0.0	0.0	0.0	0.3
328	17624280.40	5050378.87	342.00	0	DEN	500	66.8	0.0	0.0	0.0	0.0	59.7	0.5	1.0	0.0	0.0	3.8	0.0	0.0	1.8
328	17624280.40	5050378.87	342.00	0	DEN	1000	68.0	0.0	0.0	0.0	0.0	59.7	1.0	-0.7	0.0	0.0	5.4	0.0	0.0	2.5
328	17624280.40	5050378.87	342.00	0	DEN	2000	66.2	0.0	0.0	0.0	0.0	59.7	2.6	-0.8	0.0	0.0	5.5	0.0	0.0	-0.9
328	17624280.40	5050378.87	342.00	0	DEN	4000	68.0	0.0	0.0	0.0	0.0	59.7	8.9	-0.8	0.0	0.0	5.6	0.0	0.0	-5.4
328	17624280.40	5050378.87	342.00	0	DEN	8000	48.9	0.0	0.0	0.0	0.0	59.7	31.8	-0.8	0.0	0.0	5.6	0.0	0.0	-47.4

Point Source, ISO 9613, Name: "PCS 7", ID: "PCS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
334	17624298.22	5050378.41	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.5	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-34.0
334	17624298.22	5050378.41	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.5	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-21.3
334	17624298.22	5050378.41	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.5	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-1.3
334	17624298.22	5050378.41	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.5	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.6
334	17624298.22	5050378.41	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.5	0.5	1.0	0.0	0.0	3.9	0.0	0.0	0.9
334	17624298.22	5050378.41	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.5	1.0	-0.7	0.0	0.0	5.7	0.0	0.0	4.3
334	17624298.22	5050378.41	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.5	2.6	-0.8	0.0	0.0	6.1	0.0	0.0	3.8
334	17624298.22	5050378.41	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.5	8.7	-0.8	0.0	0.0	6.7	0.0	0.0	-7.4
334	17624298.22	5050378.41	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.5	31.1	-0.8	0.0	0.0	7.6	0.0	0.0	-42.1

Point Source, ISO 9613, Name: "PCS 3", ID: "PCS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
351	17624290.73	5050378.40	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.6	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-34.1
351	17624290.73	5050378.40	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.6	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-21.4
351	17624290.73	5050378.40	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.6	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-1.3
351	17624290.73	5050378.40	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.6	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.5
351	17624290.73	5050378.40	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.6	0.5	1.0	0.0	0.0	3.8	0.0	0.0	0.9
351	17624290.73	5050378.40	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.6	1.0	-0.7	0.0	0.0	5.5	0.0	0.0	4.4
351	17624290.73	5050378.40	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.6	2.6	-0.8	0.0	0.0	5.7	0.0	0.0	4.1
351	17624290.73	5050378.40	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.6	8.8	-0.8	0.0	0.0	5.9	0.0	0.0	-6.7
351	17624290.73	5050378.40	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.6	31.4	-0.8	0.0	0.0	6.2	0.0	0.0	-41.1

Point Source, ISO 9613, Name: "PCS 4", ID: "PCS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
356	17624291.60	5050373.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.7	0.0	-3.9	0.0	0.0	8.6	0.0	0.0	-34.2
356	17624291.60	5050373.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.7	0.0	-3.9	0.0	0.0	8.6	0.0	0.0	-21.5
356	17624291.60	5050373.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.7	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-1.5
356	17624291.60	5050373.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.7	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.3
356	17624291.60	5050373.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.7	0.5	1.0	0.0	0.0	3.9	0.0	0.0	0.7
356	17624291.60	5050373.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.7	1.0	-0.7	0.0	0.0	5.7	0.0	0.0	4.1
356	17624291.60	5050373.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.7	2.6	-0.8	0.0	0.0	6.0	0.0	0.0	3.6
356	17624291.60	5050373.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.7	9.0	-0.8	0.0	0.0	6.5	0.0	0.0	-7.6
356	17624291.60	5050373.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.7	31.9	-0.8	0.0	0.0	7.2	0.0	0.0	-42.7

Point Source, ISO 9613, Name: "PCS 10", ID: "PCS10"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
358	17624280.69	5050376.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.8	0.0	-3.9	0.0	0.0	8.6	0.0	0.0	-34.3
358	17624280.69	5050376.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.8	0.0	-3.9	0.0	0.0	8.6	0.0	0.0	-21.6
358	17624280.69	5050376.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.8	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-1.5
358	17624280.69	5050376.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.8	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.3
358	17624280.69	5050376.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.8	0.5	1.0	0.0	0.0	3.8	0.0	0.0	0.8
358	17624280.69	5050376.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.8	1.0	-0.7	0.0	0.0	5.4	0.0	0.0	4.3
358	17624280.69	5050376.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.8	2.6	-0.8	0.0	0.0	5.6	0.0	0.0	4.0
358	17624280.69	5050376.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.8	9.0	-0.8	0.0	0.0	5.6	0.0	0.0	-6.8
358	17624280.69	5050376.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.8	32.0	-0.8	0.0	0.0	5.6	0.0	0.0	-41.3

Point Source, ISO 9613, Name: "PCS 11", ID: "PCS11"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
360	17624280.74	5050375.25	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.8	0.0	-3.9	0.0	0.0	8.6	0.0	0.0	-34.3
360	17624280.74	5050375.25	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.8	0.0	-3.9	0.0	0.0	8.6	0.0	0.0	-21.6
360	17624280.74	5050375.25	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.8	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-1.5
360	17624280.74	5050375.25	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.8	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.3
360	17624280.74	5050375.25	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.8	0.5	1.0	0.0	0.0	3.8	0.0	0.0	0.7
360	17624280.74	5050375.25	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.8	1.0	-0.7	0.0	0.0	5.5	0.0	0.0	4.3
360	17624280.74	5050375.25	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.8	2.7	-0.8	0.0	0.0	5.6	0.0	0.0	4.0
360	17624280.74	5050375.25	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.8	9.0	-0.8	0.0	0.0	5.6	0.0	0.0	-6.9
360	17624280.74	5050375.25	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.8	32.2	-0.8	0.0	0.0	5.7	0.0	0.0	-41.6

Point Source, ISO 9613, Name: "PCS 8", ID: "PCS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
362	17624298.45	5050367.65	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.8	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-34.4
362	17624298.45	5050367.65	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.8	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-21.7
362	17624298.45	5050367.65	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.8	0.1	3.1	0.0	0.0	1.8	0.0	0.0	-1.7
362	17624298.45	5050367.65	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.8	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.2
362	17624298.45	5050367.65	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.8	0.5	1.0	0.0	0.0	4.2	0.0	0.0	0.3
362	17624298.45	5050367.65	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.8	1.0	-0.7	0.0	0.0	6.3	0.0	0.0	3.4
362	17624298.45	5050367.65	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.8	2.7	-0.8	0.0	0.0	7.1	0.0	0.0	2.4
362	17624298.45	5050367.65	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.8	9.1	-0.8	0.0	0.0	8.3	0.0	0.0	-9.6
362	17624298.45	5050367.65	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.8	32.3	-0.8	0.0	0.0	9.9	0.0	0.0	-46.0

Point Source, ISO 9613, Name: "PCS 5", ID: "PCS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
371	17624288.51	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.9	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-34.4
371	17624288.51	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.9	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-21.8
371	17624288.51	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.9	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-1.7
371	17624288.51	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.9	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.1
371	17624288.51	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.9	0.5	1.0	0.0	0.0	4.0	0.0	0.0	0.4
371	17624288.51	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.9	1.0	-0.7	0.0	0.0	5.8	0.0	0.0	3.8
371	17624288.51	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.9	2.7	-0.8	0.0	0.0	6.2	0.0	0.0	3.2
371	17624288.51	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.9	9.2	-0.8	0.0	0.0	6.8	0.0	0.0	-8.3
371	17624288.51	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.9	32.7	-0.8	0.0	0.0	7.8	0.0	0.0	-44.2

Point Source, ISO 9613, Name: "PCS 9", ID: "PCS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
378	17624299.21	5050362.68	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.0	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-34.5
378	17624299.21	5050362.68	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.0	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-21.8
378	17624299.21	5050362.68	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.0	0.1	3.1	0.0	0.0	1.8	0.0	0.0	-1.9
378	17624299.21	5050362.68	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.0	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.1
378	17624299.21	5050362.68	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.0	0.5	1.0	0.0	0.0	4.4	0.0	0.0	-0.1
378	17624299.21	5050362.68	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.0	1.0	-0.7	0.0	0.0	6.6	0.0	0.0	2.9
378	17624299.21	5050362.68	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.0	2.7	-0.8	0.0	0.0	7.7	0.0	0.0	1.6
378	17624299.21	5050362.68	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.0	9.2	-0.8	0.0	0.0	9.1	0.0	0.0	-10.8
378	17624299.21	5050362.68	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.0	32.8	-0.8	0.0	0.0	11.1	0.0	0.0	-47.7

Point Source, ISO 9613, Name: "PCS 1", ID: "PCS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
406	17624280.88	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.0	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-34.5
406	17624280.88	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.0	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-21.8
406	17624280.88	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.0	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-1.8
406	17624280.88	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.0	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.0
406	17624280.88	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.0	0.5	1.0	0.0	0.0	3.9	0.0	0.0	0.4
406	17624280.88	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.0	1.0	-0.7	0.0	0.0	5.6	0.0	0.0	3.9
406	17624280.88	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.0	2.7	-0.8	0.0	0.0	5.8	0.0	0.0	3.4
406	17624280.88	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.0	9.3	-0.8	0.0	0.0	6.1	0.0	0.0	-7.8
406	17624280.88	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.0	33.0	-0.8	0.0	0.0	6.6	0.0	0.0	-43.5

Point Source, ISO 9613, Name: "PCS 6", ID: "PCS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
433	17624289.16	5050362.78	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.1	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-34.6
433	17624289.16	5050362.78	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.1	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-21.9
433	17624289.16	5050362.78	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.1	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-1.9
433	17624289.16	5050362.78	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.1	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.0
433	17624289.16	5050362.78	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.1	0.5	1.0	0.0	0.0	4.1	0.0	0.0	0.2
433	17624289.16	5050362.78	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.1	1.0	-0.7	0.0	0.0	6.0	0.0	0.0	3.4
433	17624289.16	5050362.78	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.1	2.7	-0.8	0.0	0.0	6.6	0.0	0.0	2.6
433	17624289.16	5050362.78	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.1	9.3	-0.8	0.0	0.0	7.5	0.0	0.0	-9.3
433	17624289.16	5050362.78	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.1	33.2	-0.8	0.0	0.0	8.8	0.0	0.0	-45.9

Point Source, ISO 9613, Name: "PCS 2", ID: "PCS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
435	17624281.69	5050362.69	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.1	0.0	-4.0	0.0	0.0	8.7	0.0	0.0	-34.7
435	17624281.69	5050362.69	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.1	0.0	-4.0	0.0	0.0	8.7	0.0	0.0	-22.0
435	17624281.69	5050362.69	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.1	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-1.9
435	17624281.69	5050362.69	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.1	0.3	5.1	0.0	0.0	0.0	0.0	0.0	0.9
435	17624281.69	5050362.69	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.1	0.6	1.0	0.0	0.0	3.9	0.0	0.0	0.2
435	17624281.69	5050362.69	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.1	1.0	-0.7	0.0	0.0	5.8	0.0	0.0	3.6
435	17624281.69	5050362.69	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.1	2.8	-0.8	0.0	0.0	6.1	0.0	0.0	3.0
435	17624281.69	5050362.69	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.1	9.4	-0.8	0.0	0.0	6.6	0.0	0.0	-8.6
435	17624281.69	5050362.69	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.1	33.5	-0.8	0.0	0.0	7.5	0.0	0.0	-45.0

Point Source, ISO 9613, Name: "PCS 12", ID: "PCS12"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
445	17624270.58	5050364.97	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.2	0.0	-4.0	0.0	0.0	8.7	0.0	0.0	-34.7
445	17624270.58	5050364.97	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.2	0.0	-4.0	0.0	0.0	8.7	0.0	0.0	-22.0
445	17624270.58	5050364.97	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.2	0.1	3.2	0.0	0.0	1.6	0.0	0.0	-2.0
445	17624270.58	5050364.97	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.2	0.3	5.1	0.0	0.0	0.0	0.0	0.0	0.9
445	17624270.58	5050364.97	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.2	0.6	1.0	0.0	0.0	3.8	0.0	0.0	0.3
445	17624270.58	5050364.97	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.2	1.1	-0.7	0.0	0.0	5.5	0.0	0.0	3.8
445	17624270.58	5050364.97	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.2	2.8	-0.8	0.0	0.0	5.7	0.0	0.0	3.4
445	17624270.58	5050364.97	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.2	9.5	-0.8	0.0	0.0	5.8	0.0	0.0	-7.9
445	17624270.58	5050364.97	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.2	33.7	-0.8	0.0	0.0	6.0	0.0	0.0	-43.8

Point Source, ISO 9613, Name: "PCS 13", ID: "PCS13"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
448	17624270.54	5050363.56	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.2	0.0	-4.0	0.0	0.0	8.8	0.0	0.0	-34.8
448	17624270.54	5050363.56	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.2	0.0	-4.0	0.0	0.0	8.8	0.0	0.0	-22.1
448	17624270.54	5050363.56	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.2	0.1	3.2	0.0	0.0	1.6	0.0	0.0	-2.0
448	17624270.54	5050363.56	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.2	0.3	5.1	0.0	0.0	0.0	0.0	0.0	0.8
448	17624270.54	5050363.56	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.2	0.6	1.0	0.0	0.0	3.8	0.0	0.0	0.2
448	17624270.54	5050363.56	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.2	1.1	-0.7	0.0	0.0	5.5	0.0	0.0	3.7
448	17624270.54	5050363.56	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.2	2.8	-0.8	0.0	0.0	5.7	0.0	0.0	3.3
448	17624270.54	5050363.56	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.2	9.5	-0.8	0.0	0.0	5.8	0.0	0.0	-8.0
448	17624270.54	5050363.56	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.2	33.9	-0.8	0.0	0.0	6.1	0.0	0.0	-44.1

Point Source, ISO 9613, Name: "PCS 14", ID: "PCS14"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
451	17624270.56	5050362.20	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.3	0.0	-4.0	0.0	0.0	8.8	0.0	0.0	-34.8
451	17624270.56	5050362.20	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.3	0.0	-4.0	0.0	0.0	8.8	0.0	0.0	-22.1
451	17624270.56	5050362.20	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.3	0.1	3.2	0.0	0.0	1.6	0.0	0.0	-2.0
451	17624270.56	5050362.20	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.3	0.3	5.1	0.0	0.0	0.0	0.0	0.0	0.8
451	17624270.56	5050362.20	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.3	0.6	1.0	0.0	0.0	3.8	0.0	0.0	0.2
451	17624270.56	5050362.20	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.3	1.1	-0.7	0.0	0.0	5.6	0.0	0.0	3.7
451	17624270.56	5050362.20	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.3	2.8	-0.8	0.0	0.0	5.8	0.0	0.0	3.2
451	17624270.56	5050362.20	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.3	9.5	-0.8	0.0	0.0	5.9	0.0	0.0	-8.2
451	17624270.56	5050362.20	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.3	34.0	-0.8	0.0	0.0	6.3	0.0	0.0	-44.4

Point Source, ISO 9613, Name: "HVAC Condenser 7", ID: "HVAC_condenser7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
457	17624300.76	5050378.47	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	59.5	0.0	-3.1	0.0	0.0	7.9	0.0	0.0	-36.6
457	17624300.76	5050378.47	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	59.5	0.0	-3.1	0.0	0.0	7.9	0.0	0.0	-15.9
457	17624300.76	5050378.47	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	59.5	0.1	4.1	0.0	0.0	0.6	0.0	0.0	-3.0
457	17624300.76	5050378.47	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	59.5	0.3	2.1	0.0	0.0	2.7	0.0	0.0	3.1
457	17624300.76	5050378.47	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	59.5	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	4.8
457	17624300.76	5050378.47	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	59.5	1.0	-0.6	0.0	0.0	5.4	0.0	0.0	1.7
457	17624300.76	5050378.47	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	59.5	2.6	-0.6	0.0	0.0	5.4	0.0	0.0	-2.7
457	17624300.76	5050378.47	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	59.5	8.7	-0.6	0.0	0.0	5.4	0.0	0.0	-17.0
457	17624300.76	5050378.47	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	59.5	31.0	-0.6	0.0	0.0	5.4	0.0	0.0	-47.7

Point Source, ISO 9613, Name: "HVAC Condenser 3", ID: "HVAC_condenser3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
466	17624293.15	5050378.41	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	59.6	0.0	-3.1	0.0	0.0	7.9	0.0	0.0	-36.7
466	17624293.15	5050378.41	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	59.6	0.0	-3.1	0.0	0.0	7.9	0.0	0.0	-16.0
466	17624293.15	5050378.41	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	59.6	0.1	4.1	0.0	0.0	0.6	0.0	0.0	-3.1
466	17624293.15	5050378.41	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	59.6	0.3	2.1	0.0	0.0	2.7	0.0	0.0	3.0
466	17624293.15	5050378.41	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	59.6	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	4.7
466	17624293.15	5050378.41	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	59.6	1.0	-0.6	0.0	0.0	5.4	0.0	0.0	1.6
466	17624293.15	5050378.41	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	59.6	2.6	-0.6	0.0	0.0	5.4	0.0	0.0	-2.8
466	17624293.15	5050378.41	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	59.6	8.8	-0.6	0.0	0.0	5.4	0.0	0.0	-17.2
466	17624293.15	5050378.41	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	59.6	31.3	-0.6	0.0	0.0	5.4	0.0	0.0	-48.1

Point Source, ISO 9613, Name: "HVAC Condenser 4", ID: "HVAC_condenser4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
470	17624289.10	5050373.50	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	59.8	0.0	-3.2	0.0	0.0	8.0	0.0	0.0	-36.9
470	17624289.10	5050373.50	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	59.8	0.0	-3.2	0.0	0.0	8.0	0.0	0.0	-16.2
470	17624289.10	5050373.50	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	59.8	0.1	4.1	0.0	0.0	0.6	0.0	0.0	-3.3
470	17624289.10	5050373.50	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	59.8	0.3	2.1	0.0	0.0	2.7	0.0	0.0	2.8
470	17624289.10	5050373.50	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	59.8	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	4.5
470	17624289.10	5050373.50	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	59.8	1.0	-0.6	0.0	0.0	5.4	0.0	0.0	1.4
470	17624289.10	5050373.50	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	59.8	2.6	-0.6	0.0	0.0	5.4	0.0	0.0	-3.1
470	17624289.10	5050373.50	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	59.8	9.0	-0.6	0.0	0.0	5.4	0.0	0.0	-17.6
470	17624289.10	5050373.50	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	59.8	32.0	-0.6	0.0	0.0	5.4	0.0	0.0	-48.9

Point Source, ISO 9613, Name: "HVAC Condenser 8", ID: "HVAC_condenser8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
474	17624300.95	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	59.8	0.0	-3.2	0.0	0.0	8.0	0.0	0.0	-37.0
474	17624300.95	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	59.8	0.0	-3.2	0.0	0.0	8.0	0.0	0.0	-16.2
474	17624300.95	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	59.8	0.1	4.1	0.0	0.0	0.6	0.0	0.0	-3.3
474	17624300.95	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	59.8	0.3	2.1	0.0	0.0	2.7	0.0	0.0	2.8
474	17624300.95	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	59.8	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	4.4
474	17624300.95	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	59.8	1.0	-0.6	0.0	0.0	5.4	0.0	0.0	1.3
474	17624300.95	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	59.8	2.7	-0.6	0.0	0.0	5.4	0.0	0.0	-3.1
474	17624300.95	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	59.8	9.0	-0.6	0.0	0.0	5.4	0.0	0.0	-17.7
474	17624300.95	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	59.8	32.2	-0.6	0.0	0.0	5.4	0.0	0.0	-49.2

Point Source, ISO 9613, Name: "HVAC Condenser 5", ID: "HVAC_condenser5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
477	17624290.96	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	59.9	0.0	-3.3	0.0	0.0	8.0	0.0	0.0	-37.1
477	17624290.96	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	59.9	0.0	-3.3	0.0	0.0	8.0	0.0	0.0	-16.3
477	17624290.96	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	59.9	0.1	4.1	0.0	0.0	0.6	0.0	0.0	-3.4
477	17624290.96	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	59.9	0.3	2.1	0.0	0.0	2.7	0.0	0.0	2.7
477	17624290.96	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	59.9	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	4.3
477	17624290.96	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	59.9	1.0	-0.7	0.0	0.0	5.4	0.0	0.0	1.2
477	17624290.96	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	59.9	2.7	-0.7	0.0	0.0	5.4	0.0	0.0	-3.3
477	17624290.96	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	59.9	9.1	-0.7	0.0	0.0	5.4	0.0	0.0	-17.9
477	17624290.96	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	59.9	32.6	-0.7	0.0	0.0	5.4	0.0	0.0	-49.7

Point Source, ISO 9613, Name: "HVAC Condenser 1", ID: "HVAC_condenser1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
482	17624283.37	5050367.59	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	60.0	0.0	-3.3	0.0	0.0	8.0	0.0	0.0	-37.2
482	17624283.37	5050367.59	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	60.0	0.0	-3.3	0.0	0.0	8.0	0.0	0.0	-16.4
482	17624283.37	5050367.59	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	60.0	0.1	4.1	0.0	0.0	0.6	0.0	0.0	-3.5
482	17624283.37	5050367.59	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	60.0	0.3	2.1	0.0	0.0	2.7	0.0	0.0	2.6
482	17624283.37	5050367.59	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	60.0	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	4.2
482	17624283.37	5050367.59	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	60.0	1.0	-0.7	0.0	0.0	5.4	0.0	0.0	1.1
482	17624283.37	5050367.59	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	60.0	2.7	-0.7	0.0	0.0	5.4	0.0	0.0	-3.4
482	17624283.37	5050367.59	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	60.0	9.2	-0.7	0.0	0.0	5.4	0.0	0.0	-18.1
482	17624283.37	5050367.59	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	60.0	32.9	-0.7	0.0	0.0	5.4	0.0	0.0	-50.1

Point Source, ISO 9613, Name: "HVAC Condenser 9", ID: "HVAC_condenser9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
485	17624296.83	5050362.76	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	60.0	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-37.2
485	17624296.83	5050362.76	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	60.0	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-16.4
485	17624296.83	5050362.76	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	60.0	0.1	4.1	0.0	0.0	0.6	0.0	0.0	-3.5
485	17624296.83	5050362.76	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	60.0	0.3	2.1	0.0	0.0	2.7	0.0	0.0	2.6
485	17624296.83	5050362.76	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	60.0	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	4.2
485	17624296.83	5050362.76	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	60.0	1.0	-0.7	0.0	0.0	5.4	0.0	0.0	1.1
485	17624296.83	5050362.76	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	60.0	2.7	-0.7	0.0	0.0	5.4	0.0	0.0	-3.4
485	17624296.83	5050362.76	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	60.0	9.2	-0.7	0.0	0.0	5.4	0.0	0.0	-18.1
485	17624296.83	5050362.76	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	60.0	32.9	-0.7	0.0	0.0	5.4	0.0	0.0	-50.1

Point Source, ISO 9613, Name: "HVAC Condenser 6", ID: "HVAC_condenser6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
487	17624286.79	5050362.77	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	60.1	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-37.3
487	17624286.79	5050362.77	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	60.1	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-16.5
487	17624286.79	5050362.77	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	60.1	0.1	4.1	0.0	0.0	0.6	0.0	0.0	-3.6
487	17624286.79	5050362.77	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	60.1	0.3	2.1	0.0	0.0	2.7	0.0	0.0	2.5
487	17624286.79	5050362.77	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	60.1	0.5	-0.7	0.0	0.0	5.4	0.0	0.0	4.1
487	17624286.79	5050362.77	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	60.1	1.0	-0.7	0.0	0.0	5.4	0.0	0.0	1.0
487	17624286.79	5050362.77	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	60.1	2.8	-0.7	0.0	0.0	5.4	0.0	0.0	-3.5
487	17624286.79	5050362.77	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	60.1	9.3	-0.7	0.0	0.0	5.4	0.0	0.0	-18.3
487	17624286.79	5050362.77	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	60.1	33.3	-0.7	0.0	0.0	5.4	0.0	0.0	-50.6

Point Source, ISO 9613, Name: "HVAC Condenser 2", ID: "HVAC_condenser2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
491	17624279.21	5050362.61	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	60.2	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-37.3
491	17624279.21	5050362.61	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	60.2	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-16.6
491	17624279.21	5050362.61	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	60.2	0.1	4.2	0.0	0.0	0.6	0.0	0.0	-3.7
491	17624279.21	5050362.61	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	60.2	0.3	2.1	0.0	0.0	2.7	0.0	0.0	2.4
491	17624279.21	5050362.61	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	60.2	0.6	-0.7	0.0	0.0	5.4	0.0	0.0	4.0
491	17624279.21	5050362.61	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	60.2	1.1	-0.7	0.0	0.0	5.4	0.0	0.0	0.9
491	17624279.21	5050362.61	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	60.2	2.8	-0.7	0.0	0.0	5.4	0.0	0.0	-3.6
491	17624279.21	5050362.61	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	60.2	9.4	-0.7	0.0	0.0	5.4	0.0	0.0	-18.5
491	17624279.21	5050362.61	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	60.2	33.6	-0.7	0.0	0.0	5.4	0.0	0.0	-51.0

Point Source, ISO 9613, Name: "UPS 7", ID: "UPS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
495	17624296.42	5050378.45	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	59.5	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-38.7
495	17624296.42	5050378.45	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	59.5	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-26.0
495	17624296.42	5050378.45	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	59.5	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-6.0
495	17624296.42	5050378.45	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	59.5	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-3.2
495	17624296.42	5050378.45	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	59.5	0.5	1.0	0.0	0.0	3.9	0.0	0.0	-3.8
495	17624296.42	5050378.45	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	59.5	1.0	-0.7	0.0	0.0	5.7	0.0	0.0	-0.3
495	17624296.42	5050378.45	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	59.5	2.6	-0.8	0.0	0.0	6.0	0.0	0.0	-0.8
495	17624296.42	5050378.45	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	59.5	8.7	-0.8	0.0	0.0	6.4	0.0	0.0	-11.9
495	17624296.42	5050378.45	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	59.5	31.2	-0.8	0.0	0.0	7.2	0.0	0.0	-46.5

Point Source, ISO 9613, Name: "UPS 3", ID: "UPS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
502	17624288.82	5050378.40	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	59.6	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-38.8
502	17624288.82	5050378.40	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	59.6	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-26.1
502	17624288.82	5050378.40	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	59.6	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-6.1
502	17624288.82	5050378.40	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	59.6	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-3.3
502	17624288.82	5050378.40	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	59.6	0.5	1.0	0.0	0.0	3.8	0.0	0.0	-3.8
502	17624288.82	5050378.40	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	59.6	1.0	-0.7	0.0	0.0	5.5	0.0	0.0	-0.3
502	17624288.82	5050378.40	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	59.6	2.6	-0.8	0.0	0.0	5.7	0.0	0.0	-0.6
502	17624288.82	5050378.40	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	59.6	8.8	-0.8	0.0	0.0	5.8	0.0	0.0	-11.4
502	17624288.82	5050378.40	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	59.6	31.5	-0.8	0.0	0.0	6.0	0.0	0.0	-45.7

Point Source, ISO 9613, Name: "UPS 4", ID: "UPS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
505	17624293.53	5050373.46	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	59.7	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-38.9
505	17624293.53	5050373.46	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	59.7	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-26.2
505	17624293.53	5050373.46	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	59.7	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-6.2
505	17624293.53	5050373.46	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	59.7	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-3.3
505	17624293.53	5050373.46	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	59.7	0.5	1.0	0.0	0.0	3.9	0.0	0.0	-4.0
505	17624293.53	5050373.46	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	59.7	1.0	-0.7	0.0	0.0	5.7	0.0	0.0	-0.6
505	17624293.53	5050373.46	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	59.7	2.6	-0.8	0.0	0.0	6.1	0.0	0.0	-1.2
505	17624293.53	5050373.46	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	59.7	8.9	-0.8	0.0	0.0	6.7	0.0	0.0	-12.5
505	17624293.53	5050373.46	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	59.7	31.9	-0.8	0.0	0.0	7.6	0.0	0.0	-47.7

Point Source, ISO 9613, Name: "UPS 8", ID: "UPS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
507	17624296.53	5050367.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	59.8	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-39.1
507	17624296.53	5050367.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	59.8	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-26.4
507	17624296.53	5050367.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	59.8	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-6.4
507	17624296.53	5050367.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	59.8	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-3.5
507	17624296.53	5050367.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	59.8	0.5	1.0	0.0	0.0	4.1	0.0	0.0	-4.4
507	17624296.53	5050367.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	59.8	1.0	-0.7	0.0	0.0	6.1	0.0	0.0	-1.2
507	17624296.53	5050367.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	59.8	2.7	-0.8	0.0	0.0	6.9	0.0	0.0	-2.1
507	17624296.53	5050367.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	59.8	9.1	-0.8	0.0	0.0	7.9	0.0	0.0	-13.9
507	17624296.53	5050367.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	59.8	32.4	-0.8	0.0	0.0	9.4	0.0	0.0	-50.2

Point Source, ISO 9613, Name: "UPS 9", ID: "UPS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
509	17624301.15	5050362.78	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.0	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-39.2
509	17624301.15	5050362.78	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.0	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-26.5
509	17624301.15	5050362.78	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.0	0.1	3.1	0.0	0.0	1.8	0.0	0.0	-6.5
509	17624301.15	5050362.78	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.0	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-3.6
509	17624301.15	5050362.78	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.0	0.5	1.0	0.0	0.0	4.5	0.0	0.0	-4.8
509	17624301.15	5050362.78	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.0	1.0	-0.7	0.0	0.0	6.8	0.0	0.0	-1.9
509	17624301.15	5050362.78	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.0	2.7	-0.8	0.0	0.0	8.0	0.0	0.0	-3.3
509	17624301.15	5050362.78	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.0	9.2	-0.8	0.0	0.0	9.5	0.0	0.0	-15.8
509	17624301.15	5050362.78	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.0	32.8	-0.8	0.0	0.0	11.5	0.0	0.0	-52.8

Point Source, ISO 9613, Name: "UPS 5", ID: "UPS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
511	17624286.54	5050367.66	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.0	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-39.2
511	17624286.54	5050367.66	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.0	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-26.5
511	17624286.54	5050367.66	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.0	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-6.4
511	17624286.54	5050367.66	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.0	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-3.6
511	17624286.54	5050367.66	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.0	0.5	1.0	0.0	0.0	3.9	0.0	0.0	-4.3
511	17624286.54	5050367.66	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.0	1.0	-0.7	0.0	0.0	5.7	0.0	0.0	-0.9
511	17624286.54	5050367.66	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.0	2.7	-0.8	0.0	0.0	6.1	0.0	0.0	-1.4
511	17624286.54	5050367.66	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.0	9.2	-0.8	0.0	0.0	6.6	0.0	0.0	-12.9
511	17624286.54	5050367.66	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.0	32.8	-0.8	0.0	0.0	7.4	0.0	0.0	-48.7

Point Source, ISO 9613, Name: "UPS 1", ID: "UPS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
513	17624278.90	5050367.58	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.0	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-39.3
513	17624278.90	5050367.58	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.0	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-26.5
513	17624278.90	5050367.58	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.0	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-6.5
513	17624278.90	5050367.58	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.0	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-3.7
513	17624278.90	5050367.58	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.0	0.5	1.0	0.0	0.0	3.8	0.0	0.0	-4.3
513	17624278.90	5050367.58	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.0	1.0	-0.7	0.0	0.0	5.6	0.0	0.0	-0.8
513	17624278.90	5050367.58	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.0	2.7	-0.8	0.0	0.0	5.8	0.0	0.0	-1.2
513	17624278.90	5050367.58	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.0	9.3	-0.8	0.0	0.0	6.0	0.0	0.0	-12.4
513	17624278.90	5050367.58	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.0	33.1	-0.8	0.0	0.0	6.4	0.0	0.0	-48.1

Point Source, ISO 9613, Name: "UPS 6", ID: "UPS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
515	17624291.19	5050362.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.0	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-39.3
515	17624291.19	5050362.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.0	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-26.6
515	17624291.19	5050362.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.0	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-6.6
515	17624291.19	5050362.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.0	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-3.7
515	17624291.19	5050362.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.0	0.5	1.0	0.0	0.0	4.1	0.0	0.0	-4.5
515	17624291.19	5050362.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.0	1.0	-0.7	0.0	0.0	6.1	0.0	0.0	-1.3
515	17624291.19	5050362.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.0	2.7	-0.8	0.0	0.0	6.8	0.0	0.0	-2.2
515	17624291.19	5050362.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.0	9.3	-0.8	0.0	0.0	7.7	0.0	0.0	-14.2
515	17624291.19	5050362.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.0	33.1	-0.8	0.0	0.0	9.2	0.0	0.0	-50.9

Point Source, ISO 9613, Name: "UPS 2", ID: "UPS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
516	17624283.74	5050362.73	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.1	0.0	-4.0	0.0	0.0	8.7	0.0	0.0	-39.3
516	17624283.74	5050362.73	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.1	0.0	-4.0	0.0	0.0	8.7	0.0	0.0	-26.6
516	17624283.74	5050362.73	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.1	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-6.6
516	17624283.74	5050362.73	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.1	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-3.8
516	17624283.74	5050362.73	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.1	0.6	1.0	0.0	0.0	4.0	0.0	0.0	-4.5
516	17624283.74	5050362.73	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.1	1.0	-0.7	0.0	0.0	5.8	0.0	0.0	-1.1
516	17624283.74	5050362.73	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.1	2.8	-0.8	0.0	0.0	6.2	0.0	0.0	-1.8
516	17624283.74	5050362.73	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.1	9.4	-0.8	0.0	0.0	6.8	0.0	0.0	-13.5
516	17624283.74	5050362.73	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.1	33.4	-0.8	0.0	0.0	7.8	0.0	0.0	-49.9

Receiver

Name: POR8

ID: POR8

X: 17624055.04 m

Y: 5050526.62 m

Z: 315.98 m

Point Source, ISO 9613, Name: "Transformer 4MW", ID: "transformer_4MW"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
291	17624270.19	5050367.48	342.00	0	DEN	32	41.6	0.0	0.0	0.0	0.0	59.6	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-22.8
291	17624270.19	5050367.48	342.00	0	DEN	63	62.8	0.0	0.0	0.0	0.0	59.6	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-1.6
291	17624270.19	5050367.48	342.00	0	DEN	125	76.9	0.0	0.0	0.0	0.0	59.6	0.1	3.1	0.0	0.0	1.7	0.0	0.0	12.4
291	17624270.19	5050367.48	342.00	0	DEN	250	68.4	0.0	0.0	0.0	0.0	59.6	0.3	5.1	0.0	0.0	0.0	0.0	0.0	3.4
291	17624270.19	5050367.48	342.00	0	DEN	500	69.8	0.0	0.0	0.0	0.0	59.6	0.5	1.0	0.0	0.0	3.9	0.0	0.0	4.7
291	17624270.19	5050367.48	342.00	0	DEN	1000	71.0	0.0	0.0	0.0	0.0	59.6	1.0	-0.7	0.0	0.0	5.8	0.0	0.0	5.3
291	17624270.19	5050367.48	342.00	0	DEN	2000	69.2	0.0	0.0	0.0	0.0	59.6	2.6	-0.8	0.0	0.0	6.2	0.0	0.0	1.6
291	17624270.19	5050367.48	342.00	0	DEN	4000	71.0	0.0	0.0	0.0	0.0	59.6	8.8	-0.8	0.0	0.0	6.8	0.0	0.0	-3.4
291	17624270.19	5050367.48	342.00	0	DEN	8000	51.9	0.0	0.0	0.0	0.0	59.6	31.4	-0.8	0.0	0.0	7.8	0.0	0.0	-46.1

Point Source, ISO 9613, Name: "HVAC Economizer Hood 2", ID: "HVAC_hood2"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
297	17624278.29	5050363.89	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	59.9	0.0	-3.2	0.0	0.0	8.0	0.0	0.0	-32.3
297	17624278.29	5050363.89	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	59.9	0.0	-3.2	0.0	0.0	8.0	0.0	0.0	-11.6
297	17624278.29	5050363.89	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	59.9	0.1	4.1	0.0	0.0	0.6	0.0	0.0	1.3
297	17624278.29	5050363.89	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	59.9	0.3	2.1	0.0	0.0	2.7	0.0	0.0	7.4
297	17624278.29	5050363.89	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	59.9	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	9.1
297	17624278.29	5050363.89	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	59.9	1.0	-0.6	0.0	0.0	5.4	0.0	0.0	5.9
297	17624278.29	5050363.89	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	59.9	2.7	-0.6	0.0	0.0	5.4	0.0	0.0	1.5
297	17624278.29	5050363.89	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	59.9	9.1	-0.6	0.0	0.0	5.4	0.0	0.0	-13.1
297	17624278.29	5050363.89	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	59.9	32.5	-0.6	0.0	0.0	5.4	0.0	0.0	-44.8

Point Source, ISO 9613, Name: "HVAC Economizer Hood 4", ID: "HVAC_hood4"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
303	17624288.27	5050374.68	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	59.9	0.0	-3.3	0.0	0.0	8.0	0.0	0.0	-32.4
303	17624288.27	5050374.68	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	59.9	0.0	-3.3	0.0	0.0	8.0	0.0	0.0	-11.6
303	17624288.27	5050374.68	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	59.9	0.1	4.1	0.0	0.0	0.6	0.0	0.0	1.3
303	17624288.27	5050374.68	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	59.9	0.3	2.1	0.0	0.0	2.7	0.0	0.0	7.3
303	17624288.27	5050374.68	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	59.9	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	9.0
303	17624288.27	5050374.68	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	59.9	1.0	-0.7	0.0	0.0	5.4	0.0	0.0	5.9
303	17624288.27	5050374.68	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	59.9	2.7	-0.7	0.0	0.0	5.4	0.0	0.0	1.4
303	17624288.27	5050374.68	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	59.9	9.2	-0.7	0.0	0.0	5.4	0.0	0.0	-13.3
303	17624288.27	5050374.68	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	59.9	32.7	-0.7	0.0	0.0	5.4	0.0	0.0	-45.1

Point Source, ISO 9613, Name: "HVAC Economizer Hood 1", ID: "HVAC_hood1"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
316	17624284.42	5050366.44	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	60.0	0.0	-3.3	0.0	0.0	8.0	0.0	0.0	-32.4
316	17624284.42	5050366.44	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	60.0	0.0	-3.3	0.0	0.0	8.0	0.0	0.0	-11.7
316	17624284.42	5050366.44	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	60.0	0.1	4.1	0.0	0.0	0.6	0.0	0.0	1.2
316	17624284.42	5050366.44	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	60.0	0.3	2.1	0.0	0.0	2.7	0.0	0.0	7.3
316	17624284.42	5050366.44	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	60.0	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	9.0
316	17624284.42	5050366.44	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	60.0	1.0	-0.7	0.0	0.0	5.4	0.0	0.0	5.8
316	17624284.42	5050366.44	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	60.0	2.7	-0.7	0.0	0.0	5.4	0.0	0.0	1.4
316	17624284.42	5050366.44	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	60.0	9.2	-0.7	0.0	0.0	5.4	0.0	0.0	-13.4
316	17624284.42	5050366.44	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	60.0	32.9	-0.7	0.0	0.0	5.4	0.0	0.0	-45.3

Point Source, ISO 9613, Name: "HVAC Economizer Hood 3", ID: "HVAC_hood3"

Nr.	X (m)	Y (m)	Z (m)	Refl.	DEN	Freq. (Hz)	Lw dB(A)	l/a dB	Optime dB	K0 (dB)	Di (dB)	Adiv (dB)	Aatm (dB)	Agr (dB)	Afol (dB)	Ahous (dB)	Abar (dB)	Cmet (dB)	RL (dB)	Lr dB(A)
331	17624294.15	5050377.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	60.0	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-32.5

Point Source, ISO 9613, Name: "HVAC Economizer Hood 3", ID: "HVAC_hood3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
331	17624294.15	5050377.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	60.0	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-11.8
331	17624294.15	5050377.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	60.0	0.1	4.1	0.0	0.0	0.6	0.0	0.0	1.1
331	17624294.15	5050377.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	60.0	0.3	2.1	0.0	0.0	2.7	0.0	0.0	7.2
331	17624294.15	5050377.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	60.0	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	8.9
331	17624294.15	5050377.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	60.0	1.0	-0.7	0.0	0.0	5.4	0.0	0.0	5.7
331	17624294.15	5050377.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	60.0	2.7	-0.7	0.0	0.0	5.4	0.0	0.0	1.3
331	17624294.15	5050377.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	60.0	9.3	-0.7	0.0	0.0	5.4	0.0	0.0	-13.5
331	17624294.15	5050377.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	60.0	33.1	-0.7	0.0	0.0	5.4	0.0	0.0	-45.6

Point Source, ISO 9613, Name: "HVAC Economizer Hood 6", ID: "HVAC_hood6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
333	17624285.84	5050363.98	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	60.1	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-32.5
333	17624285.84	5050363.98	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	60.1	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-11.8
333	17624285.84	5050363.98	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	60.1	0.1	4.1	0.0	0.0	0.6	0.0	0.0	1.1
333	17624285.84	5050363.98	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	60.1	0.3	2.1	0.0	0.0	2.7	0.0	0.0	7.2
333	17624285.84	5050363.98	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	60.1	0.5	-0.7	0.0	0.0	5.4	0.0	0.0	8.9
333	17624285.84	5050363.98	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	60.1	1.0	-0.7	0.0	0.0	5.4	0.0	0.0	5.7
333	17624285.84	5050363.98	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	60.1	2.7	-0.7	0.0	0.0	5.4	0.0	0.0	1.2
333	17624285.84	5050363.98	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	60.1	9.3	-0.7	0.0	0.0	5.4	0.0	0.0	-13.5
333	17624285.84	5050363.98	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	60.1	33.2	-0.7	0.0	0.0	5.5	0.0	0.0	-45.7

Point Source, ISO 9613, Name: "HVAC Economizer Hood 5", ID: "HVAC_hood5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
341	17624291.94	5050366.35	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	60.2	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-32.6
341	17624291.94	5050366.35	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	60.2	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-11.9
341	17624291.94	5050366.35	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	60.2	0.1	4.2	0.0	0.0	0.6	0.0	0.0	1.0
341	17624291.94	5050366.35	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	60.2	0.3	2.1	0.0	0.0	2.7	0.0	0.0	7.1
341	17624291.94	5050366.35	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	60.2	0.6	-0.7	0.0	0.0	5.4	0.0	0.0	8.8
341	17624291.94	5050366.35	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	60.2	1.1	-0.7	0.0	0.0	5.4	0.0	0.0	5.6
341	17624291.94	5050366.35	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	60.2	2.8	-0.7	0.0	0.0	5.4	0.0	0.0	1.1
341	17624291.94	5050366.35	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	60.2	9.4	-0.7	0.0	0.0	5.4	0.0	0.0	-13.8
341	17624291.94	5050366.35	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	60.2	33.6	-0.7	0.0	0.0	5.5	0.0	0.0	-46.2

Point Source, ISO 9613, Name: "HVAC Economizer Hood 7", ID: "HVAC_hood7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
343	17624301.74	5050377.18	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	60.2	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-32.7
343	17624301.74	5050377.18	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	60.2	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-12.0
343	17624301.74	5050377.18	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	60.2	0.1	4.2	0.0	0.0	0.6	0.0	0.0	0.9
343	17624301.74	5050377.18	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	60.2	0.3	2.1	0.0	0.0	2.7	0.0	0.0	7.0
343	17624301.74	5050377.18	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	60.2	0.6	-0.7	0.0	0.0	5.4	0.0	0.0	8.7
343	17624301.74	5050377.18	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	60.2	1.1	-0.7	0.0	0.0	5.4	0.0	0.0	5.5
343	17624301.74	5050377.18	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	60.2	2.8	-0.7	0.0	0.0	5.4	0.0	0.0	1.0
343	17624301.74	5050377.18	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	60.2	9.5	-0.7	0.0	0.0	5.4	0.0	0.0	-13.9
343	17624301.74	5050377.18	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	60.2	33.9	-0.7	0.0	0.0	5.4	0.0	0.0	-46.6

Point Source, ISO 9613, Name: "HVAC Economizer Hood 9", ID: "HVAC_hood9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
348	17624295.94	5050364.07	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	60.3	0.0	-3.4	0.0	0.0	8.1	0.0	0.0	-32.8
348	17624295.94	5050364.07	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	60.3	0.0	-3.4	0.0	0.0	8.1	0.0	0.0	-12.0
348	17624295.94	5050364.07	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	60.3	0.1	4.2	0.0	0.0	0.6	0.0	0.0	0.9
348	17624295.94	5050364.07	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	60.3	0.3	2.1	0.0	0.0	2.7	0.0	0.0	7.0
348	17624295.94	5050364.07	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	60.3	0.6	-0.7	0.0	0.0	5.4	0.0	0.0	8.6
348	17624295.94	5050364.07	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	60.3	1.1	-0.7	0.0	0.0	5.5	0.0	0.0	5.4
348	17624295.94	5050364.07	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	60.3	2.8	-0.7	0.0	0.0	5.5	0.0	0.0	0.9
348	17624295.94	5050364.07	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	60.3	9.6	-0.7	0.0	0.0	5.5	0.0	0.0	-14.1
348	17624295.94	5050364.07	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	60.3	34.1	-0.7	0.0	0.0	5.5	0.0	0.0	-47.0

Point Source, ISO 9613, Name: "HVAC Economizer Hood 8", ID: "HVAC_hood8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
350	17624301.95	5050366.49	344.00	0	DEN	32	32.3	0.0	0.0	0.0	0.0	60.4	0.0	-3.4	0.0	0.0	8.2	0.0	0.0	-32.9
350	17624301.95	5050366.49	344.00	0	DEN	63	53.1	0.0	0.0	0.0	0.0	60.4	0.0	-3.4	0.0	0.0	8.2	0.0	0.0	-12.1
350	17624301.95	5050366.49	344.00	0	DEN	125	66.1	0.0	0.0	0.0	0.0	60.4	0.1	4.2	0.0	0.0	0.6	0.0	0.0	0.8
350	17624301.95	5050366.49	344.00	0	DEN	250	72.3	0.0	0.0	0.0	0.0	60.4	0.3	2.1	0.0	0.0	2.7	0.0	0.0	6.8
350	17624301.95	5050366.49	344.00	0	DEN	500	74.2	0.0	0.0	0.0	0.0	60.4	0.6	-0.7	0.0	0.0	5.4	0.0	0.0	8.5
350	17624301.95	5050366.49	344.00	0	DEN	1000	71.6	0.0	0.0	0.0	0.0	60.4	1.1	-0.7	0.0	0.0	5.5	0.0	0.0	5.3
350	17624301.95	5050366.49	344.00	0	DEN	2000	68.8	0.0	0.0	0.0	0.0	60.4	2.9	-0.7	0.0	0.0	5.5	0.0	0.0	0.8
350	17624301.95	5050366.49	344.00	0	DEN	4000	60.6	0.0	0.0	0.0	0.0	60.4	9.7	-0.7	0.0	0.0	5.5	0.0	0.0	-14.3
350	17624301.95	5050366.49	344.00	0	DEN	8000	52.3	0.0	0.0	0.0	0.0	60.4	34.6	-0.7	0.0	0.0	5.5	0.0	0.0	-47.5

Point Source, ISO 9613, Name: "Transformer 2MW", ID: "transformer_2MW"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
355	17624280.40	5050378.87	342.00	0	DEN	32	38.6	0.0	0.0	0.0	0.0	59.7	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-25.8
355	17624280.40	5050378.87	342.00	0	DEN	63	59.8	0.0	0.0	0.0	0.0	59.7	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-4.7
355	17624280.40	5050378.87	342.00	0	DEN	125	73.9	0.0	0.0	0.0	0.0	59.7	0.1	3.1	0.0	0.0	1.7	0.0	0.0	9.4
355	17624280.40	5050378.87	342.00	0	DEN	250	65.4	0.0	0.0	0.0	0.0	59.7	0.3	5.1	0.0	0.0	0.0	0.0	0.0	0.3
355	17624280.40	5050378.87	342.00	0	DEN	500	66.8	0.0	0.0	0.0	0.0	59.7	0.5	1.0	0.0	0.0	3.8	0.0	0.0	1.8
355	17624280.40	5050378.87	342.00	0	DEN	1000	68.0	0.0	0.0	0.0	0.0	59.7	1.0	-0.7	0.0	0.0	5.5	0.0	0.0	2.5
355	17624280.40	5050378.87	342.00	0	DEN	2000	66.2	0.0	0.0	0.0	0.0	59.7	2.6	-0.8	0.0	0.0	5.6	0.0	0.0	-0.9
355	17624280.40	5050378.87	342.00	0	DEN	4000	68.0	0.0	0.0	0.0	0.0	59.7	8.9	-0.8	0.0	0.0	5.7	0.0	0.0	-5.5
355	17624280.40	5050378.87	342.00	0	DEN	8000	48.9	0.0	0.0	0.0	0.0	59.7	31.6	-0.8	0.0	0.0	5.9	0.0	0.0	-47.6

Point Source, ISO 9613, Name: "PCS 12", ID: "PCS12"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
361	17624270.58	5050364.97	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.6	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-34.2
361	17624270.58	5050364.97	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.6	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-21.5
361	17624270.58	5050364.97	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.6	0.1	3.1	0.0	0.0	1.8	0.0	0.0	-1.5
361	17624270.58	5050364.97	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.6	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.4
361	17624270.58	5050364.97	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.6	0.5	1.0	0.0	0.0	4.0	0.0	0.0	0.7
361	17624270.58	5050364.97	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.6	1.0	-0.7	0.0	0.0	5.9	0.0	0.0	4.0
361	17624270.58	5050364.97	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.6	2.6	-0.8	0.0	0.0	6.5	0.0	0.0	3.3
361	17624270.58	5050364.97	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.6	8.9	-0.8	0.0	0.0	7.2	0.0	0.0	-8.2
361	17624270.58	5050364.97	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.6	31.6	-0.8	0.0	0.0	8.4	0.0	0.0	-43.6

Point Source, ISO 9613, Name: "PCS 13", ID: "PCS13"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
370	17624270.54	5050363.56	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.7	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-34.2
370	17624270.54	5050363.56	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.7	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-21.5
370	17624270.54	5050363.56	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.7	0.1	3.1	0.0	0.0	1.8	0.0	0.0	-1.5
370	17624270.54	5050363.56	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.7	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.4
370	17624270.54	5050363.56	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.7	0.5	1.0	0.0	0.0	4.1	0.0	0.0	0.6
370	17624270.54	5050363.56	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.7	1.0	-0.7	0.0	0.0	6.0	0.0	0.0	3.9
370	17624270.54	5050363.56	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.7	2.6	-0.8	0.0	0.0	6.6	0.0	0.0	3.1
370	17624270.54	5050363.56	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.7	8.9	-0.8	0.0	0.0	7.5	0.0	0.0	-8.5
370	17624270.54	5050363.56	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.7	31.7	-0.8	0.0	0.0	8.8	0.0	0.0	-44.1

Point Source, ISO 9613, Name: "PCS 10", ID: "PCS10"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
377	17624280.69	5050376.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.7	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-34.2
377	17624280.69	5050376.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.7	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-21.5
377	17624280.69	5050376.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.7	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-1.5
377	17624280.69	5050376.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.7	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.4
377	17624280.69	5050376.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.7	0.5	1.0	0.0	0.0	3.8	0.0	0.0	0.8
377	17624280.69	5050376.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.7	1.0	-0.7	0.0	0.0	5.5	0.0	0.0	4.3
377	17624280.69	5050376.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.7	2.6	-0.8	0.0	0.0	5.8	0.0	0.0	3.9
377	17624280.69	5050376.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.7	8.9	-0.8	0.0	0.0	6.0	0.0	0.0	-7.0
377	17624280.69	5050376.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.7	31.8	-0.8	0.0	0.0	6.3	0.0	0.0	-41.7

Point Source, ISO 9613, Name: "PCS 14", ID: "PCS14"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
379	17624270.56	5050362.20	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.7	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-34.2
379	17624270.56	5050362.20	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.7	0.0	-3.8	0.0	0.0	8.7	0.0	0.0	-21.5
379	17624270.56	5050362.20	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.7	0.1	3.1	0.0	0.0	1.8	0.0	0.0	-1.5
379	17624270.56	5050362.20	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.7	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.4
379	17624270.56	5050362.20	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.7	0.5	1.0	0.0	0.0	4.1	0.0	0.0	0.5
379	17624270.56	5050362.20	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.7	1.0	-0.7	0.0	0.0	6.1	0.0	0.0	3.8
379	17624270.56	5050362.20	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.7	2.6	-0.8	0.0	0.0	6.7	0.0	0.0	2.9
379	17624270.56	5050362.20	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.7	8.9	-0.8	0.0	0.0	7.7	0.0	0.0	-8.7
379	17624270.56	5050362.20	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.7	31.8	-0.8	0.0	0.0	9.1	0.0	0.0	-44.5

Point Source, ISO 9613, Name: "PCS 11", ID: "PCS11"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
420	17624280.74	5050375.25	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.7	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-34.2
420	17624280.74	5050375.25	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.7	0.0	-3.8	0.0	0.0	8.6	0.0	0.0	-21.5
420	17624280.74	5050375.25	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.7	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-1.5
420	17624280.74	5050375.25	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.7	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.3
420	17624280.74	5050375.25	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.7	0.5	1.0	0.0	0.0	3.8	0.0	0.0	0.8
420	17624280.74	5050375.25	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.7	1.0	-0.7	0.0	0.0	5.6	0.0	0.0	4.2
420	17624280.74	5050375.25	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.7	2.6	-0.8	0.0	0.0	5.8	0.0	0.0	3.8
420	17624280.74	5050375.25	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.7	8.9	-0.8	0.0	0.0	6.1	0.0	0.0	-7.2
420	17624280.74	5050375.25	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.7	31.9	-0.8	0.0	0.0	6.6	0.0	0.0	-42.1

Point Source, ISO 9613, Name: "PCS 1", ID: "PCS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
438	17624280.88	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.9	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-34.4
438	17624280.88	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.9	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-21.7
438	17624280.88	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.9	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-1.7
438	17624280.88	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.9	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.2
438	17624280.88	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.9	0.5	1.0	0.0	0.0	4.0	0.0	0.0	0.4
438	17624280.88	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.9	1.0	-0.7	0.0	0.0	5.9	0.0	0.0	3.7
438	17624280.88	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.9	2.7	-0.8	0.0	0.0	6.4	0.0	0.0	3.0
438	17624280.88	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.9	9.1	-0.8	0.0	0.0	7.2	0.0	0.0	-8.6
438	17624280.88	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.9	32.4	-0.8	0.0	0.0	8.4	0.0	0.0	-44.5

Point Source, ISO 9613, Name: "PCS 3", ID: "PCS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
443	17624290.73	5050378.40	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	59.9	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-34.4
443	17624290.73	5050378.40	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	59.9	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-21.7
443	17624290.73	5050378.40	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	59.9	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-1.7
443	17624290.73	5050378.40	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	59.9	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.1
443	17624290.73	5050378.40	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	59.9	0.5	1.0	0.0	0.0	3.8	0.0	0.0	0.5
443	17624290.73	5050378.40	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	59.9	1.0	-0.7	0.0	0.0	5.6	0.0	0.0	4.0
443	17624290.73	5050378.40	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	59.9	2.7	-0.8	0.0	0.0	5.8	0.0	0.0	3.6
443	17624290.73	5050378.40	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	59.9	9.2	-0.8	0.0	0.0	6.1	0.0	0.0	-7.6
443	17624290.73	5050378.40	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	59.9	32.7	-0.8	0.0	0.0	6.5	0.0	0.0	-43.0

Point Source, ISO 9613, Name: "PCS 2", ID: "PCS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
446	17624281.69	5050362.69	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.0	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-34.5
446	17624281.69	5050362.69	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.0	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-21.8
446	17624281.69	5050362.69	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.0	0.1	3.1	0.0	0.0	1.8	0.0	0.0	-1.8
446	17624281.69	5050362.69	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.0	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.1
446	17624281.69	5050362.69	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.0	0.5	1.0	0.0	0.0	4.2	0.0	0.0	0.2
446	17624281.69	5050362.69	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.0	1.0	-0.7	0.0	0.0	6.2	0.0	0.0	3.4
446	17624281.69	5050362.69	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.0	2.7	-0.8	0.0	0.0	6.9	0.0	0.0	2.4
446	17624281.69	5050362.69	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.0	9.2	-0.8	0.0	0.0	8.0	0.0	0.0	-9.6
446	17624281.69	5050362.69	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.0	32.8	-0.8	0.0	0.0	9.5	0.0	0.0	-46.2

Point Source, ISO 9613, Name: "PCS 4", ID: "PCS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
449	17624291.60	5050373.50	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.0	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-34.6
449	17624291.60	5050373.50	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.0	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-21.9
449	17624291.60	5050373.50	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.0	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-1.8
449	17624291.60	5050373.50	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.0	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.0
449	17624291.60	5050373.50	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.0	0.5	1.0	0.0	0.0	3.9	0.0	0.0	0.3
449	17624291.60	5050373.50	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.0	1.0	-0.7	0.0	0.0	5.8	0.0	0.0	3.7
449	17624291.60	5050373.50	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.0	2.7	-0.8	0.0	0.0	6.2	0.0	0.0	3.1
449	17624291.60	5050373.50	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.0	9.3	-0.8	0.0	0.0	6.7	0.0	0.0	-8.5
449	17624291.60	5050373.50	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.0	33.1	-0.8	0.0	0.0	7.6	0.0	0.0	-44.6

Point Source, ISO 9613, Name: "PCS 5", ID: "PCS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
453	17624288.51	5050367.64	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.1	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-34.6
453	17624288.51	5050367.64	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.1	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-21.9
453	17624288.51	5050367.64	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.1	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-1.9
453	17624288.51	5050367.64	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.1	0.3	5.1	0.0	0.0	0.0	0.0	0.0	1.0
453	17624288.51	5050367.64	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.1	0.5	1.0	0.0	0.0	4.1	0.0	0.0	0.2
453	17624288.51	5050367.64	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.1	1.0	-0.7	0.0	0.0	6.0	0.0	0.0	3.4
453	17624288.51	5050367.64	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.1	2.7	-0.8	0.0	0.0	6.6	0.0	0.0	2.6
453	17624288.51	5050367.64	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.1	9.3	-0.8	0.0	0.0	7.5	0.0	0.0	-9.2
453	17624288.51	5050367.64	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.1	33.2	-0.8	0.0	0.0	8.8	0.0	0.0	-45.8

Point Source, ISO 9613, Name: "PCS 7", ID: "PCS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
456	17624298.22	5050378.41	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.1	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-34.6
456	17624298.22	5050378.41	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.1	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-21.9
456	17624298.22	5050378.41	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.1	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-1.9
456	17624298.22	5050378.41	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.1	0.3	5.1	0.0	0.0	0.0	0.0	0.0	0.9
456	17624298.22	5050378.41	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.1	0.6	1.0	0.0	0.0	3.9	0.0	0.0	0.3
456	17624298.22	5050378.41	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.1	1.0	-0.7	0.0	0.0	5.6	0.0	0.0	3.7
456	17624298.22	5050378.41	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.1	2.8	-0.8	0.0	0.0	5.9	0.0	0.0	3.2
456	17624298.22	5050378.41	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.1	9.4	-0.8	0.0	0.0	6.3	0.0	0.0	-8.2
456	17624298.22	5050378.41	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.1	33.4	-0.8	0.0	0.0	6.9	0.0	0.0	-44.3

Point Source, ISO 9613, Name: "PCS 6", ID: "PCS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
462	17624289.16	5050362.78	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.2	0.0	-4.0	0.0	0.0	8.8	0.0	0.0	-34.7
462	17624289.16	5050362.78	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.2	0.0	-4.0	0.0	0.0	8.8	0.0	0.0	-22.0
462	17624289.16	5050362.78	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.2	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-2.0
462	17624289.16	5050362.78	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.2	0.3	5.1	0.0	0.0	0.0	0.0	0.0	0.9
462	17624289.16	5050362.78	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.2	0.6	1.0	0.0	0.0	4.2	0.0	0.0	-0.1
462	17624289.16	5050362.78	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.2	1.0	-0.7	0.0	0.0	6.3	0.0	0.0	3.1
462	17624289.16	5050362.78	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.2	2.8	-0.8	0.0	0.0	7.1	0.0	0.0	2.0
462	17624289.16	5050362.78	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.2	9.4	-0.8	0.0	0.0	8.2	0.0	0.0	-10.2
462	17624289.16	5050362.78	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.2	33.5	-0.8	0.0	0.0	9.8	0.0	0.0	-47.4

Point Source, ISO 9613, Name: "PCS 8", ID: "PCS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
465	17624298.45	5050367.65	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.3	0.0	-4.0	0.0	0.0	8.8	0.0	0.0	-34.8
465	17624298.45	5050367.65	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.3	0.0	-4.0	0.0	0.0	8.8	0.0	0.0	-22.2
465	17624298.45	5050367.65	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.3	0.1	3.2	0.0	0.0	1.7	0.0	0.0	-2.1
465	17624298.45	5050367.65	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.3	0.3	5.1	0.0	0.0	0.0	0.0	0.0	0.8
465	17624298.45	5050367.65	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.3	0.6	1.0	0.0	0.0	4.1	0.0	0.0	-0.1
465	17624298.45	5050367.65	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.3	1.1	-0.7	0.0	0.0	6.1	0.0	0.0	3.1
465	17624298.45	5050367.65	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.3	2.8	-0.8	0.0	0.0	6.8	0.0	0.0	2.1
465	17624298.45	5050367.65	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.3	9.6	-0.8	0.0	0.0	7.8	0.0	0.0	-10.0
465	17624298.45	5050367.65	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.3	34.1	-0.8	0.0	0.0	9.2	0.0	0.0	-47.5

Point Source, ISO 9613, Name: "PCS 9", ID: "PCS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
467	17624299.21	5050362.68	342.00	0	DEN	32	30.3	0.0	0.0	0.0	0.0	60.4	0.0	-4.0	0.0	0.0	8.8	0.0	0.0	-34.9
467	17624299.21	5050362.68	342.00	0	DEN	63	43.0	0.0	0.0	0.0	0.0	60.4	0.0	-4.0	0.0	0.0	8.8	0.0	0.0	-22.3
467	17624299.21	5050362.68	342.00	0	DEN	125	63.1	0.0	0.0	0.0	0.0	60.4	0.1	3.2	0.0	0.0	1.7	0.0	0.0	-2.3
467	17624299.21	5050362.68	342.00	0	DEN	250	66.5	0.0	0.0	0.0	0.0	60.4	0.3	5.1	0.0	0.0	0.0	0.0	0.0	0.7
467	17624299.21	5050362.68	342.00	0	DEN	500	65.9	0.0	0.0	0.0	0.0	60.4	0.6	1.0	0.0	0.0	4.3	0.0	0.0	-0.4
467	17624299.21	5050362.68	342.00	0	DEN	1000	69.9	0.0	0.0	0.0	0.0	60.4	1.1	-0.7	0.0	0.0	6.4	0.0	0.0	2.7
467	17624299.21	5050362.68	342.00	0	DEN	2000	71.2	0.0	0.0	0.0	0.0	60.4	2.9	-0.8	0.0	0.0	7.2	0.0	0.0	1.5
467	17624299.21	5050362.68	342.00	0	DEN	4000	66.8	0.0	0.0	0.0	0.0	60.4	9.7	-0.8	0.0	0.0	8.4	0.0	0.0	-10.9
467	17624299.21	5050362.68	342.00	0	DEN	8000	55.4	0.0	0.0	0.0	0.0	60.4	34.5	-0.8	0.0	0.0	10.2	0.0	0.0	-48.9

Point Source, ISO 9613, Name: "HVAC Condenser 2", ID: "HVAC_condenser2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
469	17624279.21	5050362.61	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	59.9	0.0	-3.2	0.0	0.0	8.0	0.0	0.0	-37.1
469	17624279.21	5050362.61	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	59.9	0.0	-3.2	0.0	0.0	8.0	0.0	0.0	-16.3
469	17624279.21	5050362.61	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	59.9	0.1	4.1	0.0	0.0	0.6	0.0	0.0	-3.4
469	17624279.21	5050362.61	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	59.9	0.3	2.1	0.0	0.0	2.7	0.0	0.0	2.7
469	17624279.21	5050362.61	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	59.9	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	4.3
469	17624279.21	5050362.61	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	59.9	1.0	-0.6	0.0	0.0	5.4	0.0	0.0	1.2
469	17624279.21	5050362.61	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	59.9	2.7	-0.6	0.0	0.0	5.4	0.0	0.0	-3.3
469	17624279.21	5050362.61	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	59.9	9.1	-0.6	0.0	0.0	5.4	0.0	0.0	-17.9
469	17624279.21	5050362.61	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	59.9	32.6	-0.6	0.0	0.0	5.4	0.0	0.0	-49.7

Point Source, ISO 9613, Name: "HVAC Condenser 1", ID: "HVAC_condenser1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
472	17624283.37	5050367.59	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	59.9	0.0	-3.3	0.0	0.0	8.0	0.0	0.0	-37.1
472	17624283.37	5050367.59	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	59.9	0.0	-3.3	0.0	0.0	8.0	0.0	0.0	-16.3
472	17624283.37	5050367.59	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	59.9	0.1	4.1	0.0	0.0	0.6	0.0	0.0	-3.4
472	17624283.37	5050367.59	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	59.9	0.3	2.1	0.0	0.0	2.7	0.0	0.0	2.6
472	17624283.37	5050367.59	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	59.9	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	4.3
472	17624283.37	5050367.59	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	59.9	1.0	-0.7	0.0	0.0	5.4	0.0	0.0	1.2
472	17624283.37	5050367.59	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	59.9	2.7	-0.7	0.0	0.0	5.4	0.0	0.0	-3.3
472	17624283.37	5050367.59	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	59.9	9.2	-0.7	0.0	0.0	5.4	0.0	0.0	-18.0
472	17624283.37	5050367.59	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	59.9	32.7	-0.7	0.0	0.0	5.4	0.0	0.0	-49.8

Point Source, ISO 9613, Name: "HVAC Condenser 4", ID: "HVAC_condenser4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
475	17624289.10	5050373.50	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	60.0	0.0	-3.3	0.0	0.0	8.0	0.0	0.0	-37.1
475	17624289.10	5050373.50	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	60.0	0.0	-3.3	0.0	0.0	8.0	0.0	0.0	-16.4
475	17624289.10	5050373.50	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	60.0	0.1	4.1	0.0	0.0	0.6	0.0	0.0	-3.5
475	17624289.10	5050373.50	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	60.0	0.3	2.1	0.0	0.0	2.7	0.0	0.0	2.6
475	17624289.10	5050373.50	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	60.0	0.5	-0.6	0.0	0.0	5.4	0.0	0.0	4.3
475	17624289.10	5050373.50	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	60.0	1.0	-0.7	0.0	0.0	5.4	0.0	0.0	1.1
475	17624289.10	5050373.50	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	60.0	2.7	-0.7	0.0	0.0	5.4	0.0	0.0	-3.3
475	17624289.10	5050373.50	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	60.0	9.2	-0.7	0.0	0.0	5.4	0.0	0.0	-18.0
475	17624289.10	5050373.50	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	60.0	32.9	-0.7	0.0	0.0	5.4	0.0	0.0	-50.0

Point Source, ISO 9613, Name: "HVAC Condenser 3", ID: "HVAC_condenser3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
478	17624293.15	5050378.41	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	60.0	0.0	-3.3	0.0	0.0	0.0	0.0	0.0	-29.1
478	17624293.15	5050378.41	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	60.0	0.0	-3.3	0.0	0.0	0.0	0.0	0.0	-8.4
478	17624293.15	5050378.41	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	60.0	0.1	4.1	0.0	0.0	0.0	0.0	0.0	-2.9
478	17624293.15	5050378.41	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	60.0	0.3	2.1	0.0	0.0	0.0	0.0	0.0	5.3
478	17624293.15	5050378.41	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	60.0	0.5	-0.6	0.0	0.0	0.0	0.0	0.0	9.7
478	17624293.15	5050378.41	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	60.0	1.0	-0.7	0.0	0.0	0.0	0.0	0.0	6.5
478	17624293.15	5050378.41	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	60.0	2.7	-0.7	0.0	0.0	0.0	0.0	0.0	2.1
478	17624293.15	5050378.41	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	60.0	9.2	-0.7	0.0	0.0	0.0	0.0	0.0	-12.7
478	17624293.15	5050378.41	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	60.0	32.9	-0.7	0.0	0.0	0.0	0.0	0.0	-44.7

Point Source, ISO 9613, Name: "HVAC Condenser 6", ID: "HVAC_condenser6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
480	17624286.79	5050362.77	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	60.1	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-37.3
480	17624286.79	5050362.77	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	60.1	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-16.5
480	17624286.79	5050362.77	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	60.1	0.1	4.1	0.0	0.0	0.6	0.0	0.0	-3.6
480	17624286.79	5050362.77	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	60.1	0.3	2.1	0.0	0.0	2.7	0.0	0.0	2.5
480	17624286.79	5050362.77	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	60.1	0.5	-0.7	0.0	0.0	5.4	0.0	0.0	4.1
480	17624286.79	5050362.77	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	60.1	1.0	-0.7	0.0	0.0	5.4	0.0	0.0	1.0
480	17624286.79	5050362.77	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	60.1	2.8	-0.7	0.0	0.0	5.4	0.0	0.0	-3.5
480	17624286.79	5050362.77	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	60.1	9.3	-0.7	0.0	0.0	5.5	0.0	0.0	-18.3
480	17624286.79	5050362.77	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	60.1	33.3	-0.7	0.0	0.0	5.5	0.0	0.0	-50.6

Point Source, ISO 9613, Name: "HVAC Condenser 5", ID: "HVAC_condenser5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
484	17624290.96	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	60.1	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-37.3
484	17624290.96	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	60.1	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-16.5
484	17624290.96	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	60.1	0.1	4.1	0.0	0.0	0.6	0.0	0.0	-3.6
484	17624290.96	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	60.1	0.3	2.1	0.0	0.0	2.7	0.0	0.0	2.4
484	17624290.96	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	60.1	0.6	-0.7	0.0	0.0	5.4	0.0	0.0	4.1
484	17624290.96	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	60.1	1.0	-0.7	0.0	0.0	5.4	0.0	0.0	1.0
484	17624290.96	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	60.1	2.8	-0.7	0.0	0.0	5.4	0.0	0.0	-3.5
484	17624290.96	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	60.1	9.4	-0.7	0.0	0.0	5.4	0.0	0.0	-18.3
484	17624290.96	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	60.1	33.4	-0.7	0.0	0.0	5.4	0.0	0.0	-50.7

Point Source, ISO 9613, Name: "HVAC Condenser 7", ID: "HVAC_condenser7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
490	17624300.76	5050378.47	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	60.2	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-37.4
490	17624300.76	5050378.47	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	60.2	0.0	-3.3	0.0	0.0	8.1	0.0	0.0	-16.6
490	17624300.76	5050378.47	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	60.2	0.1	4.2	0.0	0.0	0.6	0.0	0.0	-3.7
490	17624300.76	5050378.47	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	60.2	0.3	2.1	0.0	0.0	2.7	0.0	0.0	2.4
490	17624300.76	5050378.47	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	60.2	0.6	-0.7	0.0	0.0	5.4	0.0	0.0	4.0
490	17624300.76	5050378.47	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	60.2	1.1	-0.7	0.0	0.0	5.4	0.0	0.0	0.9
490	17624300.76	5050378.47	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	60.2	2.8	-0.7	0.0	0.0	5.4	0.0	0.0	-3.6
490	17624300.76	5050378.47	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	60.2	9.4	-0.7	0.0	0.0	5.4	0.0	0.0	-18.5
490	17624300.76	5050378.47	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	60.2	33.7	-0.7	0.0	0.0	5.4	0.0	0.0	-51.0

Point Source, ISO 9613, Name: "HVAC Condenser 9", ID: "HVAC_condenser9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
492	17624296.83	5050362.76	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	60.3	0.0	-3.4	0.0	0.0	8.2	0.0	0.0	-37.5
492	17624296.83	5050362.76	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	60.3	0.0	-3.4	0.0	0.0	8.2	0.0	0.0	-16.8
492	17624296.83	5050362.76	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	60.3	0.1	4.2	0.0	0.0	0.6	0.0	0.0	-3.9
492	17624296.83	5050362.76	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	60.3	0.3	2.1	0.0	0.0	2.7	0.0	0.0	2.2
492	17624296.83	5050362.76	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	60.3	0.6	-0.7	0.0	0.0	5.4	0.0	0.0	3.9
492	17624296.83	5050362.76	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	60.3	1.1	-0.7	0.0	0.0	5.5	0.0	0.0	0.7
492	17624296.83	5050362.76	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	60.3	2.8	-0.7	0.0	0.0	5.5	0.0	0.0	-3.9
492	17624296.83	5050362.76	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	60.3	9.6	-0.7	0.0	0.0	5.5	0.0	0.0	-18.9
492	17624296.83	5050362.76	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	60.3	34.3	-0.7	0.0	0.0	5.6	0.0	0.0	-52.0

Point Source, ISO 9613, Name: "HVAC Condenser 8", ID: "HVAC_condenser8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
494	17624300.95	5050367.66	344.00	0	DEN	32	27.6	0.0	0.0	0.0	0.0	60.4	0.0	-3.4	0.0	0.0	8.2	0.0	0.0	-37.5
494	17624300.95	5050367.66	344.00	0	DEN	63	48.4	0.0	0.0	0.0	0.0	60.4	0.0	-3.4	0.0	0.0	8.2	0.0	0.0	-16.8
494	17624300.95	5050367.66	344.00	0	DEN	125	61.4	0.0	0.0	0.0	0.0	60.4	0.1	4.2	0.0	0.0	0.6	0.0	0.0	-3.9
494	17624300.95	5050367.66	344.00	0	DEN	250	67.6	0.0	0.0	0.0	0.0	60.4	0.3	2.1	0.0	0.0	2.7	0.0	0.0	2.2
494	17624300.95	5050367.66	344.00	0	DEN	500	69.5	0.0	0.0	0.0	0.0	60.4	0.6	-0.7	0.0	0.0	5.4	0.0	0.0	3.8
494	17624300.95	5050367.66	344.00	0	DEN	1000	66.9	0.0	0.0	0.0	0.0	60.4	1.1	-0.7	0.0	0.0	5.5	0.0	0.0	0.7
494	17624300.95	5050367.66	344.00	0	DEN	2000	64.1	0.0	0.0	0.0	0.0	60.4	2.8	-0.7	0.0	0.0	5.5	0.0	0.0	-3.9
494	17624300.95	5050367.66	344.00	0	DEN	4000	55.9	0.0	0.0	0.0	0.0	60.4	9.6	-0.7	0.0	0.0	5.5	0.0	0.0	-18.9
494	17624300.95	5050367.66	344.00	0	DEN	8000	47.6	0.0	0.0	0.0	0.0	60.4	34.4	-0.7	0.0	0.0	5.5	0.0	0.0	-51.9

Point Source, ISO 9613, Name: "UPS 1", ID: "UPS1"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
497	17624278.90	5050367.58	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	59.8	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-39.0
497	17624278.90	5050367.58	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	59.8	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-26.3
497	17624278.90	5050367.58	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	59.8	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-6.3
497	17624278.90	5050367.58	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	59.8	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-3.5
497	17624278.90	5050367.58	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	59.8	0.5	1.0	0.0	0.0	4.0	0.0	0.0	-4.2
497	17624278.90	5050367.58	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	59.8	1.0	-0.7	0.0	0.0	5.9	0.0	0.0	-0.9
497	17624278.90	5050367.58	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	59.8	2.7	-0.8	0.0	0.0	6.4	0.0	0.0	-1.6
497	17624278.90	5050367.58	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	59.8	9.0	-0.8	0.0	0.0	7.1	0.0	0.0	-13.1
497	17624278.90	5050367.58	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	59.8	32.2	-0.8	0.0	0.0	8.3	0.0	0.0	-48.9

Point Source, ISO 9613, Name: "UPS 3", ID: "UPS3"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)
499	17624288.82	5050378.40	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	59.9	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-39.1
499	17624288.82	5050378.40	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	59.9	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-26.4
499	17624288.82	5050378.40	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	59.9	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-6.3
499	17624288.82	5050378.40	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	59.9	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-3.5
499	17624288.82	5050378.40	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	59.9	0.5	1.0	0.0	0.0	3.8	0.0	0.0	-4.1
499	17624288.82	5050378.40	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	59.9	1.0	-0.7	0.0	0.0	5.6	0.0	0.0	-0.6
499	17624288.82	5050378.40	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	59.9	2.7	-0.8	0.0	0.0	5.8	0.0	0.0	-1.0
499	17624288.82	5050378.40	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	59.9	9.1	-0.8	0.0	0.0	6.0	0.0	0.0	-12.1
499	17624288.82	5050378.40	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	59.9	32.5	-0.8	0.0	0.0	6.4	0.0	0.0	-47.4

Point Source, ISO 9613, Name: "UPS 5", ID: "UPS5"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
501	17624286.54	5050367.66	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.0	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-39.2
501	17624286.54	5050367.66	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.0	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-26.5
501	17624286.54	5050367.66	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.0	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-6.5
501	17624286.54	5050367.66	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.0	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-3.6
501	17624286.54	5050367.66	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.0	0.5	1.0	0.0	0.0	4.1	0.0	0.0	-4.4
501	17624286.54	5050367.66	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.0	1.0	-0.7	0.0	0.0	6.0	0.0	0.0	-1.2
501	17624286.54	5050367.66	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.0	2.7	-0.8	0.0	0.0	6.6	0.0	0.0	-2.0
501	17624286.54	5050367.66	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.0	9.2	-0.8	0.0	0.0	7.4	0.0	0.0	-13.8
501	17624286.54	5050367.66	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.0	33.0	-0.8	0.0	0.0	8.7	0.0	0.0	-50.2

Point Source, ISO 9613, Name: "UPS 2", ID: "UPS2"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
504	17624283.74	5050362.73	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.0	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-39.3
504	17624283.74	5050362.73	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.0	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-26.6
504	17624283.74	5050362.73	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.0	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-6.6
504	17624283.74	5050362.73	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.0	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-3.7
504	17624283.74	5050362.73	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.0	0.5	1.0	0.0	0.0	4.2	0.0	0.0	-4.6
504	17624283.74	5050362.73	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.0	1.0	-0.7	0.0	0.0	6.2	0.0	0.0	-1.4
504	17624283.74	5050362.73	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.0	2.7	-0.8	0.0	0.0	7.0	0.0	0.0	-2.4
504	17624283.74	5050362.73	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.0	9.3	-0.8	0.0	0.0	8.0	0.0	0.0	-14.5
504	17624283.74	5050362.73	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.0	33.0	-0.8	0.0	0.0	9.6	0.0	0.0	-51.2

Point Source, ISO 9613, Name: "UPS 7", ID: "UPS7"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
506	17624296.42	5050378.45	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.1	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-39.3
506	17624296.42	5050378.45	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.1	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-26.6
506	17624296.42	5050378.45	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.1	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-6.5
506	17624296.42	5050378.45	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.1	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-3.7
506	17624296.42	5050378.45	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.1	0.5	1.0	0.0	0.0	3.9	0.0	0.0	-4.3
506	17624296.42	5050378.45	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.1	1.0	-0.7	0.0	0.0	5.6	0.0	0.0	-0.9
506	17624296.42	5050378.45	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.1	2.7	-0.8	0.0	0.0	5.9	0.0	0.0	-1.4
506	17624296.42	5050378.45	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.1	9.3	-0.8	0.0	0.0	6.2	0.0	0.0	-12.8
506	17624296.42	5050378.45	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.1	33.2	-0.8	0.0	0.0	6.8	0.0	0.0	-48.7

Point Source, ISO 9613, Name: "UPS 4", ID: "UPS4"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
508	17624293.53	5050373.46	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.1	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-39.3
508	17624293.53	5050373.46	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.1	0.0	-3.9	0.0	0.0	8.7	0.0	0.0	-26.6
508	17624293.53	5050373.46	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.1	0.1	3.1	0.0	0.0	1.7	0.0	0.0	-6.6
508	17624293.53	5050373.46	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.1	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-3.7
508	17624293.53	5050373.46	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.1	0.5	1.0	0.0	0.0	4.0	0.0	0.0	-4.4
508	17624293.53	5050373.46	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.1	1.0	-0.7	0.0	0.0	5.8	0.0	0.0	-1.1
508	17624293.53	5050373.46	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.1	2.8	-0.8	0.0	0.0	6.2	0.0	0.0	-1.7
508	17624293.53	5050373.46	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.1	9.3	-0.8	0.0	0.0	6.8	0.0	0.0	-13.3
508	17624293.53	5050373.46	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.1	33.3	-0.8	0.0	0.0	7.7	0.0	0.0	-49.6

Point Source, ISO 9613, Name: "UPS 6", ID: "UPS6"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
510	17624291.19	5050362.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.2	0.0	-4.0	0.0	0.0	8.8	0.0	0.0	-39.4
510	17624291.19	5050362.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.2	0.0	-4.0	0.0	0.0	8.8	0.0	0.0	-26.8
510	17624291.19	5050362.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.2	0.1	3.2	0.0	0.0	1.7	0.0	0.0	-6.8
510	17624291.19	5050362.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.2	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-3.8
510	17624291.19	5050362.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.2	0.6	1.0	0.0	0.0	4.2	0.0	0.0	-4.8
510	17624291.19	5050362.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.2	1.1	-0.7	0.0	0.0	6.3	0.0	0.0	-1.7
510	17624291.19	5050362.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.2	2.8	-0.8	0.0	0.0	7.1	0.0	0.0	-2.8
510	17624291.19	5050362.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.2	9.5	-0.8	0.0	0.0	8.3	0.0	0.0	-15.0
510	17624291.19	5050362.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.2	33.7	-0.8	0.0	0.0	9.9	0.0	0.0	-52.4

Point Source, ISO 9613, Name: "UPS 8", ID: "UPS8"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
512	17624296.53	5050367.72	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.3	0.0	-4.0	0.0	0.0	8.8	0.0	0.0	-39.5
512	17624296.53	5050367.72	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.3	0.0	-4.0	0.0	0.0	8.8	0.0	0.0	-26.8
512	17624296.53	5050367.72	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.3	0.1	3.2	0.0	0.0	1.7	0.0	0.0	-6.8
512	17624296.53	5050367.72	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.3	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-3.9
512	17624296.53	5050367.72	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.3	0.6	1.0	0.0	0.0	4.1	0.0	0.0	-4.8
512	17624296.53	5050367.72	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.3	1.1	-0.7	0.0	0.0	6.1	0.0	0.0	-1.6
512	17624296.53	5050367.72	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.3	2.8	-0.8	0.0	0.0	6.8	0.0	0.0	-2.5
512	17624296.53	5050367.72	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.3	9.5	-0.8	0.0	0.0	7.7	0.0	0.0	-14.6
512	17624296.53	5050367.72	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.3	33.9	-0.8	0.0	0.0	9.1	0.0	0.0	-51.8

Point Source, ISO 9613, Name: "UPS 9", ID: "UPS9"																				
Nr.	X	Y	Z	Refl.	DEN	Freq.	Lw	l/a	Optime	K0	Di	Adiv	Aatm	Agr	Afol	Ahous	Abar	Cmet	RL	Lr
	(m)	(m)	(m)			(Hz)	dB(A)	dB	dB	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	dB(A)
514	17624301.15	5050362.78	342.00	0	DEN	32	25.6	0.0	0.0	0.0	0.0	60.4	0.0	-4.0	0.0	0.0	8.8	0.0	0.0	-39.7
514	17624301.15	5050362.78	342.00	0	DEN	63	38.3	0.0	0.0	0.0	0.0	60.4	0.0	-4.0	0.0	0.0	8.9	0.0	0.0	-27.0
514	17624301.15	5050362.78	342.00	0	DEN	125	58.4	0.0	0.0	0.0	0.0	60.4	0.1	3.2	0.0	0.0	1.7	0.0	0.0	-7.0
514	17624301.15	5050362.78	342.00	0	DEN	250	61.8	0.0	0.0	0.0	0.0	60.4	0.3	5.1	0.0	0.0	0.0	0.0	0.0	-4.1
514	17624301.15	5050362.78	342.00	0	DEN	500	61.2	0.0	0.0	0.0	0.0	60.4	0.6	1.0	0.0	0.0	4.3	0.0	0.0	-5.1
514	17624301.15	5050362.78	342.00	0	DEN	1000	65.2	0.0	0.0	0.0	0.0	60.4	1.1	-0.7	0.0	0.0	6.4	0.0	0.0	-2.1
514	17624301.15	5050362.78	342.00	0	DEN	2000	66.5	0.0	0.0	0.0	0.0	60.4	2.9	-0.8	0.0	0.0	7.3	0.0	0.0	-3.2
514	17624301.15	5050362.78	342.00	0	DEN	4000	62.1	0.0	0.0	0.0	0.0	60.4	9.7	-0.8	0.0	0.0	8.5	0.0	0.0	-15.8
514	17624301.15	5050362.78	342.00	0	DEN	8000	50.7	0.0	0.0	0.0	0.0	60.4	34.7	-0.8	0.0	0.0	10.2	0.0	0.0	-53.9