

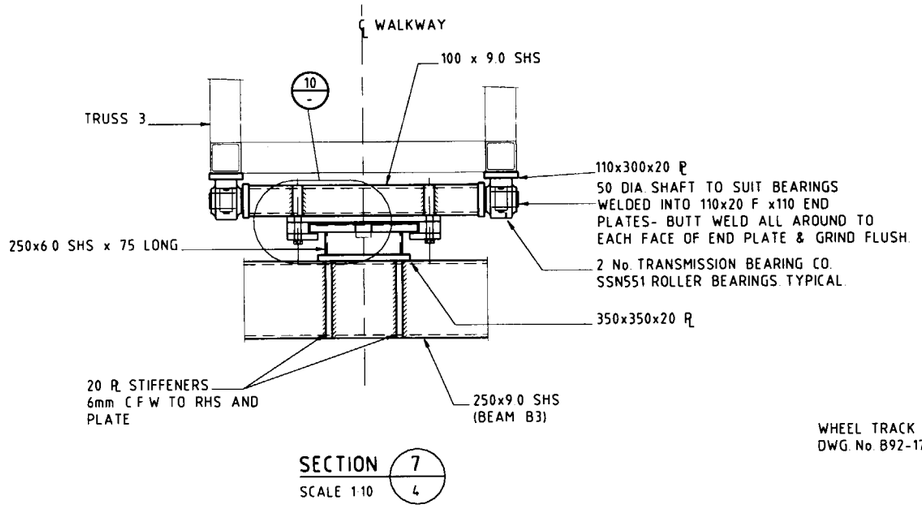



SECTION 7/4
SCALE 1:10

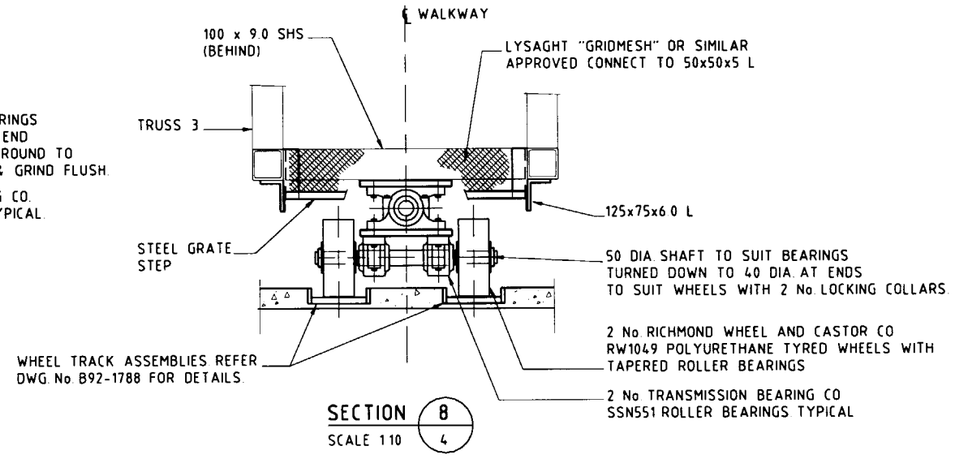

SECTION 8/4
SCALE 1:10

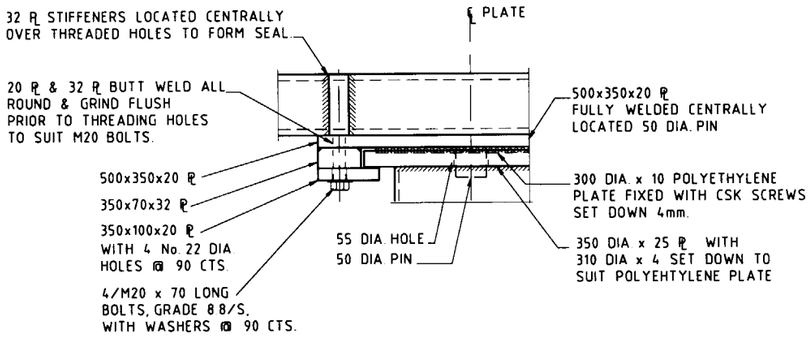

DETAIL 10/-
SCALE 1:5

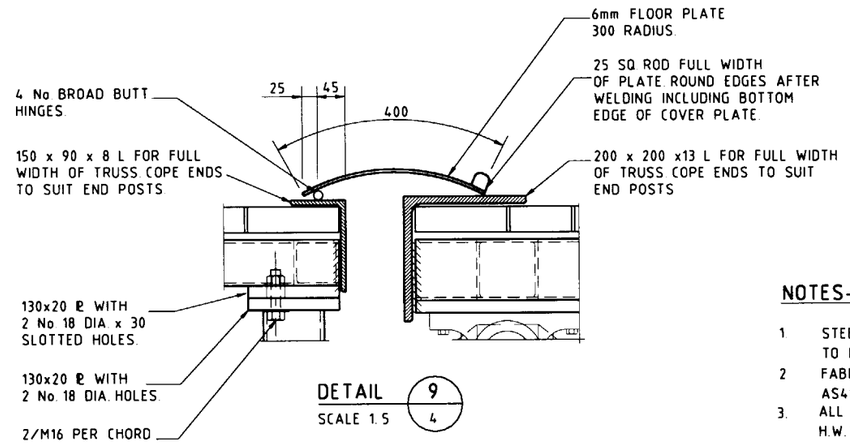

DETAIL 9/4
SCALE 1:5

NOTE: TRUSS END POSTS OMITTED FOR CLARITY

NOTES-

1. STEELWORK DIMENSIONS SHALL BE CONFIRMED ON SITE PRIOR TO FABRICATION
2. FABRICATION AND ERECTION OF STEELWORK SHALL CONFORM TO AS4100.
3. ALL TIMBER SHALL BE GRADE F14 MINIMUM SELANGUMUM BATU H.W. TIMBER.
4. ALL BOLTS SHALL BE GRADE 4.6/S TO AS1111 UNO.
5. ALL STEEL SHALL HAVE MIN YIELD STRESS 250 MPa AS PER AS4100. RHS MEMBERS SHALL BE GRADE C350 TO AS1163 UNO
6. ALL HOLLOW SECTIONS SHALL BE SEALED WITH CAPPING PLATES OF THICKNESS GREATER THAN WALL THICKNESS UNO
7. ALL WELDS SHALL BE 6mm FILLET WELDS FOR FULL PERIMETER OF CONTACT AND BE OF SP CATEGORY IN ACCORDANCE WITH AS1554
8. ALL BEARING AND WHEEL SHAFTS SHALL BE MACHINED TO TOLERANCES AS RECOMMENDED BY THE MANUFACTURER
9. ALL NUTS, BOLTS, WASHERS, NAILS, CHAINS AND SHACKLES SHALL BE HOT DIPPED GALVANISED.
10. ALL STEELWORK SHALL HAVE THE FOLLOWING SURFACE PROTECTIVE COATING-
    PREPARATION.. ABRASIVE BLAST TO AS1627.4 CLASS 3
    1st. COAT.....DULUX AMERLOK 400, DRY FILM THICKNESS 200 um.
    2nd COAT DULUX AMERLOK 400, DRY FILM THICKNESS 200 um. WHARF PRECINCT GREEN

MICROFILMED
Date: 02 OCT 1995

No.	DESCRIPTION	DATE	INIT.
1.	BEAM B2 TO B3; COVER PLATE TO FLOOR PLATE	09/92	A.M.

AMENDMENTS

No.	TITLE

ASSOCIATED DOCUMENTS

FILENAME B921765

DRAWN A.M.C.		CHECKED	
DATE	JUNE 1992	DATE	
DESIGN	N WRIGHT	CHECKED	
	JUNE 1992	DATE	
PROJECT OFFICER		SUPERVISING ENG./ARCH	
DATE			

NORTHERN TERRITORY OF AUSTRALIA
DEPARTMENT OF TRANSPORT AND WORKS
Copyright Reserved

DARWIN
WHARF PRECINCT-STOKES HILL WHARF
PONTOON ACCESS WALKWAY
TRUSS MOUNTING DETAILS- SHEET 2

FILE No.	SCALE Horiz. Vert.
SHEET 5 OF 5	AMEND 1
DRAWING No.	B92-1765