


PEPIN PRECAST

59 Shaw Rd Sanford Maine
 Telephone: 207-324-6125
 WWW.PEPINPRECAST.COM
 6' ID Duplex Pump Station
 Template

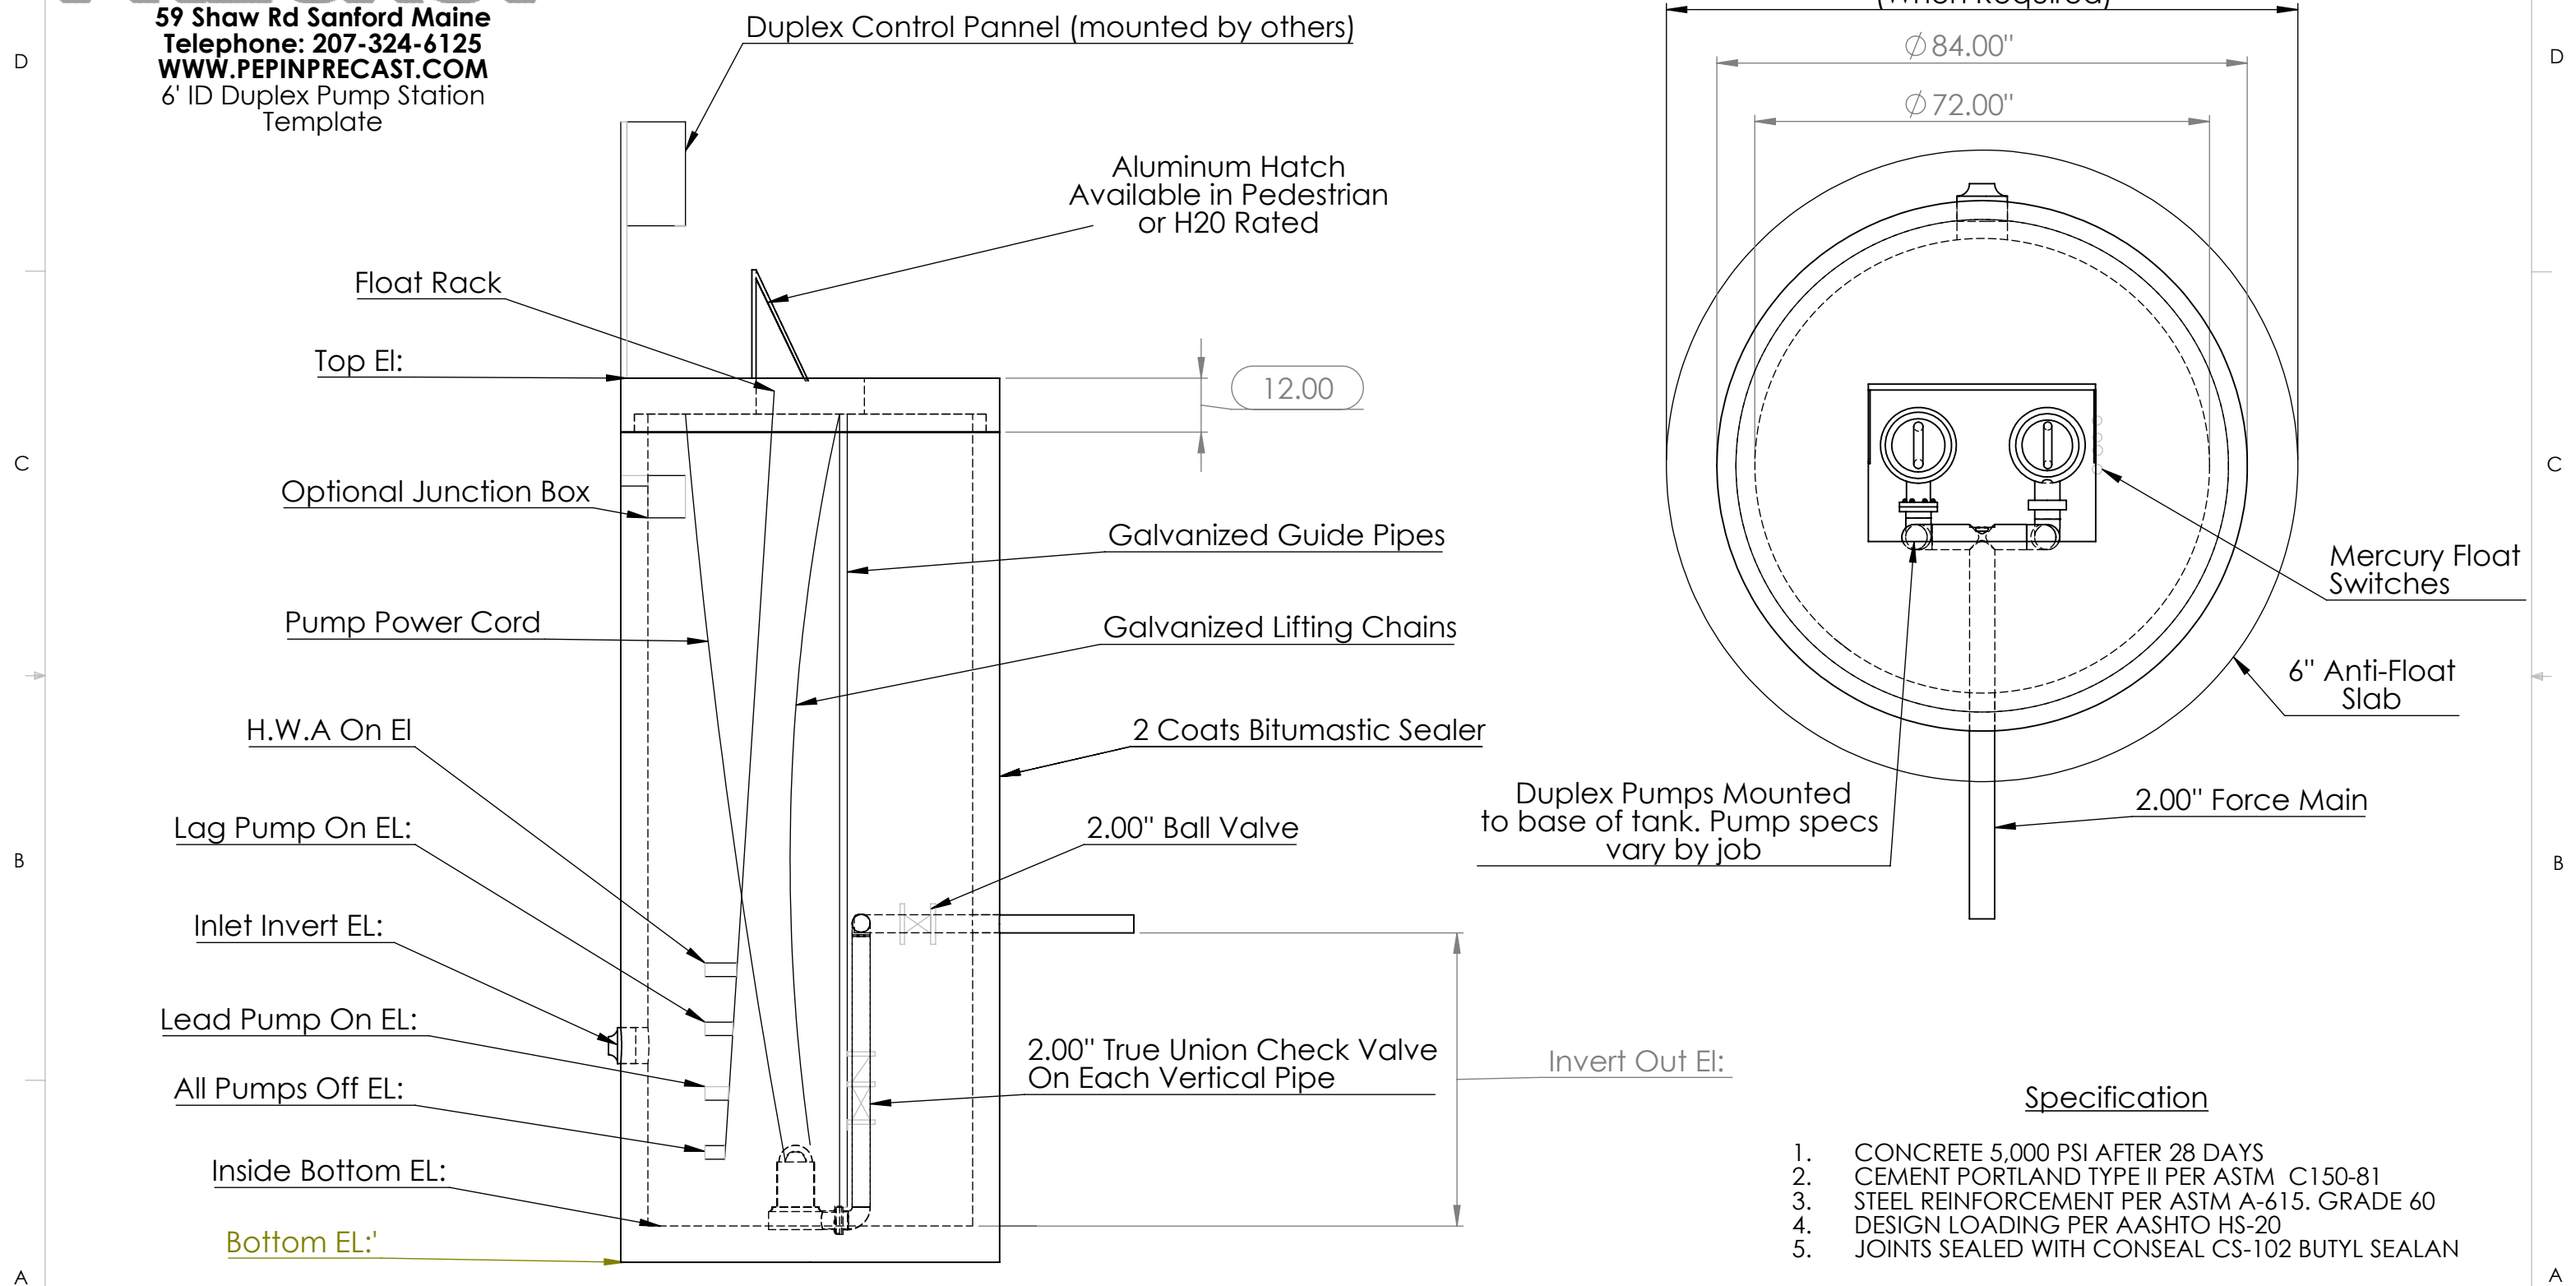

- Specification**
1. CONCRETE 5,000 PSI AFTER 28 DAYS
 2. CEMENT PORTLAND TYPE II PER ASTM C150-81
 3. STEEL REINFORCEMENT PER ASTM A-615. GRADE 60
 4. DESIGN LOADING PER AASHTO HS-20
 5. JOINTS SEALED WITH CONSEAL CS-102 BUTYL SEALAN

Bottom EL	All Pumps Off EL	Lead Pump On EL	Lag Pump On EL	H.W.A On EL	Top EL	Inlet Invert EL	Invert Out EL