


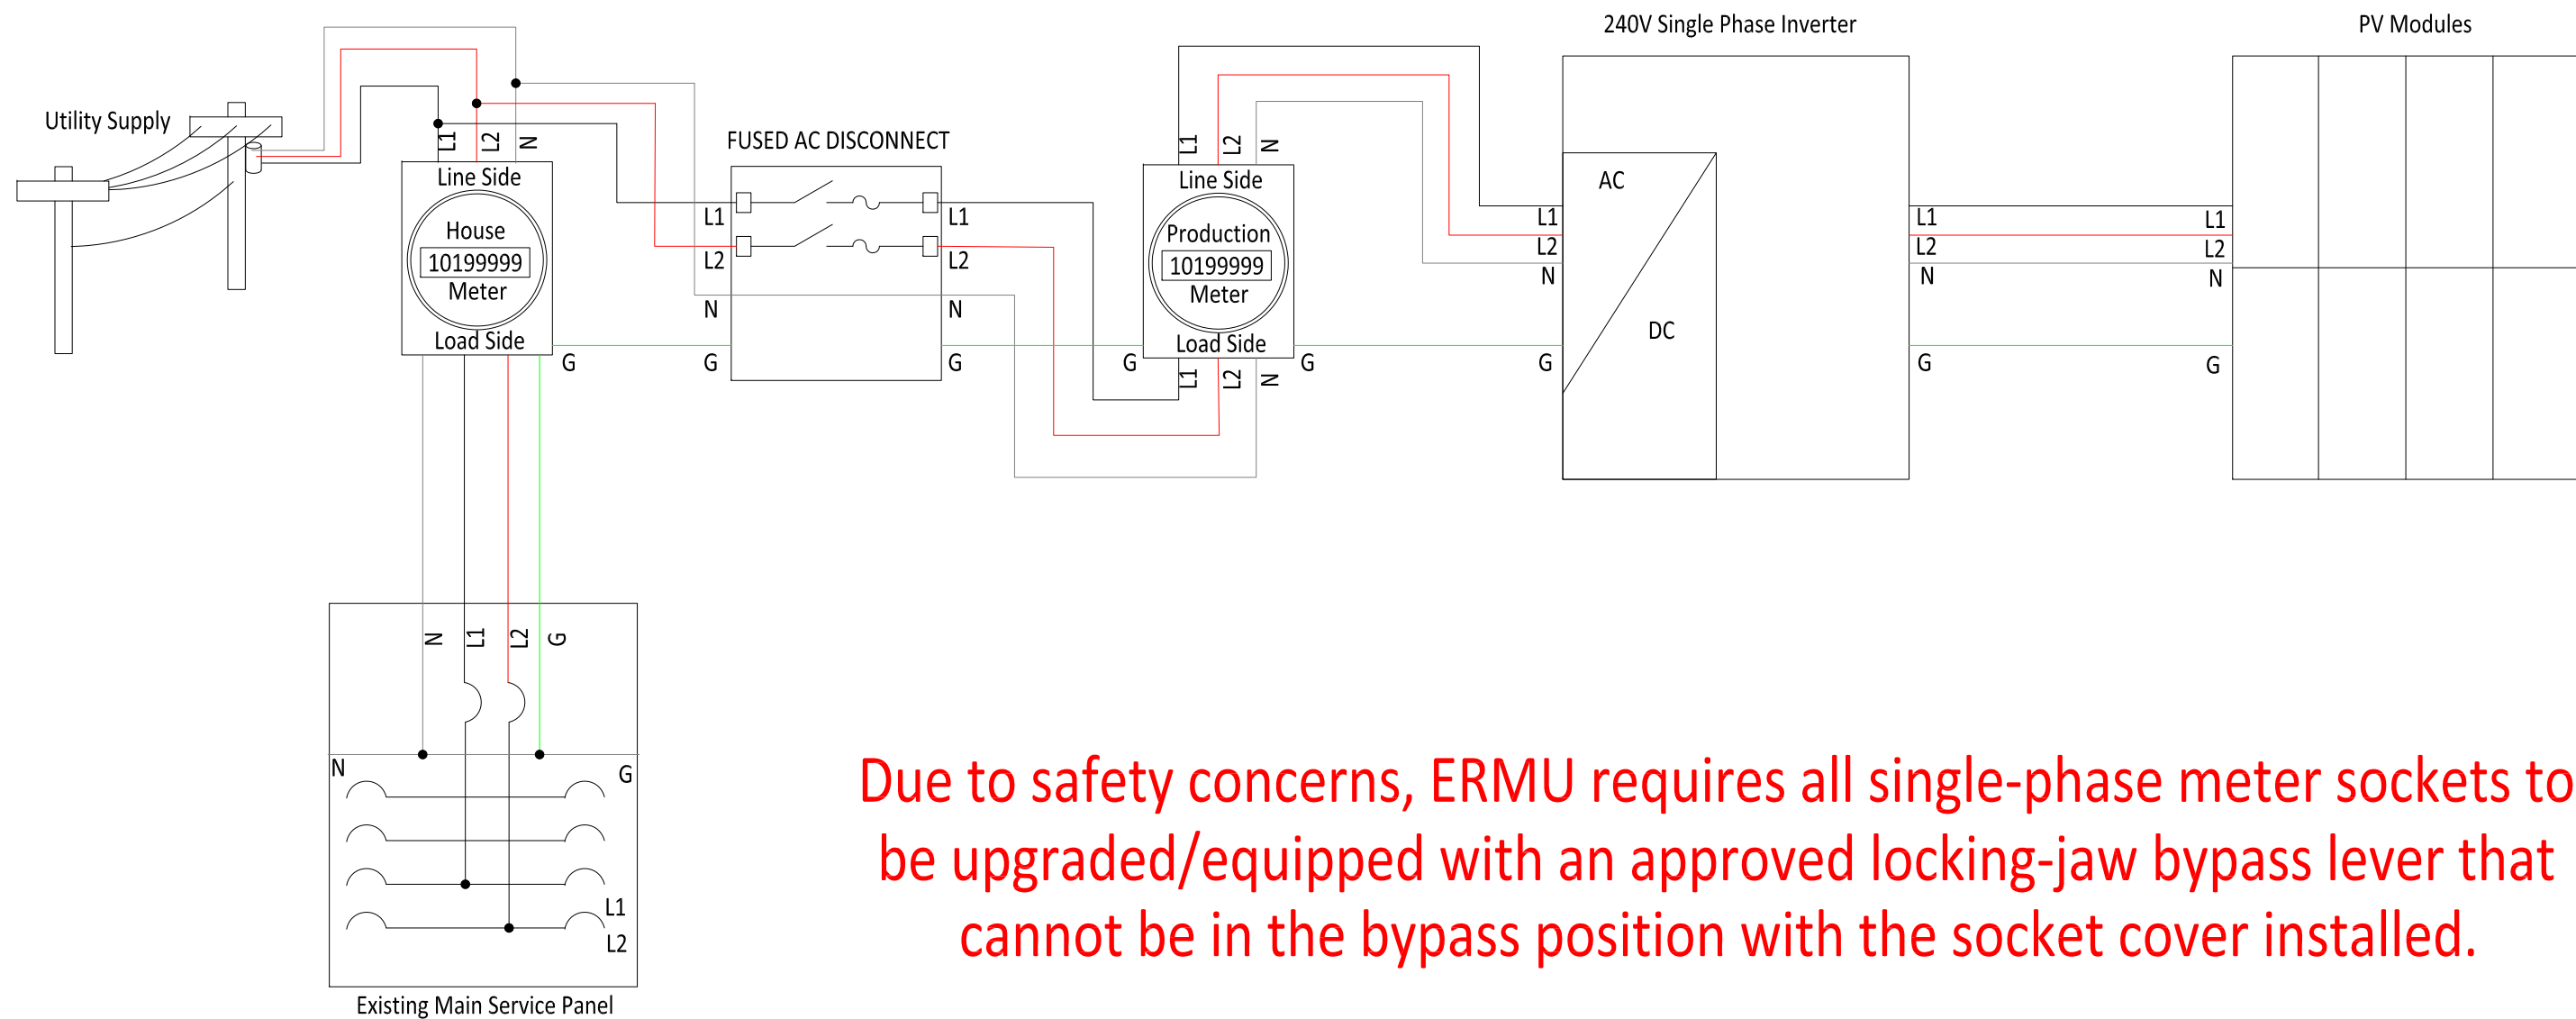

Due to safety concerns, ERMU requires all single-phase meter sockets to be upgraded/equipped with an approved locking-jaw bypass lever that cannot be in the bypass position with the socket cover installed.

- NOTES:
1. DOUBLE-LUGS REQUIRED ON LINE SIDE OF EXISTING HOUSE METER.
 2. FUSED AC DISCONNECT SHOULD BE INSTALLED IN THE OFF POSITION.
 3. CONTACT ERMU TO SCHEDULE DISCONNECT OF POWER AT HOUSE METER WHEN READY TO MAKE CONNECTIONS.
 4. ALL WIRING MUST MEET NEC REQUIREMENTS AND BE INSPECTED PRIOR TO INSTALLING ERMU PRODUCTION METER.