

AIR CONDITIONING SYSTEMS

CITY MULTI

DATA BOOK

MODEL

PUMY-SP100-140VKM2-PA, DA(-BS)

PUMY-SP100-140YKM2-PA, DA(-BS)

PUMY-CP100-140VKM2-PA, DA(-BS)

PUMY-CP100-140YKM2-PA(-BS)

PUMY-CP112-140VKM2-TH

PUMY-CP112-140YKM2-TH

Line-up of Outdoor Units of R410A CITY MULTI

S-Series



- | | |
|----------------------------|-----------------------------|
| PUMY-SP100VKM2-PA, DA(-BS) | PUMY-CP100VKM2-PA, DA(-BS) |
| PUMY-SP100YKM2-PA, DA(-BS) | PUMY-CP100YKM2-PA(-BS) |
| PUMY-SP125VKM2-PA, DA(-BS) | PUMY-CP112VKM2-TH |
| PUMY-SP125YKM2-PA, DA(-BS) | PUMY-CP112YKM2-TH |
| PUMY-SP140VKM2-PA, DA(-BS) | PUMY-CP125VKM2-TH |
| PUMY-SP140YKM2-PA, DA(-BS) | PUMY-CP125VKM2-PA, DA(-BS) |
| | PUMY-CP125YKM2-TH |
| | PUMY-CP125YKM2-PA(-BS) |
| | PUMY-CP140VKM2-TH |
| | PUMY-CP140VKM2-PA, -DA(-BS) |
| | PUMY-CP140YKM2-TH |
| | PUMY-CP140YKM2-PA(-BS) |

4, 4.5, 5, 6HP

PUMY-SP-YKM2, PUMY-SP-VKM2, PUMY-CP-YKM2, PUMY-CP-VKM2

1. SPECIFICATIONS	2
2. EXTERNAL DIMENSIONS	8
3. CENTER OF GRAVITY	10
4. ELECTRICAL WIRING DIAGRAMS	11
5. SOUND LEVELS	17
6. OPERATION TEMPERATURE RANGE	19
7. CAPACITY TABLES	20
7-1. Correction by temperature/total indoor	20
7-2. Correction by refrigerant piping length	56
7-3. Correction at frost and defrost	57
8. OPTIONAL PARTS	58
8-1. JOINT	58
8-2. HEADER	59
9. ELECTRICAL WORK	60
9-1. General cautions	60
9-2. Power supply for Outdoor unit	61
9-3. Power cable specifications	62
9-4. Power supply examples	64
10.M-NET CONTROL	65
10-1.Transmission cable length limitation	65
10-2.Transmission cable specifications	66
10-3.System configuration restrictions	67
10-4.Address setting	71
11.PIPING DESIGN	81
11-1.R410A Piping material	81
11-2.Piping Design	82
11-3.Refrigerant charging calculation	92
12.OUTDOOR INSTALLATION	93
12-1.Requirement on installation site	93
12-2.Spacing	95
12-3.Piping direction	96

1. SPECIFICATIONS

S-Series

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

Model				PUMY-SP100VKM2-PA, DA(-BS)	PUMY-SP125VKM2-PA, DA(-BS)	PUMY-SP140VKM2-PA, DA(-BS)	
Power source				1-phase 220-230-240 V, 50 Hz; 1-phase 220 V, 60 Hz			
Cooling capacity (Nominal)	kW *1			11.2	14.0	15.5	
	kcal/h *1			9,632	12,040	13,330	
	BTU/h *1			38,214	47,768	52,886	
	Power input			2.78	3.84	4.31	
	Current input			A 12.89-12.33-11.82,12.89	17.81-17.04-16.33,17.81	19.99-19.12-18.32,19.99	
Temp. range of cooling	EER			4.03	3.65	3.60	
	Indoor temp.			W.B.	15 to 24°C		
Outdoor temp.			D.B.	-5 to 52°C *3, *4			
Heating capacity (Nominal)	kW *2			12.5	16.0	16.5	
	kcal/h *2			10,750	13,760	14,190	
	BTU/h *2			42,650	54,592	56,298	
	Power input			2.58	3.90	4.02	
	Current input			A 11.97-11.45-10.97,11.97	18.09-17.30-16.58,18.09	18.65-17.83-17.09,18.65	
Temp. range of heating	COP			4.84	4.10	4.10	
	Indoor temp.			D.B.	15 to 27°C		
Outdoor temp.			W.B.	-20 to 15°C			
Indoor unit connectable				50 to 130% of outdoor unit capacity			
	Model/ Quantity	City Multi		P15-P125/7	P15-P140/10	P15-P140/12	
		Branch box		kW type: 22-100 BTU type: 10-18/7 Cal type: 22-63	kW type: 22-100 BTU type: 10-18/8 Cal type: 22-63	kW type: 22-100 BTU type: 10-18/8 Cal type: 22-63	
		Mixed system	Branch box 1 unit	City Multi	P15-P125/5	P15-P140/5	P15-P140/5
				Branch box	kW type: 22-100 BTU type: 10-18/5 Cal type: 22-63	kW type: 22-100 BTU type: 10-18/5 Cal type: 22-63	kW type: 22-100 BTU type: 10-18/5 Cal type: 22-63
			Branch box 2 unit	City Multi	P15-P125/3	P15-P140/3	P15-P140/3
				Branch box	kW type: 22-100 BTU type: 10-18/7 Cal type: 22-63	kW type: 22-100 BTU type: 10-18/8 Cal type: 22-63	kW type: 22-100 BTU type: 10-18/8 Cal type: 22-63
Sound pressure level (measured in anechoic room)				dB <A>	51/54	53/56	54/56
Refrigerant piping diameter	Liquid pipe			mm (inch)	9.52 (3/8)		
	Gas pipe			mm (inch)	15.88 (5/8)		
FAN	Type × Quantity			Propeller Fan × 1			
	Air flow rate			m³/min	75	83	83
				L/s	1250	1383	1383
				cfm	2648	2931	2931
	Control, Driving mechanism			DC control			
	Motor output			kW	0.20 × 1		
	External static press.			0 Pa / 30 Pa *6			
Compressor	Type × Quantity			Twin rotary hermetic compressor × 1			
	Manufacturer			Mitsubishi Electric Corporation			
	Starting method			Inverter			
	Capacity control			%	Cooling 29 to 100 Heating 24 to 100	Cooling 24 to 100 Heating 18 to 100	Cooling 21 to 100 Heating 17 to 100
	Motor output			kW	2.7	3.5	3.7
	Case heater			kW	0		
	Lubricant			FV50S (1.4liter)			
External finish				Galvanized Steel Sheet Munsell No. 3Y 7.8/1.1			
External dimension H × W × D				mm	981 × 1,050 × 330(+25)		
				inch	38-5/8 × 41-3/8 × 13 (+1)		
Protection devices	High pressure protection			High pressure Switch			
	Inverter circuit (COMP./FAN)			Overcurrent detection, Overheat detection(Heat sink thermistor)			
	Compressor			Compressor thermistor, Overcurrent detection			
	Fan motor			Overheating, Voltage protection			
Refrigerant	Type × original charge			R410A 3.5 kg			
	Control			Electronic expansion valve			
Net weight				kg (lb)	93 (205) *5		
Heat exchanger				Cross Fin and Copper tube			
HIC circuit (HIC: Heat Inter-Changer)				HIC circuit			
Defrosting method				Reversed refrigerant circuit			
Drawing	External			RK01B477			
	Wiring			BH79N078			
Standard attachment	Document			Installation Manual			
	Accessory			Grounded lead wire × 2			
Optional parts				Joint: CMY-Y62-G-E Header: CMY-Y64/68-G-E			
Remarks							Unit converter
* 1 Nominal cooling conditions							kcal/h = kW × 860 BTU/h = kW × 3,412 cfm = m³/min × 35.31 lb = kg/0.4536
Indoor : 27°C D.B./19°C W.B. (81°F D.B./66°F W.B.)							
Outdoor : 35°C D.B. (95°F D.B.)							
Pipe length : 7.5 m (24-9/16 ft)							
Level difference : 0 m (0 ft)							
* 2 Nominal heating conditions							Above specification data is subject to rounding variation.
20°C D.B. (68°F D.B.)							
7°C D.B./6°C W.B. (45°F D.B./43°F W.B.)							
7.5 m (24-9/16 ft)							
0 m (0 ft)							
*3 10 to 52:., when connecting following models: PKFY-P15/20/25VBM, PFFY-P20/25/32VLE(R)M, PFFY-P20/25/32VKM, and M series , S series , and P series type indoor unit with branch box , M series type indoor unit with connection kit.							Above specification data is subject to rounding variation.
*4 -15 to 52:., when using an optional air protect guide [PAC-SH95AG-E]. However, this condition does not apply to the indoor unit listed in *3.							
*5 94 (207), for PUMY-SP100/125/140VKM-BS.							
*6 0 Pa which is configured at the factory.							
Notes :1. Nominal conditions *1, *2 are subject to ISO 15042.							Above specification data is subject to rounding variation.
2. Due to continuing improvement, above specifications may be subject to change without notice.							

1. SPECIFICATIONS

S-Series

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

Model					PUMY-SP100YKM2-PA, DA(-BS)	PUMY-SP125YKM2-PA, DA(-BS)	PUMY-SP140YKM2-PA, DA(-BS)	
Power source					3-phase380-400-415V, 50 Hz; 3-phase 380 V, 60 Hz			
Cooling capacity (Nominal)	kW *1				11.2	14.0	15.5	
	kcal/h *1				9,632	12,040	13,330	
	BTU/h *1				38,214	47,768	52,886	
	Power input	kW				2.78	3.84	4.31
	Current input	A				4.45-4.22-4.07, 4.45	6.14-5.83-5.62, 6.14	6.89-6.55-6.31,6.89
Temp. range of cooling	EER	kW/kW				4.03	3.65	3.60
	Indoor temp.	W.B.				15 to 24°C		
Heating capacity (Nominal)	Outdoor temp.	D.B.				-5 to 52°C *3,*4		
	kW *2				12.5	16.0	16.5	
	kcal/h *2				10,750	13,760	14,190	
	BTU/h *2				42,650	54,592	56,298	
	Power input	kW				2.58	3.90	4.02
Temp. range of heating	Current input	A				4.13-3.92-3.78, 4.13	6.24-5.93-5.71, 6.24	6.43-6.11-5.89, 6.43
	COP	kW/kW				4.84	4.10	4.10
	Indoor temp.	D.B.				15 to 27°C		
Indoor unit connectable	Outdoor temp.	W.B.				-20 to 15°C		
	Total capacity				50 to 130% of outdoor unit capacity			
	Model/ Quantity	City Multi			P15-P125/7	P15-P140/10	P15-P140/12	
		Branch box			kW type: 22-100 BTU type: 10-18/7 Cal type: 22-63	kW type: 22-100 BTU type: 10-18/8 Cal type: 22-63	kW type: 22-100 BTU type: 10-18/8 Cal type: 22-63	
		Mixed system	Branch box 1 unit	City Multi	P15-125/5	P15-P140/5	P15-P140/5	
Branch box				kW type: 22-100 BTU type: 10-18/5 Cal type: 22-63	kW type: 22-100 BTU type: 10-18/5 Cal type: 22-63	kW type: 22-100 BTU type: 10-18/5 Cal type: 22-63		
		Branch box 2 unit	City Multi	P15-P125/3	P15-P140/3	P15-P140/3		
			Branch box	kW type: 22-100 BTU type: 10-18/7 Cal type: 22-63	kW type: 22-100 BTU type: 10-18/8 Cal type: 22-63	kW type: 22-100 BTU type: 10-18/8 Cal type: 22-63		
Sound pressure level (measured in anechoic room)					51/54	53/56	54/56	
Refrigerant piping diameter	Liquid pipe				mm (inch)	9.52 (3/8)		
	Gas pipe				mm (inch)	15.88 (5/8)		
FAN	Type × Quantity				Propeller Fan × 1			
	Air flow rate				m³/min	75	83	
					L/s	1250	1383	
					cfm	2648	2931	
	Control, Driving mechanism				DC control			
	Motor output				kW	0.20 × 1		
	External static press.				0 Pa / 30 Pa *6			
Compressor	Type × Quantity				Twin rotary hermetic compressor × 1			
	Manufacturer				Mitsubishi Electric Corporation			
	Starting method				Inverter			
	Capacity control	%				Cooling 29 to 100 Heating 24 to 100	Cooling 24 to 100 Heating 18 to 100	Cooling 21 to 100 Heating 17 to 100
	Motor output	kW				2.7	3.5	3.7
	Case heater	kW				0		
	Lubricant				FV50S (1.4litter)			
External finish					Galvanized Steel Sheet Munsell No. 3Y 7.8/1.1			
External dimension H × W × D					mm	981 × 1,050 × 330(+25)		
					inch	38-5/8 × 41-3/8 × 13 (+1)		
Protection devices	High pressure protection				High pressure Switch			
	Inverter circuit (COMP./FAN)				Overcurrent detection, Overheat detection(Heat sink thermistor)			
	Compressor				Compressor thermistor, Overcurrent detection			
	Fan motor				Overheating, Voltage protection			
Refrigerant	Type × original charge				R410A 3.5 kg			
	Control				Electronic expansion valve			
Net weight					kg (lb)	94 (207) *5		
Heat exchanger					Cross Fin and Copper tube			
HIC circuit (HIC: Heat Inter-Changer)					HIC circuit			
Defrosting method					Reversed refrigerant circuit			
Drawing					External	RK01B477		
					Wiring	BH79N079		
Standard attachment					Document	Installation Manual		
					Accessory	Grounded lead wire × 2		
Optional parts					Joint: CMY-Y62-G-E Header: CMY-Y64/68-G-E			
Remarks								
*1 Nominal cooling conditions				*2 Nominal heating conditions				
Indoor : 27°C D.B./19°C W.B. [81°F D.B./66°F W.B.]				20°C D.B. [68°F D.B.]				
Outdoor : 35°C D.B. [95°F D.B.]				7°C DB/6°C W.B. [45°F D.B./43°F W.B.]				
Pipe length : 7.5 m [24-9/16 ft]				7.5 m [24-9/16 ft]				
Level difference : 0 m [0 ft]				0 m [0 ft]				
*3 10 to 52: when connecting following models: PKFY-P15/20/25VBM, PFFY-P20/25/32VLE(R)M, PFFY-P20/25/32VKM, and M series , S series , and P series type indoor unit with branch box , M series type indoor unit with connection kit.								
*4 -15 to 52: when using an optional air protect guide [PAC-SH95AG-E]. However, this condition does not apply to the indoor unit listed in *3.								
*5 95 (209), for PUMY-SP100/125/140YKM-BS.								
*6 0 Pa which is configured at the factory.								
Notes : 1. Nominal conditions *1, *2 are subject to ISO 15042.								
2. Due to continuing improvement, above specifications may be subject to change without notice.								
						Unit converter		
						kcal/h = kW × 860 BTU/h = kW × 3,412 cfm = m³/min × 35.31 lb = kg/0.4536		
						Above specification data is subject to rounding variation.		

1. SPECIFICATIONS

S-Series

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

Model					PUMY-CP100VKM2-PA, DA(-BS)		PUMY-CP125VKM2-PA, DA(-BS)		PUMY-CP140VKM2-PA, DA(-BS)					
Power source					1-phase 220-230-240V, 50Hz; 1-phase 220V, 60Hz									
Cooling capacity (Nominal)			kW *1		11.2		14.0		15.5					
			kcal/h *1		9,600		12,000		13,300					
			BTU/h *1		38,200		47,800		52,900					
			Power input		kW		2.80		3.84		4.70			
			Current input		A		12.99-12.42-11.90, 12.99		17.81-17.04-16.33, 17.81		21.80-20.85-19.98, 21.80			
EER			kW/kW		4.00		3.65		3.30					
Temp. range of cooling			Indoor temp.		W.B.		15 to 24°C							
			Outdoor temp.		D.B.		10 to 52°C							
Indoor unit connectable			Total capacity		50 to 130% of outdoor unit capacity									
			Model/ Quantity		City Multi Branch box		P15-P140/7		P15-P140/10		P15-P140/12			
							kW type: 22-100 BTU type: 09-30/7 Cal type: 22-63		kW type: 22-100 BTU type: 09-30/8 Cal type: 22-63		kW type: 22-100 BTU type: 09-30/8 Cal type: 22-63			
			Mixed system		Branch box 1 unit		City Multi Branch box		P15-P140/5		P15-P140/5		P15-P140/5	
									kW type: 22-100 BTU type: 09-30/5 Cal type: 22-63		kW type: 22-100 BTU type: 09-30/5 Cal type: 22-63		kW type: 22-100 BTU type: 09-30/5 Cal type: 22-63	
									P15-P140/3		P15-P140/3		P15-P140/3	
Branch box 2 unit		City Multi Branch box		P15-P140/3		P15-P140/3		P15-P140/3						
				kW type: 22-100 BTU type: 09-30/7 Cal type: 22-63		kW type: 22-100 BTU type: 09-30/8 Cal type: 22-63		kW type: 22-100 BTU type: 09-30/8 Cal type: 22-63						
Sound pressure level (measured in anechoic room)					dB <A>		52		53		54			
Refrigerant piping diameter			Liquid pipe		mm (inch)		9.52 (3/8)							
			Gas pipe		mm (inch)		15.88 (5/8)							
FAN			Type × Quantity		Propeller Fan × 1									
			Air flow rate		m³/min		78.8							
					L/s		1,313							
					cfm		2,782							
			Control, Driving mechanism		DC control									
			Motor output		kW		0.20 x 1							
			External static press.		0 Pa / 30 Pa *4									
Compressor			Type × Quantity		Twin rotary hermetic compressor × 1									
			Manufacture		Mitsubishi Electric Corporation									
			Starting method		Inverter									
			Capacity control		%		Cooling 29 to 100		Cooling 24 to 100		Cooling 21 to 100			
			Motor output		kW		2.2		2.7		3.0			
			Case heater		kW		0							
			Lubricant		FV50S (1.4 litter)									
External finish					Galvanized Steel Sheet Munsell No. 3Y 7.8/1.1									
External dimension H × W × D			mm		981 × 1050 × 330(+25)									
			inch		38-5/8 × 41-3/8 × 13(+1)									
Protection devices			High pressure protection		High pressure switch									
			Inverter circuit (COMP./FAN)		Overcurrent detection, Overheat detection (Heat Sink thermistor)									
			Compressor		Compressor thermistor, Overcurrent detection									
			Fan motor		Overheating, Voltage protection									
Refrigerant			Type × original charge		R410A 2.9kg									
			Control		Electronic Expansion Valve									
Net weight			kg (lb)		86 (190) *3									
Heat exchanger					Micro Slit Fin and Copper tube									
HIC circuit (HIC: Heat Inter-Changer)					HIC circuit									
Defrosting method					—									
Drawing			External		BK01V828									
			Wiring		BH79J771/BH79J776									
Standard attachment			Document		Installation Manual									
			Accessory		Grounded lead wire × 2									
Optional parts					Joint: CMY-Y62-G-E Header: CMY-Y64/68-G-E									
Remarks					*1 Nominal cooling conditions							Unit converter		
Indoor :					27°C D.B./19°C W.B. [81°F D.B/66°F W.B.]							kcal/h = kW × 860 BTU/h = kW × 3,412 cfm = m³/min × 35.31 lb = kg/0.4536		
Outdoor :					35°C D.B. [95°F D.B.]									
Pipe length :					7.5 m [24-9/16 ft]									
Level difference :					0 m [0 ft]									
*2 When connecting 7 indoor units via branch box, connectable CityMuliti indoor units are 3; connecting 8 indoor units via branch box, connectable CityMuliti indoor units are 2.					Above specification data is subject to rounding variation.									
*3 87 (192), for PUMY-CP100/125/140VKM-BS.														
*4 0 Pa which is configured at the factory.														
Notes : 1. Nominal conditions *1 are subject to ISO 15042. 2. Due to continuing improvement, above specifications may be subject to change without notice.														

1. SPECIFICATIONS

S-Series

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

Model					PUMY-CP100YKM2-PA(-BS)		PUMY-CP125YKM2-PA(-BS)		PUMY-CP140YKM2-PA(-BS)								
Power source					3-phase 380-400-415V, 50Hz; 3-phase 380V, 60Hz												
Cooling capacity (Nominal)					kW *1		11.2		14.0		15.5						
					kcal/h *1		9,600		12,000		13,300						
					BTU/h *1		38,200		47,800		52,900						
					Power input		kW		2.80		3.84		4.70				
					Current input		A		4.48-4.25-4.10, 4.48		6.14-5.83-5.62, 6.14		7.52-7.14-6.88, 7.52				
EER					kW/kW		4.00		3.65		3.30						
Temp. range of cooling					Indoor temp.		W.B.		15 to 24°C								
					Outdoor temp.		D.B.		10 to 52°C								
Indoor unit connectable					Total capacity		50 to 130% of outdoor unit capacity										
Model/ Quantity					City Multi Branch box		P15-P140/7		P15-P140/10		P15-P140/12						
							kW type: 22-100		kW type: 22-100		kW type: 22-100						
							BTU type: 09-30/7		BTU type: 09-30/8		BTU type: 09-30/8						
					Mixed system					Branch box 1 unit		City Multi Branch box		P15-P140/5		P15-P140/5	
										kW type: 22-100		kW type: 22-100		kW type: 22-100			
										BTU type: 09-30/5		BTU type: 09-30/5		BTU type: 09-30/5			
Branch box 2 unit					City Multi Branch box		P15-P140/3		P15-P140/3		P15-P140/3						
					kW type: 22-100		kW type: 22-100		kW type: 22-100								
					BTU type: 09-30/7		BTU type: 09-30/8		BTU type: 09-30/8								
Sound pressure level (measured in anechoic room)					dB <A>		52		53		54						
Refrigerant piping diameter					Liquid pipe		mm (inch)		9.52 (3/8)								
					Gas pipe		mm (inch)		15.88 (5/8)								
FAN					Type × Quantity		Propeller Fan × 1										
Air flow rate					m³/min		78.8										
					L/s		1,313										
					cfm		2,782										
					Control, Driving mechanism		DC control										
Motor output					kW		0.20 × 1										
External static press.					0 Pa / 30 Pa *4												
Compressor					Type × Quantity		Twin rotary hermetic compressor × 1										
					Manufacture		Mitsubishi Electric Corporation										
					Starting method		Inverter										
					Capacity control		%		Cooling 29 to 100		Cooling 24 to 100		Cooling 21 to 100				
					Motor output		kW		2.2		2.7		3.0				
					Case heater		kW		0								
					Lubricant		FV50S (1.4 liter)										
External finish					Galvanized Steel Sheet Munsell No. 3Y 7.8/1.1												
External dimension H × W × D					mm		981 × 1050 × 330(+25)										
					inch		38-5/8 × 41-3/8 × 13(+1)										
Protection devices					High pressure protection		High pressure switch										
					Inverter circuit (COMP./FAN)		Overcurrent detection, Overheat detection (Heat Sink thermistor)										
					Compressor		Compressor thermistor, Overcurrent detection										
					Fan motor		Overheating, Voltage protection										
Refrigerant					Type × original charge		R410A 2.9kg										
					Control		Electronic Expansion Valve										
Net weight					kg (lb)		87 (191)*3										
Heat exchanger					Micro Slit Fin and Copper tube												
HIC circuit (HIC: Heat Inter-Changer)					HIC circuit												
Defrosting method					—												
Drawing					External		BK01V828										
					Wiring		BH79J772/BH79J777										
Standard attachment					Document		Installation Manual										
					Accessory		Grounded lead wire × 2										
Optional parts					Joint: CMY-Y62-G-E Header: CMY-Y64/68-G-E												
Remarks												Unit converter					
*1 Nominal cooling conditions												kcal/h = kW × 860 BTU/h = kW × 3,412 cfm = m³/min × 35.31 lb = kg/0.4536 Above specification data is subject to rounding variation.					
Indoor : 27°C D.B./19°C W.B. [81°F D.B/66°F W.B.]																	
Outdoor : 35°C D.B. [95°F D.B.]																	
Pipe length : 7.5 m [24-9/16 ft]																	
Level difference : 0 m [0 ft]																	
*2 When connecting 7 indoor units via branch box, connectable CityMulti indoor units are 3; connecting 8 indoor units via branch box, connectable CityMulti indoor units are 2.																	
*3 88 (195), for PUMY-CP100/125/140YKM-BS.																	
*4 0 Pa which is configured at the factory.																	
Notes : 1. Nominal conditions *1 are subject to ISO 15042.																	
2. Due to continuing improvement, above specifications may be subject to change without notice.																	

1. SPECIFICATIONS

S-Series

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

Model				PUMY-CP112VKM2-TH		PUMY-CP125VKM2-TH		PUMY-CP140VKM2-TH							
Power source				1-phase 220V,50Hz											
Cooling capacity (Nominal)				kW *1		12.5		14.0		15.5					
				kcal/h *1		10,800		12,000		13,300					
				BTU/h *1		42,700		47,800		52,900					
				Power input		kW		3.10		3.84		4.70			
				Current input		A		14.38		17.81		21.80			
				EER		kW/kW		4.03		3.65		3.30			
Temp. range of cooling				Indoor temp.		W.B.		15 to 24°C							
				Outdoor temp.		D.B.		10 to 52°C							
Indoor unit connectable				Total capacity		50 to 130% of outdoor unit capacity									
				Model/ Quantity		City Multi		P15-P140/8		P15-P140/10		P15-P140/12			
						Branch box		kW type: 22-100 BTU type: 09-30/8		kW type: 22-100 BTU type: 09-30/8 Cal type: 22-63		kW type: 22-100 BTU type: 09-30/8 Cal type: 22-63			
				Mixed system		Branch box 1 unit		City Multi		P15-P140/5		P15-P140/5		P15-P140/5	
								Branch box		kW type: 22-100 BTU type: 09-30/5 Cal type: 22-63		kW type: 22-100 BTU type: 09-30/5 Cal type: 22-63			
						Branch box 2 unit		City Multi		P15-P140/3 or 2 *2		P15-P140/3		P15-P140/3	
Branch box		kW type: 22-100 BTU type: 09-30/7 or 8 *2						kW type: 22-100 BTU type: 09-30/8 Cal type: 22-63		kW type: 22-100 BTU type: 09-30/8 Cal type: 22-63					
Sound pressure level (measured in anechoic room)				dB <A>		52		53		54					
Refrigerant piping diameter				Liquid pipe		mm (inch)		9.52 (3/8)							
				Gas pipe		mm (inch)		15.88 (5/8)							
FAN				Type × Quantity		Propeller Fan × 1									
				Air flow rate		m³/min		78.8							
						L/s		1,313							
						cfm		2,782							
				Control, Driving mechanism		DC control									
				Motor output		kW		0.20 x 1							
				External static press.		0 Pa / 30 Pa *4									
Compressor				Type × Quantity		Twin rotary hermetic compressor × 1									
				Manufacture		Mitsubishi Electric Corporation									
				Starting method		Inverter									
				Capacity control		%		Cooling 26 to 100		Cooling 24 to 100		Cooling 21 to 100			
				Motor output		kW		2.3		2.7		3.0			
				Case heater		kW		0							
				Lubricant		FV50S (1.4 litter)									
External finish				Galvanized Steel Sheet Munsell No. 3Y 7.8/1.1											
External dimension H × W × D				mm		981 × 1050 × 330(+25)									
				inch		38-5/8 × 41-3/8 × 13(+1)									
Protection devices				High pressure protection		High pressure switch									
				Inverter circuit (COMP./FAN)		Overcurrent detection, Overheat detection (Heat Sink thermistor)									
				Compressor		Compressor thermistor, Overcurrent detection									
				Fan motor		Overheating, Voltage protection									
Refrigerant				Type × original charge		R410A 2.9kg									
				Control		Electronic Expansion Valve									
Net weight				kg (lb)		86 (190) *3									
Heat exchanger				Micro Slit Fin and Copper tube											
HIC circuit (HIC: Heat Inter-Changer)				HIC circuit											
Defrosting method				—											
Drawing				External		BK01V828									
				Wiring		BH79J771/BH79J776									
Standard attachment				Document		Installation Manual									
				Accessory		Grounded lead wire × 2									
Optional parts				Joint: CMY-Y62-G-E Header: CMY-Y64/68-G-E											
Remarks												Unit converter			
*1 Nominal cooling conditions															
Indoor : 27°C D.B./19°C W.B. [81°F D.B./66°F W.B.]															
Outdoor : 35°C D.B. [95°F D.B.]															
Pipe length : 7.5 m [24-9/16 ft]															
Level difference : 0 m [0 ft]															
*2 When connecting 7 indoor units via branch box, connectable CityMulti indoor units are 3; connecting 8 indoor units via branch box, connectable CityMulti indoor units are 2.															
*3 87 (192), for PUMY-CP100/125/140VKM-BS.															
*4 0 Pa which is configured at the factory.															
Notes : 1. Nominal conditions *1 are subject to ISO 15042.															
2. Due to continuing improvement, above specifications may be subject to change without notice.															
												kcal/h = kW × 860 BTU/h = kW × 3,412 cfm = m³/min × 35.31 lb = kg/0.4536			
												Above specification data is subject to rounding variation.			

1. SPECIFICATIONS


S-Series

Model					PUMY-CP112YKM2-TH		PUMY-CP125YKM2-TH		PUMY-CP140YKM2-TH							
Power source					3-phase 380V,50Hz											
Cooling capacity (Nominal)					kW *1	12.5		14.0		15.5						
					kcal/h *1	10,800		12,000		13,300						
					BTU/h *1	42,700		47,800		52,900						
					Power input	kW	3.10		3.84		4.70					
					Current input	A	4.96		6.14		7.52					
EER					kW/kW	4.03		3.65		3.30						
Temp. range of cooling					Indoor temp.		W.B.		15 to 24°C							
					Outdoor temp.		D.B.		10 to 52°C							
Indoor unit connectable					Total capacity		50 to 130% of outdoor unit capacity									
Model/ Quantity					City Multi Branch box		P15-P140/8		P15-P140/10		P15-P140/12					
							kW type: 22-100 BTU type: 09-30/8		kW type: 22-100 BTU type: 09-30/8 Cal type: 22-63		kW type: 22-100 BTU type: 09-30/8 Cal type: 22-63					
					Mixed system		Branch box 1 unit		City Multi Branch box		P15-P140/5		P15-P140/5		P15-P140/5	
							kW type: 22-100 BTU type: 09-30/5		kW type: 22-100 BTU type: 09-30/5 Cal type: 22-63		kW type: 22-100 BTU type: 09-30/5 Cal type: 22-63					
					Branch box 2 unit		City Multi Branch box		P15-P140/3 or 2 *2		P15-P140/3		P15-P140/3			
kW type: 22-100 BTU type: 09-30/7 or 8 *2		kW type: 22-100 BTU type: 09-30/8 Cal type: 22-63		kW type: 22-100 BTU type: 09-30/8 Cal type: 22-63												
Sound pressure level (measured in anechoic room)					dB <A>		52		53		54					
Refrigerant piping diameter					Liquid pipe		mm (inch)		9.52 (3/8)							
					Gas pipe		mm (inch)		15.88 (5/8)							
FAN					Type × Quantity		Propeller Fan × 1									
Air flow rate					m³/min		78.8									
							1,313									
							2,782									
					Control, Driving mechanism		DC control									
					Motor output		kW		0.20 x 1							
External static press.					0 Pa / 30 Pa *4											
Compressor					Type × Quantity		Twin rotary hermetic compressor × 1									
					Manufacture		Mitsubishi Electric Corporation									
					Starting method		Inverter									
					Capacity control		%		Cooling 26 to 100		Cooling 24 to 100		Cooling 21 to 100			
					Motor output		kW		2.3		2.7		3.0			
					Case heater		kW		0							
					Lubricant		FV50S (1.4 litter)									
External finish					Galvanized Steel Sheet Munsell No. 3Y 7.8/1.1											
External dimension H × W × D					mm		981 × 1050 × 330(+25)									
					inch		38-5/8 × 41-3/8 × 13(+1)									
Protection devices					High pressure protection		High pressure switch									
					Inverter circuit (COMP./FAN)		Overcurrent detection, Overheat detection (Heat Sink thermistor)									
					Compressor		Compressor thermistor, Overcurrent detection									
					Fan motor		Overheating, Voltage protection									
Refrigerant					Type × original charge		R410A 2.9kg									
					Control		Electronic Expansion Valve									
Net weight					kg (lb)		87 (191)*3									
Heat exchanger					Micro Slit Fin and Copper tube											
HIC circuit (HIC: Heat Inter-Changer)					HIC circuit											
Defrosting method					—											
Drawing					External		BK01V828									
					Wiring		BH79J772/BH79J777									
Standard attachment					Document		Installation Manual									
					Accessory		Grounded lead wire × 2									
Optional parts					Joint: CMY-Y62-G-E Header: CMY-Y64/68-G-E											
Remarks												Unit converter				
*1 Nominal cooling conditions												kcal/h = kW × 860 BTU/h = kW × 3,412 cfm = m³/min × 35.31 lb = kg/0.4536				
Indoor : 27°C D.B./19°C W.B. [81°F D.B/66°F W.B.]																
Outdoor : 35°C D.B. [95°F D.B.]																
Pipe length : 7.5 m [24-9/16 ft]																
Level difference : 0 m [0 ft]												Above specification data is subject to rounding variation.				
*2 When connecting 7 indoor units via branch box, connectable CityMulti indoor units are 3; connecting 8 indoor units via branch box, connectable CityMulti indoor units are 2.																
*3 88 (195), for PUMY-CP100/125/140YKM-BS.																
*4 0 Pa which is configured at the factory.																
Notes : 1. Nominal conditions *1 are subject to ISO 15042.																
2. Due to continuing improvement, above specifications may be subject to change without notice.																

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

Unit: mm


PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

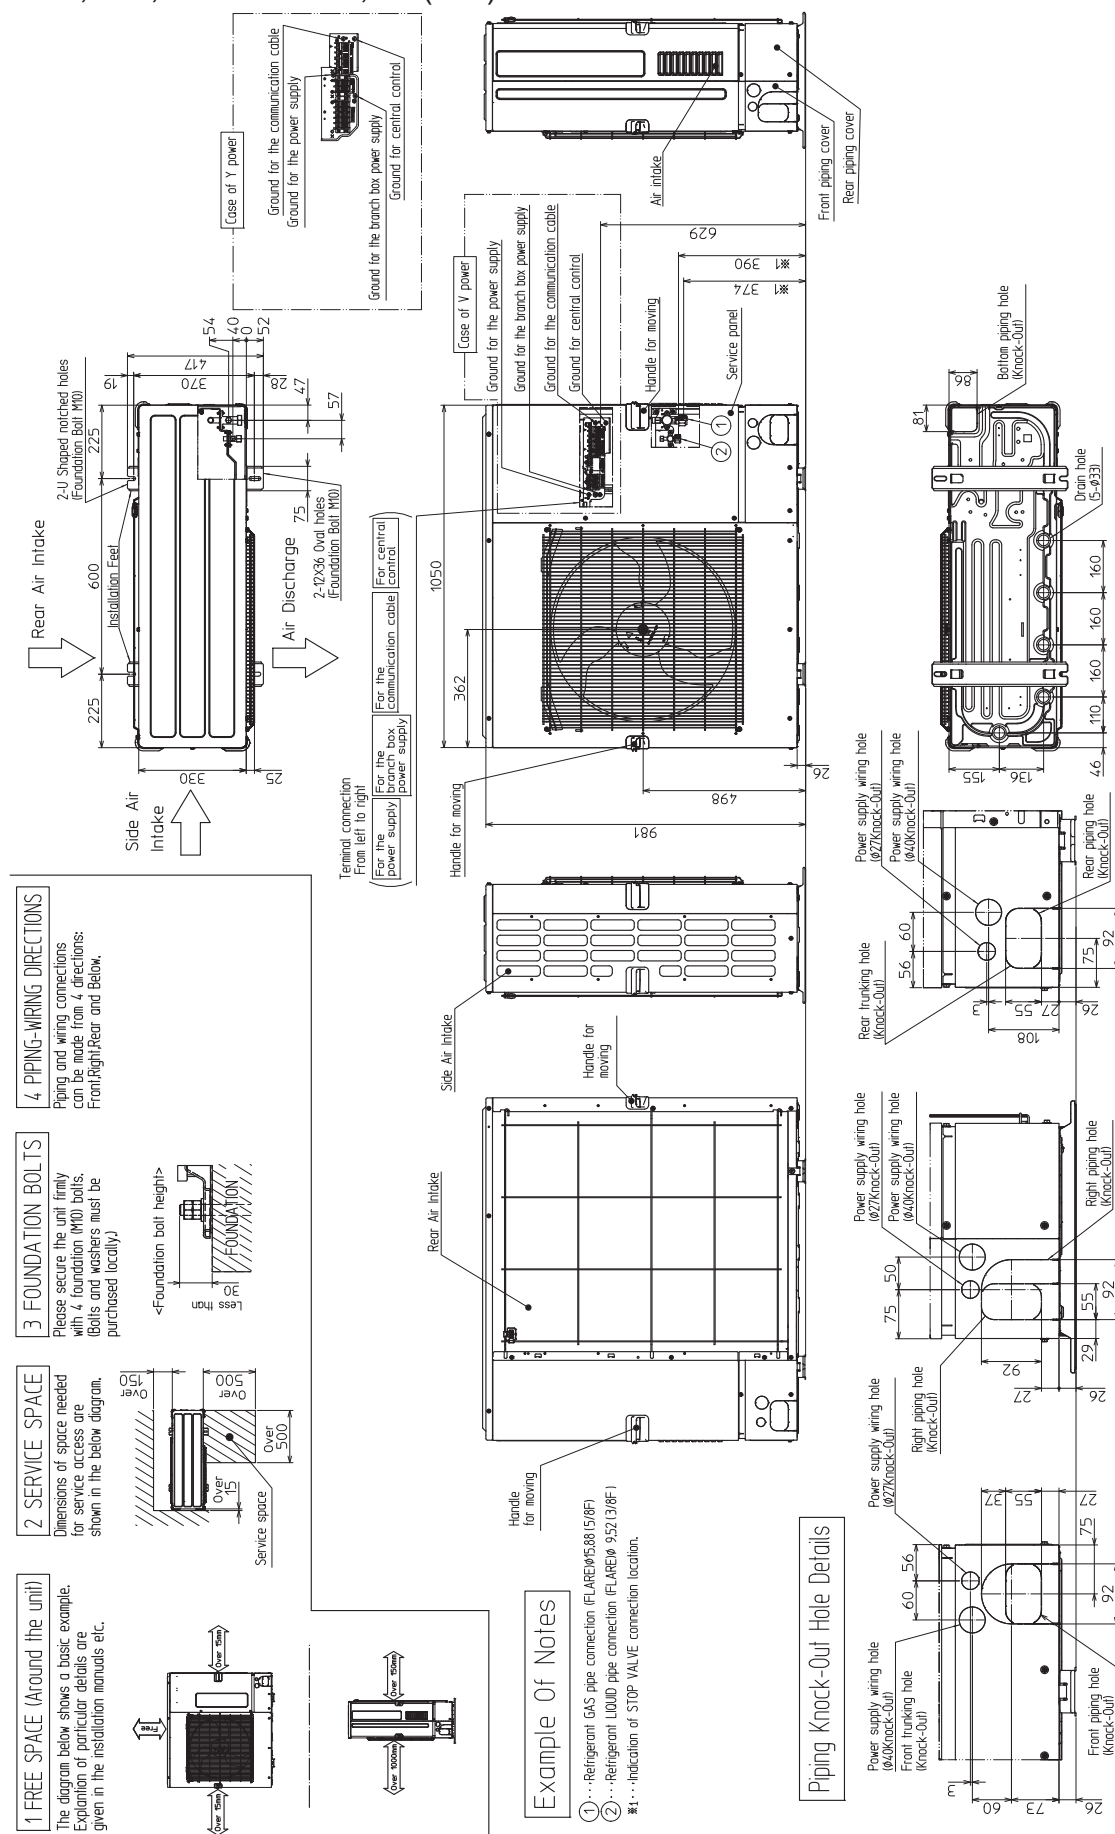

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

PUMY-CP100, 125, 140VKM2-PA, DA(-BS) / PUMY-CP112, 125, 140VKM2-TH
PUMY-CP100, 125, 140YKM2-PA(-BS) / PUMY-CP112, 125, 140YKM2-TH


Unit: mm

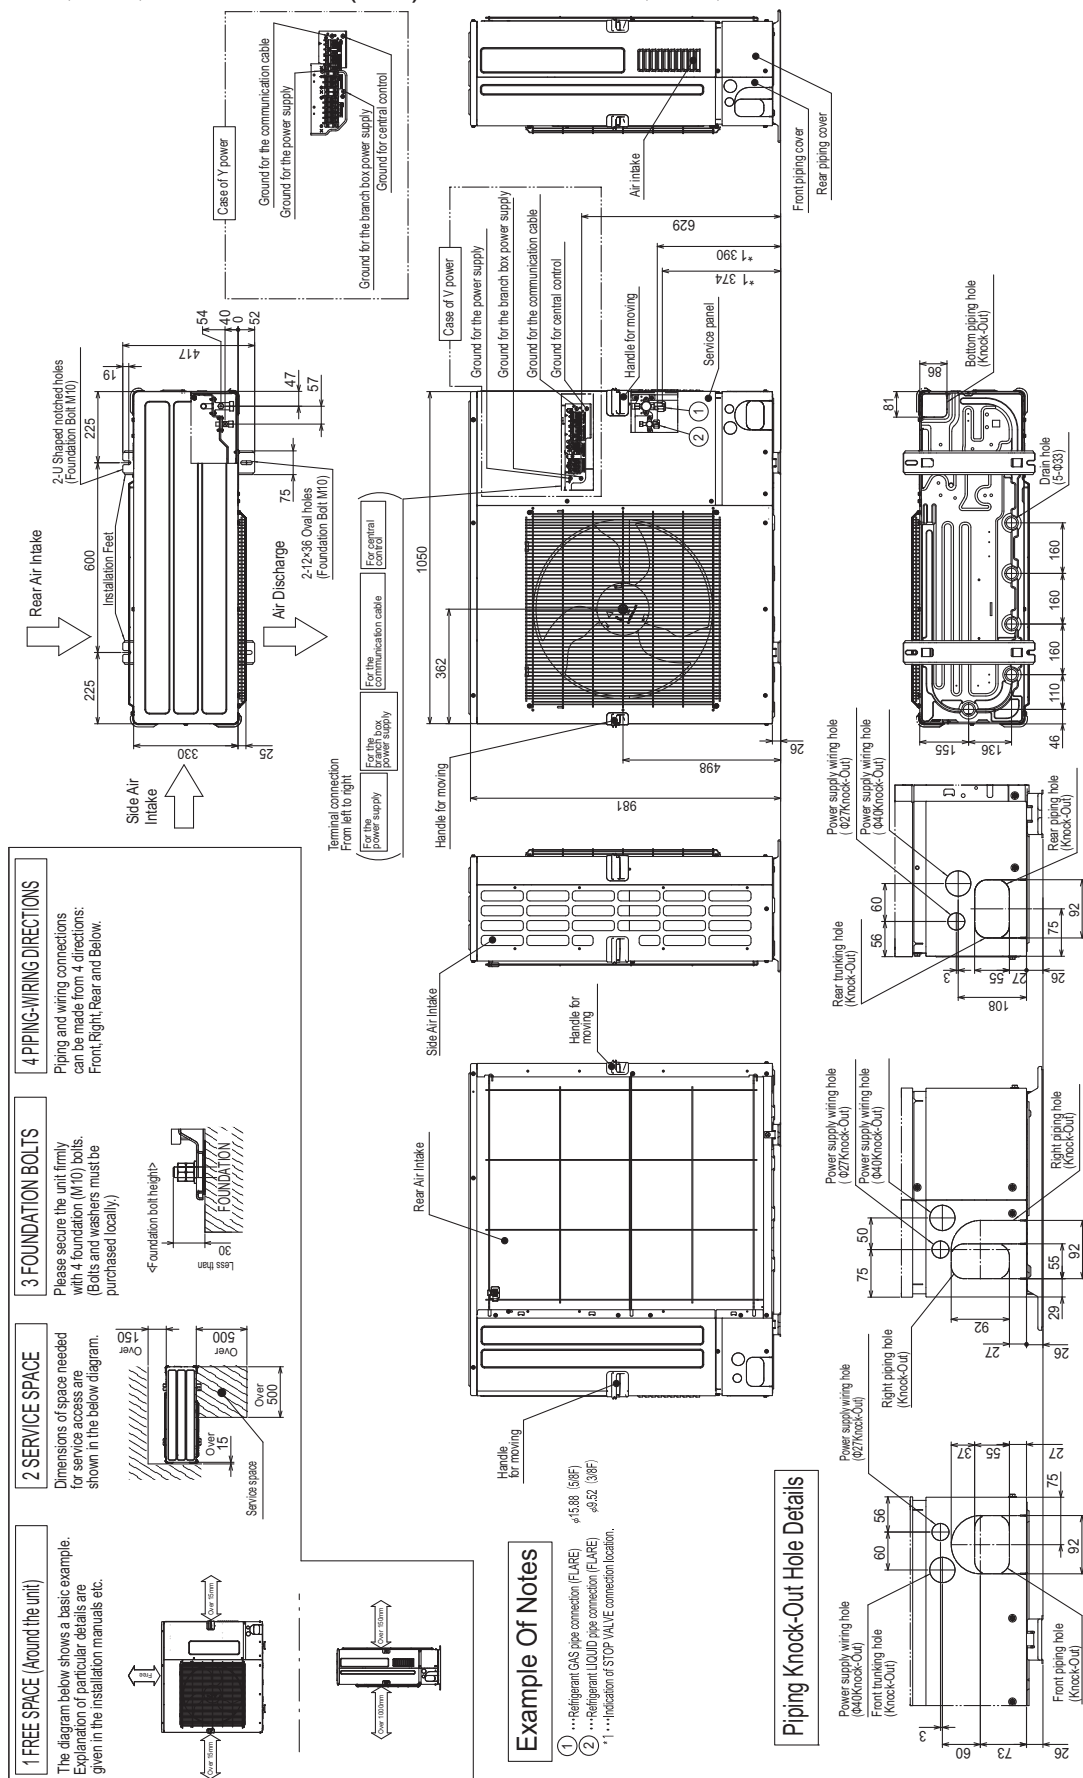


PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

PUMY-SP100, 125, 140VKM2-PA, DA(-BS)
PUMY-SP100, 125, 140YKM2-PA, DA(-BS)


Unit: mm

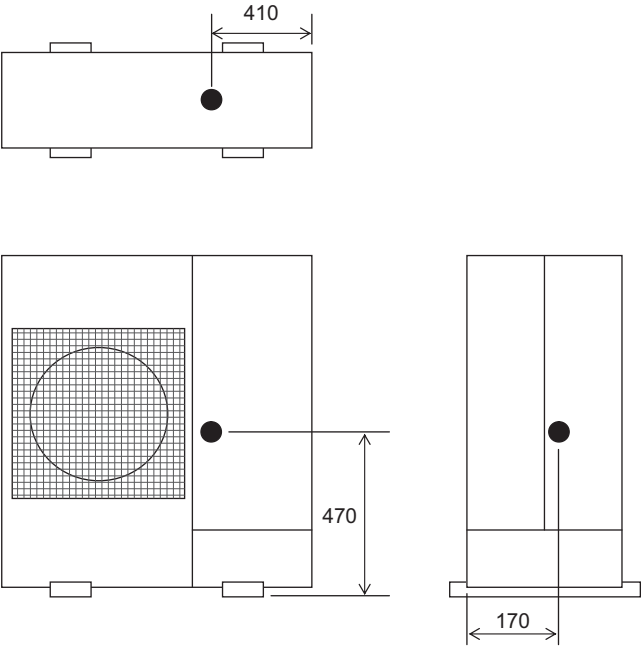


PUMY-CP100, 125, 140VKM2-PA, DA(-BS) / PUMY-CP112, 125, 140VKM2-TH
PUMY-CP100, 125, 140YKM2-PA(-BS) / PUMY-CP112, 125, 140YKM2-TH

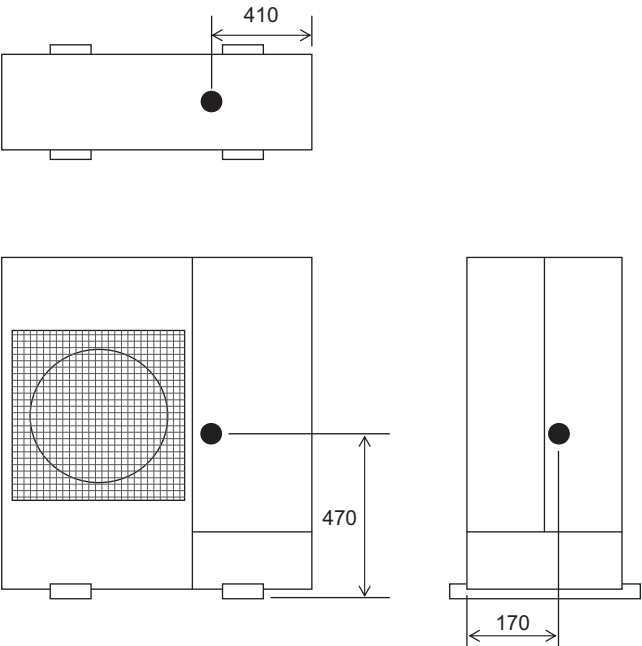

PUMY-SP100, 125, 140VKM2-PA, DA-(BS)

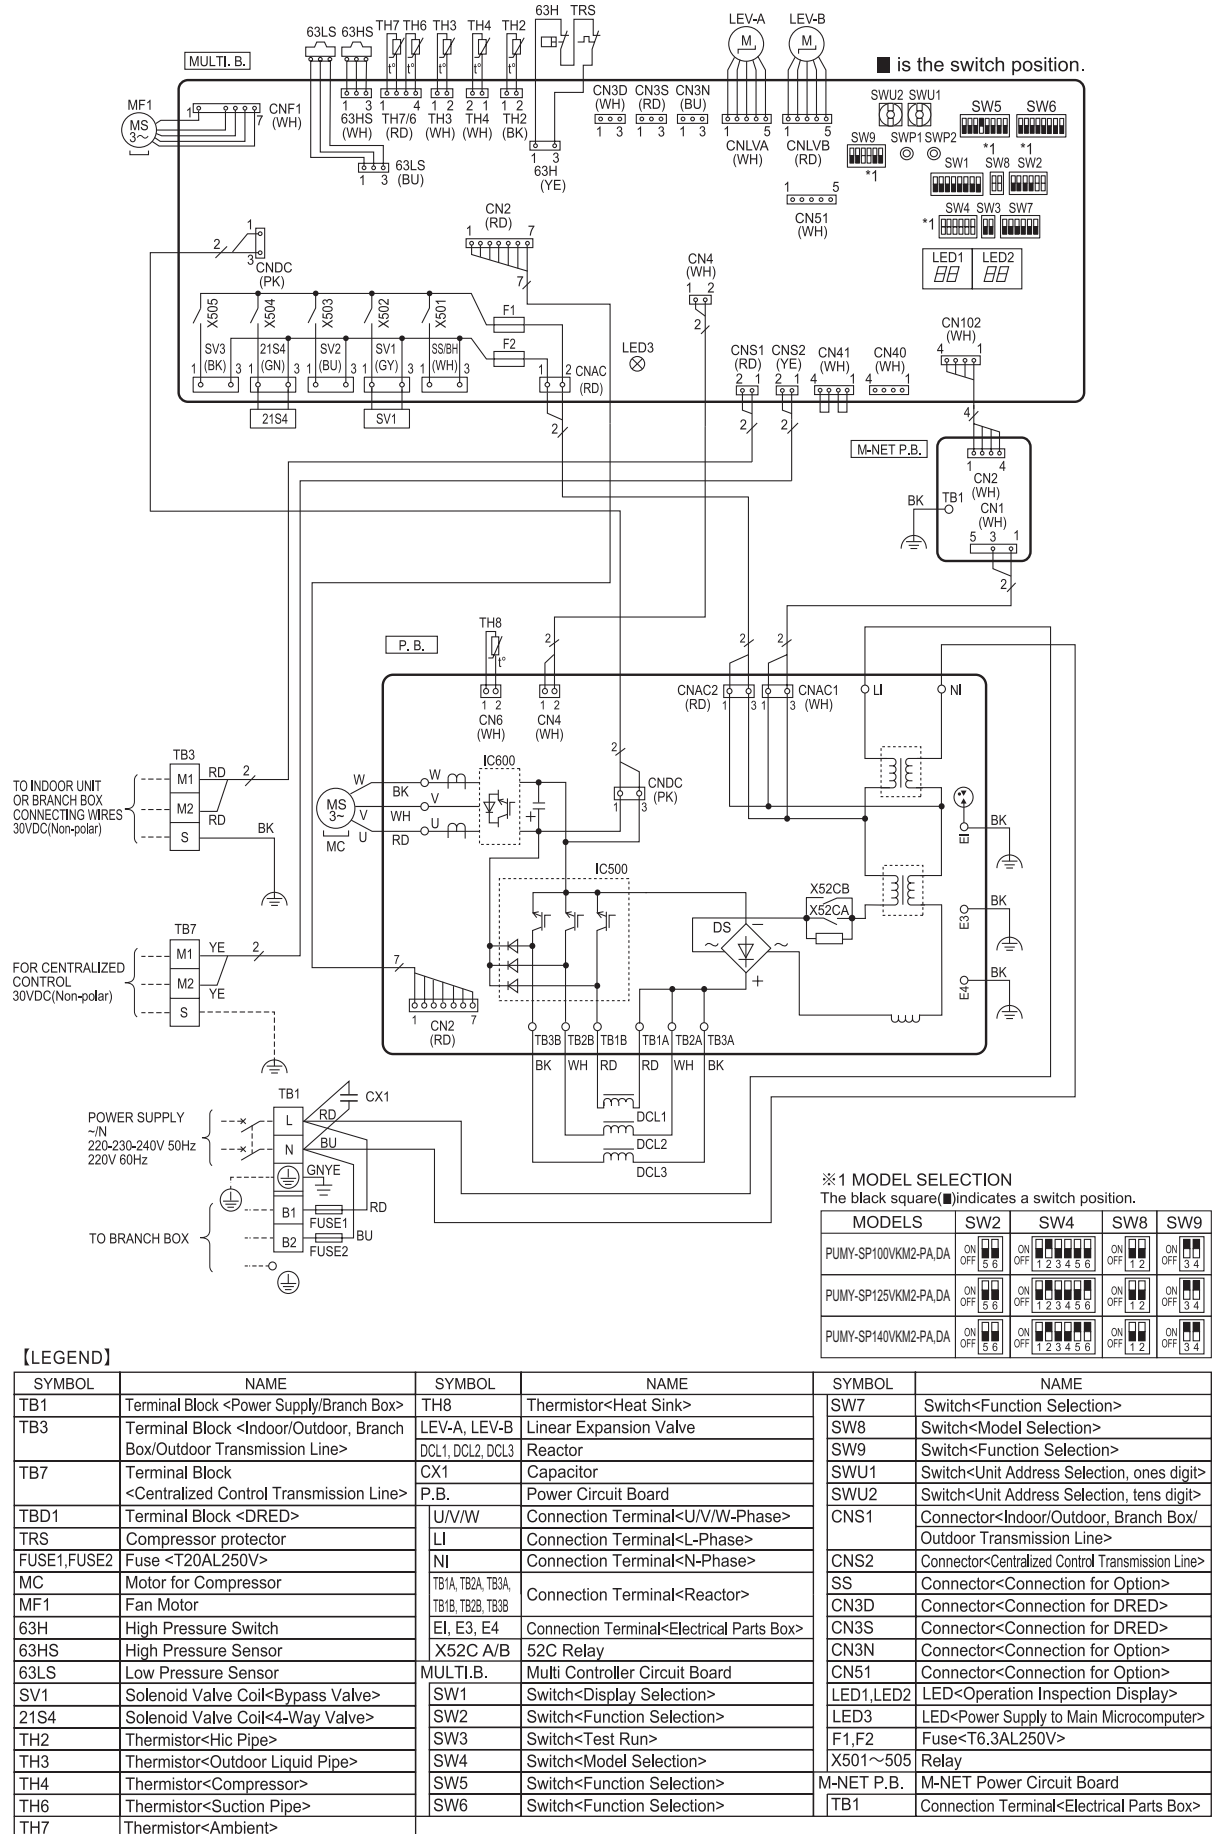

PUMY-SP100, 125, 140YKM2-PA, DA(-BS)

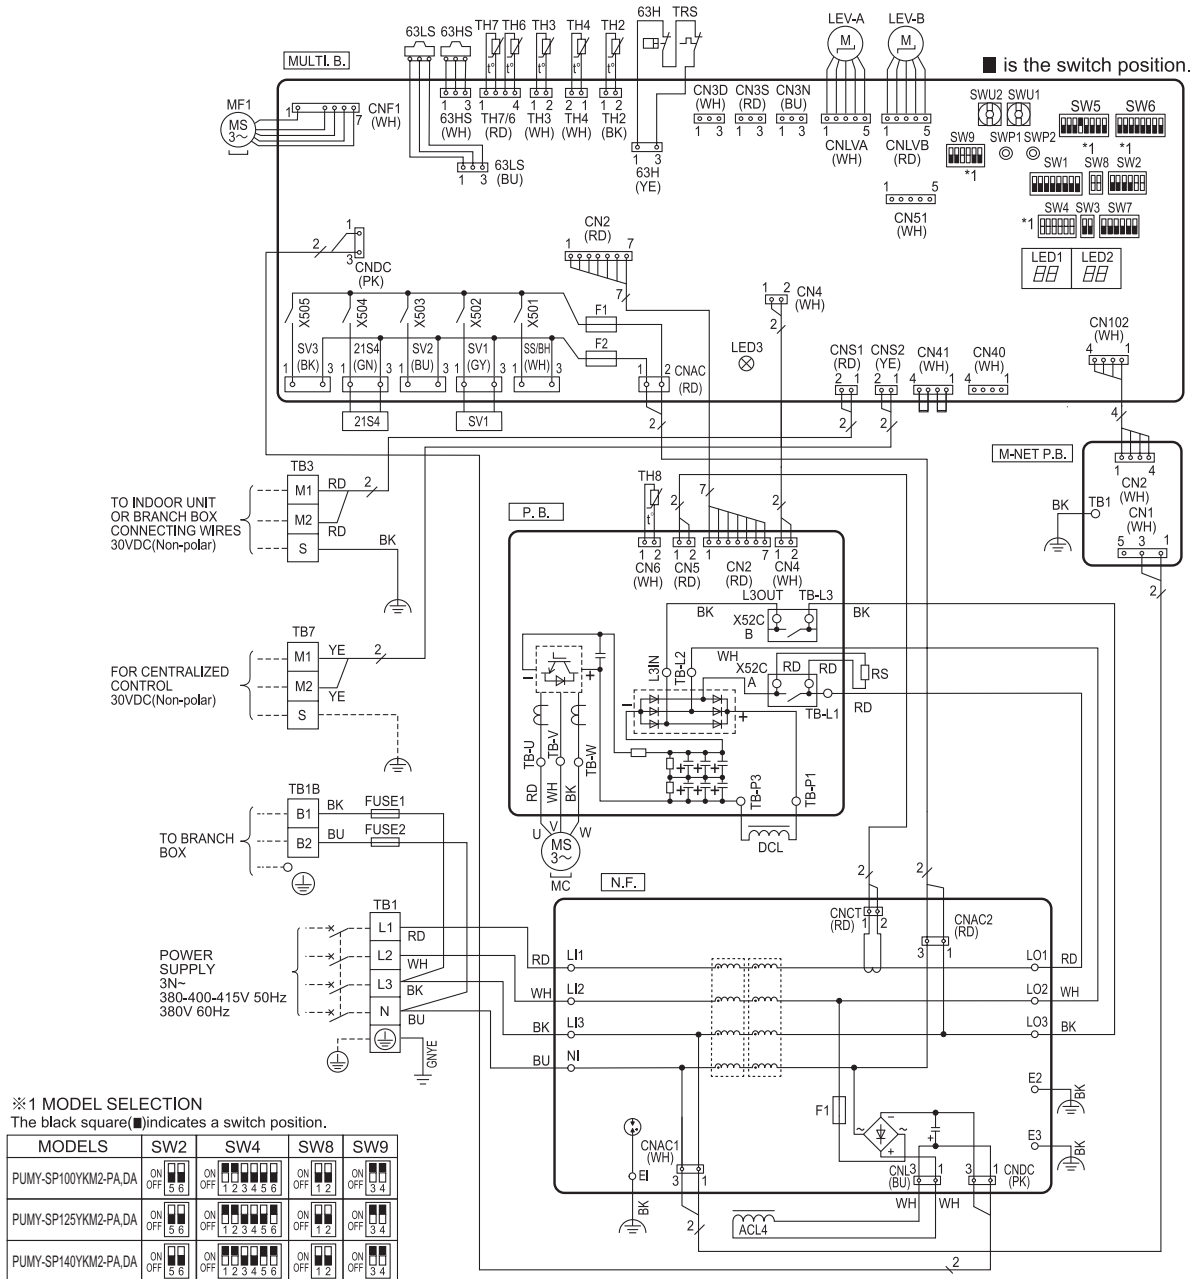


※ 1 MODEL SELECTION
The black square (■) indicates a switch position.


MODELS	SW2	SW4	SW8	SW9
PUMY-SP100YKM2-PA, DA				
PUMY-SP125YKM2-PA, DA				
PUMY-SP140YKM2-PA, DA				

[LEGEND]					
SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
TB1	Terminal Block<Power Supply>	TH8	Thermistor<Heat Sink>	SW6	Switch<Function Selection>
TB1B	Terminal Block<Branch Box>	RS	Rush Current Protect Resistor	SW7	Switch<Function Selection>
TB3	Terminal Block<Indoor/Outdoor, Branch Box/Outdoor Transmission Line>	LEV-A, LEV-B	Linear Expansion Valve	SW8	Switch<Model Selection>
TB7	Terminal Block<Centralized Control Transmission Line>	ACL4	Reactor	SW9	Switch<Function Selection>
TBD1	Terminal Block<DRED>	DCL	Reactor	SWU1	Switch<Unit Address Selection, ones digit>
TRS	Compressor protector	P.B.	Power Circuit Board	SWU2	Switch<Unit Address Selection, tens digit>
FUSE1, FUSE2	Fuse<T20AL250V>	TB-U/V/W	Connection Terminal<U/V/W-Phase>	CNS1	Connector<Indoor/Outdoor, Branch Box/Outdoor Transmission Line>
MC	Motor for Compressor	TB-L1/L2/L3	Connection Terminal<L1/L2/L3-Power Supply>	CNS2	Connector<Centralized Control Transmission Line>
MF1	Fan Motor	TB-P1/P3	Connection Terminal	SS	Connector<Connection for Option>
63H	High Pressure Switch	X52CA/B	52C Relay	CN3D	Connector<Connection for DRED>
63HS	High Pressure Sensor	N.F.	Noise Filter Circuit Board	CN3S	Connector<Connection for DRED>
63LS	Low Pressure Sensor	L01/L02/L03	Connection Terminal<L1/L2/L3-Power Supply>	CN3N	Connector<Connection for Option>
SV1	Solenoid Valve Coil<Bypass Valve>	L1/L2/L3/NI	Connection Terminal<L1/L2/L3-Power Supply>	CN51	Connector<Connection for Option>
21S4	Solenoid Valve Coil<4-Way Valve>	E1, E2, E3	Connection Terminal<Electrical Parts Box>	LED1, LED2	LED<Operation Inspection Display>
TH2	Thermistor<Hic Pipe>	F1	Fuse<T6.3AL250V>	LED3	LED<Power Supply to Main Microcomputer>
TH3	Thermistor<Outdoor Liquid Pipe>	MULTI.B.	Multi Controller Circuit Board	F1, F2	Fuse<T6.3AL250V>
TH4	Thermistor<Compressor>	SW1	Switch<Display Selection>	X501~505	Relay
TH6	Thermistor<Suction Pipe>	SW2	Switch<Function Selection>	M-NET P.B.	M-NET Power Circuit Board
TH7	Thermistor<Ambient>	SW3	Switch<Test Run>	TB1	Connection Terminal<Electrical Parts Box>
		SW4	Switch<Model Selection>		
		SW5	Switch<Function Selection>		

PUMY-CP100, 125, 140VKM2-PA, DA(-BS)

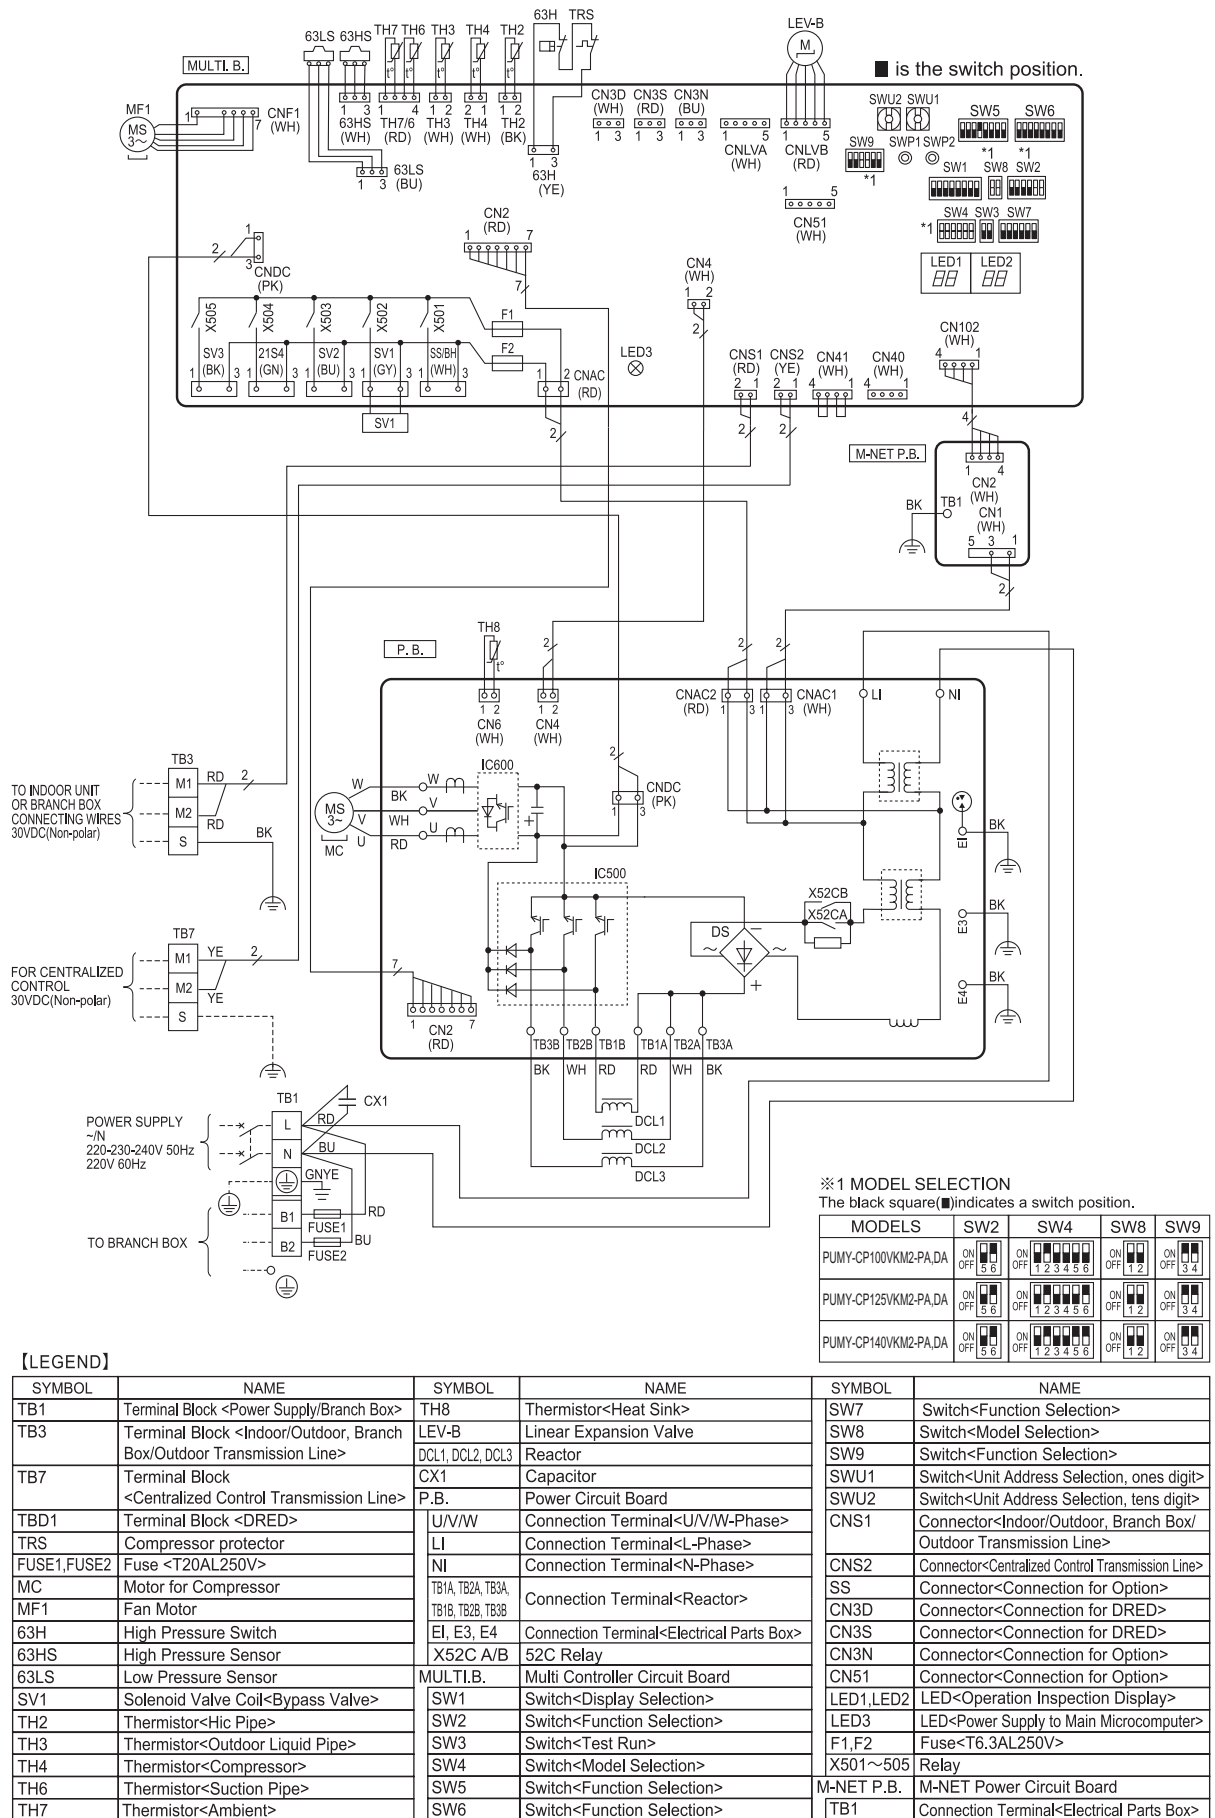


PUMY-CP100, 125, 140YKM2-PA(-BS)

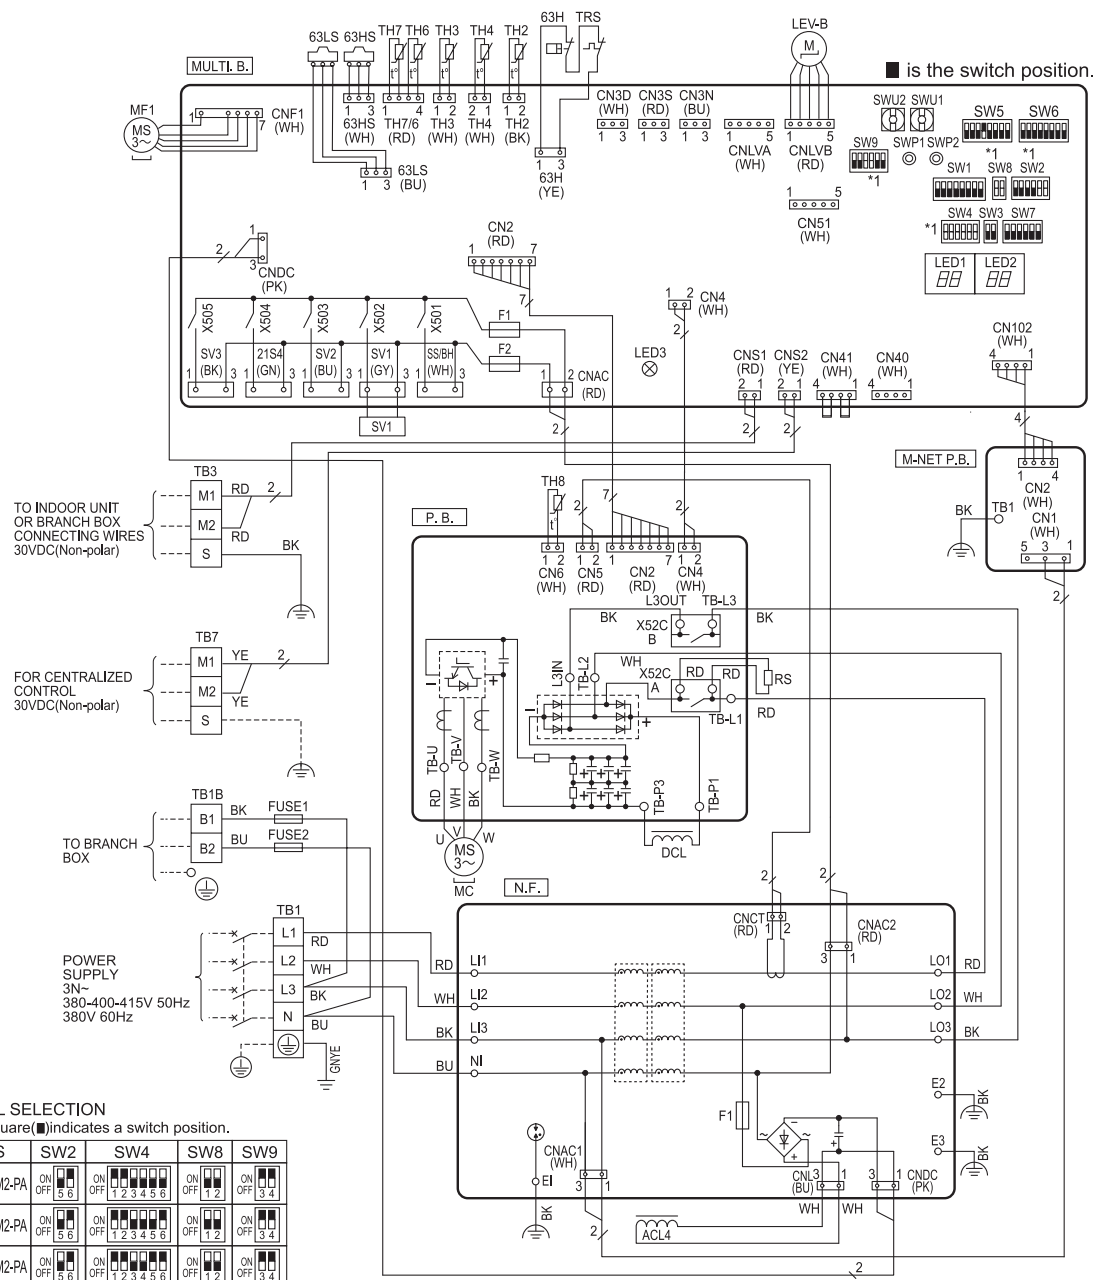

【LEGEND】

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
TB1	Terminal Block<Power Supply>	RS	Rush Current Protect Resistor	SW6	Switch<Function Selection>
TB1B	Terminal Block<Branch Box>	LEV-B	Linear Expansion Valve	SW7	Switch<Function Selection>
TB3	Terminal Block<Indoor/Outdoor, Branch Box/Outdoor Transmission Line>	ACL4	Reactor	SW8	Switch<Model Selection>
TB7	Terminal Block<Centralized Control Transmission Line>	DCL	Reactor	SW9	Switch<Function Selection>
TBD1	Terminal Block <DRED>	P.B.	Power Circuit Board	SWU1	Switch<Unit Address Selection, ones digit>
TRS	Compressor protector	TB-U/V/W	Connection Terminal<U/V/W-Phase>	SWU2	Switch<Unit Address Selection, tens digit>
FUSE1,FUSE2	Fuse<T20AL250V>	TB-L1/L2/L3	Connection Terminal<L1/L2/L3-Power Supply>	CNS1	Connector<Indoor/Outdoor, Branch Box/Outdoor Transmission Line>
MC	Motor for Compressor	TB-P1/P3	Connection Terminal	CNS2	Connector<Centralized Control Transmission Line>
MF1	Fan Motor	X52CA/B	52C Relay	SS	Connector<Connection for Option>
63H	High Pressure Sensor	N.F.	Noise Filter Circuit Board	CN3D	Connector<Connection for DRED>
63HS	High Pressure Sensor	L01/L02/L03	Connection Terminal<L1/L2/L3-Power Supply>	CN3S	Connector<Connection for DRED>
63LS	Low Pressure Sensor	L1/L2/L3/N	Connection Terminal<L1/L2/L3-Power Supply>	CN3N	Connector<Connection for Option>
SV1	Solenoid Valve Coil<Bypass Valve>	E1, E2, E3	Connection Terminal<Electrical Parts Box>	CN51	Connector<Connection for Option>
TH2	Thermistor<Hic Pipe>	F1	Fuse<T6.3AL250V>	LED1,LED2	LED<Operation Inspection Display>
TH3	Thermistor<Outdoor Liquid Pipe>	MULTI.B.	Multi Controller Circuit Board	LED3	LED<Power Supply to Main Microcomputer>
TH4	Thermistor<Compressor>	SW1	Switch<Display Selection>	F1,F2	Fuse<T6.3AL250V>
TH6	Thermistor<Suction Pipe>	SW2	Switch<Function Selection>	X501~505	Relay
TH7	Thermistor<Ambient>	SW3	Switch<Test Run>	M-NET P.B.	M-NET Power Circuit Board
TH8	Thermistor<Heat Sink>	SW4	Switch<Model Selection>	TB1	Connection Terminal<Electrical Parts Box>
		SW5	Switch<Function Selection>		

PUMY-CP112, 125, 140VKM2-TH

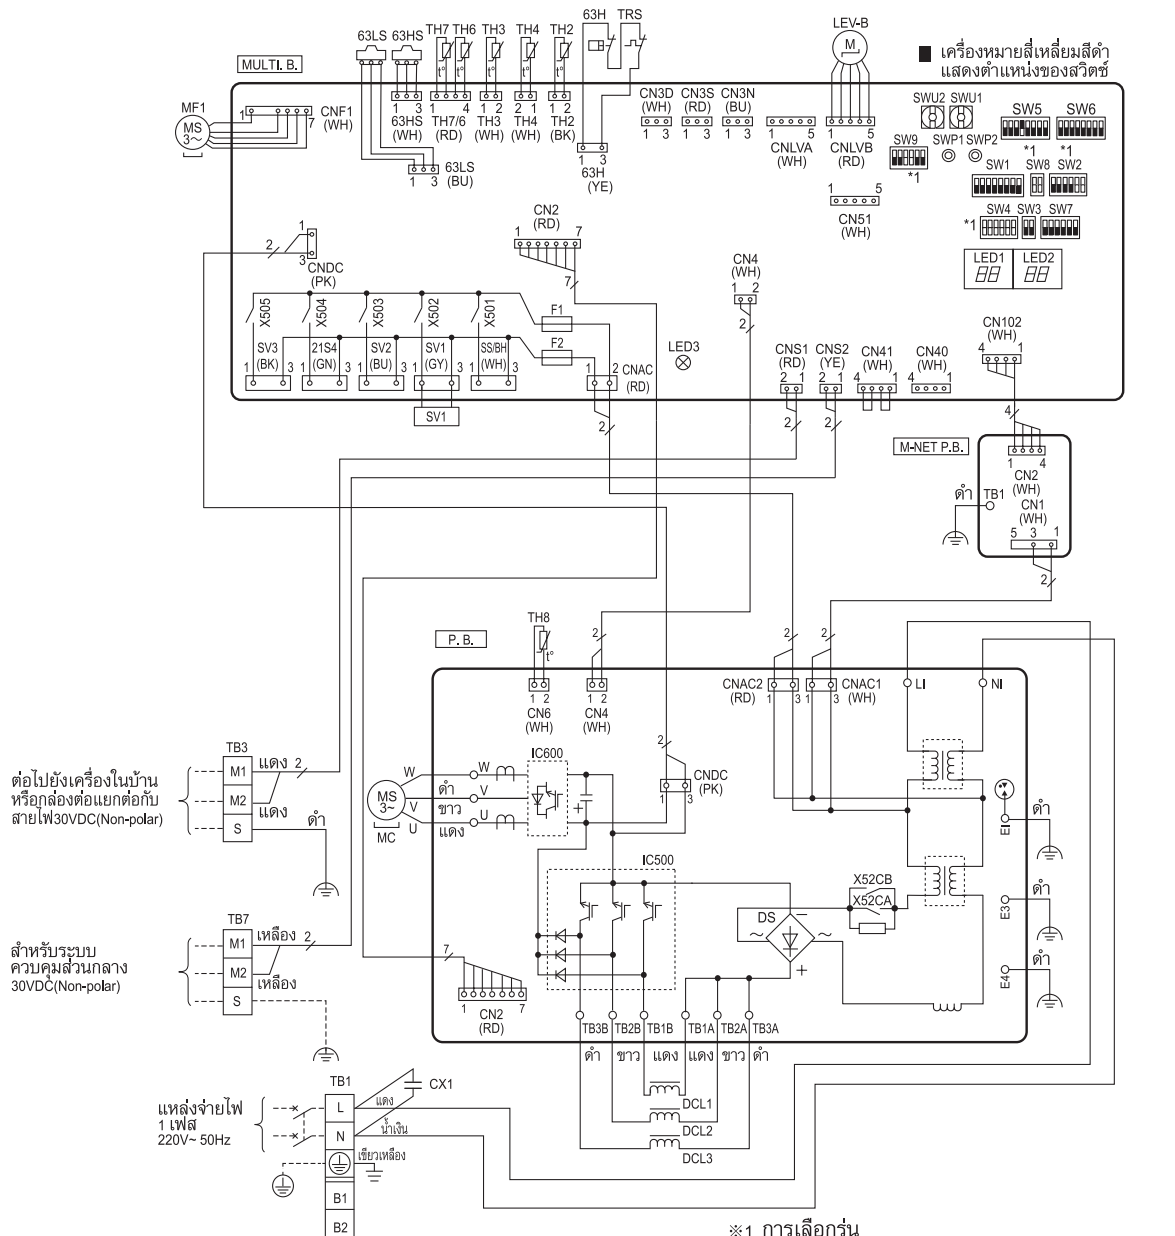

※1 การเลือกรุ่น


เครื่องหมาย (■) สีเหลี่ยมสีดำบ่งบอกถึงตำแหน่งของสวิตช์

MODELS	SW2	SW4	SW8	SW9
PUMY-CP112VKM2-TH.TH	ON OFF 1 2 3 4 5 6	ON OFF 1 2 3 4 5 6	ON OFF 1 2 3 4 5 6	ON OFF 1 2 3 4
PUMY-CP125VKM2-TH.TH	ON OFF 1 2 3 4 5 6	ON OFF 1 2 3 4 5 6	ON OFF 1 2 3 4 5 6	ON OFF 1 2 3 4
PUMY-CP140VKM2-TH.TH	ON OFF 1 2 3 4 5 6	ON OFF 1 2 3 4 5 6	ON OFF 1 2 3 4 5 6	ON OFF 1 2 3 4

สัญลักษณ์	ชื่อ	สัญลักษณ์	ชื่อ	สัญลักษณ์	ชื่อ
TB1	ฐานเสียบสายไฟ <แหล่งจ่ายไฟ/กล่องต่อแยก>	LEV-B	วาล์วลดความดัน	SW9	สวิตช์ <เลือกการทำงาน>
TB3	ฐานเสียบสายไฟ <เครื่องในบ้าน/เครื่องนอกบ้าน/กล่องต่อแยก/สายสัญญาณของเครื่องนอกบ้าน>	DCL1, DCL2, DCL3	รีเลย์คอนโทรล	SWP1	สวิตช์ <เลือกการแสดงผล>
TB7	ฐานเสียบสายไฟ <สายสัญญาณสำหรับระบบควบคุมส่วนกลาง>	CX1	ตัวเก็บประจุ	SWP2	สวิตช์ <เลือกการแสดงผล>
TRS	ตัวป้องกันคอมเพรสเซอร์	P.B.	Power Circuit Board	SWU1	สวิตช์ <การเลือกตำแหน่งที่อยู่ของบูต หน่วยหลัก>
FUSE1, FUSE2	ฟิวส์ <T20AL250V>	U/V/W	หัวเสียบสายไฟ <U/V/W-เฟส>	SWU2	สวิตช์ <การเลือกตำแหน่งที่อยู่ของบูต หน่วยหลัก>
MC	Motor for Compressor	LI	หัวเสียบสายไฟ <L-เฟส>	CNS1	คอนเน็คเตอร์ <เครื่องในบ้าน/เครื่องนอกบ้าน/กล่องต่อแยก/สายสัญญาณของเครื่องนอกบ้าน>
MF1	Fan Motor	NI	หัวเสียบสายไฟ <N-เฟส>	CNS2	คอนเน็คเตอร์ <สายสัญญาณสำหรับระบบควบคุมส่วนกลาง>
63H	High Pressure Switch	TB1A, TB2A, TB3A, TB1B, TB2B, TB3B	หัวเสียบสายไฟ <รีเลย์คอนโทรล>	SS	คอนเน็คเตอร์ <สำหรับตู้ปรับอากาศเสริม>
63HS	ตัวตรวจจับแรงดันสูง	E1, E2, E3, E4	หัวเสียบสายไฟ <ชุดวงจรไฟฟ้า>	CN3D	คอนเน็คเตอร์ <สำหรับตู้ปรับอากาศเสริม>
63LS	ตัวตรวจจับแรงดันต่ำ	MULTI.B.	แผงวงจรควบคุม	CN3S	คอนเน็คเตอร์ <สำหรับตู้ปรับอากาศเสริม>
SV1	โซลินอยด์วาล์วคอยล์ <Bypass Valve>	SW1	สวิตช์ <เลือกการแสดงผล>	CN3N	คอนเน็คเตอร์ <สำหรับตู้ปรับอากาศเสริม>
TH2	เทอร์มิสเตอร์ <ท่อ Hic>	SW2	สวิตช์ <เลือกการทำงาน>	CN51	คอนเน็คเตอร์ <สำหรับตู้ปรับอากาศเสริม>
TH3	เทอร์มิสเตอร์ <ท่อ Liquid ของเครื่องนอกบ้าน>	SW3	สวิตช์ <ทดสอบการทำงาน>	LED1, LED2	LED <ตรวจสอบการทำงาน>
TH4	เทอร์มิสเตอร์ <คอมเพรสเซอร์>	SW4	สวิตช์ <เลือก>	LED3	LED <แสดงไฟฟ้าที่ส่งไปยังไมโครคอมพิวเตอร์>
TH6	เทอร์มิสเตอร์ <ท่อ Suction>	SW5	สวิตช์ <เลือกการทำงาน>	F1 F2	ฟิวส์ <T6.3AL250V>
TH7	เทอร์มิสเตอร์ <อุณหภูมิโดยตรง>	SW6	สวิตช์ <เลือกการทำงาน>	X501~505	รีเลย์
TH8	เทอร์มิสเตอร์ <แผ่น Heat Sink ระบายความร้อน>	SW7	สวิตช์ <เลือกการทำงาน>	M-NET P.B.	แผงวงจร M-NET
		SW8	สวิตช์ <เลือก>	TB1	หัวเสียบสายไฟ <ชุดวงจรไฟฟ้า>

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

PUMY-CP112, 125, 140YKM2-TH


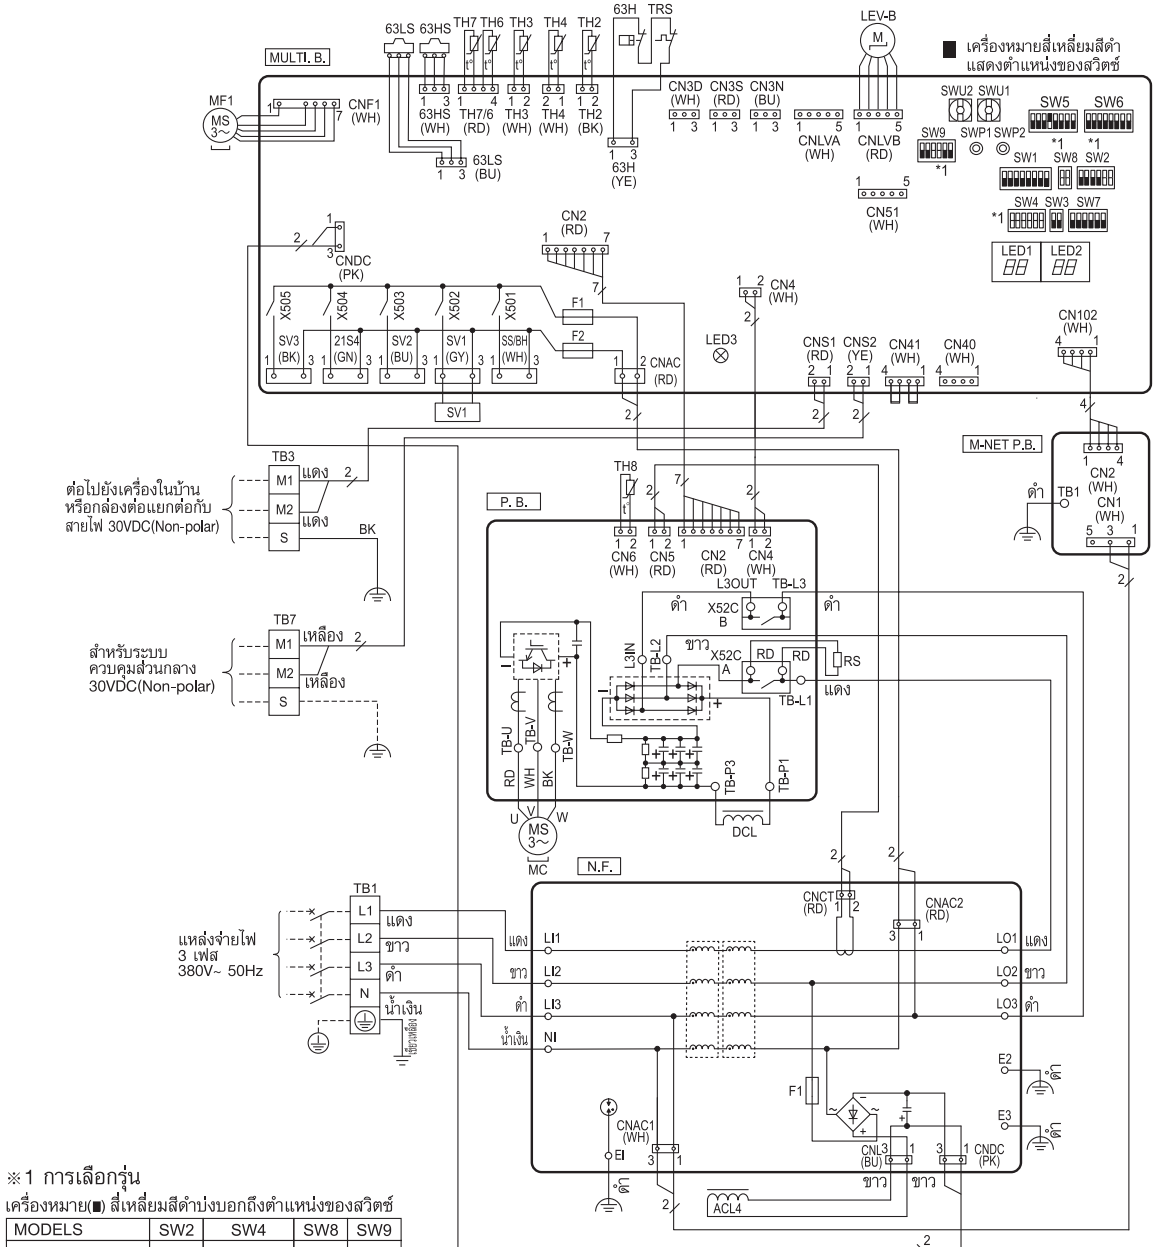


※1 การเลือกรุ่น


เครื่องหมาย (■) สีเหลี่ยมสีดำบ่งบอกถึงตำแหน่งของสวิตช์

MODELS	SW2	SW4	SW8	SW9
PUMY-CP112YKM2-TH,TH	ON OFF 5 6	ON OFF 1 2 3 4 5 6	ON OFF 1 2	ON OFF 3 4
PUMY-CP125YKM2-TH,TH	ON OFF 5 6	ON OFF 1 2 3 4 5 6	ON OFF 1 2	ON OFF 3 4
PUMY-CP140YKM2-TH,TH	ON OFF 5 6	ON OFF 1 2 3 4 5 6	ON OFF 1 2	ON OFF 3 4


สัญลักษณ์	ชื่อ	สัญลักษณ์	ชื่อ	สัญลักษณ์	ชื่อ
TB1	ฐานเสียบขั้วสายไฟ <แหล่งจ่ายไฟ/กล่องต่อแยก>	LEV-B	วาล์วลดความดัน	SW8	สวิตช์ <เลือกรุ่น>
TB3	ฐานเสียบขั้วสายไฟ <เครื่องในบ้าน/เครื่องนอกบ้าน, กล่องต่อแยก/สายสัญญาณของเครื่องนอกบ้าน>	ACL4	รีเลย์คอนดักเตอร์	SW9	สวิตช์ <เลือกการทำงาน>
TB7	ฐานเสียบขั้วสายไฟ <สายสัญญาณสำหรับระบบควบคุมส่วนกลาง>	DCL	รีเลย์คอนดักเตอร์	SWP1	สวิตช์ <เลือกการแสดงผล>
TRS	ตัวป้องกันคอมเพรสเซอร์	P.B.	Power Circuit Board	SWP2	สวิตช์ <เลือกการแสดงผล>
FUSE1,FUSE2	ฟิวส์ <T20AL250V>	TB-U/V/W	ขั้วเสียบสายไฟ <U/V/W-เฟส>	SWU1	สวิตช์ <การเลือกตำแหน่งที่อยู่ของยูนิต หลักหน่วย>
MC	Motor For Compressor	TB-L1/L2/L3	ฐานเสียบขั้วสายไฟ <L1/L2/L3-แหล่งจ่ายไฟ>	SWU2	สวิตช์ <การเลือกตำแหน่งที่อยู่ของยูนิต หลักลิบ>
MF1	Fan Motor	TB-P1/P3	ฐานเสียบขั้วสายไฟ	CNS1	คอนเน็คเตอร์ <เครื่องในบ้าน/เครื่องนอกบ้าน, กล่องต่อแยก/สายสัญญาณของเครื่องนอกบ้าน>
63H	Hight Pressure Switch	X52CA/B	52C รีเลย์	CNS2	คอนเน็คเตอร์ <สายสัญญาณสำหรับระบบควบคุมส่วนกลาง>
63HS	ตัวตรวจจับแรงดันสูง	N.F.	แผ่นวงจรควบคุม	SS	คอนเน็คเตอร์ <สำหรับต่ออุปกรณ์เสริม>
63LS	ตัวตรวจจับแรงดันต่ำ	LO1/LO2/LO3	ฐานเสียบขั้วสายไฟ <L1/L2/L3-แหล่งจ่ายไฟ>	CN3D	คอนเน็คเตอร์ <สำหรับต่ออุปกรณ์เสริม>
SV1	โซลินอยด์วาล์วคอยล์ <Bypass Valve>	LI1/L2/L3/NI	ฐานเสียบขั้วสายไฟ <L1/L2/L3-แหล่งจ่ายไฟ>	CN3S	คอนเน็คเตอร์ <สำหรับต่ออุปกรณ์เสริม>
TH2	เทอร์มิสเตอร์ <ท่อ Hic>	EI, E2, E3	ขั้วเสียบสายไฟ <ชุดวงจรไฟฟ้า>	CN3N	คอนเน็คเตอร์ <สำหรับต่ออุปกรณ์เสริม>
TH3	เทอร์มิสเตอร์ <ท่อ Liquid ของเครื่องนอกบ้าน>	MULTI. B.	แผงวงจรควบคุม	CN51	คอนเน็คเตอร์ <สำหรับต่ออุปกรณ์เสริม>
TH4	เทอร์มิสเตอร์ <คอมเพรสเซอร์>	SW1	สวิตช์ <เลือกการแสดงผล>	LED1, LED2	LED <ตรวจสอบการทำงาน>
TH6	เทอร์มิสเตอร์ <ท่อ Suction>	SW2	สวิตช์ <เลือกการทำงาน>	LED3	LED <แสดงไฟฟ้ที่ส่งไปยังไมโครคอมพิวเตอร์>
TH7	เทอร์มิสเตอร์ <อุณหภูมิโดยรวม>	SW3	สวิตช์ <ทดสอบการทำงาน>	F1, F2	ฟิวส์ <T6.3AL250V>
TH8	เทอร์มิสเตอร์ <แผ่น Heat Sink ระบายความร้อน>	SW4	สวิตช์ <เลือกรุ่น>	X501~505	รีเลย์
RS	ตัวป้องกันกระแสไฟกระชาก	SW5	สวิตช์ <เลือกการทำงาน>	M-NET P.B.	แผงวงจร M-NET
		SW6	สวิตช์ <เลือกการทำงาน>	TB1	ขั้วเสียบสายไฟ <ชุดวงจรไฟฟ้า>
		SW7	สวิตช์ <เลือกการทำงาน>		

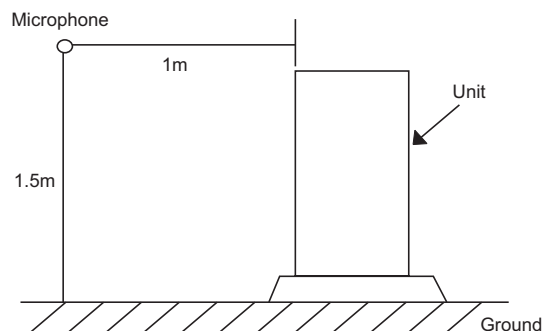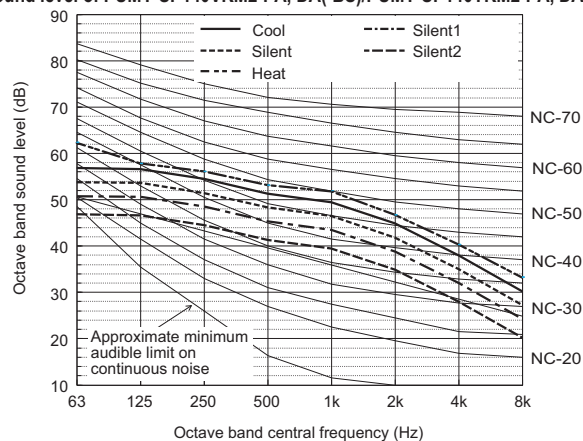Measurement condition**PUMY-SP100, 125, 140VKM2-PA, DA(-BS)****PUMY-SP100, 125, 140YKM2-PA, DA(-BS)****Sound level of PUMY-SP140VKM2-PA, DA(-BS)/PUMY-SP140YKM2-PA, DA(-BS)**

	63	125	250	500	1k	2k	4k	8k	dB(A)
Standard Cooling	56.8	56.6	54.5	51.3	49.4	44.8	38.0	30.3	54.0
Silent	53.8	53.6	51.5	48.3	46.4	41.8	35.0	27.3	51.0
Super silent1	50.8	50.6	48.5	45.3	43.4	38.8	32.0	24.3	48.0
Super silent2	46.8	46.6	44.5	41.3	39.4	34.8	28.0	20.3	44.0
Standard Heating	62.3	57.8	56.1	53.1	51.8	46.7	40.3	33.2	56.0

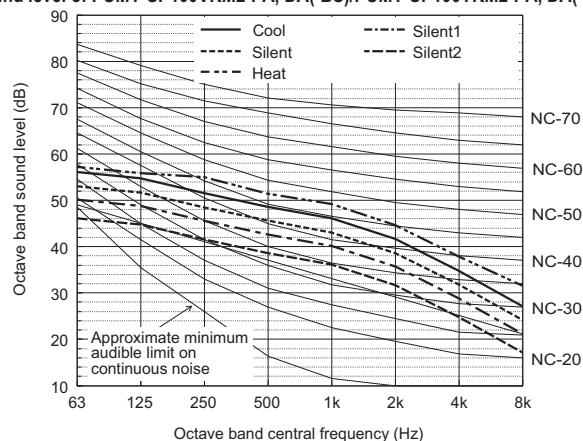Sound level of PUMY-SP100VKM2-PA, DA(-BS)/PUMY-SP100YKM2-PA, DA(-BS)

	63	125	250	500	1k	2k	4k	8k	dB(A)
Standard Cooling	56.1	54.7	51.5	48.6	46.1	41.7	34.8	27.1	51.0
Silent	53.1	51.7	48.5	45.6	43.1	38.7	31.8	24.1	48.0
Super silent1	50.1	48.7	45.5	42.6	40.1	35.7	28.8	21.1	45.0
Super silent2	46.1	44.7	41.5	38.6	36.1	31.7	24.8	17.1	41.0
Standard Heating	57.2	55.9	55.0	51.5	49.2	44.7	37.9	31.5	54.0

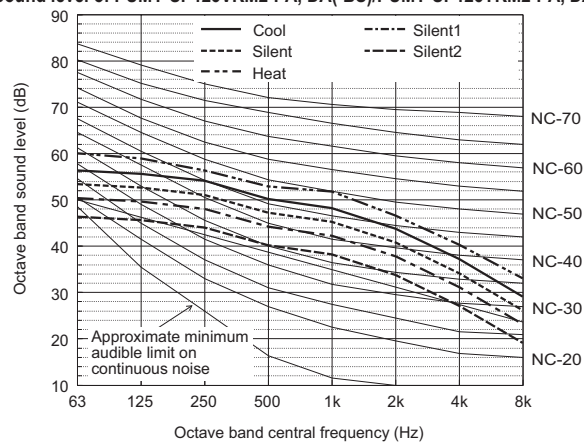Sound level of PUMY-SP125VKM2-PA, DA(-BS)/PUMY-SP125YKM2-PA, DA(-BS)

	63	125	250	500	1k	2k	4k	8k	dB(A)
Standard Cooling	56.3	55.6	54.1	50.2	48.3	43.8	37.2	29.1	53.0
Silent	53.3	52.6	51.1	47.2	45.3	40.8	34.2	26.1	50.0
Super silent1	50.3	49.6	48.1	44.2	42.3	37.8	31.2	23.1	47.0
Super silent2	46.3	45.6	44.1	40.2	38.3	33.8	27.2	19.1	43.0
Standard Heating	60.0	58.9	56.4	52.9	51.8	46.6	40.3	33.0	56.0


Measurement condition

PUMY-CP100, 125, 140VKM2-PA, DA(-BS)


PUMY-CP112, 125, 140VKM2-TH

PUMY-CP100, 125, 140YKM2-PA(-BS)

PUMY-CP112, 125, 140YKM2-TH

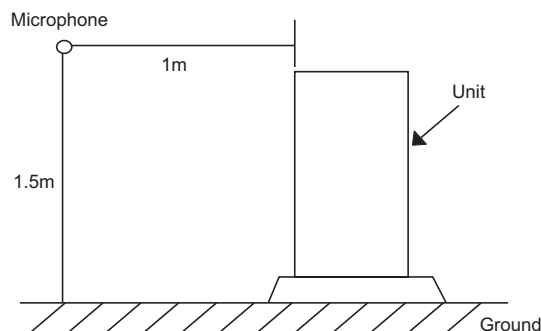


Sound level of PUMY-CP125VKM2-PA, DA(-BS), -TH/PUMY-CP125YKM2-PA(-BS), -TH

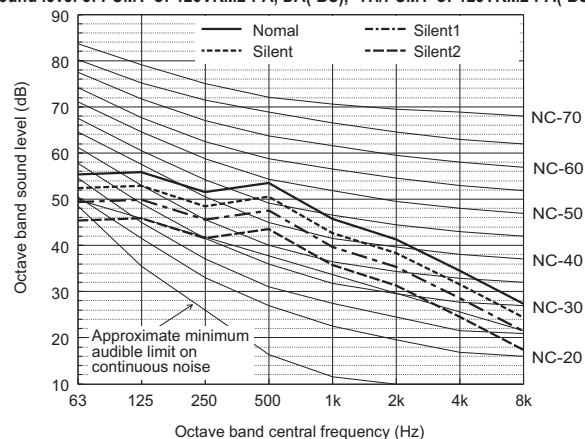


	63	125	250	500	1k	2k	4k	8k	dB(A)
Normal	55.4	55.9	51.5	53.5	45.7	41.4	34.5	27.4	53.0
Silent	52.4	52.9	48.5	50.5	42.7	38.4	31.5	24.4	50.0
Super silent1	49.4	49.9	45.5	47.5	39.7	35.4	28.5	21.4	47.0
Super silent2	45.4	45.9	41.5	43.5	35.7	31.4	24.5	17.4	43.0

Sound level of PUMY-CP100VKM2-PA, DA(-BS)/PUMY-CP100YKM2-PA(-BS)

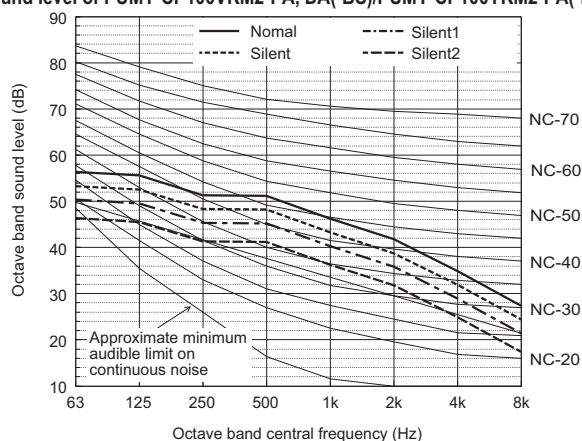


	63	125	250	500	1k	2k	4k	8k	dB(A)
Normal	56.3	55.6	51.3	51.2	46.2	41.8	34.9	27.4	52.0
Silent	53.3	52.6	48.3	48.2	43.2	38.8	31.9	24.4	49.0
Super silent1	50.3	49.6	45.3	45.2	40.2	35.8	28.9	21.4	46.0
Super silent2	46.3	45.6	41.3	41.2	36.2	31.8	24.9	17.4	42.0

Sound level of PUMY-CP140VKM2-PA, DA(-BS), -TH/PUMY-CP140YKM2-PA(-BS), -TH

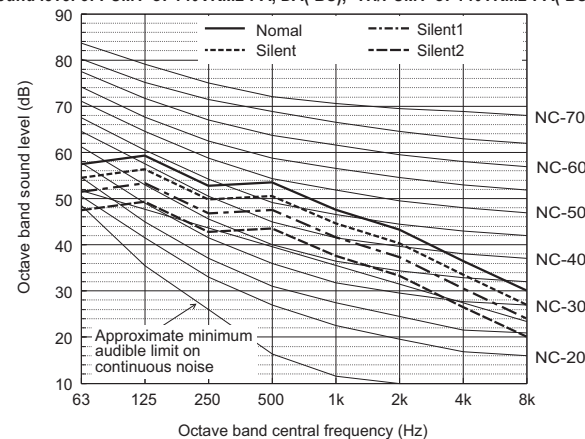

	63	125	250	500	1k	2k	4k	8k	dB(A)
Normal	57.5	59.3	52.8	53.6	47.6	43.3	36.5	30.1	54.0
Silent	54.5	56.3	49.8	50.6	44.6	40.3	33.5	27.1	51.0
Super silent1	51.5	53.3	46.8	47.6	41.6	37.3	30.5	24.1	48.0
Super silent2	47.5	49.3	42.8	43.6	37.6	33.3	26.5	20.1	44.0

Sound level of PUMY-CP112VKM2-TH/PUMY-CP112YKM2-TH

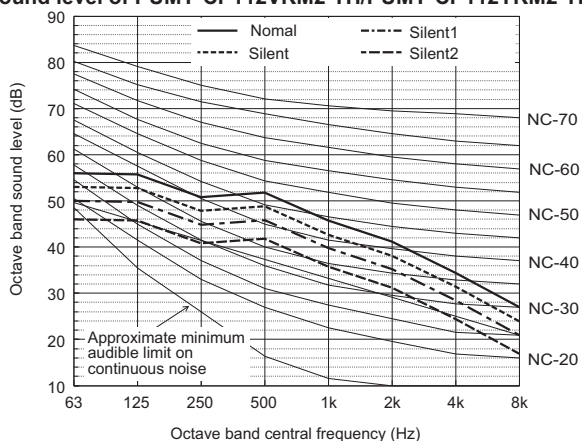


	63	125	250	500	1k	2k	4k	8k	dB(A)
Normal	56.0	55.7	50.8	51.8	45.7	41.1	34.4	27.0	52.0
Silent	53.0	52.7	47.8	48.8	42.7	38.1	31.4	24.0	49.0
Super silent1	50.0	49.7	44.8	45.8	39.7	35.1	28.4	21.0	46.0
Super silent2	46.0	45.7	40.8	41.8	35.7	31.1	24.4	17.0	42.0

PUMY-SP100, 125, 140VKM2-PA, DA(-BS)


PUMY-SP100, 125, 140YKM2-PA, DA(-BS)

• Cooling

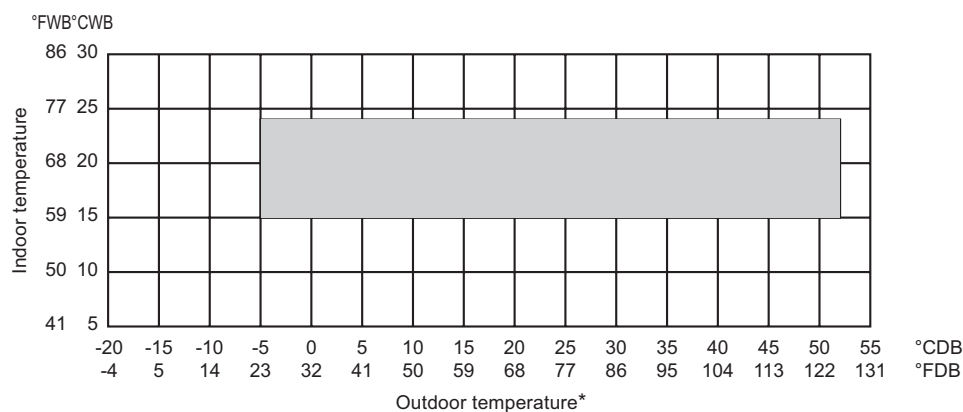

* 10 to 52°CDB (50 to 126°FDB): When connecting following models such as PKFY-P15/20/25/32VLM-E, PFFY-P20/25/32VKM-E, PFFY-P20/25/32VLE(R)M(M)-E, PFFY-P20/25/32VCM-E, PEFY-P25/40/63/71VMA4-E, and M series, S series, and P series type indoor unit.

• Heating

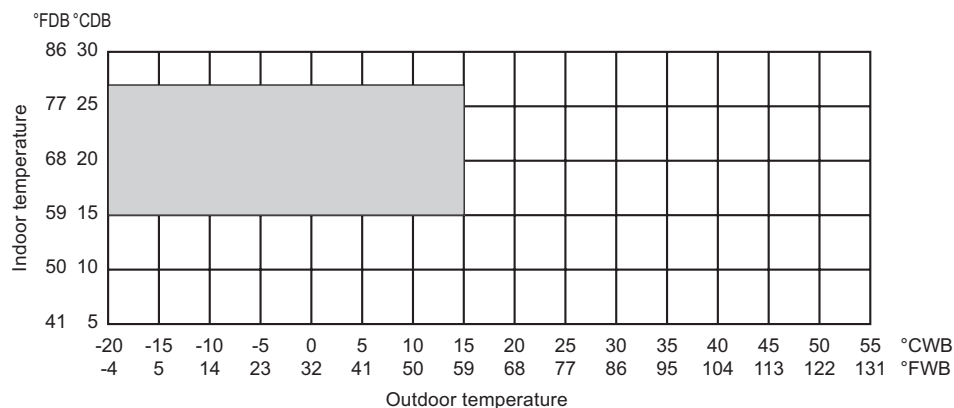


PUMY-CP100, 125, 140VKM2-PA, DA(-BS)

PUMY-CP112, 125, 140VKM2-TH

PUMY-CP100, 125, 140YKM2-PA(-BS)

PUMY-CP112, 125, 140YKM2-TH

• Cooling

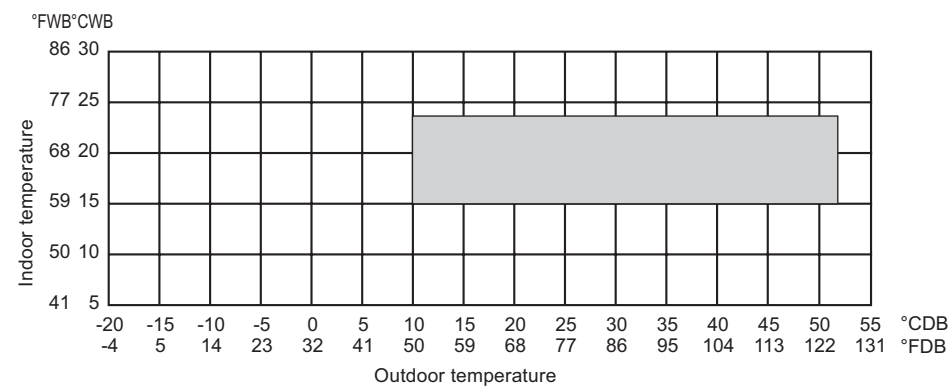

7-1. Correction by temperature/total indoor

7-1-1. Cooling capacity

PUMY-SP100VKM2-PA, DA(-BS)/PUMY-SP100YKM2-PA, DA(-BS)

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC
130	-5.0	9.43	0.82	10.11	0.94	11.47	1.60	12.15	1.98	12.51	2.41	13.25	2.48	13.98	2.55
	0.0	9.43	0.82	10.11	0.94	11.47	1.60	12.15	1.98	12.51	2.41	13.25	2.48	13.98	2.55
	5.0	9.43	0.82	10.11	0.94	11.47	1.60	12.15	1.98	12.51	2.41	13.25	2.48	13.98	2.55
	10.0	9.43	0.82	10.11	0.94	11.47	1.60	12.15	1.98	12.51	2.41	13.25	2.48	13.98	2.55
	12.0	9.43	0.83	10.11	0.94	11.47	1.60	12.15	1.98	12.51	2.41	13.25	2.48	13.98	2.55
	14.0	9.43	0.84	10.11	0.95	11.47	1.61	12.15	1.98	12.51	2.41	13.25	2.47	13.98	2.54
	16.0	9.43	0.85	10.11	0.96	11.47	1.62	12.15	1.97	12.51	2.40	13.25	2.47	13.98	2.54
	18.0	9.43	0.85	10.11	0.97	11.47	1.62	12.15	1.97	12.51	2.40	13.25	2.47	13.98	2.53
	20.0	9.43	0.86	10.11	0.98	11.47	1.63	12.15	1.96	12.51	2.40	13.25	2.46	13.98	2.53
	21.0	9.42	0.93	10.10	1.04	11.45	1.69	12.13	2.02	12.50	2.43	13.23	2.49	13.96	2.56
	23.0	9.40	1.07	10.07	1.18	11.42	1.81	12.10	2.14	12.46	2.49	13.20	2.56	13.93	2.62
	25.0	9.37	1.18	10.05	1.32	11.39	1.93	12.07	2.25	12.43	2.55	13.16	2.62	13.89	2.69
	27.0	9.35	1.32	10.02	1.46	11.36	2.05	12.04	2.37	12.40	2.62	13.13	2.68	13.85	2.75
	29.0	9.32	1.46	9.99	1.60	11.33	2.17	12.00	2.49	12.37	2.68	13.09	2.75	13.82	2.81
	31.0	9.30	1.57	9.97	1.74	11.30	2.29	11.97	2.60	12.33	2.74	13.06	2.81	13.78	2.87
	32.0	9.29	1.64	9.95	1.81	11.29	2.35	11.96	2.66	12.32	2.77	13.04	2.84	13.76	2.91
	33.0	9.27	1.71	9.94	1.88	11.27	2.41	11.94	2.72	12.30	2.80	13.02	2.87	13.74	2.94
	35.0	9.25	1.84	9.91	2.01	11.24	2.53	11.91	2.83	12.27	2.86	12.99	2.93	13.71	3.00
	37.0	9.25	2.11	9.91	2.31	11.24	2.82	11.91	3.13	12.27	3.16	12.99	3.23	13.71	3.29
	39.0	9.25	2.37	9.91	2.60	11.24	3.11	11.91	3.42	12.27	3.45	12.99	3.52	13.71	3.59
	40.0	9.25	2.52	9.91	2.75	11.24	3.26	11.91	3.57	12.27	3.60	12.99	3.67	13.71	3.73
	42.0	9.25	2.81	9.91	3.04	11.24	3.55	11.91	3.86	12.27	3.82	12.99	3.80	13.71	3.77
	43.0	9.25	2.93	9.91	3.19	11.24	3.70	11.91	4.01	12.27	3.93	12.99	3.87	13.71	3.79
	46.0	7.40	2.38	7.93	2.60	8.99	3.26	9.53	3.26	9.81	3.22	10.39	3.20	10.97	3.18
	52.0	3.24	1.67	3.47	1.84	3.94	2.27	4.17	2.27	4.29	2.23	4.55	2.18	4.80	2.13
120	-5.0	9.25	0.82	9.91	0.93	11.24	1.59	11.91	1.97	12.27	2.39	12.99	2.46	13.71	2.53
	0.0	9.25	0.82	9.91	0.93	11.24	1.59	11.91	1.97	12.27	2.39	12.99	2.46	13.71	2.53
	5.0	9.25	0.82	9.91	0.93	11.24	1.59	11.91	1.97	12.27	2.39	12.99	2.46	13.71	2.53
	10.0	9.25	0.82	9.91	0.93	11.24	1.59	11.91	1.97	12.27	2.39	12.99	2.46	13.71	2.53
	12.0	9.25	0.82	9.91	0.94	11.24	1.59	11.91	1.97	12.27	2.39	12.99	2.46	13.71	2.53
	14.0	9.25	0.83	9.91	0.95	11.24	1.60	11.91	1.96	12.27	2.39	12.99	2.46	13.71	2.52
	16.0	9.25	0.84	9.91	0.95	11.24	1.61	11.91	1.96	12.27	2.39	12.99	2.45	13.71	2.52
	18.0	9.25	0.85	9.91	0.96	11.24	1.61	11.91	1.95	12.27	2.39	12.99	2.45	13.71	2.52
	20.0	9.25	0.86	9.91	0.97	11.24	1.62	11.91	1.95	12.27	2.38	12.99	2.45	13.71	2.51
	21.0	9.24	0.93	9.90	1.04	11.23	1.68	11.89	2.01	12.25	2.41	12.97	2.48	13.69	2.54
	23.0	9.21	1.06	9.87	1.18	11.20	1.80	11.86	2.12	12.22	2.48	12.94	2.54	13.65	2.60
	25.0	9.19	1.17	9.85	1.31	11.17	1.92	11.83	2.24	12.19	2.54	12.90	2.60	13.62	2.67
	27.0	9.16	1.31	9.82	1.45	11.14	2.04	11.80	2.35	12.15	2.60	12.87	2.66	13.58	2.73
	29.0	9.14	1.45	9.80	1.59	11.11	2.15	11.77	2.47	12.12	2.66	12.83	2.73	13.54	2.79
	31.0	9.11	1.56	9.77	1.73	11.08	2.27	11.74	2.58	12.09	2.72	12.80	2.79	13.51	2.86
	32.0	9.10	1.63	9.76	1.79	11.07	2.33	11.72	2.64	12.07	2.75	12.78	2.82	13.49	2.89
	33.0	9.09	1.69	9.74	1.86	11.05	2.39	11.71	2.70	12.06	2.78	12.77	2.85	13.47	2.92
	35.0	9.07	1.83	9.72	2.00	11.02	2.51	11.67	2.81	12.03	2.85	12.73	2.91	13.44	2.98
	37.0	9.07	2.10	9.72	2.29	11.02	2.80	11.67	3.11	12.03	3.14	12.73	3.20	13.44	3.27
	39.0	9.07	2.36	9.72	2.58	11.02	3.09	11.67	3.40	12.03	3.43	12.73	3.50	13.44	3.56
	40.0	9.07	2.50	9.72	2.73	11.02	3.24	11.67	3.54	12.03	3.57	12.73	3.64	13.44	3.71
	42.0	9.07	2.80	9.72	3.02	11.02	3.53	11.67	3.83	12.03	3.79	12.73	3.78	13.44	3.74
	43.0	9.07	2.91	9.72	3.17	11.02	3.68	11.67	3.98	12.03	3.90	12.73	3.85	13.44	3.76
	46.0	7.25	2.36	7.77	2.59	8.82	3.24	9.34	3.24	9.62	3.20	10.19	3.18	10.75	3.16
	52.0	3.17	1.66	3.40	1.83	3.86	2.25	4.09	2.25	4.21	2.21	4.46	2.17	4.70	2.12

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-SP100VKM2-PA, DA(-BS)/PUMY-SP100YKM2-PA, DA(-BS)

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC
110	-5.0	9.06	0.81	9.71	0.92	11.02	1.58	11.67	1.96	12.02	2.38	12.73	2.45	13.43	2.52
	0.0	9.06	0.81	9.71	0.92	11.02	1.58	11.67	1.96	12.02	2.38	12.73	2.45	13.43	2.52
	5.0	9.06	0.81	9.71	0.92	11.02	1.58	11.67	1.96	12.02	2.38	12.73	2.45	13.43	2.52
	10.0	9.06	0.81	9.71	0.92	11.02	1.58	11.67	1.96	12.02	2.38	12.73	2.45	13.43	2.52
	12.0	9.06	0.82	9.71	0.93	11.02	1.58	11.67	1.96	12.02	2.38	12.73	2.45	13.43	2.51
	14.0	9.06	0.83	9.71	0.94	11.02	1.59	11.67	1.95	12.02	2.38	12.73	2.44	13.43	2.51
	16.0	9.06	0.84	9.71	0.95	11.02	1.60	11.67	1.95	12.02	2.37	12.73	2.44	13.43	2.51
	18.0	9.06	0.84	9.71	0.96	11.02	1.60	11.67	1.94	12.02	2.37	12.73	2.44	13.43	2.50
	20.0	9.06	0.85	9.71	0.96	11.02	1.61	11.67	1.94	12.02	2.37	12.73	2.43	13.43	2.50
	21.0	9.05	0.92	9.70	1.03	11.00	1.67	11.65	2.00	12.00	2.40	12.71	2.46	13.41	2.53
	23.0	9.03	1.06	9.68	1.17	10.97	1.79	11.62	2.11	11.97	2.46	12.68	2.53	13.38	2.59
	25.0	9.00	1.17	9.65	1.31	10.94	1.91	11.59	2.23	11.94	2.52	12.64	2.59	13.34	2.65
	27.0	8.98	1.30	9.62	1.44	10.92	2.02	11.56	2.34	11.91	2.58	12.61	2.65	13.31	2.71
	29.0	8.96	1.44	9.60	1.58	10.89	2.14	11.53	2.45	11.88	2.65	12.58	2.71	13.27	2.78
	31.0	8.93	1.55	9.57	1.72	10.86	2.26	11.50	2.57	11.85	2.71	12.54	2.77	13.24	2.84
	32.0	8.92	1.62	9.56	1.78	10.84	2.32	11.49	2.63	11.83	2.74	12.53	2.80	13.22	2.87
	33.0	8.91	1.69	9.55	1.85	10.83	2.38	11.47	2.68	11.82	2.77	12.51	2.83	13.20	2.90
	35.0	8.88	1.82	9.52	1.99	10.80	2.50	11.44	2.80	11.78	2.83	12.48	2.90	13.17	2.96
	37.0	8.88	2.08	9.52	2.28	10.80	2.78	11.44	3.09	11.78	3.12	12.48	3.19	13.17	3.25
	39.0	8.88	2.35	9.52	2.57	10.80	3.07	11.44	3.38	11.78	3.41	12.48	3.48	13.17	3.54
	40.0	8.88	2.49	9.52	2.71	10.80	3.22	11.44	3.52	11.78	3.55	12.48	3.62	13.17	3.69
	42.0	8.88	2.78	9.52	3.00	10.80	3.51	11.44	3.81	11.78	3.77	12.48	3.76	13.17	3.72
	43.0	8.88	2.90	9.52	3.15	10.80	3.65	11.44	3.96	11.78	3.88	12.48	3.82	13.17	3.74
	46.0	7.11	2.35	7.62	2.57	8.64	3.22	9.15	3.22	9.43	3.18	9.98	3.16	10.53	3.14
	52.0	3.11	1.65	3.33	1.82	3.78	2.24	4.00	2.24	4.12	2.20	4.37	2.15	4.61	2.10
100	-5.0	8.87	0.81	9.51	0.92	10.79	1.57	11.42	1.95	11.77	2.36	12.46	2.43	13.15	2.50
	0.0	8.87	0.81	9.51	0.92	10.79	1.57	11.42	1.95	11.77	2.36	12.46	2.43	13.15	2.50
	5.0	8.87	0.81	9.51	0.92	10.79	1.57	11.42	1.95	11.77	2.36	12.46	2.43	13.15	2.50
	10.0	8.87	0.81	9.51	0.92	10.79	1.57	11.42	1.95	11.77	2.36	12.46	2.43	13.15	2.50
	12.0	8.87	0.81	9.51	0.93	10.79	1.57	11.42	1.94	11.77	2.36	12.46	2.43	13.15	2.50
	14.0	8.87	0.82	9.51	0.93	10.79	1.58	11.42	1.94	11.77	2.36	12.46	2.43	13.15	2.49
	16.0	8.87	0.83	9.51	0.94	10.79	1.59	11.42	1.93	11.77	2.36	12.46	2.42	13.15	2.49
	18.0	8.87	0.84	9.51	0.95	10.79	1.59	11.42	1.93	11.77	2.36	12.46	2.42	13.15	2.48
	20.0	8.87	0.85	9.51	0.96	10.79	1.60	11.42	1.93	11.77	2.35	12.46	2.42	13.15	2.48
	21.0	8.86	0.91	9.50	1.02	10.77	1.66	11.41	1.98	11.75	2.39	12.44	2.45	13.13	2.51
	23.0	8.84	1.05	9.47	1.16	10.74	1.78	11.38	2.10	11.72	2.45	12.41	2.51	13.10	2.57
	25.0	8.81	1.16	9.45	1.30	10.72	1.89	11.35	2.21	11.69	2.51	12.38	2.57	13.06	2.63
	27.0	8.79	1.29	9.42	1.43	10.69	2.01	11.32	2.32	11.66	2.57	12.35	2.63	13.03	2.70
	29.0	8.77	1.43	9.40	1.57	10.66	2.13	11.29	2.44	11.63	2.63	12.31	2.69	12.99	2.76
	31.0	8.74	1.54	9.37	1.70	10.63	2.24	11.26	2.55	11.60	2.69	12.28	2.75	12.96	2.82
	32.0	8.73	1.61	9.36	1.77	10.62	2.30	11.24	2.61	11.58	2.72	12.26	2.79	12.94	2.85
	33.0	8.72	1.67	9.35	1.84	10.60	2.36	11.23	2.67	11.57	2.75	12.25	2.82	12.93	2.88
	35.0	8.70	1.81	9.32	1.98	10.57	2.48	11.20	2.78	11.54	2.81	12.21	2.88	12.89	2.94
	37.0	8.70	2.07	9.32	2.26	10.57	2.77	11.20	3.07	11.54	3.10	12.21	3.17	12.89	3.23
	39.0	8.70	2.33	9.32	2.55	10.57	3.05	11.20	3.36	11.54	3.39	12.21	3.45	12.89	3.52
	40.0	8.70	2.47	9.32	2.70	10.57	3.20	11.20	3.50	11.54	3.53	12.21	3.60	12.89	3.66
	42.0	8.70	2.76	9.32	2.98	10.57	3.49	11.20	3.79	11.54	3.75	12.21	3.73	12.89	3.70
	43.0	8.70	2.88	9.32	3.13	10.57	3.63	11.20	3.93	11.54	3.85	12.21	3.80	12.89	3.72
	46.0	6.96	2.33	7.46	2.55	8.46	3.20	8.96	3.20	9.23	3.16	9.77	3.14	10.31	3.12
	52.0	3.04	1.64	3.26	1.80	3.70	2.23	3.92	2.22	4.04	2.18	4.28	2.14	4.51	2.09

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

7. CAPACITY TABLES

S-Series

PUMY-SP100VKM2-PA, DA(-BS)/PUMY-SP100YKM2-PA, DA(-BS)

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
	°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
90	-5.0	7.99	0.71	8.56	0.81	9.71	1.38	10.28	1.71	10.59	2.08	11.21	2.14	11.84	2.20
	0.0	7.99	0.71	8.56	0.81	9.71	1.38	10.28	1.71	10.59	2.08	11.21	2.14	11.84	2.20
	5.0	7.99	0.71	8.56	0.81	9.71	1.38	10.28	1.71	10.59	2.08	11.21	2.14	11.84	2.20
	10.0	7.99	0.71	8.56	0.81	9.71	1.38	10.28	1.71	10.59	2.08	11.21	2.14	11.84	2.20
	12.0	7.99	0.72	8.56	0.81	9.71	1.38	10.28	1.71	10.59	2.07	11.21	2.13	11.84	2.19
	14.0	7.99	0.72	8.56	0.82	9.71	1.39	10.28	1.70	10.59	2.07	11.21	2.13	11.84	2.19
	16.0	7.99	0.73	8.56	0.83	9.71	1.39	10.28	1.70	10.59	2.07	11.21	2.13	11.84	2.19
	18.0	7.99	0.74	8.56	0.83	9.71	1.40	10.28	1.70	10.59	2.07	11.21	2.13	11.84	2.18
	20.0	7.99	0.74	8.56	0.84	9.71	1.41	10.28	1.69	10.59	2.07	11.21	2.12	11.84	2.18
	21.0	7.98	0.80	8.55	0.90	9.70	1.46	10.27	1.74	10.58	2.09	11.20	2.15	11.82	2.21
	23.0	7.95	0.92	8.53	1.02	9.67	1.56	10.24	1.84	10.55	2.15	11.17	2.20	11.79	2.26
	25.0	7.93	1.02	8.50	1.14	9.65	1.66	10.22	1.94	10.52	2.20	11.14	2.26	11.76	2.31
	27.0	7.91	1.14	8.48	1.26	9.62	1.77	10.19	2.04	10.50	2.25	11.11	2.31	11.73	2.37
	29.0	7.89	1.26	8.46	1.38	9.59	1.87	10.16	2.14	10.47	2.31	11.08	2.37	11.70	2.42
	31.0	7.87	1.35	8.44	1.50	9.57	1.97	10.14	2.24	10.44	2.36	11.05	2.42	11.67	2.48
	32.0	7.86	1.41	8.43	1.56	9.56	2.02	10.12	2.29	10.43	2.39	11.04	2.45	11.65	2.50
	33.0	7.85	1.47	8.42	1.62	9.54	2.07	10.11	2.34	10.41	2.42	11.02	2.47	11.63	2.53
	35.0	7.83	1.59	8.39	1.74	9.52	2.18	10.08	2.44	10.39	2.47	11.00	2.53	11.60	2.59
	37.0	7.83	1.82	8.39	1.99	9.52	2.43	10.08	2.69	10.39	2.72	11.00	2.78	11.60	2.84
	39.0	7.83	2.05	8.39	2.24	9.52	2.68	10.08	2.95	10.39	2.97	11.00	3.03	11.60	3.09
	40.0	7.83	2.17	8.39	2.37	9.52	2.81	10.08	3.07	10.39	3.10	11.00	3.16	11.60	3.22
	42.0	7.83	2.43	8.39	2.62	9.52	3.06	10.08	3.33	10.39	3.29	11.00	3.28	11.60	3.25
	43.0	7.83	2.53	8.39	2.75	9.52	3.19	10.08	3.45	10.39	3.39	11.00	3.34	11.60	3.26
	46.0	6.26	2.05	6.71	2.24	7.61	2.81	8.07	2.81	8.31	2.77	8.80	2.76	9.28	2.74
	52.0	2.74	1.44	2.94	1.58	3.33	1.95	3.53	1.95	3.64	1.92	3.85	1.88	4.06	1.84
80	-5.0	7.10	0.62	7.61	0.70	8.63	1.20	9.14	1.49	9.42	1.81	9.97	1.86	10.52	1.91
	0.0	7.10	0.62	7.61	0.70	8.63	1.20	9.14	1.49	9.42	1.81	9.97	1.86	10.52	1.91
	5.0	7.10	0.62	7.61	0.70	8.63	1.20	9.14	1.49	9.42	1.81	9.97	1.86	10.52	1.91
	10.0	7.10	0.62	7.61	0.70	8.63	1.20	9.14	1.49	9.42	1.81	9.97	1.86	10.52	1.91
	12.0	7.10	0.62	7.61	0.71	8.63	1.20	9.14	1.48	9.42	1.81	9.97	1.86	10.52	1.91
	14.0	7.10	0.63	7.61	0.71	8.63	1.21	9.14	1.48	9.42	1.80	9.97	1.85	10.52	1.91
	16.0	7.10	0.63	7.61	0.72	8.63	1.21	9.14	1.48	9.42	1.80	9.97	1.85	10.52	1.90
	18.0	7.10	0.64	7.61	0.73	8.63	1.22	9.14	1.48	9.42	1.80	9.97	1.85	10.52	1.90
	20.0	7.10	0.65	7.61	0.73	8.63	1.22	9.14	1.47	9.42	1.80	9.97	1.85	10.52	1.90
	21.0	7.09	0.70	7.60	0.78	8.62	1.27	9.13	1.52	9.40	1.82	9.96	1.87	10.51	1.92
	23.0	7.07	0.80	7.58	0.89	8.60	1.36	9.10	1.60	9.38	1.87	9.93	1.92	10.48	1.97
	25.0	7.05	0.89	7.56	0.99	8.57	1.45	9.08	1.69	9.36	1.92	9.90	1.97	10.45	2.01
	27.0	7.03	0.99	7.54	1.10	8.55	1.54	9.06	1.78	9.33	1.96	9.88	2.01	10.42	2.06
	29.0	7.02	1.09	7.52	1.20	8.53	1.63	9.03	1.86	9.31	2.01	9.85	2.06	10.40	2.11
	31.0	7.00	1.18	7.50	1.30	8.51	1.72	9.01	1.95	9.28	2.06	9.83	2.11	10.37	2.16
	32.0	6.99	1.23	7.49	1.36	8.49	1.76	9.00	1.99	9.27	2.08	9.81	2.13	10.36	2.18
	33.0	6.98	1.28	7.48	1.41	8.48	1.81	8.99	2.04	9.26	2.10	9.80	2.15	10.34	2.20
	35.0	6.96	1.38	7.46	1.51	8.46	1.89	8.96	2.13	9.23	2.15	9.77	2.20	10.31	2.25
	37.0	6.96	1.58	7.46	1.73	8.46	2.11	8.96	2.35	9.23	2.37	9.77	2.42	10.31	2.47
	39.0	6.96	1.78	7.46	1.95	8.46	2.33	8.96	2.57	9.23	2.59	9.77	2.64	10.31	2.69
	40.0	6.96	1.89	7.46	2.06	8.46	2.44	8.96	2.68	9.23	2.70	9.77	2.75	10.31	2.80
	42.0	6.96	2.11	7.46	2.28	8.46	2.66	8.96	2.90	9.23	2.86	9.77	2.85	10.31	2.83
	43.0	6.96	2.20	7.46	2.39	8.46	2.77	8.96	3.01	9.23	2.95	9.77	2.90	10.31	2.84
	46.0	5.57	1.78	5.97	1.95	6.77	2.45	7.17	2.44	7.39	2.41	7.82	2.40	8.25	2.38
	52.0	2.44	1.25	2.61	1.38	2.96	1.70	3.14	1.70	3.23	1.67	3.42	1.64	3.61	1.60

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-SP100VKM2-PA, DA(-BS)/PUMY-SP100YKM2-PA, DA(-BS)

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC
70	-5.0	6.21	0.53	6.66	0.61	7.55	1.04	8.00	1.29	8.24	1.56	8.72	1.61	9.21	1.66
	0.0	6.21	0.53	6.66	0.61	7.55	1.04	8.00	1.29	8.24	1.56	8.72	1.61	9.21	1.66
	5.0	6.21	0.53	6.66	0.61	7.55	1.04	8.00	1.29	8.24	1.56	8.72	1.61	9.21	1.66
	10.0	6.21	0.53	6.66	0.61	7.55	1.04	8.00	1.29	8.24	1.56	8.72	1.61	9.21	1.66
	12.0	6.21	0.54	6.66	0.61	7.55	1.04	8.00	1.29	8.24	1.56	8.72	1.61	9.21	1.65
	14.0	6.21	0.54	6.66	0.62	7.55	1.05	8.00	1.28	8.24	1.56	8.72	1.61	9.21	1.65
	16.0	6.21	0.55	6.66	0.62	7.55	1.05	8.00	1.28	8.24	1.56	8.72	1.60	9.21	1.65
	18.0	6.21	0.55	6.66	0.63	7.55	1.06	8.00	1.28	8.24	1.56	8.72	1.60	9.21	1.64
	20.0	6.21	0.56	6.66	0.63	7.55	1.06	8.00	1.28	8.24	1.56	8.72	1.60	9.21	1.64
	21.0	6.20	0.60	6.65	0.68	7.54	1.10	7.99	1.31	8.23	1.58	8.71	1.62	9.19	1.66
	23.0	6.19	0.69	6.63	0.77	7.52	1.18	7.97	1.39	8.21	1.62	8.69	1.66	9.17	1.70
	25.0	6.17	0.77	6.61	0.86	7.50	1.25	7.95	1.46	8.19	1.66	8.67	1.70	9.15	1.74
	27.0	6.15	0.86	6.60	0.95	7.48	1.33	7.92	1.54	8.16	1.70	8.64	1.74	9.12	1.78
	29.0	6.14	0.95	6.58	1.04	7.46	1.41	7.90	1.61	8.14	1.74	8.62	1.78	9.10	1.83
	31.0	6.12	1.02	6.56	1.13	7.44	1.49	7.88	1.69	8.12	1.78	8.60	1.82	9.07	1.87
	32.0	6.11	1.06	6.55	1.17	7.43	1.52	7.87	1.73	8.11	1.80	8.59	1.84	9.06	1.89
	33.0	6.11	1.11	6.55	1.22	7.42	1.56	7.86	1.76	8.10	1.82	8.57	1.86	9.05	1.91
	35.0	6.09	1.20	6.53	1.31	7.40	1.64	7.84	1.84	8.08	1.86	8.55	1.90	9.03	1.95
	37.0	6.09	1.37	6.53	1.50	7.40	1.83	7.84	2.03	8.08	2.05	8.55	2.10	9.03	2.14
	39.0	6.09	1.54	6.53	1.69	7.40	2.02	7.84	2.22	8.08	2.24	8.55	2.29	9.03	2.33
	40.0	6.09	1.64	6.53	1.78	7.40	2.12	7.84	2.32	8.08	2.34	8.55	2.38	9.03	2.43
	42.0	6.09	1.83	6.53	1.98	7.40	2.31	7.84	2.51	8.08	2.48	8.55	2.47	9.03	2.45
	43.0	6.09	1.90	6.53	2.07	7.40	2.40	7.84	2.60	8.08	2.55	8.55	2.51	9.03	2.46
	46.0	4.87	1.54	5.22	1.69	5.92	2.12	6.27	2.12	6.46	2.09	6.84	2.08	7.22	2.06
	52.0	2.13	1.08	2.28	1.19	2.59	1.47	2.74	1.47	2.83	1.45	2.99	1.42	3.16	1.38
60	-5.0	5.32	0.46	5.71	0.52	6.47	0.89	6.86	1.11	7.06	1.35	7.48	1.39	7.89	1.43
	0.0	5.32	0.46	5.71	0.52	6.47	0.89	6.86	1.11	7.06	1.35	7.48	1.39	7.89	1.43
	5.0	5.32	0.46	5.71	0.52	6.47	0.89	6.86	1.11	7.06	1.35	7.48	1.39	7.89	1.43
	10.0	5.32	0.46	5.71	0.52	6.47	0.89	6.86	1.11	7.06	1.35	7.48	1.39	7.89	1.43
	12.0	5.32	0.47	5.71	0.53	6.47	0.90	6.86	1.11	7.06	1.35	7.48	1.39	7.89	1.43
	14.0	5.32	0.47	5.71	0.53	6.47	0.90	6.86	1.11	7.06	1.35	7.48	1.39	7.89	1.42
	16.0	5.32	0.47	5.71	0.54	6.47	0.91	6.86	1.10	7.06	1.35	7.48	1.38	7.89	1.42
	18.0	5.32	0.48	5.71	0.54	6.47	0.91	6.86	1.10	7.06	1.35	7.48	1.38	7.89	1.42
	20.0	5.32	0.48	5.71	0.55	6.47	0.91	6.86	1.10	7.06	1.35	7.48	1.38	7.89	1.42
	21.0	5.32	0.52	5.70	0.59	6.46	0.95	6.85	1.13	7.05	1.36	7.47	1.40	7.88	1.43
	23.0	5.30	0.60	5.68	0.66	6.45	1.01	6.83	1.20	7.03	1.40	7.45	1.43	7.86	1.47
	25.0	5.29	0.66	5.67	0.74	6.43	1.08	6.81	1.26	7.02	1.43	7.43	1.47	7.84	1.50
	27.0	5.28	0.74	5.65	0.82	6.41	1.15	6.79	1.33	7.00	1.47	7.41	1.50	7.82	1.54
	29.0	5.26	0.82	5.64	0.90	6.40	1.22	6.77	1.39	6.98	1.50	7.39	1.54	7.80	1.58
	31.0	5.25	0.88	5.62	0.97	6.38	1.28	6.76	1.46	6.96	1.54	7.37	1.57	7.78	1.61
	32.0	5.24	0.92	5.62	1.01	6.37	1.32	6.75	1.49	6.95	1.55	7.36	1.59	7.77	1.63
	33.0	5.23	0.96	5.61	1.05	6.36	1.35	6.74	1.52	6.94	1.57	7.35	1.61	7.76	1.65
	35.0	5.22	1.03	5.60	1.13	6.35	1.42	6.72	1.59	6.92	1.61	7.33	1.64	7.74	1.68
	37.0	5.22	1.18	5.60	1.29	6.35	1.58	6.72	1.75	6.92	1.77	7.33	1.81	7.74	1.85
	39.0	5.22	1.33	5.60	1.46	6.35	1.74	6.72	1.92	6.92	1.93	7.33	1.97	7.74	2.01
	40.0	5.22	1.41	5.60	1.54	6.35	1.83	6.72	2.00	6.92	2.02	7.33	2.05	7.74	2.09
	42.0	5.22	1.58	5.60	1.70	6.35	1.99	6.72	2.16	6.92	2.14	7.33	2.13	7.74	2.11
	43.0	5.22	1.64	5.60	1.79	6.35	2.07	6.72	2.25	6.92	2.20	7.33	2.17	7.74	2.12
	46.0	4.18	1.33	4.48	1.46	5.08	1.83	5.38	1.83	5.54	1.80	5.86	1.79	6.19	1.78
	52.0	1.83	0.94	1.96	1.03	2.22	1.27	2.35	1.27	2.42	1.25	2.57	1.22	2.71	1.19

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

7. CAPACITY TABLES

S-Series

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

PUMY-SP100VKM2-PA, DA(-BS)/PUMY-SP100YKM2-PA, DA(-BS)															TC: Total Capacity (kW), PI: Power Input (kW)	
Combination (%)	Outdoor air temp.	Indoor air temp.														
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.		
	°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	
50	-5.0	4.44	0.40	4.76	0.45	5.39	0.77	5.71	0.96	5.89	1.16	6.23	1.20	6.58	1.23	
	0.0	4.44	0.40	4.76	0.45	5.39	0.77	5.71	0.96	5.89	1.16	6.23	1.20	6.58	1.23	
	5.0	4.44	0.40	4.76	0.45	5.39	0.77	5.71	0.96	5.89	1.16	6.23	1.20	6.58	1.23	
	10.0	4.44	0.40	4.76	0.45	5.39	0.77	5.71	0.96	5.89	1.16	6.23	1.20	6.58	1.23	
	12.0	4.44	0.40	4.76	0.46	5.39	0.77	5.71	0.95	5.89	1.16	6.23	1.19	6.58	1.23	
	14.0	4.44	0.40	4.76	0.46	5.39	0.78	5.71	0.95	5.89	1.16	6.23	1.19	6.58	1.23	
	16.0	4.44	0.41	4.76	0.46	5.39	0.78	5.71	0.95	5.89	1.16	6.23	1.19	6.58	1.22	
	18.0	4.44	0.41	4.76	0.47	5.39	0.78	5.71	0.95	5.89	1.16	6.23	1.19	6.58	1.22	
	20.0	4.44	0.42	4.76	0.47	5.39	0.79	5.71	0.95	5.89	1.16	6.23	1.19	6.58	1.22	
	21.0	4.43	0.45	4.75	0.50	5.39	0.82	5.71	0.97	5.88	1.17	6.22	1.20	6.57	1.23	
	23.0	4.42	0.52	4.74	0.57	5.37	0.87	5.69	1.03	5.86	1.20	6.21	1.23	6.55	1.26	
	25.0	4.41	0.57	4.72	0.64	5.36	0.93	5.68	1.09	5.85	1.23	6.19	1.26	6.53	1.29	
	27.0	4.40	0.64	4.71	0.70	5.34	0.99	5.66	1.14	5.83	1.26	6.17	1.29	6.52	1.33	
	29.0	4.38	0.70	4.70	0.77	5.33	1.05	5.65	1.20	5.82	1.29	6.16	1.32	6.50	1.36	
	31.0	4.37	0.76	4.69	0.84	5.32	1.10	5.63	1.25	5.80	1.32	6.14	1.35	6.48	1.39	
	32.0	4.37	0.79	4.68	0.87	5.31	1.13	5.62	1.28	5.79	1.34	6.13	1.37	6.47	1.40	
	33.0	4.36	0.82	4.68	0.90	5.30	1.16	5.62	1.31	5.79	1.35	6.12	1.38	6.46	1.42	
	35.0	4.35	0.89	4.66	0.97	5.29	1.22	5.60	1.37	5.77	1.38	6.11	1.41	6.45	1.45	
	37.0	4.35	1.02	4.66	1.11	5.29	1.36	5.60	1.51	5.77	1.52	6.11	1.56	6.45	1.59	
	39.0	4.35	1.14	4.66	1.25	5.29	1.50	5.60	1.65	5.77	1.66	6.11	1.70	6.45	1.73	
	40.0	4.35	1.22	4.66	1.32	5.29	1.57	5.60	1.72	5.77	1.73	6.11	1.77	6.45	1.80	
	42.0	4.35	1.36	4.66	1.47	5.29	1.71	5.60	1.86	5.77	1.84	6.11	1.83	6.45	1.82	
	43.0	4.35	1.41	4.66	1.54	5.29	1.78	5.60	1.93	5.77	1.89	6.11	1.87	6.45	1.83	
	46.0	3.48	1.15	3.73	1.26	4.23	1.57	4.48	1.57	4.62	1.55	4.89	1.54	5.16	1.53	
	52.0	1.52	0.80	1.63	0.89	1.85	1.09	1.96	1.09	2.02	1.07	2.14	1.05	2.26	1.03	

* Corrections for piping length are not taken into account. Please contact the sales company for questions. kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-SP125VKM2-PA, DA(-BS)/PUMY-SP125YKM2-PA, DA(-BS)

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
		°C D.B.		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
130	-5.0	11.79	1.14	12.64	1.30	14.34	2.21	15.18	2.75	15.64	3.34	16.56	3.44	17.48	3.53
	0.0	11.79	1.14	12.64	1.30	14.34	2.21	15.18	2.75	15.64	3.34	16.56	3.44	17.48	3.53
	5.0	11.79	1.14	12.64	1.30	14.34	2.21	15.18	2.75	15.64	3.34	16.56	3.44	17.48	3.53
	10.0	11.79	1.14	12.64	1.30	14.34	2.21	15.18	2.75	15.64	3.34	16.56	3.44	17.48	3.53
	12.0	11.79	1.15	12.64	1.31	14.34	2.22	15.18	2.74	15.64	3.34	16.56	3.43	17.48	3.53
	14.0	11.79	1.16	12.64	1.32	14.34	2.23	15.18	2.74	15.64	3.33	16.56	3.43	17.48	3.52
	16.0	11.79	1.17	12.64	1.33	14.34	2.24	15.18	2.73	15.64	3.33	16.56	3.42	17.48	3.51
	18.0	11.79	1.18	12.64	1.34	14.34	2.25	15.18	2.73	15.64	3.33	16.56	3.42	17.48	3.51
	20.0	11.79	1.19	12.64	1.35	14.34	2.26	15.18	2.72	15.64	3.33	16.56	3.41	17.48	3.50
	21.0	11.78	1.29	12.62	1.45	14.32	2.34	15.16	2.80	15.62	3.37	16.54	3.46	17.45	3.55
	23.0	11.75	1.48	12.59	1.64	14.28	2.51	15.12	2.96	15.58	3.45	16.49	3.54	17.41	3.63
	25.0	11.71	1.64	12.56	1.83	14.24	2.67	15.08	3.12	15.54	3.54	16.45	3.63	17.36	3.72
	27.0	11.68	1.83	12.52	2.02	14.20	2.84	15.04	3.28	15.50	3.63	16.41	3.72	17.32	3.81
	29.0	11.65	2.02	12.49	2.22	14.17	3.00	15.00	3.44	15.46	3.71	16.36	3.80	17.27	3.90
	31.0	11.62	2.17	12.46	2.41	14.13	3.17	14.96	3.60	15.42	3.80	16.32	3.89	17.22	3.98
	32.0	11.61	2.27	12.44	2.50	14.11	3.25	14.94	3.69	15.40	3.84	16.30	3.93	17.20	4.03
	33.0	11.59	2.36	12.42	2.60	14.09	3.34	14.93	3.77	15.38	3.88	16.28	3.98	17.18	4.07
	35.0	11.56	2.56	12.39	2.79	14.05	3.50	14.89	3.93	15.33	3.97	16.23	4.06	17.13	4.16
	37.0	11.56	2.84	12.39	3.11	14.05	3.82	14.89	4.25	15.33	4.29	16.23	4.39	17.13	4.48
	39.0	11.56	3.12	12.39	3.44	14.05	4.15	14.89	4.57	15.33	4.61	16.23	4.71	17.13	4.80
	40.0	11.56	3.28	12.39	3.60	14.05	4.31	14.89	4.73	15.33	4.78	16.23	4.87	17.13	4.96
	42.0	11.56	3.61	12.39	3.92	14.05	4.63	14.89	5.06	15.33	5.00	16.23	4.98	17.13	4.93
	43.0	11.56	3.73	12.39	4.08	14.05	4.79	14.89	5.22	15.33	5.11	16.23	5.03	17.13	4.91
	46.0	9.25	3.02	9.91	3.33	11.24	4.09	11.91	4.08	12.27	4.03	12.99	4.00	13.71	3.97
	52.0	4.05	2.31	4.34	2.55	4.92	3.14	5.21	3.14	5.37	3.08	5.68	3.02	6.00	2.95
120	-5.0	11.56	1.13	12.39	1.29	14.05	2.20	14.88	2.73	15.33	3.31	16.23	3.41	17.13	3.51
	0.0	11.56	1.13	12.39	1.29	14.05	2.20	14.88	2.73	15.33	3.31	16.23	3.41	17.13	3.51
	5.0	11.56	1.13	12.39	1.29	14.05	2.20	14.88	2.73	15.33	3.31	16.23	3.41	17.13	3.51
	10.0	11.56	1.13	12.39	1.29	14.05	2.20	14.88	2.73	15.33	3.31	16.23	3.41	17.13	3.51
	12.0	11.56	1.14	12.39	1.30	14.05	2.21	14.88	2.72	15.33	3.31	16.23	3.41	17.13	3.50
	14.0	11.56	1.15	12.39	1.31	14.05	2.22	14.88	2.72	15.33	3.31	16.23	3.40	17.13	3.50
	16.0	11.56	1.16	12.39	1.32	14.05	2.23	14.88	2.71	15.33	3.31	16.23	3.40	17.13	3.49
	18.0	11.56	1.18	12.39	1.33	14.05	2.24	14.88	2.71	15.33	3.30	16.23	3.39	17.13	3.48
	20.0	11.56	1.19	12.39	1.34	14.05	2.25	14.88	2.70	15.33	3.30	16.23	3.39	17.13	3.48
	21.0	11.54	1.28	12.37	1.44	14.03	2.33	14.86	2.78	15.31	3.34	16.21	3.43	17.10	3.52
	23.0	11.51	1.47	12.34	1.63	13.99	2.49	14.82	2.94	15.27	3.43	16.16	3.52	17.06	3.61
	25.0	11.48	1.62	12.31	1.82	13.96	2.66	14.78	3.10	15.23	3.52	16.12	3.60	17.01	3.69
	27.0	11.45	1.81	12.27	2.01	13.92	2.82	14.74	3.26	15.19	3.60	16.08	3.69	16.97	3.78
	29.0	11.42	2.00	12.24	2.20	13.88	2.98	14.70	3.42	15.15	3.69	16.04	3.78	16.92	3.87
	31.0	11.39	2.16	12.21	2.39	13.85	3.15	14.67	3.58	15.11	3.77	15.99	3.86	16.88	3.95
	32.0	11.37	2.25	12.19	2.49	13.83	3.23	14.65	3.66	15.09	3.81	15.97	3.91	16.86	4.00
	33.0	11.36	2.35	12.18	2.58	13.81	3.31	14.63	3.74	15.07	3.86	15.95	3.95	16.83	4.04
	35.0	11.33	2.54	12.14	2.77	13.77	3.48	14.59	3.90	15.03	3.94	15.91	4.03	16.79	4.13
	37.0	11.33	2.82	12.14	3.09	13.77	3.80	14.59	4.22	15.03	4.26	15.91	4.36	16.79	4.45
	39.0	11.33	3.10	12.14	3.41	13.77	4.12	14.59	4.54	15.03	4.58	15.91	4.68	16.79	4.77
	40.0	11.33	3.26	12.14	3.57	13.77	4.28	14.59	4.70	15.03	4.74	15.91	4.84	16.79	4.93
	42.0	11.33	3.58	12.14	3.89	13.77	4.60	14.59	5.02	15.03	4.96	15.91	4.94	16.79	4.89
	43.0	11.33	3.70	12.14	4.05	13.77	4.76	14.59	5.18	15.03	5.07	15.91	4.99	16.79	4.88
	46.0	9.06	3.00	9.71	3.31	11.02	4.06	11.67	4.05	12.02	4.00	12.73	3.97	13.43	3.94
	52.0	3.97	2.30	4.25	2.53	4.82	3.12	5.11	3.12	5.26	3.06	5.57	3.00	5.88	2.93

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

7. CAPACITY TABLES

S-Series

PUMY-SP125VKM2-PA, DA(-BS)/PUMY-SP125YKM2-PA, DA(-BS)

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC
110	-5.0	11.32	1.12	12.13	1.28	13.76	2.18	14.58	2.71	15.02	3.29	15.90	3.39	16.78	3.48
	0.0	11.32	1.12	12.13	1.28	13.76	2.18	14.58	2.71	15.02	3.29	15.90	3.39	16.78	3.48
	5.0	11.32	1.12	12.13	1.28	13.76	2.18	14.58	2.71	15.02	3.29	15.90	3.39	16.78	3.48
	10.0	11.32	1.12	12.13	1.28	13.76	2.18	14.58	2.71	15.02	3.29	15.90	3.39	16.78	3.48
	12.0	11.32	1.13	12.13	1.29	13.76	2.19	14.58	2.70	15.02	3.29	15.90	3.38	16.78	3.48
	14.0	11.32	1.15	12.13	1.30	13.76	2.20	14.58	2.70	15.02	3.29	15.90	3.38	16.78	3.47
	16.0	11.32	1.16	12.13	1.31	13.76	2.21	14.58	2.69	15.02	3.28	15.90	3.37	16.78	3.46
	18.0	11.32	1.17	12.13	1.32	13.76	2.22	14.58	2.69	15.02	3.28	15.90	3.37	16.78	3.46
	20.0	11.32	1.18	12.13	1.33	13.76	2.23	14.58	2.68	15.02	3.28	15.90	3.37	16.78	3.45
	21.0	11.30	1.27	12.12	1.43	13.74	2.31	14.56	2.76	15.00	3.32	15.88	3.41	16.75	3.50
	23.0	11.28	1.46	12.09	1.62	13.71	2.47	14.52	2.92	14.96	3.41	15.83	3.49	16.71	3.58
	25.0	11.25	1.61	12.05	1.81	13.67	2.64	14.48	3.08	14.92	3.49	15.79	3.58	16.67	3.67
	27.0	11.22	1.80	12.02	1.99	13.64	2.80	14.44	3.24	14.88	3.57	15.75	3.66	16.62	3.75
	29.0	11.19	1.99	11.99	2.18	13.60	2.96	14.40	3.40	14.84	3.66	15.71	3.75	16.58	3.84
	31.0	11.16	2.14	11.96	2.37	13.56	3.13	14.37	3.55	14.80	3.74	15.67	3.84	16.53	3.93
	32.0	11.14	2.24	11.94	2.47	13.55	3.21	14.35	3.63	14.78	3.79	15.65	3.88	16.51	3.97
	33.0	11.13	2.33	11.93	2.56	13.53	3.29	14.33	3.71	14.76	3.83	15.63	3.92	16.49	4.01
	35.0	11.10	2.52	11.90	2.75	13.49	3.45	14.29	3.87	14.72	3.91	15.58	4.01	16.45	4.10
	37.0	11.10	2.80	11.90	3.07	13.49	3.77	14.29	4.19	14.72	4.23	15.58	4.32	16.45	4.42
	39.0	11.10	3.08	11.90	3.39	13.49	4.09	14.29	4.51	14.72	4.55	15.58	4.64	16.45	4.74
	40.0	11.10	3.24	11.90	3.55	13.49	4.25	14.29	4.67	14.72	4.71	15.58	4.80	16.45	4.89
	42.0	11.10	3.56	11.90	3.87	13.49	4.56	14.29	4.98	14.72	4.93	15.58	4.91	16.45	4.86
	43.0	11.10	3.68	11.90	4.02	13.49	4.72	14.29	5.14	14.72	5.04	15.58	4.96	16.45	4.84
	46.0	8.88	2.98	9.52	3.29	10.79	4.03	11.43	4.03	11.78	3.97	12.47	3.95	13.16	3.92
	52.0	3.88	2.28	4.16	2.51	4.72	3.10	5.00	3.10	5.15	3.04	5.45	2.98	5.76	2.91
100	-5.0	11.09	1.11	11.89	1.27	13.48	2.16	14.28	2.69	14.71	3.26	15.57	3.36	16.44	3.46
	0.0	11.09	1.11	11.89	1.27	13.48	2.16	14.28	2.69	14.71	3.26	15.57	3.36	16.44	3.46
	5.0	11.09	1.11	11.89	1.27	13.48	2.16	14.28	2.69	14.71	3.26	15.57	3.36	16.44	3.46
	10.0	11.09	1.11	11.89	1.27	13.48	2.16	14.28	2.69	14.71	3.26	15.57	3.36	16.44	3.46
	12.0	11.09	1.13	11.89	1.28	13.48	2.17	14.28	2.68	14.71	3.26	15.57	3.36	16.44	3.45
	14.0	11.09	1.14	11.89	1.29	13.48	2.18	14.28	2.68	14.71	3.26	15.57	3.35	16.44	3.44
	16.0	11.09	1.15	11.89	1.30	13.48	2.19	14.28	2.67	14.71	3.26	15.57	3.35	16.44	3.44
	18.0	11.09	1.16	11.89	1.31	13.48	2.20	14.28	2.67	14.71	3.25	15.57	3.34	16.44	3.43
	20.0	11.09	1.17	11.89	1.32	13.48	2.21	14.28	2.66	14.71	3.25	15.57	3.34	16.44	3.43
	21.0	11.08	1.26	11.87	1.42	13.46	2.29	14.26	2.74	14.69	3.29	15.55	3.38	16.41	3.47
	23.0	11.05	1.45	11.84	1.60	13.43	2.45	14.22	2.90	14.65	3.38	15.51	3.47	16.37	3.55
	25.0	11.02	1.60	11.81	1.79	13.39	2.62	14.19	3.05	14.62	3.46	15.47	3.55	16.33	3.64
	27.0	10.99	1.79	11.78	1.98	13.36	2.78	14.15	3.21	14.58	3.55	15.43	3.64	16.29	3.72
	29.0	10.96	1.97	11.75	2.17	13.32	2.94	14.11	3.37	14.54	3.63	15.39	3.72	16.24	3.81
	31.0	10.93	2.12	11.72	2.35	13.29	3.10	14.07	3.53	14.50	3.71	15.35	3.80	16.20	3.90
	32.0	10.92	2.22	11.70	2.45	13.27	3.18	14.06	3.60	14.48	3.76	15.33	3.85	16.18	3.94
	33.0	10.90	2.31	11.69	2.54	13.25	3.26	14.04	3.68	14.46	3.80	15.31	3.89	16.16	3.98
	35.0	10.87	2.50	11.65	2.73	13.22	3.42	14.00	3.84	14.42	3.88	15.27	3.97	16.11	4.07
	37.0	10.87	2.78	11.65	3.05	13.22	3.74	14.00	4.16	14.42	4.20	15.27	4.29	16.11	4.38
	39.0	10.87	3.05	11.65	3.36	13.22	4.05	14.00	4.47	14.42	4.51	15.27	4.61	16.11	4.70
	40.0	10.87	3.21	11.65	3.52	13.22	4.21	14.00	4.63	14.42	4.67	15.27	4.76	16.11	4.86
	42.0	10.87	3.53	11.65	3.83	13.22	4.53	14.00	4.94	14.42	4.89	15.27	4.87	16.11	4.82
	43.0	10.87	3.65	11.65	3.99	13.22	4.69	14.00	5.10	14.42	5.00	15.27	4.92	16.11	4.80
	46.0	8.70	2.95	9.32	3.26	10.57	4.00	11.20	3.99	11.54	3.94	12.21	3.91	12.89	3.89
	52.0	3.81	2.26	4.08	2.49	4.63	3.07	4.90	3.07	5.05	3.02	5.34	2.95	5.64	2.89

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-SP125VKM2-PA, DA(-BS)/PUMY-SP125YKM2-PA, DA(-BS)

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC
90	-5.0	9.98	0.96	10.69	1.09	12.13	1.86	12.85	2.30	13.23	2.80	14.01	2.88	14.79	2.96
	0.0	9.98	0.96	10.69	1.09	12.13	1.86	12.85	2.30	13.23	2.80	14.01	2.88	14.79	2.96
	5.0	9.98	0.96	10.69	1.09	12.13	1.86	12.85	2.30	13.23	2.80	14.01	2.88	14.79	2.96
	10.0	9.98	0.96	10.69	1.09	12.13	1.86	12.85	2.30	13.23	2.80	14.01	2.88	14.79	2.96
	12.0	9.98	0.96	10.69	1.10	12.13	1.86	12.85	2.30	13.23	2.80	14.01	2.88	14.79	2.96
	14.0	9.98	0.97	10.69	1.11	12.13	1.87	12.85	2.29	13.23	2.79	14.01	2.87	14.79	2.95
	16.0	9.98	0.98	10.69	1.11	12.13	1.88	12.85	2.29	13.23	2.79	14.01	2.87	14.79	2.95
	18.0	9.98	0.99	10.69	1.12	12.13	1.89	12.85	2.29	13.23	2.79	14.01	2.87	14.79	2.94
	20.0	9.98	1.00	10.69	1.13	12.13	1.90	12.85	2.28	13.23	2.79	14.01	2.86	14.79	2.94
	21.0	9.96	1.08	10.68	1.21	12.11	1.97	12.83	2.35	13.22	2.82	13.99	2.90	14.77	2.97
	23.0	9.94	1.24	10.65	1.37	12.08	2.10	12.80	2.48	13.18	2.90	13.96	2.97	14.73	3.05
	25.0	9.91	1.37	10.62	1.54	12.05	2.24	12.76	2.62	13.15	2.97	13.92	3.04	14.69	3.12
	27.0	9.89	1.53	10.60	1.70	12.02	2.38	12.73	2.75	13.11	3.04	13.88	3.12	14.65	3.19
	29.0	9.86	1.69	10.57	1.86	11.99	2.52	12.70	2.89	13.08	3.11	13.85	3.19	14.61	3.27
	31.0	9.83	1.82	10.54	2.02	11.96	2.66	12.66	3.02	13.04	3.18	13.81	3.26	14.57	3.34
	32.0	9.82	1.90	10.53	2.10	11.94	2.73	12.65	3.09	13.03	3.22	13.79	3.30	14.55	3.38
	33.0	9.81	1.98	10.51	2.18	11.92	2.80	12.63	3.16	13.01	3.26	13.77	3.33	14.54	3.41
	35.0	9.78	2.14	10.48	2.34	11.89	2.93	12.59	3.29	12.98	3.33	13.74	3.41	14.50	3.49
	37.0	9.78	2.38	10.48	2.61	11.89	3.21	12.59	3.56	12.98	3.60	13.74	3.68	14.50	3.76
	39.0	9.78	2.62	10.48	2.88	11.89	3.48	12.59	3.83	12.98	3.87	13.74	3.95	14.50	4.03
	40.0	9.78	2.75	10.48	3.02	11.89	3.61	12.59	3.97	12.98	4.00	13.74	4.08	14.50	4.16
	42.0	9.78	3.02	10.48	3.29	11.89	3.88	12.59	4.24	12.98	4.19	13.74	4.17	14.50	4.13
	43.0	9.78	3.13	10.48	3.42	11.89	4.02	12.59	4.37	12.98	4.28	13.74	4.22	14.50	4.12
	46.0	7.83	2.53	8.39	2.79	9.51	3.43	10.08	3.42	10.38	3.38	10.99	3.36	11.60	3.33
	52.0	3.42	1.94	3.67	2.14	4.16	2.64	4.41	2.63	4.54	2.59	4.81	2.53	5.07	2.48
80	-5.0	8.87	0.81	9.51	0.92	10.78	1.58	11.42	1.96	11.76	2.38	12.45	2.45	13.14	2.52
	0.0	8.87	0.81	9.51	0.92	10.78	1.58	11.42	1.96	11.76	2.38	12.45	2.45	13.14	2.52
	5.0	8.87	0.81	9.51	0.92	10.78	1.58	11.42	1.96	11.76	2.38	12.45	2.45	13.14	2.52
	10.0	8.87	0.81	9.51	0.92	10.78	1.58	11.42	1.96	11.76	2.38	12.45	2.45	13.14	2.52
	12.0	8.87	0.82	9.51	0.93	10.78	1.58	11.42	1.95	11.76	2.38	12.45	2.44	13.14	2.51
	14.0	8.87	0.83	9.51	0.94	10.78	1.59	11.42	1.95	11.76	2.37	12.45	2.44	13.14	2.51
	16.0	8.87	0.84	9.51	0.95	10.78	1.60	11.42	1.95	11.76	2.37	12.45	2.44	13.14	2.50
	18.0	8.87	0.84	9.51	0.96	10.78	1.60	11.42	1.94	11.76	2.37	12.45	2.44	13.14	2.50
	20.0	8.87	0.85	9.51	0.96	10.78	1.61	11.42	1.94	11.76	2.37	12.45	2.43	13.14	2.50
	21.0	8.86	0.92	9.49	1.03	10.77	1.67	11.40	2.00	11.75	2.40	12.44	2.46	13.13	2.53
	23.0	8.83	1.06	9.47	1.17	10.74	1.79	11.37	2.11	11.72	2.46	12.41	2.52	13.09	2.59
	25.0	8.81	1.16	9.44	1.30	10.71	1.91	11.34	2.22	11.69	2.52	12.37	2.59	13.06	2.65
	27.0	8.79	1.30	9.42	1.44	10.68	2.02	11.31	2.34	11.66	2.58	12.34	2.65	13.02	2.71
	29.0	8.76	1.44	9.39	1.58	10.65	2.14	11.29	2.45	11.63	2.64	12.31	2.71	12.99	2.78
	31.0	8.74	1.55	9.37	1.72	10.63	2.26	11.26	2.57	11.60	2.71	12.27	2.77	12.95	2.84
	32.0	8.73	1.62	9.36	1.78	10.61	2.32	11.24	2.63	11.58	2.74	12.26	2.80	12.94	2.87
	33.0	8.72	1.68	9.34	1.85	10.60	2.38	11.23	2.68	11.56	2.77	12.24	2.83	12.92	2.90
	35.0	8.69	1.82	9.32	1.99	10.57	2.49	11.20	2.80	11.53	2.83	12.21	2.90	12.89	2.96
	37.0	8.69	2.02	9.32	2.22	10.57	2.72	11.20	3.03	11.53	3.06	12.21	3.12	12.89	3.19
	39.0	8.69	2.22	9.32	2.45	10.57	2.95	11.20	3.26	11.53	3.29	12.21	3.35	12.89	3.42
	40.0	8.69	2.34	9.32	2.56	10.57	3.07	11.20	3.37	11.53	3.40	12.21	3.47	12.89	3.54
	42.0	8.69	2.57	9.32	2.79	10.57	3.30	11.20	3.60	11.53	3.56	12.21	3.55	12.89	3.51
	43.0	8.69	2.66	9.32	2.91	10.57	3.41	11.20	3.72	11.53	3.64	12.21	3.58	12.89	3.50
	46.0	6.96	2.15	7.46	2.37	8.46	2.91	8.96	2.91	9.23	2.87	9.77	2.85	10.31	2.83
	52.0	3.04	1.65	3.26	1.82	3.70	2.24	3.92	2.24	4.04	2.20	4.27	2.15	4.51	2.10

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

7. CAPACITY TABLES

S-Series

PUMY-SP125VKM2-PA, DA(-BS)/PUMY-SP125YKM2-PA, DA(-BS)

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC
70	-5.0	7.76	0.68	8.32	0.78	9.43	1.33	9.99	1.65	10.29	2.00	10.90	2.06	11.50	2.12
	0.0	7.76	0.68	8.32	0.78	9.43	1.33	9.99	1.65	10.29	2.00	10.90	2.06	11.50	2.12
	5.0	7.76	0.68	8.32	0.78	9.43	1.33	9.99	1.65	10.29	2.00	10.90	2.06	11.50	2.12
	10.0	7.76	0.68	8.32	0.78	9.43	1.33	9.99	1.65	10.29	2.00	10.90	2.06	11.50	2.12
	12.0	7.76	0.69	8.32	0.78	9.43	1.33	9.99	1.65	10.29	2.00	10.90	2.06	11.50	2.12
	14.0	7.76	0.70	8.32	0.79	9.43	1.34	9.99	1.64	10.29	2.00	10.90	2.06	11.50	2.11
	16.0	7.76	0.70	8.32	0.80	9.43	1.34	9.99	1.64	10.29	2.00	10.90	2.05	11.50	2.11
	18.0	7.76	0.71	8.32	0.80	9.43	1.35	9.99	1.64	10.29	2.00	10.90	2.05	11.50	2.10
	20.0	7.76	0.72	8.32	0.81	9.43	1.36	9.99	1.63	10.29	1.99	10.90	2.05	11.50	2.10
	21.0	7.75	0.77	8.31	0.87	9.42	1.41	9.98	1.68	10.28	2.02	10.88	2.07	11.49	2.13
	23.0	7.73	0.89	8.29	0.98	9.40	1.50	9.95	1.78	10.25	2.07	10.85	2.13	11.46	2.18
	25.0	7.71	0.98	8.26	1.10	9.37	1.60	9.93	1.87	10.23	2.12	10.83	2.18	11.43	2.23
	27.0	7.69	1.10	8.24	1.21	9.35	1.70	9.90	1.97	10.20	2.17	10.80	2.23	11.40	2.28
	29.0	7.67	1.21	8.22	1.33	9.32	1.80	9.87	2.07	10.17	2.23	10.77	2.28	11.37	2.34
	31.0	7.65	1.30	8.20	1.44	9.30	1.90	9.85	2.16	10.15	2.28	10.74	2.33	11.34	2.39
	32.0	7.64	1.36	8.19	1.50	9.29	1.95	9.84	2.21	10.13	2.30	10.73	2.36	11.32	2.42
	33.0	7.63	1.42	8.18	1.56	9.27	2.00	9.82	2.26	10.12	2.33	10.71	2.39	11.31	2.44
	35.0	7.61	1.53	8.15	1.67	9.25	2.10	9.80	2.35	10.09	2.38	10.68	2.44	11.28	2.49
	37.0	7.61	1.70	8.15	1.87	9.25	2.29	9.80	2.55	10.09	2.57	10.68	2.63	11.28	2.69
	39.0	7.61	1.87	8.15	2.06	9.25	2.49	9.80	2.74	10.09	2.77	10.68	2.82	11.28	2.88
	40.0	7.61	1.97	8.15	2.16	9.25	2.58	9.80	2.84	10.09	2.86	10.68	2.92	11.28	2.98
	42.0	7.61	2.16	8.15	2.35	9.25	2.78	9.80	3.03	10.09	3.00	10.68	2.98	11.28	2.96
	43.0	7.61	2.24	8.15	2.45	9.25	2.87	9.80	3.13	10.09	3.06	10.68	3.02	11.28	2.95
	46.0	6.09	1.81	6.52	2.00	7.40	2.45	7.84	2.45	8.07	2.41	8.55	2.40	9.02	2.38
	52.0	2.66	1.39	2.85	1.53	3.24	1.89	3.43	1.88	3.53	1.85	3.74	1.81	3.95	1.77
60	-5.0	6.65	0.57	7.13	0.65	8.09	1.11	8.56	1.37	8.82	1.67	9.34	1.72	9.86	1.77
	0.0	6.65	0.57	7.13	0.65	8.09	1.11	8.56	1.37	8.82	1.67	9.34	1.72	9.86	1.77
	5.0	6.65	0.57	7.13	0.65	8.09	1.11	8.56	1.37	8.82	1.67	9.34	1.72	9.86	1.77
	10.0	6.65	0.57	7.13	0.65	8.09	1.11	8.56	1.37	8.82	1.67	9.34	1.72	9.86	1.77
	12.0	6.65	0.58	7.13	0.65	8.09	1.11	8.56	1.37	8.82	1.67	9.34	1.72	9.86	1.76
	14.0	6.65	0.58	7.13	0.66	8.09	1.12	8.56	1.37	8.82	1.67	9.34	1.71	9.86	1.76
	16.0	6.65	0.59	7.13	0.66	8.09	1.12	8.56	1.37	8.82	1.67	9.34	1.71	9.86	1.76
	18.0	6.65	0.59	7.13	0.67	8.09	1.13	8.56	1.36	8.82	1.66	9.34	1.71	9.86	1.75
	20.0	6.65	0.60	7.13	0.68	8.09	1.13	8.56	1.36	8.82	1.66	9.34	1.71	9.86	1.75
	21.0	6.64	0.65	7.12	0.72	8.08	1.17	8.55	1.40	8.81	1.68	9.33	1.73	9.84	1.77
	23.0	6.63	0.74	7.10	0.82	8.05	1.25	8.53	1.48	8.79	1.73	9.30	1.77	9.82	1.82
	25.0	6.61	0.82	7.08	0.92	8.03	1.34	8.51	1.56	8.77	1.77	9.28	1.82	9.79	1.86
	27.0	6.59	0.91	7.06	1.01	8.01	1.42	8.49	1.64	8.74	1.81	9.26	1.86	9.77	1.90
	29.0	6.57	1.01	7.05	1.11	7.99	1.50	8.46	1.72	8.72	1.86	9.23	1.90	9.74	1.95
	31.0	6.56	1.09	7.03	1.20	7.97	1.59	8.44	1.80	8.70	1.90	9.21	1.95	9.72	1.99
	32.0	6.55	1.13	7.02	1.25	7.96	1.63	8.43	1.84	8.68	1.92	9.19	1.97	9.70	2.01
	33.0	6.54	1.18	7.01	1.30	7.95	1.67	8.42	1.88	8.67	1.94	9.18	1.99	9.69	2.04
	35.0	6.52	1.28	6.99	1.40	7.93	1.75	8.40	1.96	8.65	1.99	9.16	2.03	9.66	2.08
	37.0	6.52	1.42	6.99	1.56	7.93	1.91	8.40	2.13	8.65	2.15	9.16	2.19	9.66	2.24
	39.0	6.52	1.56	6.99	1.72	7.93	2.07	8.40	2.29	8.65	2.31	9.16	2.36	9.66	2.40
	40.0	6.52	1.64	6.99	1.80	7.93	2.15	8.40	2.37	8.65	2.39	9.16	2.44	9.66	2.48
	42.0	6.52	1.80	6.99	1.96	7.93	2.32	8.40	2.53	8.65	2.50	9.16	2.49	9.66	2.47
	43.0	6.52	1.87	6.99	2.04	7.93	2.40	8.40	2.61	8.65	2.55	9.16	2.52	9.66	2.46
	46.0	5.22	1.51	5.59	1.67	6.34	2.04	6.72	2.04	6.92	2.01	7.33	2.00	7.73	1.99
	52.0	2.28	1.16	2.45	1.27	2.77	1.57	2.94	1.57	3.03	1.54	3.21	1.51	3.38	1.48

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-SP125VKM2-PA, DA(-BS)/PUMY-SP125YKM2-PA, DA(-BS)

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC
50	-5.0	5.54	0.47	5.94	0.54	6.74	0.91	7.14	1.14	7.35	1.38	7.78	1.42	8.21	1.46
	0.0	5.54	0.47	5.94	0.54	6.74	0.91	7.14	1.14	7.35	1.38	7.78	1.42	8.21	1.46
	5.0	5.54	0.47	5.94	0.54	6.74	0.91	7.14	1.14	7.35	1.38	7.78	1.42	8.21	1.46
	10.0	5.54	0.47	5.94	0.54	6.74	0.91	7.14	1.14	7.35	1.38	7.78	1.42	8.21	1.46
	12.0	5.54	0.48	5.94	0.54	6.74	0.92	7.14	1.13	7.35	1.38	7.78	1.42	8.21	1.46
	14.0	5.54	0.48	5.94	0.55	6.74	0.92	7.14	1.13	7.35	1.38	7.78	1.42	8.21	1.46
	16.0	5.54	0.48	5.94	0.55	6.74	0.93	7.14	1.13	7.35	1.38	7.78	1.42	8.21	1.45
	18.0	5.54	0.49	5.94	0.55	6.74	0.93	7.14	1.13	7.35	1.38	7.78	1.41	8.21	1.45
	20.0	5.54	0.49	5.94	0.56	6.74	0.93	7.14	1.13	7.35	1.38	7.78	1.41	8.21	1.45
	21.0	5.54	0.53	5.93	0.60	6.73	0.97	7.13	1.16	7.34	1.39	7.77	1.43	8.20	1.47
	23.0	5.52	0.61	5.92	0.68	6.71	1.04	7.11	1.22	7.32	1.43	7.75	1.47	8.18	1.50
	25.0	5.51	0.68	5.90	0.76	6.69	1.11	7.09	1.29	7.30	1.46	7.73	1.50	8.16	1.54
	27.0	5.49	0.76	5.89	0.84	6.68	1.17	7.07	1.36	7.29	1.50	7.71	1.54	8.14	1.57
	29.0	5.48	0.83	5.87	0.92	6.66	1.24	7.05	1.42	7.27	1.53	7.69	1.57	8.12	1.61
	31.0	5.46	0.90	5.86	1.00	6.64	1.31	7.03	1.49	7.25	1.57	7.67	1.61	8.10	1.65
	32.0	5.46	0.94	5.85	1.04	6.63	1.34	7.03	1.52	7.24	1.59	7.66	1.63	8.09	1.66
	33.0	5.45	0.98	5.84	1.07	6.62	1.38	7.02	1.56	7.23	1.61	7.65	1.64	8.08	1.68
	35.0	5.43	1.06	5.82	1.15	6.61	1.45	7.00	1.62	7.21	1.64	7.63	1.68	8.05	1.72
	37.0	5.43	1.17	5.82	1.29	6.61	1.58	7.00	1.76	7.21	1.77	7.63	1.81	8.05	1.85
	39.0	5.43	1.29	5.82	1.42	6.61	1.71	7.00	1.89	7.21	1.91	7.63	1.95	8.05	1.99
	40.0	5.43	1.36	5.82	1.49	6.61	1.78	7.00	1.96	7.21	1.97	7.63	2.01	8.05	2.05
	42.0	5.43	1.49	5.82	1.62	6.61	1.91	7.00	2.09	7.21	2.07	7.63	2.06	8.05	2.04
	43.0	5.43	1.54	5.82	1.69	6.61	1.98	7.00	2.16	7.21	2.11	7.63	2.08	8.05	2.03
	46.0	4.35	1.25	4.66	1.38	5.29	1.69	5.60	1.69	5.77	1.66	6.10	1.66	6.44	1.64
	52.0	1.90	0.96	2.04	1.05	2.31	1.30	2.45	1.30	2.52	1.28	2.67	1.25	2.82	1.22

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

7. CAPACITY TABLES

S-Series

PUMY-SP140VKM2-PA, DA(-BS)/PUMY-SP140YKM2-PA, DA(-BS)

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
	°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
130	-5.0	12.82	1.28	13.74	1.46	15.58	2.49	16.51	3.09	17.00	3.75	18.00	3.86	19.00	3.97
	0.0	12.82	1.28	13.74	1.46	15.58	2.49	16.51	3.09	17.00	3.75	18.00	3.86	19.00	3.97
	5.0	12.82	1.28	13.74	1.46	15.58	2.49	16.51	3.09	17.00	3.97	18.00	3.86	19.00	3.97
	10.0	12.82	1.28	13.74	1.46	15.58	2.49	16.51	3.09	17.00	3.75	18.00	3.86	19.00	3.97
	12.0	12.82	1.29	13.74	1.47	15.58	2.50	16.51	3.08	17.00	3.75	18.00	3.86	19.00	3.96
	14.0	12.82	1.31	13.74	1.48	15.58	2.51	16.51	3.08	17.00	3.74	18.00	3.85	19.00	3.96
	16.0	12.82	1.32	13.74	1.49	15.58	2.52	16.51	3.07	17.00	3.74	18.00	3.85	19.00	3.95
	18.0	12.82	1.33	13.74	1.51	15.58	2.53	16.51	3.06	17.00	3.74	18.00	3.84	19.00	3.94
	20.0	12.82	1.34	13.74	1.52	15.58	2.54	16.51	3.06	17.00	3.74	18.00	3.84	19.00	3.94
	21.0	12.80	1.45	13.72	1.63	15.56	2.63	16.48	3.15	16.98	3.78	17.98	3.88	18.97	3.98
	23.0	12.77	1.67	13.69	1.84	15.52	2.82	16.44	3.33	16.94	3.88	17.93	3.98	18.92	4.08
	25.0	12.74	1.84	13.65	2.06	15.48	3.01	16.40	3.51	16.89	3.98	17.88	4.08	18.87	4.18
	27.0	12.70	2.05	13.61	2.27	15.44	3.19	16.35	3.69	16.85	4.07	17.84	4.18	18.82	4.28
	29.0	12.67	2.27	13.58	2.49	15.40	3.38	16.31	3.87	16.80	4.17	17.79	4.27	18.77	4.38
	31.0	12.63	2.44	13.54	2.71	15.36	3.56	16.27	4.05	16.76	4.27	17.74	4.37	18.72	4.48
	32.0	12.62	2.55	13.53	2.81	15.34	3.65	16.25	4.14	16.74	4.32	17.72	4.42	18.70	4.52
	33.0	12.60	2.66	13.51	2.92	15.32	3.75	16.23	4.23	16.72	4.36	17.70	4.47	18.68	4.57
	35.0	12.57	2.87	13.47	3.14	15.28	3.93	16.18	4.41	16.67	4.46	17.65	4.57	18.63	4.67
	37.0	12.57	3.02	13.47	3.33	15.28	4.13	16.18	4.61	16.67	4.66	17.65	4.76	18.63	4.87
	39.0	12.57	3.18	13.47	3.53	15.28	4.33	16.18	4.80	16.67	4.85	17.65	4.96	18.63	5.06
	40.0	12.57	3.27	13.47	3.63	15.28	4.42	16.18	4.90	16.67	4.95	17.65	5.06	18.63	5.16
	42.0	12.57	3.47	13.47	3.82	15.28	4.62	16.18	5.10	16.67	5.03	17.65	5.01	18.63	4.96
	43.0	12.57	3.52	13.47	3.92	15.28	4.72	16.18	5.20	16.67	5.07	17.65	4.99	18.63	4.85
	46.0	10.05	3.39	10.78	3.75	12.22	4.41	12.95	4.41	13.34	4.35	14.12	4.28	14.90	4.20
	52.0	4.40	2.60	4.71	2.86	5.35	3.53	5.66	3.53	5.83	3.47	6.18	3.39	6.52	3.32
120	-5.0	12.64	1.27	13.55	1.45	15.37	2.47	16.28	3.06	16.77	3.72	17.75	3.83	18.73	3.94
	0.0	12.64	1.27	13.55	1.45	15.37	2.47	16.28	3.06	16.77	3.72	17.75	3.83	18.73	3.94
	5.0	12.64	1.27	13.55	1.45	15.37	2.47	16.28	3.06	16.77	3.94	17.75	3.83	18.73	3.94
	10.0	12.64	1.27	13.55	1.45	15.37	2.47	16.28	3.06	16.77	3.72	17.75	3.83	18.73	3.94
	12.0	12.64	1.28	13.55	1.46	15.37	2.48	16.28	3.06	16.77	3.72	17.75	3.83	18.73	3.93
	14.0	12.64	1.30	13.55	1.47	15.37	2.49	16.28	3.05	16.77	3.72	17.75	3.82	18.73	3.93
	16.0	12.64	1.31	13.55	1.48	15.37	2.50	16.28	3.05	16.77	3.71	17.75	3.82	18.73	3.92
	18.0	12.64	1.32	13.55	1.49	15.37	2.51	16.28	3.04	16.77	3.71	17.75	3.81	18.73	3.91
	20.0	12.64	1.33	13.55	1.51	15.37	2.52	16.28	3.03	16.77	3.71	17.75	3.81	18.73	3.90
	21.0	12.62	1.44	13.53	1.61	15.35	2.61	16.25	3.12	16.75	3.76	17.73	3.85	18.71	3.95
	23.0	12.59	1.65	13.50	1.83	15.31	2.80	16.21	3.30	16.70	3.85	17.68	3.95	18.66	4.05
	25.0	12.56	1.82	13.46	2.04	15.27	2.98	16.17	3.48	16.66	3.95	17.63	4.05	18.61	4.15
	27.0	12.52	2.04	13.42	2.26	15.23	3.17	16.13	3.66	16.61	4.04	17.59	4.14	18.56	4.25
	29.0	12.49	2.25	13.39	2.47	15.19	3.35	16.08	3.84	16.57	4.14	17.54	4.24	18.51	4.34
	31.0	12.46	2.42	13.35	2.68	15.15	3.53	16.04	4.02	16.53	4.23	17.49	4.34	18.46	4.44
	32.0	12.44	2.53	13.34	2.79	15.13	3.63	16.02	4.11	16.50	4.28	17.47	4.39	18.44	4.49
	33.0	12.43	2.64	13.32	2.90	15.11	3.72	16.00	4.20	16.48	4.33	17.45	4.43	18.41	4.54
	35.0	12.39	2.85	13.28	3.11	15.07	3.90	15.96	4.38	16.44	4.43	17.40	4.53	18.37	4.64
	37.0	12.39	3.00	13.28	3.31	15.07	4.10	15.96	4.57	16.44	4.62	17.40	4.73	18.37	4.83
	39.0	12.39	3.15	13.28	3.50	15.07	4.29	15.96	4.77	16.44	4.81	17.40	4.92	18.37	5.02
	40.0	12.39	3.25	13.28	3.60	15.07	4.39	15.96	4.86	16.44	4.91	17.40	5.02	18.37	5.12
	42.0	12.39	3.44	13.28	3.79	15.07	4.58	15.96	5.06	16.44	4.99	17.40	4.97	18.37	4.92
	43.0	12.39	3.50	13.28	3.89	15.07	4.68	15.96	5.16	16.44	5.03	17.40	4.95	18.37	4.82
	46.0	9.91	3.37	10.63	3.72	12.05	4.38	12.77	4.38	13.15	4.31	13.92	4.24	14.69	4.17
	52.0	4.34	2.58	4.65	2.84	5.27	3.50	5.58	3.50	5.75	3.44	6.09	3.37	6.43	3.29

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-SP140VKM2-PA, DA(-BS)/PUMY-SP140YKM2-PA, DA(-BS)

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC
110	-5.0	12.46	1.26	13.36	1.43	15.15	2.45	16.05	3.04	16.53	3.69	17.50	3.80	18.47	3.91
	0.0	12.46	1.26	13.36	1.43	15.15	2.45	16.05	3.04	16.53	3.69	17.50	3.80	18.47	3.91
	5.0	12.46	1.26	13.36	1.43	15.15	2.45	16.05	3.04	16.53	3.91	17.50	3.80	18.47	3.91
	10.0	12.46	1.26	13.36	1.43	15.15	2.45	16.05	3.04	16.53	3.69	17.50	3.80	18.47	3.91
	12.0	12.46	1.27	13.36	1.45	15.15	2.46	16.05	3.03	16.53	3.69	17.50	3.80	18.47	3.90
	14.0	12.46	1.29	13.36	1.46	15.15	2.47	16.05	3.03	16.53	3.69	17.50	3.79	18.47	3.90
	16.0	12.46	1.30	13.36	1.47	15.15	2.48	16.05	3.02	16.53	3.68	17.50	3.79	18.47	3.89
	18.0	12.46	1.31	13.36	1.48	15.15	2.49	16.05	3.02	16.53	3.68	17.50	3.78	18.47	3.88
	20.0	12.46	1.32	13.36	1.49	15.15	2.50	16.05	3.01	16.53	3.68	17.50	3.78	18.47	3.87
	21.0	12.44	1.43	13.34	1.60	15.13	2.59	16.02	3.10	16.51	3.73	17.48	3.82	18.44	3.92
	23.0	12.41	1.64	13.30	1.81	15.09	2.78	15.98	3.28	16.46	3.82	17.43	3.92	18.40	4.02
	25.0	12.38	1.81	13.27	2.03	15.05	2.96	15.94	3.45	16.42	3.92	17.38	4.02	18.35	4.12
	27.0	12.35	2.02	13.23	2.24	15.01	3.14	15.90	3.63	16.38	4.01	17.34	4.11	18.30	4.21
	29.0	12.31	2.23	13.20	2.45	14.97	3.32	15.86	3.81	16.34	4.11	17.29	4.21	18.25	4.31
	31.0	12.28	2.40	13.17	2.66	14.93	3.51	15.81	3.99	16.29	4.20	17.25	4.30	18.20	4.41
	32.0	12.27	2.51	13.15	2.77	14.91	3.60	15.79	4.08	16.27	4.25	17.22	4.35	18.18	4.45
	33.0	12.25	2.62	13.13	2.88	14.89	3.69	15.77	4.17	16.25	4.30	17.20	4.40	18.15	4.50
	35.0	12.22	2.83	13.10	3.09	14.85	3.87	15.73	4.34	16.21	4.39	17.16	4.50	18.11	4.60
	37.0	12.22	2.98	13.10	3.28	14.85	4.07	15.73	4.54	16.21	4.58	17.16	4.69	18.11	4.79
	39.0	12.22	3.13	13.10	3.47	14.85	4.26	15.73	4.73	16.21	4.78	17.16	4.88	18.11	4.99
	40.0	12.22	3.22	13.10	3.57	14.85	4.35	15.73	4.83	16.21	4.87	17.16	4.98	18.11	5.08
	42.0	12.22	3.42	13.10	3.76	14.85	4.55	15.73	5.02	16.21	4.95	17.16	4.93	18.11	4.88
	43.0	12.22	3.47	13.10	3.86	14.85	4.64	15.73	5.12	16.21	4.99	17.16	4.91	18.11	4.78
	46.0	9.77	3.34	10.48	3.69	11.88	4.35	12.58	4.34	12.96	4.28	13.72	4.21	14.48	4.13
	52.0	4.28	2.56	4.58	2.82	5.20	3.48	5.51	3.47	5.67	3.41	6.00	3.34	6.34	3.27
100	-5.0	12.28	1.25	13.16	1.42	14.93	2.43	15.81	3.02	16.29	3.66	17.24	3.77	18.20	3.88
	0.0	12.28	1.25	13.16	1.42	14.93	2.43	15.81	3.02	16.29	3.66	17.24	3.77	18.20	3.88
	5.0	12.28	1.25	13.16	1.42	14.93	2.43	15.81	3.02	16.29	3.88	17.24	3.77	18.20	3.88
	10.0	12.28	1.25	13.16	1.42	14.93	2.43	15.81	3.02	16.29	3.66	17.24	3.77	18.20	3.88
	12.0	12.28	1.26	13.16	1.44	14.93	2.44	15.81	3.01	16.29	3.66	17.24	3.77	18.20	3.87
	14.0	12.28	1.28	13.16	1.45	14.93	2.45	15.81	3.00	16.29	3.66	17.24	3.76	18.20	3.87
	16.0	12.28	1.29	13.16	1.46	14.93	2.46	15.81	3.00	16.29	3.66	17.24	3.76	18.20	3.86
	18.0	12.28	1.30	13.16	1.47	14.93	2.47	15.81	2.99	16.29	3.65	17.24	3.75	18.20	3.85
	20.0	12.28	1.31	13.16	1.48	14.93	2.48	15.81	2.99	16.29	3.65	17.24	3.75	18.20	3.84
	21.0	12.26	1.42	13.14	1.59	14.91	2.57	15.79	3.08	16.27	3.70	17.22	3.80	18.17	3.89
	23.0	12.23	1.63	13.11	1.80	14.87	2.75	15.75	3.25	16.22	3.79	17.17	3.89	18.13	3.99
	25.0	12.20	1.80	13.08	2.01	14.83	2.94	15.71	3.43	16.18	3.89	17.13	3.99	18.08	4.08
	27.0	12.17	2.01	13.04	2.22	14.79	3.12	15.67	3.60	16.14	3.98	17.08	4.08	18.03	4.18
	29.0	12.13	2.22	13.01	2.43	14.75	3.30	15.62	3.78	16.10	4.07	17.04	4.18	17.98	4.28
	31.0	12.10	2.38	12.97	2.64	14.71	3.48	15.58	3.96	16.05	4.17	16.99	4.27	17.94	4.37
	32.0	12.09	2.49	12.95	2.75	14.69	3.57	15.56	4.05	16.03	4.22	16.97	4.32	17.91	4.42
	33.0	12.07	2.60	12.94	2.85	14.67	3.66	15.54	4.13	16.01	4.26	16.95	4.37	17.89	4.47
	35.0	12.04	2.81	12.90	3.06	14.63	3.84	15.50	4.31	15.97	4.36	16.90	4.46	17.84	4.56
	37.0	12.04	2.95	12.90	3.26	14.63	4.03	15.50	4.50	15.97	4.55	16.90	4.65	17.84	4.76
	39.0	12.04	3.10	12.90	3.45	14.63	4.23	15.50	4.69	15.97	4.74	16.90	4.84	17.84	4.95
	40.0	12.04	3.20	12.90	3.54	14.63	4.32	15.50	4.79	15.97	4.84	16.90	4.94	17.84	5.04
	42.0	12.04	3.39	12.90	3.73	14.63	4.51	15.50	4.98	15.97	4.92	16.90	4.89	17.84	4.84
	43.0	12.04	3.44	12.90	3.83	14.63	4.61	15.50	5.08	15.97	4.96	16.90	4.87	17.84	4.74
	46.0	9.63	3.31	10.32	3.66	11.71	4.31	12.40	4.31	12.77	4.25	13.52	4.18	14.27	4.10
	52.0	4.21	2.54	4.52	2.80	5.12	3.45	5.43	3.45	5.59	3.39	5.92	3.32	6.24	3.24

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

7. CAPACITY TABLES

S-Series

PUMY-SP140VKM2-PA, DA(-BS)/PUMY-SP140YKM2-PA, DA(-BS)

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
	°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
90	-5.0	11.05	1.03	11.84	1.17	13.43	2.00	14.23	2.49	14.66	3.02	15.51	3.11	16.37	3.20
	0.0	11.05	1.03	11.84	1.17	13.43	2.00	14.23	2.49	14.66	3.02	15.51	3.11	16.37	3.20
	5.0	11.05	1.03	11.84	1.17	13.43	2.00	14.23	2.49	14.66	3.20	15.51	3.11	16.37	3.20
	10.0	11.05	1.03	11.84	1.17	13.43	2.00	14.23	2.49	14.66	3.02	15.51	3.11	16.37	3.20
	12.0	11.05	1.04	11.84	1.18	13.43	2.01	14.23	2.48	14.66	3.02	15.51	3.11	16.37	3.19
	14.0	11.05	1.05	11.84	1.19	13.43	2.02	14.23	2.48	14.66	3.02	15.51	3.10	16.37	3.19
	16.0	11.05	1.06	11.84	1.20	13.43	2.03	14.23	2.47	14.66	3.01	15.51	3.10	16.37	3.18
	18.0	11.05	1.07	11.84	1.21	13.43	2.04	14.23	2.47	14.66	3.01	15.51	3.09	16.37	3.18
	20.0	11.05	1.08	11.84	1.22	13.43	2.05	14.23	2.46	14.66	3.01	15.51	3.09	16.37	3.17
	21.0	11.03	1.17	11.83	1.31	13.41	2.12	14.21	2.54	14.64	3.05	15.49	3.13	16.35	3.21
	23.0	11.00	1.34	11.80	1.48	13.38	2.27	14.17	2.68	14.60	3.13	15.45	3.21	16.31	3.29
	25.0	10.98	1.48	11.76	1.66	13.34	2.42	14.13	2.83	14.56	3.20	15.41	3.29	16.27	3.37
	27.0	10.95	1.65	11.73	1.83	13.31	2.57	14.10	2.97	14.52	3.28	15.37	3.36	16.22	3.45
	29.0	10.92	1.83	11.70	2.01	13.27	2.72	14.06	3.12	14.48	3.36	15.33	3.44	16.18	3.53
	31.0	10.89	1.97	11.67	2.18	13.24	2.87	14.02	3.26	14.44	3.44	15.29	3.52	16.14	3.60
	32.0	10.87	2.05	11.66	2.27	13.22	2.94	14.00	3.34	14.43	3.48	15.27	3.56	16.12	3.64
	33.0	10.86	2.14	11.64	2.35	13.20	3.02	13.98	3.41	14.41	3.51	15.25	3.60	16.10	3.68
	35.0	10.83	2.31	11.61	2.53	13.17	3.17	13.95	3.55	14.37	3.59	15.21	3.68	16.05	3.76
	37.0	10.83	2.44	11.61	2.68	13.17	3.33	13.95	3.71	14.37	3.75	15.21	3.84	16.05	3.92
	39.0	10.83	2.56	11.61	2.84	13.17	3.48	13.95	3.87	14.37	3.91	15.21	3.99	16.05	4.08
	40.0	10.83	2.64	11.61	2.92	13.17	3.56	13.95	3.95	14.37	3.99	15.21	4.07	16.05	4.16
	42.0	10.83	2.79	11.61	3.08	13.17	3.72	13.95	4.11	14.37	4.05	15.21	4.03	16.05	3.99
	43.0	10.83	2.84	11.61	3.16	13.17	3.80	13.95	4.18	14.37	4.09	15.21	4.02	16.05	3.91
	46.0	8.67	2.73	9.29	3.02	10.53	3.56	11.16	3.55	11.49	3.50	12.17	3.44	12.84	3.38
	52.0	3.79	2.09	4.06	2.31	4.61	2.84	4.88	2.84	5.03	2.79	5.32	2.73	5.62	2.67
80	-5.0	9.82	0.86	10.53	0.98	11.94	1.67	12.64	2.07	13.03	2.52	13.79	2.59	14.55	2.66
	0.0	9.82	0.86	10.53	0.98	11.94	1.67	12.64	2.07	13.03	2.52	13.79	2.59	14.55	2.66
	5.0	9.82	0.86	10.53	0.98	11.94	1.67	12.64	2.07	13.03	2.66	13.79	2.59	14.55	2.66
	10.0	9.82	0.86	10.53	0.98	11.94	1.67	12.64	2.07	13.03	2.52	13.79	2.59	14.55	2.66
	12.0	9.82	0.87	10.53	0.99	11.94	1.68	12.64	2.07	13.03	2.51	13.79	2.59	14.55	2.66
	14.0	9.82	0.88	10.53	0.99	11.94	1.68	12.64	2.06	13.03	2.51	13.79	2.58	14.55	2.65
	16.0	9.82	0.88	10.53	1.00	11.94	1.69	12.64	2.06	13.03	2.51	13.79	2.58	14.55	2.65
	18.0	9.82	0.89	10.53	1.01	11.94	1.70	12.64	2.06	13.03	2.51	13.79	2.58	14.55	2.64
	20.0	9.82	0.90	10.53	1.02	11.94	1.70	12.64	2.05	13.03	2.51	13.79	2.57	14.55	2.64
	21.0	9.81	0.97	10.51	1.09	11.92	1.77	12.63	2.11	13.01	2.54	13.77	2.61	14.54	2.67
	23.0	9.78	1.12	10.49	1.24	11.89	1.89	12.60	2.23	12.98	2.60	13.74	2.67	14.50	2.74
	25.0	9.76	1.23	10.46	1.38	11.86	2.02	12.56	2.35	12.94	2.67	13.70	2.74	14.46	2.80
	27.0	9.73	1.38	10.43	1.53	11.83	2.14	12.53	2.47	12.91	2.73	13.66	2.80	14.42	2.87
	29.0	9.70	1.52	10.40	1.67	11.80	2.26	12.50	2.60	12.87	2.80	13.63	2.87	14.38	2.94
	31.0	9.68	1.64	10.38	1.81	11.77	2.39	12.46	2.72	12.84	2.86	13.59	2.93	14.34	3.00
	32.0	9.67	1.71	10.36	1.89	11.75	2.45	12.45	2.78	12.82	2.89	13.57	2.97	14.33	3.04
	33.0	9.65	1.78	10.35	1.96	11.74	2.51	12.43	2.84	12.81	2.93	13.56	3.00	14.31	3.07
	35.0	9.63	1.93	10.32	2.10	11.70	2.64	12.40	2.96	12.77	2.99	13.52	3.06	14.27	3.13
	37.0	9.63	2.03	10.32	2.24	11.70	2.77	12.40	3.09	12.77	3.12	13.52	3.19	14.27	3.27
	39.0	9.63	2.13	10.32	2.37	11.70	2.90	12.40	3.22	12.77	3.25	13.52	3.33	14.27	3.40
	40.0	9.63	2.20	10.32	2.43	11.70	2.97	12.40	3.29	12.77	3.32	13.52	3.39	14.27	3.46
	42.0	9.63	2.33	10.32	2.56	11.70	3.10	12.40	3.42	12.77	3.38	13.52	3.36	14.27	3.32
	43.0	9.63	2.36	10.32	2.63	11.70	3.16	12.40	3.49	12.77	3.40	13.52	3.34	14.27	3.26
	46.0	7.70	2.28	8.26	2.51	9.36	2.96	9.92	2.96	10.22	2.92	10.82	2.87	11.42	2.82
	52.0	3.37	1.74	3.61	1.92	4.10	2.37	4.34	2.37	4.47	2.32	4.73	2.28	4.99	2.23

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-SP140VKM2-PA, DA(-BS)/PUMY-SP140YKM2-PA, DA(-BS)

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC
70	-5.0	8.59	0.71	9.21	0.81	10.45	1.38	11.06	1.71	11.40	2.08	12.07	2.14	12.73	2.20
	0.0	8.59	0.71	9.21	0.81	10.45	1.38	11.06	1.71	11.40	2.08	12.07	2.14	12.73	2.20
	5.0	8.59	0.71	9.21	0.81	10.45	1.38	11.06	1.71	11.40	2.20	12.07	2.14	12.73	2.20
	10.0	8.59	0.71	9.21	0.81	10.45	1.38	11.06	1.71	11.40	2.08	12.07	2.14	12.73	2.20
	12.0	8.59	0.72	9.21	0.82	10.45	1.39	11.06	1.71	11.40	2.08	12.07	2.14	12.73	2.20
	14.0	8.59	0.72	9.21	0.82	10.45	1.39	11.06	1.71	11.40	2.08	12.07	2.14	12.73	2.20
	16.0	8.59	0.73	9.21	0.83	10.45	1.40	11.06	1.70	11.40	2.08	12.07	2.13	12.73	2.19
	18.0	8.59	0.74	9.21	0.84	10.45	1.40	11.06	1.70	11.40	2.07	12.07	2.13	12.73	2.19
	20.0	8.59	0.74	9.21	0.84	10.45	1.41	11.06	1.70	11.40	2.07	12.07	2.13	12.73	2.18
	21.0	8.58	0.80	9.20	0.90	10.43	1.46	11.05	1.75	11.38	2.10	12.05	2.16	12.72	2.21
	23.0	8.56	0.92	9.17	1.02	10.41	1.56	11.02	1.85	11.35	2.15	12.02	2.21	12.68	2.27
	25.0	8.54	1.02	9.15	1.14	10.38	1.67	10.99	1.95	11.32	2.21	11.99	2.26	12.65	2.32
	27.0	8.51	1.14	9.13	1.26	10.35	1.77	10.96	2.05	11.29	2.26	11.96	2.32	12.62	2.37
	29.0	8.49	1.26	9.10	1.38	10.32	1.87	10.93	2.15	11.26	2.31	11.92	2.37	12.59	2.43
	31.0	8.47	1.35	9.08	1.50	10.30	1.98	10.91	2.25	11.23	2.37	11.89	2.43	12.55	2.48
	32.0	8.46	1.41	9.07	1.56	10.28	2.03	10.89	2.30	11.22	2.39	11.88	2.45	12.54	2.51
	33.0	8.45	1.47	9.05	1.62	10.27	2.08	10.88	2.35	11.20	2.42	11.86	2.48	12.52	2.54
	35.0	8.42	1.59	9.03	1.74	10.24	2.18	10.85	2.45	11.17	2.47	11.83	2.53	12.49	2.59
	37.0	8.42	1.68	9.03	1.85	10.24	2.29	10.85	2.56	11.17	2.58	11.83	2.64	12.49	2.70
	39.0	8.42	1.76	9.03	1.96	10.24	2.40	10.85	2.67	11.17	2.69	11.83	2.75	12.49	2.81
	40.0	8.42	1.82	9.03	2.01	10.24	2.45	10.85	2.72	11.17	2.75	11.83	2.81	12.49	2.86
	42.0	8.42	1.93	9.03	2.12	10.24	2.56	10.85	2.83	11.17	2.79	11.83	2.78	12.49	2.75
	43.0	8.42	1.96	9.03	2.18	10.24	2.62	10.85	2.88	11.17	2.82	11.83	2.77	12.49	2.69
	46.0	6.74	1.88	7.22	2.08	8.19	2.45	8.68	2.45	8.94	2.41	9.46	2.37	9.99	2.33
	52.0	2.95	1.44	3.16	1.59	3.58	1.96	3.80	1.96	3.91	1.92	4.14	1.88	4.37	1.84
60	-5.0	7.37	0.58	7.89	0.65	8.95	1.12	9.48	1.39	9.77	1.69	10.34	1.74	10.92	1.78
	0.0	7.37	0.58	7.89	0.65	8.95	1.12	9.48	1.39	9.77	1.69	10.34	1.74	10.92	1.78
	5.0	7.37	0.58	7.89	0.65	8.95	1.12	9.48	1.39	9.77	1.78	10.34	1.74	10.92	1.78
	10.0	7.37	0.58	7.89	0.65	8.95	1.12	9.48	1.39	9.77	1.69	10.34	1.74	10.92	1.78
	12.0	7.37	0.58	7.89	0.66	8.95	1.12	9.48	1.39	9.77	1.68	10.34	1.73	10.92	1.78
	14.0	7.37	0.59	7.89	0.67	8.95	1.13	9.48	1.38	9.77	1.68	10.34	1.73	10.92	1.78
	16.0	7.37	0.59	7.89	0.67	8.95	1.13	9.48	1.38	9.77	1.68	10.34	1.73	10.92	1.78
	18.0	7.37	0.60	7.89	0.68	8.95	1.14	9.48	1.38	9.77	1.68	10.34	1.73	10.92	1.77
	20.0	7.37	0.60	7.89	0.68	8.95	1.14	9.48	1.37	9.77	1.68	10.34	1.72	10.92	1.77
	21.0	7.36	0.65	7.88	0.73	8.94	1.18	9.47	1.41	9.76	1.70	10.33	1.75	10.90	1.79
	23.0	7.34	0.75	7.86	0.83	8.92	1.27	9.45	1.50	9.73	1.74	10.30	1.79	10.87	1.83
	25.0	7.32	0.83	7.84	0.92	8.90	1.35	9.42	1.58	9.71	1.79	10.28	1.83	10.84	1.88
	27.0	7.30	0.92	7.82	1.02	8.87	1.43	9.40	1.66	9.68	1.83	10.25	1.88	10.82	1.92
	29.0	7.28	1.02	7.80	1.12	8.85	1.52	9.37	1.74	9.66	1.87	10.22	1.92	10.79	1.97
	31.0	7.26	1.10	7.78	1.22	8.83	1.60	9.35	1.82	9.63	1.92	10.19	1.96	10.76	2.01
	32.0	7.25	1.15	7.77	1.26	8.81	1.64	9.33	1.86	9.62	1.94	10.18	1.99	10.74	2.03
	33.0	7.24	1.19	7.76	1.31	8.80	1.68	9.32	1.90	9.60	1.96	10.17	2.01	10.73	2.06
	35.0	7.22	1.29	7.74	1.41	8.78	1.77	9.30	1.98	9.58	2.00	10.14	2.05	10.70	2.10
	37.0	7.22	1.36	7.74	1.50	8.78	1.86	9.30	2.07	9.58	2.09	10.14	2.14	10.70	2.19
	39.0	7.22	1.43	7.74	1.59	8.78	1.94	9.30	2.16	9.58	2.18	10.14	2.23	10.70	2.28
	40.0	7.22	1.47	7.74	1.63	8.78	1.99	9.30	2.20	9.58	2.22	10.14	2.27	10.70	2.32
	42.0	7.22	1.56	7.74	1.72	8.78	2.08	9.30	2.29	9.58	2.26	10.14	2.25	10.70	2.23
	43.0	7.22	1.58	7.74	1.76	8.78	2.12	9.30	2.34	9.58	2.28	10.14	2.24	10.70	2.18
	46.0	5.78	1.52	6.19	1.68	7.02	1.98	7.44	1.98	7.66	1.95	8.11	1.92	8.56	1.89
	52.0	2.53	1.17	2.71	1.29	3.07	1.59	3.25	1.59	3.35	1.56	3.55	1.53	3.75	1.49

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

7. CAPACITY TABLES

S-Series

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

PUMY-SP140VKM2-PA, DA(-BS)/PUMY-SP140YKM2-PA, DA(-BS)															TC: Total Capacity (kW), PI: Power Input (kW)	
Combination (%)	Outdoor air temp.	Indoor air temp.														
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.		
	°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	
50	-5.0	6.14	0.46	6.58	0.52	7.46	0.89	7.90	1.10	8.14	1.34	8.62	1.37	9.10	1.41	
	0.0	6.14	0.46	6.58	0.52	7.46	0.89	7.90	1.10	8.14	1.34	8.62	1.37	9.10	1.41	
	5.0	6.14	0.46	6.58	0.52	7.46	0.89	7.90	1.10	8.14	1.41	8.62	1.37	9.10	1.41	
	10.0	6.14	0.46	6.58	0.52	7.46	0.89	7.90	1.10	8.14	1.34	8.62	1.37	9.10	1.41	
	12.0	6.14	0.46	6.58	0.52	7.46	0.89	7.90	1.10	8.14	1.33	8.62	1.37	9.10	1.41	
	14.0	6.14	0.46	6.58	0.53	7.46	0.89	7.90	1.10	8.14	1.33	8.62	1.37	9.10	1.41	
	16.0	6.14	0.47	6.58	0.53	7.46	0.90	7.90	1.09	8.14	1.33	8.62	1.37	9.10	1.41	
	18.0	6.14	0.47	6.58	0.54	7.46	0.90	7.90	1.09	8.14	1.33	8.62	1.37	9.10	1.40	
	20.0	6.14	0.48	6.58	0.54	7.46	0.90	7.90	1.09	8.14	1.33	8.62	1.37	9.10	1.40	
	21.0	6.13	0.52	6.57	0.58	7.45	0.94	7.89	1.12	8.13	1.35	8.61	1.38	9.08	1.42	
	23.0	6.11	0.59	6.55	0.66	7.43	1.00	7.87	1.19	8.11	1.38	8.59	1.42	9.06	1.45	
	25.0	6.10	0.65	6.54	0.73	7.41	1.07	7.85	1.25	8.09	1.42	8.56	1.45	9.04	1.49	
	27.0	6.08	0.73	6.52	0.81	7.39	1.14	7.83	1.31	8.07	1.45	8.54	1.49	9.01	1.52	
	29.0	6.07	0.81	6.50	0.89	7.37	1.20	7.81	1.38	8.05	1.49	8.52	1.52	8.99	1.56	
	31.0	6.05	0.87	6.48	0.96	7.35	1.27	7.79	1.44	8.02	1.52	8.50	1.56	8.97	1.59	
	32.0	6.04	0.91	6.48	1.00	7.34	1.30	7.78	1.47	8.01	1.54	8.48	1.57	8.95	1.61	
	33.0	6.03	0.95	6.47	1.04	7.33	1.33	7.77	1.51	8.00	1.55	8.47	1.59	8.94	1.63	
	35.0	6.02	1.02	6.45	1.12	7.32	1.40	7.75	1.57	7.98	1.59	8.45	1.63	8.92	1.66	
	37.0	6.02	1.08	6.45	1.19	7.32	1.47	7.75	1.64	7.98	1.66	8.45	1.70	8.92	1.73	
	39.0	6.02	1.13	6.45	1.26	7.32	1.54	7.75	1.71	7.98	1.73	8.45	1.77	8.92	1.80	
	40.0	6.02	1.17	6.45	1.29	7.32	1.58	7.75	1.75	7.98	1.76	8.45	1.80	8.92	1.84	
	42.0	6.02	1.24	6.45	1.36	7.32	1.65	7.75	1.82	7.98	1.79	8.45	1.78	8.92	1.77	
	43.0	6.02	1.26	6.45	1.40	7.32	1.68	7.75	1.85	7.98	1.81	8.45	1.78	8.92	1.73	
	46.0	4.81	1.21	5.16	1.33	5.85	1.57	6.20	1.57	6.39	1.55	6.76	1.52	7.13	1.50	
	52.0	2.11	0.93	2.26	1.02	2.56	1.26	2.71	1.26	2.79	1.23	2.96	1.21	3.12	1.18	

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-CP100VKM2-PA, DA(-BS)/PUMY-CP100YKM2-PA(-BS)

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC
130	10.0	9.43	0.83	10.11	0.94	11.47	1.61	12.15	2.00	12.51	2.43	13.25	2.50	13.98	2.57
	12.0	9.43	0.84	10.11	0.95	11.47	1.62	12.15	1.99	12.51	2.42	13.25	2.49	13.98	2.56
	14.0	9.43	0.84	10.11	0.96	11.47	1.62	12.15	1.99	12.51	2.42	13.25	2.49	13.98	2.56
	16.0	9.43	0.85	10.11	0.97	11.47	1.63	12.15	1.99	12.51	2.42	13.25	2.49	13.98	2.55
	18.0	9.43	0.86	10.11	0.97	11.47	1.64	12.15	1.98	12.51	2.42	13.25	2.48	13.98	2.55
	20.0	9.43	0.87	10.11	0.98	11.47	1.64	12.15	1.98	12.51	2.42	13.25	2.48	13.98	2.55
	21.0	9.42	0.94	10.10	1.05	11.45	1.70	12.13	2.04	12.50	2.45	13.23	2.51	13.96	2.58
	23.0	9.40	1.08	10.07	1.19	11.42	1.82	12.10	2.15	12.46	2.51	13.20	2.58	13.93	2.64
	25.0	9.37	1.19	10.05	1.33	11.39	1.94	12.07	2.27	12.43	2.57	13.16	2.64	13.89	2.70
	27.0	9.35	1.33	10.02	1.47	11.36	2.06	12.04	2.39	12.40	2.64	13.13	2.70	13.85	2.77
	29.0	9.32	1.47	9.99	1.61	11.33	2.18	12.00	2.50	12.37	2.70	13.09	2.76	13.82	2.83
	31.0	9.30	1.58	9.97	1.75	11.30	2.30	11.97	2.62	12.33	2.76	13.06	2.83	13.78	2.90
	32.0	9.29	1.65	9.95	1.82	11.29	2.36	11.96	2.68	12.32	2.79	13.04	2.86	13.76	2.93
	33.0	9.27	1.72	9.94	1.89	11.27	2.42	11.94	2.74	12.30	2.82	13.02	2.89	13.74	2.96
	35.0	9.25	1.86	9.91	2.03	11.24	2.54	11.91	2.85	12.27	2.89	12.99	2.95	13.71	3.02
	37.0	9.25	2.12	9.91	2.32	11.24	2.84	11.91	3.15	12.27	3.18	12.99	3.25	13.71	3.32
	39.0	9.25	2.39	9.91	2.62	11.24	3.14	11.91	3.44	12.27	3.48	12.99	3.54	13.71	3.61
	40.0	9.25	2.54	9.91	2.77	11.24	3.28	11.91	3.59	12.27	3.62	12.99	3.69	13.71	3.76
	42.0	9.25	2.83	9.91	3.06	11.24	3.58	11.91	3.89	12.27	3.85	12.99	3.83	13.71	3.80
	43.0	9.25	2.95	9.91	3.21	11.24	3.73	11.91	4.04	12.27	3.96	12.99	3.90	13.71	3.81
	46.0	7.40	2.39	7.93	2.62	8.99	3.28	9.53	3.28	9.81	3.24	10.39	3.22	10.97	3.20
	52.0	3.24	1.68	3.47	1.85	3.94	2.28	4.17	2.28	4.29	2.24	4.55	2.20	4.80	2.15
120	10.0	9.25	0.82	9.91	0.94	11.24	1.60	11.91	1.98	12.27	2.41	12.99	2.48	13.71	2.55
	12.0	9.25	0.83	9.91	0.94	11.24	1.60	11.91	1.98	12.27	2.41	12.99	2.48	13.71	2.55
	14.0	9.25	0.84	9.91	0.95	11.24	1.61	11.91	1.98	12.27	2.41	12.99	2.47	13.71	2.54
	16.0	9.25	0.85	9.91	0.96	11.24	1.62	11.91	1.97	12.27	2.40	12.99	2.47	13.71	2.54
	18.0	9.25	0.85	9.91	0.97	11.24	1.63	11.91	1.97	12.27	2.40	12.99	2.47	13.71	2.53
	20.0	9.25	0.86	9.91	0.98	11.24	1.63	11.91	1.96	12.27	2.40	12.99	2.46	13.71	2.53
	21.0	9.24	0.93	9.90	1.05	11.23	1.69	11.89	2.02	12.25	2.43	12.97	2.50	13.69	2.56
	23.0	9.21	1.07	9.87	1.18	11.20	1.81	11.86	2.14	12.22	2.49	12.94	2.56	13.65	2.62
	25.0	9.19	1.18	9.85	1.32	11.17	1.93	11.83	2.25	12.19	2.56	12.90	2.62	13.62	2.69
	27.0	9.16	1.32	9.82	1.46	11.14	2.05	11.80	2.37	12.15	2.62	12.87	2.68	13.58	2.75
	29.0	9.14	1.46	9.80	1.60	11.11	2.17	11.77	2.49	12.12	2.68	12.83	2.75	13.54	2.81
	31.0	9.11	1.57	9.77	1.74	11.08	2.29	11.74	2.60	12.09	2.74	12.80	2.81	13.51	2.88
	32.0	9.10	1.64	9.76	1.81	11.07	2.35	11.72	2.66	12.07	2.77	12.78	2.84	13.49	2.91
	33.0	9.09	1.71	9.74	1.88	11.05	2.41	11.71	2.72	12.06	2.80	12.77	2.87	13.47	2.94
	35.0	9.07	1.85	9.72	2.02	11.02	2.53	11.67	2.83	12.03	2.87	12.73	2.93	13.44	3.00
	37.0	9.07	2.11	9.72	2.31	11.02	2.82	11.67	3.13	12.03	3.16	12.73	3.23	13.44	3.30
	39.0	9.07	2.38	9.72	2.60	11.02	3.11	11.67	3.42	12.03	3.45	12.73	3.52	13.44	3.59
	40.0	9.07	2.52	9.72	2.75	11.02	3.26	11.67	3.57	12.03	3.60	12.73	3.67	13.44	3.74
	42.0	9.07	2.82	9.72	3.04	11.02	3.55	11.67	3.86	12.03	3.82	12.73	3.81	13.44	3.77
	43.0	9.07	2.93	9.72	3.19	11.02	3.70	11.67	4.01	12.03	3.93	12.73	3.87	13.44	3.79
	46.0	7.25	2.38	7.77	2.61	8.82	3.26	9.34	3.26	9.62	3.22	10.19	3.20	10.75	3.18
	52.0	3.17	1.67	3.40	1.84	3.86	2.27	4.09	2.27	4.21	2.23	4.46	2.18	4.70	2.13
110	10.0	9.06	0.82	9.71	0.93	11.02	1.59	11.67	1.97	12.02	2.40	12.73	2.47	13.43	2.54
	12.0	9.06	0.83	9.71	0.94	11.02	1.60	11.67	1.97	12.02	2.39	12.73	2.46	13.43	2.53
	14.0	9.06	0.83	9.71	0.95	11.02	1.60	11.67	1.97	12.02	2.39	12.73	2.46	13.43	2.53
	16.0	9.06	0.84	9.71	0.95	11.02	1.61	11.67	1.96	12.02	2.39	12.73	2.46	13.43	2.52
	18.0	9.06	0.85	9.71	0.96	11.02	1.62	11.67	1.96	12.02	2.39	12.73	2.45	13.43	2.52
	20.0	9.06	0.86	9.71	0.97	11.02	1.62	11.67	1.95	12.02	2.39	12.73	2.45	13.43	2.51
	21.0	9.05	0.93	9.70	1.04	11.00	1.68	11.65	2.01	12.00	2.42	12.71	2.48	13.41	2.55
	23.0	9.03	1.06	9.68	1.18	10.97	1.80	11.62	2.13	11.97	2.48	12.68	2.54	13.38	2.61
	25.0	9.00	1.17	9.65	1.31	10.94	1.92	11.59	2.24	11.94	2.54	12.64	2.61	13.34	2.67
	27.0	8.98	1.31	9.62	1.45	10.92	2.04	11.56	2.36	11.91	2.60	12.61	2.67	13.31	2.73
	29.0	8.96	1.45	9.60	1.59	10.89	2.16	11.53	2.47	11.88	2.66	12.58	2.73	13.27	2.80
	31.0	8.93	1.56	9.57	1.73	10.86	2.28	11.50	2.59	11.85	2.73	12.54	2.79	13.24	2.86
	32.0	8.92	1.63	9.56	1.80	10.84	2.34	11.49	2.65	11.83	2.76	12.53	2.82	13.22	2.89
	33.0	8.91	1.70	9.55	1.87	10.83	2.39	11.47	2.70	11.82	2.79	12.51	2.86	13.20	2.92
	35.0	8.88	1.83	9.52	2.00	10.80	2.51	11.44	2.82	11.78	2.85	12.48	2.92	13.17	2.98
	37.0	8.88	2.10	9.52	2.30	10.80	2.80	11.44	3.11	11.78	3.14	12.48	3.21	13.17	3.28
	39.0	8.88	2.36	9.52	2.59	10.80	3.10	11.44	3.40	11.78	3.43	12.48	3.50	13.17	3.57
	40.0	8.88	2.51	9.52	2.73	10.80	3.24	11.44	3.55	11.78	3.58	12.48	3.65	13.17	3.71
	42.0	8.88	2.80	9.52	3.03	10.80	3.53	11.44	3.84	11.78	3.80	12.48	3.78	13.17	3.75
	43.0	8.88	2.92	9.52	3.17	10.80	3.68	11.44	3.99	11.78	3.91	12.48	3.85	13.17	3.77
	46.0	7.11	2.36	7.62	2.59	8.64	3.24	9.15	3.24	9.43	3.20	9.98	3.18	10.53	3.16
	52.0	3.11	1.66	3.33	1.83	3.78	2.26	4.00	2.25	4.12	2.21	4.37	2.17	4.61	2.12

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-CP100VKM2-PA, DA(-BS)/PUMY-CP100YKM2-PA(-BS)

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC
100	10.0	8.87	0.81	9.51	0.92	10.79	1.58	11.42	1.96	11.77	2.38	12.46	2.45	13.15	2.52
	12.0	8.87	0.82	9.51	0.93	10.79	1.58	11.42	1.96	11.77	2.38	12.46	2.45	13.15	2.52
	14.0	8.87	0.83	9.51	0.94	10.79	1.59	11.42	1.95	11.77	2.38	12.46	2.44	13.15	2.51
	16.0	8.87	0.84	9.51	0.95	10.79	1.60	11.42	1.95	11.77	2.37	12.46	2.44	13.15	2.51
	18.0	8.87	0.84	9.51	0.96	10.79	1.61	11.42	1.94	11.77	2.37	12.46	2.44	13.15	2.50
	20.0	8.87	0.85	9.51	0.96	10.79	1.61	11.42	1.94	11.77	2.37	12.46	2.43	13.15	2.50
	21.0	8.86	0.92	9.50	1.03	10.77	1.67	11.41	2.00	11.75	2.40	12.44	2.47	13.13	2.53
	23.0	8.84	1.06	9.47	1.17	10.74	1.79	11.38	2.11	11.72	2.46	12.41	2.53	13.10	2.59
	25.0	8.81	1.17	9.45	1.31	10.72	1.91	11.35	2.23	11.69	2.52	12.38	2.59	13.06	2.65
	27.0	8.79	1.30	9.42	1.44	10.69	2.03	11.32	2.34	11.66	2.59	12.35	2.65	13.03	2.72
	29.0	8.77	1.44	9.40	1.58	10.66	2.14	11.29	2.46	11.63	2.65	12.31	2.71	12.99	2.78
	31.0	8.74	1.55	9.37	1.72	10.63	2.26	11.26	2.57	11.60	2.71	12.28	2.77	12.96	2.84
	32.0	8.73	1.62	9.36	1.79	10.62	2.32	11.24	2.63	11.58	2.74	12.26	2.81	12.94	2.87
	33.0	8.72	1.69	9.35	1.85	10.60	2.38	11.23	2.69	11.57	2.77	12.25	2.84	12.93	2.90
	35.0	8.70	1.82	9.32	1.99	10.57	2.50	11.20	2.80	11.54	2.83	12.21	2.90	12.89	2.97
	37.0	8.70	2.08	9.32	2.28	10.57	2.79	11.20	3.09	11.54	3.12	12.21	3.19	12.89	3.26
	39.0	8.70	2.35	9.32	2.57	10.57	3.08	11.20	3.38	11.54	3.41	12.21	3.48	12.89	3.54
	40.0	8.70	2.49	9.32	2.72	10.57	3.22	11.20	3.52	11.54	3.56	12.21	3.62	12.89	3.69
	42.0	8.70	2.78	9.32	3.01	10.57	3.51	11.20	3.81	11.54	3.77	12.21	3.76	12.89	3.72
	43.0	8.70	2.90	9.32	3.15	10.57	3.66	11.20	3.96	11.54	3.88	12.21	3.83	12.89	3.74
	46.0	6.96	2.35	7.46	2.57	8.46	3.22	8.96	3.22	9.23	3.18	9.77	3.16	10.31	3.14
	52.0	3.04	1.65	3.26	1.82	3.70	2.24	3.92	2.24	4.04	2.20	4.28	2.15	4.51	2.11
90	10.0	7.99	0.71	8.56	0.81	9.71	1.39	10.28	1.72	10.59	2.09	11.21	2.15	11.84	2.21
	12.0	7.99	0.72	8.56	0.82	9.71	1.39	10.28	1.72	10.59	2.09	11.21	2.15	11.84	2.21
	14.0	7.99	0.73	8.56	0.83	9.71	1.40	10.28	1.71	10.59	2.09	11.21	2.15	11.84	2.21
	16.0	7.99	0.73	8.56	0.83	9.71	1.40	10.28	1.71	10.59	2.09	11.21	2.14	11.84	2.20
	18.0	7.99	0.74	8.56	0.84	9.71	1.41	10.28	1.71	10.59	2.08	11.21	2.14	11.84	2.20
	20.0	7.99	0.75	8.56	0.85	9.71	1.42	10.28	1.70	10.59	2.08	11.21	2.14	11.84	2.19
	21.0	7.98	0.81	8.55	0.91	9.70	1.47	10.27	1.75	10.58	2.11	11.20	2.17	11.82	2.22
	23.0	7.95	0.93	8.53	1.03	9.67	1.57	10.24	1.86	10.55	2.16	11.17	2.22	11.79	2.28
	25.0	7.93	1.02	8.50	1.15	9.65	1.68	10.22	1.96	10.52	2.22	11.14	2.27	11.76	2.33
	27.0	7.91	1.14	8.48	1.27	9.62	1.78	10.19	2.06	10.50	2.27	11.11	2.33	11.73	2.39
	29.0	7.89	1.26	8.46	1.39	9.59	1.88	10.16	2.16	10.47	2.32	11.08	2.38	11.70	2.44
	31.0	7.87	1.36	8.44	1.51	9.57	1.99	10.14	2.26	10.44	2.38	11.05	2.44	11.67	2.49
	32.0	7.86	1.42	8.43	1.57	9.56	2.04	10.12	2.31	10.43	2.41	11.04	2.46	11.65	2.52
	33.0	7.85	1.48	8.42	1.63	9.54	2.09	10.11	2.36	10.41	2.43	11.02	2.49	11.63	2.55
	35.0	7.83	1.60	8.39	1.75	9.52	2.19	10.08	2.46	10.39	2.49	11.00	2.55	11.60	2.60
	37.0	7.83	1.83	8.39	2.00	9.52	2.45	10.08	2.71	10.39	2.74	11.00	2.80	11.60	2.86
	39.0	7.83	2.06	8.39	2.26	9.52	2.70	10.08	2.97	10.39	3.00	11.00	3.05	11.60	3.11
	40.0	7.83	2.19	8.39	2.39	9.52	2.83	10.08	3.10	10.39	3.12	11.00	3.18	11.60	3.24
	42.0	7.83	2.44	8.39	2.64	9.52	3.08	10.08	3.35	10.39	3.31	11.00	3.30	11.60	3.27
	43.0	7.83	2.55	8.39	2.77	9.52	3.21	10.08	3.48	10.39	3.41	11.00	3.36	11.60	3.29
	46.0	6.26	2.06	6.71	2.26	7.61	2.83	8.07	2.83	8.31	2.79	8.80	2.78	9.28	2.76
	52.0	2.74	1.45	2.94	1.60	3.33	1.97	3.53	1.97	3.64	1.93	3.85	1.89	4.06	1.85
80	10.0	7.10	0.62	7.61	0.71	8.63	1.21	9.14	1.50	9.42	1.82	9.97	1.87	10.52	1.93
	12.0	7.10	0.63	7.61	0.71	8.63	1.21	9.14	1.50	9.42	1.82	9.97	1.87	10.52	1.92
	14.0	7.10	0.63	7.61	0.72	8.63	1.22	9.14	1.49	9.42	1.82	9.97	1.87	10.52	1.92
	16.0	7.10	0.64	7.61	0.72	8.63	1.22	9.14	1.49	9.42	1.82	9.97	1.87	10.52	1.92
	18.0	7.10	0.65	7.61	0.73	8.63	1.23	9.14	1.49	9.42	1.81	9.97	1.86	10.52	1.91
	20.0	7.10	0.65	7.61	0.74	8.63	1.23	9.14	1.48	9.42	1.81	9.97	1.86	10.52	1.91
	21.0	7.09	0.70	7.60	0.79	8.62	1.28	9.13	1.53	9.40	1.84	9.96	1.88	10.51	1.93
	23.0	7.07	0.81	7.58	0.89	8.60	1.37	9.10	1.61	9.38	1.88	9.93	1.93	10.48	1.98
	25.0	7.05	0.89	7.56	1.00	8.57	1.46	9.08	1.70	9.36	1.93	9.90	1.98	10.45	2.03
	27.0	7.03	1.00	7.54	1.10	8.55	1.55	9.06	1.79	9.33	1.98	9.88	2.03	10.42	2.08
	29.0	7.02	1.10	7.52	1.21	8.53	1.64	9.03	1.88	9.31	2.02	9.85	2.07	10.40	2.12
	31.0	7.00	1.18	7.50	1.31	8.51	1.73	9.01	1.97	9.28	2.07	9.83	2.12	10.37	2.17
	32.0	6.99	1.24	7.49	1.36	8.49	1.77	9.00	2.01	9.27	2.09	9.81	2.14	10.36	2.20
	33.0	6.98	1.29	7.48	1.42	8.48	1.82	8.99	2.05	9.26	2.12	9.80	2.17	10.34	2.22
	35.0	6.96	1.39	7.46	1.52	8.46	1.91	8.96	2.14	9.23	2.16	9.77	2.22	10.31	2.27
	37.0	6.96	1.59	7.46	1.74	8.46	2.13	8.96	2.36	9.23	2.39	9.77	2.44	10.31	2.49
	39.0	6.96	1.79	7.46	1.97	8.46	2.35	8.96	2.58	9.23	2.61	9.77	2.66	10.31	2.71
	40.0	6.96	1.90	7.46	2.08	8.46	2.46	8.96	2.69	9.23	2.72	9.77	2.77	10.31	2.82
	42.0	6.96	2.13	7.46	2.30	8.46	2.68	8.96	2.92	9.23	2.88	9.77	2.87	10.31	2.85
	43.0	6.96	2.22	7.46	2.41	8.46	2.79	8.96	3.03	9.23	2.97	9.77	2.92	10.31	2.86
	46.0	5.57	1.80	5.97	1.97	6.77	2.46	7.17	2.46	7.39	2.43	7.82	2.42	8.25	2.40
	52.0	2.44	1.26	2.61	1.39	2.96	1.71	3.14	1.71	3.23	1.68	3.42	1.65	3.61	1.61

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-CP100VKM2-PA, DA(-BS)/PUMY-CP100YKM2-PA(-BS)

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC
70	10.0	6.21	0.54	6.66	0.61	7.55	1.04	8.00	1.30	8.24	1.58	8.72	1.62	9.21	1.67
	12.0	6.21	0.54	6.66	0.62	7.55	1.05	8.00	1.29	8.24	1.57	8.72	1.62	9.21	1.67
	14.0	6.21	0.55	6.66	0.62	7.55	1.05	8.00	1.29	8.24	1.57	8.72	1.62	9.21	1.66
	16.0	6.21	0.55	6.66	0.63	7.55	1.06	8.00	1.29	8.24	1.57	8.72	1.62	9.21	1.66
	18.0	6.21	0.56	6.66	0.63	7.55	1.06	8.00	1.29	8.24	1.57	8.72	1.61	9.21	1.66
	20.0	6.21	0.56	6.66	0.64	7.55	1.07	8.00	1.28	8.24	1.57	8.72	1.61	9.21	1.65
	21.0	6.20	0.61	6.65	0.68	7.54	1.11	7.99	1.32	8.23	1.59	8.71	1.63	9.19	1.67
	23.0	6.19	0.70	6.63	0.77	7.52	1.18	7.97	1.40	8.21	1.63	8.69	1.67	9.17	1.72
	25.0	6.17	0.77	6.61	0.86	7.50	1.26	7.95	1.47	8.19	1.67	8.67	1.71	9.15	1.76
	27.0	6.15	0.86	6.60	0.96	7.48	1.34	7.92	1.55	8.16	1.71	8.64	1.75	9.12	1.80
	29.0	6.14	0.95	6.58	1.05	7.46	1.42	7.90	1.63	8.14	1.75	8.62	1.80	9.10	1.84
	31.0	6.12	1.03	6.56	1.14	7.44	1.50	7.88	1.70	8.12	1.79	8.60	1.84	9.07	1.88
	32.0	6.11	1.07	6.55	1.18	7.43	1.54	7.87	1.74	8.11	1.81	8.59	1.86	9.06	1.90
	33.0	6.11	1.12	6.55	1.23	7.42	1.57	7.86	1.78	8.10	1.83	8.57	1.88	9.05	1.92
	35.0	6.09	1.21	6.53	1.32	7.40	1.65	7.84	1.85	8.08	1.87	8.55	1.92	9.03	1.96
	37.0	6.09	1.38	6.53	1.51	7.40	1.84	7.84	2.05	8.08	2.07	8.55	2.11	9.03	2.15
	39.0	6.09	1.55	6.53	1.70	7.40	2.04	7.84	2.24	8.08	2.26	8.55	2.30	9.03	2.35
	40.0	6.09	1.65	6.53	1.80	7.40	2.13	7.84	2.33	8.08	2.35	8.55	2.40	9.03	2.44
	42.0	6.09	1.84	6.53	1.99	7.40	2.32	7.84	2.53	8.08	2.50	8.55	2.49	9.03	2.47
	43.0	6.09	1.92	6.53	2.09	7.40	2.42	7.84	2.62	8.08	2.57	8.55	2.53	9.03	2.48
	46.0	4.87	1.56	5.22	1.70	5.92	2.13	6.27	2.13	6.46	2.10	6.84	2.09	7.22	2.08
	52.0	2.13	1.09	2.28	1.20	2.59	1.48	2.74	1.48	2.83	1.46	2.99	1.43	3.16	1.39
60	10.0	5.32	0.46	5.71	0.53	6.47	0.90	6.86	1.12	7.06	1.36	7.48	1.40	7.89	1.44
	12.0	5.32	0.47	5.71	0.53	6.47	0.91	6.86	1.12	7.06	1.36	7.48	1.40	7.89	1.44
	14.0	5.32	0.47	5.71	0.54	6.47	0.91	6.86	1.12	7.06	1.36	7.48	1.40	7.89	1.43
	16.0	5.32	0.48	5.71	0.54	6.47	0.91	6.86	1.11	7.06	1.36	7.48	1.39	7.89	1.43
	18.0	5.32	0.48	5.71	0.55	6.47	0.92	6.86	1.11	7.06	1.36	7.48	1.39	7.89	1.43
	20.0	5.32	0.49	5.71	0.55	6.47	0.92	6.86	1.11	7.06	1.35	7.48	1.39	7.89	1.43
	21.0	5.32	0.53	5.70	0.59	6.46	0.95	6.85	1.14	7.05	1.37	7.47	1.41	7.88	1.44
	23.0	5.30	0.60	5.68	0.67	6.45	1.02	6.83	1.21	7.03	1.41	7.45	1.44	7.86	1.48
	25.0	5.29	0.67	5.67	0.75	6.43	1.09	6.81	1.27	7.02	1.44	7.43	1.48	7.84	1.52
	27.0	5.28	0.74	5.65	0.82	6.41	1.16	6.79	1.34	7.00	1.48	7.41	1.51	7.82	1.55
	29.0	5.26	0.82	5.64	0.90	6.40	1.22	6.77	1.40	6.98	1.51	7.39	1.55	7.80	1.59
	31.0	5.25	0.88	5.62	0.98	6.38	1.29	6.76	1.47	6.96	1.55	7.37	1.58	7.78	1.62
	32.0	5.24	0.92	5.62	1.02	6.37	1.33	6.75	1.50	6.95	1.56	7.36	1.60	7.77	1.64
	33.0	5.23	0.96	5.61	1.06	6.36	1.36	6.74	1.53	6.94	1.58	7.35	1.62	7.76	1.66
	35.0	5.22	1.04	5.60	1.14	6.35	1.43	6.72	1.60	6.92	1.62	7.33	1.66	7.74	1.69
	37.0	5.22	1.19	5.60	1.30	6.35	1.59	6.72	1.77	6.92	1.78	7.33	1.82	7.74	1.86
	39.0	5.22	1.34	5.60	1.47	6.35	1.76	6.72	1.93	6.92	1.95	7.33	1.99	7.74	2.03
	40.0	5.22	1.42	5.60	1.55	6.35	1.84	6.72	2.01	6.92	2.03	7.33	2.07	7.74	2.11
	42.0	5.22	1.59	5.60	1.72	6.35	2.01	6.72	2.18	6.92	2.16	7.33	2.15	7.74	2.13
	43.0	5.22	1.66	5.60	1.80	6.35	2.09	6.72	2.26	6.92	2.22	7.33	2.19	7.74	2.14
	46.0	4.18	1.34	4.48	1.47	5.08	1.84	5.38	1.84	5.54	1.82	5.86	1.81	6.19	1.79
	52.0	1.83	0.94	1.96	1.04	2.22	1.28	2.35	1.28	2.42	1.26	2.57	1.23	2.71	1.20
50	10.0	4.44	0.40	4.76	0.45	5.39	0.78	5.71	0.96	5.89	1.17	6.23	1.20	6.58	1.24
	12.0	4.44	0.40	4.76	0.46	5.39	0.78	5.71	0.96	5.89	1.17	6.23	1.20	6.58	1.24
	14.0	4.44	0.41	4.76	0.46	5.39	0.78	5.71	0.96	5.89	1.17	6.23	1.20	6.58	1.23
	16.0	4.44	0.41	4.76	0.47	5.39	0.79	5.71	0.96	5.89	1.17	6.23	1.20	6.58	1.23
	18.0	4.44	0.41	4.76	0.47	5.39	0.79	5.71	0.96	5.89	1.17	6.23	1.20	6.58	1.23
	20.0	4.44	0.42	4.76	0.47	5.39	0.79	5.71	0.95	5.89	1.17	6.23	1.20	6.58	1.23
	21.0	4.43	0.45	4.75	0.51	5.39	0.82	5.71	0.98	5.88	1.18	6.22	1.21	6.57	1.24
	23.0	4.42	0.52	4.74	0.57	5.37	0.88	5.69	1.04	5.86	1.21	6.21	1.24	6.55	1.27
	25.0	4.41	0.57	4.72	0.64	5.36	0.94	5.68	1.09	5.85	1.24	6.19	1.27	6.53	1.30
	27.0	4.40	0.64	4.71	0.71	5.34	1.00	5.66	1.15	5.83	1.27	6.17	1.30	6.52	1.33
	29.0	4.38	0.71	4.70	0.78	5.33	1.05	5.65	1.21	5.82	1.30	6.16	1.33	6.50	1.37
	31.0	4.37	0.76	4.69	0.84	5.32	1.11	5.63	1.26	5.80	1.33	6.14	1.36	6.48	1.40
	32.0	4.37	0.79	4.68	0.88	5.31	1.14	5.62	1.29	5.79	1.35	6.13	1.38	6.47	1.41
	33.0	4.36	0.83	4.68	0.91	5.30	1.17	5.62	1.32	5.79	1.36	6.12	1.39	6.46	1.43
	35.0	4.35	0.90	4.66	0.98	5.29	1.23	5.60	1.38	5.77	1.39	6.11	1.42	6.45	1.46
	37.0	4.35	1.02	4.66	1.12	5.29	1.37	5.60	1.52	5.77	1.53	6.11	1.57	6.45	1.60
	39.0	4.35	1.15	4.66	1.26	5.29	1.51	5.60	1.66	5.77	1.68	6.11	1.71	6.45	1.74
	40.0	4.35	1.22	4.66	1.33	5.29	1.58	5.60	1.73	5.77	1.75	6.11	1.78	6.45	1.81
	42.0	4.35	1.37	4.66	1.48	5.29	1.73	5.60	1.87	5.77	1.85	6.11	1.85	6.45	1.83
	43.0	4.35	1.42	4.66	1.55	5.29	1.80	5.60	1.95	5.77	1.91	6.11	1.88	6.45	1.84
	46.0	3.48	1.15	3.73	1.26	4.23	1.58	4.48	1.58	4.62	1.56	4.89	1.55	5.16	1.54
	52.0	1.52	0.81	1.63	0.89	1.85	1.10	1.96	1.10	2.02	1.08	2.14	1.06	2.26	1.03

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

7. CAPACITY TABLES

S-Series

PUMY-CP112VKM2-TH/PUMY-CP112YKM2-TH

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
	°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
130	10.0	10.52	0.92	11.27	1.04	12.78	1.78	13.54	2.21	13.95	2.69	14.77	2.76	15.58	2.84
	12.0	10.52	0.93	11.27	1.05	12.78	1.79	13.54	2.21	13.95	2.68	14.77	2.76	15.58	2.84
	14.0	10.52	0.93	11.27	1.06	12.78	1.80	13.54	2.20	13.95	2.68	14.77	2.76	15.58	2.83
	16.0	10.52	0.94	11.27	1.07	12.78	1.80	13.54	2.20	13.95	2.68	14.77	2.75	15.58	2.83
	18.0	10.52	0.95	11.27	1.08	12.78	1.81	13.54	2.19	13.95	2.68	14.77	2.75	15.58	2.82
	20.0	10.52	0.96	11.27	1.09	12.78	1.82	13.54	2.19	13.95	2.68	14.77	2.75	15.58	2.82
	21.0	10.50	1.04	11.26	1.16	12.77	1.89	13.52	2.25	13.93	2.71	14.75	2.78	15.56	2.85
	23.0	10.47	1.19	11.23	1.32	12.73	2.02	13.49	2.38	13.89	2.78	14.71	2.85	15.52	2.92
	25.0	10.45	1.32	11.20	1.47	12.70	2.15	13.45	2.51	13.86	2.85	14.67	2.92	15.48	2.99
	27.0	10.42	1.47	11.17	1.63	12.67	2.28	13.42	2.64	13.82	2.92	14.63	2.99	15.44	3.06
	29.0	10.39	1.62	11.14	1.78	12.63	2.42	13.38	2.77	13.78	2.99	14.59	3.06	15.40	3.13
	31.0	10.36	1.75	11.11	1.94	12.60	2.55	13.35	2.90	13.75	3.06	14.55	3.13	15.36	3.20
	32.0	10.35	1.82	11.10	2.01	12.58	2.62	13.33	2.97	13.73	3.09	14.54	3.17	15.34	3.24
	33.0	10.34	1.90	11.08	2.09	12.57	2.68	13.31	3.03	13.71	3.12	14.52	3.20	15.32	3.28
	35.0	10.31	2.06	11.05	2.25	12.53	2.82	13.27	3.16	13.68	3.19	14.48	3.27	15.28	3.35
	37.0	10.31	2.28	11.05	2.51	12.53	3.08	13.27	3.42	13.68	3.45	14.48	3.53	15.28	3.61
	39.0	10.31	2.51	11.05	2.77	12.53	3.34	13.27	3.68	13.68	3.71	14.48	3.79	15.28	3.86
	40.0	10.31	2.64	11.05	2.90	12.53	3.47	13.27	3.81	13.68	3.84	14.48	3.92	15.28	3.99
	42.0	10.31	2.90	11.05	3.16	12.53	3.73	13.27	4.07	13.68	4.02	14.48	4.00	15.28	3.97
	43.0	10.31	3.00	11.05	3.28	12.53	3.86	13.27	4.20	13.68	4.11	14.48	4.05	15.28	3.95
46.0	8.25	2.43	8.84	2.68	10.03	3.29	10.62	3.29	10.94	3.24	11.58	3.22	12.22	3.20	
52.0	3.61	1.86	3.87	2.05	4.39	2.53	4.65	2.53	4.79	2.48	5.07	2.43	5.35	2.38	
120	10.0	10.31	0.91	11.05	1.04	12.53	1.77	13.27	2.20	13.67	2.67	14.48	2.75	15.28	2.83
	12.0	10.31	0.92	11.05	1.05	12.53	1.78	13.27	2.19	13.67	2.67	14.48	2.74	15.28	2.82
	14.0	10.31	0.93	11.05	1.05	12.53	1.78	13.27	2.19	13.67	2.66	14.48	2.74	15.28	2.82
	16.0	10.31	0.94	11.05	1.06	12.53	1.79	13.27	2.18	13.67	2.66	14.48	2.74	15.28	2.81
	18.0	10.31	0.95	11.05	1.07	12.53	1.80	13.27	2.18	13.67	2.66	14.48	2.73	15.28	2.81
	20.0	10.31	0.95	11.05	1.08	12.53	1.81	13.27	2.18	13.67	2.66	14.48	2.73	15.28	2.80
	21.0	10.30	1.03	11.04	1.16	12.52	1.87	13.26	2.24	13.66	2.69	14.46	2.76	15.26	2.83
	23.0	10.27	1.19	11.01	1.31	12.48	2.01	13.22	2.37	13.62	2.76	14.42	2.83	15.22	2.90
	25.0	10.24	1.31	10.98	1.46	12.45	2.14	13.19	2.50	13.59	2.83	14.38	2.90	15.18	2.97
	27.0	10.21	1.46	10.95	1.62	12.42	2.27	13.15	2.63	13.55	2.90	14.34	2.97	15.14	3.04
	29.0	10.19	1.61	10.92	1.77	12.39	2.40	13.12	2.75	13.51	2.97	14.31	3.04	15.10	3.11
	31.0	10.16	1.74	10.89	1.92	12.35	2.53	13.08	2.88	13.48	3.04	14.27	3.11	15.06	3.18
	32.0	10.15	1.81	10.88	2.00	12.34	2.60	13.07	2.95	13.46	3.07	14.25	3.15	15.04	3.22
	33.0	10.13	1.89	10.86	2.08	12.32	2.67	13.05	3.01	13.44	3.10	14.23	3.18	15.02	3.25
	35.0	10.11	2.04	10.83	2.23	12.29	2.80	13.01	3.14	13.41	3.17	14.19	3.25	14.98	3.32
	37.0	10.11	2.27	10.83	2.49	12.29	3.06	13.01	3.40	13.41	3.43	14.19	3.51	14.98	3.58
	39.0	10.11	2.50	10.83	2.75	12.29	3.31	13.01	3.66	13.41	3.69	14.19	3.76	14.98	3.84
	40.0	10.11	2.63	10.83	2.88	12.29	3.44	13.01	3.78	13.41	3.82	14.19	3.89	14.98	3.97
	42.0	10.11	2.88	10.83	3.13	12.29	3.70	13.01	4.04	13.41	4.00	14.19	3.98	14.98	3.94
	43.0	10.11	2.98	10.83	3.26	12.29	3.83	13.01	4.17	13.41	4.08	14.19	4.02	14.98	3.93
46.0	8.09	2.41	8.67	2.67	9.83	3.27	10.41	3.26	10.73	3.22	11.35	3.20	11.98	3.18	
52.0	3.54	1.85	3.79	2.04	4.30	2.51	4.55	2.51	4.69	2.47	4.97	2.42	5.24	2.36	
110	10.0	10.10	0.91	10.83	1.03	12.28	1.76	13.01	2.18	13.40	2.65	14.19	2.73	14.97	2.81
	12.0	10.10	0.91	10.83	1.04	12.28	1.77	13.01	2.18	13.40	2.65	14.19	2.73	14.97	2.80
	14.0	10.10	0.92	10.83	1.05	12.28	1.77	13.01	2.17	13.40	2.65	14.19	2.72	14.97	2.80
	16.0	10.10	0.93	10.83	1.06	12.28	1.78	13.01	2.17	13.40	2.65	14.19	2.72	14.97	2.79
	18.0	10.10	0.94	10.83	1.06	12.28	1.79	13.01	2.17	13.40	2.64	14.19	2.72	14.97	2.79
	20.0	10.10	0.95	10.83	1.07	12.28	1.80	13.01	2.16	13.40	2.64	14.19	2.71	14.97	2.78
	21.0	10.09	1.03	10.81	1.15	12.27	1.86	12.99	2.23	13.38	2.68	14.17	2.75	14.95	2.82
	23.0	10.06	1.18	10.79	1.30	12.23	1.99	12.96	2.35	13.35	2.74	14.13	2.82	14.91	2.89
	25.0	10.04	1.30	10.76	1.45	12.20	2.12	12.92	2.48	13.31	2.81	14.09	2.88	14.87	2.96
	27.0	10.01	1.45	10.73	1.61	12.17	2.26	12.89	2.61	13.28	2.88	14.06	2.95	14.84	3.03
	29.0	9.98	1.60	10.70	1.76	12.14	2.39	12.85	2.74	13.24	2.95	14.02	3.02	14.80	3.09
	31.0	9.96	1.73	10.67	1.91	12.10	2.52	12.82	2.86	13.21	3.02	13.98	3.09	14.76	3.16
	32.0	9.94	1.80	10.66	1.99	12.09	2.58	12.80	2.93	13.19	3.05	13.96	3.12	14.74	3.20
	33.0	9.93	1.88	10.64	2.06	12.07	2.65	12.79	2.99	13.17	3.08	13.95	3.16	14.72	3.23
	35.0	9.90	2.03	10.62	2.22	12.04	2.78	12.75	3.12	13.14	3.15	13.91	3.23	14.68	3.30
	37.0	9.90	2.26	10.62	2.47	12.04	3.04	12.75	3.38	13.14	3.41	13.91	3.48	14.68	3.56
	39.0	9.90	2.48	10.62	2.73	12.04	3.29	12.75	3.63	13.14	3.67	13.91	3.74	14.68	3.82
	40.0	9.90	2.61	10.62	2.86	12.04	3.42	12.75	3.76	13.14	3.79	13.91	3.87	14.68	3.94
	42.0	9.90	2.87	10.62	3.11	12.04	3.68	12.75	4.02	13.14	3.97	13.91	3.95	14.68	3.92
	43.0	9.90	2.96	10.62	3.24	12.04	3.81	12.75	4.14	13.14	4.06	13.91	4.00	14.68	3.90
	46.0	7.92	2.40	8.49	2.65	9.63	3.25	10.20	3.24	10.51	3.20	11.13	3.18	11.74	3.16
	52.0	3.47	1.84	3.72	2.02	4.21	2.50	4.46	2.50	4.60	2.45	4.87	2.40	5.14	2.35

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-CP112VKM2-TH/PUMY-CP112YKM2-TH

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC
100	10.0	9.90	0.90	10.61	1.02	12.04	1.75	12.75	2.17	13.14	2.64	13.91	2.71	14.68	2.79
	12.0	9.90	0.91	10.61	1.03	12.04	1.75	12.75	2.17	13.14	2.63	13.91	2.71	14.68	2.79
	14.0	9.90	0.92	10.61	1.04	12.04	1.76	12.75	2.16	13.14	2.63	13.91	2.71	14.68	2.78
	16.0	9.90	0.93	10.61	1.05	12.04	1.77	12.75	2.16	13.14	2.63	13.91	2.70	14.68	2.78
	18.0	9.90	0.93	10.61	1.06	12.04	1.78	12.75	2.15	13.14	2.63	13.91	2.70	14.68	2.77
	20.0	9.90	0.94	10.61	1.07	12.04	1.79	12.75	2.15	13.14	2.63	13.91	2.70	14.68	2.77
	21.0	9.89	1.02	10.60	1.14	12.02	1.85	12.73	2.21	13.12	2.66	13.89	2.73	14.66	2.80
	23.0	9.86	1.17	10.57	1.29	11.99	1.98	12.70	2.34	13.08	2.73	13.85	2.80	14.62	2.87
	25.0	9.84	1.29	10.54	1.45	11.96	2.11	12.67	2.47	13.05	2.80	13.81	2.87	14.58	2.94
	27.0	9.81	1.44	10.52	1.60	11.93	2.24	12.63	2.59	13.01	2.86	13.78	2.93	14.54	3.01
	29.0	9.79	1.59	10.49	1.75	11.90	2.37	12.60	2.72	12.98	2.93	13.74	3.00	14.50	3.08
	31.0	9.76	1.71	10.46	1.90	11.86	2.50	12.57	2.85	12.95	3.00	13.71	3.07	14.46	3.14
	32.0	9.75	1.79	10.45	1.98	11.85	2.57	12.55	2.91	12.93	3.03	13.69	3.11	14.45	3.18
	33.0	9.73	1.87	10.43	2.05	11.83	2.63	12.53	2.97	12.91	3.07	13.67	3.14	14.43	3.21
	35.0	9.71	2.02	10.41	2.20	11.80	2.76	12.50	3.10	12.88	3.13	13.63	3.21	14.39	3.28
	37.0	9.71	2.24	10.41	2.46	11.80	3.02	12.50	3.35	12.88	3.39	13.63	3.46	14.39	3.54
	39.0	9.71	2.47	10.41	2.71	11.80	3.27	12.50	3.61	12.88	3.64	13.63	3.72	14.39	3.79
	40.0	9.71	2.59	10.41	2.84	11.80	3.40	12.50	3.74	12.88	3.77	13.63	3.85	14.39	3.92
	42.0	9.71	2.85	10.41	3.10	11.80	3.66	12.50	3.99	12.88	3.95	13.63	3.93	14.39	3.89
	43.0	9.71	2.94	10.41	3.22	11.80	3.78	12.50	4.12	12.88	4.03	13.63	3.97	14.39	3.88
	46.0	7.77	2.38	8.32	2.63	9.44	3.23	10.00	3.22	10.30	3.18	10.91	3.16	11.51	3.14
	52.0	3.40	1.83	3.64	2.01	4.13	2.48	4.38	2.48	4.51	2.43	4.77	2.39	5.04	2.33
90	10.0	8.91	0.79	9.55	0.90	10.83	1.54	11.48	1.91	11.82	2.32	12.51	2.39	13.21	2.46
	12.0	8.91	0.80	9.55	0.91	10.83	1.55	11.48	1.91	11.82	2.32	12.51	2.39	13.21	2.46
	14.0	8.91	0.81	9.55	0.92	10.83	1.55	11.48	1.91	11.82	2.32	12.51	2.39	13.21	2.45
	16.0	8.91	0.82	9.55	0.93	10.83	1.56	11.48	1.90	11.82	2.32	12.51	2.38	13.21	2.45
	18.0	8.91	0.82	9.55	0.93	10.83	1.57	11.48	1.90	11.82	2.32	12.51	2.38	13.21	2.44
	20.0	8.91	0.83	9.55	0.94	10.83	1.58	11.48	1.90	11.82	2.32	12.51	2.38	13.21	2.44
	21.0	8.90	0.90	9.54	1.01	10.82	1.63	11.46	1.95	11.81	2.35	12.50	2.41	13.19	2.47
	23.0	8.88	1.03	9.52	1.14	10.79	1.75	11.43	2.06	11.78	2.41	12.47	2.47	13.16	2.53
	25.0	8.85	1.14	9.49	1.28	10.76	1.86	11.40	2.18	11.74	2.47	12.43	2.53	13.12	2.59
	27.0	8.83	1.27	9.47	1.41	10.74	1.98	11.37	2.29	11.71	2.53	12.40	2.59	13.09	2.65
	29.0	8.81	1.41	9.44	1.54	10.71	2.09	11.34	2.40	11.68	2.59	12.37	2.65	13.05	2.71
	31.0	8.78	1.51	9.42	1.68	10.68	2.21	11.31	2.51	11.65	2.65	12.33	2.71	13.02	2.77
	32.0	8.77	1.58	9.40	1.74	10.66	2.27	11.30	2.57	11.64	2.68	12.32	2.74	13.00	2.80
	33.0	8.76	1.65	9.39	1.81	10.65	2.32	11.28	2.62	11.62	2.71	12.30	2.77	12.98	2.84
	35.0	8.74	1.78	9.37	1.94	10.62	2.44	11.25	2.73	11.59	2.76	12.27	2.83	12.95	2.90
	37.0	8.74	1.98	9.37	2.17	10.62	2.66	11.25	2.96	11.59	2.99	12.27	3.06	12.95	3.12
	39.0	8.74	2.18	9.37	2.39	10.62	2.89	11.25	3.18	11.59	3.21	12.27	3.28	12.95	3.35
	40.0	8.74	2.29	9.37	2.51	10.62	3.00	11.25	3.30	11.59	3.33	12.27	3.39	12.95	3.46
	42.0	8.74	2.51	9.37	2.73	10.62	3.22	11.25	3.52	11.59	3.48	12.27	3.47	12.95	3.43
	43.0	8.74	2.60	9.37	2.84	10.62	3.34	11.25	3.63	11.59	3.56	12.27	3.50	12.95	3.42
	46.0	6.99	2.10	7.49	2.32	8.50	2.85	9.00	2.84	9.27	2.80	9.82	2.79	10.36	2.77
	52.0	3.06	1.61	3.28	1.77	3.72	2.19	3.94	2.19	4.06	2.15	4.29	2.10	4.53	2.06
80	10.0	7.92	0.69	8.49	0.78	9.63	1.33	10.20	1.66	10.51	2.01	11.12	2.07	11.74	2.13
	12.0	7.92	0.69	8.49	0.79	9.63	1.34	10.20	1.65	10.51	2.01	11.12	2.07	11.74	2.13
	14.0	7.92	0.70	8.49	0.79	9.63	1.35	10.20	1.65	10.51	2.01	11.12	2.06	11.74	2.12
	16.0	7.92	0.71	8.49	0.80	9.63	1.35	10.20	1.65	10.51	2.01	11.12	2.06	11.74	2.12
	18.0	7.92	0.71	8.49	0.81	9.63	1.36	10.20	1.64	10.51	2.01	11.12	2.06	11.74	2.11
	20.0	7.92	0.72	8.49	0.81	9.63	1.36	10.20	1.64	10.51	2.00	11.12	2.06	11.74	2.11
	21.0	7.91	0.78	8.48	0.87	9.62	1.41	10.19	1.69	10.49	2.03	11.11	2.08	11.72	2.14
	23.0	7.89	0.89	8.46	0.99	9.59	1.51	10.16	1.78	10.47	2.08	11.08	2.14	11.69	2.19
	25.0	7.87	0.99	8.44	1.10	9.57	1.61	10.13	1.88	10.44	2.13	11.05	2.19	11.66	2.24
	27.0	7.85	1.10	8.41	1.22	9.54	1.71	10.11	1.98	10.41	2.18	11.02	2.24	11.63	2.29
	29.0	7.83	1.22	8.39	1.33	9.52	1.81	10.08	2.08	10.38	2.24	10.99	2.29	11.60	2.35
	31.0	7.81	1.31	8.37	1.45	9.49	1.91	10.05	2.17	10.36	2.29	10.96	2.34	11.57	2.40
	32.0	7.80	1.37	8.36	1.51	9.48	1.96	10.04	2.22	10.34	2.31	10.95	2.37	11.56	2.43
	33.0	7.79	1.42	8.35	1.57	9.47	2.01	10.03	2.27	10.33	2.34	10.94	2.40	11.54	2.45
	35.0	7.77	1.54	8.32	1.68	9.44	2.11	10.00	2.37	10.30	2.39	10.91	2.45	11.51	2.51
	37.0	7.77	1.71	8.32	1.88	9.44	2.30	10.00	2.56	10.30	2.59	10.91	2.64	11.51	2.70
	39.0	7.77	1.88	8.32	2.07	9.44	2.50	10.00	2.75	10.30	2.78	10.91	2.84	11.51	2.89
	40.0	7.77	1.98	8.32	2.17	9.44	2.60	10.00	2.85	10.30	2.88	10.91	2.93	11.51	2.99
	42.0	7.77	2.17	8.32	2.36	9.44	2.79	10.00	3.05	10.30	3.01	10.91	3.00	11.51	2.97
	43.0	7.77	2.25	8.32	2.46	9.44	2.89	10.00	3.14	10.30	3.08	10.91	3.03	11.51	2.96
	46.0	6.21	1.82	6.66	2.01	7.55	2.46	8.00	2.46	8.24	2.43	8.72	2.41	9.21	2.39
	52.0	2.72	1.39	2.91	1.54	3.30	1.89	3.50	1.89	3.61	1.86	3.82	1.82	4.03	1.78

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

7. CAPACITY TABLES

S-Series

PUMY-CP112VKM2-TH/PUMY-CP112YKM2-TH

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC
70	10.0	6.93	0.59	7.43	0.67	8.43	1.14	8.93	1.42	9.19	1.72	9.73	1.77	10.27	1.82
	12.0	6.93	0.59	7.43	0.67	8.43	1.15	8.93	1.41	9.19	1.72	9.73	1.77	10.27	1.82
	14.0	6.93	0.60	7.43	0.68	8.43	1.15	8.93	1.41	9.19	1.72	9.73	1.77	10.27	1.81
	16.0	6.93	0.60	7.43	0.69	8.43	1.16	8.93	1.41	9.19	1.72	9.73	1.76	10.27	1.81
	18.0	6.93	0.61	7.43	0.69	8.43	1.16	8.93	1.41	9.19	1.72	9.73	1.76	10.27	1.81
	20.0	6.93	0.62	7.43	0.70	8.43	1.17	8.93	1.40	9.19	1.71	9.73	1.76	10.27	1.80
	21.0	6.92	0.67	7.42	0.75	8.42	1.21	8.91	1.44	9.18	1.74	9.72	1.78	10.26	1.83
	23.0	6.90	0.76	7.40	0.84	8.39	1.29	8.89	1.53	9.16	1.78	9.70	1.83	10.23	1.87
	25.0	6.89	0.84	7.38	0.94	8.37	1.38	8.87	1.61	9.13	1.82	9.67	1.87	10.21	1.92
	27.0	6.87	0.94	7.36	1.04	8.35	1.46	8.84	1.69	9.11	1.87	9.64	1.92	10.18	1.96
	29.0	6.85	1.04	7.34	1.14	8.33	1.55	8.82	1.77	9.09	1.91	9.62	1.96	10.15	2.01
	31.0	6.83	1.12	7.32	1.24	8.31	1.63	8.80	1.86	9.06	1.96	9.59	2.00	10.12	2.05
	32.0	6.82	1.17	7.31	1.29	8.29	1.68	8.79	1.90	9.05	1.98	9.58	2.03	10.11	2.08
	33.0	6.81	1.22	7.30	1.34	8.28	1.72	8.77	1.94	9.04	2.00	9.57	2.05	10.10	2.10
	35.0	6.80	1.32	7.28	1.44	8.26	1.80	8.75	2.02	9.01	2.05	9.54	2.09	10.07	2.14
	37.0	6.80	1.46	7.28	1.60	8.26	1.97	8.75	2.19	9.01	2.21	9.54	2.26	10.07	2.31
	39.0	6.80	1.61	7.28	1.77	8.26	2.14	8.75	2.36	9.01	2.38	9.54	2.43	10.07	2.48
	40.0	6.80	1.69	7.28	1.85	8.26	2.22	8.75	2.44	9.01	2.46	9.54	2.51	10.07	2.56
	42.0	6.80	1.86	7.28	2.02	8.26	2.39	8.75	2.61	9.01	2.58	9.54	2.56	10.07	2.54
	43.0	6.80	1.92	7.28	2.10	8.26	2.47	8.75	2.69	9.01	2.63	9.54	2.59	10.07	2.53
60	46.0	5.44	1.56	5.83	1.72	6.61	2.11	7.00	2.10	7.21	2.07	7.63	2.06	8.06	2.05
	52.0	2.38	1.19	2.55	1.31	2.89	1.62	3.06	1.62	3.15	1.59	3.34	1.56	3.52	1.52
	10.0	5.94	0.50	6.37	0.57	7.22	0.97	7.65	1.20	7.88	1.46	8.34	1.51	8.81	1.55
	12.0	5.94	0.50	6.37	0.57	7.22	0.97	7.65	1.20	7.88	1.46	8.34	1.50	8.81	1.55
	14.0	5.94	0.51	6.37	0.58	7.22	0.98	7.65	1.20	7.88	1.46	8.34	1.50	8.81	1.54
	16.0	5.94	0.51	6.37	0.58	7.22	0.98	7.65	1.20	7.88	1.46	8.34	1.50	8.81	1.54
	18.0	5.94	0.52	6.37	0.59	7.22	0.99	7.65	1.20	7.88	1.46	8.34	1.50	8.81	1.54
	20.0	5.94	0.52	6.37	0.59	7.22	0.99	7.65	1.19	7.88	1.46	8.34	1.50	8.81	1.54
	21.0	5.93	0.57	6.36	0.63	7.21	1.03	7.64	1.23	7.87	1.48	8.33	1.52	8.79	1.55
	23.0	5.92	0.65	6.34	0.72	7.19	1.10	7.62	1.30	7.85	1.51	8.31	1.55	8.77	1.59
	25.0	5.90	0.72	6.33	0.80	7.18	1.17	7.60	1.37	7.83	1.55	8.29	1.59	8.75	1.63
	27.0	5.89	0.80	6.31	0.89	7.16	1.24	7.58	1.44	7.81	1.59	8.27	1.63	8.72	1.67
	29.0	5.87	0.89	6.29	0.97	7.14	1.32	7.56	1.51	7.79	1.63	8.24	1.67	8.70	1.71
	31.0	5.86	0.95	6.28	1.06	7.12	1.39	7.54	1.58	7.77	1.66	8.22	1.71	8.68	1.75
	32.0	5.85	0.99	6.27	1.10	7.11	1.43	7.53	1.62	7.76	1.68	8.21	1.72	8.67	1.77
	33.0	5.84	1.04	6.26	1.14	7.10	1.46	7.52	1.65	7.75	1.70	8.20	1.74	8.66	1.78
	35.0	5.82	1.12	6.24	1.22	7.08	1.53	7.50	1.72	7.73	1.74	8.18	1.78	8.63	1.82
	37.0	5.82	1.24	6.24	1.37	7.08	1.68	7.50	1.86	7.73	1.88	8.18	1.92	8.63	1.96
	39.0	5.82	1.37	6.24	1.51	7.08	1.82	7.50	2.00	7.73	2.02	8.18	2.06	8.63	2.11
	40.0	5.82	1.44	6.24	1.58	7.08	1.89	7.50	2.07	7.73	2.09	8.18	2.13	8.63	2.18
50	42.0	5.82	1.58	6.24	1.72	7.08	2.03	7.50	2.22	7.73	2.19	8.18	2.18	8.63	2.16
	43.0	5.82	1.63	6.24	1.79	7.08	2.10	7.50	2.29	7.73	2.24	8.18	2.20	8.63	2.15
	46.0	4.66	1.32	4.99	1.46	5.66	1.79	6.00	1.79	6.18	1.76	6.54	1.75	6.91	1.74
	52.0	2.04	1.01	2.19	1.12	2.48	1.38	2.63	1.38	2.70	1.35	2.86	1.32	3.02	1.29
	10.0	4.95	0.42	5.31	0.48	6.02	0.82	6.38	1.02	6.57	1.24	6.95	1.28	7.34	1.31
	12.0	4.95	0.43	5.31	0.49	6.02	0.83	6.38	1.02	6.57	1.24	6.95	1.27	7.34	1.31
	14.0	4.95	0.43	5.31	0.49	6.02	0.83	6.38	1.02	6.57	1.24	6.95	1.27	7.34	1.31
	16.0	4.95	0.44	5.31	0.49	6.02	0.83	6.38	1.01	6.57	1.24	6.95	1.27	7.34	1.31
	18.0	4.95	0.44	5.31	0.50	6.02	0.84	6.38	1.01	6.57	1.24	6.95	1.27	7.34	1.30
	20.0	4.95	0.44	5.31	0.50	6.02	0.84	6.38	1.01	6.57	1.24	6.95	1.27	7.34	1.30
	21.0	4.94	0.48	5.30	0.54	6.01	0.87	6.37	1.04	6.56	1.25	6.94	1.28	7.33	1.32
	23.0	4.93	0.55	5.29	0.61	6.00	0.93	6.35	1.10	6.54	1.28	6.93	1.32	7.31	1.35
	25.0	4.92	0.61	5.27	0.68	5.98	0.99	6.33	1.16	6.52	1.31	6.91	1.35	7.29	1.38
	27.0	4.91	0.68	5.26	0.75	5.96	1.05	6.32	1.22	6.51	1.35	6.89	1.38	7.27	1.41
	29.0	4.89	0.75	5.24	0.82	5.95	1.12	6.30	1.28	6.49	1.38	6.87	1.41	7.25	1.45
	31.0	4.88	0.81	5.23	0.89	5.93	1.18	6.28	1.34	6.47	1.41	6.85	1.45	7.23	1.48
	32.0	4.87	0.84	5.22	0.93	5.92	1.21	6.28	1.37	6.46	1.43	6.84	1.46	7.22	1.50
	33.0	4.87	0.88	5.22	0.97	5.92	1.24	6.27	1.40	6.46	1.44	6.83	1.48	7.21	1.51
	35.0	4.85	0.95	5.20	1.04	5.90	1.30	6.25	1.46	6.44	1.47	6.82	1.51	7.19	1.54
	37.0	4.85	1.05	5.20	1.16	5.90	1.42	6.25	1.58	6.44	1.59	6.82	1.63	7.19	1.66
	39.0	4.85	1.16	5.20	1.28	5.90	1.54	6.25	1.70	6.44	1.71	6.82	1.75	7.19	1.78
	40.0	4.85	1.22	5.20	1.34	5.90	1.60	6.25	1.76	6.44	1.77	6.82	1.81	7.19	1.84
	42.0	4.85	1.34	5.20	1.46	5.90	1.72	6.25	1.88	6.44	1.86	6.82	1.85	7.19	1.83
	43.0	4.85	1.39	5.20	1.52	5.90	1.78	6.25	1.94	6.44	1.90	6.82	1.87	7.19	1.82
	46.0	3.88	1.12	4.16	1.24	4.72	1.52	5.00	1.52	5.15	1.50	5.45	1.49	5.76	1.48
	52.0	1.70	0.86	1.82	0.95	2.07	1.17	2.19	1.17	2.25	1.15	2.39	1.12	2.52	1.10

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-CP125VKM2-TH/PUMY-CP125VKM2-PA, DA(-BS)/PUMY-CP125YKM2-TH/PUMY-CP125YKM2-PA(-BS)										TC: Total Capacity (kW), PI: Power Input (kW)					
Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
	°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
130	10.0	11.79	1.14	12.64	1.30	14.34	2.21	15.18	2.75	15.64	3.34	16.56	3.44	17.48	3.53
	12.0	11.79	1.15	12.64	1.31	14.34	2.22	15.18	2.74	15.64	3.34	16.56	3.43	17.48	3.53
	14.0	11.79	1.16	12.64	1.32	14.34	2.23	15.18	2.74	15.64	3.33	16.56	3.43	17.48	3.52
	16.0	11.79	1.17	12.64	1.33	14.34	2.24	15.18	2.73	15.64	3.33	16.56	3.42	17.48	3.51
	18.0	11.79	1.18	12.64	1.34	14.34	2.25	15.18	2.73	15.64	3.33	16.56	3.42	17.48	3.51
	20.0	11.79	1.19	12.64	1.35	14.34	2.26	15.18	2.72	15.64	3.33	16.56	3.41	17.48	3.50
	21.0	11.78	1.29	12.62	1.45	14.32	2.34	15.16	2.80	15.62	3.37	16.54	3.46	17.45	3.55
	23.0	11.75	1.48	12.59	1.64	14.28	2.51	15.12	2.96	15.58	3.45	16.49	3.54	17.41	3.63
	25.0	11.71	1.64	12.56	1.83	14.24	2.67	15.08	3.12	15.54	3.54	16.45	3.63	17.36	3.72
	27.0	11.68	1.83	12.52	2.02	14.20	2.84	15.04	3.28	15.50	3.63	16.41	3.72	17.32	3.81
	29.0	11.65	2.02	12.49	2.22	14.17	3.00	15.00	3.44	15.46	3.71	16.36	3.80	17.27	3.90
	31.0	11.62	2.17	12.46	2.41	14.13	3.17	14.96	3.60	15.42	3.80	16.32	3.89	17.22	3.98
	32.0	11.61	2.27	12.44	2.50	14.11	3.25	14.94	3.69	15.40	3.84	16.30	3.93	17.20	4.03
	33.0	11.59	2.36	12.42	2.60	14.09	3.34	14.93	3.77	15.38	3.88	16.28	3.98	17.18	4.07
	35.0	11.56	2.56	12.39	2.79	14.05	3.50	14.89	3.93	15.33	3.97	16.23	4.06	17.13	4.16
	37.0	11.56	2.84	12.39	3.11	14.05	3.82	14.89	4.25	15.33	4.29	16.23	4.39	17.13	4.48
	39.0	11.56	3.12	12.39	3.44	14.05	4.15	14.89	4.57	15.33	4.61	16.23	4.71	17.13	4.80
	40.0	11.56	3.28	12.39	3.60	14.05	4.31	14.89	4.73	15.33	4.78	16.23	4.87	17.13	4.96
	42.0	11.56	3.61	12.39	3.92	14.05	4.63	14.89	5.06	15.33	5.00	16.23	4.98	17.13	4.93
	43.0	11.56	3.73	12.39	4.08	14.05	4.79	14.89	5.22	15.33	5.11	16.23	5.03	17.13	4.91
46.0	9.25	3.02	9.91	3.33	11.24	4.09	11.91	4.08	12.27	4.03	12.99	4.00	13.71	3.97	
52.0	4.05	2.31	4.34	2.55	4.92	3.14	5.21	3.14	5.37	3.08	5.68	3.02	6.00	2.95	
120	10.0	11.56	1.13	12.39	1.29	14.05	2.20	14.88	2.73	15.33	3.31	16.23	3.41	17.13	3.51
	12.0	11.56	1.14	12.39	1.30	14.05	2.21	14.88	2.72	15.33	3.31	16.23	3.41	17.13	3.50
	14.0	11.56	1.15	12.39	1.31	14.05	2.22	14.88	2.72	15.33	3.31	16.23	3.40	17.13	3.50
	16.0	11.56	1.16	12.39	1.32	14.05	2.23	14.88	2.71	15.33	3.31	16.23	3.40	17.13	3.49
	18.0	11.56	1.18	12.39	1.33	14.05	2.24	14.88	2.71	15.33	3.30	16.23	3.39	17.13	3.48
	20.0	11.56	1.19	12.39	1.34	14.05	2.25	14.88	2.70	15.33	3.30	16.23	3.39	17.13	3.48
	21.0	11.54	1.28	12.37	1.44	14.03	2.33	14.86	2.78	15.31	3.34	16.21	3.43	17.10	3.52
	23.0	11.51	1.47	12.34	1.63	13.99	2.49	14.82	2.94	15.27	3.43	16.16	3.52	17.06	3.61
	25.0	11.48	1.62	12.31	1.82	13.96	2.66	14.78	3.10	15.23	3.52	16.12	3.60	17.01	3.69
	27.0	11.45	1.81	12.27	2.01	13.92	2.82	14.74	3.26	15.19	3.60	16.08	3.69	16.97	3.78
	29.0	11.42	2.00	12.24	2.20	13.88	2.98	14.70	3.42	15.15	3.69	16.04	3.78	16.92	3.87
	31.0	11.39	2.16	12.21	2.39	13.85	3.15	14.67	3.58	15.11	3.77	15.99	3.86	16.88	3.95
	32.0	11.37	2.25	12.19	2.49	13.83	3.23	14.65	3.66	15.09	3.81	15.97	3.91	16.86	4.00
	33.0	11.36	2.35	12.18	2.58	13.81	3.31	14.63	3.74	15.07	3.86	15.95	3.95	16.83	4.04
	35.0	11.33	2.54	12.14	2.77	13.77	3.48	14.59	3.90	15.03	3.94	15.91	4.03	16.79	4.13
	37.0	11.33	2.82	12.14	3.09	13.77	3.80	14.59	4.22	15.03	4.26	15.91	4.36	16.79	4.45
	39.0	11.33	3.10	12.14	3.41	13.77	4.12	14.59	4.54	15.03	4.58	15.91	4.68	16.79	4.77
	40.0	11.33	3.26	12.14	3.57	13.77	4.28	14.59	4.70	15.03	4.74	15.91	4.84	16.79	4.93
	42.0	11.33	3.58	12.14	3.89	13.77	4.60	14.59	5.02	15.03	4.96	15.91	4.94	16.79	4.89
	43.0	11.33	3.70	12.14	4.05	13.77	4.76	14.59	5.18	15.03	5.07	15.91	4.99	16.79	4.88
46.0	9.06	3.00	9.71	3.31	11.02	4.06	11.67	4.05	12.02	4.00	12.73	3.97	13.43	3.94	
52.0	3.97	2.30	4.25	2.53	4.82	3.12	5.11	3.12	5.26	3.06	5.57	3.00	5.88	2.93	
110	10.0	11.32	1.12	12.13	1.28	13.76	2.18	14.58	2.71	15.02	3.29	15.90	3.39	16.78	3.48
	12.0	11.32	1.13	12.13	1.29	13.76	2.19	14.58	2.70	15.02	3.29	15.90	3.38	16.78	3.48
	14.0	11.32	1.15	12.13	1.30	13.76	2.20	14.58	2.70	15.02	3.29	15.90	3.38	16.78	3.47
	16.0	11.32	1.16	12.13	1.31	13.76	2.21	14.58	2.69	15.02	3.28	15.90	3.37	16.78	3.46
	18.0	11.32	1.17	12.13	1.32	13.76	2.22	14.58	2.69	15.02	3.28	15.90	3.37	16.78	3.46
	20.0	11.32	1.18	12.13	1.33	13.76	2.23	14.58	2.68	15.02	3.28	15.90	3.37	16.78	3.45
	21.0	11.30	1.27	12.12	1.43	13.74	2.31	14.56	2.76	15.00	3.32	15.88	3.41	16.75	3.50
	23.0	11.28	1.46	12.09	1.62	13.71	2.47	14.52	2.92	14.96	3.41	15.83	3.49	16.71	3.58
	25.0	11.25	1.61	12.05	1.81	13.67	2.64	14.48	3.08	14.92	3.49	15.79	3.58	16.67	3.67
	27.0	11.22	1.80	12.02	1.99	13.64	2.80	14.44	3.24	14.88	3.57	15.75	3.66	16.62	3.75
	29.0	11.19	1.99	11.99	2.18	13.60	2.96	14.40	3.40	14.84	3.66	15.71	3.75	16.58	3.84
	31.0	11.16	2.14	11.96	2.37	13.56	3.13	14.37	3.55	14.80	3.74	15.67	3.84	16.53	3.93
	32.0	11.14	2.24	11.94	2.47	13.55	3.21	14.35	3.63	14.78	3.79	15.65	3.88	16.51	3.97
	33.0	11.13	2.33	11.93	2.56	13.53	3.29	14.33	3.71	14.76	3.83	15.63	3.92	16.49	4.01
	35.0	11.10	2.52	11.90	2.75	13.49	3.45	14.29	3.87	14.72	3.91	15.58	4.01	16.45	4.10
	37.0	11.10	2.80	11.90	3.07	13.49	3.77	14.29	4.19	14.72	4.23	15.58	4.32	16.45	4.42
	39.0	11.10	3.08	11.90	3.39	13.49	4.09	14.29	4.51	14.72	4.55	15.58	4.64	16.45	4.74
	40.0	11.10	3.24	11.90	3.55	13.49	4.25	14.29	4.67	14.72	4.71	15.58	4.80	16.45	4.89
	42.0	11.10	3.56	11.90	3.87	13.49	4.56	14.29	4.98	14.72	4.93	15.58	4.91	16.45	4.86
	43.0	11.10	3.68	11.90	4.02	13.49	4.72	14.29	5.14	14.72	5.04	15.58	4.96	16.45	4.84
46.0	8.88	2.98	9.52	3.29	10.79	4.03	11.43	4.03	11.78	3.97	12.47	3.95	13.16	3.92	
52.0	3.88	2.28	4.16	2.51	4.72	3.10	5.00	3.10	5.15	3.04	5.45	2.98	5.76	2.91	

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-CP125VKM2-TH/PUMY-CP125VKM2-PA, DA(-BS)/PUMY-CP125YKM2-TH/PUMY-CP125YKM2-PA(-BS) TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC
100	10.0	11.09	1.11	11.89	1.27	13.48	2.16	14.28	2.69	14.71	3.26	15.57	3.36	16.44	3.46
	12.0	11.09	1.13	11.89	1.28	13.48	2.17	14.28	2.68	14.71	3.26	15.57	3.36	16.44	3.45
	14.0	11.09	1.14	11.89	1.29	13.48	2.18	14.28	2.68	14.71	3.26	15.57	3.35	16.44	3.44
	16.0	11.09	1.15	11.89	1.30	13.48	2.19	14.28	2.67	14.71	3.26	15.57	3.35	16.44	3.44
	18.0	11.09	1.16	11.89	1.31	13.48	2.20	14.28	2.67	14.71	3.25	15.57	3.34	16.44	3.43
	20.0	11.09	1.17	11.89	1.32	13.48	2.21	14.28	2.66	14.71	3.25	15.57	3.34	16.44	3.43
	21.0	11.08	1.26	11.87	1.42	13.46	2.29	14.26	2.74	14.69	3.29	15.55	3.38	16.41	3.47
	23.0	11.05	1.45	11.84	1.60	13.43	2.45	14.22	2.90	14.65	3.38	15.51	3.47	16.37	3.55
	25.0	11.02	1.60	11.81	1.79	13.39	2.62	14.19	3.05	14.62	3.46	15.47	3.55	16.33	3.64
	27.0	10.99	1.79	11.78	1.98	13.36	2.78	14.15	3.21	14.58	3.55	15.43	3.64	16.29	3.72
	29.0	10.96	1.97	11.75	2.17	13.32	2.94	14.11	3.37	14.54	3.63	15.39	3.72	16.24	3.81
	31.0	10.93	2.12	11.72	2.35	13.29	3.10	14.07	3.53	14.50	3.71	15.35	3.80	16.20	3.90
	32.0	10.92	2.22	11.70	2.45	13.27	3.18	14.06	3.60	14.48	3.76	15.33	3.85	16.18	3.94
	33.0	10.90	2.31	11.69	2.54	13.25	3.26	14.04	3.68	14.46	3.80	15.31	3.89	16.16	3.98
	35.0	10.87	2.50	11.65	2.73	13.22	3.42	14.00	3.84	14.42	3.88	15.27	3.97	16.11	4.07
	37.0	10.87	2.78	11.65	3.05	13.22	3.74	14.00	4.16	14.42	4.20	15.27	4.29	16.11	4.38
	39.0	10.87	3.05	11.65	3.36	13.22	4.05	14.00	4.47	14.42	4.51	15.27	4.61	16.11	4.70
	40.0	10.87	3.21	11.65	3.52	13.22	4.21	14.00	4.63	14.42	4.67	15.27	4.76	16.11	4.86
	42.0	10.87	3.53	11.65	3.83	13.22	4.53	14.00	4.94	14.42	4.89	15.27	4.87	16.11	4.82
	43.0	10.87	3.65	11.65	3.99	13.22	4.69	14.00	5.10	14.42	5.00	15.27	4.92	16.11	4.80
	46.0	8.70	2.95	9.32	3.26	10.57	4.00	11.20	3.99	11.54	3.94	12.21	3.91	12.89	3.89
	52.0	3.81	2.26	4.08	2.49	4.63	3.07	4.90	3.07	5.05	3.02	5.34	2.95	5.64	2.89
90	10.0	9.98	0.96	10.69	1.09	12.13	1.86	12.85	2.30	13.23	2.80	14.01	2.88	14.79	2.96
	12.0	9.98	0.96	10.69	1.10	12.13	1.86	12.85	2.30	13.23	2.80	14.01	2.88	14.79	2.96
	14.0	9.98	0.97	10.69	1.11	12.13	1.87	12.85	2.29	13.23	2.79	14.01	2.87	14.79	2.95
	16.0	9.98	0.98	10.69	1.11	12.13	1.88	12.85	2.29	13.23	2.79	14.01	2.87	14.79	2.95
	18.0	9.98	0.99	10.69	1.12	12.13	1.89	12.85	2.29	13.23	2.79	14.01	2.87	14.79	2.94
	20.0	9.98	1.00	10.69	1.13	12.13	1.90	12.85	2.28	13.23	2.79	14.01	2.86	14.79	2.94
	21.0	9.96	1.08	10.68	1.21	12.11	1.97	12.83	2.35	13.22	2.82	13.99	2.90	14.77	2.97
	23.0	9.94	1.24	10.65	1.37	12.08	2.10	12.80	2.48	13.18	2.90	13.96	2.97	14.73	3.05
	25.0	9.91	1.37	10.62	1.54	12.05	2.24	12.76	2.62	13.15	2.97	13.92	3.04	14.69	3.12
	27.0	9.89	1.53	10.60	1.70	12.02	2.38	12.73	2.75	13.11	3.04	13.88	3.12	14.65	3.19
	29.0	9.86	1.69	10.57	1.86	11.99	2.52	12.70	2.89	13.08	3.11	13.85	3.19	14.61	3.27
	31.0	9.83	1.82	10.54	2.02	11.96	2.66	12.66	3.02	13.04	3.18	13.81	3.26	14.57	3.34
	32.0	9.82	1.90	10.53	2.10	11.94	2.73	12.65	3.09	13.03	3.22	13.79	3.30	14.55	3.38
	33.0	9.81	1.98	10.51	2.18	11.92	2.80	12.63	3.16	13.01	3.26	13.77	3.33	14.54	3.41
	35.0	9.78	2.14	10.48	2.34	11.89	2.93	12.59	3.29	12.98	3.33	13.74	3.41	14.50	3.49
	37.0	9.78	2.38	10.48	2.61	11.89	3.21	12.59	3.56	12.98	3.60	13.74	3.68	14.50	3.76
	39.0	9.78	2.62	10.48	2.88	11.89	3.48	12.59	3.83	12.98	3.87	13.74	3.95	14.50	4.03
	40.0	9.78	2.75	10.48	3.02	11.89	3.61	12.59	3.97	12.98	4.00	13.74	4.08	14.50	4.16
	42.0	9.78	3.02	10.48	3.29	11.89	3.88	12.59	4.24	12.98	4.19	13.74	4.17	14.50	4.13
	43.0	9.78	3.13	10.48	3.42	11.89	4.02	12.59	4.37	12.98	4.28	13.74	4.22	14.50	4.12
	46.0	7.83	2.53	8.39	2.79	9.51	3.43	10.08	3.42	10.38	3.38	10.99	3.36	11.60	3.33
	52.0	3.42	1.94	3.67	2.14	4.16	2.64	4.41	2.63	4.54	2.59	4.81	2.53	5.07	2.48
80	10.0	8.87	0.81	9.51	0.92	10.78	1.58	11.42	1.96	11.76	2.38	12.45	2.45	13.14	2.52
	12.0	8.87	0.82	9.51	0.93	10.78	1.58	11.42	1.95	11.76	2.38	12.45	2.44	13.14	2.51
	14.0	8.87	0.83	9.51	0.94	10.78	1.59	11.42	1.95	11.76	2.37	12.45	2.44	13.14	2.51
	16.0	8.87	0.84	9.51	0.95	10.78	1.60	11.42	1.95	11.76	2.37	12.45	2.44	13.14	2.50
	18.0	8.87	0.84	9.51	0.96	10.78	1.60	11.42	1.94	11.76	2.37	12.45	2.44	13.14	2.50
	20.0	8.87	0.85	9.51	0.96	10.78	1.61	11.42	1.94	11.76	2.37	12.45	2.43	13.14	2.50
	21.0	8.86	0.92	9.49	1.03	10.77	1.67	11.40	2.00	11.75	2.40	12.44	2.46	13.13	2.53
	23.0	8.83	1.06	9.47	1.17	10.74	1.79	11.37	2.11	11.72	2.46	12.41	2.52	13.09	2.59
	25.0	8.81	1.16	9.44	1.30	10.71	1.91	11.34	2.22	11.69	2.52	12.37	2.59	13.06	2.65
	27.0	8.79	1.30	9.42	1.44	10.68	2.02	11.31	2.34	11.66	2.58	12.34	2.65	13.02	2.71
	29.0	8.76	1.44	9.39	1.58	10.65	2.14	11.29	2.45	11.63	2.64	12.31	2.71	12.99	2.78
	31.0	8.74	1.55	9.37	1.72	10.63	2.26	11.26	2.57	11.60	2.71	12.27	2.77	12.95	2.84
	32.0	8.73	1.62	9.36	1.78	10.61	2.32	11.24	2.63	11.58	2.74	12.26	2.80	12.94	2.87
	33.0	8.72	1.68	9.34	1.85	10.60	2.38	11.23	2.68	11.56	2.77	12.24	2.83	12.92	2.90
	35.0	8.69	1.82	9.32	1.99	10.57	2.49	11.20	2.80	11.53	2.83	12.21	2.90	12.89	2.96
	37.0	8.69	2.02	9.32	2.22	10.57	2.72	11.20	3.03	11.53	3.06	12.21	3.12	12.89	3.19
	39.0	8.69	2.22	9.32	2.45	10.57	2.95	11.20	3.26	11.53	3.29	12.21	3.35	12.89	3.42
	40.0	8.69	2.34	9.32	2.56	10.57	3.07	11.20	3.37	11.53	3.40	12.21	3.47	12.89	3.54
	42.0	8.69	2.57	9.32	2.79	10.57	3.30	11.20	3.60	11.53	3.56	12.21	3.55	12.89	3.51
	43.0	8.69	2.66	9.32	2.91	10.57	3.41	11.20	3.72	11.53	3.64	12.21	3.58	12.89	3.50
	46.0	6.96	2.15	7.46	2.37	8.46	2.91	8.96	2.91	9.23	2.87	9.77	2.85	10.31	2.83
	52.0	3.04	1.65	3.26	1.82	3.70	2.24	3.92	2.24	4.04	2.20	4.27	2.15	4.51	2.10

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-CP125VKM2-TH/PUMY-CP125VKM2-PA, DA(-BS)/PUMY-CP125YKM2-TH/PUMY-CP125YKM2-PA(-BS)

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC
70	10.0	7.76	0.68	8.32	0.78	9.43	1.33	9.99	1.65	10.29	2.00	10.90	2.06	11.50	2.12
	12.0	7.76	0.69	8.32	0.78	9.43	1.33	9.99	1.65	10.29	2.00	10.90	2.06	11.50	2.12
	14.0	7.76	0.70	8.32	0.79	9.43	1.34	9.99	1.64	10.29	2.00	10.90	2.06	11.50	2.11
	16.0	7.76	0.70	8.32	0.80	9.43	1.34	9.99	1.64	10.29	2.00	10.90	2.05	11.50	2.11
	18.0	7.76	0.71	8.32	0.80	9.43	1.35	9.99	1.64	10.29	2.00	10.90	2.05	11.50	2.10
	20.0	7.76	0.72	8.32	0.81	9.43	1.36	9.99	1.63	10.29	1.99	10.90	2.05	11.50	2.10
	21.0	7.75	0.77	8.31	0.87	9.42	1.41	9.98	1.68	10.28	2.02	10.88	2.07	11.49	2.13
	23.0	7.73	0.89	8.29	0.98	9.40	1.50	9.95	1.78	10.25	2.07	10.85	2.13	11.46	2.18
	25.0	7.71	0.98	8.26	1.10	9.37	1.60	9.93	1.87	10.23	2.12	10.83	2.18	11.43	2.23
	27.0	7.69	1.10	8.24	1.21	9.35	1.70	9.90	1.97	10.20	2.17	10.80	2.23	11.40	2.28
	29.0	7.67	1.21	8.22	1.33	9.32	1.80	9.87	2.07	10.17	2.23	10.77	2.28	11.37	2.34
	31.0	7.65	1.30	8.20	1.44	9.30	1.90	9.85	2.16	10.15	2.28	10.74	2.33	11.34	2.39
	32.0	7.64	1.36	8.19	1.50	9.29	1.95	9.84	2.21	10.13	2.30	10.73	2.36	11.32	2.42
	33.0	7.63	1.42	8.18	1.56	9.27	2.00	9.82	2.26	10.12	2.33	10.71	2.39	11.31	2.44
	35.0	7.61	1.53	8.15	1.67	9.25	2.10	9.80	2.35	10.09	2.38	10.68	2.44	11.28	2.49
	37.0	7.61	1.70	8.15	1.87	9.25	2.29	9.80	2.55	10.09	2.57	10.68	2.63	11.28	2.69
	39.0	7.61	1.87	8.15	2.06	9.25	2.49	9.80	2.74	10.09	2.77	10.68	2.82	11.28	2.88
	40.0	7.61	1.97	8.15	2.16	9.25	2.58	9.80	2.84	10.09	2.86	10.68	2.92	11.28	2.98
	42.0	7.61	2.16	8.15	2.35	9.25	2.78	9.80	3.03	10.09	3.00	10.68	2.98	11.28	2.96
	43.0	7.61	2.24	8.15	2.45	9.25	2.87	9.80	3.13	10.09	3.06	10.68	3.02	11.28	2.95
	46.0	6.09	1.81	6.52	2.00	7.40	2.45	7.84	2.45	8.07	2.41	8.55	2.40	9.02	2.38
	52.0	2.66	1.39	2.85	1.53	3.24	1.89	3.43	1.88	3.53	1.85	3.74	1.81	3.95	1.77
60	10.0	6.65	0.57	7.13	0.65	8.09	1.11	8.56	1.37	8.82	1.67	9.34	1.72	9.86	1.77
	12.0	6.65	0.58	7.13	0.65	8.09	1.11	8.56	1.37	8.82	1.67	9.34	1.72	9.86	1.76
	14.0	6.65	0.58	7.13	0.66	8.09	1.12	8.56	1.37	8.82	1.67	9.34	1.71	9.86	1.76
	16.0	6.65	0.59	7.13	0.66	8.09	1.12	8.56	1.37	8.82	1.67	9.34	1.71	9.86	1.76
	18.0	6.65	0.59	7.13	0.67	8.09	1.13	8.56	1.36	8.82	1.66	9.34	1.71	9.86	1.75
	20.0	6.65	0.60	7.13	0.68	8.09	1.13	8.56	1.36	8.82	1.66	9.34	1.71	9.86	1.75
	21.0	6.64	0.65	7.12	0.72	8.08	1.17	8.55	1.40	8.81	1.68	9.33	1.73	9.84	1.77
	23.0	6.63	0.74	7.10	0.82	8.05	1.25	8.53	1.48	8.79	1.73	9.30	1.77	9.82	1.82
	25.0	6.61	0.82	7.08	0.92	8.03	1.34	8.51	1.56	8.77	1.77	9.28	1.82	9.79	1.86
	27.0	6.59	0.91	7.06	1.01	8.01	1.42	8.49	1.64	8.74	1.81	9.26	1.86	9.77	1.90
	29.0	6.57	1.01	7.05	1.11	7.99	1.50	8.46	1.72	8.72	1.86	9.23	1.90	9.74	1.95
	31.0	6.56	1.09	7.03	1.20	7.97	1.59	8.44	1.80	8.70	1.90	9.21	1.95	9.72	1.99
	32.0	6.55	1.13	7.02	1.25	7.96	1.63	8.43	1.84	8.68	1.92	9.19	1.97	9.70	2.01
	33.0	6.54	1.18	7.01	1.30	7.95	1.67	8.42	1.88	8.67	1.94	9.18	1.99	9.69	2.04
	35.0	6.52	1.28	6.99	1.40	7.93	1.75	8.40	1.96	8.65	1.99	9.16	2.03	9.66	2.08
	37.0	6.52	1.42	6.99	1.56	7.93	1.91	8.40	2.13	8.65	2.15	9.16	2.19	9.66	2.24
	39.0	6.52	1.56	6.99	1.72	7.93	2.07	8.40	2.29	8.65	2.31	9.16	2.36	9.66	2.40
	40.0	6.52	1.64	6.99	1.80	7.93	2.15	8.40	2.37	8.65	2.39	9.16	2.44	9.66	2.48
	42.0	6.52	1.80	6.99	1.96	7.93	2.32	8.40	2.53	8.65	2.50	9.16	2.49	9.66	2.47
	43.0	6.52	1.87	6.99	2.04	7.93	2.40	8.40	2.61	8.65	2.55	9.16	2.52	9.66	2.46
	46.0	5.22	1.51	5.59	1.67	6.34	2.04	6.72	2.04	6.92	2.01	7.33	2.00	7.73	1.99
	52.0	2.28	1.16	2.45	1.27	2.77	1.57	2.94	1.57	3.03	1.54	3.21	1.51	3.38	1.48
50	10.0	5.54	0.47	5.94	0.54	6.74	0.91	7.14	1.14	7.35	1.38	7.78	1.42	8.21	1.46
	12.0	5.54	0.48	5.94	0.54	6.74	0.92	7.14	1.13	7.35	1.38	7.78	1.42	8.21	1.46
	14.0	5.54	0.48	5.94	0.55	6.74	0.92	7.14	1.13	7.35	1.38	7.78	1.42	8.21	1.46
	16.0	5.54	0.48	5.94	0.55	6.74	0.93	7.14	1.13	7.35	1.38	7.78	1.42	8.21	1.45
	18.0	5.54	0.49	5.94	0.55	6.74	0.93	7.14	1.13	7.35	1.38	7.78	1.41	8.21	1.45
	20.0	5.54	0.49	5.94	0.56	6.74	0.93	7.14	1.13	7.35	1.38	7.78	1.41	8.21	1.45
	21.0	5.54	0.53	5.93	0.60	6.73	0.97	7.13	1.16	7.34	1.39	7.77	1.43	8.20	1.47
	23.0	5.52	0.61	5.92	0.68	6.71	1.04	7.11	1.22	7.32	1.43	7.75	1.47	8.18	1.50
	25.0	5.51	0.68	5.90	0.76	6.69	1.11	7.09	1.29	7.30	1.46	7.73	1.50	8.16	1.54
	27.0	5.49	0.76	5.89	0.84	6.68	1.17	7.07	1.36	7.29	1.50	7.71	1.54	8.14	1.57
	29.0	5.48	0.83	5.87	0.92	6.66	1.24	7.05	1.42	7.27	1.53	7.69	1.57	8.12	1.61
	31.0	5.46	0.90	5.86	1.00	6.64	1.31	7.03	1.49	7.25	1.57	7.67	1.61	8.10	1.65
	32.0	5.46	0.94	5.85	1.04	6.63	1.34	7.03	1.52	7.24	1.59	7.66	1.63	8.09	1.66
	33.0	5.45	0.98	5.84	1.07	6.62	1.38	7.02	1.56	7.23	1.61	7.65	1.64	8.08	1.68
	35.0	5.43	1.06	5.82	1.15	6.61	1.45	7.00	1.62	7.21	1.64	7.63	1.68	8.05	1.72
	37.0	5.43	1.17	5.82	1.29	6.61	1.58	7.00	1.76	7.21	1.77	7.63	1.81	8.05	1.85
	39.0	5.43	1.29	5.82	1.42	6.61	1.71	7.00	1.89	7.21	1.91	7.63	1.95	8.05	1.99
	40.0	5.43	1.36	5.82	1.49	6.61	1.78	7.00	1.96	7.21	1.97	7.63	2.01	8.05	2.05
	42.0	5.43	1.49	5.82	1.62	6.61	1.91	7.00	2.09	7.21	2.07	7.63	2.06	8.05	2.04
	43.0	5.43	1.54	5.82	1.69	6.61	1.98	7.00	2.16	7.21	2.11	7.63	2.08	8.05	2.03
	46.0	4.35	1.25	4.66	1.38	5.29	1.69	5.60	1.69	5.77	1.66	6.10	1.66	6.44	1.64
	52.0	1.90	0.96	2.04	1.05	2.31	1.30	2.45	1.30	2.52	1.28	2.67	1.25	2.82	1.22

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

7. CAPACITY TABLES

S-Series

PUMY-CP140VKM2-TH/PUMY-CP140VKM2-PA, -DA(-BS)/PUMY-CP140YKM2-TH/PUMY-CP140YKM2-PA(-BS)

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
	°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
130	10.0	12.82	1.40	13.74	1.59	15.58	2.71	16.51	3.37	17.00	4.09	18.00	4.21	19.00	4.33
	12.0	12.82	1.41	13.74	1.60	15.58	2.72	16.51	3.36	17.00	4.09	18.00	4.20	19.00	4.32
	14.0	12.82	1.42	13.74	1.62	15.58	2.74	16.51	3.35	17.00	4.08	18.00	4.20	19.00	4.31
	16.0	12.82	1.44	13.74	1.63	15.58	2.75	16.51	3.35	17.00	4.08	18.00	4.19	19.00	4.31
	18.0	12.82	1.45	13.74	1.64	15.58	2.76	16.51	3.34	17.00	4.08	18.00	4.19	19.00	4.30
	20.0	12.82	1.46	13.74	1.66	15.58	2.77	16.51	3.33	17.00	4.07	18.00	4.18	19.00	4.29
	21.0	12.80	1.58	13.72	1.77	15.56	2.87	16.48	3.43	16.98	4.13	17.98	4.24	18.97	4.34
	23.0	12.77	1.82	13.69	2.01	15.52	3.07	16.44	3.63	16.94	4.23	17.93	4.34	18.92	4.45
	25.0	12.74	2.00	13.65	2.24	15.48	3.28	16.40	3.83	16.89	4.34	17.88	4.45	18.87	4.56
	27.0	12.70	2.24	13.61	2.48	15.44	3.48	16.35	4.02	16.85	4.44	17.84	4.55	18.82	4.67
	29.0	12.67	2.47	13.58	2.71	15.40	3.68	16.31	4.22	16.80	4.55	17.79	4.66	18.77	4.77
	31.0	12.63	2.66	13.54	2.95	15.36	3.88	16.27	4.42	16.76	4.65	17.74	4.77	18.72	4.88
	32.0	12.62	2.78	13.53	3.07	15.34	3.99	16.25	4.52	16.74	4.71	17.72	4.82	18.70	4.93
	33.0	12.60	2.90	13.51	3.19	15.32	4.09	16.23	4.61	16.72	4.76	17.70	4.87	18.68	4.99
	35.0	12.57	3.13	13.47	3.42	15.28	4.29	16.18	4.81	16.67	4.86	17.65	4.98	18.63	5.09
	37.0	12.57	3.30	13.47	3.63	15.28	4.50	16.18	5.02	16.67	5.08	17.65	5.19	18.63	5.31
	39.0	12.57	3.46	13.47	3.85	15.28	4.72	16.18	5.24	16.67	5.29	17.65	5.41	18.63	5.52
	40.0	12.57	3.57	13.47	3.95	15.28	4.82	16.18	5.35	16.67	5.40	17.65	5.51	18.63	5.63
	42.0	12.57	3.78	13.47	4.17	15.28	5.04	16.18	5.56	16.67	5.49	17.65	5.46	18.63	5.40
	43.0	12.57	3.84	13.47	4.28	15.28	5.14	16.18	5.67	16.67	5.53	17.65	5.44	18.63	5.29
	46.0	10.05	3.70	10.78	4.08	12.22	4.81	12.95	4.81	13.34	4.74	14.12	4.66	14.90	4.58
	52.0	4.40	2.83	4.71	3.12	5.35	3.85	5.66	3.85	5.83	3.78	6.18	3.70	6.52	3.62
120	10.0	12.64	1.39	13.55	1.58	15.37	2.69	16.28	3.34	16.77	4.06	17.75	4.18	18.73	4.30
	12.0	12.64	1.40	13.55	1.59	15.37	2.70	16.28	3.33	16.77	4.05	17.75	4.17	18.73	4.29
	14.0	12.64	1.41	13.55	1.60	15.37	2.71	16.28	3.33	16.77	4.05	17.75	4.17	18.73	4.28
	16.0	12.64	1.43	13.55	1.62	15.37	2.73	16.28	3.32	16.77	4.05	17.75	4.16	18.73	4.27
	18.0	12.64	1.44	13.55	1.63	15.37	2.74	16.28	3.31	16.77	4.05	17.75	4.16	18.73	4.27
	20.0	12.64	1.45	13.55	1.64	15.37	2.75	16.28	3.31	16.77	4.04	17.75	4.15	18.73	4.26
	21.0	12.62	1.57	13.53	1.76	15.35	2.85	16.25	3.41	16.75	4.10	17.73	4.20	18.71	4.31
	23.0	12.59	1.80	13.50	1.99	15.31	3.05	16.21	3.60	16.70	4.20	17.68	4.31	18.66	4.42
	25.0	12.56	1.99	13.46	2.23	15.27	3.25	16.17	3.80	16.66	4.30	17.63	4.41	18.61	4.52
	27.0	12.52	2.22	13.42	2.46	15.23	3.45	16.13	3.99	16.61	4.41	17.59	4.52	18.56	4.63
	29.0	12.49	2.46	13.39	2.69	15.19	3.65	16.08	4.19	16.57	4.51	17.54	4.62	18.51	4.74
	31.0	12.46	2.64	13.35	2.93	15.15	3.85	16.04	4.38	16.53	4.62	17.49	4.73	18.46	4.84
	32.0	12.44	2.76	13.34	3.04	15.13	3.95	16.02	4.48	16.50	4.67	17.47	4.78	18.44	4.90
	33.0	12.43	2.87	13.32	3.16	15.11	4.06	16.00	4.58	16.48	4.72	17.45	4.84	18.41	4.95
	35.0	12.39	3.11	13.28	3.39	15.07	4.26	15.96	4.77	16.44	4.83	17.40	4.94	18.37	5.06
	37.0	12.39	3.27	13.28	3.61	15.07	4.47	15.96	4.99	16.44	5.04	17.40	5.15	18.37	5.27
	39.0	12.39	3.44	13.28	3.82	15.07	4.68	15.96	5.20	16.44	5.25	17.40	5.36	18.37	5.48
	40.0	12.39	3.54	13.28	3.92	15.07	4.79	15.96	5.30	16.44	5.36	17.40	5.47	18.37	5.59
	42.0	12.39	3.75	13.28	4.14	15.07	5.00	15.96	5.52	16.44	5.45	17.40	5.42	18.37	5.36
	43.0	12.39	3.81	13.28	4.24	15.07	5.10	15.96	5.62	16.44	5.49	17.40	5.39	18.37	5.25
	46.0	9.91	3.67	10.63	4.05	12.05	4.78	12.77	4.77	13.15	4.70	13.92	4.63	14.69	4.54
	52.0	4.34	2.81	4.65	3.10	5.27	3.82	5.58	3.82	5.75	3.75	6.09	3.67	6.43	3.59
110	10.0	12.46	1.37	13.36	1.56	15.15	2.67	16.05	3.32	16.53	4.03	17.50	4.14	18.47	4.26
	12.0	12.46	1.39	13.36	1.58	15.15	2.68	16.05	3.31	16.53	4.02	17.50	4.14	18.47	4.26
	14.0	12.46	1.40	13.36	1.59	15.15	2.69	16.05	3.30	16.53	4.02	17.50	4.13	18.47	4.25
	16.0	12.46	1.41	13.36	1.60	15.15	2.70	16.05	3.30	16.53	4.02	17.50	4.13	18.47	4.24
	18.0	12.46	1.43	13.36	1.62	15.15	2.72	16.05	3.29	16.53	4.01	17.50	4.12	18.47	4.23
	20.0	12.46	1.44	13.36	1.63	15.15	2.73	16.05	3.28	16.53	4.01	17.50	4.12	18.47	4.22
	21.0	12.44	1.56	13.34	1.75	15.13	2.83	16.02	3.38	16.51	4.06	17.48	4.17	18.44	4.28
	23.0	12.41	1.79	13.30	1.98	15.09	3.03	15.98	3.57	16.46	4.17	17.43	4.28	18.40	4.38
	25.0	12.38	1.97	13.27	2.21	15.05	3.23	15.94	3.77	16.42	4.27	17.38	4.38	18.35	4.49
	27.0	12.35	2.20	13.23	2.44	15.01	3.43	15.90	3.96	16.38	4.37	17.34	4.48	18.30	4.59
	29.0	12.31	2.44	13.20	2.67	14.97	3.62	15.86	4.15	16.34	4.48	17.29	4.59	18.25	4.70
	31.0	12.28	2.62	13.17	2.90	14.93	3.82	15.81	4.35	16.29	4.58	17.25	4.69	18.20	4.80
	32.0	12.27	2.74	13.15	3.02	14.91	3.92	15.79	4.45	16.27	4.63	17.22	4.75	18.18	4.86
	33.0	12.25	2.85	13.13	3.14	14.89	4.02	15.77	4.54	16.25	4.68	17.20	4.80	18.15	4.91
	35.0	12.22	3.08	13.10	3.37	14.85	4.22	15.73	4.74	16.21	4.79	17.16	4.90	18.11	5.02
	37.0	12.22	3.25	13.10	3.58	14.85	4.43	15.73	4.95	16.21	5.00	17.16	5.11	18.11	5.23
	39.0	12.22	3.41	13.10	3.79	14.85	4.64	15.73	5.16	16.21	5.21	17.16	5.32	18.11	5.44
	40.0	12.22	3.51	13.10	3.89	14.85	4.75	15.73	5.26	16.21	5.31	17.16	5.43	18.11	5.54
	42.0	12.22	3.73	13.10	4.10	14.85	4.96	15.73	5.47	16.21	5.40	17.16	5.38	18.11	5.32
	43.0	12.22	3.78	13.10	4.21	14.85	5.06	15.73	5.58	16.21	5.45	17.16	5.35	18.11	5.21
	46.0	9.77	3.64	10.48	4.02	11.88	4.74	12.58	4.74	12.96	4.67	13.72	4.59	14.48	4.51
	52.0	4.28	2.79	4.58	3.07	5.20	3.79	5.51	3.79	5.67	3.72	6.00	3.64	6.34	3.56

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-CP140VKM2-TH/PUMY-CP140VKM2-PA, -DA(-BS)/PUMY-CP140YKM2-TH/PUMY-CP140YKM2-PA(-BS)

TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC
100	10.0	12.28	1.36	13.16	1.55	14.93	2.65	15.81	3.29	16.29	4.00	17.24	4.11	18.20	4.23
	12.0	12.28	1.38	13.16	1.57	14.93	2.66	15.81	3.28	16.29	3.99	17.24	4.11	18.20	4.22
	14.0	12.28	1.39	13.16	1.58	14.93	2.67	15.81	3.28	16.29	3.99	17.24	4.10	18.20	4.21
	16.0	12.28	1.40	13.16	1.59	14.93	2.68	15.81	3.27	16.29	3.99	17.24	4.10	18.20	4.21
	18.0	12.28	1.42	13.16	1.60	14.93	2.70	15.81	3.26	16.29	3.98	17.24	4.09	18.20	4.20
	20.0	12.28	1.43	13.16	1.62	14.93	2.71	15.81	3.26	16.29	3.98	17.24	4.09	18.20	4.19
	21.0	12.26	1.54	13.14	1.73	14.91	2.81	15.79	3.35	16.27	4.03	17.22	4.14	18.17	4.24
	23.0	12.23	1.77	13.11	1.96	14.87	3.00	15.75	3.55	16.22	4.14	17.17	4.24	18.13	4.35
	25.0	12.20	1.96	13.08	2.19	14.83	3.20	15.71	3.74	16.18	4.24	17.13	4.35	18.08	4.45
	27.0	12.17	2.19	13.04	2.42	14.79	3.40	15.67	3.93	16.14	4.34	17.08	4.45	18.03	4.56
	29.0	12.13	2.42	13.01	2.65	14.75	3.60	15.62	4.12	16.10	4.44	17.04	4.55	17.98	4.66
	31.0	12.10	2.60	12.97	2.88	14.71	3.79	15.58	4.32	16.05	4.55	16.99	4.66	17.94	4.77
	32.0	12.09	2.71	12.95	3.00	14.69	3.89	15.56	4.41	16.03	4.60	16.97	4.71	17.91	4.82
	33.0	12.07	2.83	12.94	3.11	14.67	3.99	15.54	4.51	16.01	4.65	16.95	4.76	17.89	4.87
	35.0	12.04	3.06	12.90	3.34	14.63	4.19	15.50	4.70	15.97	4.75	16.90	4.86	17.84	4.98
	37.0	12.04	3.22	12.90	3.55	14.63	4.40	15.50	4.91	15.97	4.96	16.90	5.07	17.84	5.19
	39.0	12.04	3.38	12.90	3.76	14.63	4.61	15.50	5.12	15.97	5.17	16.90	5.28	17.84	5.39
	40.0	12.04	3.49	12.90	3.86	14.63	4.71	15.50	5.22	15.97	5.27	16.90	5.39	17.84	5.50
	42.0	12.04	3.70	12.90	4.07	14.63	4.92	15.50	5.43	15.97	5.36	16.90	5.34	17.84	5.28
	43.0	12.04	3.75	12.90	4.18	14.63	5.03	15.50	5.54	15.97	5.41	16.90	5.31	17.84	5.17
	46.0	9.63	3.61	10.32	3.99	11.71	4.70	12.40	4.70	12.77	4.63	13.52	4.56	14.27	4.47
	52.0	4.21	2.77	4.52	3.05	5.12	3.76	5.43	3.76	5.59	3.69	5.92	3.62	6.24	3.53
90	10.0	11.05	1.12	11.84	1.28	13.43	2.18	14.23	2.71	14.66	3.29	15.51	3.39	16.37	3.49
	12.0	11.05	1.14	11.84	1.29	13.43	2.19	14.23	2.71	14.66	3.29	15.51	3.39	16.37	3.48
	14.0	11.05	1.15	11.84	1.30	13.43	2.20	14.23	2.70	14.66	3.29	15.51	3.38	16.37	3.47
	16.0	11.05	1.16	11.84	1.31	13.43	2.21	14.23	2.70	14.66	3.29	15.51	3.38	16.37	3.47
	18.0	11.05	1.17	11.84	1.32	13.43	2.22	14.23	2.69	14.66	3.28	15.51	3.37	16.37	3.46
	20.0	11.05	1.18	11.84	1.33	13.43	2.23	14.23	2.69	14.66	3.28	15.51	3.37	16.37	3.46
	21.0	11.03	1.27	11.83	1.43	13.41	2.31	14.21	2.76	14.64	3.32	15.49	3.41	16.35	3.50
	23.0	11.00	1.46	11.80	1.62	13.38	2.48	14.17	2.92	14.60	3.41	15.45	3.50	16.31	3.59
	25.0	10.98	1.61	11.76	1.81	13.34	2.64	14.13	3.08	14.56	3.49	15.41	3.58	16.27	3.67
	27.0	10.95	1.80	11.73	2.00	13.31	2.80	14.10	3.24	14.52	3.58	15.37	3.67	16.22	3.76
	29.0	10.92	1.99	11.70	2.19	13.27	2.97	14.06	3.40	14.48	3.66	15.33	3.75	16.18	3.84
	31.0	10.89	2.14	11.67	2.38	13.24	3.13	14.02	3.56	14.44	3.75	15.29	3.84	16.14	3.93
	32.0	10.87	2.24	11.66	2.47	13.22	3.21	14.00	3.64	14.43	3.79	15.27	3.88	16.12	3.97
	33.0	10.86	2.33	11.64	2.57	13.20	3.29	13.98	3.72	14.41	3.83	15.25	3.92	16.10	4.02
	35.0	10.83	2.52	11.61	2.76	13.17	3.45	13.95	3.87	14.37	3.92	15.21	4.01	16.05	4.10
	37.0	10.83	2.66	11.61	2.93	13.17	3.63	13.95	4.05	14.37	4.09	15.21	4.18	16.05	4.28
	39.0	10.83	2.79	11.61	3.10	13.17	3.80	13.95	4.22	14.37	4.26	15.21	4.35	16.05	4.45
	40.0	10.83	2.88	11.61	3.19	13.17	3.88	13.95	4.31	14.37	4.35	15.21	4.44	16.05	4.53
	42.0	10.83	3.05	11.61	3.36	13.17	4.06	13.95	4.48	14.37	4.42	15.21	4.40	16.05	4.35
	43.0	10.83	3.09	11.61	3.44	13.17	4.14	13.95	4.56	14.37	4.46	15.21	4.38	16.05	4.26
	46.0	8.67	2.98	9.29	3.29	10.53	3.88	11.16	3.87	11.49	3.82	12.17	3.76	12.84	3.69
	52.0	3.79	2.28	4.06	2.51	4.61	3.10	4.88	3.10	5.03	3.04	5.32	2.98	5.62	2.91
80	10.0	9.82	0.94	10.53	1.07	11.94	1.82	12.64	2.26	13.03	2.74	13.79	2.82	14.55	2.90
	12.0	9.82	0.95	10.53	1.07	11.94	1.83	12.64	2.25	13.03	2.74	13.79	2.82	14.55	2.90
	14.0	9.82	0.95	10.53	1.08	11.94	1.83	12.64	2.25	13.03	2.74	13.79	2.82	14.55	2.89
	16.0	9.82	0.96	10.53	1.09	11.94	1.84	12.64	2.25	13.03	2.74	13.79	2.81	14.55	2.89
	18.0	9.82	0.97	10.53	1.10	11.94	1.85	12.64	2.24	13.03	2.74	13.79	2.81	14.55	2.88
	20.0	9.82	0.98	10.53	1.11	11.94	1.86	12.64	2.24	13.03	2.73	13.79	2.81	14.55	2.88
	21.0	9.81	1.06	10.51	1.19	11.92	1.93	12.63	2.30	13.01	2.77	13.77	2.84	14.54	2.91
	23.0	9.78	1.22	10.49	1.35	11.89	2.06	12.60	2.43	12.98	2.84	13.74	2.91	14.50	2.99
	25.0	9.76	1.34	10.46	1.51	11.86	2.20	12.56	2.57	12.94	2.91	13.70	2.98	14.46	3.06
	27.0	9.73	1.50	10.43	1.66	11.83	2.33	12.53	2.70	12.91	2.98	13.66	3.06	14.42	3.13
	29.0	9.70	1.66	10.40	1.82	11.80	2.47	12.50	2.83	12.87	3.05	13.63	3.13	14.38	3.20
	31.0	9.68	1.79	10.38	1.98	11.77	2.61	12.46	2.96	12.84	3.12	13.59	3.20	14.34	3.27
	32.0	9.67	1.86	10.36	2.06	11.75	2.67	12.45	3.03	12.82	3.16	13.57	3.23	14.33	3.31
	33.0	9.65	1.94	10.35	2.14	11.74	2.74	12.43	3.10	12.81	3.19	13.56	3.27	14.31	3.35
	35.0	9.63	2.10	10.32	2.29	11.70	2.88	12.40	3.23	12.77	3.26	13.52	3.34	14.27	3.42
	37.0	9.63	2.21	10.32	2.44	11.70	3.02	12.40	3.37	12.77	3.41	13.52	3.48	14.27	3.56
	39.0	9.63	2.32	10.32	2.58	11.70	3.16	12.40	3.51	12.77	3.55	13.52	3.63	14.27	3.70
	40.0	9.63	2.39	10.32	2.65	11.70	3.24	12.40	3.59	12.77	3.62	13.52	3.70	14.27	3.78
	42.0	9.63	2.54	10.32	2.80	11.70	3.38	12.40	3.73	12.77	3.68	13.52	3.66	14.27	3.63
	43.0	9.63	2.58	10.32	2.87	11.70	3.45	12.40	3.80	12.77	3.71	13.52	3.65	14.27	3.55
	46.0	7.70	2.48	8.26	2.74	9.36	3.23	9.92	3.23	10.22	3.18	10.82	3.13	11.42	3.07
	52.0	3.37	1.90	3.61	2.09	4.10	2.58	4.34	2.58	4.47	2.53	4.73	2.48	4.99	2.43

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-CP140VKM2-TH/PUMY-CP140VKM2-PA, -DA(-BS)/PUMY-CP140YKM2-TH/PUMY-CP140YKM2-PA(-BS) TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.													
		22°C D.B. 15°C W.B.		23°C D.B. 16°C W.B.		25°C D.B. 18°C W.B.		27°C D.B. 19°C W.B.		28°C D.B. 20°C W.B.		30°C D.B. 22°C W.B.		32°C D.B. 24°C W.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC
70	10.0	8.59	0.77	9.21	0.88	10.45	1.50	11.06	1.87	11.40	2.27	12.07	2.34	12.73	2.40
	12.0	8.59	0.78	9.21	0.89	10.45	1.51	11.06	1.86	11.40	2.27	12.07	2.33	12.73	2.40
	14.0	8.59	0.79	9.21	0.90	10.45	1.52	11.06	1.86	11.40	2.27	12.07	2.33	12.73	2.39
	16.0	8.59	0.80	9.21	0.90	10.45	1.52	11.06	1.86	11.40	2.26	12.07	2.33	12.73	2.39
	18.0	8.59	0.80	9.21	0.91	10.45	1.53	11.06	1.85	11.40	2.26	12.07	2.32	12.73	2.39
	20.0	8.59	0.81	9.21	0.92	10.45	1.54	11.06	1.85	11.40	2.26	12.07	2.32	12.73	2.38
	21.0	8.58	0.88	9.20	0.98	10.43	1.59	11.05	1.90	11.38	2.29	12.05	2.35	12.72	2.41
	23.0	8.56	1.01	9.17	1.11	10.41	1.71	11.02	2.01	11.35	2.35	12.02	2.41	12.68	2.47
	25.0	8.54	1.11	9.15	1.25	10.38	1.82	10.99	2.12	11.32	2.41	11.99	2.47	12.65	2.53
	27.0	8.51	1.24	9.13	1.38	10.35	1.93	10.96	2.23	11.29	2.47	11.96	2.53	12.62	2.59
	29.0	8.49	1.37	9.10	1.51	10.32	2.04	10.93	2.34	11.26	2.52	11.92	2.59	12.59	2.65
	31.0	8.47	1.48	9.08	1.64	10.30	2.16	10.91	2.45	11.23	2.58	11.89	2.65	12.55	2.71
	32.0	8.46	1.54	9.07	1.70	10.28	2.21	10.89	2.51	11.22	2.61	11.88	2.67	12.54	2.74
	33.0	8.45	1.61	9.05	1.77	10.27	2.27	10.88	2.56	11.20	2.64	11.86	2.70	12.52	2.77
	35.0	8.42	1.74	9.03	1.90	10.24	2.38	10.85	2.67	11.17	2.70	11.83	2.76	12.49	2.83
	37.0	8.42	1.83	9.03	2.02	10.24	2.50	10.85	2.79	11.17	2.82	11.83	2.88	12.49	2.95
	39.0	8.42	1.92	9.03	2.14	10.24	2.62	10.85	2.91	11.17	2.94	11.83	3.00	12.49	3.06
	40.0	8.42	1.98	9.03	2.19	10.24	2.68	10.85	2.97	11.17	3.00	11.83	3.06	12.49	3.12
	42.0	8.42	2.10	9.03	2.31	10.24	2.80	10.85	3.08	11.17	3.05	11.83	3.03	12.49	3.00
	43.0	8.42	2.13	9.03	2.37	10.24	2.85	10.85	3.14	11.17	3.07	11.83	3.02	12.49	2.94
	46.0	6.74	2.05	7.22	2.27	8.19	2.67	8.68	2.67	8.94	2.63	9.46	2.59	9.99	2.54
	52.0	2.95	1.57	3.16	1.73	3.58	2.14	3.80	2.14	3.91	2.10	4.14	2.05	4.37	2.01
60	10.0	7.37	0.63	7.89	0.71	8.95	1.22	9.48	1.51	9.77	1.84	10.34	1.89	10.92	1.95
	12.0	7.37	0.63	7.89	0.72	8.95	1.22	9.48	1.51	9.77	1.84	10.34	1.89	10.92	1.94
	14.0	7.37	0.64	7.89	0.73	8.95	1.23	9.48	1.51	9.77	1.84	10.34	1.89	10.92	1.94
	16.0	7.37	0.65	7.89	0.73	8.95	1.23	9.48	1.50	9.77	1.83	10.34	1.88	10.92	1.94
	18.0	7.37	0.65	7.89	0.74	8.95	1.24	9.48	1.50	9.77	1.83	10.34	1.88	10.92	1.93
	20.0	7.37	0.66	7.89	0.74	8.95	1.25	9.48	1.50	9.77	1.83	10.34	1.88	10.92	1.93
	21.0	7.36	0.71	7.88	0.80	8.94	1.29	9.47	1.54	9.76	1.86	10.33	1.90	10.90	1.95
	23.0	7.34	0.82	7.86	0.90	8.92	1.38	9.45	1.63	9.73	1.90	10.30	1.95	10.87	2.00
	25.0	7.32	0.90	7.84	1.01	8.90	1.47	9.42	1.72	9.71	1.95	10.28	2.00	10.84	2.05
	27.0	7.30	1.01	7.82	1.11	8.87	1.56	9.40	1.81	9.68	2.00	10.25	2.05	10.82	2.10
	29.0	7.28	1.11	7.80	1.22	8.85	1.65	9.37	1.90	9.66	2.04	10.22	2.09	10.79	2.15
	31.0	7.26	1.20	7.78	1.33	8.83	1.75	9.35	1.99	9.63	2.09	10.19	2.14	10.76	2.19
	32.0	7.25	1.25	7.77	1.38	8.81	1.79	9.33	2.03	9.62	2.12	10.18	2.17	10.74	2.22
	33.0	7.24	1.30	7.76	1.43	8.80	1.84	9.32	2.07	9.60	2.14	10.17	2.19	10.73	2.24
	35.0	7.22	1.41	7.74	1.54	8.78	1.93	9.30	2.16	9.58	2.19	10.14	2.24	10.70	2.29
	37.0	7.22	1.48	7.74	1.63	8.78	2.02	9.30	2.26	9.58	2.28	10.14	2.33	10.70	2.39
	39.0	7.22	1.56	7.74	1.73	8.78	2.12	9.30	2.35	9.58	2.38	10.14	2.43	10.70	2.48
	40.0	7.22	1.60	7.74	1.78	8.78	2.17	9.30	2.40	9.58	2.43	10.14	2.48	10.70	2.53
	42.0	7.22	1.70	7.74	1.87	8.78	2.26	9.30	2.50	9.58	2.47	10.14	2.45	10.70	2.43
	43.0	7.22	1.73	7.74	1.92	8.78	2.31	9.30	2.55	9.58	2.49	10.14	2.44	10.70	2.38
	46.0	5.78	1.66	6.19	1.84	7.02	2.16	7.44	2.16	7.66	2.13	8.11	2.10	8.56	2.06
	52.0	2.53	1.27	2.71	1.40	3.07	1.73	3.25	1.73	3.35	1.70	3.55	1.66	3.75	1.63
50	10.0	6.14	0.50	6.58	0.57	7.46	0.97	7.90	1.20	8.14	1.46	8.62	1.50	9.10	1.54
	12.0	6.14	0.50	6.58	0.57	7.46	0.97	7.90	1.20	8.14	1.46	8.62	1.50	9.10	1.54
	14.0	6.14	0.51	6.58	0.58	7.46	0.97	7.90	1.19	8.14	1.45	8.62	1.50	9.10	1.54
	16.0	6.14	0.51	6.58	0.58	7.46	0.98	7.90	1.19	8.14	1.45	8.62	1.49	9.10	1.53
	18.0	6.14	0.52	6.58	0.59	7.46	0.98	7.90	1.19	8.14	1.45	8.62	1.49	9.10	1.53
	20.0	6.14	0.52	6.58	0.59	7.46	0.99	7.90	1.19	8.14	1.45	8.62	1.49	9.10	1.53
	21.0	6.13	0.56	6.57	0.63	7.45	1.02	7.89	1.22	8.13	1.47	8.61	1.51	9.08	1.55
	23.0	6.11	0.65	6.55	0.72	7.43	1.10	7.87	1.29	8.11	1.51	8.59	1.55	9.06	1.59
	25.0	6.10	0.71	6.54	0.80	7.41	1.17	7.85	1.36	8.09	1.55	8.56	1.58	9.04	1.62
	27.0	6.08	0.80	6.52	0.88	7.39	1.24	7.83	1.43	8.07	1.58	8.54	1.62	9.01	1.66
	29.0	6.07	0.88	6.50	0.97	7.37	1.31	7.81	1.50	8.05	1.62	8.52	1.66	8.99	1.70
	31.0	6.05	0.95	6.48	1.05	7.35	1.38	7.79	1.57	8.02	1.66	8.50	1.70	8.97	1.74
	32.0	6.04	0.99	6.48	1.09	7.34	1.42	7.78	1.61	8.01	1.68	8.48	1.72	8.95	1.76
	33.0	6.03	1.03	6.47	1.13	7.33	1.46	7.77	1.64	8.00	1.69	8.47	1.74	8.94	1.78
	35.0	6.02	1.12	6.45	1.22	7.32	1.53	7.75	1.71	7.98	1.73	8.45	1.77	8.92	1.81
	37.0	6.02	1.17	6.45	1.29	7.32	1.60	7.75	1.79	7.98	1.81	8.45	1.85	8.92	1.89
	39.0	6.02	1.23	6.45	1.37	7.32	1.68	7.75	1.87	7.98	1.88	8.45	1.93	8.92	1.97
	40.0	6.02	1.27	6.45	1.41	7.32	1.72	7.75	1.90	7.98	1.92	8.45	1.96	8.92	2.00
	42.0	6.02	1.35	6.45	1.48	7.32	1.79	7.75	1.98	7.98	1.95	8.45	1.95	8.92	1.92
	43.0	6.02	1.37	6.45	1.52	7.32	1.83	7.75	2.02	7.98	1.97	8.45	1.94	8.92	1.88
	46.0	4.81	1.32	5.16	1.45	5.85	1.71	6.20	1.71	6.39	1.69	6.76	1.66	7.13	1.63
	52.0	2.11	1.01	2.26	1.11	2.56	1.37	2.71	1.37	2.79	1.35	2.96	1.32	3.12	1.29

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

7-1-2. Heating capacity

PUMY-SP100VKM2-PA, DA(-BS)/PUMY-SP100YKM2-PA, DA(-BS) TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp. °C D.B.	Indoor air temp.							
		15°C D.B.		20°C D.B.		25°C D.B.		27°C D.B.	
		TC	PI	TC	PI	TC	PI	TC	PI
130	-20.0	8.00	1.50	6.71	1.69	5.42	1.97	4.91	2.11
	-17.5	8.61	1.60	7.23	1.80	5.84	2.12	5.28	2.23
	-15.0	9.23	1.72	7.74	1.95	6.26	2.24	5.66	2.37
	-12.5	9.84	1.83	8.26	2.09	6.67	2.36	6.04	2.53
	-10.0	10.46	1.98	8.77	2.27	7.09	2.53	6.42	2.70
	-7.5	11.77	2.15	9.88	2.47	7.98	2.78	7.22	2.58
	-5.0	13.12	2.35	11.01	2.68	8.89	2.77	8.05	2.35
	-2.5	14.46	2.58	12.13	2.91	9.81	2.52	8.87	2.14
	0.0	15.38	2.67	12.90	2.96	10.43	2.27	9.44	1.94
	2.5	15.38	2.41	12.90	2.67	10.43	2.03	9.44	1.76
	5.0	15.38	2.17	12.90	2.41	10.43	1.81	9.44	1.61
	6.0	15.38	2.08	12.90	2.31	10.43	1.70	9.44	1.53
	7.5	15.38	1.96	12.90	2.17	10.43	1.63	9.44	1.47
	10.0	15.38	1.78	12.90	1.97	10.43	1.50	9.44	1.38
	12.5	15.38	1.63	12.90	1.80	10.43	1.37	9.44	1.27
	15.0	15.38	1.51	12.90	1.68	10.43	1.32	9.44	1.19
120	-20.0	7.92	1.56	6.64	1.76	5.37	2.05	4.86	2.19
	-17.5	8.52	1.66	7.15	1.87	5.78	2.20	5.23	2.32
	-15.0	9.13	1.79	7.66	2.03	6.19	2.32	5.60	2.46
	-12.5	9.74	1.90	8.17	2.17	6.60	2.45	5.98	2.62
	-10.0	10.35	2.06	8.68	2.36	7.02	2.63	6.35	2.81
	-7.5	11.65	2.23	9.77	2.56	7.90	2.89	7.15	2.68
	-5.0	12.98	2.44	10.89	2.78	8.80	2.88	7.96	2.44
	-2.5	14.31	2.68	12.01	3.02	9.70	2.61	8.78	2.22
	0.0	15.22	2.77	12.77	3.07	10.32	2.36	9.34	2.02
	2.5	15.22	2.50	12.77	2.77	10.32	2.11	9.34	1.83
	5.0	15.22	2.25	12.77	2.50	10.32	1.88	9.34	1.67
	6.0	15.22	2.16	12.77	2.40	10.32	1.77	9.34	1.59
	7.5	15.22	2.03	12.77	2.26	10.32	1.69	9.34	1.53
	10.0	15.22	1.84	12.77	2.05	10.32	1.56	9.34	1.44
	12.5	15.22	1.69	12.77	1.87	10.32	1.42	9.34	1.31
	15.0	15.22	1.57	12.77	1.74	10.32	1.37	9.34	1.24
110	-20.0	7.83	1.61	6.57	1.82	5.31	2.12	4.80	2.27
	-17.5	8.43	1.72	7.08	1.94	5.72	2.28	5.17	2.40
	-15.0	9.04	1.86	7.58	2.11	6.13	2.41	5.54	2.56
	-12.5	9.64	1.98	8.09	2.25	6.53	2.54	5.91	2.72
	-10.0	10.24	2.13	8.59	2.45	6.94	2.73	6.28	2.91
	-7.5	11.53	2.32	9.67	2.66	7.81	3.00	7.07	2.78
	-5.0	12.85	2.53	10.78	2.89	8.71	2.99	7.88	2.54
	-2.5	14.16	2.78	11.88	3.13	9.60	2.71	8.69	2.31
	0.0	15.06	2.88	12.63	3.19	10.21	2.45	9.24	2.09
	2.5	15.06	2.59	12.63	2.88	10.21	2.19	9.24	1.90
	5.0	15.06	2.34	12.63	2.60	10.21	1.96	9.24	1.73
	6.0	15.06	2.24	12.63	2.49	10.21	1.84	9.24	1.65
	7.5	15.06	2.11	12.63	2.34	10.21	1.75	9.24	1.59
	10.0	15.06	1.91	12.63	2.12	10.21	1.62	9.24	1.49
	12.5	15.06	1.75	12.63	1.94	10.21	1.48	9.24	1.36
	15.0	15.06	1.63	12.63	1.81	10.21	1.42	9.24	1.28

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

7. CAPACITY TABLES

S-Series

PUMY-SP100VKM2-PA, DA(-BS)/PUMY-SP100YKM2-PA, DA(-BS) TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.							
		15°C D.B.		20°C D.B.		25°C D.B.		27°C D.B.	
	°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI
100	-20.0	7.75	1.67	6.50	1.89	5.25	2.20	4.75	2.35
	-17.5	8.34	1.78	7.00	2.01	5.66	2.37	5.12	2.49
	-15.0	8.94	1.92	7.50	2.18	6.06	2.50	5.48	2.65
	-12.5	9.54	2.05	8.00	2.33	6.46	2.63	5.85	2.82
	-10.0	10.13	2.21	8.50	2.53	6.87	2.82	6.22	3.02
	-7.5	11.40	2.40	9.57	2.75	7.73	3.11	7.00	2.88
	-5.0	12.71	2.63	10.66	2.99	8.61	3.09	7.80	2.63
	-2.5	14.01	2.88	11.76	3.24	9.50	2.81	8.60	2.39
	0.0	14.90	2.98	12.50	3.30	10.10	2.53	9.14	2.17
	2.5	14.90	2.69	12.50	2.98	10.10	2.27	9.14	1.97
	5.0	14.90	2.42	12.50	2.69	10.10	2.02	9.14	1.79
	6.0	14.90	2.32	12.50	2.58	10.10	1.90	9.14	1.71
	7.5	14.90	2.19	12.50	2.43	10.10	1.81	9.14	1.64
	10.0	14.90	1.98	12.50	2.20	10.10	1.68	9.14	1.55
	12.5	14.90	1.81	12.50	2.01	10.10	1.53	9.14	1.41
	15.0	14.90	1.69	12.50	1.87	10.10	1.47	9.14	1.33
90	-20.0	6.97	1.52	5.85	1.71	4.73	1.99	4.28	2.13
	-17.5	7.51	1.62	6.30	1.82	5.09	2.14	4.61	2.26
	-15.0	8.05	1.74	6.75	1.98	5.45	2.26	4.94	2.40
	-12.5	8.58	1.85	7.20	2.11	5.82	2.39	5.26	2.56
	-10.0	9.12	2.00	7.65	2.30	6.18	2.56	5.59	2.74
	-7.5	10.26	2.18	8.61	2.50	6.96	2.82	6.30	2.61
	-5.0	11.44	2.38	9.59	2.71	7.75	2.80	7.02	2.38
	-2.5	12.61	2.61	10.58	2.94	8.55	2.55	7.74	2.16
	0.0	13.41	2.70	11.25	3.00	9.09	2.30	8.23	1.97
	2.5	13.41	2.44	11.25	2.70	9.09	2.06	8.23	1.79
	5.0	13.41	2.20	11.25	2.44	9.09	1.84	8.23	1.63
	6.0	13.41	2.11	11.25	2.34	9.09	1.72	8.23	1.55
	7.5	13.41	1.98	11.25	2.20	9.09	1.65	8.23	1.49
	10.0	13.41	1.80	11.25	1.99	9.09	1.52	8.23	1.40
	12.5	13.41	1.64	11.25	1.83	9.09	1.39	8.23	1.28
	15.0	13.41	1.53	11.25	1.70	9.09	1.33	8.23	1.20
80	-20.0	6.20	1.38	5.20	1.55	4.20	1.81	3.80	1.94
	-17.5	6.68	1.47	5.60	1.65	4.53	1.95	4.10	2.05
	-15.0	7.15	1.58	6.00	1.79	4.85	2.05	4.39	2.18
	-12.5	7.63	1.68	6.40	1.92	5.17	2.17	4.68	2.32
	-10.0	8.11	1.82	6.80	2.08	5.49	2.32	4.97	2.48
	-7.5	9.12	1.98	7.65	2.27	6.18	2.56	5.60	2.37
	-5.0	10.17	2.16	8.53	2.46	6.89	2.54	6.24	2.16
	-2.5	11.21	2.37	9.40	2.67	7.60	2.31	6.88	1.96
	0.0	11.92	2.45	10.00	2.72	8.08	2.08	7.31	1.78
	2.5	11.92	2.21	10.00	2.45	8.08	1.87	7.31	1.62
	5.0	11.92	1.99	10.00	2.21	8.08	1.67	7.31	1.48
	6.0	11.92	1.91	10.00	2.12	8.08	1.56	7.31	1.41
	7.5	11.92	1.80	10.00	2.00	8.08	1.49	7.31	1.35
	10.0	11.92	1.63	10.00	1.81	8.08	1.38	7.31	1.27
	12.5	11.92	1.49	10.00	1.66	8.08	1.26	7.31	1.16
	15.0	11.92	1.39	10.00	1.54	8.08	1.21	7.31	1.09
70	-20.0	5.42	1.23	4.55	1.39	3.68	1.62	3.33	1.74
	-17.5	5.84	1.31	4.90	1.48	3.96	1.74	3.58	1.84
	-15.0	6.26	1.42	5.25	1.61	4.24	1.84	3.84	1.95
	-12.5	6.68	1.51	5.60	1.72	4.53	1.94	4.10	2.08
	-10.0	7.09	1.63	5.95	1.87	4.81	2.08	4.35	2.23
	-7.5	7.98	1.77	6.70	2.03	5.41	2.29	4.90	2.13
	-5.0	8.90	1.94	7.46	2.21	6.03	2.28	5.46	1.94
	-2.5	9.81	2.13	8.23	2.39	6.65	2.07	6.02	1.76
	0.0	10.43	2.20	8.75	2.44	7.07	1.87	6.40	1.60
	2.5	10.43	1.98	8.75	2.20	7.07	1.67	6.40	1.45
	5.0	10.43	1.79	8.75	1.98	7.07	1.49	6.40	1.32
	6.0	10.43	1.71	8.75	1.90	7.07	1.40	6.40	1.26
	7.5	10.43	1.61	8.75	1.79	7.07	1.34	6.40	1.21
	10.0	10.43	1.46	8.75	1.62	7.07	1.24	6.40	1.14
	12.5	10.43	1.34	8.75	1.49	7.07	1.13	6.40	1.04
	15.0	10.43	1.24	8.75	1.38	7.07	1.08	6.40	0.98

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-SP100VKM2-PA, DA(-BS)/PUMY-SP100YKM2-PA, DA(-BS) TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.							
		15°C D.B.		20°C D.B.		25°C D.B.		27°C D.B.	
	°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI
60	-20.0	4.65	1.09	3.90	1.23	3.15	1.43	2.85	1.53
	-17.5	5.01	1.16	4.20	1.31	3.40	1.54	3.07	1.62
	-15.0	5.37	1.25	4.50	1.42	3.64	1.62	3.29	1.72
	-12.5	5.72	1.33	4.80	1.51	3.88	1.71	3.51	1.83
	-10.0	6.08	1.44	5.10	1.64	4.12	1.83	3.73	1.96
	-7.5	6.85	1.56	5.74	1.79	4.64	2.02	4.20	1.87
	-5.0	7.63	1.70	6.40	1.94	5.17	2.01	4.68	1.71
	-2.5	8.41	1.87	7.06	2.11	5.70	1.83	5.16	1.55
	0.0	8.94	1.93	7.50	2.15	6.06	1.64	5.49	1.41
	2.5	8.94	1.75	7.50	1.94	6.06	1.47	5.49	1.28
	5.0	8.94	1.57	7.50	1.75	6.06	1.31	5.49	1.17
	6.0	8.94	1.51	7.50	1.68	6.06	1.23	5.49	1.11
	7.5	8.94	1.42	7.50	1.58	6.06	1.18	5.49	1.07
	10.0	8.94	1.29	7.50	1.43	6.06	1.09	5.49	1.00
	12.5	8.94	1.18	7.50	1.31	6.06	0.99	5.49	0.92
	15.0	8.94	1.09	7.50	1.21	6.06	0.96	5.49	0.86
50	-20.0	3.88	0.94	3.25	1.06	2.63	1.23	2.38	1.32
	-17.5	4.17	1.00	3.50	1.13	2.83	1.33	2.56	1.40
	-15.0	4.47	1.08	3.75	1.22	3.03	1.40	2.74	1.49
	-12.5	4.77	1.15	4.00	1.31	3.23	1.48	2.93	1.58
	-10.0	5.07	1.24	4.25	1.42	3.44	1.58	3.11	1.69
	-7.5	5.71	1.35	4.79	1.55	3.87	1.74	3.50	1.62
	-5.0	6.36	1.47	5.33	1.68	4.31	1.74	3.90	1.47
	-2.5	7.01	1.62	5.88	1.82	4.75	1.58	4.30	1.34
	0.0	7.46	1.67	6.25	1.85	5.05	1.42	4.57	1.22
	2.5	7.46	1.51	6.25	1.67	5.05	1.27	4.57	1.11
	5.0	7.46	1.36	6.25	1.51	5.05	1.14	4.57	1.01
	6.0	7.46	1.30	6.25	1.45	5.05	1.07	4.57	0.96
	7.5	7.46	1.23	6.25	1.36	5.05	1.02	4.57	0.92
	10.0	7.46	1.11	6.25	1.24	5.05	0.94	4.57	0.87
	12.5	7.46	1.02	6.25	1.13	5.05	0.86	4.57	0.79
	15.0	7.46	0.95	6.25	1.05	5.05	0.83	4.57	0.75

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

7. CAPACITY TABLES

S-Series

PUMY-SP125VKM2-PA, DA(-BS)/PUMY-SP125YKM2-PA, DA(-BS) TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp. °C D.B.	Indoor air temp.							
		15°C D.B.		20°C D.B.		25°C D.B.		27°C D.B.	
		TC	PI	TC	PI	TC	PI	TC	PI
130	-20.0	10.23	2.23	8.58	2.51	6.93	2.93	6.27	3.13
	-17.5	11.01	2.37	9.24	2.67	7.47	3.15	6.76	3.31
	-15.0	11.80	2.56	9.90	2.90	8.00	3.32	7.24	3.52
	-12.5	12.59	2.72	10.56	3.10	8.53	3.51	7.72	3.76
	-10.0	13.37	2.94	11.22	3.37	9.06	3.76	8.20	4.02
	-7.5	15.05	3.20	12.63	3.67	10.20	4.14	9.23	3.84
	-5.0	16.77	3.49	14.07	3.98	11.37	4.11	10.29	3.50
	-2.5	18.49	3.84	15.51	4.32	12.54	3.74	11.34	3.18
	0.0	19.67	3.96	16.50	4.40	13.33	3.37	12.06	2.89
	2.5	19.67	3.58	16.50	3.97	13.33	3.02	12.06	2.62
	5.0	19.67	3.22	16.50	3.58	13.33	2.69	12.06	2.39
	6.0	19.67	3.09	16.50	3.43	13.33	2.53	12.06	2.28
	7.5	19.67	2.91	16.50	3.23	13.33	2.42	12.06	2.19
	10.0	19.67	2.64	16.50	2.93	13.33	2.23	12.06	2.06
	12.5	19.67	2.42	16.50	2.68	13.33	2.04	12.06	1.88
	15.0	19.67	2.24	16.50	2.49	13.33	1.96	12.06	1.77
120	-20.0	10.12	2.32	8.49	2.63	6.86	3.06	6.21	3.27
	-17.5	10.90	2.48	9.15	2.79	7.39	3.29	6.69	3.46
	-15.0	11.68	2.67	9.80	3.03	7.92	3.47	7.17	3.68
	-12.5	12.46	2.84	10.45	3.24	8.45	3.66	7.64	3.92
	-10.0	13.24	3.07	11.11	3.52	8.97	3.93	8.12	4.20
	-7.5	14.90	3.34	12.50	3.83	10.10	4.32	9.14	4.01
	-5.0	16.60	3.65	13.93	4.16	11.26	4.30	10.19	3.65
	-2.5	18.31	4.01	15.36	4.51	12.41	3.91	11.23	3.32
	0.0	19.47	4.14	16.33	4.60	13.20	3.52	11.94	3.01
	2.5	19.47	3.74	16.33	4.15	13.20	3.15	11.94	2.74
	5.0	19.47	3.37	16.33	3.74	13.20	2.82	11.94	2.49
	6.0	19.47	3.23	16.33	3.59	13.20	2.64	11.94	2.38
	7.5	19.47	3.04	16.33	3.37	13.20	2.52	11.94	2.28
	10.0	19.47	2.76	16.33	3.06	13.20	2.33	11.94	2.15
	12.5	19.47	2.52	16.33	2.80	13.20	2.13	11.94	1.96
	15.0	19.47	2.34	16.33	2.60	13.20	2.04	11.94	1.85
110	-20.0	10.02	2.42	8.41	2.74	6.79	3.19	6.15	3.41
	-17.5	10.79	2.58	9.05	2.91	7.32	3.43	6.62	3.61
	-15.0	11.56	2.79	9.70	3.16	7.84	3.62	7.09	3.84
	-12.5	12.33	2.97	10.35	3.38	8.36	3.82	7.57	4.09
	-10.0	13.10	3.21	10.99	3.67	8.88	4.09	8.04	4.38
	-7.5	14.75	3.48	12.37	3.99	10.00	4.51	9.05	4.18
	-5.0	16.44	3.81	13.79	4.34	11.14	4.48	10.08	3.81
	-2.5	18.12	4.18	15.20	4.70	12.28	4.08	11.12	3.46
	0.0	19.27	4.32	16.17	4.79	13.06	3.67	11.82	3.14
	2.5	19.27	3.90	16.17	4.32	13.06	3.29	11.82	2.86
	5.0	19.27	3.51	16.17	3.90	13.06	2.94	11.82	2.60
	6.0	19.27	3.37	16.17	3.74	13.06	2.76	11.82	2.48
	7.5	19.27	3.17	16.17	3.52	13.06	2.63	11.82	2.38
	10.0	19.27	2.87	16.17	3.19	13.06	2.43	11.82	2.24
	12.5	19.27	2.63	16.17	2.92	13.06	2.22	11.82	2.05
	15.0	19.27	2.44	16.17	2.71	13.06	2.13	11.82	1.93

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

PUMY-SP125VKM2-PA, DA(-BS)/PUMY-SP125YKM2-PA, DA(-BS) TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	Indoor air temp.							
		15°C D.B.		20°C D.B.		25°C D.B.		27°C D.B.	
	°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI
100	-20.0	9.92	2.53	8.32	2.86	6.72	3.32	6.08	3.56
	-17.5	10.68	2.69	8.96	3.04	7.24	3.58	6.55	3.76
	-15.0	11.44	2.90	9.60	3.30	7.76	3.77	7.02	4.00
	-12.5	12.21	3.09	10.24	3.53	8.27	3.98	7.49	4.27
	-10.0	12.97	3.34	10.88	3.83	8.79	4.27	7.96	4.56
	-7.5	14.60	3.63	12.25	4.16	9.90	4.70	8.96	4.36
	-5.0	16.27	3.97	13.65	4.52	11.03	4.67	9.98	3.97
	-2.5	17.94	4.36	15.05	4.90	12.16	4.25	11.00	3.61
	0.0	19.07	4.50	16.00	5.00	12.93	3.83	11.70	3.28
	2.5	19.07	4.06	16.00	4.51	12.93	3.43	11.70	2.98
	5.0	19.07	3.66	16.00	4.06	12.93	3.06	11.70	2.71
	6.0	19.07	3.51	16.00	3.90	12.93	2.87	11.70	2.59
	7.5	19.07	3.31	16.00	3.67	12.93	2.74	11.70	2.48
	10.0	19.07	3.00	16.00	3.33	12.93	2.54	11.70	2.34
	12.5	19.07	2.74	16.00	3.04	12.93	2.31	11.70	2.14
	15.0	19.07	2.55	16.00	2.83	12.93	2.22	11.70	2.01
90	-20.0	8.81	2.22	7.39	2.51	5.97	2.92	5.40	3.12
	-17.5	9.49	2.37	7.96	2.67	6.43	3.14	5.82	3.30
	-15.0	10.16	2.55	8.53	2.89	6.89	3.31	6.24	3.51
	-12.5	10.84	2.71	9.10	3.09	7.35	3.49	6.65	3.74
	-10.0	11.52	2.93	9.66	3.36	7.81	3.75	7.07	4.00
	-7.5	12.97	3.19	10.88	3.65	8.79	4.12	7.95	3.83
	-5.0	14.45	3.48	12.12	3.97	9.79	4.10	8.86	3.48
	-2.5	15.93	3.83	13.36	4.30	10.80	3.73	9.77	3.17
	0.0	16.94	3.95	14.21	4.39	11.48	3.36	10.39	2.88
	2.5	16.94	3.57	14.21	3.96	11.48	3.01	10.39	2.61
	5.0	16.94	3.21	14.21	3.57	11.48	2.69	10.39	2.38
	6.0	16.94	3.08	14.21	3.42	11.48	2.52	10.39	2.27
	7.5	16.94	2.90	14.21	3.22	11.48	2.41	10.39	2.18
	10.0	16.94	2.63	14.21	2.92	11.48	2.23	10.39	2.05
	12.5	16.94	2.41	14.21	2.67	11.48	2.03	10.39	1.87
	15.0	16.94	2.24	14.21	2.48	11.48	1.95	10.39	1.76
80	-20.0	7.82	1.93	6.56	2.18	5.30	2.54	4.80	2.72
	-17.5	8.42	2.06	7.07	2.32	5.71	2.73	5.17	2.88
	-15.0	9.03	2.22	7.57	2.52	6.12	2.89	5.54	3.06
	-12.5	9.63	2.37	8.08	2.70	6.53	3.04	5.91	3.26
	-10.0	10.23	2.56	8.58	2.93	6.93	3.26	6.28	3.49
	-7.5	11.52	2.78	9.66	3.18	7.81	3.59	7.06	3.33
	-5.0	12.83	3.03	10.76	3.46	8.70	3.57	7.87	3.04
	-2.5	14.15	3.33	11.87	3.75	9.59	3.25	8.68	2.76
	0.0	15.04	3.44	12.62	3.82	10.20	2.93	9.23	2.51
	2.5	15.04	3.11	12.62	3.45	10.20	2.62	9.23	2.28
	5.0	15.04	2.80	12.62	3.11	10.20	2.34	9.23	2.07
	6.0	15.04	2.69	12.62	2.98	10.20	2.20	9.23	1.98
	7.5	15.04	2.53	12.62	2.81	10.20	2.10	9.23	1.90
	10.0	15.04	2.29	12.62	2.54	10.20	1.94	9.23	1.79
	12.5	15.04	2.10	12.62	2.33	10.20	1.77	9.23	1.63
	15.0	15.04	1.95	12.62	2.16	10.20	1.70	9.23	1.54
70	-20.0	6.84	1.67	5.74	1.89	4.63	2.19	4.19	2.35
	-17.5	7.36	1.78	6.18	2.00	4.99	2.36	4.52	2.48
	-15.0	7.89	1.92	6.62	2.18	5.35	2.49	4.84	2.64
	-12.5	8.42	2.04	7.06	2.33	5.70	2.63	5.16	2.82
	-10.0	8.94	2.21	7.50	2.53	6.06	2.82	5.48	3.01
	-7.5	10.06	2.40	8.44	2.75	6.82	3.10	6.17	2.88
	-5.0	11.21	2.62	9.41	2.98	7.60	3.08	6.88	2.62
	-2.5	12.37	2.88	10.37	3.24	8.38	2.80	7.59	2.38
	0.0	13.15	2.97	11.03	3.30	8.91	2.53	8.07	2.16
	2.5	13.15	2.68	11.03	2.98	8.91	2.26	8.07	1.97
	5.0	13.15	2.42	11.03	2.68	8.91	2.02	8.07	1.79
	6.0	13.15	2.32	11.03	2.57	8.91	1.90	8.07	1.71
	7.5	13.15	2.18	11.03	2.42	8.91	1.81	8.07	1.64
	10.0	13.15	1.98	11.03	2.20	8.91	1.67	8.07	1.54
	12.5	13.15	1.81	11.03	2.01	8.91	1.53	8.07	1.41
	15.0	13.15	1.68	11.03	1.87	8.91	1.47	8.07	1.33

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-SP125VKM2-PA, DA(-BS)/PUMY-SP125YKM2-PA, DA(-BS) TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor	Indoor air temp.								
	air temp.	15°C D.B.			20°C D.B.		25°C D.B.		27°C D.B.	
	°C D.B.	TC	PI	TC	PI	TC	PI	TC	PI	
60	-20.0	5.85	1.42	4.91	1.61	3.97	1.87	3.59	2.00	
	-17.5	6.30	1.52	5.29	1.71	4.27	2.01	3.87	2.12	
	-15.0	6.75	1.64	5.66	1.86	4.58	2.12	4.14	2.25	
	-12.5	7.20	1.74	6.04	1.99	4.88	2.24	4.42	2.40	
	-10.0	7.65	1.88	6.42	2.16	5.19	2.40	4.69	2.57	
	-7.5	8.61	2.04	7.23	2.34	5.84	2.64	5.28	2.45	
	-5.0	9.60	2.23	8.05	2.55	6.51	2.63	5.89	2.24	
	-2.5	10.58	2.45	8.88	2.76	7.17	2.39	6.49	2.03	
	0.0	11.25	2.53	9.44	2.81	7.63	2.16	6.90	1.85	
	2.5	11.25	2.29	9.44	2.54	7.63	1.93	6.90	1.68	
	5.0	11.25	2.06	9.44	2.29	7.63	1.72	6.90	1.53	
	6.0	11.25	1.98	9.44	2.20	7.63	1.62	6.90	1.46	
	7.5	11.25	1.86	9.44	2.07	7.63	1.54	6.90	1.40	
	10.0	11.25	1.69	9.44	1.87	7.63	1.43	6.90	1.32	
	12.5	11.25	1.54	9.44	1.71	7.63	1.30	6.90	1.20	
15.0	11.25	1.43	9.44	1.59	7.63	1.25	6.90	1.13		
50	-20.0	4.87	1.20	4.08	1.35	3.30	1.58	2.98	1.69	
	-17.5	5.24	1.28	4.40	1.44	3.55	1.70	3.21	1.79	
	-15.0	5.61	1.38	4.71	1.56	3.81	1.79	3.44	1.90	
	-12.5	5.99	1.47	5.02	1.67	4.06	1.89	3.67	2.02	
	-10.0	6.36	1.58	5.34	1.82	4.31	2.02	3.90	2.16	
	-7.5	7.16	1.72	6.01	1.97	4.85	2.23	4.39	2.07	
	-5.0	7.98	1.88	6.69	2.14	5.41	2.22	4.90	1.88	
	-2.5	8.80	2.07	7.38	2.32	5.96	2.01	5.40	1.71	
	0.0	9.36	2.13	7.85	2.37	6.34	1.82	5.74	1.55	
	2.5	9.36	1.93	7.85	2.14	6.34	1.63	5.74	1.41	
	5.0	9.36	1.74	7.85	1.93	6.34	1.45	5.74	1.29	
	6.0	9.36	1.67	7.85	1.85	6.34	1.36	5.74	1.23	
	7.5	9.36	1.57	7.85	1.74	6.34	1.30	5.74	1.18	
	10.0	9.36	1.42	7.85	1.58	6.34	1.20	5.74	1.11	
	12.5	9.36	1.30	7.85	1.44	6.34	1.10	5.74	1.01	
15.0	9.36	1.21	7.85	1.34	6.34	1.05	5.74	0.95		

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-SP140VKM2-PA, DA(-BS)/PUMY-SP140YKM2-PA, DA(-BS) TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	SP140							
		Indoor air temp.							
		15°C D.B.		20°C D.B.		25°C D.B.		27°C D.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC
130	-20.0	10.64	2.29	8.93	2.59	7.21	3.01	6.53	3.23
	-17.5	11.46	2.44	9.61	2.76	7.77	3.24	7.03	3.41
	-15.0	12.28	2.63	10.30	2.99	8.32	3.42	7.53	3.63
	-12.5	13.10	2.80	10.99	3.20	8.88	3.61	8.03	3.87
	-10.0	13.91	3.03	11.67	3.47	9.43	3.87	8.54	4.14
	-7.5	15.66	3.29	13.14	3.78	10.62	4.26	9.61	3.95
	-5.0	17.45	3.60	14.64	4.10	11.83	4.24	10.71	3.60
	-2.5	19.24	3.95	16.14	4.45	13.04	3.85	11.80	3.27
	0.0	20.46	4.08	17.17	4.53	13.87	3.47	12.55	2.97
	2.5	20.46	3.68	17.17	4.09	13.87	3.11	12.55	2.70
	5.0	20.46	3.32	17.17	3.69	13.87	2.78	12.55	2.46
	6.0	20.46	3.19	17.17	3.54	13.87	2.61	12.55	2.34
	7.5	20.46	3.00	17.17	3.33	13.87	2.49	12.55	2.25
	10.0	20.46	2.72	17.17	3.02	13.87	2.30	12.55	2.12
	12.5	20.46	2.49	17.17	2.76	13.87	2.10	12.55	1.94
	15.0	20.46	2.31	17.17	2.56	13.87	2.02	12.55	1.82
120	-20.0	10.51	2.40	8.82	2.71	7.13	3.15	6.45	3.37
	-17.5	11.32	2.56	9.50	2.88	7.67	3.39	6.94	3.57
	-15.0	12.13	2.75	10.17	3.13	8.22	3.58	7.44	3.79
	-12.5	12.94	2.93	10.85	3.34	8.77	3.78	7.94	4.05
	-10.0	13.75	3.17	11.53	3.63	9.32	4.05	8.43	4.33
	-7.5	15.47	3.44	12.98	3.95	10.49	4.45	9.49	4.13
	-5.0	17.24	3.76	14.46	4.29	11.69	4.43	10.58	3.76
	-2.5	19.01	4.13	15.95	4.65	12.89	4.03	11.66	3.42
	0.0	20.21	4.27	16.96	4.74	13.70	3.63	12.40	3.11
	2.5	20.21	3.85	16.96	4.28	13.70	3.25	12.40	2.82
	5.0	20.21	3.47	16.96	3.85	13.70	2.90	12.40	2.57
	6.0	20.21	3.33	16.96	3.70	13.70	2.73	12.40	2.45
	7.5	20.21	3.13	16.96	3.48	13.70	2.60	12.40	2.35
	10.0	20.21	2.84	16.96	3.15	13.70	2.40	12.40	2.22
	12.5	20.21	2.60	16.96	2.89	13.70	2.20	12.40	2.03
	15.0	20.21	2.42	16.96	2.68	13.70	2.11	12.40	1.90
110	-20.0	10.38	2.50	8.71	2.83	7.04	3.29	6.37	3.52
	-17.5	11.18	2.67	9.38	3.01	7.58	3.54	6.86	3.72
	-15.0	11.98	2.87	10.05	3.26	8.12	3.74	7.35	3.96
	-12.5	12.78	3.06	10.72	3.49	8.66	3.94	7.84	4.22
	-10.0	13.58	3.31	11.39	3.79	9.20	4.22	8.33	4.51
	-7.5	15.28	3.59	12.82	4.12	10.36	4.65	9.38	4.31
	-5.0	17.03	3.93	14.29	4.48	11.54	4.62	10.45	3.93
	-2.5	18.78	4.31	15.75	4.85	12.73	4.20	11.52	3.57
	0.0	19.97	4.45	16.75	4.94	13.54	3.79	12.25	3.24
	2.5	19.97	4.02	16.75	4.46	13.54	3.39	12.25	2.95
	5.0	19.97	3.62	16.75	4.02	13.54	3.03	12.25	2.68
	6.0	19.97	3.48	16.75	3.86	13.54	2.84	12.25	2.56
	7.5	19.97	3.27	16.75	3.63	13.54	2.71	12.25	2.46
	10.0	19.97	2.97	16.75	3.29	13.54	2.51	12.25	2.31
	12.5	19.97	2.71	16.75	3.01	13.54	2.29	12.25	2.11
	15.0	19.97	2.52	16.75	2.80	13.54	2.20	12.25	1.99

* Corrections for piping length are not taken into account. Please contact the sales company for questions. kcal/h = kW x 860, BTU/h = kW x 3,412

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

7. CAPACITY TABLES

S-Series

PUMY-SP140VKM2-PA, DA(-BS)/PUMY-SP140YKM2-PA, DA(-BS) TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	SP140							
		Indoor air temp.							
		15°C D.B.		20°C D.B.		25°C D.B.		27°C D.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC
100	-20.0	10.23	2.61	8.58	2.94	6.93	3.43	6.27	3.67
	-17.5	11.01	2.78	9.24	3.13	7.47	3.69	6.76	3.88
	-15.0	11.80	2.99	9.90	3.40	8.00	3.89	7.24	4.12
	-12.5	12.59	3.19	10.56	3.63	8.53	4.10	7.72	4.40
	-10.0	13.37	3.44	11.22	3.95	9.07	4.40	8.20	4.70
	-7.5	15.05	3.74	12.63	4.29	10.20	4.84	9.23	4.49
	-5.0	16.78	4.09	14.07	4.66	11.37	4.82	10.29	4.09
	-2.5	18.50	4.49	15.52	5.05	12.54	4.38	11.35	3.72
	0.0	19.67	4.64	16.50	5.15	13.33	3.95	12.07	3.38
	2.5	19.67	4.19	16.50	4.65	13.33	3.53	12.07	3.07
	5.0	19.67	3.77	16.50	4.19	13.33	3.16	12.07	2.80
	6.0	19.67	3.62	16.50	4.02	13.33	2.96	12.07	2.67
	7.5	19.67	3.41	16.50	3.78	13.33	2.83	12.07	2.56
	10.0	19.67	3.09	16.50	3.43	13.33	2.61	12.07	2.41
	12.5	19.67	2.83	16.50	3.14	13.33	2.39	12.07	2.20
	15.0	19.67	2.63	16.50	2.91	13.33	2.29	12.07	2.07
90	-20.0	9.77	2.31	8.19	2.62	6.62	3.04	5.99	3.26
	-17.5	10.52	2.47	8.82	2.78	7.13	3.27	6.45	3.45
	-15.0	11.27	2.66	9.45	3.02	7.64	3.46	6.91	3.66
	-12.5	12.02	2.83	10.08	3.23	8.15	3.65	7.37	3.91
	-10.0	12.77	3.06	10.71	3.51	8.66	3.91	7.83	4.18
	-7.5	14.38	3.33	12.06	3.81	9.75	4.30	8.82	3.99
	-5.0	16.02	3.63	13.44	4.14	10.86	4.28	9.83	3.64
	-2.5	17.66	3.99	14.82	4.49	11.97	3.89	10.84	3.30
	0.0	18.78	4.12	15.76	4.57	12.73	3.51	11.52	3.00
	2.5	18.78	3.72	15.76	4.13	12.73	3.14	11.52	2.73
	5.0	18.78	3.35	15.76	3.72	12.73	2.80	11.52	2.48
	6.0	18.78	3.22	15.76	3.57	12.73	2.63	11.52	2.37
	7.5	18.78	3.03	15.76	3.36	12.73	2.51	11.52	2.27
	10.0	18.78	2.74	15.76	3.05	12.73	2.32	11.52	2.14
	12.5	18.78	2.51	15.76	2.79	12.73	2.12	11.52	1.96
	15.0	18.78	2.33	15.76	2.59	12.73	2.04	11.52	1.84
80	-20.0	8.67	2.05	7.28	2.31	5.88	2.69	5.32	2.88
	-17.5	9.34	2.18	7.84	2.46	6.33	2.89	5.73	3.05
	-15.0	10.01	2.35	8.40	2.67	6.78	3.05	6.14	3.24
	-12.5	10.68	2.50	8.96	2.85	7.24	3.22	6.55	3.45
	-10.0	11.34	2.70	9.52	3.10	7.69	3.45	6.96	3.69
	-7.5	12.77	2.94	10.71	3.37	8.66	3.80	7.83	3.53
	-5.0	14.23	3.21	11.94	3.66	9.64	3.78	8.73	3.21
	-2.5	15.69	3.53	13.16	3.97	10.63	3.44	9.62	2.92
	0.0	16.68	3.64	13.99	4.04	11.31	3.10	10.23	2.65
	2.5	16.68	3.29	13.99	3.65	11.31	2.77	10.23	2.41
	5.0	16.68	2.96	13.99	3.29	11.31	2.48	10.23	2.19
	6.0	16.68	2.84	13.99	3.16	11.31	2.33	10.23	2.09
	7.5	16.68	2.67	13.99	2.97	11.31	2.22	10.23	2.01
	10.0	16.68	2.43	13.99	2.69	11.31	2.05	10.23	1.89
	12.5	16.68	2.22	13.99	2.46	11.31	1.87	10.23	1.73
	15.0	16.68	2.06	13.99	2.29	11.31	1.80	10.23	1.63
70	-20.0	7.58	1.79	6.36	2.02	5.14	2.35	4.65	2.51
	-17.5	8.17	1.90	6.85	2.15	5.54	2.53	5.01	2.66
	-15.0	8.75	2.05	7.34	2.33	5.93	2.67	5.37	2.83
	-12.5	9.33	2.19	7.83	2.49	6.33	2.81	5.72	3.01
	-10.0	9.92	2.36	8.32	2.71	6.72	3.02	6.08	3.22
	-7.5	11.16	2.57	9.36	2.94	7.57	3.32	6.85	3.08
	-5.0	12.44	2.80	10.43	3.20	8.43	3.30	7.63	2.81
	-2.5	13.71	3.08	11.50	3.46	9.30	3.00	8.41	2.55
	0.0	14.58	3.18	12.23	3.53	9.88	2.71	8.94	2.32
	2.5	14.58	2.87	12.23	3.19	9.88	2.42	8.94	2.10
	5.0	14.58	2.59	12.23	2.87	9.88	2.16	8.94	1.92
	6.0	14.58	2.48	12.23	2.76	9.88	2.03	8.94	1.83
	7.5	14.58	2.34	12.23	2.59	9.88	1.94	8.94	1.75
	10.0	14.58	2.12	12.23	2.35	9.88	1.79	8.94	1.65
	12.5	14.58	1.94	12.23	2.15	9.88	1.64	8.94	1.51
	15.0	14.58	1.80	12.23	2.00	9.88	1.57	8.94	1.42

* Corrections for piping length are not taken into account. Please contact the sales company for questions. kcal/h = kW x 860, BTU/h = kW x 3,412

7. CAPACITY TABLES

S-Series

PUMY-SP140VKM2-PA, DA(-BS)/PUMY-SP140YKM2-PA, DA(-BS) TC: Total Capacity (kW), PI: Power Input (kW)

Combination (%)	Outdoor air temp.	SP140							
		Indoor air temp.							
		15°C D.B.		20°C D.B.		25°C D.B.		27°C D.B.	
		°C D.B.	TC	PI	TC	PI	TC	PI	TC
60	-20.0	6.49	1.53	5.44	1.73	4.40	2.01	3.98	2.16
	-17.5	6.99	1.63	5.86	1.84	4.74	2.17	4.29	2.28
	-15.0	7.49	1.76	6.28	2.00	5.08	2.29	4.59	2.42
	-12.5	7.99	1.87	6.70	2.14	5.41	2.41	4.90	2.59
	-10.0	8.49	2.03	7.12	2.32	5.75	2.59	5.21	2.76
	-7.5	9.55	2.20	8.01	2.52	6.48	2.85	5.86	2.64
	-5.0	10.65	2.41	8.93	2.74	7.22	2.83	6.53	2.41
	-2.5	11.74	2.64	9.85	2.97	7.96	2.57	7.20	2.19
	0.0	12.48	2.73	10.47	3.03	8.46	2.32	7.66	1.99
	2.5	12.48	2.46	10.47	2.73	8.46	2.08	7.66	1.80
	5.0	12.48	2.22	10.47	2.46	8.46	1.85	7.66	1.64
	6.0	12.48	2.13	10.47	2.36	8.46	1.74	7.66	1.57
	7.5	12.48	2.00	10.47	2.22	8.46	1.66	7.66	1.50
	10.0	12.48	1.82	10.47	2.02	8.46	1.54	7.66	1.42
	12.5	12.48	1.66	10.47	1.85	8.46	1.40	7.66	1.29
	15.0	12.48	1.54	10.47	1.71	8.46	1.35	7.66	1.22
50	-20.0	5.40	1.28	4.53	1.45	3.66	1.69	3.31	1.81
	-17.5	5.81	1.37	4.88	1.54	3.94	1.82	3.57	1.91
	-15.0	6.23	1.48	5.22	1.67	4.22	1.92	3.82	2.03
	-12.5	6.64	1.57	5.57	1.79	4.50	2.02	4.08	2.17
	-10.0	7.06	1.70	5.92	1.95	4.78	2.17	4.33	2.32
	-7.5	7.95	1.85	6.67	2.12	5.39	2.39	4.87	2.21
	-5.0	8.85	2.02	7.43	2.30	6.00	2.37	5.43	2.02
	-2.5	9.76	2.21	8.19	2.49	6.62	2.16	5.99	1.83
	0.0	10.38	2.29	8.71	2.54	7.04	1.94	6.37	1.67
	2.5	10.38	2.06	8.71	2.29	7.04	1.74	6.37	1.51
	5.0	10.38	1.86	8.71	2.06	7.04	1.56	6.37	1.38
	6.0	10.38	1.79	8.71	1.98	7.04	1.46	6.37	1.31
	7.5	10.38	1.68	8.71	1.86	7.04	1.39	6.37	1.26
	10.0	10.38	1.52	8.71	1.69	7.04	1.29	6.37	1.19
	12.5	10.38	1.39	8.71	1.55	7.04	1.18	6.37	1.08
	15.0	10.38	1.29	8.71	1.44	7.04	1.13	6.37	1.02

* Corrections for piping length are not taken into account. Please contact the sales company for questions.

kcal/h = kW x 860, BTU/h = kW x 3,412


PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2


7-2. Correction by refrigerant piping length

CITY MULTI systems can have extended piping lengths if certain limitations are followed, but cooling/heating capacity could be reduced. Using following correction factor by equivalent piping length shown at 7-2-1 and 7-2-2, capacity can be found.

7-2-3 shows how to obtain the equivalent piping length.

7-2-1. Cooling capacity correction

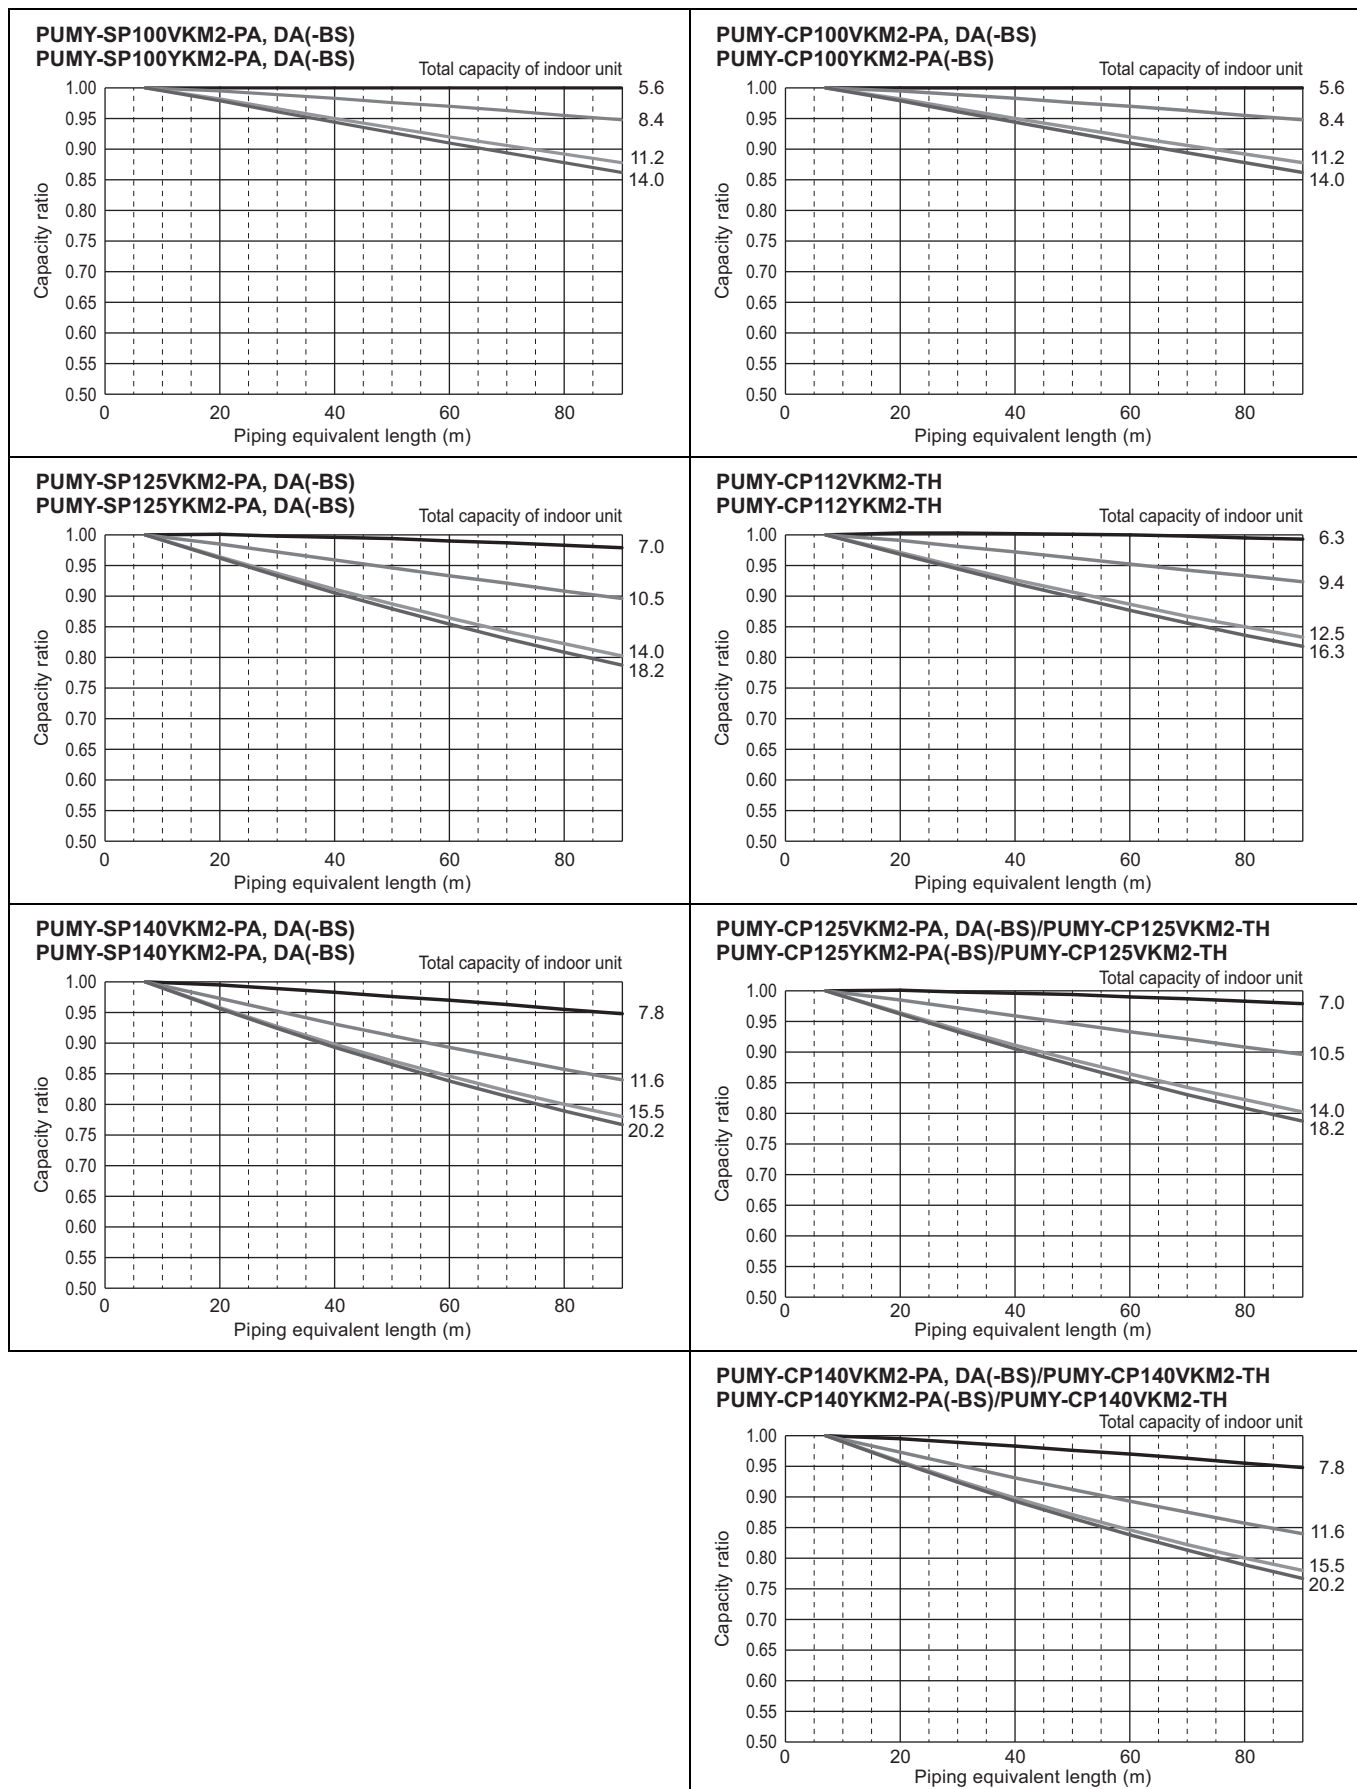

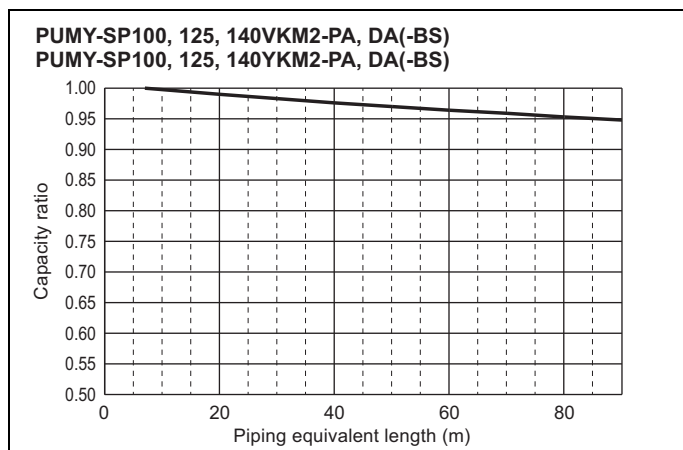7-2-2. Heating capacity correction**7-2-3. How to obtain the equivalent piping length**

Equivalent length = (Actual piping length to the farthest indoor unit) + (0.30 x number of bends on the piping) m

7-3. Correction at frost and defrost

PUMY-SP100, 125, 140V(Y)KM2

Due to frost at the outdoor heat exchanger and the automatical defrosting operation, the heating capacity of the outdoor unit should be considered by multiplying the correction factor which shown in the table below.

Table of correction factor at frosting and defrosting

Outdoor intake temperature (W.B.°C)	6	4	2	0	-2	-4	-6	-8	-10	-15	-20
Correction factor	1.0	0.98	0.89	0.88	0.89	0.90	0.95	0.95	0.95	0.95	0.95

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

8-1. JOINT

CMY-Y62-G-E


Unit: mm

1. Specification


Items	Details
Main	Number of ports
	2 ports
	Number of branch joints
Accessory	One for each liquid and gas pipe
	Pipe material
	Phosphorus deoxidized copper C1220T-OL (JIS H3300)
Insulation material	Foamed polyethylene (one for each liquid and gas pipe)
	Reducer
	10 reducers of 7 types (Refer to the external drawing for details.)

2. External drawing

For liquid pipe:


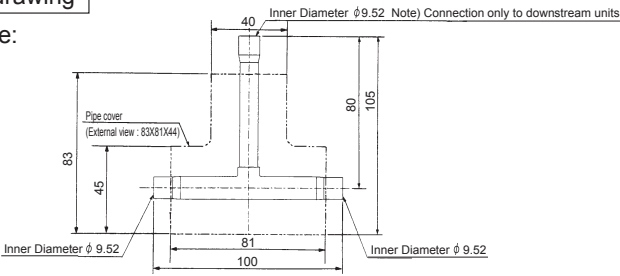


Reducer (Accessory):



A (Inner Diameter)	B (Outer Diameter)	Number of reducers
φ 12.7	φ 9.52	2
φ 19.05	φ 15.88	1
φ 22.22	φ 19.05	1

For gas pipe:

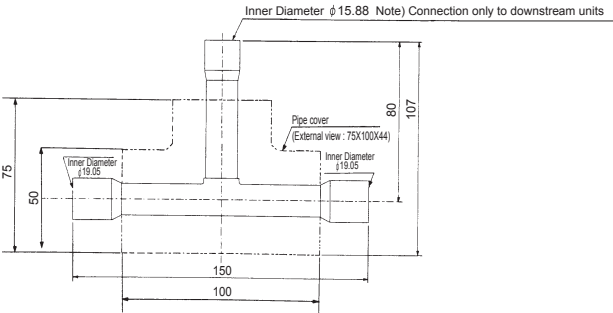

C (Inner Diameter)	D (Outer Diameter)	Number of reducers
φ 6.35	φ 9.52	2
φ 12.7	φ 15.88	1
φ 12.7	φ 19.05	1
φ 15.88	φ 19.05	2

8-2. HEADER

CMY-Y64-G-E


Unit: mm

1. Specification

Items		Details
Main	Number of ports	3 ~ 4 ports
	Number of branch joints	One for each liquid and gas pipe
	Pipe material	Phosphorus deoxidized copper C1220T-OL (JIS H3300)
Accessory	Insulation material	Foamed polyethylene
	Reducer	7 reducers of 5 types
	Cap	2 caps of 2 different types for each liquid and gas pipe 4 caps in total

2. External drawing


For liquid pipe:

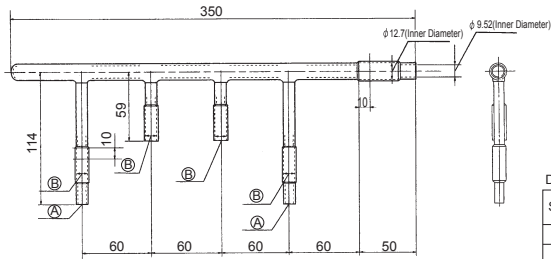

Dimension table


Symbol	Inner Diameter (mm)
(A)	φ 6.35
(B)	φ 9.52

Reducer (Accessory):




A (Inner Diameter)	B (Outer Diameter)	Number of reducers
φ 19.05	φ 15.88	1
φ 15.88	φ 12.7	2
φ 9.52	φ 6.35	2

For gas pipe:

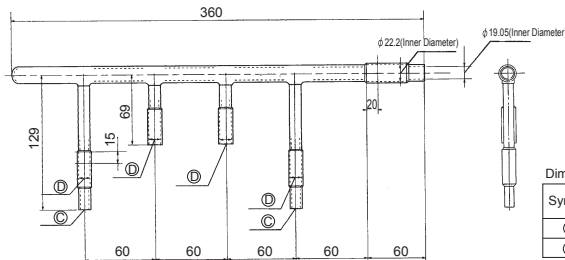

Dimension table

Symbol	Inner Diameter (mm)
(C)	φ 12.7
(D)	φ 15.88



C (Inner Diameter)	D (Outer Diameter)	Number of reducers
φ 15.88	φ 19.05	1
φ 9.52	φ 12.7	1

CMY-Y68-G-E


Unit: mm

1. Specification

Items		Details
Main	Number of ports	5 ~ 8 ports
	Number of branch joints	One for each liquid and gas pipe
	Pipe material	Phosphorus deoxidized copper C1220T-OL (JIS H3300)
Accessory	Insulation material	Foamed polyethylene
	Reducer	3 reducers of 3 types
	Cap	3 caps for each liquid and gas pipe 6 in total

2. External drawing


For liquid pipe:

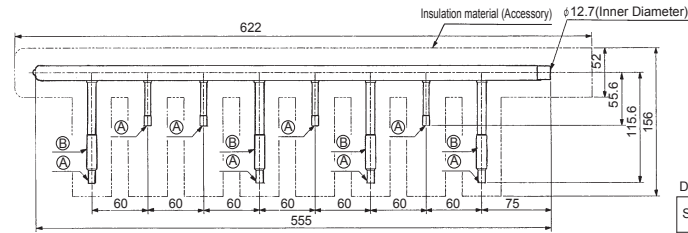

Dimension table


Symbol	Inner Diameter (mm)
(A)	φ 6.35
(B)	φ 9.52

Reducer (Accessory):




A (Inner Diameter)	B (Outer Diameter)	Number of reducers
φ 19.05	φ 15.88	1
φ 12.7	φ 9.52	1

For gas pipe:

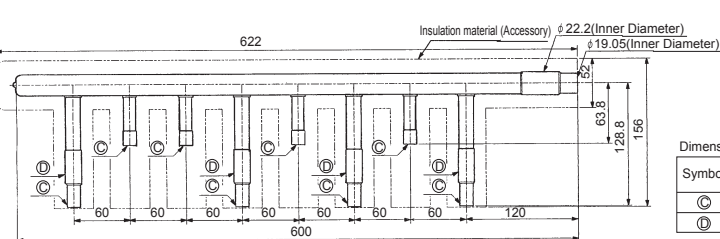

Dimension table



Symbol	Inner Diameter (mm)
(C)	φ 12.7
(D)	φ 15.88



C (Inner Diameter)	D (Outer Diameter)	Number of reducers
φ 15.88	φ 19.05	1

9-1. General cautions

- ① Follow ordinance of your governmental organization for technical standard related to electrical equipment, wiring regulations, and guidance of each electric power company.
- ② Wiring for control (hereinafter referred to as transmission cable) shall be (50mm[1-5/8in.] or more) apart from power source wiring so that it is not influenced by electric noise from power source wiring. (Do not insert transmission cable and power source wire in the same conduit.)
- ③ Be sure to provide designated grounding work to outdoor unit.
- ④ Give some allowance to wiring for electrical part box of indoor and outdoor units, because the box is sometimes removed at the time of service work.
- ⑤ Never connect 380~415V(220~240V) power source to terminal block of transmission cable. If connected, electrical parts will be damaged.
- ⑥ Use 2-core shield cable for transmission cable. If transmission cables of different systems are wired with the same multiple-core cable, the resultant poor transmitting and receiving will cause erroneous operations.
- ⑦ When extending the transmission line, make sure to extend the shield cable as well.

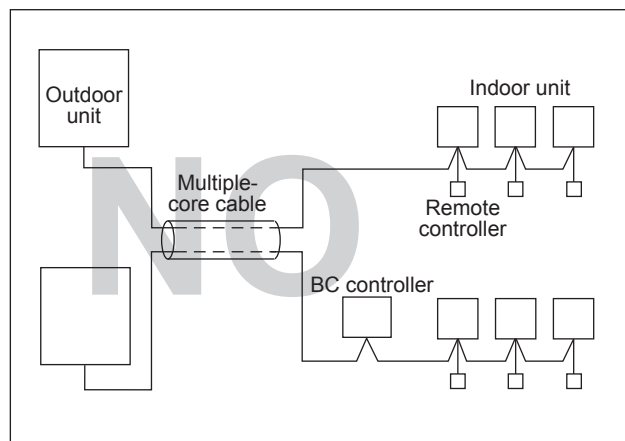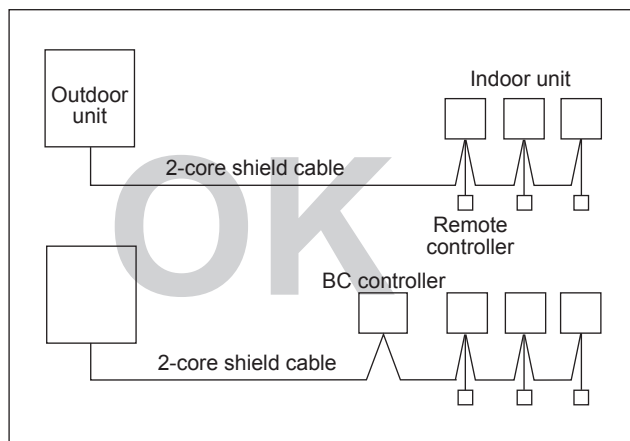

9-2. Power supply for Outdoor unit

9-2-1. Electrical characteristics of Outdoor unit at cooling mode

Symbols: MCA (Max Circuit Amps = 1.25 x Temperature correction x RLA)
RLA (Rated Load Amps), SC (Starting Current)

PUMY-SP-YKM2	Units			Power supply	Compressor		FAN	RLA (A)
	Hz	Volts	Voltage range	MCA (A)	Output (kW)	SC (A)	Output (kW)	
PUMY-SP100YKM2-PA, DA(-BS)	50	380	Max.: 457V Min.: 342V	13	2.70	7	0.20	4.45/4.22/4.07
PUMY-SP125YKM2-PA, DA(-BS)		400			3.50			6.14/5.83/5.62
PUMY-SP140YKM2-PA, DA(-BS)		415			3.70			6.89/6.55/6.31

PUMY-SP-YKM2	Units			Power supply	Compressor		FAN	RLA (A)
	Hz	Volts	Voltage range	MCA (A)	Output (kW)	SC (A)	Output (kW)	
PUMY-SP100YKM2-PA, DA(-BS)	60	380	Max.: 418V Min.: 342V	13	2.70	7	0.20	4.45
PUMY-SP125YKM2-PA, DA(-BS)					3.50			6.14
PUMY-SP140YKM2-PA, DA(-BS)					3.70			6.89

PUMY-SP-VKM2	Units			Power supply	Compressor		FAN	RLA (A)
	Hz	Volts	Voltage range	MCA (A)	Output (kW)	SC (A)	Output (kW)	
PUMY-SP100VKM2-PA, DA(-BS)	50	220	Max.: 264V Min.: 198V	30.5	2.77	7	0.20	12.89/12.33/11.82
PUMY-SP125VKM2-PA, DA(-BS)		230			3.42			17.81/17.04/16.33
PUMY-SP140VKM2-PA, DA(-BS)		240			3.58			19.99/19.12/18.32

PUMY-SP-VKM2	Units			Power supply	Compressor		FAN	RLA (A)
	Hz	Volts	Voltage range	MCA (A)	Output (kW)	SC (A)	Output (kW)	
PUMY-SP100VKM2-PA, DA(-BS)	60	220	Max.: 242V Min.: 198V	30.5	2.77	7	0.20	12.89
PUMY-SP125VKM2-PA, DA(-BS)					3.42			17.81
PUMY-SP140VKM2-PA, DA(-BS)					3.58			19.99

PUMY-CP-YKM2	Units			Power supply	Compressor		FAN	RLA (A)
	Hz	Volts	Voltage range	MCA (A)	Output (kW)	SC (A)	Output (kW)	
PUMY-CP100YKM2-PA(-BS)	50	380	Max.: 457V Min.: 342V	13	2.7	7	0.20	4.48/4.25/4.10
PUMY-CP125YKM2-PA(-BS)		400			3.5			6.14/5.83/5.62
PUMY-CP140YKM2-PA(-BS)		415			3.7			7.52/7.14/6.88

PUMY-CP-YKM2	Units			Power supply	Compressor		FAN	RLA (A)
	Hz	Volts	Voltage range	MCA (A)	Output (kW)	SC (A)	Output (kW)	
PUMY-CP100YKM2-PA(-BS)	60	380	Max.: 418V Min.: 342V	13	2.7	7	0.20	4.48
PUMY-CP125YKM2-PA(-BS)					3.5			6.14
PUMY-CP140YKM2-PA(-BS)					3.7			7.52

PUMY-CP-VKM2	Units			Power supply	Compressor		FAN	RLA (A)
	Hz	Volts	Voltage range	MCA (A)	Output (kW)	SC (A)	Output (kW)	
PUMY-CP100VKM2-PA, DA(-BS)	50	220	Max.: 264V Min.: 198V	30.5	2.7	7	0.20	12.99/12.42/11.90
PUMY-CP125VKM2-PA, DA(-BS)		230			3.5			17.81/17.04/16.33
PUMY-CP140VKM2-PA, DA(-BS)		240			3.7			21.80/20.85/19.98

PUMY-CP-VKM2	Units			Power supply	Compressor		FAN	RLA (A)
	Hz	Volts	Voltage range	MCA (A)	Output (kW)	SC (A)	Output (kW)	
PUMY-CP100VKM2-PA, DA(-BS)	60	220	Max.: 242V Min.: 198V	30.5	2.7	7	0.20	12.99
PUMY-CP125VKM2-PA, DA(-BS)					3.5			17.81
PUMY-CP140VKM2-PA, DA(-BS)					3.7			21.80

PUMY-CP-VKM2	Units			Power supply	Compressor		FAN	RLA (A)
	Hz	Volts	Voltage range	MCA (A)	Output (kW)	SC (A)	Output (kW)	
PUMY-CP112YKM2-TH	50	380	Max.: 418V Min.: 342V	13	2.7	7	0.20	4.96
PUMY-CP125YKM2-TH					3.5			6.14
PUMY-CP140YKM2-TH					3.7			7.52

PUMY-CP-VKM2	Units			Power supply	Compressor		FAN	RLA (A)
	Hz	Volts	Voltage range	MCA (A)	Output (kW)	SC (A)	Output (kW)	
PUMY-CP112VKM2-TH	50	220	Max.: 242V Min.: 198V	30.5	2.7	7	0.20	14.38
PUMY-CP125VKM2-TH					3.5			17.81
PUMY-CP140VKM2-TH					3.7			21.80

9-3. Power cable specifications

PUMY-SP100, 125, 140VKM2-PA, DA(-BS)

PUMY-SP100, 125, 140YKM2-PA, DA(-BS)

Thickness of Wire for Main Power Supply and On/Off Capacities

Model	Power supply	Minimum Wire Thickness (mm ²)			Breaker for Wiring *1	Breaker for Current Leakage
			Main Cable	Ground		
Outdoor unit	~ /N 220-230-240 V 50 Hz ~ /N 220 V 60 Hz	When power is supplied separately	6.0	6.0	32 A	32 A 30 mA 0.1 sec. or less
		When power is supplied from the outdoor unit	6.0	6.0	40 A	40 A 30 mA 0.1 sec. or less
	3N~ 380-400-415 V 50 Hz 3N~ 380 V 60 Hz *2	When power is supplied separately	2.5	2.5	16 A	16 A 30 mA 0.1 sec. or less
		When power is supplied from the outdoor unit	4.0	4.0	25 A	25 A 30 mA 0.1 sec. or less

*1 A breaker with at least 3.0 mm contact separation in each poles shall be provided. Use non-fuse breaker (NF) or earth leakage breaker (NV).

*2 In multi-phase appliances, the colour of the neutral conductor of the supply cord, if any, shall be blue.

<Indoor units> *When power is supplied to indoor unit and outdoor unit separately

Total operating current of the indoor unit	Minimum wire thickness (mm ²)			Ground-fault interrupter *1	Local switch (A)		Breaker for wiring (NFB)
	Main Cable	Branch	Ground		Capacity	Fuse	
F0 = 16A or less *2	1.5	1.5	1.5	20 A current sensitivity *3	16	16	20
F0 = 25A or less *2	2.5	2.5	2.5	30 A current sensitivity *3	25	25	30
F0 = 32A or less *2	4.0	4.0	4.0	40 A current sensitivity *3	32	32	40

Apply to IEC61000-3-3 about max. permissive system impedance.

*1 The Ground-fault interrupter should support inverter circuit.

The Ground-fault interrupter should combine using of local switch or wiring breaker.

*2 Please take the larger of F1 or F2 as the value for F0.

F1 = Total operating maximum current of the indoor units × 1.2

F2 = {V1 × (Quantity of Type1)/C} + {V1 × (Quantity of Type2)/C} + {V1 × (Quantity of Type3)/C} + ... + {V1 × (Quantity of Type16)/C}

Connect to Branch box (PAC-MK·BC)

Indoor unit		V1	V2
Type 1	PEAD-RP·JA(L)Q	26.9	2.4
Type 2	SEZ-KD·VA(L), PLA-RP·BA	19.8	
Type 3	MLZ-KA·VA-E4	9.9	
Type 4	MSXZ-MP·VA	7.4	
Type 5	MSZ-FH·VE2, MSZ-EF·VE, MSZ-GE·VA, MSZ-FH·VA, MSXZ-FP·VA	6.8	
Type 6	SLZ-KA·VA(L)	3.5	
Type 7	Branch box (PAC-MK·BC)	5.1	3.0

Connect to Connection kit (PAC-LV11M)

Indoor unit		V1	V2
Type 8	MSZ-EF·VE, MSZ-FH·VE, MSZ-GE·VA, MSZ-FH·VA	6.8	2.4
Type 9	Connection kit (PAC-LV11M)	3.5	

Indoor unit		V1	V2
Type 10	PMFY-P·VBM-E, PLFY-P·VBM-E, PLFY-P·VFM-E, PEFY-P·VMS1(L)-E, PCFY-P·VKM-E, PKFY-P·VHM-E, PKFY-P·VKM-E, PFFY-P·VKM-E2, PFFY-P·VLRMM-E, PKFY-P·VLM-E/DA	19.8	2.4
Type 11	PLFY-P·VCM-E2	9.9	
Type 12	PKFY-P·VBM-E	3.5	
Type 13	PEFY-P·VMA(L)-E	38	
Type 14	PLFY-P·VLMD-E, PEFY-P·VMH(S)-E, PEFY-P·VMR-E-L/R, PEFY-P·VMH-E-F, PFFY-P·VLEM-E, GUF-RD(H)4, PFFY-P·VLRM-E	0	0
Type 15	PEFY-P·VMA(L)-E4, PEFY-P·VMA4-E	18.6	3
Type 16	PLFY-P·VEM-PA/DA, PMFY-P·VFM-PA/DA	17.1	2.4

C : Multiple of tripping current at tripping time 0.01s

Please pick up "C" from the tripping characteristic of the breaker.

<Example of "F2" calculation>

*Condition PEFY-P·VMS1-E × 4 + PEFY-P·VMA-E × 1, C = 8 (refer to right sample chart)

$$F2 = 19.8 \times 4/8 + 38 \times 1/8 \\ = 14.65$$

*3 Current sensitivity is calculated using the following formula.

$$G1 = V2 \times (\text{Quantity of Type 1}) + V2 \times (\text{Quantity of Type 2}) + \dots + V2 \times (\text{Quantity of Type 16}) + V3 \times (\text{Wire length [km]})$$

1. Bear in mind ambient conditions (ambient temperature, direct sunlight, rain water, etc.) when proceeding with the wiring and connections.


2. The wire size is the minimum value for metal conduit wiring. The power cord size should be 1 rank thicker consideration of voltage drops. Make sure the power-supply voltage does not drop more than 10%.

3. Specific wiring requirements should adhere to the wiring regulations of the region.

4. Power supply cords of parts of appliances for outdoor use shall not be lighter than polychloroprene sheathed flexible cord (design 60245 IEC57). For example, use wiring such as YZW.

5. Install an earth line longer than power cables.

Sample chart

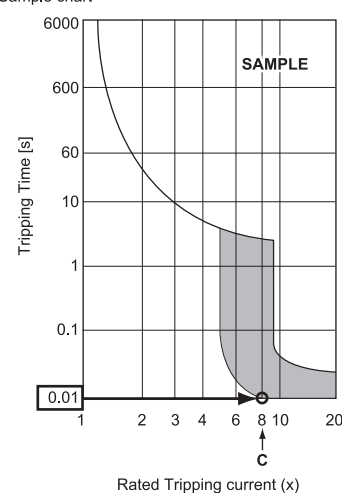

G1	Current sensitivity
30 or less	30 mA 0.1 sec or less
100 or less	100 mA 0.1 sec or less

Wire thickness	V3
1.5 mm ²	48
2.5 mm ²	56
4.0 mm ²	66

PUMY-CP100, 112, 125, 140VKM2-PA, DA(-BS), -TH

PUMY-CP100, 112, 125, 140YKM2-PA(-BS), -TH

Thickness of Wire for Main Power Supply and On/Off Capacities

Model	Power supply	Minimum Wire Thickness (mm ²)			Breaker for Wiring *1	Breaker for Current Leakage
			Main Cable	Ground		
Outdoor unit	~ /N 220-230-240 V, 50 Hz ~ /N 220 V, 60 Hz	When power is supplied separately	6.0	6.0	32 A	32 A 30 mA 0.1 sec. or less
		When power is supplied from the outdoor unit	6.0	6.0	40 A	40 A 30 mA 0.1 sec. or less
	3N~ 380-400-415 V, 50 Hz 3N~ 380 V, 60 Hz *2	When power is supplied separately	2.5	2.5	16 A	16 A 30 mA 0.1 sec. or less
		When power is supplied from the outdoor unit	4.0	4.0	25 A	25 A 30 mA 0.1 sec. or less

*1 A breaker with at least 3.0 mm contact separation in each pole shall be provided. Use non-fuse breaker (NF) or earth leakage breaker (NV).

*2 In multi-phase appliances, the color of the neutral conductor of the supply cord, if any, shall be blue.

<Indoor units> *When power is supplied to indoor unit and outdoor unit separately

Total operating current of the indoor unit	Minimum wire thickness (mm ²)			Ground-fault interrupter *1	Local switch (A)		Breaker for wiring (NFB)
	Main Cable	Branch	Ground		Capacity	Fuse	
F0 = 16A or less *2	1.5	1.5	1.5	20 A current sensitivity *3	16	16	20
F0 = 25A or less *2	2.5	2.5	2.5	30 A current sensitivity *3	25	25	30
F0 = 32A or less *2	4.0	4.0	4.0	40 A current sensitivity *3	32	32	40

Apply to IEC61000-3-3 about max. permissive system impedance.

*1 The Ground-fault interrupter should support inverter circuit.

The Ground-fault interrupter should combine using of local switch or wiring breaker.

*2 Please take the larger of F1 or F2 as the value for F0.

F1 = Total operating maximum current of the indoor units × 1.2

F2 = {V1 × (Quantity of Type1)/C} + {V1 × (Quantity of Type2)/C} + {V1 × (Quantity of Type3)/C} + ... + {V1 × (Quantity of Type16)/C}

Connect to Branch box (PAC-MK·BC)

Indoor unit		V1	V2
Type 1	PEY-P·JA-TH, PEY-SP·JA2, PEAD-RP·JA(L)Q	26.9	2.4
Type 2	PLY-P·BA-TH, PLY-SP·EA, PCY-P·KA-TH, PCY-SP·KA(L)2, SEZ-KD·VA-R1.TH, SEZ-KD·VA-R2.TH, SEZ-KD·VAL-R1.TH, SEZ-KD·VA(Q)L-R2.TH, PLA-RP·BA-R2	19.8	
Type 3	MLZ-KA·VA-E4	9.9	
Type 4	MSXY-MP·VA, MSZ-LN·VF-NE1, MSXY-JS·VF	7.4	
Type 5	MSY-GE·VA-R1, MSY-GE·VA-R2, MSY-GE·VA-R3, MSY-EF·VA-R1, MSZ-FH·VA-N1, MSZ-GE·VA-E1, MSZ-FH·VE2-E1, MSZ-EF·VE-E1, MSXZ-FP·VA	6.8	
Type 6	MSZ-GC·NA-C1, MSZ-GC·VA-C2	4.3	
Type 7	SLZ-KA·VA-R2.TH, SLZ-KA·VAL-R2.TH	3.5	
Type 8	MSXY-JS·VF	6.1	2.4
Type 9	Branch box (PAC-MK·BC)	5.1	3.0

Connect to Connection kit (PAC-LV11M-J)

Indoor unit		V1	V2
Type 10	MSY-GE·VA, MSY-GH·VA, MSZ-GE·VA, MSZ-EF·VE, MSZ-FH·VE	6.8	2.4
Type 11	MSZ-LN·VF-NE1	7.4	
Type 12	Connection kit (PAC-LV11M-J)	3.5	

Indoor unit		V1	V2
Type 13	PEFY-P·VMA(L)-E	38.0	1.6
Type 14	PEFY-P·VMHS-E-F, PEFY-P·VMHS-E	26.8	
Type 15	PMFY-P·VBM-E, PLFY-P·VBM-E, PLFY-P·VFM-E, PEFY-P·VMS1(L)-E, PCFY-P·VKM-E, PKFY-P·VHM-E, PKFY-P·VKM-E, PFFY-P·VCM-E, PFFY-P·VKM-E2, PFFY-P·VLRMM-E, PKFY-P·VLM-E/DA	19.8	2.4
Type 16	PLFY-P·VCM-E2	9.9	
Type 17	PKFY-P·VBM-E	3.5	
Type 18	PLFY-P·VLMD-E, PEFY-P·VMH-E, PEFY-P·VMR-E-L/R, PEFY-P·VMH-E-F, PFFY-P·VLEM-E, PFFY-P·VLRM-E, GUF-RD(H)4	0	0
Type 19	PLFY-P·VEM-PA/DA, PMFY-P·VFM-PA/DA	17.1	2.4
Type 20	PEFY-P·VMA(L)-E4, PEFY-P·VMA4-E	18.6	3

C : Multiple of tripping current at tripping time 0.01s

Please pick up "C" from the tripping characteristic of the breaker.

<Example of "F2" calculation>

*Condition PEFY-P·VMS1-E × 4 + PEFY-P·VMA-E × 1, C = 8 (refer to right sample chart)

F2 = 19.8 × 4/8 + 38 × 1/8

= 14.65

*3 Current sensitivity is calculated using the following formula.

G1 = V2 × (Quantity of Type 1) + V2 × (Quantity of Type 2) + ... + V2 × (Quantity of Type 16) + V3 × (Wire length [km])


1. Bear in mind ambient conditions (ambient temperature, direct sunlight, rain water, etc.) when proceeding with the wiring and connections.

2. The wire size is the minimum value for metal conduit wiring. The power cord size should be 1 rank thicker consideration of voltage drops. Make sure the power-supply voltage does not drop more than 10%.

3. Specific wiring requirements should adhere to the wiring regulations of the region.

4. Power supply cords of parts of appliances for outdoor use shall not be lighter than polychloroprene sheathed flexible cord (design 60245 IEC57). For example, use wiring such as YZW.

5. Install an earth line longer than power cables.

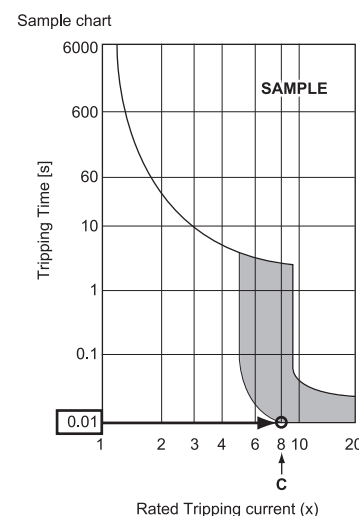

G1	Current sensitivity
30 or less	30 mA 0.1 sec or less
100 or less	100 mA 0.1 sec or less

Wire thickness	V3
1.5 mm ²	48
2.5 mm ²	56
4.0 mm ²	66


9-4. Power supply examples

The local standards and/or regulations is applicable at a higher priority.

9-4-1. PUMY-SP100, 125, 140YKM2-PA, DA(-BS) PUMY-CP100, 112, 125, 140YKM2-PA(-BS), -TH

PUMY-SP-YKM2, YKM2, PUMY-CP-YKM2, YKM2

1. The transmission cable is non-polarity two wires.
2. Symbol Ⓢ means a screw terminal.
3. Earth of transmission cable shall be grounded on the earth terminal (Ⓢ) of only variable capacity unit.
And shield of transmission cable between each indoor units shall be connected to shield terminal (S) of each indoor units or connected themselves.
4. Power supply to indoor unit varies on series or models.
5. The number of indoor units which can be connected to a switch is the number applying when the total operating current of the indoor units is less than 16A.

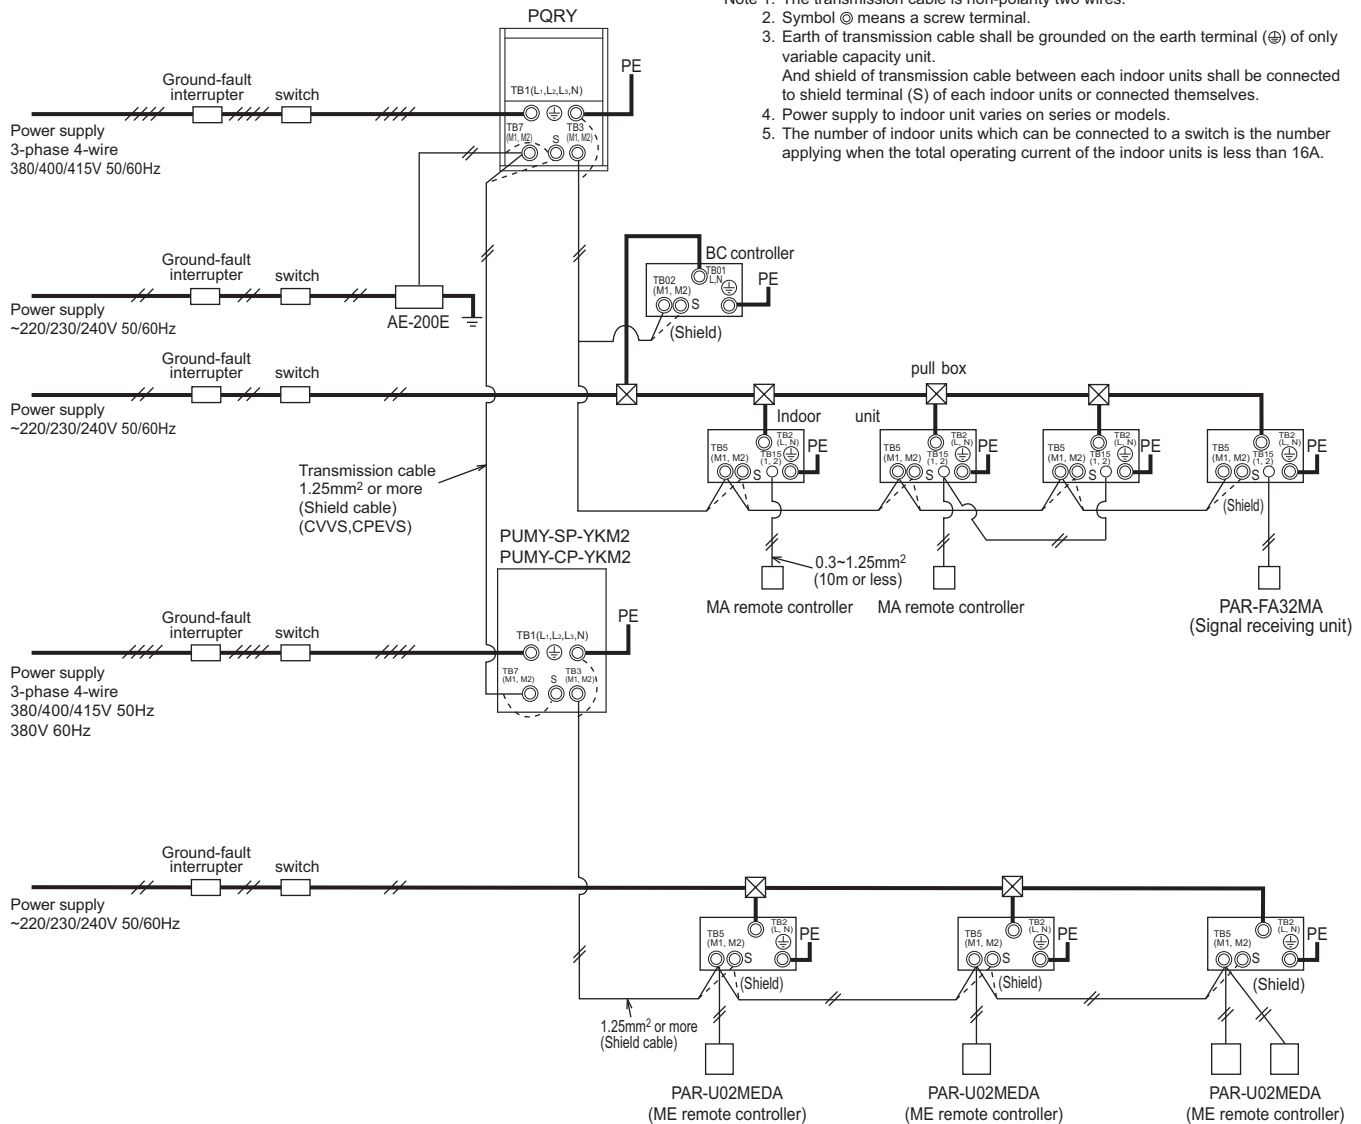


10-1. Transmission cable length limitation

10-1-1. Using MA Remote controller

Long transmission cable causes voltage down, therefore, the length limitation should be obeyed to secure proper transmission.

Max. length via Outdoor (M-NET cable)	$L1+L2+L3$, $L1+L2+L4+L5$, $L3+L4+L5$	$\leq 500\text{m}[1640\text{ft}]$	1.25mm^2 [AWG16] or thicker
Max. length to Outdoor (M-NET cable)	$L1$, $L3$, $L2+L4$, $L5$	$\leq 200\text{m}[656\text{ft}]$	1.25mm^2 [AWG16] or thicker
Max. length from MA to Indoor for each group	$a1+a2$, $a1+a2+a3+a4$	$\leq 200\text{m}[656\text{ft}]$	$0.3\text{-}1.25\text{mm}^2$ [AWG22-16]
24VDC to AG-150A	n	$\leq 50\text{m}[164\text{ft.}]$	$0.75\text{-}2.0\text{mm}^2$ [AWG18-14]

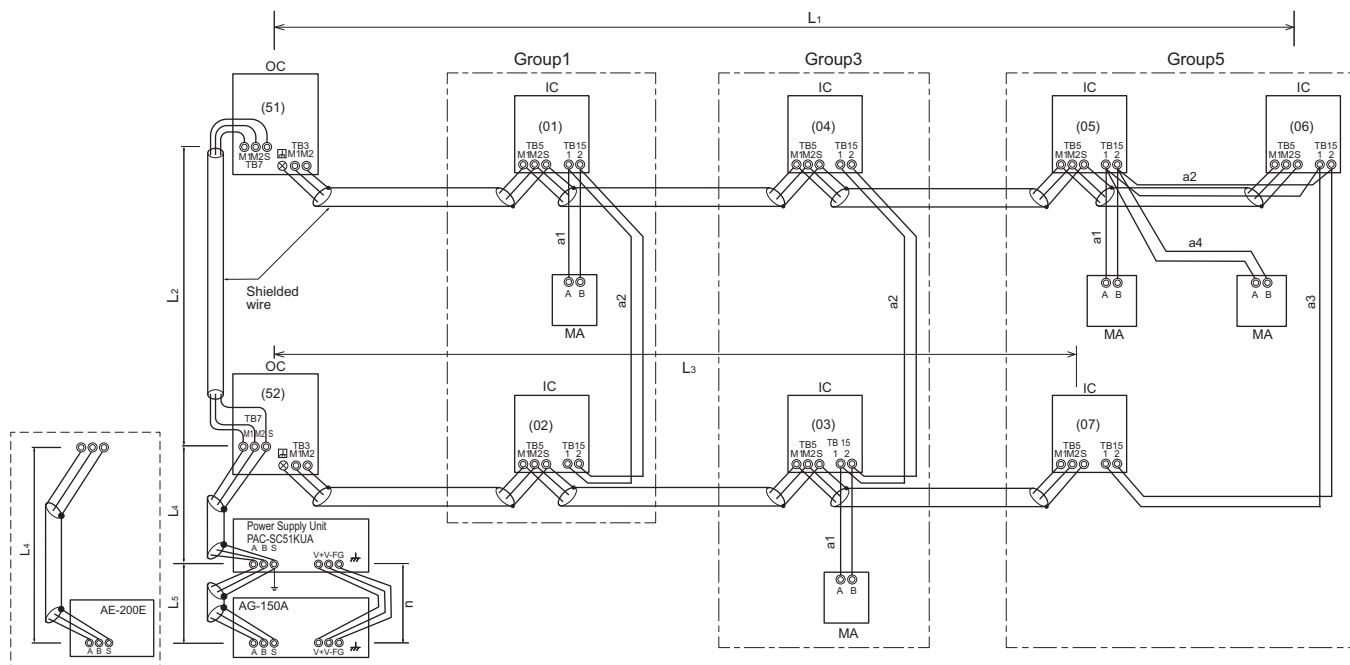


OC: Outdoor unit; IC: Indoor unit; MA: MA remote controller

10-1-2. Using ME Remote controller

Long transmission cable causes voltage down, therefore, the length limitation should be obeyed to secure proper transmission.

Max. length via Outdoor (M-NET cable)	$L1+L2+L3+L4$, $L1+L2+L6+L7$, $L1+L2+L3+L5$, $L3+L4+L6+L7$, $L3+L5+L6+L7$, $L4+L5$	$\leq 500\text{m}[1640\text{ft}]$	1.25mm^2 [AWG16] or thicker
Max. length to Outdoor (M-NET cable)	$L1$, $L3+L4$, $L2+L6$, $L7$, $L3+L5$	$\leq 200\text{m}[656\text{ft}]$	1.25mm^2 [AWG16] or thicker
Max. length from ME to Indoor	$e1$, $e2$, $e3$, $e4$	$\leq 10\text{m}[32\text{ft}] *1$	$0.3\text{-}1.25\text{mm}^2$ [AWG22-16] *1
24VDC to AG-150A	n	$\leq 50\text{m}[164\text{ft.}]$	$0.75\text{-}2.0\text{mm}^2$ [AWG18-14]

*1. If the length from ME to Indoor exceed 10m, use 1.25mm^2 [AWG16] shielded cable, but the total length should be counted into Max. length via Outdoor.

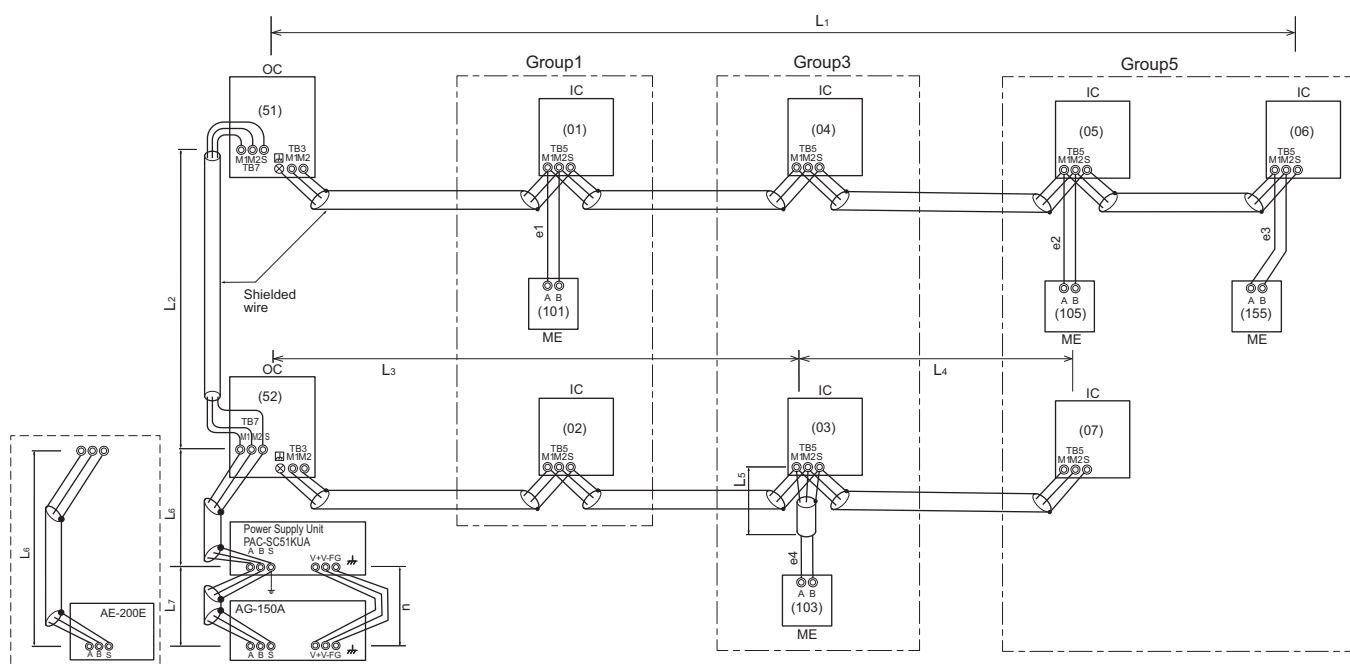

OC: Outdoor unit; IC: Indoor unit; ME: ME remote controller

10-2. Transmission cable specifications

	Transmission cables (Li)	ME Remote controller cables	MA Remote controller cables
Type of cable	Shielded cables (2-core) CVVS, CPEVS, and MVVS	Shielded cables (2-core) CVVS, CPEVS, and MVVS	VCTF, VCTFK, CVV, VVR, VVF, VCT
Cable size	Larger than 1.25 mm ² [AWG16], or ø1.2 mm or above	0.3 to 1.25 mm ² [AWG22 to 16] *1	0.3 to 1.25 mm ² [AWG22 to 16] *1*4
Maximum overall line length	Refer to 10-1.	10 m [32 ft] *2	200 m [656 f t] *3

*1 The use of cables that are smaller than 0.75 mm² (AWG18) is recommended for easy handling.

*2 The section of the cable that exceeds 10 m [32 ft] must be included in the maximum indoor-outdoor transmission line distance.

*3 70 m [229 ft] max for PAR-CT01MA

*4 To wire PAR-CT01MA, PAR-4XMAA, PAR-3XMAA ("X" represents 0 or later), and Simple MA controller, use a wire with a diameter of 0.3 mm² [AWG22].

CVVS, MVVS: PVC insulated PVC sheathed shielded control cable
CPEVS: PE insulated PVC sheathed shielded communication cable
CVV: PVC insulated PVC sheathed control cable

PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

10-3. System configuration restrictions

10-3-1. Common restrictions for the CITY MULTI system

For each Outdoor/Heat source unit, the maximum connectable quantity of Indoor unit is specified at its Specifications table.

- A) 1 Group of Indoor units can have 1-16 Indoor units;
*OA processing unit GUF-RD(H) is considered as Indoor unit.
- B) Maximum 2 remote controllers for 1 group;
*MA/ME remote controllers cannot be present together in 1group.
*When a PAR-CT01MA or PAR-4XMAA ("X" represents 0 or later) is connected to a group, no other MA remote controllers can be connected to the same group.
- C) 1 Lossnay unit can interlock maximum 16 Indoor units; 1 Indoor unit can interlock only 1 Lossnay unit.
- D) Maximum 3 System controllers are connectable when connecting to TB3 of the Outdoor/Heat source unit.
- E) A maximum of 6 system controller are connectable to TB3 and TB7 of Outdoor/Heat source unit.
- F) 4 System controllers or more are connectable when connecting to TB7 of the Outdoor/Heat source unit, if the transmission power is supplied by the power supply unit PAC-SC51KUA.
*System controller connected as described in D) would have a risk that the failure of connected Outdoor/Heat source unit would stop power supply to the System controller.

10-3-2. Ensuring proper communication power and the number of connected units for M-NET

In order to ensure proper communication among Outdoor/Heat source unit, Indoor unit, Lossnay, OA processing unit GUF-RD(H), and Controllers, the transmission power situation for the M-NET should be observed. In some cases, Transmission booster should be used. Taking the power consumption of Indoor unit as 1, the equivalent power consumption or supply of others are listed at Table 1 and Table 2.

Both the transmission line for centralized controller and indoor-outdoor transmission line must meet the conditions listed below. (Both conditions a) and b) must be met.)

a) [Total equivalent power consumption] ≤ [The equivalent power supply]

b) [Total equivalent number of units (Table 1)] ≤ [40]

Table 1 The equivalent power consumption and the equivalent number of units

Category	Model	The equivalent power consumption	The equivalent number of units
CITY MULTI indoor unit OA unit CITY MULTI connection kit Air handling unit controller	Except for the models indicated by *2 PEFY-AF2500, 3000, 4000, 5000, 6000MH GUF-50, 100 PAC-LV11M-J PAC-AH125, 140, 250, 500M-J	1	1
CITY MULTI indoor unit *2	PDFY-P100VM-E-RE	2	2
BC controller	CMB-P/M	2	1
HBC	CMB-WP CMB-WM-V-AA/AB	2	1
	CMB-WM-F-AA CMB-WM-V-BB	2	2
Hydro unit	CMH-WM-V-A	2	1
PWFY *1	P100VM-E-BU	6	1
	P200VM-E1-AU P200VM-E2-AU	5	1
	(E)P100VM-E1-AU (E)P100VM-E2-AU P140VM-E1-AU P140VM-E2-AU	1	1
PFAV	P250, 300, 500, 600VM-E(-F)	1	1
	P750, 900VM-E(-F)	2	2
PFV, PEV	P200, 250, 400, 500YM-A	1	1
MA remote controller/Lossnay	PAR-CT01MA PAR-21, 31, 32, 33, 40, 41MA PAC-YT52CRA PAR-FA32MA LGH PZ-60, 61, 62DR-E PZ-43SMF-E	0	0
ME remote controller	PAR-U02MEDA	0.5	1
	PZ-52SF	0.25	1
System controller	AE-200E/AE-50E/EW-50E LM-AP	0	0
	AG-150A EB-50GU-J PAC-IF01AHC-J	0.5	1
	AT-50B	1.5	5
	PAC-YG60MCA PAC-YG66DCA PAC-YG63MCA	0.25	1
ON/OFF controller	PAC-YT40ANRA	1	1
MN converter	CMS-MNG-E	2	1
Outdoor/Heat source unit	TB7 power consumption	0	0
System control interface	MAC-333IF-E	0	0
A-M converter	PAC-SF83MA-E		

*1 PWFY cannot be connected to PUMY model.

Table 2 The equivalent power supply

Category	Model	The equivalent power supply		
Transmission Booster	PAC-SF46EPA-G	25 *1		
Power supply unit	PAC-SC51KUA	5		
Expansion controller	PAC-YG50ECA	6		
BM ADAPTER	BAC-HD150	6		
System controller	AE-200E/AE-50E	0.75		
	EW-50E	1.5		
	LM-AP	0		
Outdoor/Heat source unit		TB3 and TB7 total	TB7 only	TB3 only
	Outdoor unit except S-Series and TKA *2	32 *1	6	32 *1-equivalent power supplied to TB7
	S-Series outdoor unit	12 *1	0	12 *1
	S-Series outdoor unit (YBM)	32 *1	0	32 *1
	TKA outdoor unit	32 *1	- *3	32 *1

*1 When one or more indoor units listed below is connected, subtract 3 from the equivalent power supply.

Table 3

Category	Model
Indoor unit	Sized P200/P250
	PEFY-AF4000/5000/6000MH, PFFY-P400/500YM-E, PFFY-P400/500YMH-C
	PFFY-P300/600YM-E-F, PFFY-P300/600YM-C-F, PDFY-P100VM-E-RE
Air handling unit controller	PAC-AH250/500M-J
PFAV	PFAV-P500/600/750/900VM-E(-F)
PFV	PFV-P400/500YM-A
PEV	PEV-P400/500YM-A

*2 If PAC-SC51KUA is used to supply power at TB7 side, no power supply need from Outdoor/Heat source unit at TB7, Connector TB3 itself will therefore have 32.

*3 Do not supply power to TB7 from TKA outdoor units.

Use PAC-SC51KUA or PAC-SF46EPA-G when connecting an M-NET device to TB7.


With the equivalent power consumption values and the equivalent number of units in Table 1 and Table 2, PAC-SF46EPA-G can be designed into the air-conditioner system to ensure proper system communication according to (A), (B), (C).

- Firstly, count from TB3 at TB3 side the total equivalent number of units of Indoor units, OA processing units, ME remote controller, and System controllers. If the total equivalent number of units reaches 40, a PAC-SF46EPA-G should be set.
- Secondly, count from TB7 side to TB3 side the total transmission power consumption. If the total equivalent power supply reaches 32, a PAC-SF46EPA-G should be set. Yet, if a PAC-SC51KUA or another controller with a built-in power supply, such as PAC-YG50ECA, is used to supply power at TB7 side, count from TB3 side only.
- Thirdly, count from TB7 at TB7 side the total transmission power consumption, If the total equivalent power supply for only TB7 reaches 6, a PAC-SF46EPA-G should be set. Also, count from TB7 at TB7 side the total equivalent number of units of System controllers, and so on. If the total equivalent number of units reaches 40, a PAC-SF46EPA-G should be set.

* The equivalent power supply of S-Series outdoor unit is 12.

* When one or more indoor units listed in Table 3 is connected, subtract 3 from the equivalent power supply.

■ System example

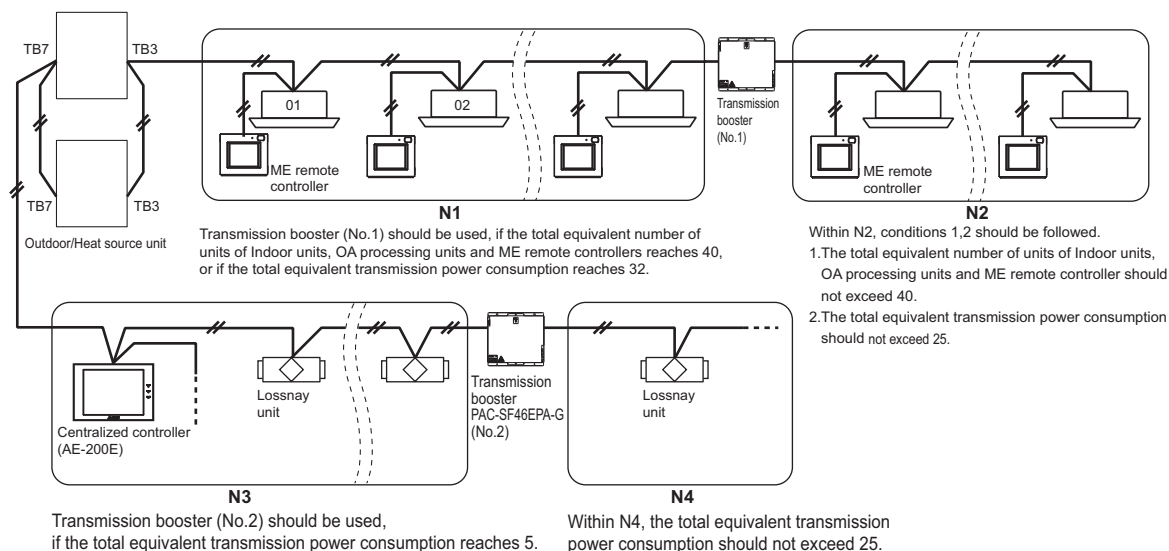

10-3-3. Ensuring proper power supply to System controller

The power to System controller (excluding AE-200E, AE-50E, EW-50E, BAC-HD150, LM-AP) is supplied via M-NET transmission line. M-NET transmission line at TB7 side is called Centralized control transmission line while one at TB3 side is called Indoor-Outdoor/Heat source transmission line. There are 3 ways to supply power to the System controller.

A) Connecting to TB3 of the Outdoor/Heat source unit and receiving power from the Outdoor/Heat source unit.

B) Connecting to TB7 of the Outdoor/Heat source unit and receiving power from the Outdoor/Heat source unit.
(Not applicable to the PUMY model)

C) Connecting to TB7 of the Outdoor/Heat source unit but receiving power from power supply unit PAC-SC51KUA.


* System controllers (AE-200E, AE-50E, EW-50E, BAC-HD150, LM-AP) have a built-in function to supply power to the M-NET transmission lines, so no power needs to be supplied to the M-NET transmission lines from the Outdoor/Heat source units or from PAC-SC51KUA.

10-3-3-A. When connecting to TB3 of the Outdoor/Heat source unit and receiving power from the Outdoor/Heat source unit.

Maximum 3 System controllers can be connected to TB3.

If there is more than 1 Outdoor/Heat source unit, it is necessary to replace power supply switch connector CN41 with CN40 on one Outdoor/Heat source unit.

Fig. 10-3-3-A

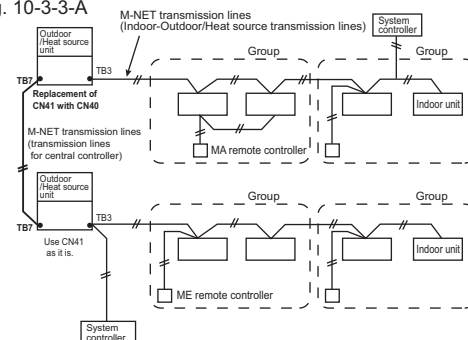


10-3-3-B. When connecting to TB7 of the Outdoor/Heat source unit and receiving power from the Outdoor/Heat source unit. (Not applicable to the PUMY model)

A maximum of 6 system controller are connectable to TB3 and TB7 of Outdoor/Heat source unit. (Not applicable to the PUMY model)

It is necessary to replace power supply switch connector CN41 with CN40 on one Outdoor/Heat source unit.

Fig. 10-3-3-B

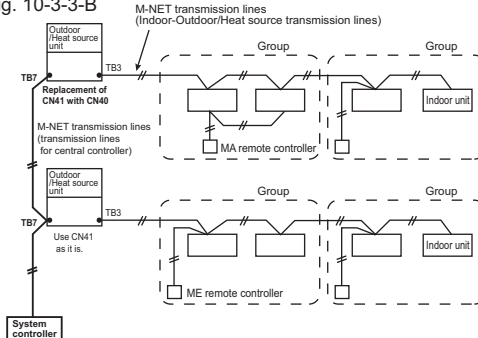

10-3-3-C. When connecting to TB7 of the Outdoor/Heat source unit but receiving power from PAC-SC51KUA.


When using PAC-SC51KUA to supply transmission power, the power supply connector CN41 on the Outdoor/Heat source units should be kept as it is. It is also a factory setting.

1 PAC-SC51KUA supports maximum 1 AG-150A or 1 EB-50GU-J unit due to the limited power 24VDC at its TB3.

However, 1 PAC-SC51KUA supplies transmission power at its TB2 equal to 5 Indoor units, which is referable at Table 2.

If System controller, ON/OFF controller connected to TB7 consume transmission power more than 5 (Indoor units), Transmission booster PAC-SF46EPA-G is needed. PAC-SF46EPA-G supplies transmission power equal to 25 Indoor units.

Fig. 10-3-3-C

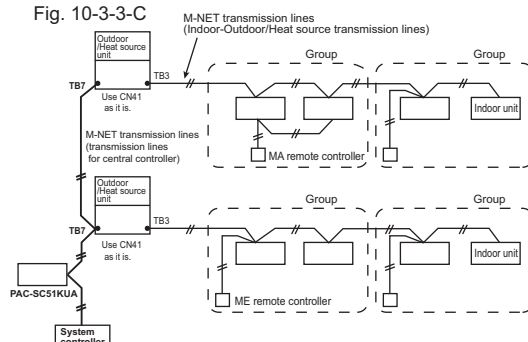


⚠ CAUTION

■ How to connect system controllers (AE-200E, AE-50E, EW-50E, BAC-HD150, LM-AP) to a given system
System controllers (AE-200E, AE-50E, EW-50E, BAC-HD150, LM-AP) have a built-in function to supply power to the M-NET transmission lines, so no power needs to be supplied to the M-NET transmission lines from the Outdoor/Heat source units or from PAC-SC51KUA.

Leave the power supply connector on the Outdoor/Heat source unit connected to CN41 as it is.

Refer to 10-3-2 for information about the power-supply capacity of each system controller (EW-50E, BAC-HD150, LM-AP) to the low-level system controllers.

Fig. 10-3-3-D

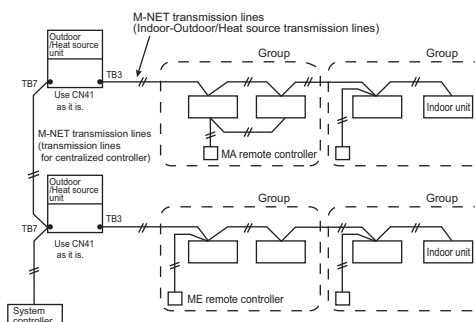

10-3-4. Power supply to LM-AP

1-phase 220-240VAC power supply is needed.

The power supply unit PAC-SC51KUA is not necessary when connecting only the LM-AP. Yet, make sure to change the power supply changeover connector CN41 to CN40 on the LM-AP.

10-3-5. Power supply to expansion controller

1-phase 100-240VAC power supply is needed.

The power supply unit PAC-SC51KUA is not necessary.

The expansion controller supplies power through TB3, which equals 6 indoor units. (refer to Table 2)

10-3-6. Power supply to BM ADAPTER

1-phase 100-240VAC power supply is needed.

The power supply unit PAC-SC51KUA is not necessary when only BM ADAPTER is connected.

Yet, make sure to move the power jumper from CN41 to CN40 on the BM ADAPTER.

10-3-7. Power supply to AE-200E/AE-50E/EW-50E

1-phase 100-240VAC power supply is needed.

The power supply unit PAC-SC51KUA is not necessary when connecting only the AE-200E/AE-50E/EW-50E.

10-4. Address setting

10-4-1. Switch operation

In order to constitute CITY MULTI in a complete system, switch operation for setting the unit address No. and connection No. is required.

- ① Address No. of outdoor unit, indoor unit and remote controller.
The address No. is set at the address setting board.

- ② Caution for switch operations

- Be sure to shut off power source before switch setting. If operated with power source on, switch can not operate properly.
- No units with identical unit address shall exist in one whole air conditioner system. If set erroneously, the system can not operate.

- ③ MA remote controller

- When connecting only one remote controller to one group, it is always the main remote controller. When connecting two remote controllers to one group, set one remote controller as the main remote controller and the other as the sub remote controller.
- The factory setting is "Main".

PAR-4XMAA ("X" represents 0 or later), PAR-CT01MA

The MA remote controller does not have the switches listed above.

Refer to the installation manual for the function setting.


PAC-YT52CRA

Setting the dip switches

There are switches on the back of the top case. Remote controller Main/Sub and other function settings are performed using these switches. Ordinarily, only change the Main/Sub setting of SW1.

(The factory settings are ON for SW1, 2, and 3 and OFF for SW4.)

SW No.	SW contents Main	ON	OFF	Comment
1	Remote controller Main/Sub setting	Main	Sub	Set one of the two remote controllers at one group to "ON".
2	Temperature display units setting	Celsius	Fahrenheit	When the temperature is displayed in [Fahrenheit], set to "OFF".
3	Cooling/heating display in AUTO mode	Yes	No	When you do not want to display "Cooling" and "Heating" in the AUTO mode, set to "OFF".
4	Indoor temperature display	Yes	No	When you want to display the indoor temperature, set to "ON".

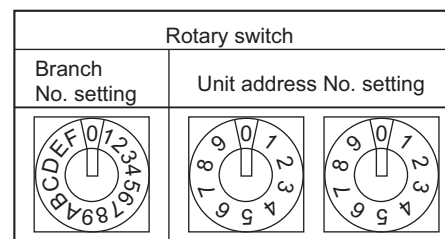

10-4-2. Rule of setting address

Unit		Address setting	Example	Note
Indoor unit		01 ~ 50	 	Use the most recent address within the same group of indoor units. Make the indoor units address connected to the BC controller (Sub) larger than the indoor units address connected to the BC controller (Main). If applicable, set the sub BC controllers in an PURY/PQRY system in the following order: (1) Indoor unit to be connected to the BC controller (Main) (2) Indoor unit to be connected to the BC controller (No.1 Sub) (3) Indoor unit to be connected to the BC controller (No.2 Sub) Set the address so that (1)<(2)<(3)
Outdoor unit		51 ~ 99, 100	 	The smallest address of indoor unit in same refrigerant system + 50 * The address automatically becomes "100" if it is set as "01 ~ 50"
BC controller (Main)		52 ~ 99, 100	 	The address of outdoor unit + 1 * Please reset another address between 51 and 99 when two addresses overlap. * The address automatically becomes "100" if it is set as "01 ~ 50"
BC controller (Sub)		53 ~ 99, 100	 	Lowest address within the indoor units connected to the BC controller (Sub) plus 50.
Local remote controller	ME remote controller (Main)	101 ~ 150	1 Fixed  	The smallest address of indoor unit in the group + 100 * The place of "100" is fixed to "1"
	ME remote controller (Sub)	151 ~ 199, 200	1 Fixed  	The address of main remote controller + 50 * The address automatically becomes "200" if it is set as "00"
System controller	ON/OFF remote controller	201 ~ 250	  	The smallest group No. to be managed + 200 * The smallest group No. to be managed is changeable.
	AE-200E/AE-50E EW-50E AG-150A EB-50GU-J AT-50B	000, 201 ~ 250	  	* AT-50B cannot be set to "000".
	PAC-YG50ECA	000, 201 ~ 250	  	* Settings are made on the initial screen of AG-150A.
	BAC-HD150	000, 201 ~ 250	  	* Settings are made with setting tool of BM ADAPTER.
	LMAP04-E	201 ~ 250	2 Fixed  	
PI, AI, DIDO	PAC-YG60MCA	01 ~ 50	 	
	PAC-YG63MCA	01 ~ 50	 	
	PAC-YG66DCA	01 ~ 50	 	
Lossnay, OA processing unit		01 ~ 50	 	After setting the addresses of all the indoor units, assign an arbitrary address.
PAC-IF01AHC		201 ~ 250	2 Fixed  	


10-4-3. System example

Factory setting

Original switch setting of the outdoors, indoors, controllers, LM-AP and BM ADAPTER at shipment is as follows.


- Outdoor unit : Address: 00, CN41: ON (Jumper), DipSW2-1: OFF
- Indoor unit : Address: 00
- ME Remote controller : Address: 101
- LM-AP : Address: 247, CN41: ON (Jumper), DipSW1-2: OFF
- BM ADAPTER : Address: 000, CN41: ON (Jumper)
- AE-200E/AE-50E/EW-50E : Address: 000, CN21: ON (Jumper)

10-4-3-1. Basic (No address setting)

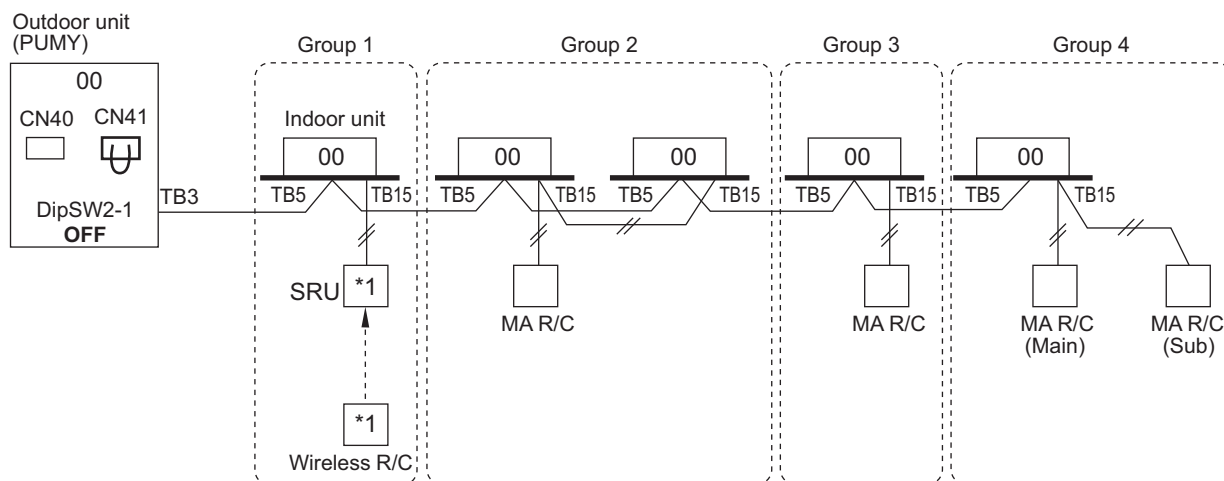


*1 For wireless R/C and Signal receiver unit(SBU), channel 1, 2 and 3 are selectable and should be set same channel.

10-4-3-2. Basic, Sub/main ME remote controller

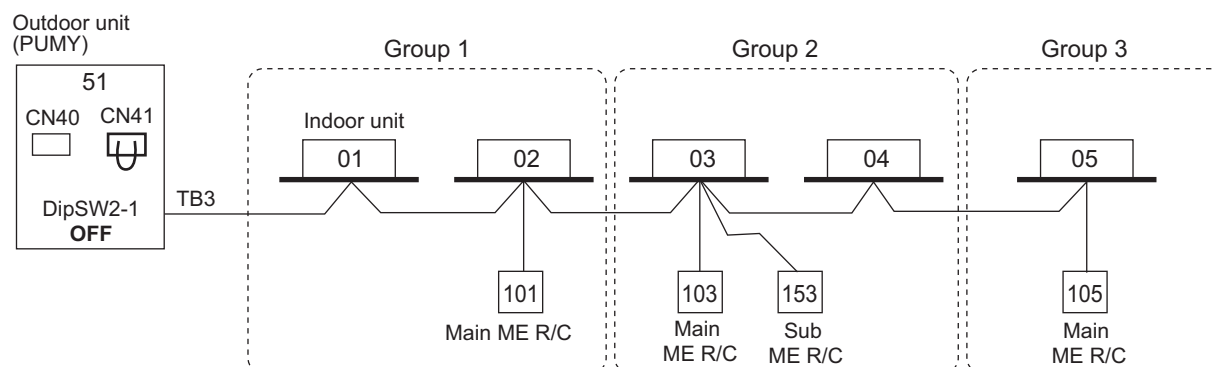


10-4-3-3. Grouping in different refrigerant system

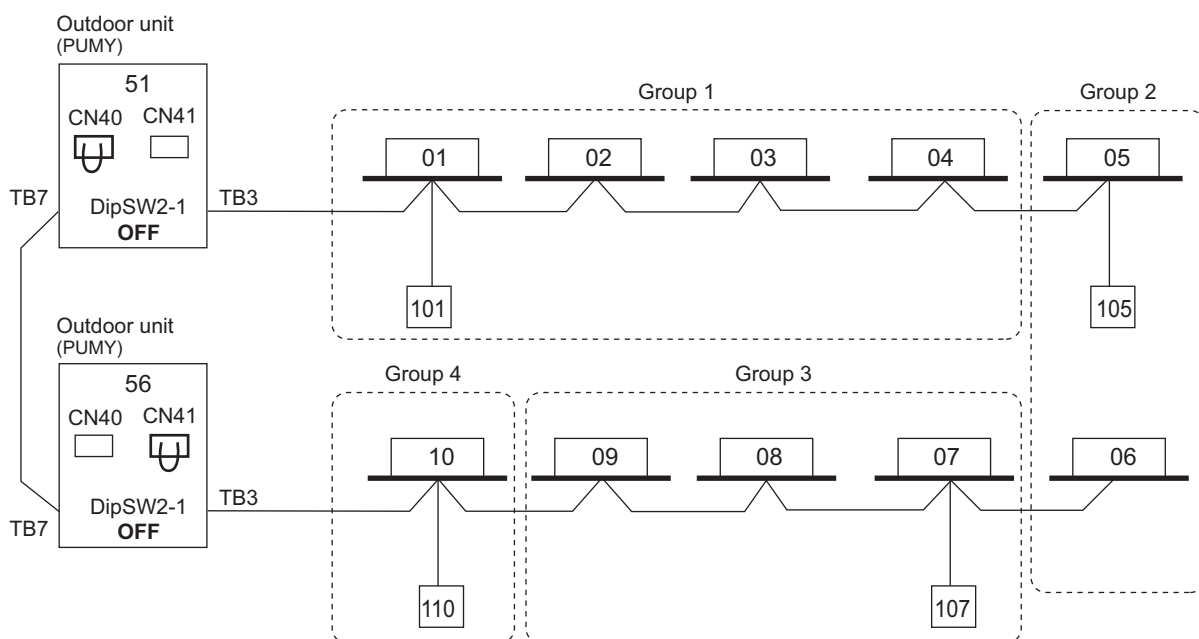

NOTE

- It is necessary to change the connector to CN40 on the outdoor unit (Heat source unit) control board (only one outdoor unit (Heat source unit)) when the group is set between other refrigerant systems.
- It is necessary to set on the remote controller by manual when group sets on the different refrigerant system. Please refer to remote controller installation manual.

10-4-3-4. 2 Outdoor unit, AG-150A, AE-200E, MA

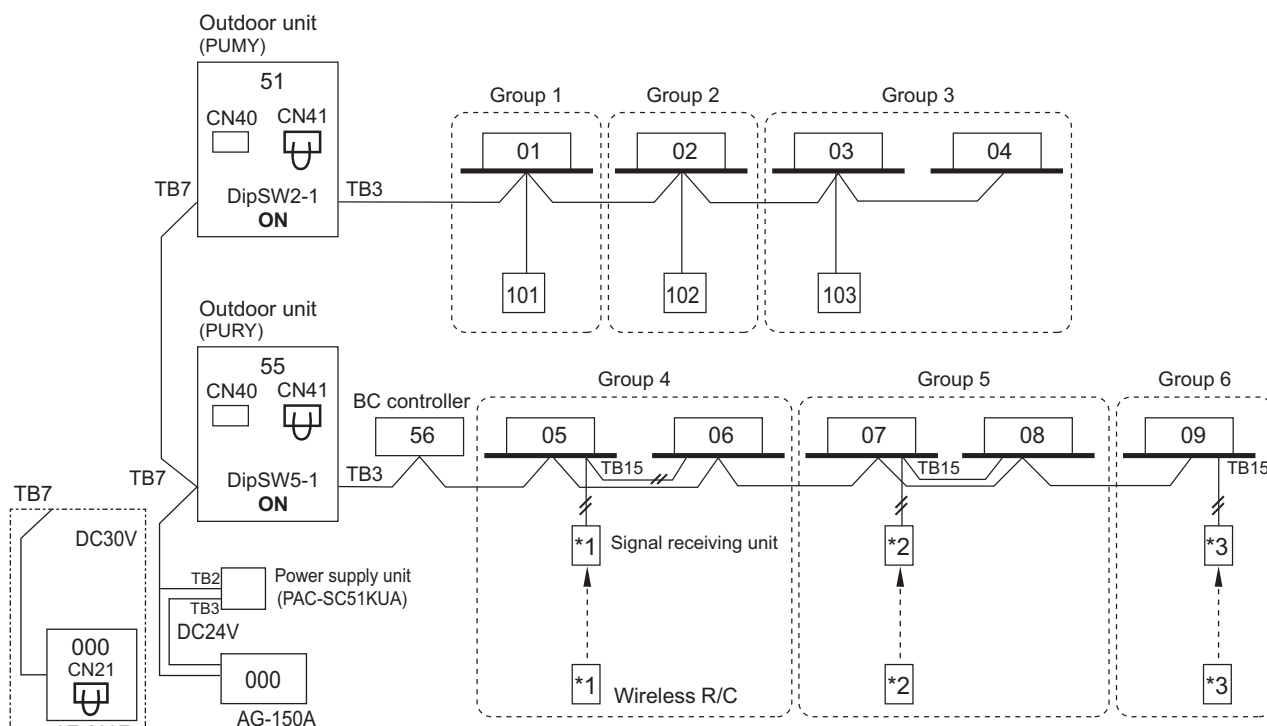


* For wireless R/C and Signal receiver unit(SBU), channel 1, 2 and 3 are selectable and should be set same channel.

10-4-3-5. TG-2000A(*1)+AE-200E/AE-50E/EW-50E

AE-200E can control max. 50 indoor units;

TG-2000A can control max. 40 of AE-200E/AE-50E/EW-50E;*2

TG-2000A can control max. 2000 indoor units.

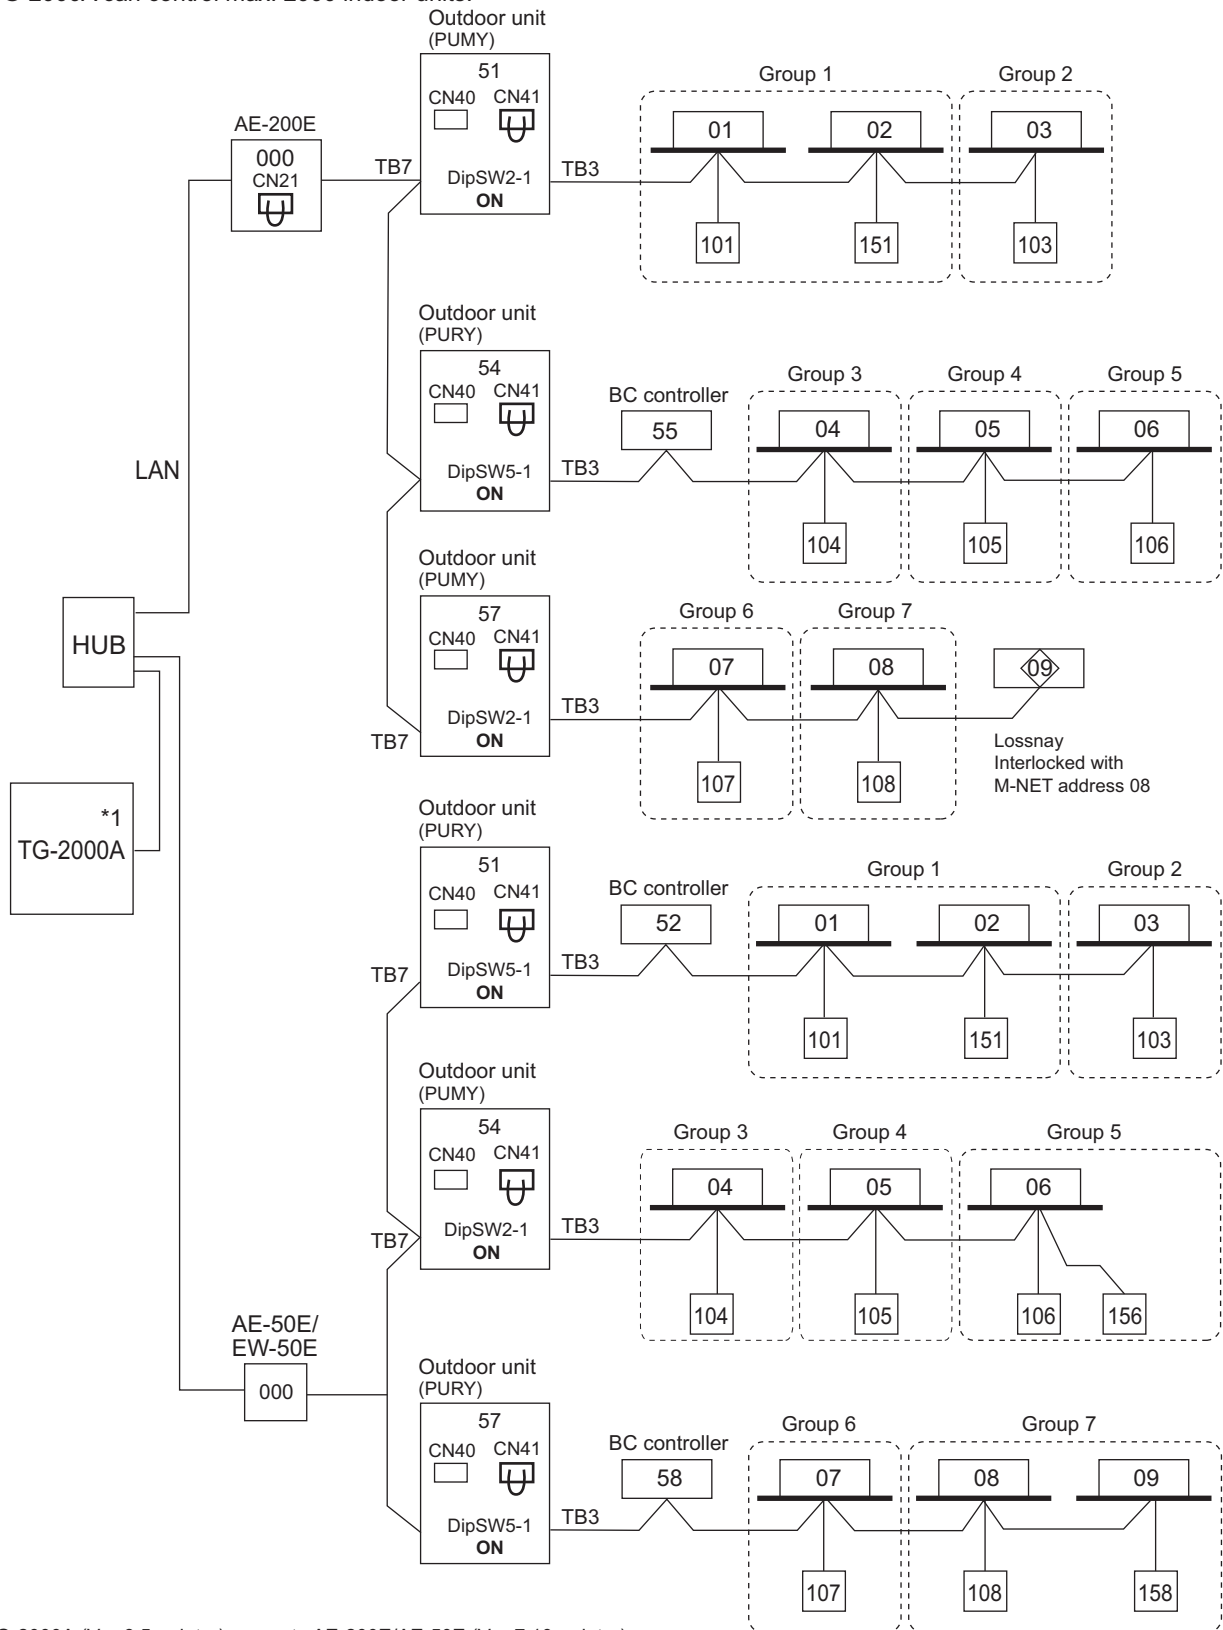

*1 TG-2000A (Ver.6.5 or later) supports AE-200E/AE-50E (Ver.7.10 or later).


TG-2000A (Ver.6.60 or later) supports EW-50E.

*2 When AE-200E connected with AE-50E/EW-50E is connected, the number of AE-50E/EW-50E will be the maximum controllable number.


TG-2000A can control up to 40 AE-200E/AE-50E/EW-50E or AE-200E without AE-50E/EW-50E connection.

10-4-3-6. AE-200E + AE-50E/EW-50E

AE-200E can control max. 200 indoor units/via AE-50E/EW-50E.

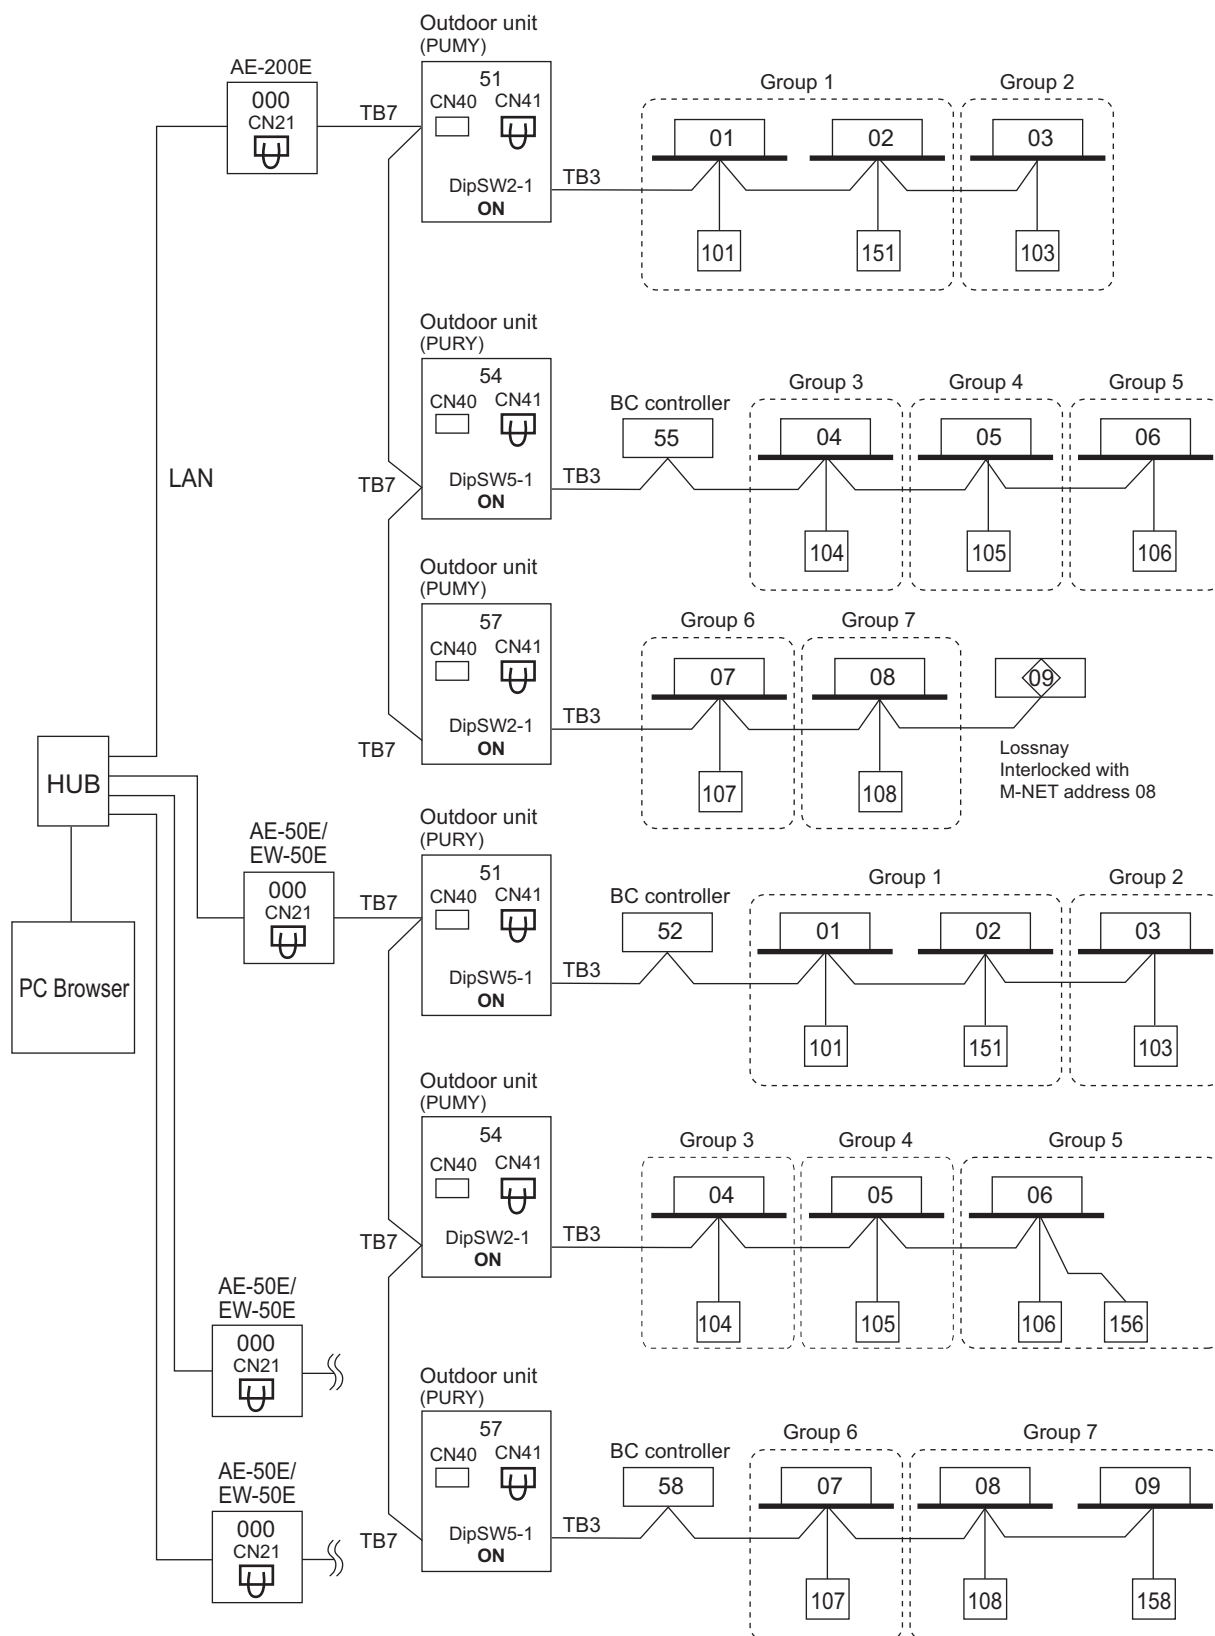

10-4-3-7. LM-AP

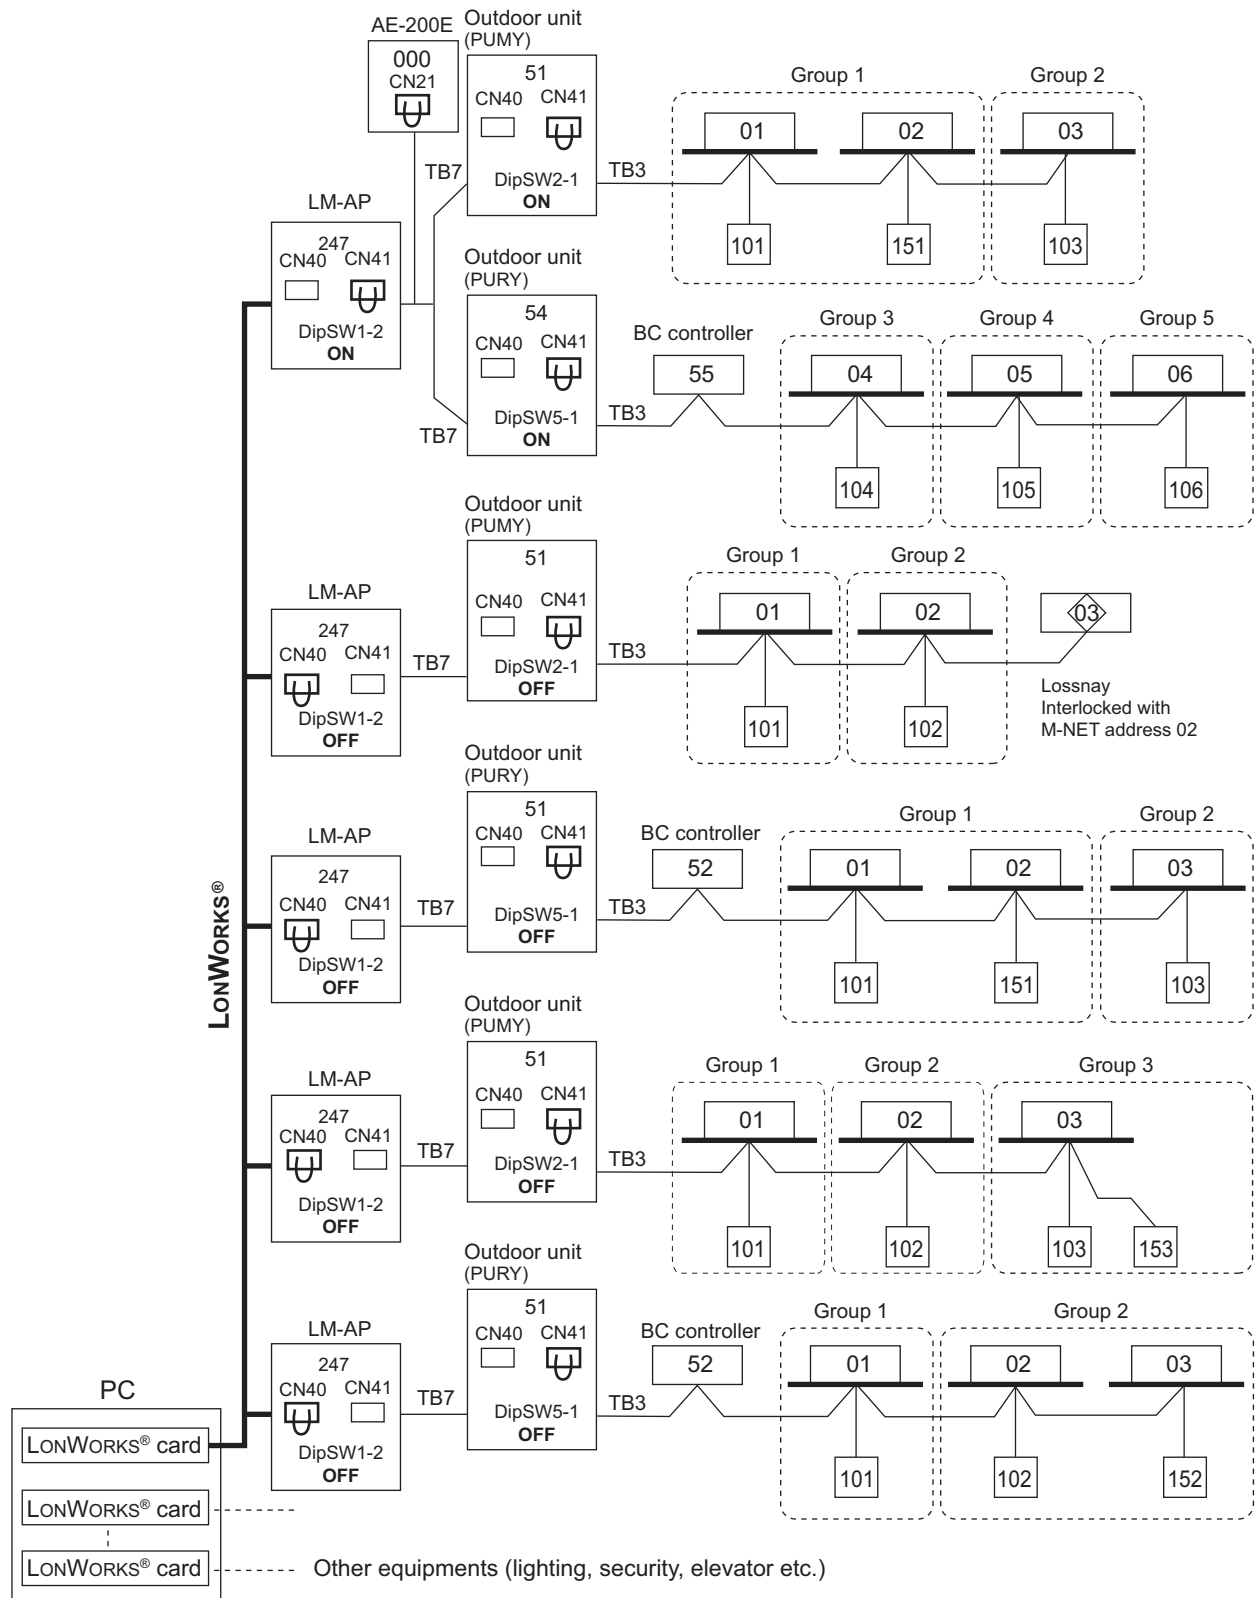


NOTE

- LM-AP can control 50 indoor units.
- It is necessary to turn on the DipSW1-2 on the LM-AP control board and the DipSW2-1 on the outdoor unit (heat source unit) control board with centralized controller (Power supply unit).
- It is necessary to change the connector to CN40 on the LM-AP control board without centralized controllers (Power supply unit).

10-4-3-8. BM ADAPTER

BM ADAPTER can transmit for max. 50 indoor units;


Change Jumper from CN41 to CN40 to activate power supply to BM ADAPTER itself for those BM ADAPTER connected without the power supply unit.

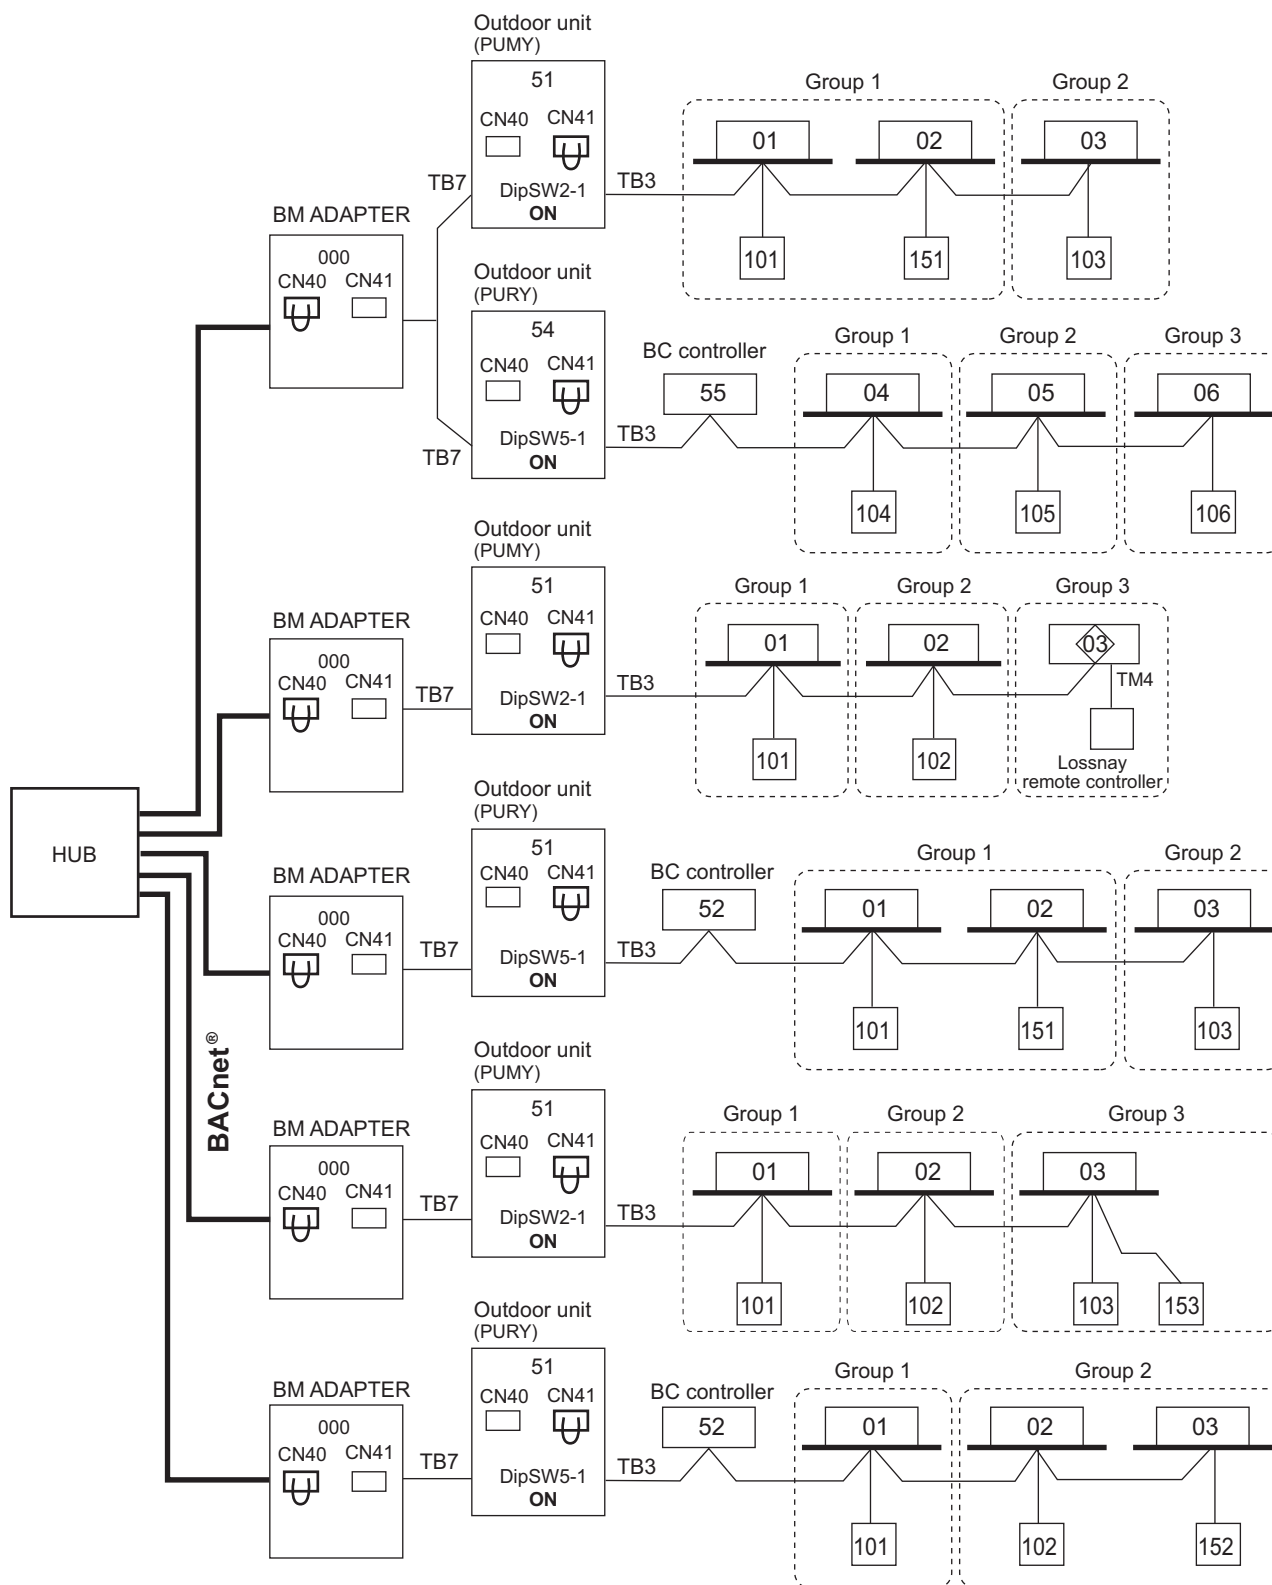

10-4-3-9. BM ADAPTER+PAC-YG50ECA (Expansion controller)

BM ADAPTER(*1) can transmit for max. 150 indoor units/via expansion controllers (PAC-YG50ECA).

When the dual-set-point function is used, no expansion controllers can be connected, and only up to 50 units can be controlled from each BAC-HD150.

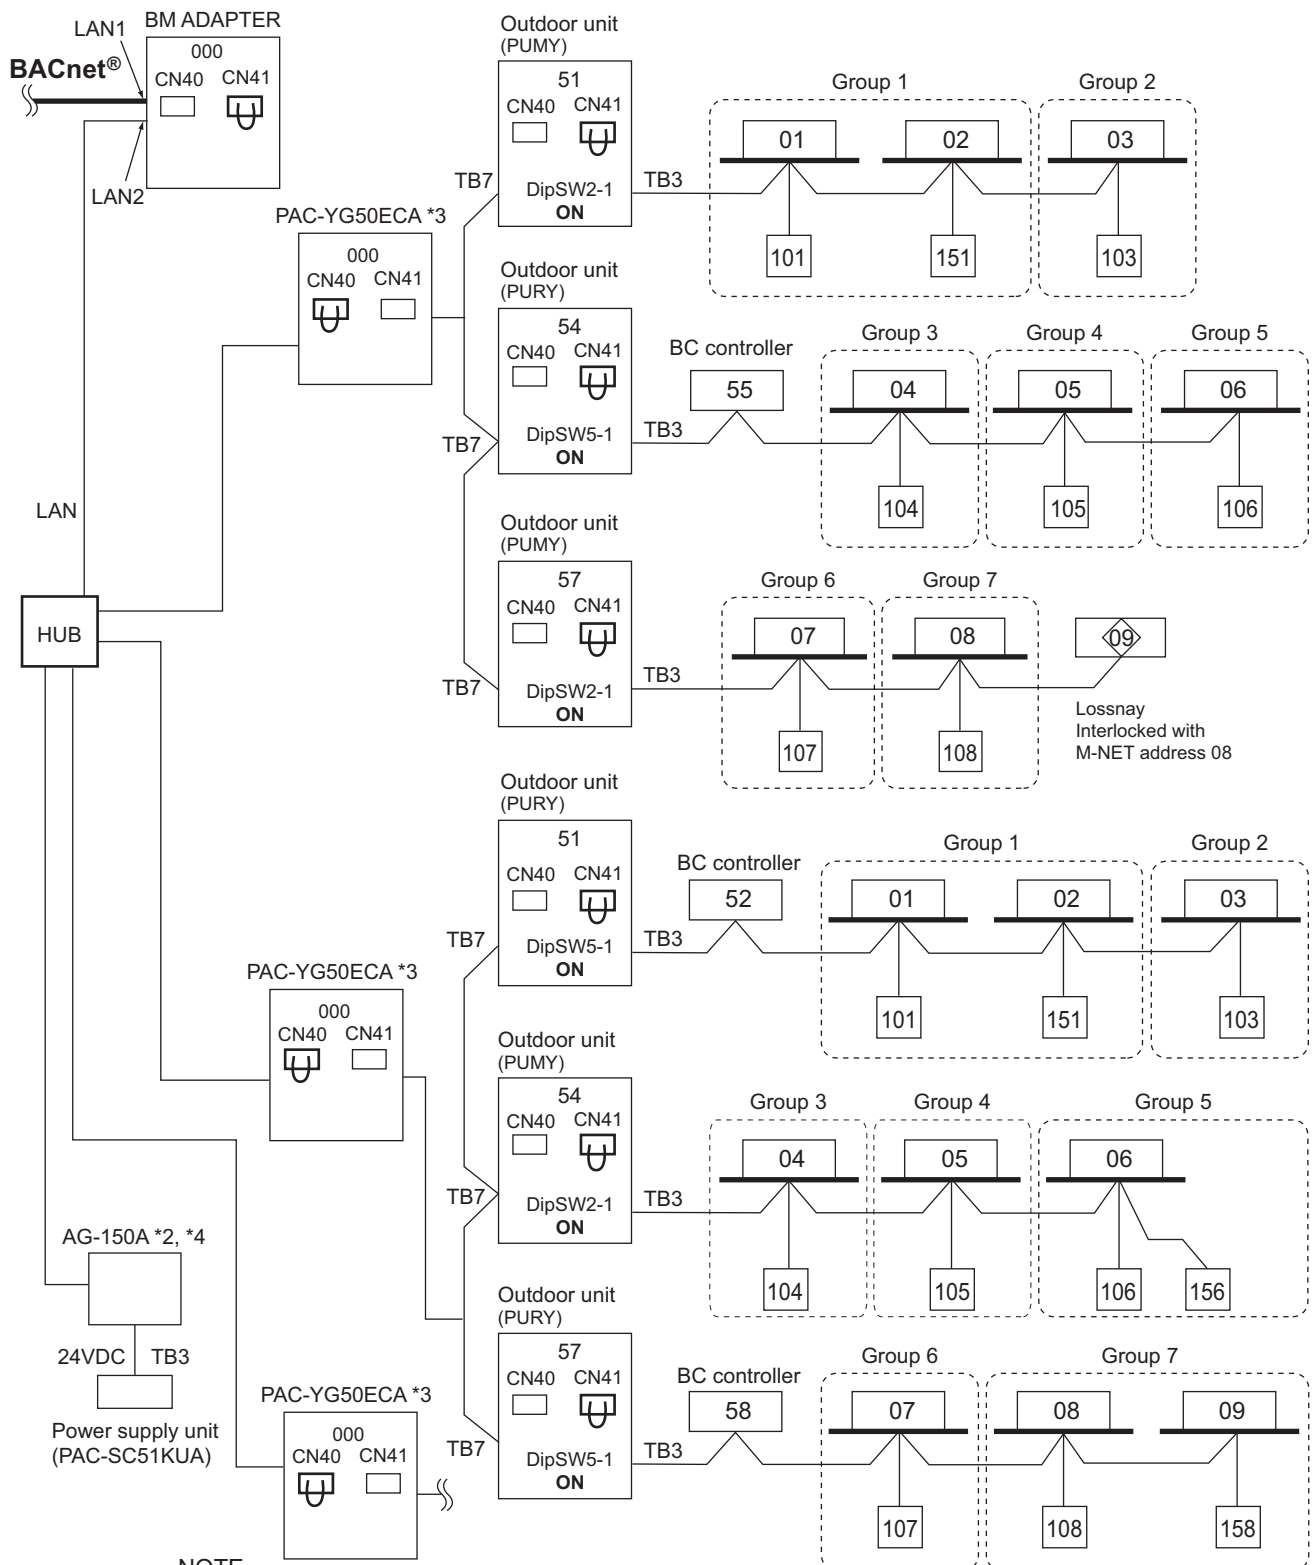

NOTE

•It is not necessary to connect the M-NET transmission line to the TB3 on BM ADAPTER. Leave the power jumper of BM ADAPTER connected to CN41.

*1 BM ADAPTER (Ver.2.00 or later) supports the expansion controller.

*2 AG-150A (Ver.2.30 or later) supports the BM ADAPTER.


*3 PAC-YG50ECA (Ver.1.30 or later) supports the BM ADAPTER.

*4 Consult your dealer for restrictions when connecting both AG-150A and BM ADAPTER to PAC-YG50ECA.

10-4-3-10. BM ADAPTER+AE-200E/AE-50E/EW-50E

BM ADAPTER can transmit for max. 50 indoor units.

One BM ADAPTER is required for one AE-200E/AE-50E/EW-50E.

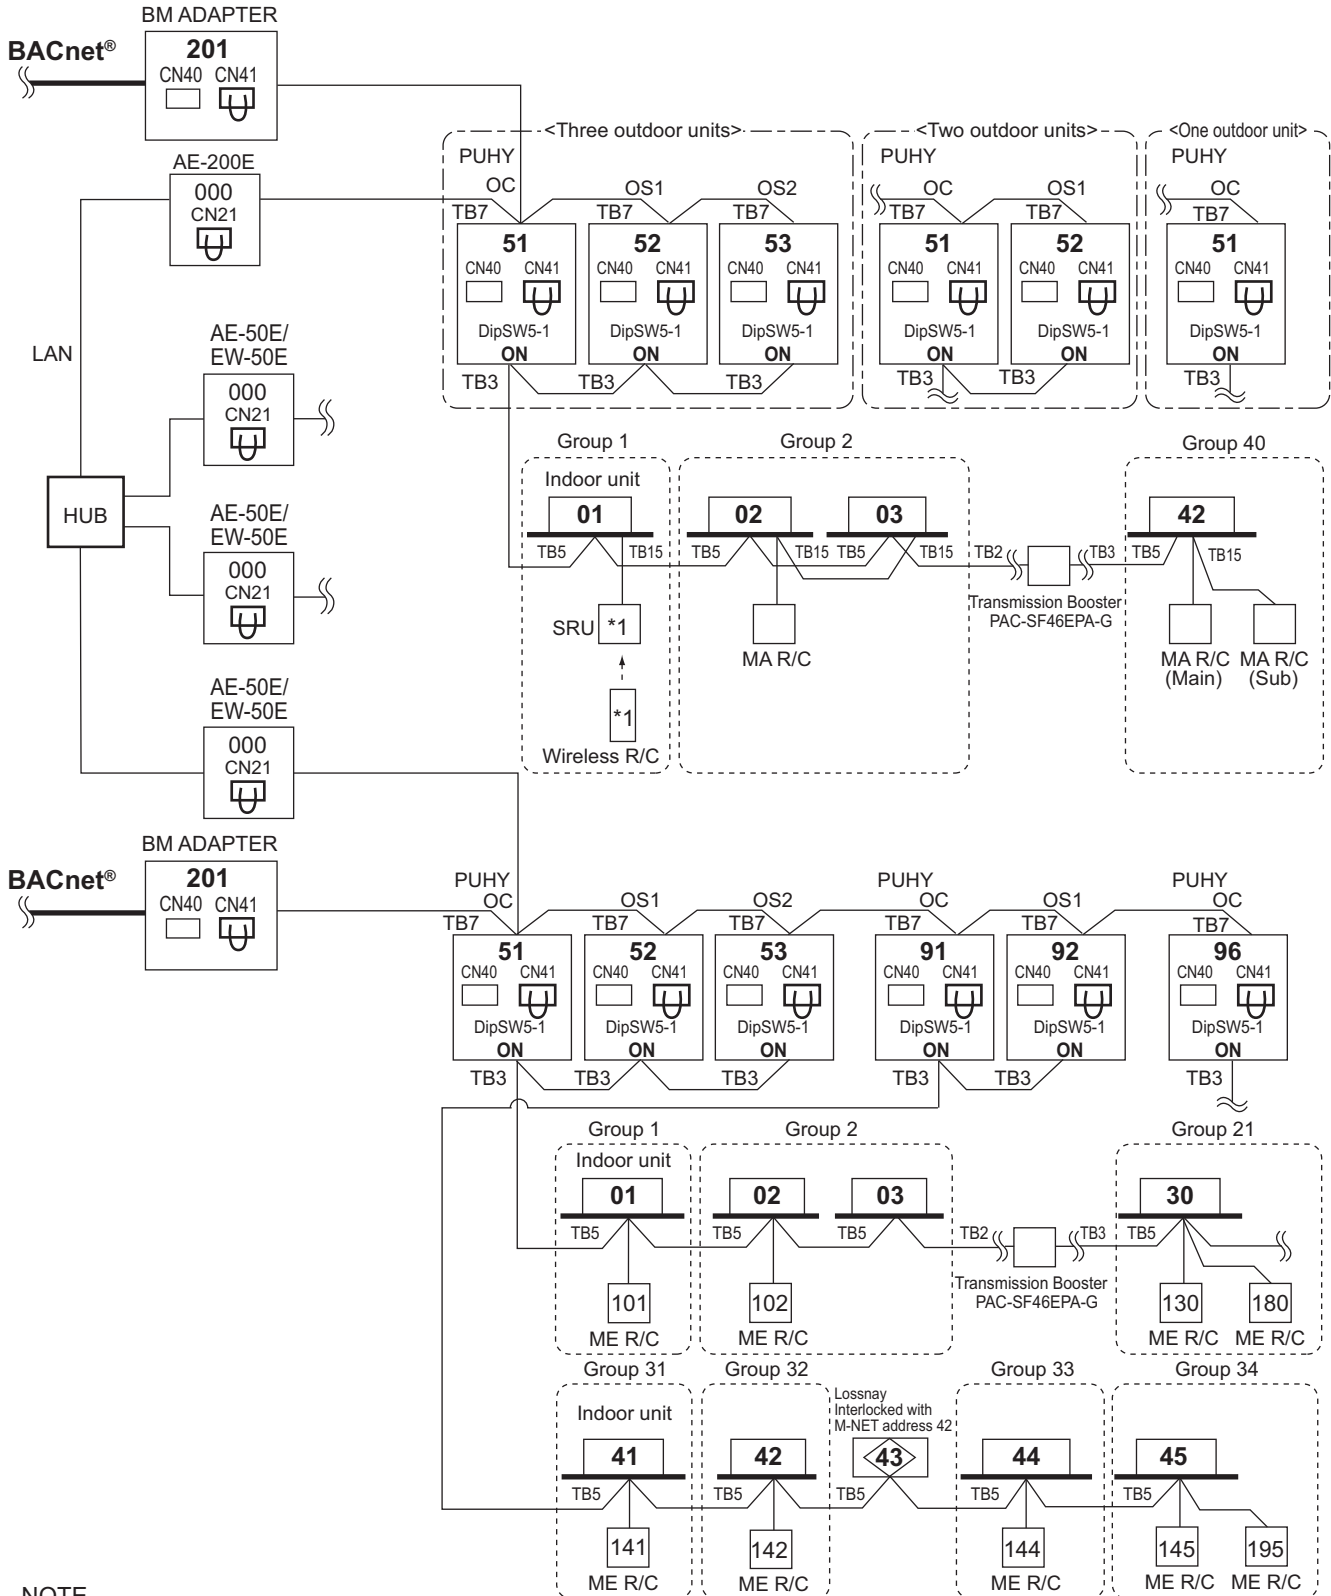

NOTE

• It is not necessary to connect the M-NET transmission line to the TB3 on BM ADAPTER. Leave the power jumper of BM ADAPTER connected to CN41.

*1 For Wireless R/C and Signal receiver unit (SRU), channel 1, 2 and 3 are selectable and should be set to same channel.

*2 Consult your dealer for restrictions when connecting both AE-200E/AE-50E/EW-50E and BM ADAPTER.

*3 When a PAR-CT01MA or PAR-3X MA-Series (X indicates 1, 2...) is connected to a group, no other MA remote controllers can be connected to the same group.

*4 In a system that uses AE-200E and/or AE-50E/EW-50E, each BM-ADAPTER must be connected to the M-NET line.

11-1. R410A Piping material

Refrigerant pipe for CITY MULTI shall be made of phosphorus deoxidized copper, and has two types.

A. Type-O: Soft copper pipe (annealed copper pipe), can be easily bent with human's hand.

B. Type-1/2H pipe: Hard copper pipe (Straight pipe), being stronger than Type-O pipe of the same radical thickness.

The maximum operation pressure of R410A air conditioner is 4.30 MPa [623psi]. The refrigerant piping should ensure the safety under the maximum operation pressure. MITSUBISHI ELECTRIC recommends pipe size as Table1, or You shall follow the local industrial standard. Pipes of radical thickness 0.7mm or less shall not be used.

Table 1. Copper pipe size and radial thickness for R410A CITY MULTI.



Size (mm)	Size (inch)	Radial thickness (mm)	Radial thickness (mil)	Pipe type
ø6.35	ø1/4"	0.8	[32]	Type-O
ø9.52	ø3/8"	0.8	[32]	Type-O
ø12.7	ø1/2"	0.8	[32]	Type-O
ø15.88	ø5/8"	1.0	[40]	Type-O
ø19.05	ø3/4"	1.2	[48]	Type-O
ø19.05	ø3/4"	1.0	[40]	Type-1/2H or H
ø22.2	ø7/8"	1.0	[40]	Type-1/2H or H
ø25.4	ø1"	1.0	[40]	Type-1/2H or H
ø28.58	ø1-1/8"	1.0	[40]	Type-1/2H or H
ø31.75	ø1-1/4"	1.1	[44]	Type-1/2H or H
ø34.93	ø1-3/8"	1.2	[48]	Type-1/2H or H
ø41.28	ø1-5/8"	1.4	[56]	Type-1/2H or H

* For pipe sized ø19.05 (3/4") for R410A air conditioner, choice of pipe type is up to you.

* The figures in the radial thickness column are based on the Japanese standards and provided only as a reference. Use pipes that meet the local standards.

Flare

Due to the relative higher operation pressure of R410A compared to R22, the flare connection should follow dimensions mentioned below so as to achieve enough the air-tightness.

Flare pipe	Pipe size	A (For R410A) (mm[in.])	Flare nut	Pipe size	B (For R410A) (mm[in.])
	ø6.35 [1/4"]	9.1		ø6.35 [1/4"]	17.0
	ø9.52 [3/8"]	13.2		ø9.52 [3/8"]	22.0
	ø12.70 [1/2"]	16.6		ø12.70 [1/2"]	26.0
	ø15.88 [5/8"]	19.7		ø15.88 [5/8"]	29.0
	ø19.05 [3/4"]	24.0		ø19.05 [3/4"]	36.0


11-2. Piping Design

11-2-1. Use of the existing refrigerant piping


Before operating the compressor, make sure the refrigerant pipes are properly installed.

- Operating the compressor without the refrigerant pipes properly being connected and with the stop (ball) valve open, the compressor may suck in air, raising the pressure inside the refrigerant cycle abnormally high and resulting in pipe bursting and personal injury.

- Adequately insulate the liquid and gas refrigerant pipes to keep condensation from dripping.
- Provide additional insulation on the refrigerant pipes as necessary to keep condensation from forming on the insulation surface. (Insulating material: Heat-resistance temperature: 120°C; Thickness: 15 mm or greater)
- * Installation of the unit in high-temperature high-humidity conditions, such as in the ceiling of the top floor, may require additional insulation.
- Insulate refrigerant pipes with heat-resistant polyethylene foam and without leaving any gap between indoor unit and insulating material or between insulating materials. (Exposed pipes may cause condensation and pose burn hazard.)
- Keep the piping length within the limits, and charge the required amount of refrigerant (R410A).
- * Before charging refrigerant, evacuate the extended piping and the indoor units, and charge refrigerant through the stop valve (applicable when the unit is stopped). When charging refrigerant through the check valve on the suction side, use a safety charger to prevent liquid refrigerant from being inhaled (applicable when the unit is operated).
- * When charging refrigerant, record the amount of refrigerant charged in the relevant section of the maintenance manual (attached to the product).
- **Determine the reusability of the existing piping, using the flowchart below.**
- **If the diameter of the existing piping differs from the standard diameter, check the reusability of the piping and restrictive conditions for reuse.**

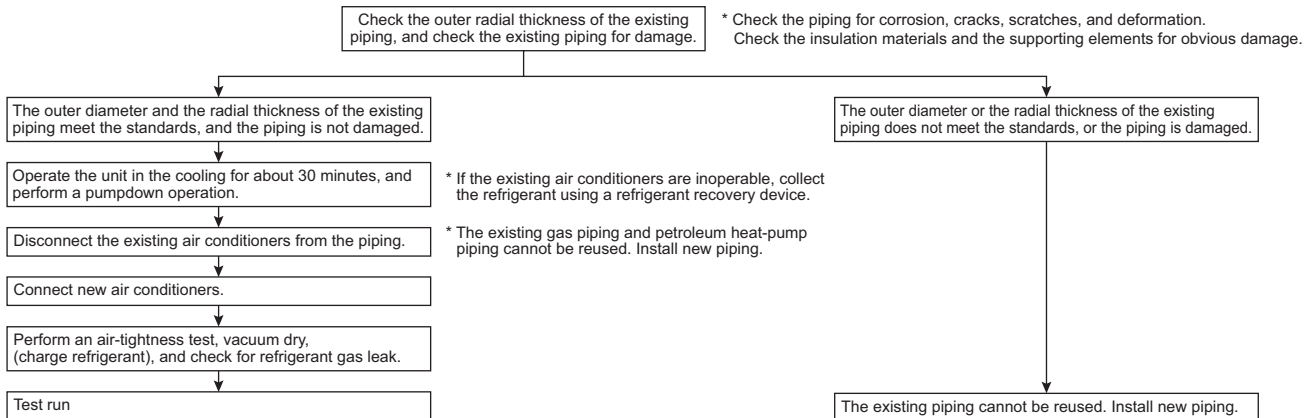Cautionary notes on reusing the existing piping


Connecting non-standard diameter pipes

- The following restrictions apply when using pipes with a diameter different from the standard recommended size.

Usability of pipes with non-standard diameters
Main pipe size

	Outside diameter(mm)	Radial thickness	SP100, CP100	CP112	SP125, CP125	SP140, CP140
Gas pipe	ø12.7	t 0.8	NA	NA	NA	NA
	ø15.88	t 1.0	A	A	A	A
	ø19.05	t 1.0	C	C	C	C
	ø22.2	t 1.0	NA	NA	NA	NA
	ø25.4 or greater	t 1.0	NA	NA	NA	NA
Liquid pipe	ø9.52	t 0.8	A	A	A	A
	ø12.7	t 0.8	D	D	D	D
	ø15.88	t 1.0	D	D	D	D
	ø19.05 or greater	t 1.0 or greater	NA	NA	NA	NA

A: Standard piping
 B: Usable (with no loss of performance)
 C: Usable (with loss of performance), Set the SW6-1 from OFF to ON.
 D: Usable (Restrictions on refrigerant charge apply.)
 NA: Unusable

Size of the piping after branching and up to indoor units

	Outside diameter(mm)	Radial thickness	P15	P20	P25	P32	P40	P50	P63	P71	P80	P100	P125	P140
Gas pipe	ø12.7	t 0.8	A	A	A	A	A	A	C	C	C	C	C	C
	ø15.88	t 1.0	NA	NA	NA	NA	B	B	A	A	A	A	A	A
	ø19.05	t 1.0	NA	NA	NA	NA	NA	NA	NA	B	B	B	B	B
	ø22.2	t 1.0	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
	ø25.4	t 1.0	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
Liquid pipe	ø28.58	t 1.0	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
	ø6.35	t 0.8	A	A	A	A	A	A	15 m or less	NA	NA	NA	NA	NA
	ø9.52	t 0.8	D	D	D	D	D	D	A	A	A	A	A	A
	ø12.7	t 1.0	NA	NA	NA	NA	NA	NA	D	D	D	D	D	D
	ø15.88	t 1.0	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
	ø19.05	t 1.0	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA

Pipe diameter and radial thickness Note: For pipes with a diameter of ø22.2 and up, use 1/2-H or H-material.

Outside diameter (mm)	ø6.35	ø9.52	ø12.7	ø15.88	ø19.05	ø22.2	ø25.4	ø28.58
Radial thickness (mm)	0.8	0.8	0.8	1.0	1.0	1.0	1.0	1.0

Restrictions on extending piping/Amount of refrigerant to be charged (REPLACE units)

When reusing the existing piping, calculate the amount of refrigerant to be charged using the formula below. The existing piping is usable if the result of the calculation below is less than 10 kg. If the calculation result is at or above 10 kg, use new piping. When reusing the existing piping, charge the amount of refrigerant required for the piping and for the indoor units.


Calculating the amount of refrigerant to be charged based on pipe size and length

Total length of ø12.7 liquid pipes × 0.12	+	Total length of ø9.52 liquid pipes × 0.05	+	Total length of ø6.35 liquid pipes × 0.019	=	Amount of additional refrigerant to be charged (REPLACE units)
(m) × 0.092 (kg/m)		(m) × 0.05 (kg/m)		(m) × 0.019 (kg/m)		(kg)

Calculating the amount of refrigerant to be charged based on indoor unit capacity


PUMY-SP112-140 PUMY-CP100-140	Total capacity index of the connected indoor units	Amount of refrigerant to be charged
	~ 8.0kW	1.5kg
	8.1kW ~ 16.0kW	2.5kg
	16.1kW ~	3.0kg

11-2-2. PUMY-SP100, 125, 140YKM2-PA, DA(-BS)/PUMY-SP100, 125, 140VKM2-PA, DA(-BS)

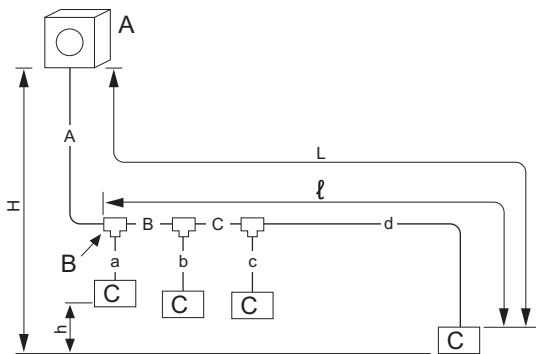
Line-Branch Method Connection Examples (Connecting to 4 Indoor Units)		 A: Outdoor Unit B: First Branch C: Indoor unit																									
Permissible Length	Total Piping Length	$A+B+C+a+b+c+d \leq 120 \text{ m}$																									
	Farthest Piping Length (L)	$A+B+C+d \leq 70 \text{ m}$																									
	Farthest Piping Length After First Branch (l)	$B+C+d \leq 50 \text{ m}$																									
Permissible High/Low Difference	High/Low Difference in Indoor/Outdoor Section (H)	50 meters or less (If the outdoor unit is lower, 30 meters or less)																									
	High/Low Difference in Indoor/Indoor Section (h)	15 meters or less																									
■ Selecting the Refrigerant Branch Kit		Use an optional branch piping kit (CMY-Y62-G-E).																									
■ Select Each Section of Refrigerant Piping		(1) Refrigerant Piping Diameter In Section From Outdoor Unit to First Branch (Outdoor Unit Piping Diameter)																									
(1) Section From Outdoor Unit to First Branch (A) (2) Sections From Branch to Indoor Unit (a,b,c,d) (3) Section From Branch to Branch (B,C) Each Section of Piping Select the size from the table to the right.		<table><tr><th>Model</th><th>Piping Diameter (mm)</th></tr><tr><td>PUMY-SP100</td><td>Liquid Line $\phi 9.52$</td></tr><tr><td>PUMY-SP125</td><td></td></tr><tr><td>PUMY-SP140</td><td>Gas Line $\phi 15.88$</td></tr></table>		Model	Piping Diameter (mm)	PUMY-SP100	Liquid Line $\phi 9.52$	PUMY-SP125		PUMY-SP140	Gas Line $\phi 15.88$																
		Model	Piping Diameter (mm)																								
		PUMY-SP100	Liquid Line $\phi 9.52$																								
PUMY-SP125																											
PUMY-SP140	Gas Line $\phi 15.88$																										
(2) Refrigerant Piping Diameter In Section From Branch to Indoor Unit (Indoor Unit Piping Diameter)																											
		<table><tr><th>Model number</th><th>Piping Diameter (mm)</th></tr><tr><td rowspan="2">50 or lower</td><td>Liquid Line $R \leq 30 \text{ m}$ $\phi 6.35$</td></tr><tr><td>Liquid Line $R > 30 \text{ m}$ $\phi 9.52$</td></tr><tr><td rowspan="2">63 to 140</td><td>Gas Line $\phi 12.7$</td></tr><tr><td>Liquid Line $\phi 9.52$</td></tr><tr><td></td><td>Gas Line $\phi 15.88$</td></tr></table>		Model number	Piping Diameter (mm)	50 or lower	Liquid Line $R \leq 30 \text{ m}$ $\phi 6.35$	Liquid Line $R > 30 \text{ m}$ $\phi 9.52$	63 to 140	Gas Line $\phi 12.7$	Liquid Line $\phi 9.52$		Gas Line $\phi 15.88$														
Model number	Piping Diameter (mm)																										
50 or lower	Liquid Line $R \leq 30 \text{ m}$ $\phi 6.35$																										
	Liquid Line $R > 30 \text{ m}$ $\phi 9.52$																										
63 to 140	Gas Line $\phi 12.7$																										
	Liquid Line $\phi 9.52$																										
	Gas Line $\phi 15.88$																										
		(3) Refrigerant Piping Diameter In Section From Branch to Branch																									
		<table><tr><th>Liquid Line (mm)</th><th>Gas Line (mm)</th></tr><tr><td>$\phi 9.52$</td><td>$\phi 15.88$</td></tr></table>		Liquid Line (mm)	Gas Line (mm)	$\phi 9.52$	$\phi 15.88$																				
Liquid Line (mm)	Gas Line (mm)																										
$\phi 9.52$	$\phi 15.88$																										
■ Additional refrigerant charge		<Additional Charge>																									
Refrigerant for the extended piping is not included in the outdoor unit when the unit is shipped from the factory. Therefore, charge each refrigerant piping system with additional refrigerant at the installation site. In addition, in order to carry out service, enter the size and length of each liquid pipe and additional refrigerant charge amounts in the spaces provided on the "Refrigerant amount" plate on the outdoor unit.		Calculation of refrigerant charge																									
Calculation of additional refrigerant charge • Calculate the additional charge using the liquid pipe size and length of the extended piping and total capacity of connected indoor units. • Calculate the additional refrigerant charge using the procedure shown to the right, and charge with the additional refrigerant. • For amounts less than 0.1 kg, round up the calculated additional refrigerant charge. (For example, if the calculated charge is 6.01 kg, round up the charge to 6.1 kg.)		<table><tr><th>Pipe size Liquid pipe $\phi 6.35$</th><th></th><th>Pipe size Liquid pipe $\phi 9.52$</th><th></th><th>Total capacity of connected indoor units</th><th>Amount for the indoor units*</th></tr><tr><td>(m) $\times 19.0 \text{ (g/m)}$</td><td>+</td><td>(m) $\times 50.0 \text{ (g/m)}$</td><td>+</td><td>up to 8.0 kW</td><td>1.5 kg</td></tr><tr><td></td><td></td><td></td><td></td><td>8.1 to 16.0 kW</td><td>2.5 kg</td></tr><tr><td></td><td></td><td></td><td></td><td>16.1 kW or above</td><td>3.0 kg</td></tr></table>		Pipe size Liquid pipe $\phi 6.35$		Pipe size Liquid pipe $\phi 9.52$		Total capacity of connected indoor units	Amount for the indoor units*	(m) $\times 19.0 \text{ (g/m)}$	+	(m) $\times 50.0 \text{ (g/m)}$	+	up to 8.0 kW	1.5 kg					8.1 to 16.0 kW	2.5 kg					16.1 kW or above	3.0 kg
		Pipe size Liquid pipe $\phi 6.35$		Pipe size Liquid pipe $\phi 9.52$		Total capacity of connected indoor units	Amount for the indoor units*																				
		(m) $\times 19.0 \text{ (g/m)}$	+	(m) $\times 50.0 \text{ (g/m)}$	+	up to 8.0 kW	1.5 kg																				
				8.1 to 16.0 kW	2.5 kg																						
				16.1 kW or above	3.0 kg																						
Included refrigerant amount when shipped from the factory																											
		<table><tr><th>Included refrigerant amount</th></tr><tr><td>3.5 kg</td></tr></table>		Included refrigerant amount	3.5 kg																						
Included refrigerant amount																											
3.5 kg																											
		<Example> Outdoor model: SP125 Indoor 1: P63 (7.1 kW) 2: P40 (4.5 kW) 3: P25 (2.8 kW) 4: P20 (2.2 kW)																									
		A: $\phi 9.52 \text{ mm}$ 20 m B: $\phi 9.52 \text{ mm}$ 5 m C: $\phi 9.52 \text{ mm}$ 5 m a: $\phi 9.52 \text{ mm}$ 15 m b: $\phi 6.35 \text{ mm}$ 10 m c: $\phi 6.35 \text{ mm}$ 10 m d: $\phi 6.35 \text{ mm}$ 20 m																									
		At the conditions below:																									
		The total length of each liquid line is as follows: $\phi 9.52$: $A + B + C + a = 20 + 5 + 5 + 15 = 45 \text{ m}$ $\phi 6.35$: $b + c + d = 10 + 10 + 20 = 40 \text{ m}$ The total capacity of connected indoor unit is as follows: $7.1 + 4.5 + 2.8 + 2.2 = 16.6$																									
		<Calculation example> Additional refrigerant charge $40 \times \frac{19}{1000} + 45 \times \frac{50.0}{1000} + 3.0 = 6.1 \text{ kg (rounded up)}$																									

Header-Branch Method

Connection Examples
(Connecting to 4 Indoor Units)

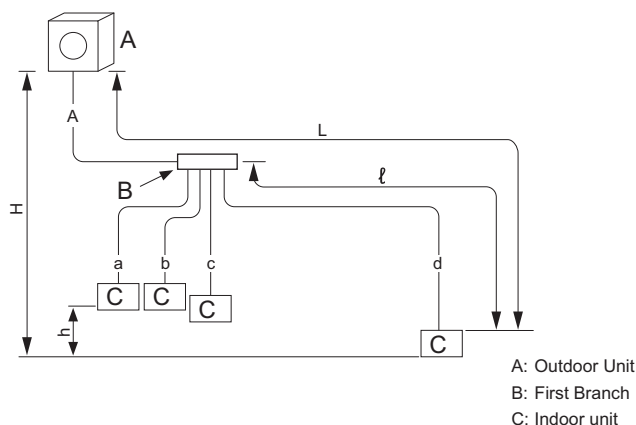


Permissible Length	Total Piping Length	A+a+b+c+d ≤ 120 m																						
	Farthest Piping Length (L)	A+d ≤ 70 m																						
	Farthest Piping Length After First Branch (ℓ)	d is 50 meters or less																						
Permissible High/Low Difference	High/Low Difference in Indoor/Outdoor Section (H)	50 meters or less (If the outdoor unit is lower, 30 meters or less)																						
	High/Low Difference in Indoor/Indoor Section (h)	15 meters or less																						
■ Selecting the Refrigerant Branch Kit		Please select branching kit, which is sold separately, from the table below. (The kit comprises sets for use with liquid pipes and for use with gas pipes.)																						
		<table><tr><td>Branch header (4 branches)</td><td>Branch header (8 branches)</td></tr><tr><td>CMY-Y64-G-E</td><td>CMY-Y68-G-E</td></tr></table>			Branch header (4 branches)	Branch header (8 branches)	CMY-Y64-G-E	CMY-Y68-G-E																
Branch header (4 branches)	Branch header (8 branches)																							
CMY-Y64-G-E	CMY-Y68-G-E																							
■ Select Each Section of Refrigerant Piping (1) Section From Outdoor Unit to First Branch (A) (2) Sections From Branch to Indoor Unit (a,b,c,d)		Each Section of Piping (1) Refrigerant Piping Diameter In Section From Outdoor Unit to First Branch (Outdoor Unit Piping Diameter) (2) Refrigerant Piping Diameter In Section From Branch to Indoor Unit (Indoor Unit Piping Diameter)																						
Select the size from the table to the right.		<table><tr><th>Model</th><th colspan="2">Piping Diameter (mm)</th></tr><tr><td>PUMY-SP100</td><td rowspan="2">Liquid Line</td><td>ø9.52</td></tr><tr><td>PUMY-SP125</td><td></td></tr><tr><td>PUMY-SP140</td><td>Gas Line</td><td>ø15.88</td></tr></table>			Model	Piping Diameter (mm)		PUMY-SP100	Liquid Line	ø9.52	PUMY-SP125		PUMY-SP140	Gas Line	ø15.88									
Model	Piping Diameter (mm)																							
PUMY-SP100	Liquid Line	ø9.52																						
PUMY-SP125																								
PUMY-SP140	Gas Line	ø15.88																						
		<table><tr><th>Model number</th><th colspan="2">Piping Diameter (mm)</th></tr><tr><td rowspan="2">50 or lower</td><td rowspan="2">Liquid Line</td><td>R≤ 30 m</td><td>ø6.35</td></tr><tr><td>R> 30 m</td><td>ø9.52</td></tr><tr><td rowspan="2">63 to 140</td><td>Gas Line</td><td colspan="2">ø12.7</td></tr><tr><td>Liquid Line</td><td colspan="2">ø9.52</td></tr><tr><td></td><td>Gas Line</td><td colspan="2">ø15.88</td></tr></table>			Model number	Piping Diameter (mm)		50 or lower	Liquid Line	R≤ 30 m	ø6.35	R> 30 m	ø9.52	63 to 140	Gas Line	ø12.7		Liquid Line	ø9.52			Gas Line	ø15.88	
Model number	Piping Diameter (mm)																							
50 or lower	Liquid Line	R≤ 30 m	ø6.35																					
		R> 30 m	ø9.52																					
63 to 140	Gas Line	ø12.7																						
	Liquid Line	ø9.52																						
	Gas Line	ø15.88																						
		Note: When connecting the CONNECTION KIT (PAC-LV11M-J) and an M-series indoor unit, refer to the installation manual for the CONNECTION KIT when selecting the pipe size and piping length																						
■ Additional refrigerant charge		Refer to the same section in the previous page.																						

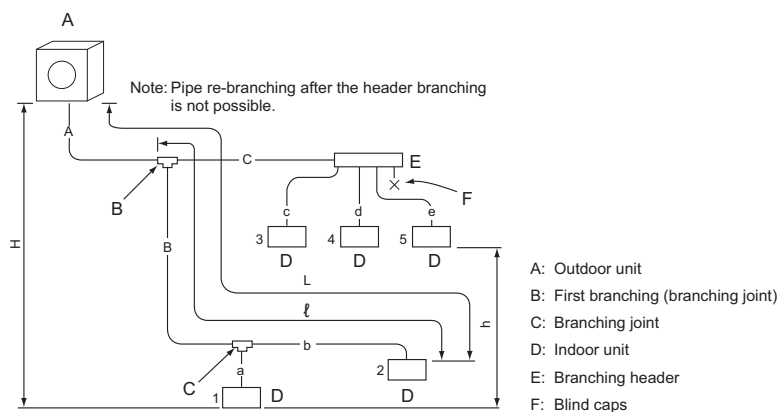Method of Combined Branching of Lines and HeadersConnection Examples
(Connecting to 5 Indoor Units)

Permissible Length	Total Piping Length	A+B+C+a+b+c+d+e is 120 meters or less		
	Farthest Piping Length (L)	A+B+b is 70 meters or less		
	Farthest Piping Length After First Branch (ℓ)	B+b is 50 meters or less		
Permissible High/Low Difference	High/Low Difference in Indoor/Outdoor Section (H)	50 meters or less (If the outdoor unit is lower, 30 meters or less)		
	High/Low Difference in Indoor/Indoor Section (h)	15 meters or less		
■ Selecting the Refrigerant Branch Kit		Please select branching kit, which is sold separately, from the table below. (The kit comprises sets for use with liquid pipes and for use with gas pipes.)		
		Branch Joint	Branch header (4 branches)	Branch header (8 branches)
		CMY-Y62-G-E	CMY-Y64-G-E	CMY-Y68-G-E
■ Select Each Section of Refrigerant Piping		(1) Refrigerant Piping Diameter In Section From Outdoor Unit to First Branch (Outdoor Unit Piping Diameter)		
(1) Section From Outdoor Unit to First Branch (A)		Each Section of Piping		
(2) Sections From Branch to Indoor Unit (a,b,c,d,e)				
(3) Section From Branch to Branch (B,C)				
Select the size from the table to the right.		(2) Refrigerant Piping Diameter In Section From Branch to Indoor Unit (Indoor Unit Piping Diameter)		
		Model	Piping Diameter (mm)	
		PUMY-SP100	Liquid Line	ø9.52
		PUMY-SP125		Gas Line
		PUMY-SP140		
		(3) Refrigerant Piping Diameter In Section From Branch to Branch		
		Liquid Line (mm)	Gas Line (mm)	
		ø9.52	ø15.88	
■ Additional refrigerant charge		Refer to the same section in the previous page.		

Branch box Method Connection Examples (Connecting to 8 Indoor Units)

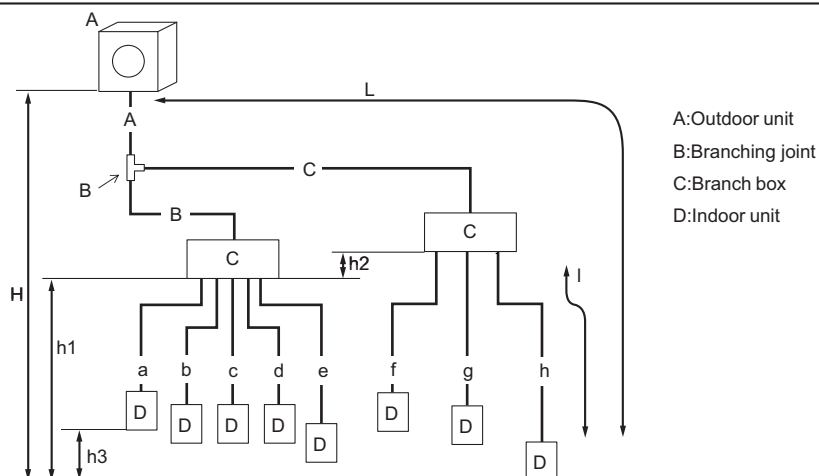

Permissible length (One-way)	Total piping length	$A + B + C + a + b + c + d + e + f + g + h \leq 120 \text{ m}$
	Farthest piping length (L)	$A + C + h \leq 80 \text{ m}$ ($A + C \leq 55 \text{ m}$, $h \leq 25 \text{ m}$)
	Piping length between outdoor unit and branch boxes	$A + B + C \leq 55 \text{ m}$
	Farthest piping length after branch box (I)	$I \leq 25 \text{ m}$
	Total piping length between branch boxes and indoor units	$a + b + c + d + e + f + g + h \leq 95 \text{ m}$
Permissible height difference (One-way)	In indoor/outdoor section (H)*	$H \leq 50 \text{ m}$ (In the case of that outdoor unit is set higher than indoor unit) $H \leq 30 \text{ m}$ (In the case of that outdoor unit is set lower than indoor unit)
	In branch box/indoor unit section (h1)	$h1 + h2 \leq 15 \text{ m}$
	In each branch unit (h2)	$h2 \leq 15 \text{ m}$
	In each indoor unit (h3)	$h3 \leq 12 \text{ m}$
Number of bends		≤ 15

*Branch box should be placed within the level between the outdoor unit and indoor units.

■ Select Each Section of Refrigerant Piping

- (1) Section From Outdoor Unit to Branch box (A, B, C)
(2) Sections From Branch box to Indoor Unit (a to h)
- Each Section of Piping

Select the size from the table to the right.

(1) Refrigerant Piping Diameter In Section From Outdoor Unit to Branch box (Outdoor Unit Piping Diameter)

Model	Piping Diameter (mm)	
PUMY-SP100	Liquid Line	ø9.52
PUMY-SP125	Gas Line	ø15.88
PUMY-SP140	Gas Line	ø15.88

(2) Refrigerant Piping Diameter In Section From Branch box to Indoor Unit (Indoor Unit Piping Diameter)

Indoor unit series	Model Number			A Liquid pipe	B Gas pipe
	kW type	Btu type	MSXZ-MP, MSXZ-FP series		
M series or S series	15 to 42	09 to 15	22 to 32	ø6.35	ø9.52
	50	18	—	ø6.35	ø12.7
	60	24	50	ø6.35	ø15.88
	71	26	63	ø9.52	ø15.88
P series	35 to 50	18	—	ø6.35	ø12.7
	60 to 100	24 to 30	—	ø9.52	ø15.88

■ Additional refrigerant charge

Refrigerant for the extended piping is not included in the outdoor unit when the unit is shipped from the factory. Therefore, charge each refrigerant piping system with additional refrigerant at the installation site. In addition, in order to carry out service, enter the size and length of each liquid pipe and additional refrigerant charge amounts in the spaces provided on the "Refrigerant amount" plate on the outdoor unit.

Calculation of additional refrigerant charge

- Calculate the additional charge using the liquid pipe size and length of the extended piping and total capacity of connected indoor units.
- Calculate the additional refrigerant charge using the procedure shown to the right, and charge with the additional refrigerant.
- For amounts less than 0.1 kg, round up the calculated additional refrigerant charge.
(For example, if the calculated charge is 6.01 kg, round up the charge to 6.1 kg.)

<Additional Charge>

Calculation of refrigerant charge

Pipe size Liquid pipe	Pipe size Liquid pipe	Total capacity of connected indoor units	Amount for the indoor units
ø6.35	ø9.52	up to 8.0 kW	1.5 kg
(m) × 19.0 (g/m)	(m) × 50.0 (g/m)	8.1 to 16.0 kW	2.5 kg
		16.1 kW or above	3.0 kg

Included refrigerant amount when shipped from the factory

Included refrigerant amount
3.5 kg

<Example>

Outdoor model : P125	A : ø9.52 mm	30 m	At the conditions below:
Indoor 1 : P63 (7.1 kW)	a : ø9.52 mm	15 m	
2 : P40 (4.5 kW)	b : ø6.35 mm	10 m	
3 : P25 (2.8 kW)	c : ø6.35 mm	10 m	
4 : P20 (2.2 kW)	d : ø6.35 mm	20 m	

The total length of each liquid line is as follows:

$$\text{ø9.52 : } A + a = 30 + 15 = 45 \text{ m}$$

$$\text{ø6.35 : } b + c + d = 10 + 10 + 20 = 40 \text{ m}$$

The total capacity of connected indoor unit is as follows:


$$7.1 + 4.5 + 2.8 + 2.2 = 16.6$$

<Calculation example>

Additional refrigerant charge

$$40 \times \frac{19.0}{1000} + 45 \times \frac{50.0}{1000} + 3.0 = 6.1 \text{ kg (rounded up)}$$

Mixed Method
Connection Examples
(Connecting to 1 Branch box)

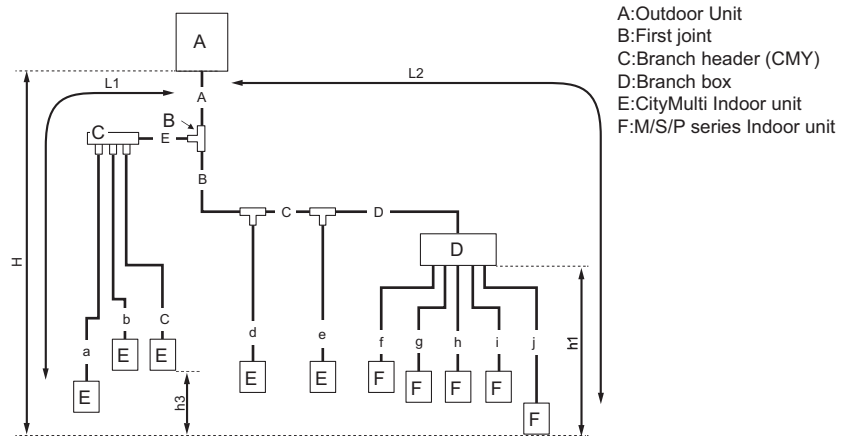

Permissible length (One-way)	Total piping length	$A+B+C+D+E+a+b+c+d+e+f+g+h+i+j \leq 120 \text{ m}$
	Farthest piping length (L1)	$A+E+a$ or $A+B+C+e \leq 70 \text{ m}$
	Farthest piping length. Via Branch box (L2)	$A+B+C+D+j \leq 80 \text{ m}$
	Piping length between outdoor unit and branch box	$A+B+C+D \leq 55 \text{ m}$
	Farthest piping length from the first joint	$B+C+D$ or $E+a \leq 50 \text{ m}$
	Farthest piping length after branch box	$j \leq 25 \text{ m}$
	Total piping length between branch boxes and indoor units	$f+g+h+i+j \leq 95 \text{ m}$
Permissible height difference (One-way)	In indoor/outdoor section (H)*	$H \leq 50 \text{ m}$ (In the case of outdoor unit is set higher than indoor unit) $H \leq 30 \text{ m}$ (In the case of outdoor unit is set lower than indoor unit)
	In branch box/indoor unit section (h1)	$h1 \leq 15 \text{ m}$
	In each indoor unit (h3)	$h3 \leq 12 \text{ m}$
Number of bends		≤ 15

*Branch box should be placed within the level between the outdoor unit and indoor units.

■ Selecting the Refrigerant Branch Kit

Please select branching kit, which is sold separately, from the table below.
(The kit comprises sets for use with liquid pipes and for use with gas pipes.)

Branch header (4 branches)	Branch header (8 branches)
CMY-Y64-G-E	CMY-Y68-G-E

■ Select Each Section of Refrigerant Piping

- (1) Section From Outdoor Unit to Branch box or Branch header (A to E)
(2) Sections From Branch box or Branch header to Indoor Unit (a to j)
- Select the size from the table to the right.

Each Section of Piping

(1) Refrigerant Piping Diameter In Section From Outdoor Unit to Branch box or Branch header (Out-door Unit Piping Diameter)

Model	Piping Diameter (mm)	
PUMY-SP100	Liquid Line	ø9.52
PUMY-SP125	Gas Line	ø15.88
PUMY-SP140		

(2) Refrigerant Piping Diameter In Section From Branch box or Branch header to Indoor Unit (Indoor Unit Piping Diameter)

Indoor unit series	Model Number			A Liquid pipe		B Gas pipe
	kW type	Btu type	MSXZ-MP, MSXZ-FP series	ℓ ≤ 30 m	ℓ > 30 m	
CityMulti	15 to 50	—	—	ø6.35	ø9.52	ø12.7
	63 to 140	—	—	ø9.52	ø15.88	
M series or S series	22 to 42	09 to 15	22 to 32	ø6.35	ø9.52	ø12.7
	50	18	—	ø6.35	ø15.88	
	60	24	50	ø6.35	ø15.88	
	71	26	63	ø9.52	ø15.88	
P series	35 to 50	18	—	ø6.35	ø12.7	ø15.88
	60 to 100	24 to 30	—	ø9.52	ø15.88	


Note:

When connecting the CONNECTION KIT (PAC-LV11M-J) and an M-series indoor unit, refer to the installation manual for the CONNECTION KIT when selecting the pipe size and piping length.

■ Additional refrigerant charge

Refer to the same section in the previous page.

Mixed Method
Connection Examples
(Connecting to 2 Branch boxes)

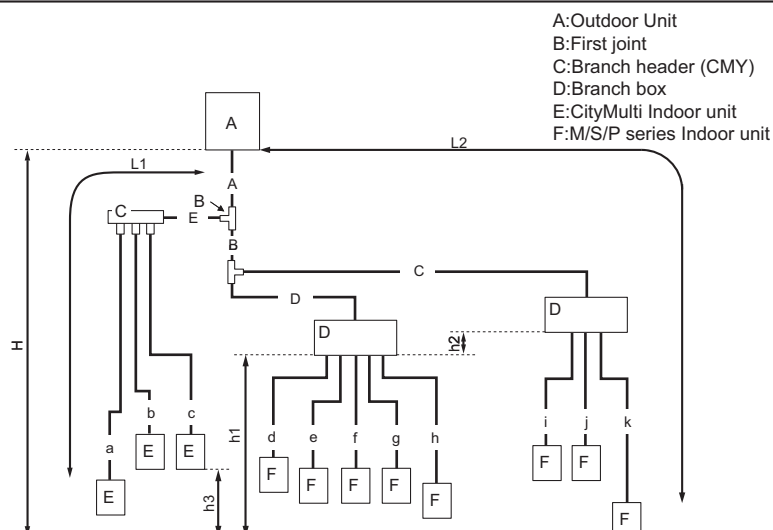

Permissible length (One-way)	Total piping length	$A+B+C+D+E+a+b+c+d+e+f+g+h+i+j+k \leq 120 \text{ m}$
	Farthest piping length (L1)	$A+E+a \leq 70 \text{ m}$
	Farthest piping length. Via Branch box (L2)	$A+B+C+k \leq 80 \text{ m}$
	Piping length between outdoor unit and branch boxes	$A+B+C+D \leq 55 \text{ m}$
	Farthest piping length from the first joint	$B+C \text{ or } E+a \leq 50 \text{ m}$
	Farthest piping length after branch box	$k \leq 25 \text{ m}$
	Farthest branch box from outdoor unit	$A+B+C \leq 55 \text{ m}$
Permissible height difference (One-way)	Total piping length between branch boxes and indoor units	$d+e+f+g+h+i+j+k \leq 95 \text{ m}$
	In indoor/outdoor section (H)*	$H \leq 50 \text{ m}$ (In the case of outdoor unit is set higher than indoor unit) $H \leq 30 \text{ m}$ (In the case of outdoor unit is set lower than indoor unit)
	In branch box/indoor unit section (h1)	$h1+h2 \leq 15 \text{ m}$
	In each branch unit (h2)	$h2 \leq 15 \text{ m}$
Number of bends		≤ 15

*Branch box should be placed within the level between the outdoor unit and indoor units.

■ Selecting the Refrigerant Branch Kit

Please select branching kit, which is sold separately, from the table below.
(The kit comprises sets for use with liquid pipes and for use with gas pipes.)

Branch header (4 branches)	Branch header (8 branches)
CMY-Y64-G-E	CMY-Y68-G-E

■ Select Each Section of Refrigerant Piping

- (1) Section From Outdoor Unit to Branch box or Branch header (A to E)
- (2) Sections From Branch box or Branch header to Indoor Unit (a to k)
- Each Section of Piping
- Select the size from the table to the right.

(1) Refrigerant Piping Diameter In Section From Outdoor Unit to Branch box or Branch header (Out-door Unit Piping Diameter)

Model	Piping Diameter (mm)	
PUMY-SP100	Liquid Line	ø9.52
PUMY-SP125	Gas Line	ø15.88
PUMY-SP140	Gas Line	ø15.88

(2) Refrigerant Piping Diameter In Section From Branch box or Branch header to Indoor Unit (Indoor Unit Piping Diameter)

Indoor unit series	Model Number			A Liquid pipe		B Gas pipe
	kW type	Btu type	MSXZ-MP, MSXZ-FP series	$t \leq 30 \text{ m}$	$t > 30 \text{ m}$	
CityMulti	15 to 50	—	—	ø6.35	ø9.52	ø12.7
	63 to 140	—	—	ø9.52	—	ø15.88
M series or S series	22 to 42	09 to 15	22 to 32	ø6.35	—	ø9.52
	50	18	—	ø6.35	—	ø12.7
	60	24	50	ø6.35	—	ø15.88
P series	71	26	63	ø9.52	—	ø15.88
	35 to 50	18	—	ø6.35	—	ø12.7
	60 to 100	24 to 30	—	ø9.52	—	ø15.88

Note:


When connecting the CONNECTION KIT (PAC-LV11M-J) and an M-series indoor unit, refer to the installation manual for the CONNECTION KIT when selecting the pipe size and piping length.

■ Additional refrigerant charge

Refer to the same section in the previous page.

11-2-3. PUMY-CP100, 125, 140YKM2-PA(-BS)/PUMY-CP112, 125, 140YKM2-TH PUMY-CP100, 125, 140VKM2-PA, DA(-BS)/PUMY-CP112, 125, 140VKM2-TH

Branch box Method Connection Examples (Connecting to 8 Indoor Units)

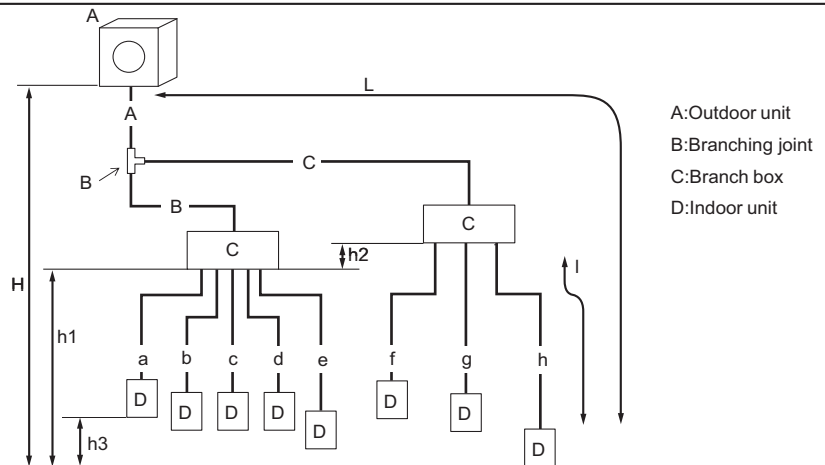

Permissible length (One-way)	Total piping length	$A + B + C + a + b + c + d + e + f + g + h \leq 120 \text{ m}$
	Farthest piping length (L)	$A + C + h \leq 80 \text{ m}$ ($A + C \leq 55 \text{ m}$, $h \leq 25 \text{ m}$)
	Piping length between outdoor unit and branch boxes	$A + B + C \leq 55 \text{ m}$
	Farthest piping length after branch box (I)	$I \leq 25 \text{ m}$
	Total piping length between branch boxes and indoor units	$a + b + c + d + e + f + g + h \leq 95 \text{ m}$
Permissible height difference (One-way)	In indoor/outdoor section (H)*	$H \leq 50 \text{ m}$ (In the case of that outdoor unit is set higher than indoor unit) $H \leq 30 \text{ m}$ (In the case of that outdoor unit is set lower than indoor unit)
	In branch box/indoor unit section (h1)	$h1 + h2 \leq 15 \text{ m}$
	In each branch unit (h2)	$h2 \leq 15 \text{ m}$
	In each indoor unit (h3)	$h3 \leq 12 \text{ m}$
Number of bends		≤ 15

*Branch box should be placed within the level between the outdoor unit and indoor units.

■ Select Each Section of Refrigerant Piping

- (1) Section From Outdoor Unit to Branch box (A, B, C)
(2) Sections From Branch box to Indoor Unit (a to h)
- Each Section of Piping

Select the size from the table to the right.

(1) Refrigerant Piping Diameter In Section From Outdoor Unit to Branch box (Outdoor Unit Piping Diameter)

Model	Piping Diameter (mm)
PUMY-CP100 PUMY-CP112 PUMY-CP125 PUMY-CP140	Liquid Line $\phi 9.52$
	Gas Line $\phi 15.88$

(2) Refrigerant Piping Diameter In Section From Branch box to Indoor Unit (Indoor Unit Piping Diameter)

Indoor unit series	kW type	BTU type	A Liquid pipe	B Gas pipe
M series or S series	15 to 42	09 to 13	ø6.35	ø9.52
	50	18	ø6.35	ø12.7
	60	24	ø6.35	ø15.88
	71	26	ø9.52	ø15.88
P series	35,50	18	ø6.35	ø12.7
	60 to 100	24, 30	ø9.52	ø15.88
Indoor unit series	CAL type		A Liquid pipe	B Gas pipe
MSXZ-FP Series or MSXY-MP Series	22 to 32		ø6.35	ø9.52
	50		ø6.35	ø15.88
	63		ø9.52	ø15.88

■ Additional refrigerant charge

Refrigerant for the extended piping is not included in the outdoor unit when the unit is shipped from the factory. Therefore, charge each refrigerant piping system with additional refrigerant at the installation site. In addition, in order to carry out service, enter the size and length of each liquid pipe and additional refrigerant charge amounts in the spaces provided on the "Refrigerant amount" plate on the outdoor unit.

Calculation of additional refrigerant charge

- Calculate the additional charge using the liquid pipe size and length of the extended piping and total capacity of connected indoor units.
- Calculate the additional refrigerant charge using the procedure shown to the right, and charge with the additional refrigerant.
- For amounts less than 0.1 kg, round up the calculated additional refrigerant charge.
(For example, if the calculated charge is 6.01 kg, round up the charge to 6.1 kg.)

<Additional Charge>

Calculation of refrigerant charge

Pipe size Liquid pipe $\phi 6.35$ (m) $\times$ 19.0 (g/m)	+	Pipe size Liquid pipe $\phi 9.52$ (m) $\times$ 50.0 (g/m)	+
--	---	--	---

Total capacity of connected indoor units	Amount for the indoor units
up to 8.0 kW	1.5 kg
8.1 to 16.0 kW	2.5 kg
16.1 kW or above	3.0 kg

Included refrigerant amount when shipped from the factory

Included refrigerant amount
2.9 kg

<Example>

Outdoor model : CP125	A : $\phi 9.52 \text{ mm}$	30 m
Indoor 1 : P63 (7.1 kW)	a : $\phi 9.52 \text{ mm}$	15 m
2 : P40 (4.5 kW)	b : $\phi 6.35 \text{ mm}$	10 m
3 : P25 (2.8 kW)	c : $\phi 6.35 \text{ mm}$	10 m
4 : P20 (2.2 kW)	d : $\phi 6.35 \text{ mm}$	20 m

At the conditions below:

The total length of each liquid line is as follows:

$$\phi 9.52 : A + a = 30 + 15 = 45 \text{ m}$$

$$\phi 6.35 : b + c + d = 10 + 10 + 20 = 40 \text{ m}$$

The total capacity of connected indoor unit is as follows:


$$7.1 + 4.5 + 2.8 + 2.2 = 16.6$$

<Calculation example>

Additional refrigerant charge

$$40 \times \frac{19.0}{1000} + 45 \times \frac{50.0}{1000} + 3.0 = 6.1 \text{ kg (rounded up)}$$

Mixed Method
Connection Examples
(Connecting to 1 Branch box)

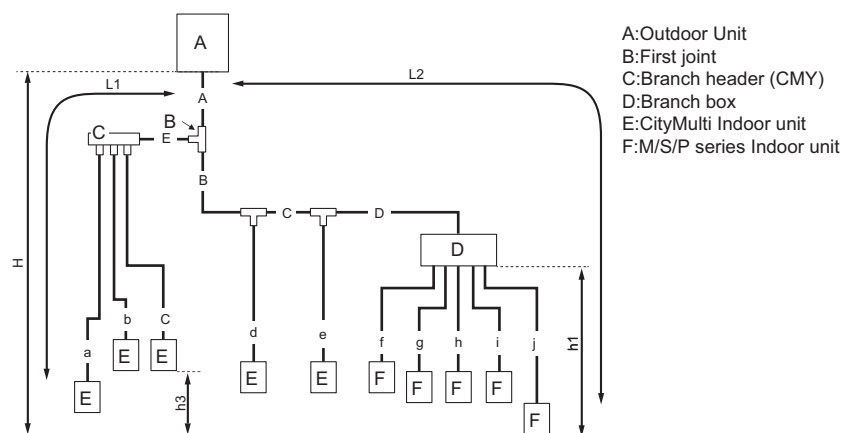

Permissible length (One-way)	Total piping length	$A+B+C+D+E+a+b+c+d+e+f+g+h+i+j \leq 120 \text{ m}$
	Farthest piping length (L1)	$A+E+a$ or $A+B+C+e \leq 70 \text{ m}$
	Farthest piping length. Via Branch box (L2)	$A+B+C+D+j \leq 80 \text{ m}$
	Piping length between outdoor unit and branch box	$A+B+C+D \leq 55 \text{ m}$
	Farthest piping length from the first joint	$B+C+D$ or $B+C+e \leq 50 \text{ m}$
	Farthest piping length after branch box	$j \leq 25 \text{ m}$
	Total piping length between branch boxes and indoor units	$f+g+h+i+j \leq 95 \text{ m}$
Permissible height difference (One-way)	In indoor/outdoor section (H)*	$H \leq 50 \text{ m}$ (In the case of outdoor unit is set higher than indoor unit) $H \leq 30 \text{ m}$ (In the case of outdoor unit is set lower than indoor unit)
	In branch box/indoor unit section (h1)	$h1 \leq 15 \text{ m}$
	In each indoor unit (h3)	$h3 \leq 12 \text{ m}$
Number of bends		≤ 15

*Branch box should be placed within the level between the outdoor unit and indoor units.

■ Selecting the Refrigerant Branch Kit

Please select branching kit, which is sold separately, from the table below.
(The kit comprises sets for use with liquid pipes and for use with gas pipes.)

Branch header (4 branches)	Branch header (8 branches)
CMY-Y64-G-E	CMY-Y68-G-E

■ Select Each Section of Refrigerant Piping

- (1) Section From Outdoor Unit to Branch box or Branch header (A to E)
(2) Sections From Branch box or Branch header to Indoor Unit (a to j)
- Each Section of Piping
- Select the size from the table to the right.

(1) Refrigerant Piping Diameter In Section From Outdoor Unit to Branch box or Branch header (Out-door Unit Piping Diameter)

Model	Piping Diameter (mm)	
PUMY-CP100 PUMY-CP112 PUMY-CP125 PUMY-CP140	Liquid Line	ø9.52
	Gas Line	ø15.88

(2) Refrigerant Piping Diameter In Section From Branch box or Branch header to Indoor Unit (Indoor Unit Piping Diameter)

Indoor unit series	kW type	BTU type	A Liquid pipe		B Gas pipe
CityMulti	15 to 50	—	$l \leq 30 \text{ m}$	ø6.35	ø12.7
			$l > 30 \text{ m}$	ø9.52	
M series or S series	63 to 140	—	ø9.52		ø15.88
	22 to 42	09 to 13	ø6.35		ø9.52
	50	18	ø6.35		ø12.7
	60	24	ø6.35		ø15.88
P series	71	26	ø9.52		ø15.88
	35,50	18	ø6.35		ø12.7
	60 to 100	24, 30	ø9.52		ø15.88

Indoor unit series	CAL type	A Liquid pipe	B Gas pipe
MSXZ-FP Series or MSXY-MP Series	22 to 32	ø6.35	ø9.52
	50	ø6.35	ø15.88
	63	ø9.52	ø15.88


Note:

When connecting the CONNECTION KIT (PAC-LV11M-J) and an M-series indoor unit, refer to the installation manual for the CONNECTION KIT when selecting the pipe size and piping length.

■ Additional refrigerant charge

Refer to the same section in the previous page.

Mixed Method
Connection Examples
(Connecting to 2 Branch boxes)

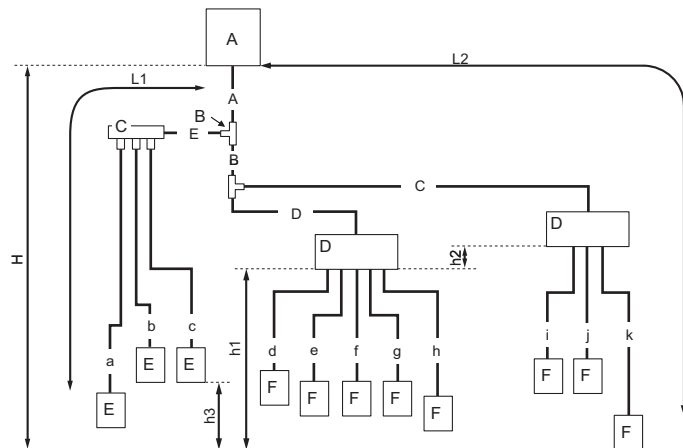

Permissible length (One-way)	Total piping length	$A+B+C+D+E+a+b+c+d+e+f+g+h+i+j+k \leq 120 \text{ m}$
	Farthest piping length (L1)	$A+E+a \leq 70 \text{ m}$
	Farthest piping length. Via Branch box (L2)	$A+B+C+k \leq 80 \text{ m}$
	Piping length between outdoor unit and branch boxes	$A+B+C+D \leq 55 \text{ m}$
	Farthest piping length from the first joint	$B+C \text{ or } E+a \leq 50 \text{ m}$
	Farthest piping length after branch box	$k \leq 25 \text{ m}$
	Farthest branch box from outdoor unit	$A+B+C \leq 55 \text{ m}$
	Total piping length between branch boxes and indoor units	$d+e+f+g+h+i+j+k \leq 95 \text{ m}$
Permissible height difference (One-way)	In indoor/outdoor section (H)*	$H \leq 50 \text{ m}$ (In the case of outdoor unit is set higher than indoor unit) $H \leq 30 \text{ m}$ (In the case of outdoor unit is set lower than indoor unit)
	In branch box/indoor unit section (h1)	$h1+h2 \leq 15 \text{ m}$
	In each branch unit (h2)	$h2 \leq 15 \text{ m}$
	In each indoor unit (h3)	$h3 \leq 12 \text{ m}$
Number of bends		≤ 15

*Branch box should be placed within the level between the outdoor unit and indoor units.

■ Selecting the Refrigerant Branch Kit

Please select branching kit, which is sold separately, from the table below.
(The kit comprises sets for use with liquid pipes and for use with gas pipes.)

Branch header (4 branches)	Branch header (8 branches)
CMY-Y64-G-E	CMY-Y68-G-E

■ Select Each Section of Refrigerant Piping

- (1) Section From Outdoor Unit to Branch box or Branch header (A to E)
(2) Sections From Branch box or Branch header to Indoor Unit (a to k)
- Each Section of Piping

Select the size from the table to the right.

- (1) Refrigerant Piping Diameter In Section From Outdoor Unit to Branch box or Branch header (Out-door Unit Piping Diameter)

Model	Piping Diameter (mm)	
PUMY-CP100 PUMY-CP112 PUMY-CP125 PUMY-CP140	Liquid Line	ø9.52
	Gas Line	ø15.88

- (2) Refrigerant Piping Diameter In Section From Branch box or Branch header to Indoor Unit (Indoor Unit Piping Diameter)

Indoor Unit (Indoor Unit Fitting Diameter)					
Indoor unit series	kW type	BTU type	A Liquid pipe		B Gas pipe
CityMulti	15 to 50	—	$\ell \leq 30 \text{ m}$	$\varnothing 6.35$	$\varnothing 12.7$
			$\ell > 30 \text{ m}$	$\varnothing 9.52$	
	63 to 140	—	$\varnothing 9.52$		$\varnothing 15.88$
M series or S series	22 to 42	09 to 13	$\varnothing 6.35$		$\varnothing 9.52$
	50	18	$\varnothing 6.35$		$\varnothing 12.7$
	60	24	$\varnothing 6.35$		$\varnothing 15.88$
	71	26	$\varnothing 9.52$		$\varnothing 15.88$
P series	35,50	18	$\varnothing 6.35$		$\varnothing 12.7$
	60 to 100	24, 30	$\varnothing 9.52$		$\varnothing 15.88$
Indoor unit series	CAL type		A Liquid pipe		B Gas pipe
MSXZ-FP Series or MSXY-MP Series	22 to 32		$\varnothing 6.35$		$\varnothing 9.52$
	50		$\varnothing 6.35$		$\varnothing 15.88$
	63		$\varnothing 9.52$		$\varnothing 15.88$

Note:

When connecting the CONNECTION KIT (PAC-LV11M-J) and an M-series indoor unit, refer to the installation manual for the CONNECTION KIT when selecting the pipe size and piping length.

■ Additional refrigerant charge

Refer to the same section in the previous page.

11-3. Refrigerant charging calculation

Additional refrigerant charge

Refrigerant for the extended piping is not included in the outdoor unit when the unit is shipped from the factory. Therefore, charge each refrigerant piping system with additional refrigerant at the installation site. In addition, in order to carry out service, enter the size and length of each liquid pipe and additional refrigerant charge amounts in the spaces provided on the "Refrigerant amount" plate on the outdoor unit.

Calculation of additional refrigerant charge

- Calculate the additional charge using the liquid pipe size and length of the extended piping and total capacity of connected indoor units.
- Calculate the additional refrigerant charge using the procedure shown to the right, and charge with the additional refrigerant.
- For amounts less than 0.1 kg, round up the calculated additional refrigerant charge.

(For example, if the calculated charge is 6.01 kg, round up the charge to 6.1 kg.)

<Additional Charge>


Calculation of refrigerant charge

Pipe size Liquid pipe ø6.35 (m) x 19.0 (g/m)	+	Pipe size Liquid pipe ø9.52 (m) x 50.0 (g/m)	+	Total capacity of connected indoor units -8.0kW 8.1-16.0kW 16.1kW-	Amount for the indoor units 1.5kg 2.5kg 3.0kg
---	---	---	---	--	---

Included refrigerant amount when shipped from the factory

Included refrigerant amount	
PUMY-SP	PUMY-CP
3.5kg	2.9kg

Example:

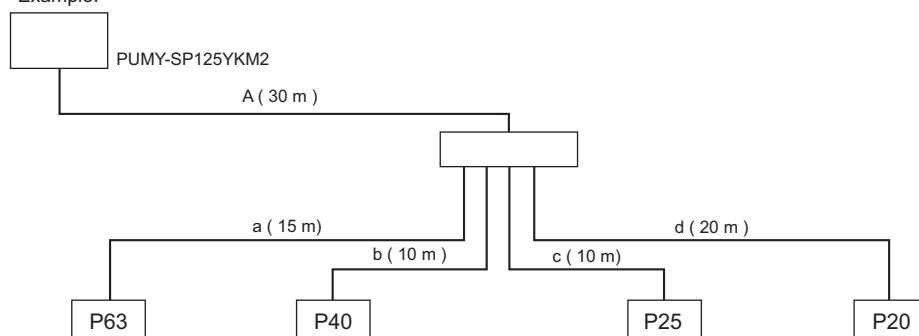

<Example>

Outdoor model: P125
Indoor 1: P63 (7.1kW)
2: P40 (4.5kW)
3: P25 (2.8kW)
4: P20 (2.2kW)

A: ø9.52 30 m
a: ø9.52 15 m
b: ø6.35 10 m
c: ø6.35 10 m
d: ø6.35 20 m

<Calculation example>

Additional refrigerant charge

$$40 \times \frac{19.0}{1000} + 40 \times \frac{50.0}{1000} + 3.0 = 6.1 \text{ kg (rounded up)}$$

The total length of each liquid line is as follows:

ø9.52: A + a = 30 + 15 = 45 m

ø6.35: b + c + d = 10 + 10 + 20 = 40 m

The total capacity of connected indoor unit is as follows:

7.1 + 4.5 + 2.8 + 2.2 = 16.8

Maximum refrigerant charge

There is a limit to the amount of refrigerant that can be charged into a unit. Regardless of the amount yielded by the formula above, observe the maximum refrigerant charge in the table below.

Total index of the outdoor units			SP100	SP125	SP140	CP100	CP112	CP125	CP140
Maximum refrigerant charge	Factory charged	kg	3.5	3.5	3.5	2.9	2.9	2.9	2.9
	Charged on site	kg	9.0	9.0	9.0	9.6	9.6	9.6	9.6
	Total for system	kg	12.5	12.5	12.5	12.5	12.5	12.5	12.5

*1 Maximum refrigerant charge: the amount of factory-charged refrigerant and the amount of refrigerant to be added on site

12-1. Requirement on installation site

12-1-1. General caution

- A. Avoid locations exposed to direct sunlight or other sources of heat.
- B. Select a location from which noise emitted by the unit will not inconvenience the neighbors.
- C. Select a location permitting easy wiring and pipe access to the power source and indoor unit.
- D. Avoid locations where combustible gases may leak, be produced, flow, or accumulate.
- E. Note that water may drain from the unit during operation.
- F. Select a level location that can bear the weight and vibration of the unit.
- G. Avoid locations where the unit can be covered by snow. In areas where heavy snow fall is anticipated, special precautions such as raising the installation location or installing a hood on the air intake must be taken to prevent the snow from blocking the air intake or blowing directly against it. This can reduce the airflow and a malfunction may result.
- H. Avoid locations exposed to oil, steam, or sulfuric gas.
- I. Use the transportation handles of the outdoor unit to transport the unit. If the unit is carried from the bottom, hands or fingers may be pinched.

12-1-2. Installation at windy location.

When installing the outdoor unit on a rooftop or other location unprotected from the wind, situate the air outlet of the unit so that it is not directly exposed to strong winds. Strong wind entering the air outlet may impede the normal airflow and a malfunction may result.

The following shows two examples of precautions against strong winds.

- ① Install an optional air guide if the unit is installed in a location where strong winds from a typhoon, etc. may directly enter the air outlet. (Fig. 12-1-2a)
 - Ⓐ Air guide
- ② Position the unit so that the air outlet blows perpendicularly to the seasonal wind direction, if possible. (Fig. 12-1-2b)
 - Ⓑ Wind direction

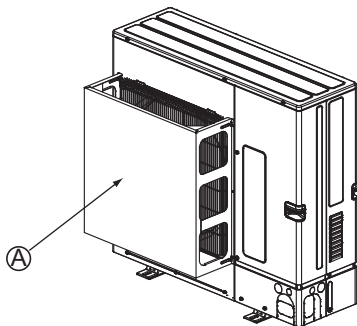


Fig. 12-1-2a

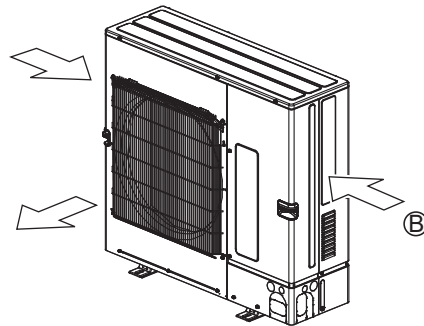


Fig. 12-1-2b


PUMY-SP-VKM2, YKM2, PUMY-CP-VKM2, YKM2

12-1-3. Foundation

- A. Be sure to install the unit in a sturdy, level surface to prevent rattling noises during operation.
(see Fig. 12-1-3)
- B. Foundation specifications are as follows.
- | Thickness of concrete | Weight-bearing capacity | Foundation bolt | Bolt length |
|-----------------------|-------------------------|-----------------|---------------|
| 120 [4-3/4"] | 320 kg [706lbs] | M10 [3/8"] | 70 [2-25/32"] |
- C. Make sure that the length of the foundation bolt is within 30 mm [1-3/16"] of the bottom surface of the base.
- D. Secure the base of the unit firmly with four-M10 [3/8"] foundation bolts in sturdy locations.

- Warning:**
- A. The foundation base should be strong enough to support the outdoor unit, otherwise, it may fall down and cause damage or injuries.
- B. The unit must be installed according to the instructions in order to minimize the risk of damage from earthquakes, typhoons, or strong winds.

- PUMY-SP100, 125, 140VKM2/YKM2
PUMY-CP100, 112, 125, 140VKM2/YKM2

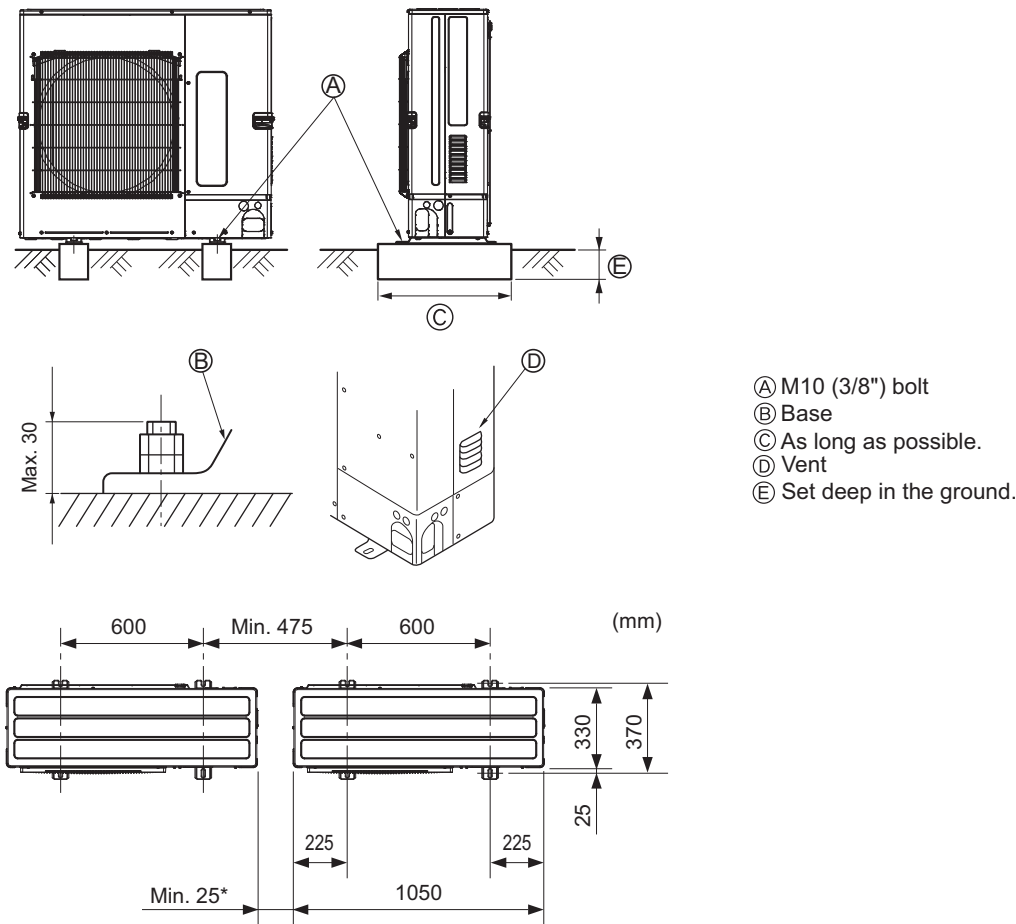

* When installing a single outdoor unit, the clearance is 15 mm or more.

Fig. 12-1-3

12-2. Spacing

12-2-1. PUMY-SP100, 125, 140VKM2/YKM2 PUMY-CP100, 112, 125, 140VKM2/YKM2

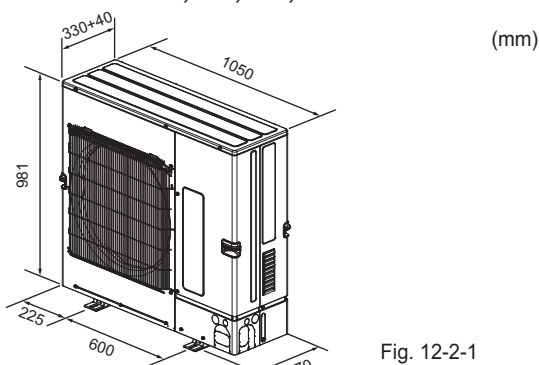


Fig. 12-2-1

12-2-1-1. Spacing individual PUMY-SP-VKM2/YKM2, PUMY-CP-VKM2/YKM2

Follow Fig. 12-2-2~7 to space individual PUMY-SP-VKM2/YKM2 or PUMY-CP-VKM2/YKM2 at the installation site.

PUMY-SP-VKM2/YKM2 or PUMY-CP-VKM2/YKM2 can connect indoor unit sized P15 to P140 and can connect totally 1-12 indoor units with total capacity ranged 50%-130% of the outdoor unit capacity.

Connectable Indoor capacity	Connectable Indoor unit
PUMY-SP100VKM2/YKM2, SP56-SP145	P15-P125, 1-7 units
PUMY-SP125VKM2/YKM2, SP63-SP160	P15-P140, 1-10 units
PUMY-SP140VKM2/YKM2, SP70-SP182	P15-P140, 1-12 units
PUMY-CP100VKM2/YKM2, SP56-SP145	P15-P125, 1-7 units
PUMY-CP112VKM2/YKM2, SP56-SP145	P15-P125, 1-8 units
PUMY-CP125VKM2/YKM2, SP63-SP160	P15-P140, 1-10 units
PUMY-CP140VKM2/YKM2, SP70-SP182	P15-P140, 1-12 units

12-2-1-2. Spacing grouped PUMY-SP-VKM2/YKM2, PUMY-CP-VKM2/YKM2

Follow Fig. 12-2-8~13 to space grouped PUMY-SP-VKM2/YKM2 or PUMY-CP-VKM2/YKM2 at the installation site.

Leave 25 mm space or more between PUMY-SP-VKM2/YKM2 or PUMY-CP-VKM2/YKM2 units.




Fig. 12-2-2
Obstacles at rear only



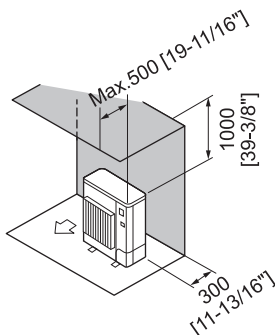


Fig. 12-2-3
Obstacles at rear and above only

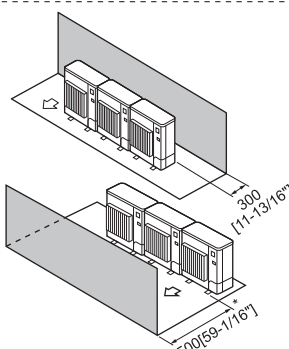

* When using an optional air outlet guide, the clearance is 1000 mm [39-3/8\"/>

Fig. 12-2-8
Obstacles at rear or front only

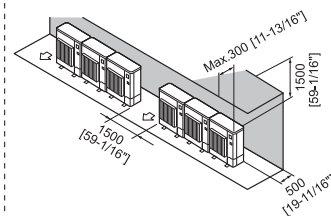

* In case of side-by-side installation, <=3 units;
* Do not install the optional air outlet guides for upward airflow.

Fig. 12-2-9
Obstacles at rear and above only



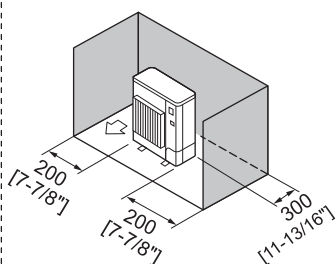


Fig. 12-2-4
Obstacles at rear and sides only




* Using an optional air outlet guide, the clearance >= 500 mm [19-11/16\"/>

Fig. 12-2-5
Obstacles at front only

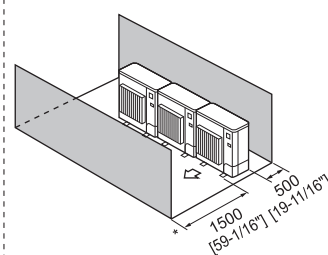


* Using an optional air outlet guide, the clearance >= 1000 mm [39-3/8\"/>

Fig. 12-2-10
Obstacles at front and rear only

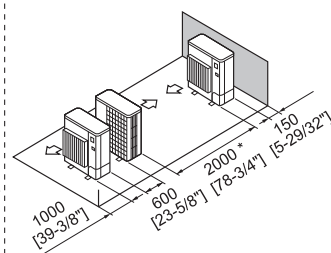


* Using an optional air outlet guide, the clearance >= 1000 mm [39-3/8\"/>

Fig. 12-2-11
Parallel individuals arrangement

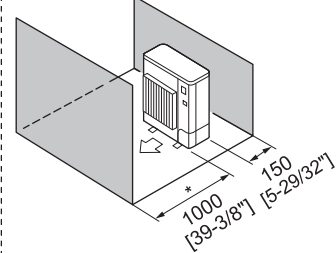


* Using an optional air outlet guide, the clearance >= 500 mm [19-11/16\"/>

Fig. 12-2-6
Obstacles at front and rear only




* NO upward airflow outlet guide.

Fig. 12-2-7
Obstacles at rear, sides and above only

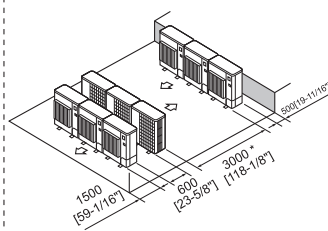

* Using an optional air outlet guide for upward airflow, the clearance >= 1500 mm [59-1/16\"/>

Fig. 12-2-12
Parallel groups arrangement

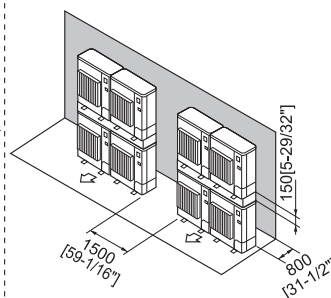


* Stacked layer <= 2 units;
* Side-by-side stacked groups <= 2 groups;


Fig. 12-2-13
Stacked groups arrangement

12-3. Piping direction

PUMY-SP100, 125, 140VKM2/YKM2
 PUMY-CP100, 112, 125, 140VKM2/YKM2

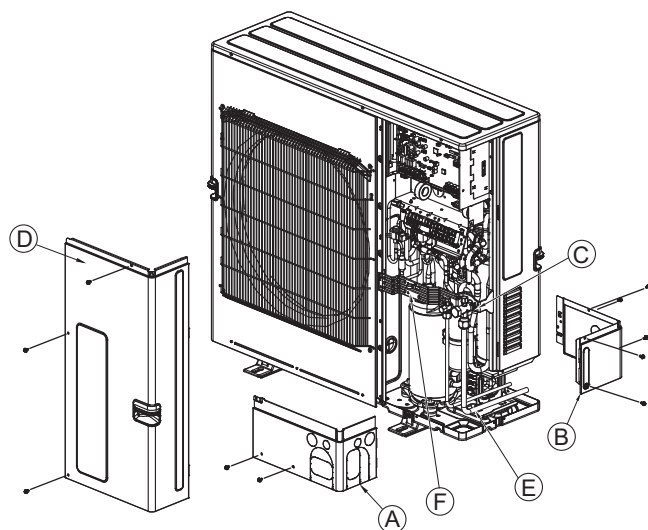

- Ⓐ Front piping cover
- Ⓑ Piping cover
- Ⓒ Stop valve
- Ⓓ Service panel
- Ⓔ Bend radius: 100mm-150mm
- Ⓕ Strap

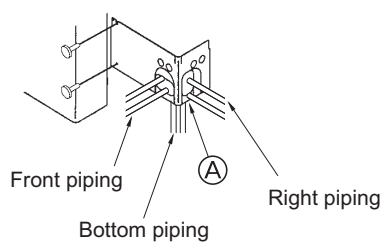

⚠ Warning

- Do not use refrigerant other than the type indicated in the manuals provided with the unit and on the nameplate.
 - Doing so may cause the unit or pipes to burst, or result in explosion or fire during use, repair, or at the time of disposal of the unit.
 - It may also be in violation of applicable laws.
 - MITSUBISHI ELECTRIC CORPORATION cannot be held responsible for malfunctions or accidents resulting from the use of the wrong type of refrigerant.
- Our air conditioning equipment and heat pumps contain a fluorinated greenhouse gas, R410A.

mitsubishi **ELECTRIC CORPORATION**

www.MitsubishiElectric.com