


GEHLBACH
4411

USE GROUP B
CONSTRUCTION TYPE 3-B
ALLOWABLE AREA IS 14,400 SF
ACTUAL AREA IS 11,444 SF
OCCUPANT LOAD BY USE GROUP IS 115
OCCUPANT LOAD BY DESIGN IS 200
1 HOUR CORRIDOR REQUIRED DUE TO OCCUPANT LOAD
DOOR PANIC HARDWARE REQUIRED DUE TO OCCUPANT LOAD
EXIT SIGNS AND EMERGENCY LIGHTING IN CORRIDOR IS REQUIRED
FIRE SUPPRESSION NOT REQUIRED
FIRE ALARM SYSTEM NOT REQUIRED
ATTIC DRAFTSTOPPING IS REQUIRED
MAXIMUM 3,000 SF AREAS

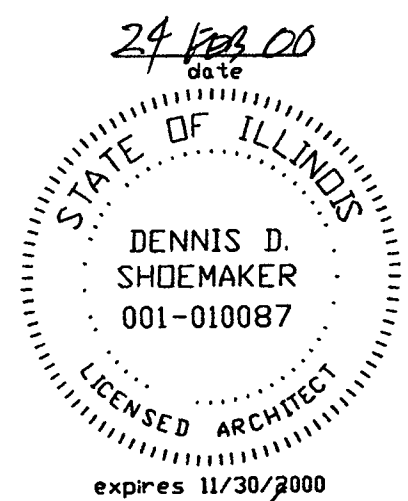


6 SHEETS #1-6
DATED 29 FEB 00

COMPLIANCE WITH THE FOLLOWING IS REQUIRED



1996 BOCA NATIONAL BUILDING CODE
1996 INTERNATIONAL MECHANICAL CODE
1999 NATIONAL ELECTRICAL CODE
ILLINOIS STATE PLUMBING CODE
ILLINOIS ENVIRONMENTAL BARRIERS ACT

THESE DOCUMENTS SHOW THE GENERAL SCOPE AND NATURE OF THIS PROJECT BUT NOT ALL MINOR DETAILS TO CREATE A LEGAL AND FULLY FUNCTIONAL FACILITY. COMPLIANCE WITH ALL CODES IS REQUIRED WHERE THESE DOCUMENTS DO NOT ADDRESS A SPECIFIC DETAIL.

I HAVE PREPARED THE ATTACHED PLANS AND STATE THAT, TO THE BEST OF MY KNOWLEDGE AND BELIEF AND TO THE EXTENT OF MY CONTRACTUAL OBLIGATION, THEY ARE IN COMPLIANCE WITH THE ENVIRONMENTAL BARRIERS ACT AND ACCESSIBILITY CODE OF THE STATE OF ILLINOIS.

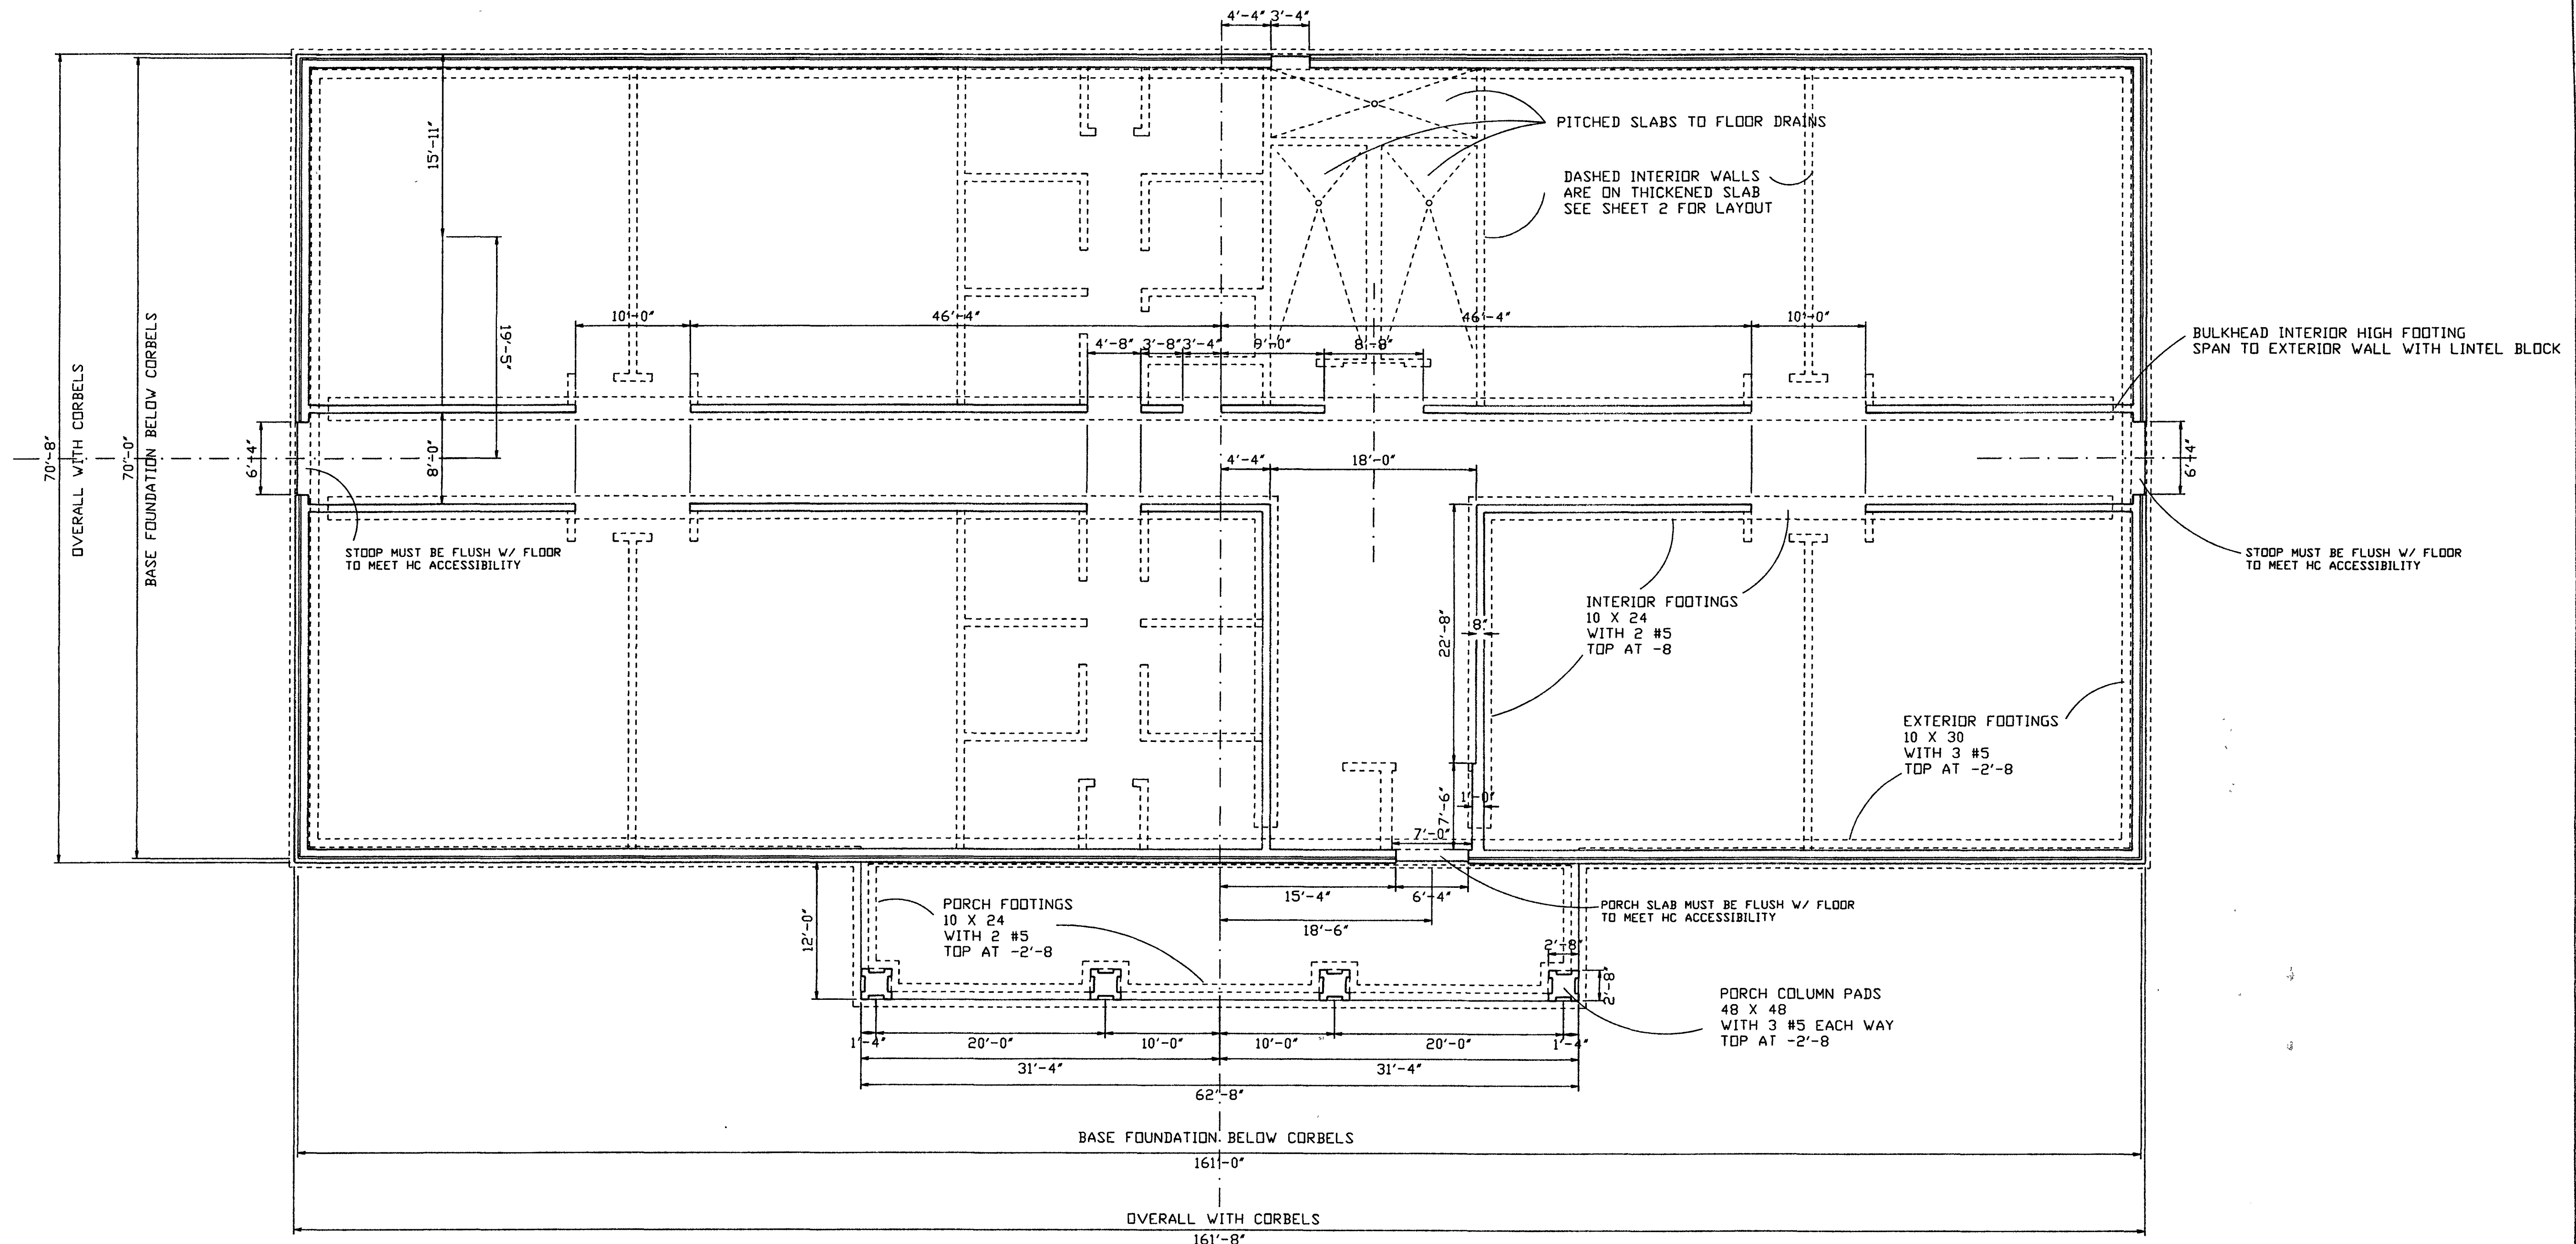


LACE BRICK CORNER STACKS IN BY ALTERNATING DIRECTIONS

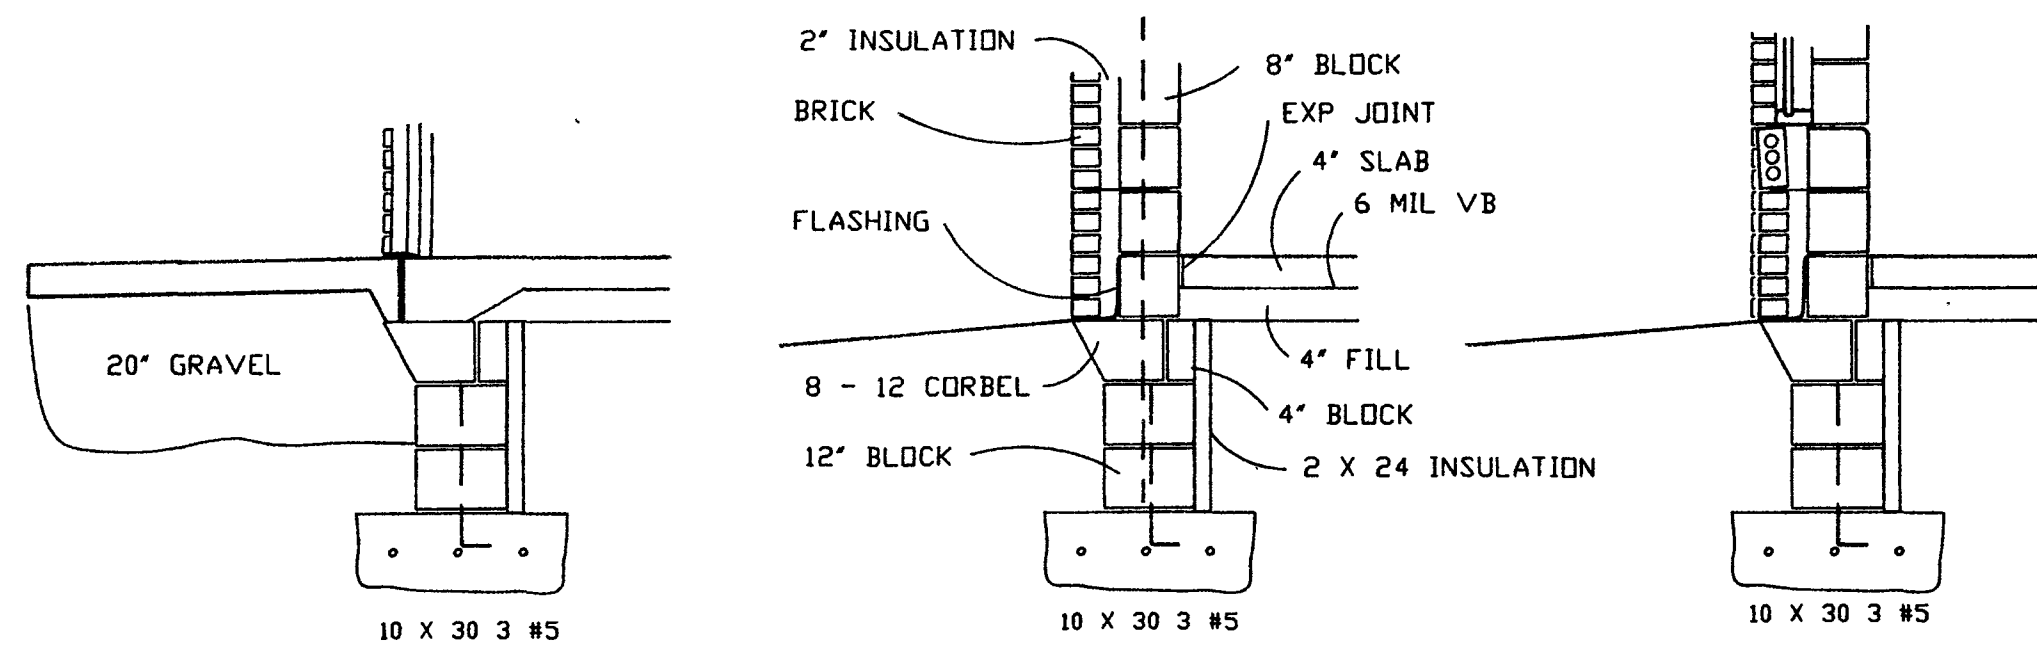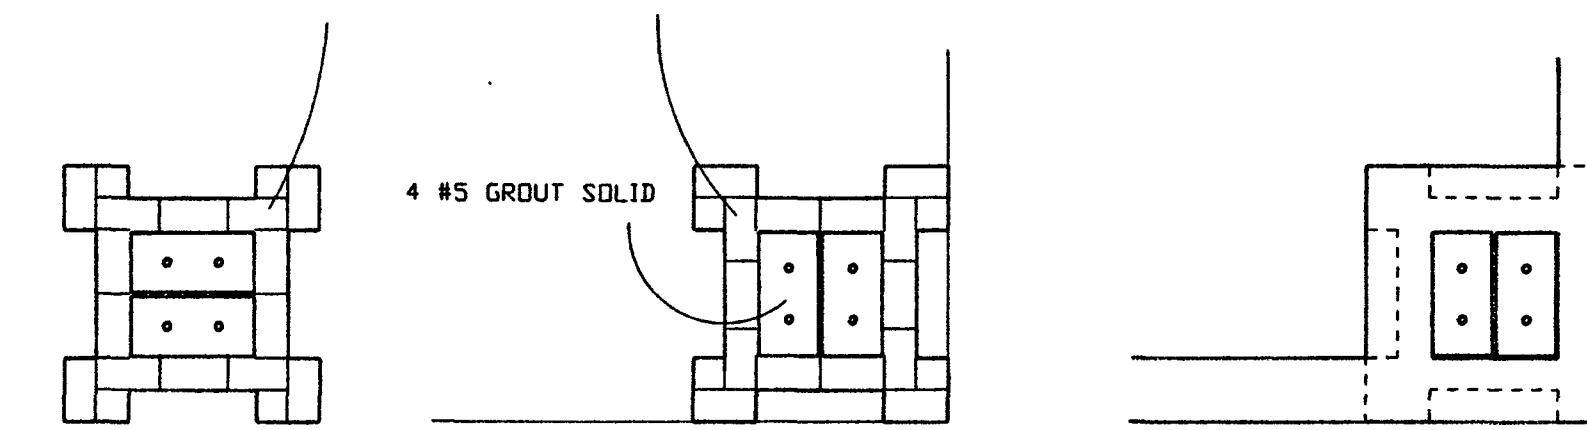


SIDE DOORS

TYPICAL WALL


WINDOW SILL

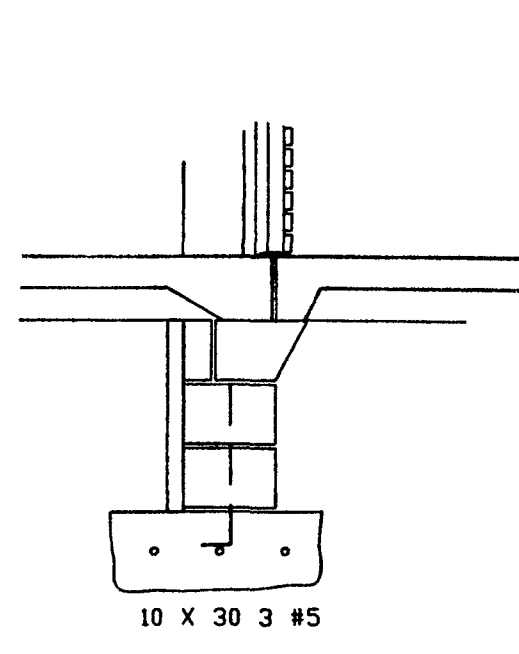


FRONT DOOR

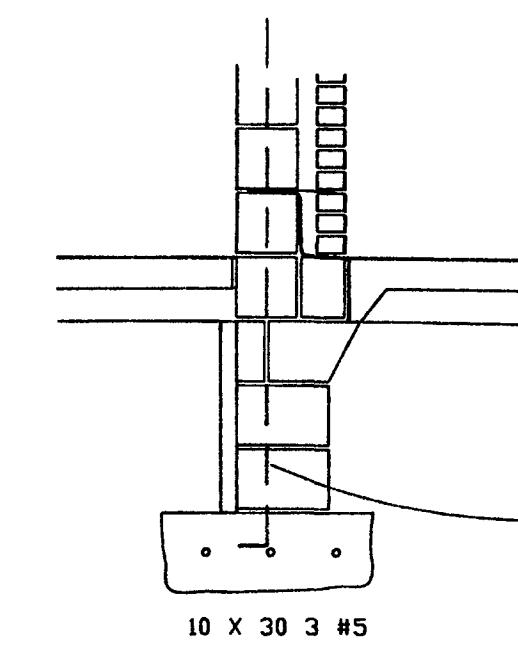


AT CANOPY

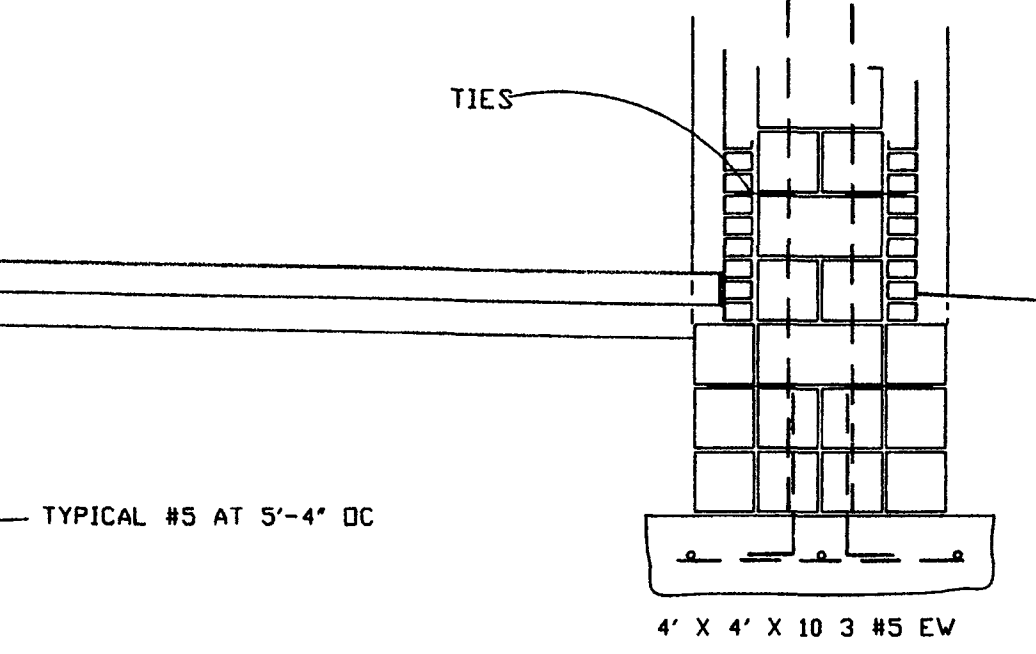

CANOPY PIER

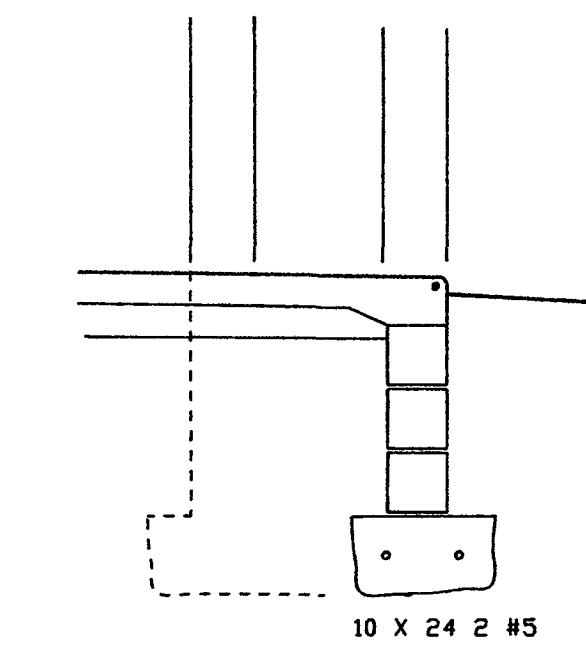

SLAB EDGE AT CANOPY

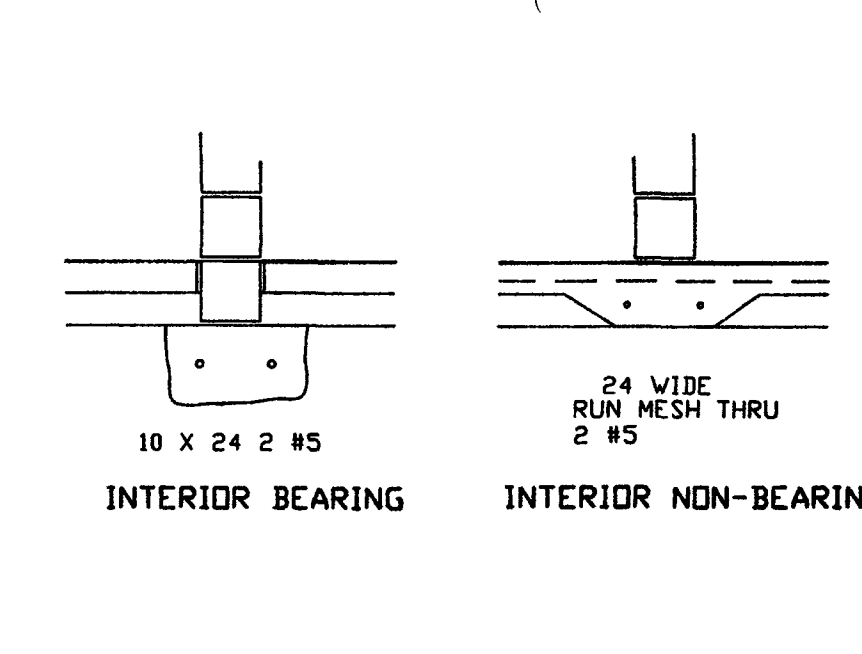

ALL SLABS 4" W/ 6X6 W 1.4 MESH

D. SHOE
DENNIS SHOEMAKER
ARCHITECT


DIVERSIFIED
BUILDINGS, INC.
DESIGN-BUILD 309 637-6725

LINCOLN COLLEGE
LINCOLN, ILLINOIS


CLASSROOM ADDITION
FOUNDATION PLAN

1/8" = 1'-0"


24 FEB 00

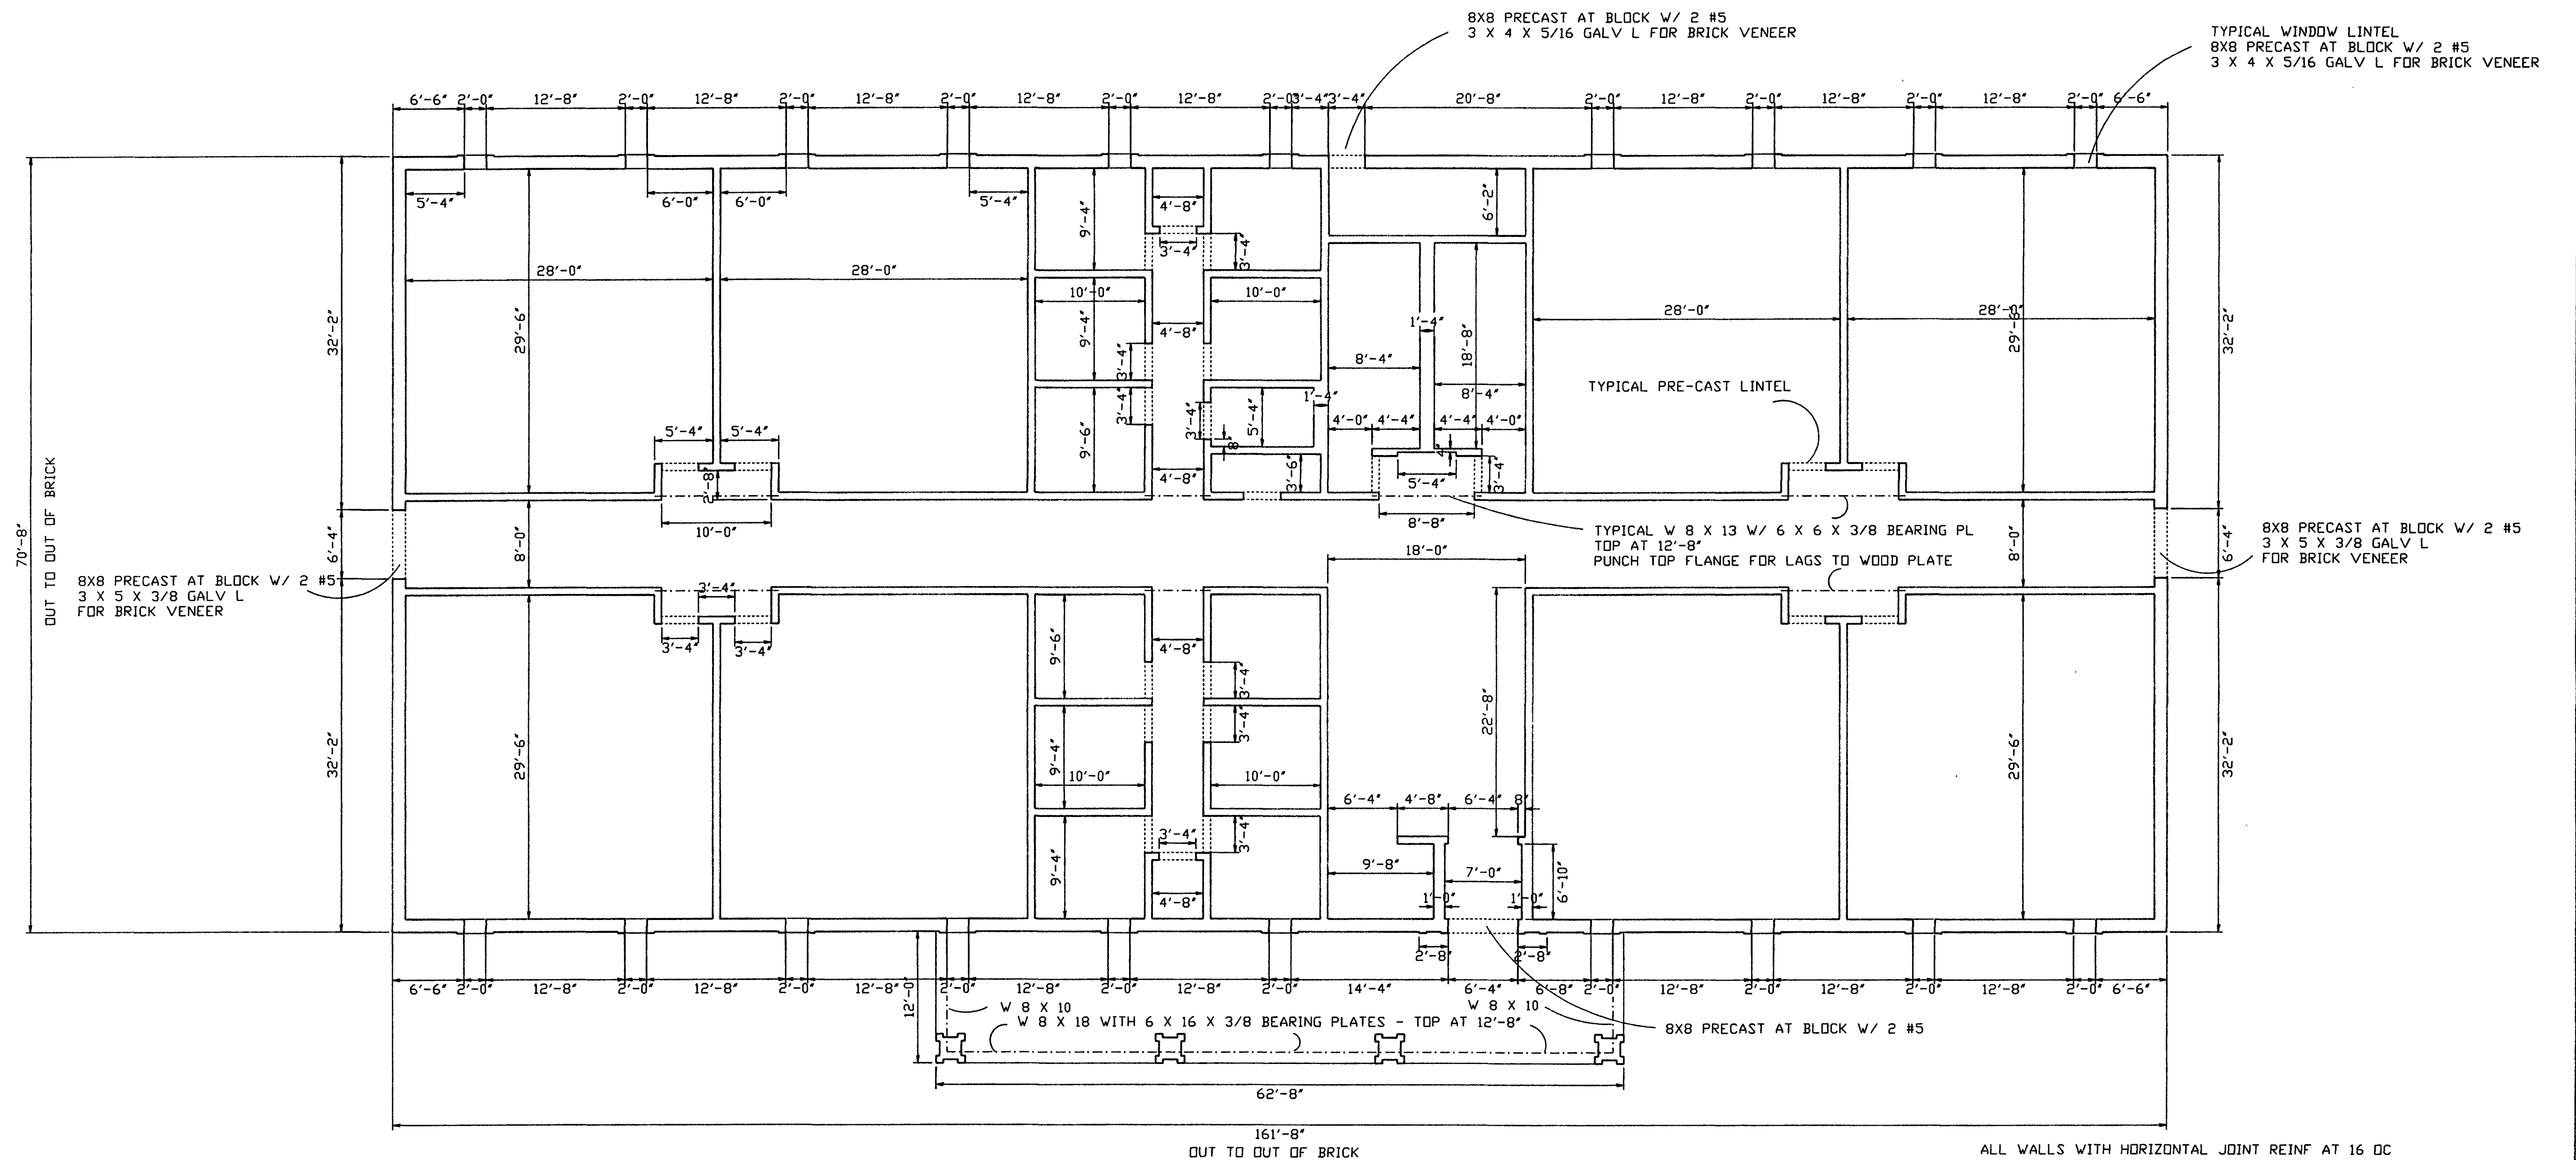



ALL WALLS WITH HORIZONTAL JOINT REINF AT 16 OC
BRICK VENEER TIED TO BLOCK
EXTERIOR WALLS WITH VERT #5
AT EVERY WINDOW AND DOOR JAMB
AND 5'-4" OC BETWEEN
EXTEND FROM FLOOR LINE INTO TOP BOND BEAM
GROUT SOLID
INTERIOR WALLS EXCEEDING 20' BETWEEN INTERSECTING WALLS
#5 IN GROUTED CORE AT 8' OC
BOND BEAM WITH 2 #4 CONT AT ALL WALLS
TOP OF BLOCK AT ALL WALLS 12'-8"
PROVIDE MASONRY CONTROL JOINTS MAX 40' OC

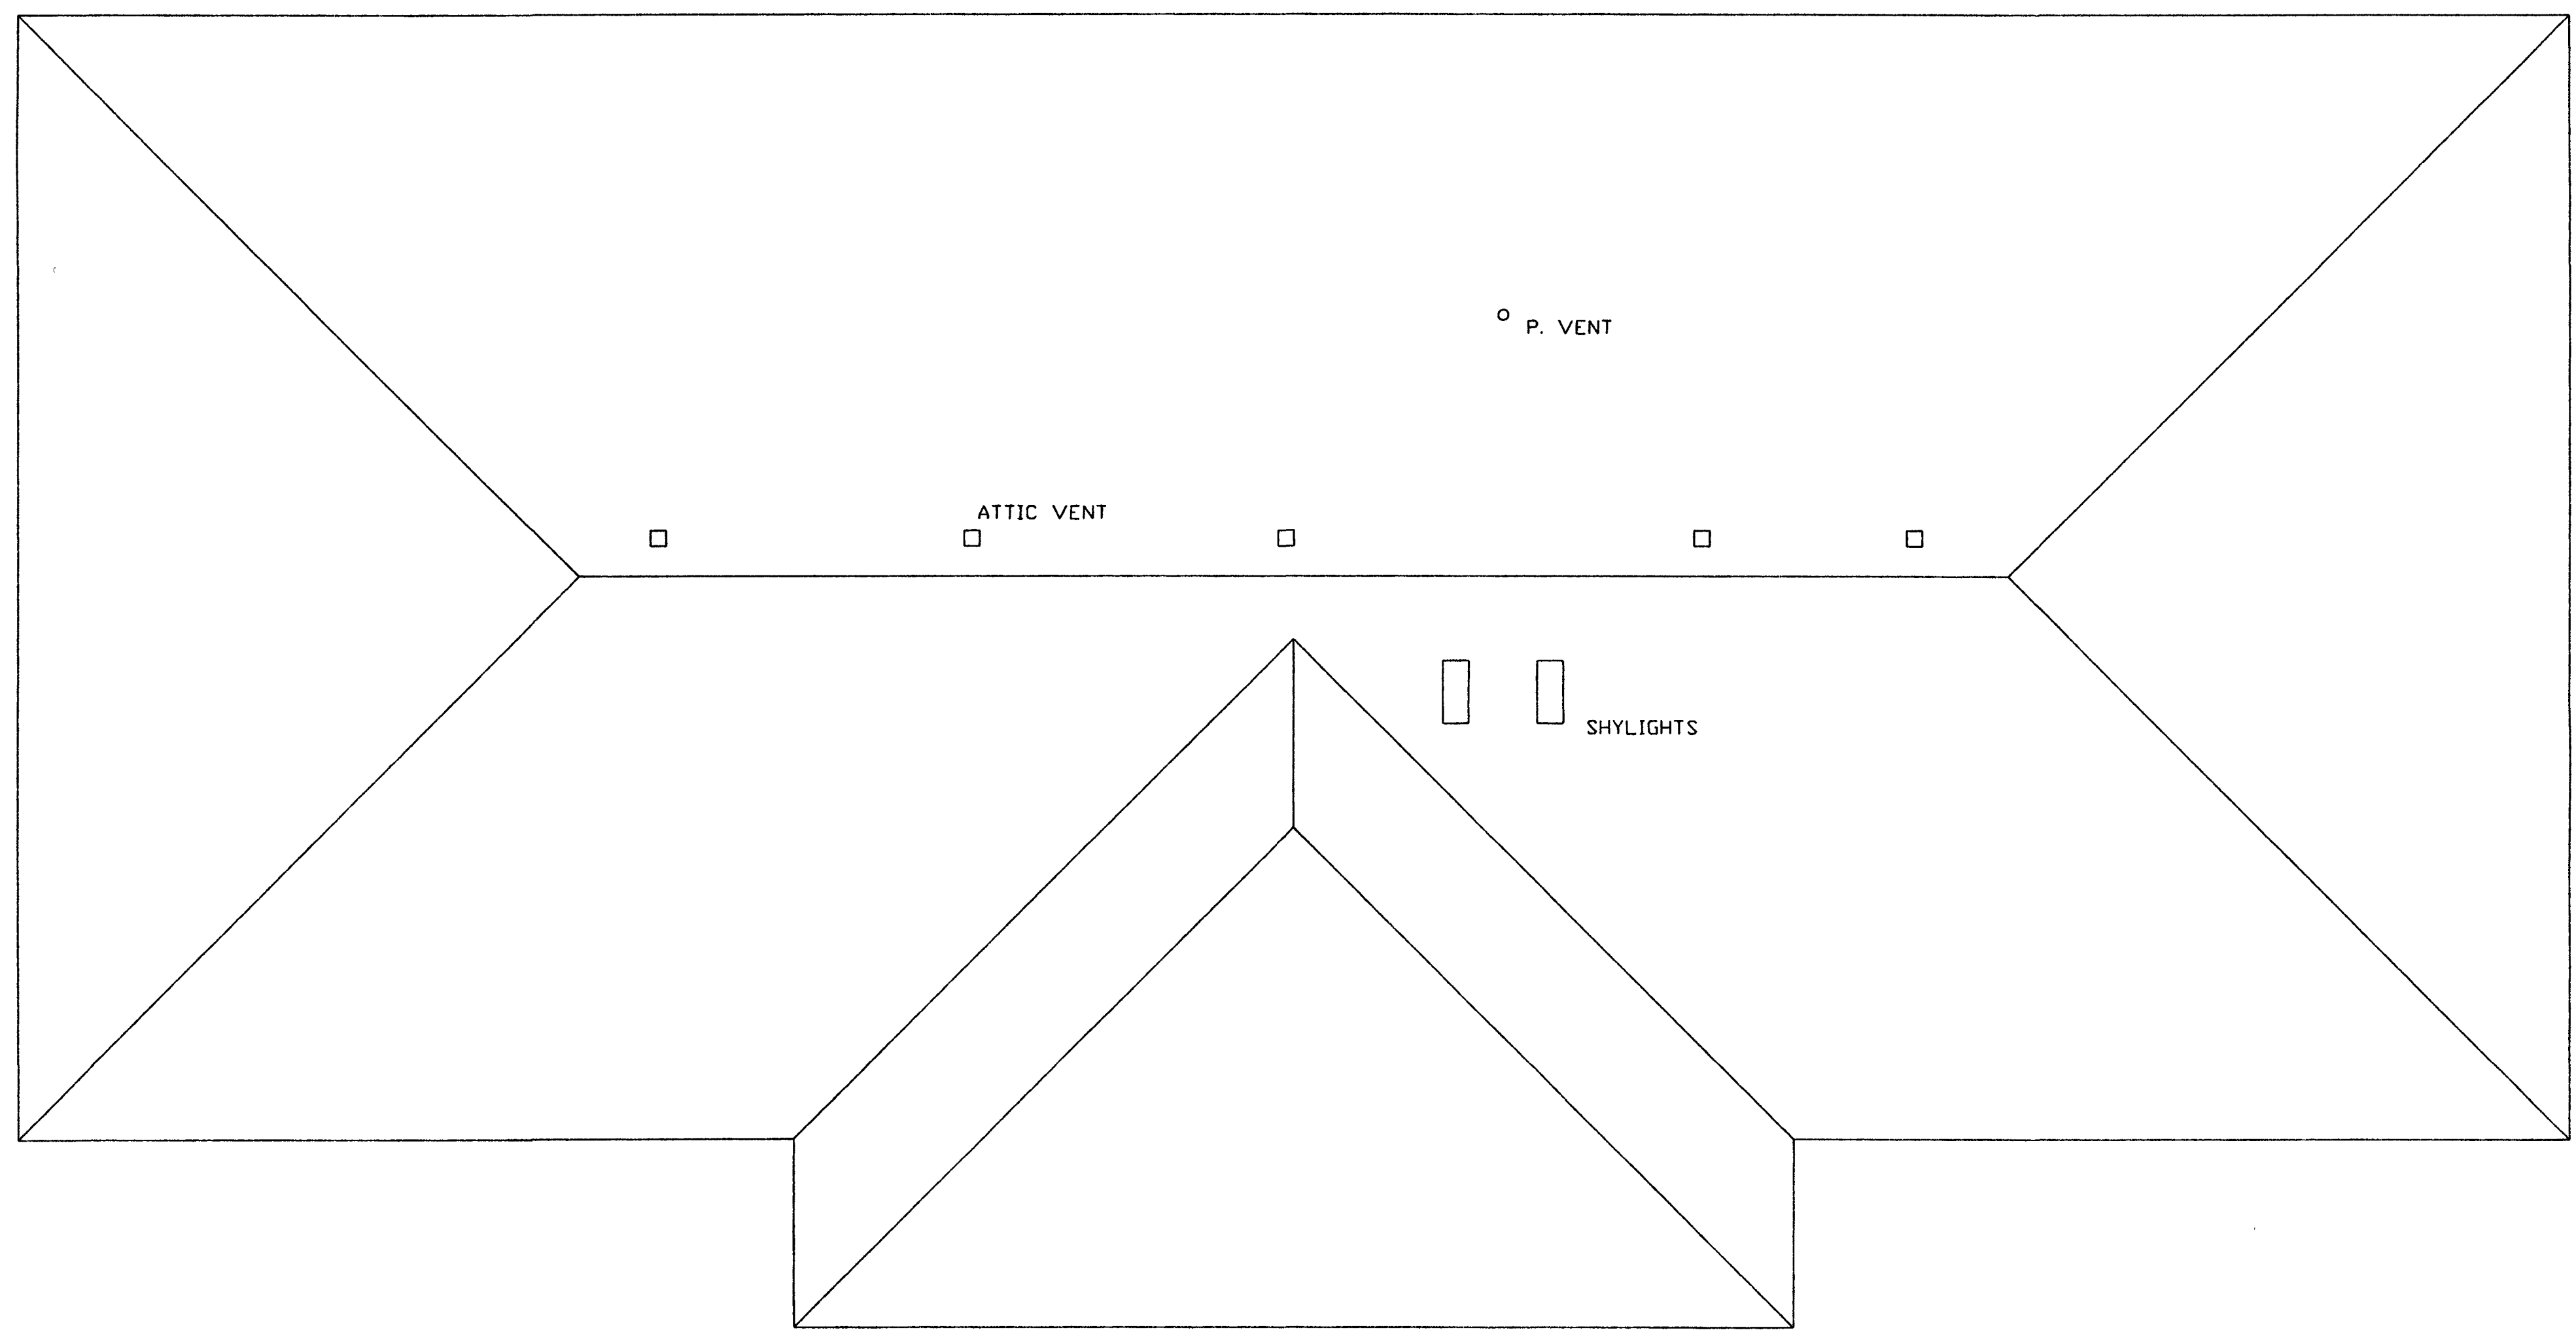


ROOF PLAN

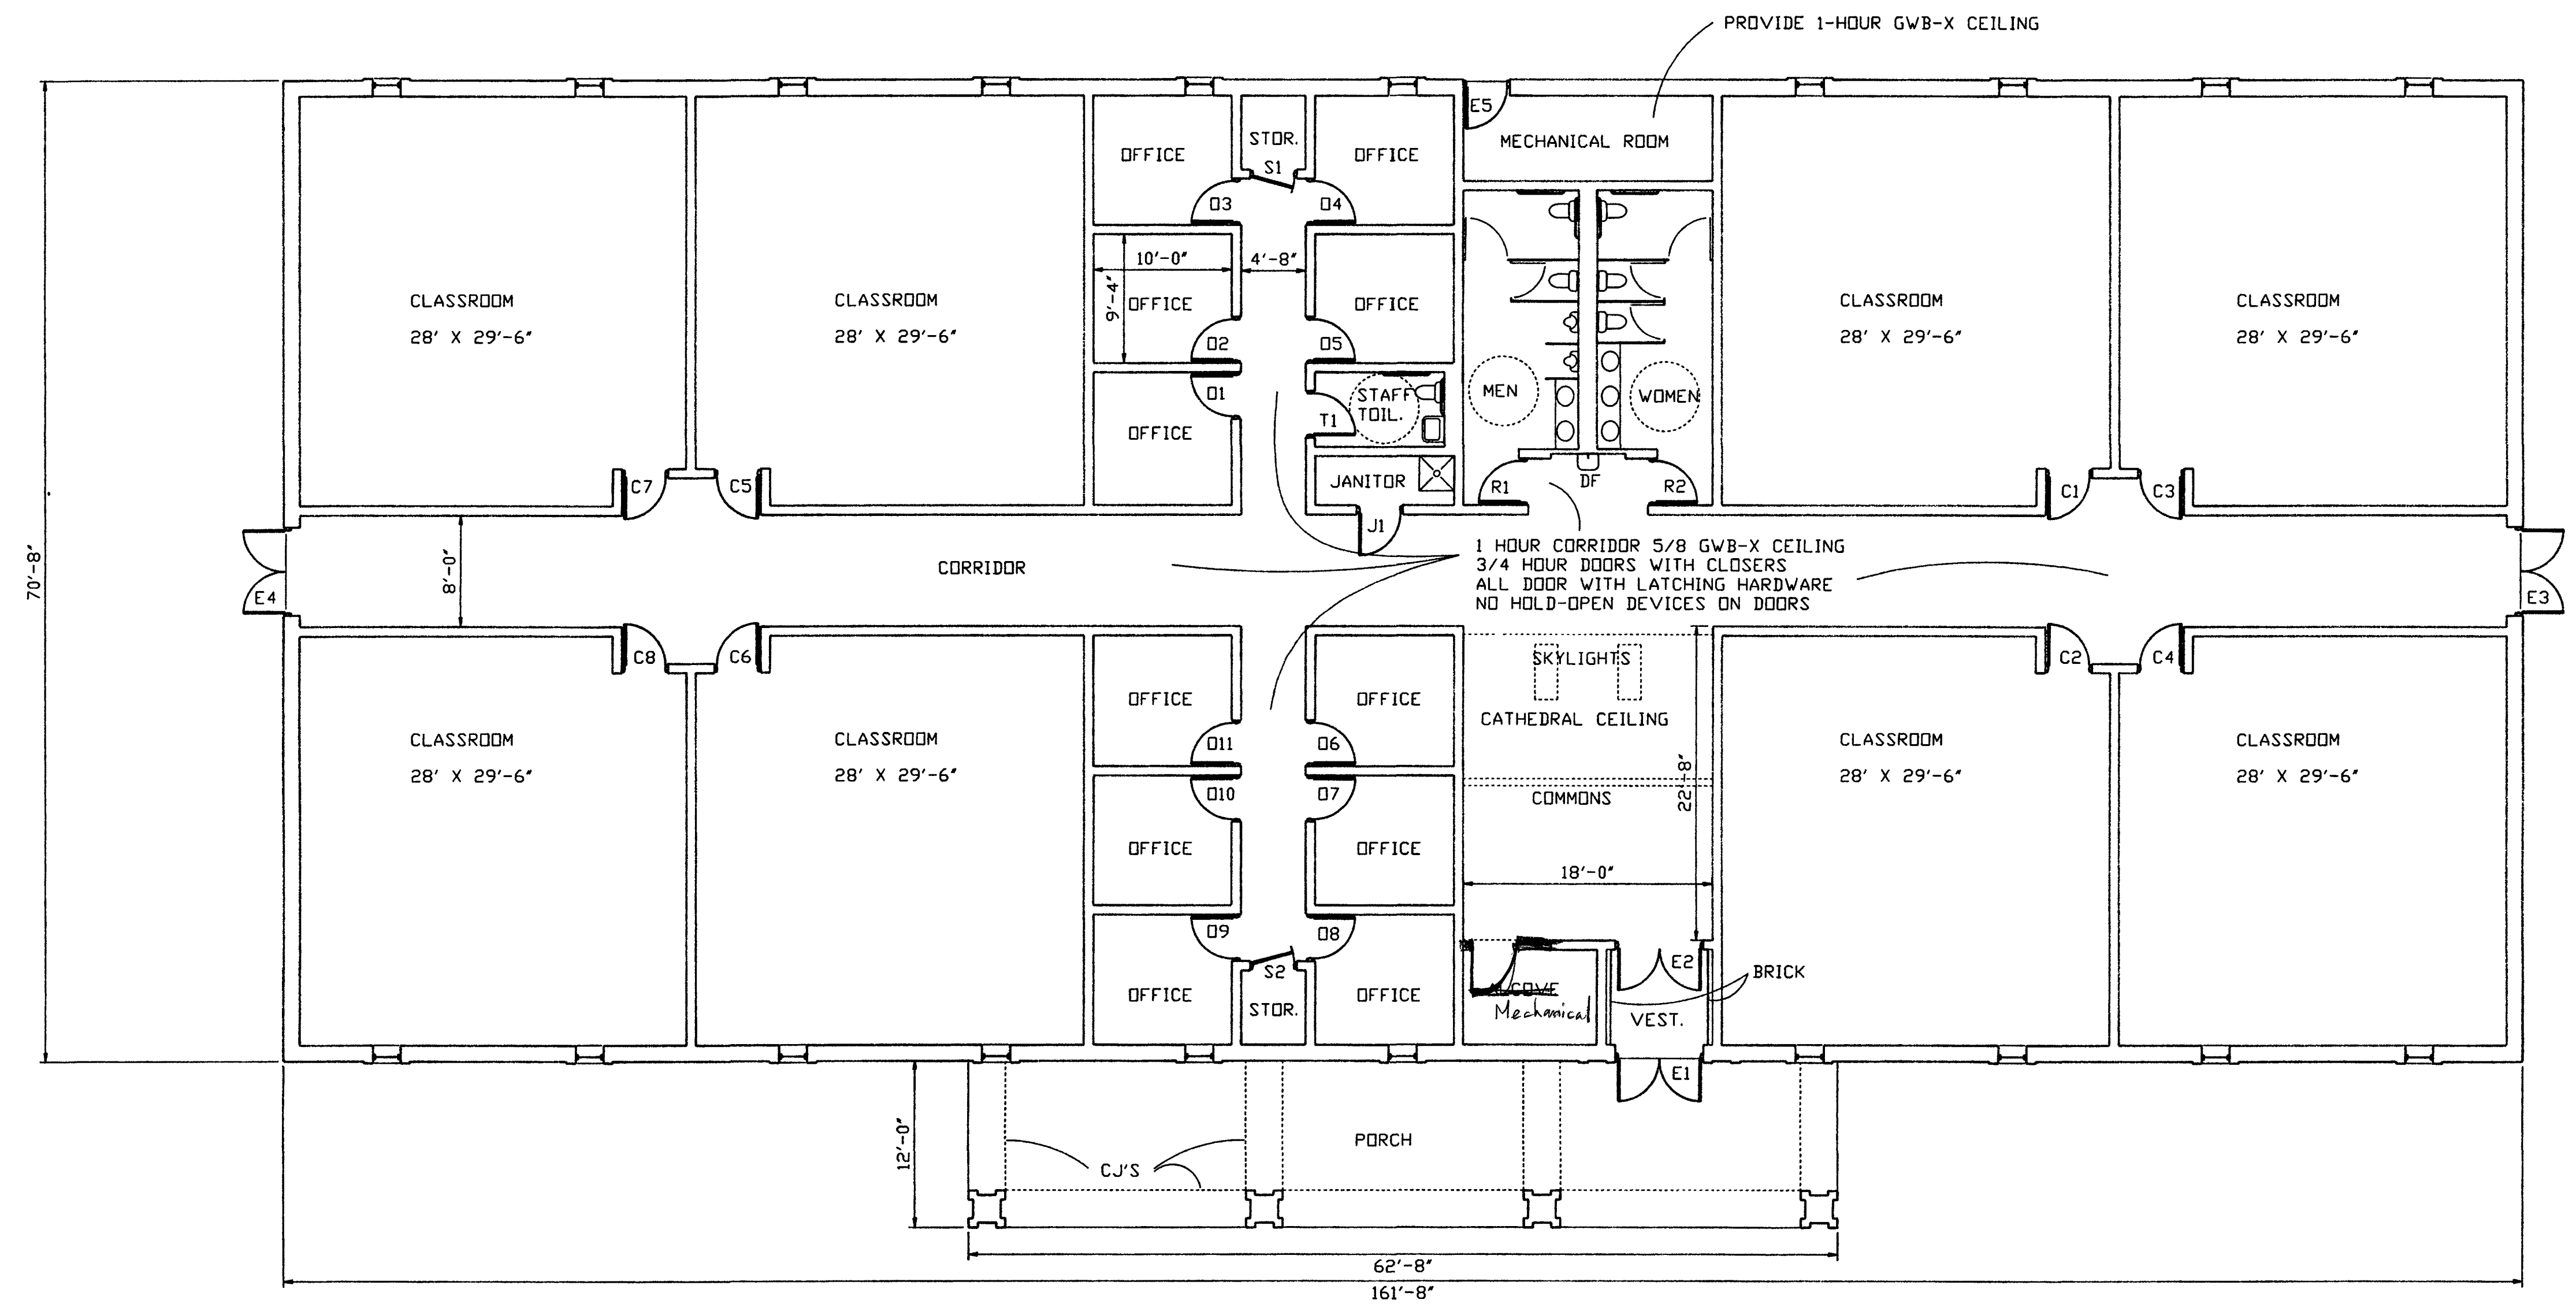

FLOOR PLAN

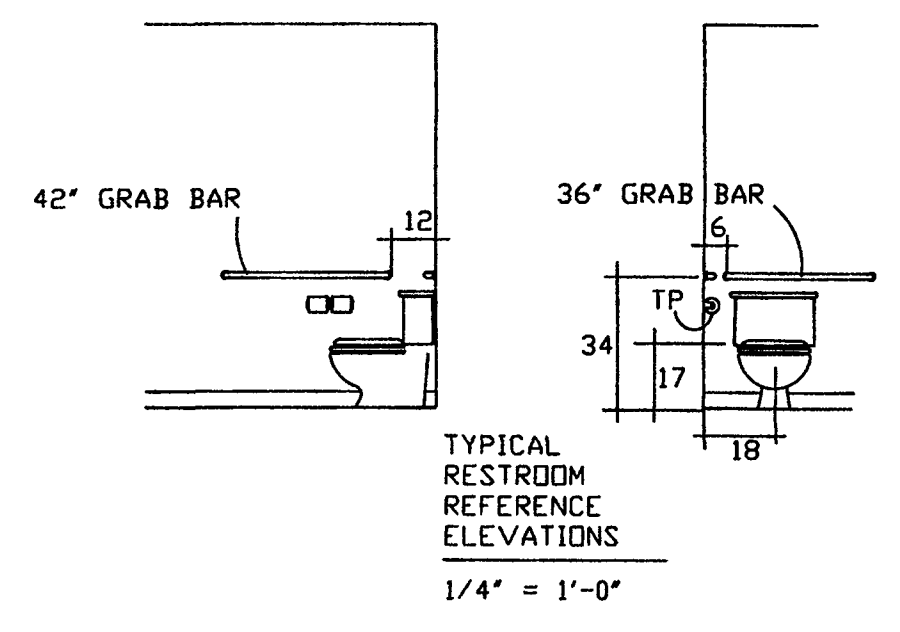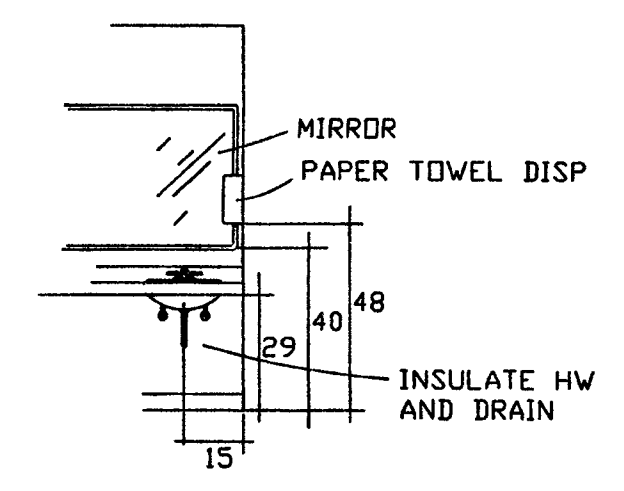


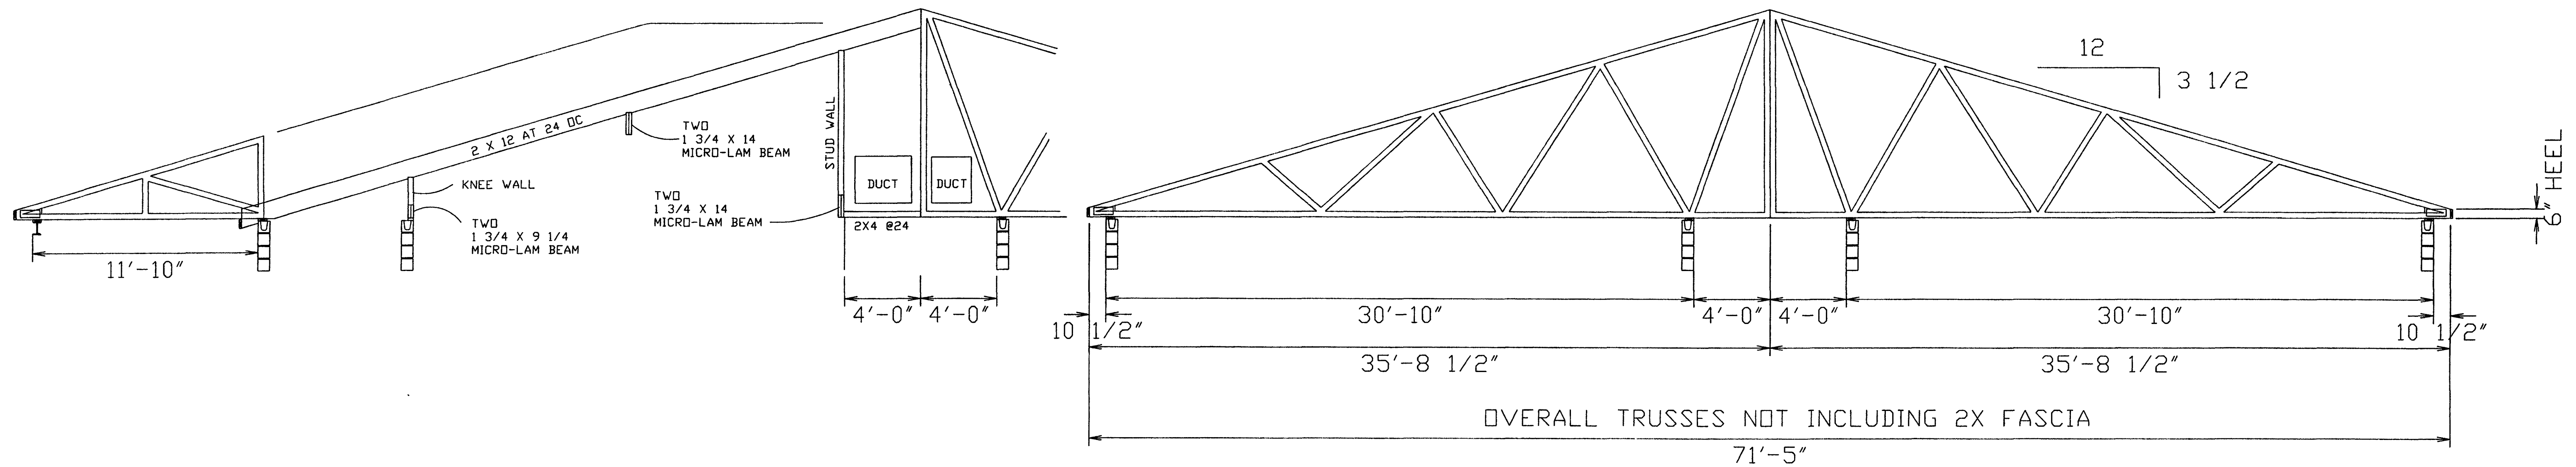



ENTRY AREA - 1/4"=1'-0"

COMMON TRUSSES - 1/4"=1'-0"


30 PSF TC SNOW
10 PSF TC DEAD
10 PSF BOTTOM CORD DEAD

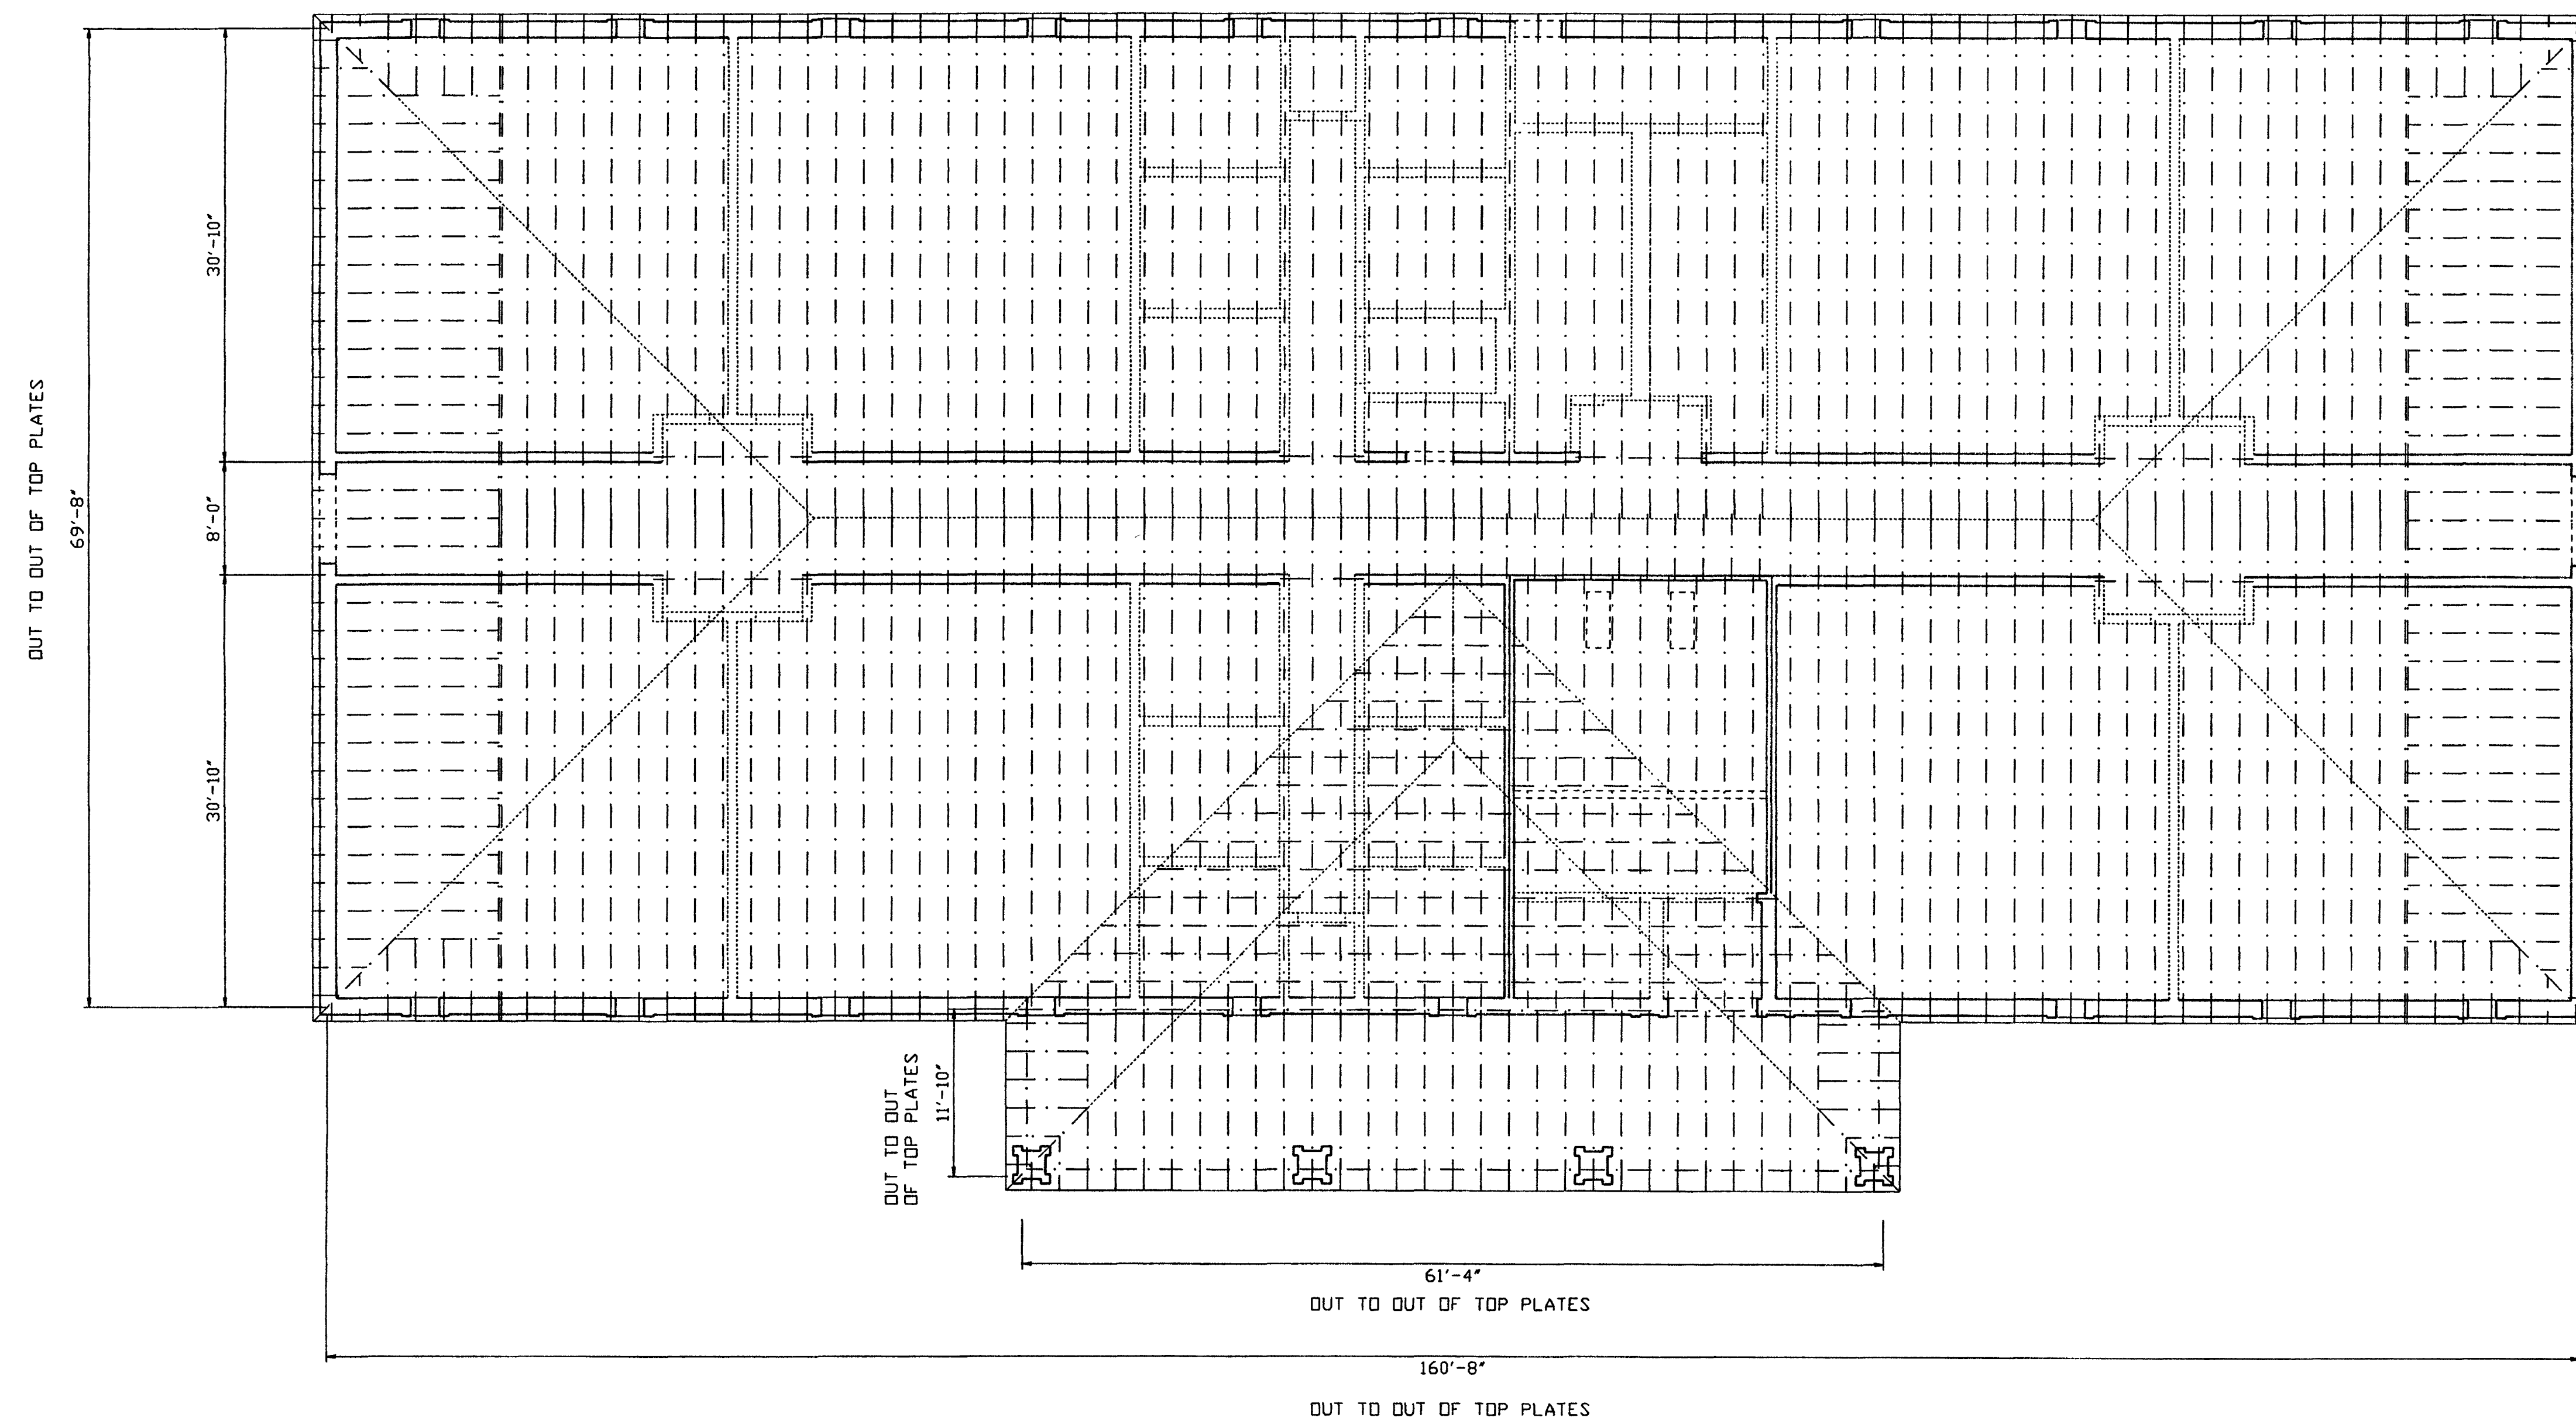

G. HALL

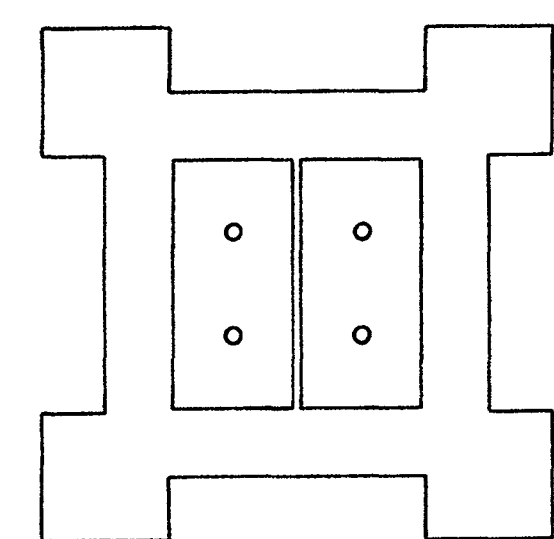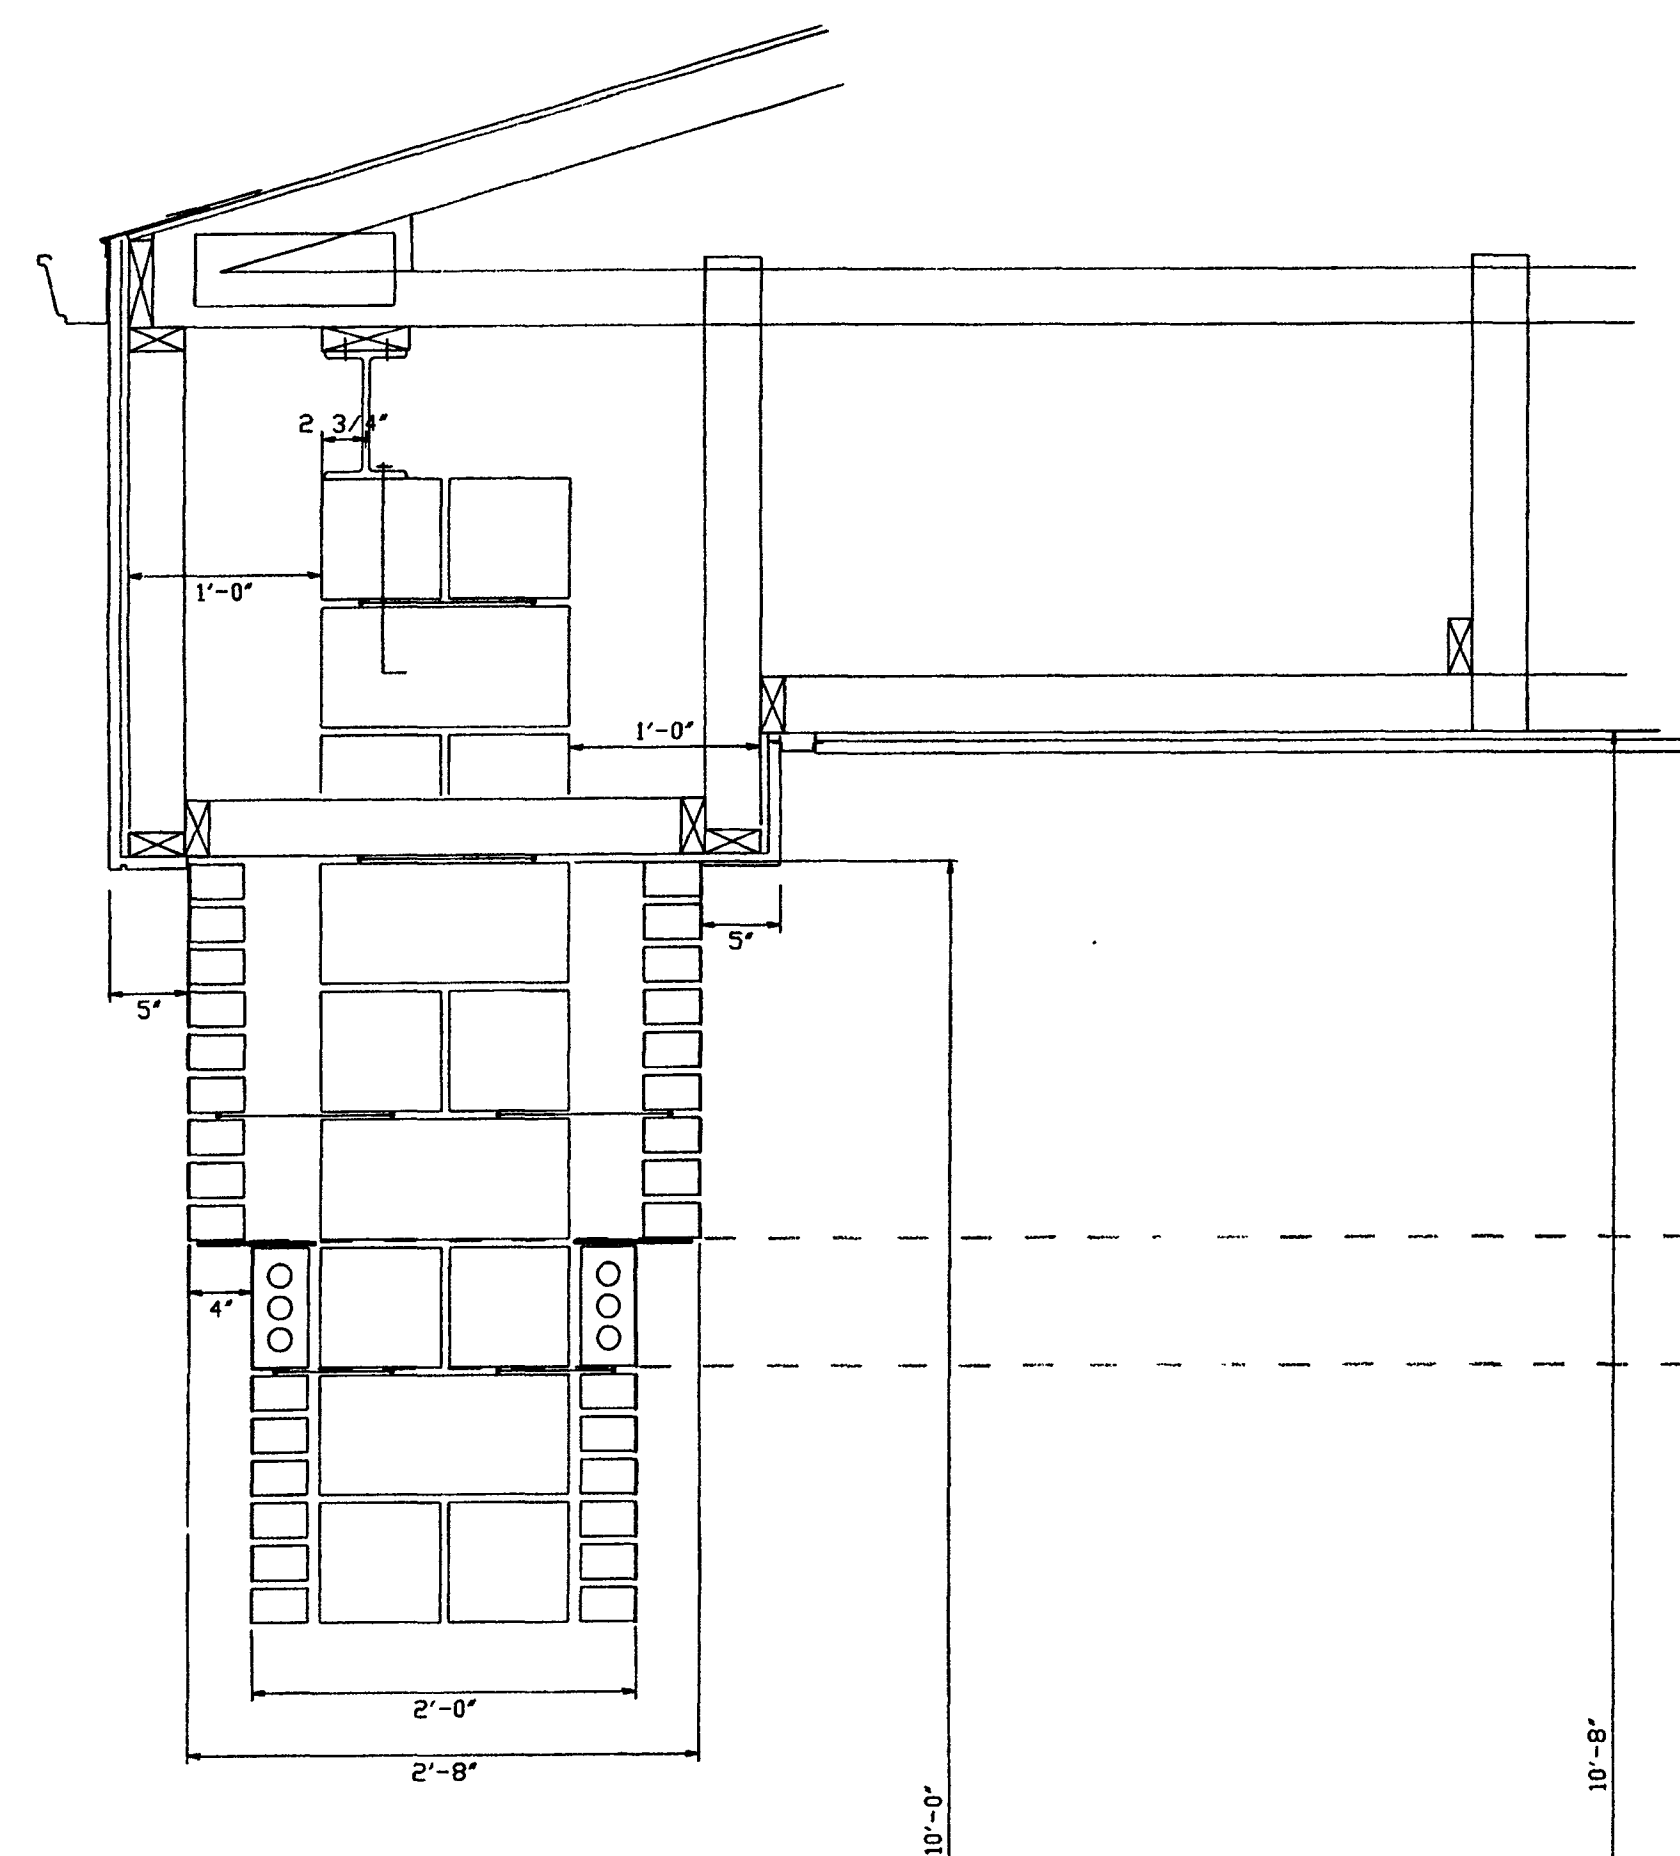


ENTRY CANOPY

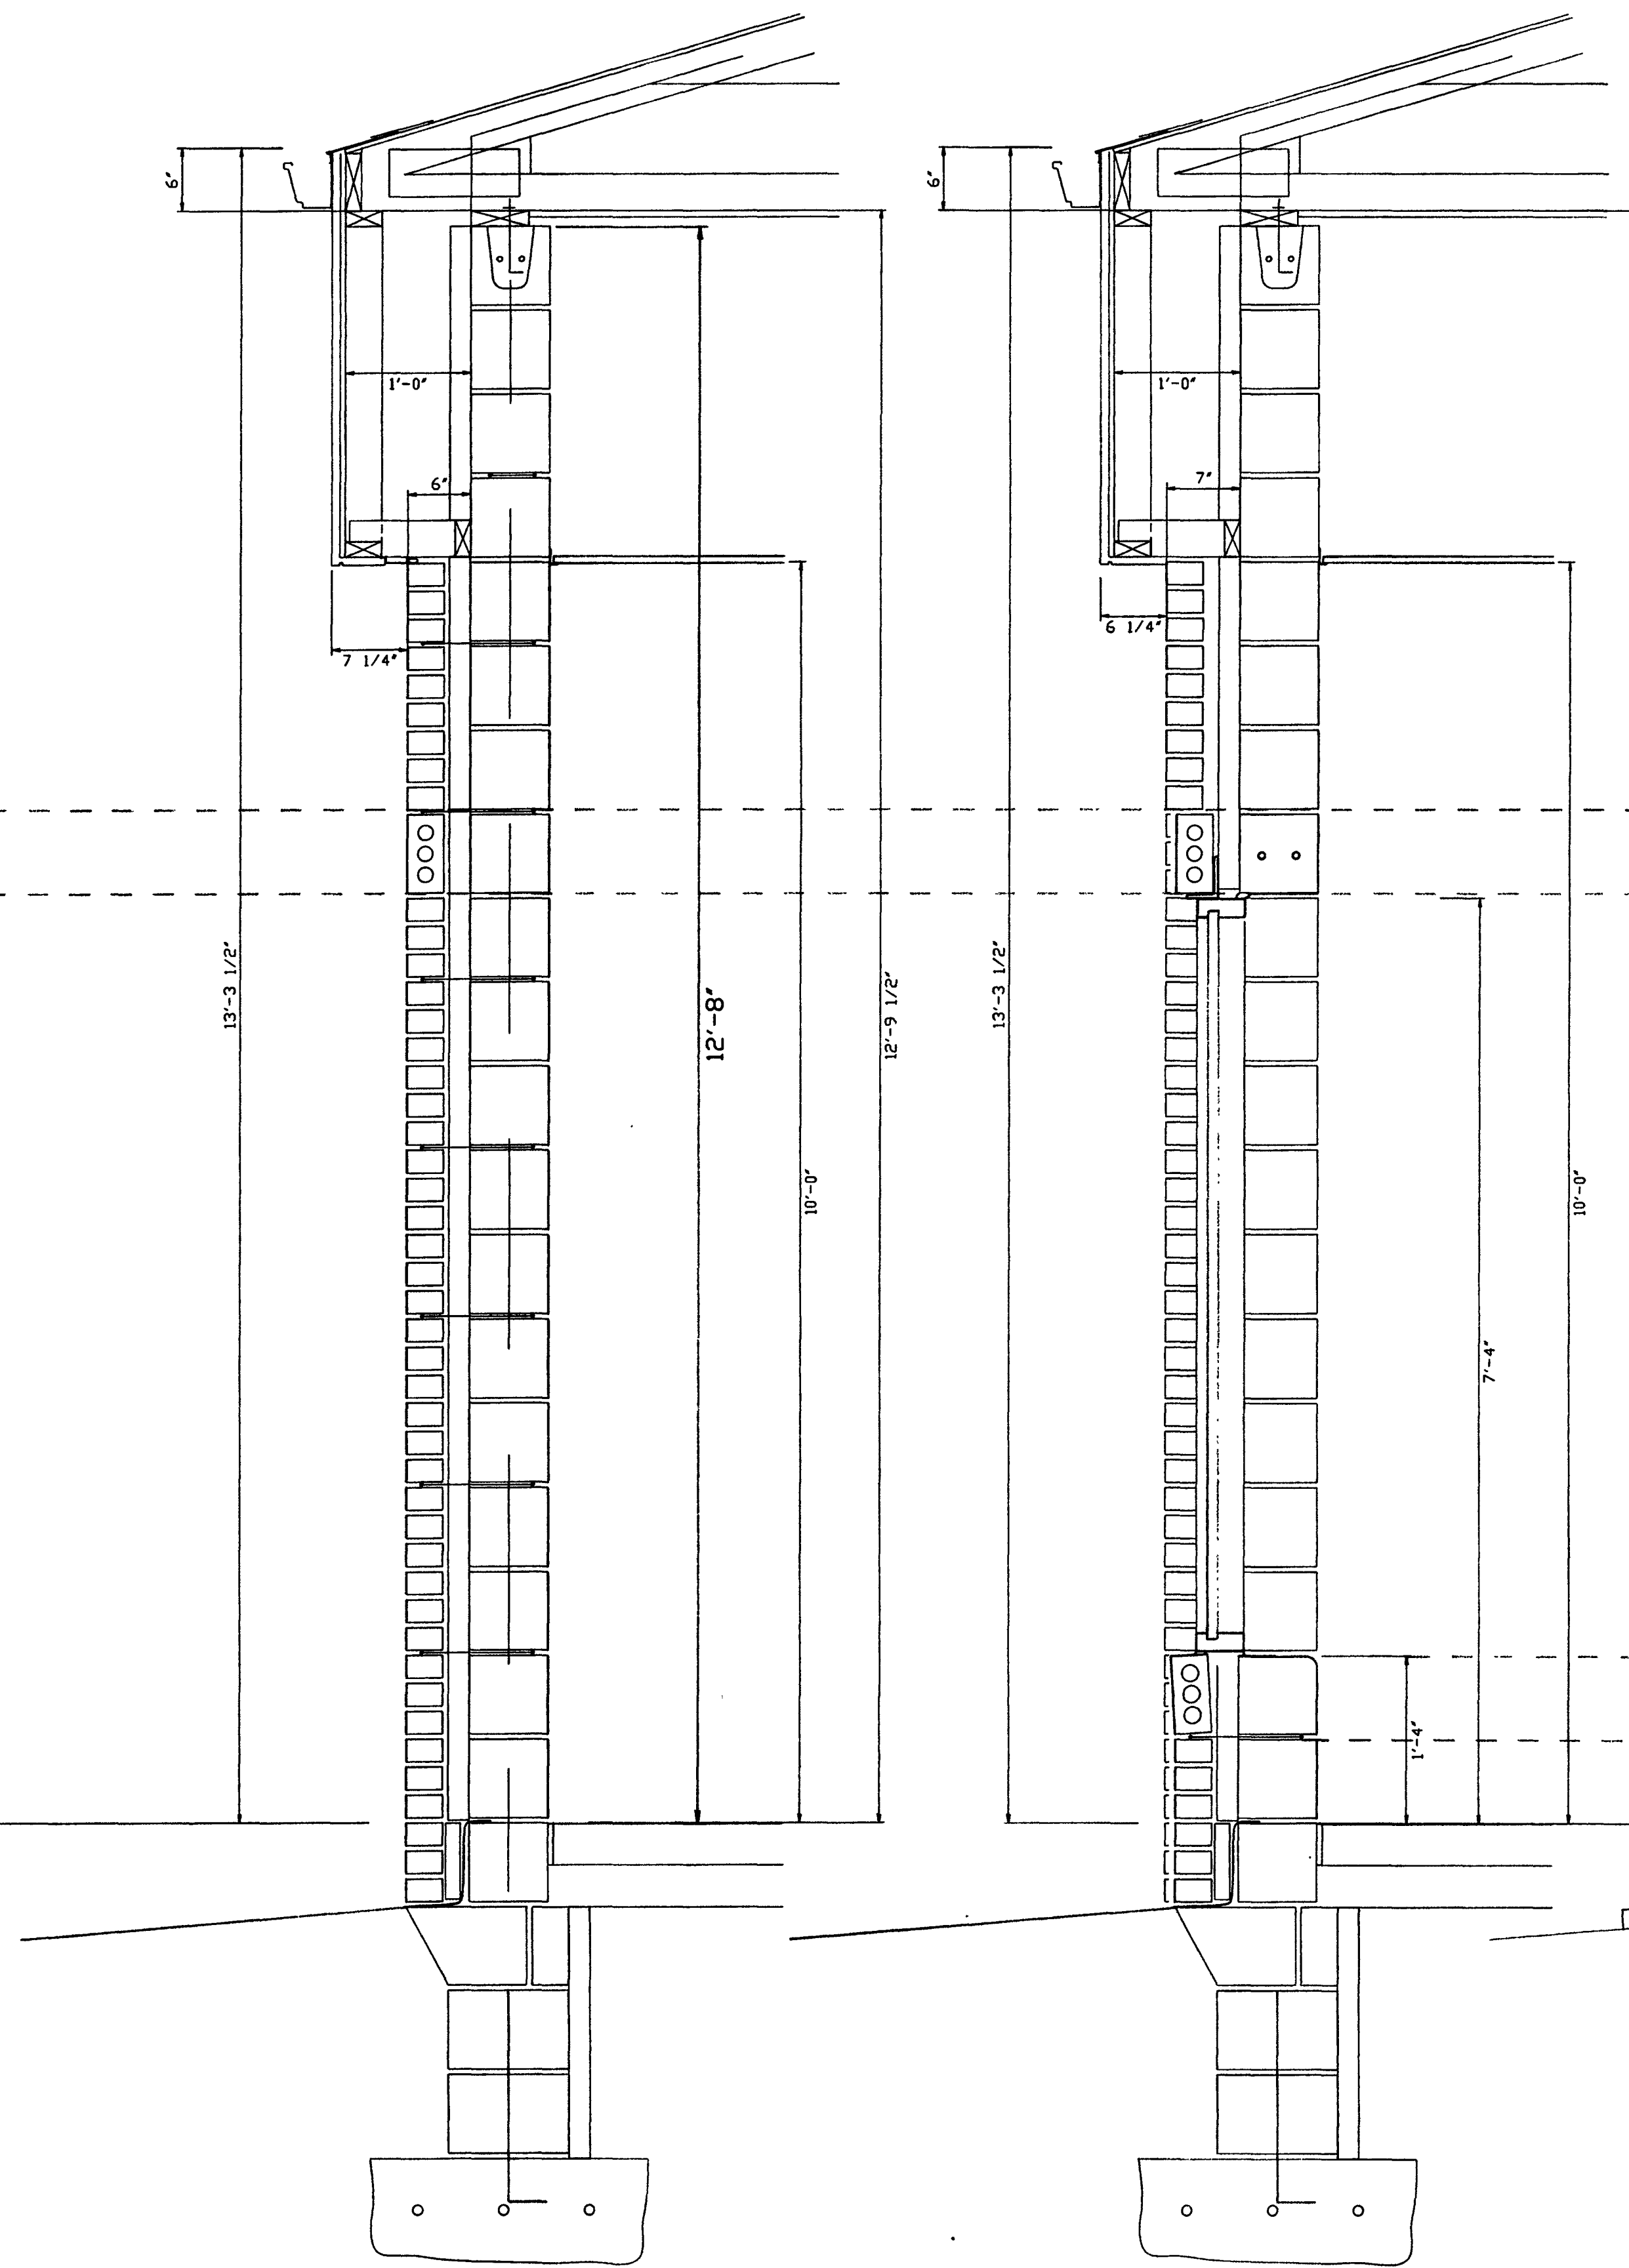


TYPICAL WALL


WALL AT WINDOW

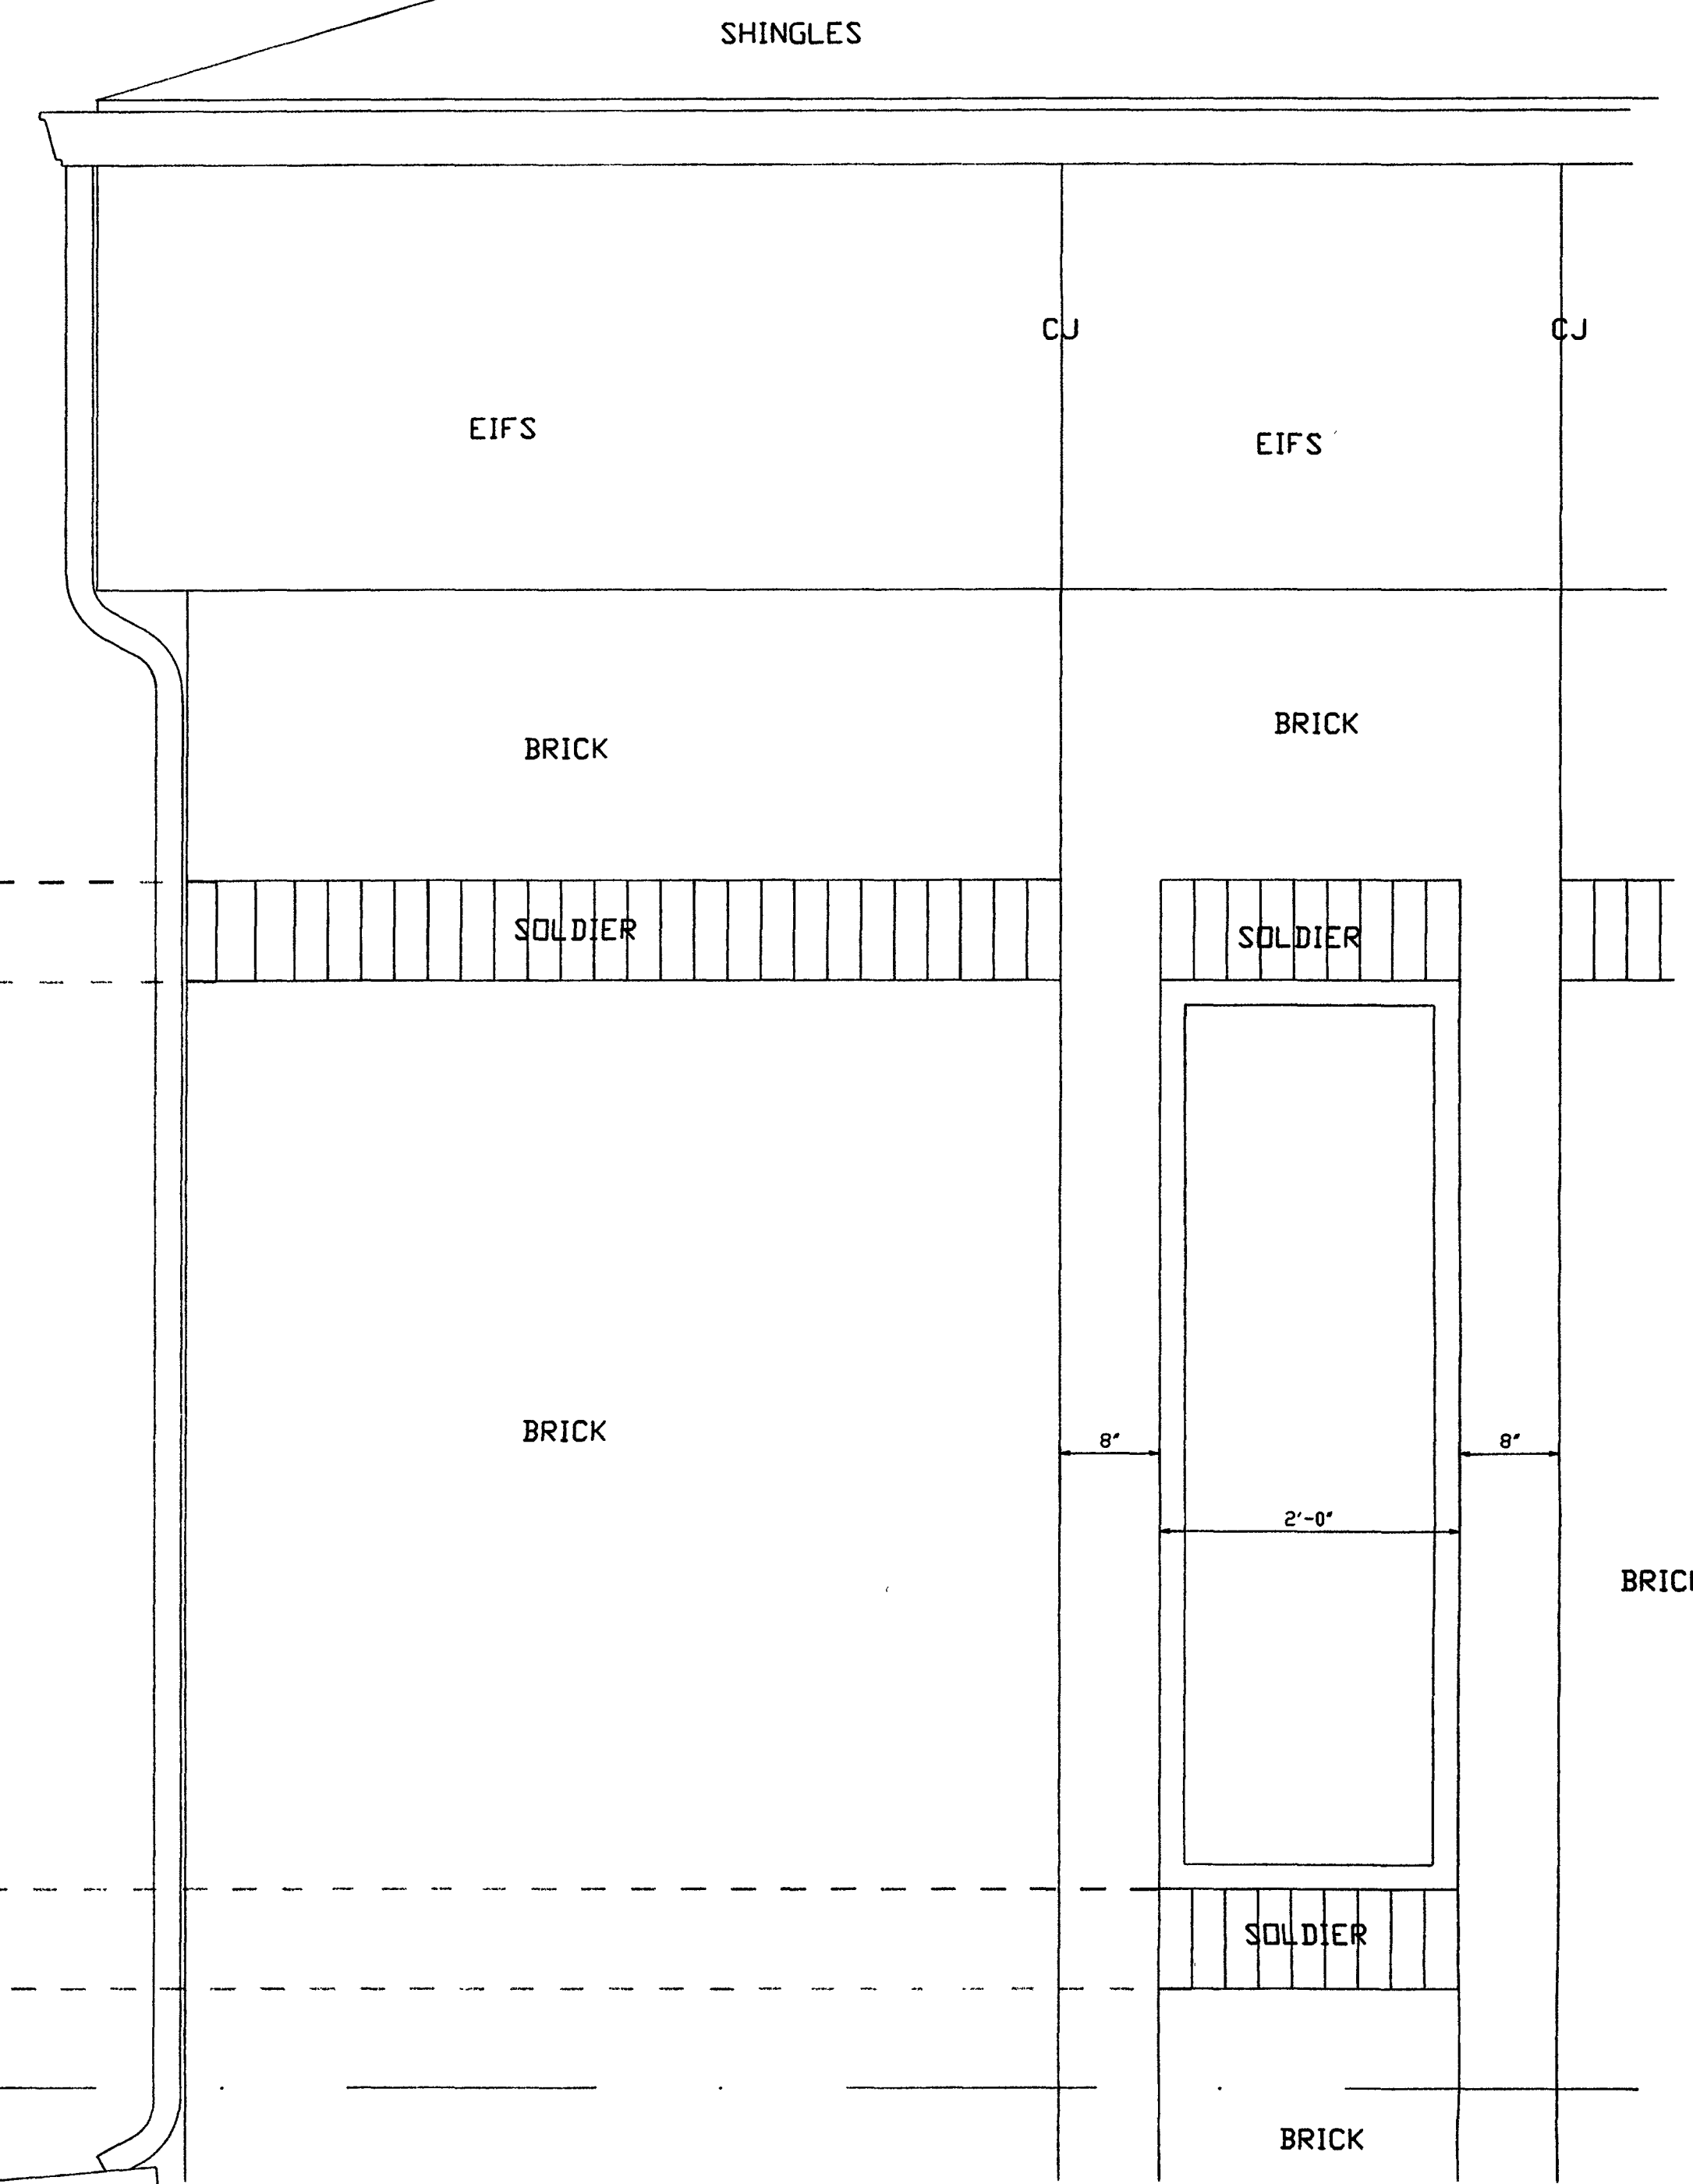


ELEVATION DETAIL

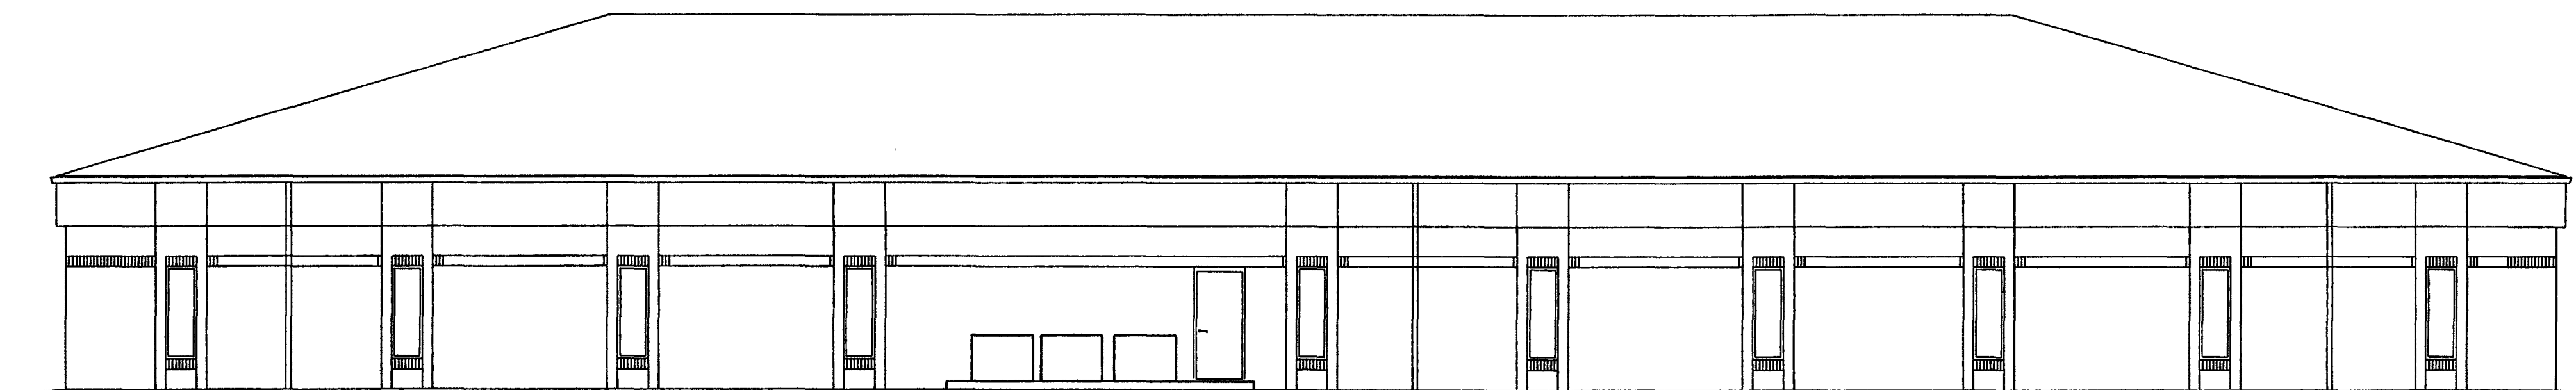


REAR

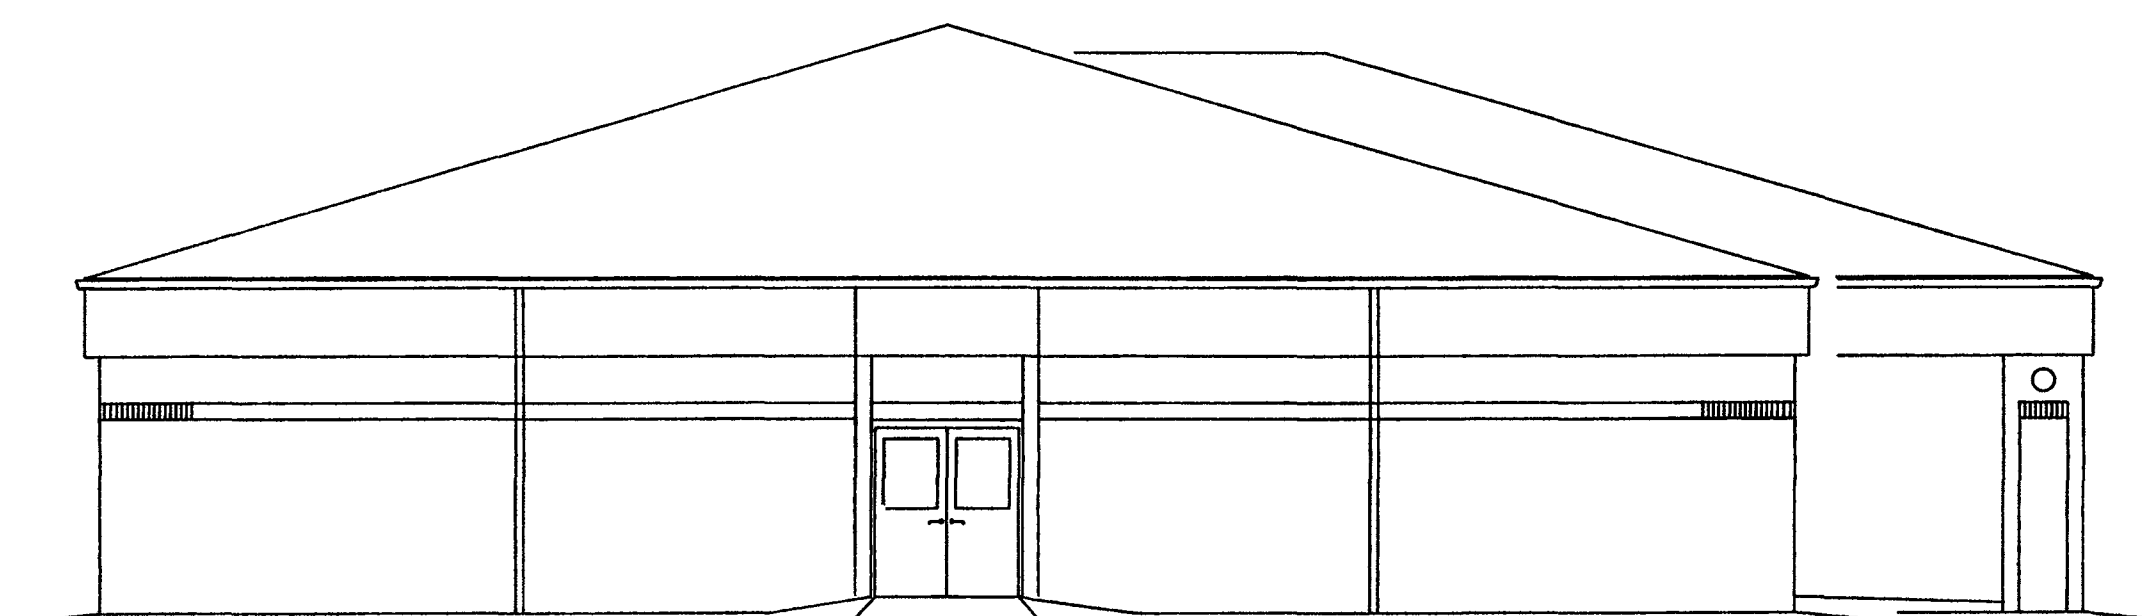

LEFT END

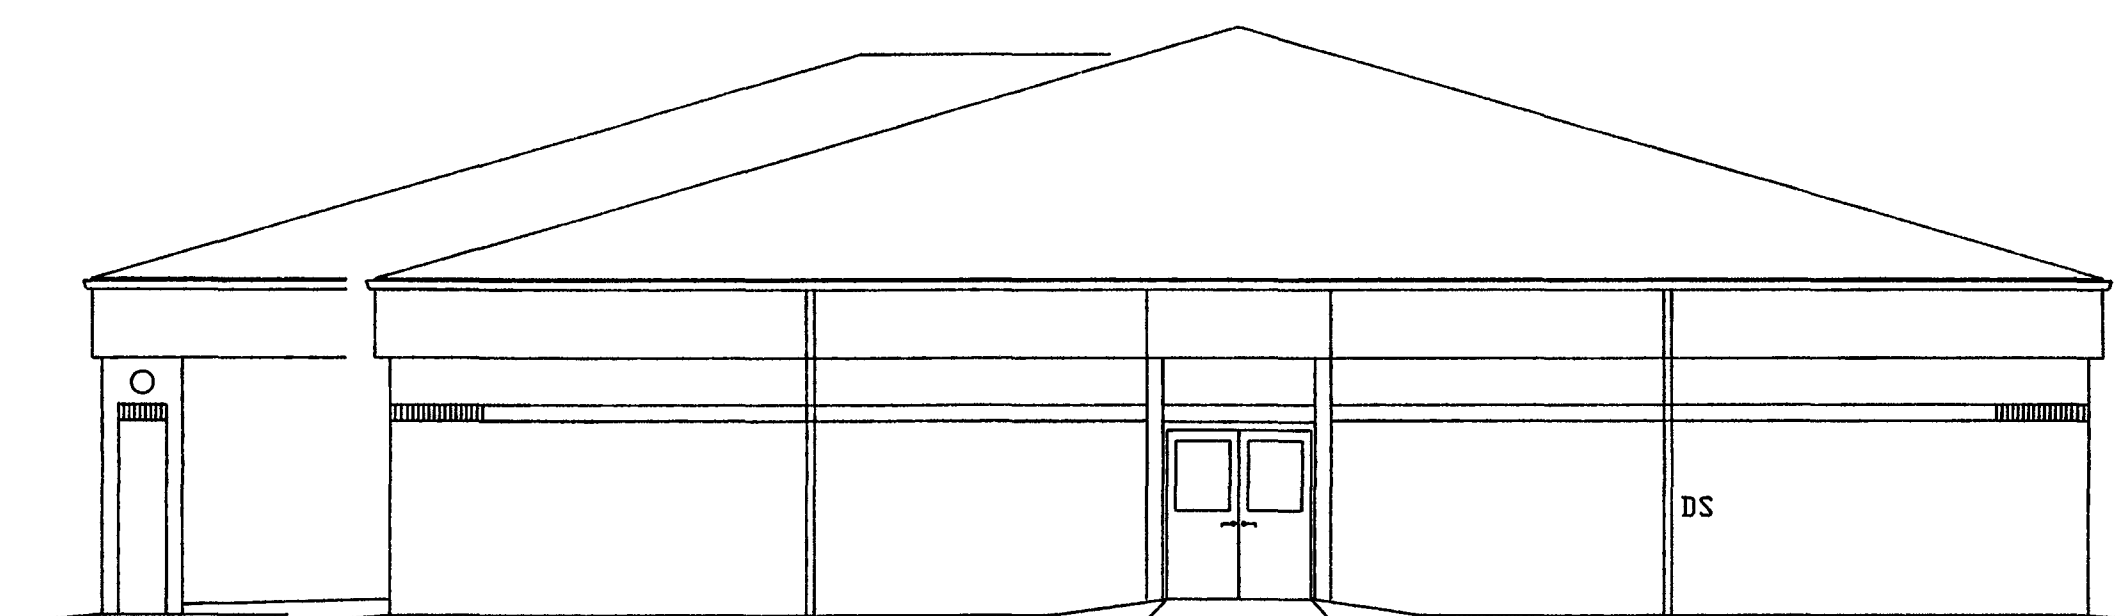

RIGHT END

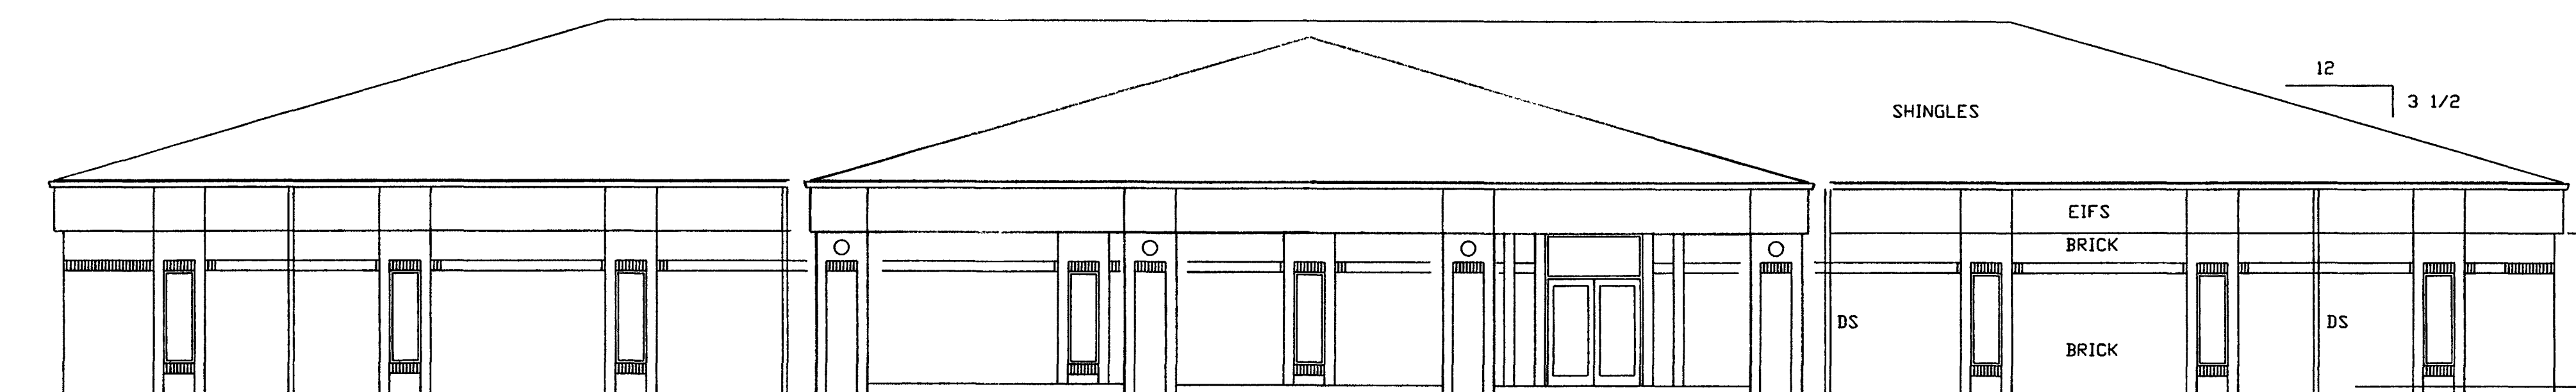

FRONT