P&ID IMPIANTO VENTILAZIONE - Fuori Scala

 Specifiche Tecniche UTA


 Etichetta
 Q [m³/h]
 H [Pa]
 P_{Nom} [kW]
 I_{Nom} [A]
 I_{Avv} [A]
 V / ph / Hz


 EV#01
 10.000
 350.0
 3.80
 11.1
 75.6
 400/3/50

 EV#02
 10.000
 350.0
 2.70
 6.3
 43.0
 400/3/50

Sp	Specifiche Tecniche Recuperatore di Calore					
Etichetta	Q [m³/h]	H [Pa]	P _{Nom} [kW]	I _{Nom} [A]	V / ph / Hz	
REC-2500	2.500	300	2.34	-	400/3/50	

Specifiche Tecniche Ventilatore							
Etichetta	Q [m³/h]	H [Pa]	P _{Nom} [kW]	I _{Nom} [A]	V / ph / Hz		
VEC#1	1300	200	0.520	2.30	230/1/50		
VEC#2	3500	350	1.000	-	230/1/50		
VEC#03	1500	200	0.620	2.30	230/1/50		

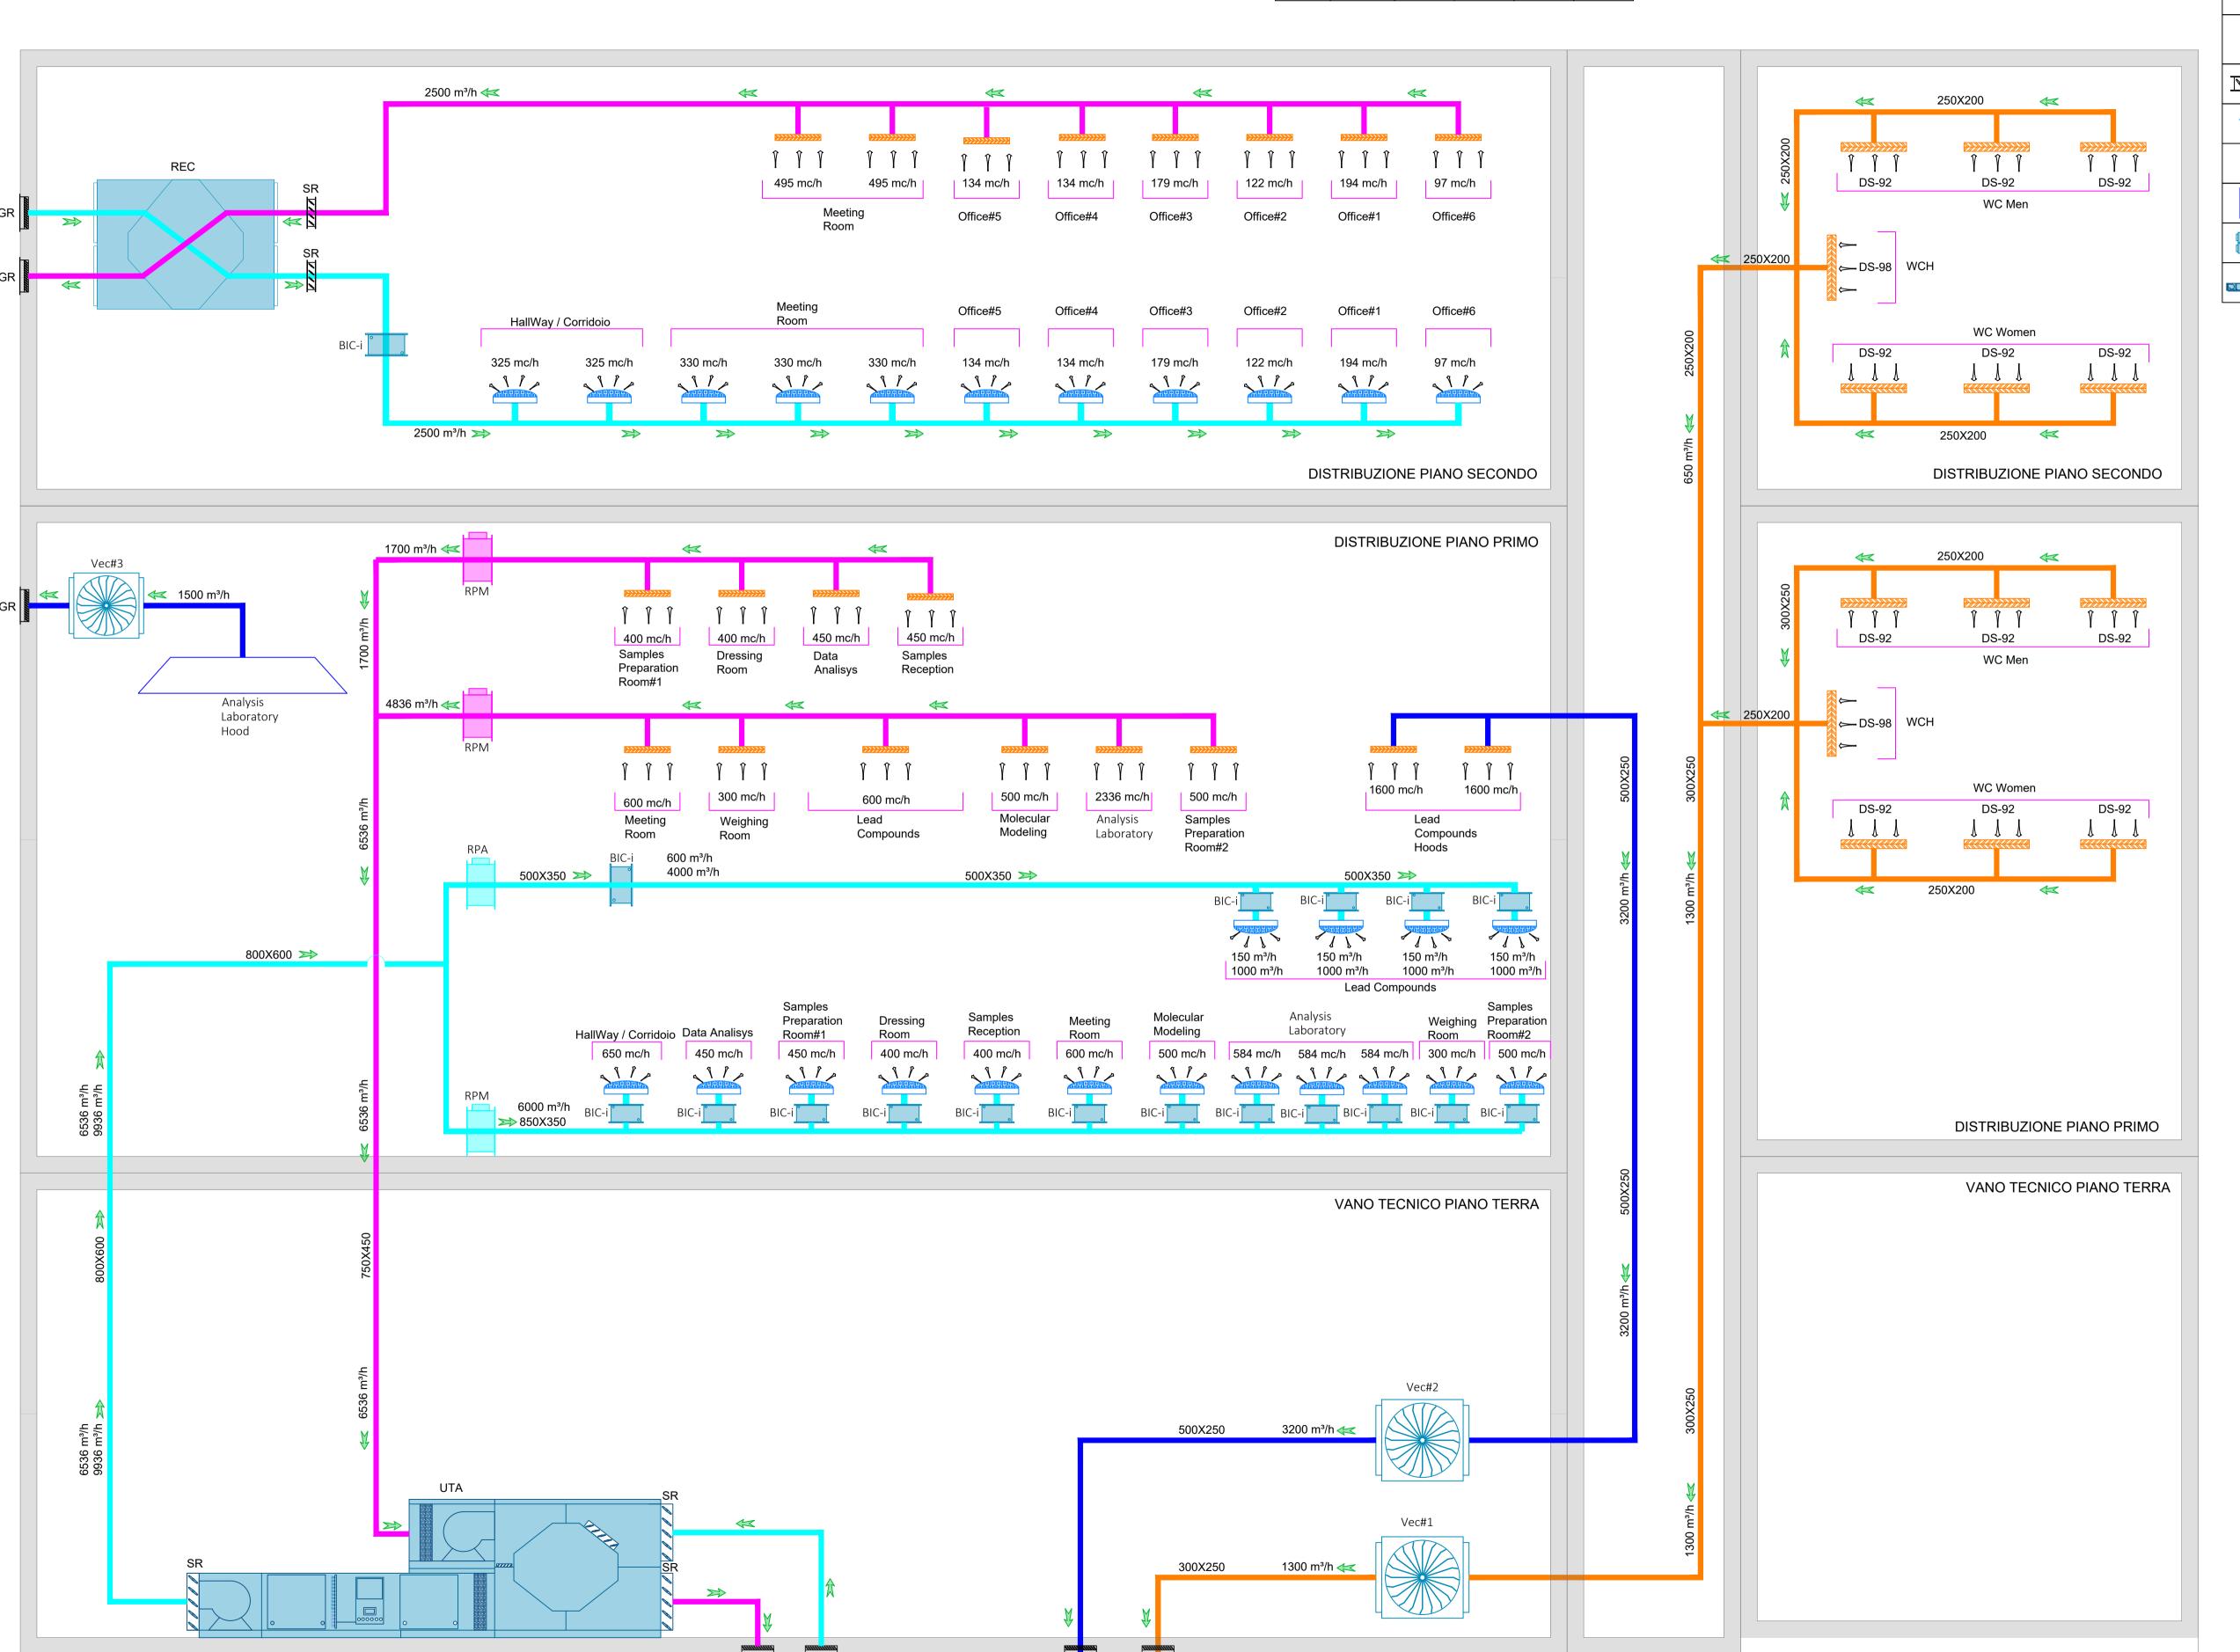

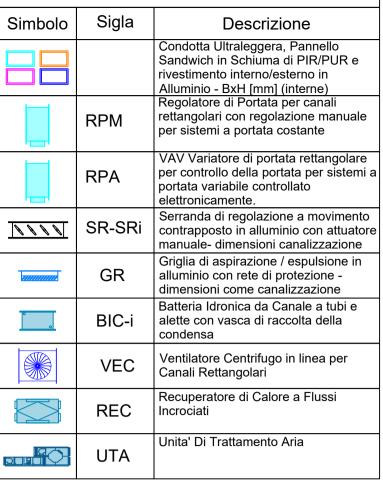

LEGENDA

