




AUGLAIZE COUNTY HEALTH DEPARTMENT

prevent. promote. protect.

Multi-Flo Aeration - Operation & Maintenance

1. Aeration sewage treatment systems are issued an annual permit.
2. A service contract with a registered service contractor or the health department is required.
3. An annual inspection is required by a registered service contractor or a trained homeowner. Submit a copy of the inspection report to the health department within sixty days of the inspection.
4. The permit requires the tank to be pumped every eight years, at a minimum. Some tanks may benefit from more frequent pumping. Multi-Flo recommends 2-4 years. Filter socks should be cleaned whenever a Multi-Flo unit is pumped.
5. The Multi-Flo is designed to run continuously and should not be on a timer.

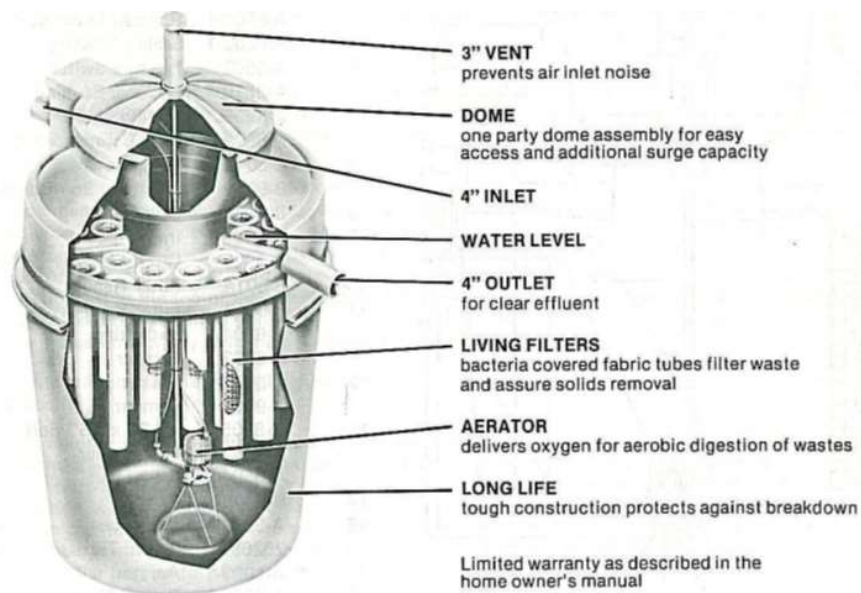

The Multi-Flo aeration unit runs continuously 24 hours a day. The aerator is a 1/6 HP 1550 RPM motor with thermal overload protection, 120 Volt AC 60Hz, 2.6 amps. The Multi-Flo aerator is built with a thermal overload switch. If the motor gets too warm, the thermal switch will turn the motor off before permanent damage occurs.