

**Product Evaluation Report**  
**MID FLORIDA METAL ROOFING SUPPLY, INC.**

**Minimum 29 Ga. MFMRS Multi-Rib Roof Panel over 15/32" Plywood**

**Florida Product Approval # 24096.2 R4**


Florida Building Code 2023  
Per Rule 61G20-3  
Method: 1 –D

Category: Roofing  
Subcategory: Metal Roofing  
Compliance Method: 61G20-3.005(1)(d)  
NON HVHZ

**Product Manufacturer:**  
**Mid Florida Metal Roofing Supply, Inc.**  
28328 County Road 561  
Tavares, Florida 32778

**Engineer Evaluator:**  
**Johnathan Green, P.E. #88223**  
Florida Evaluation ANE ID: 12901

**Contents:**  
**Evaluation Report: Page 1 - 3**  
**Installation Detail: Page 4**

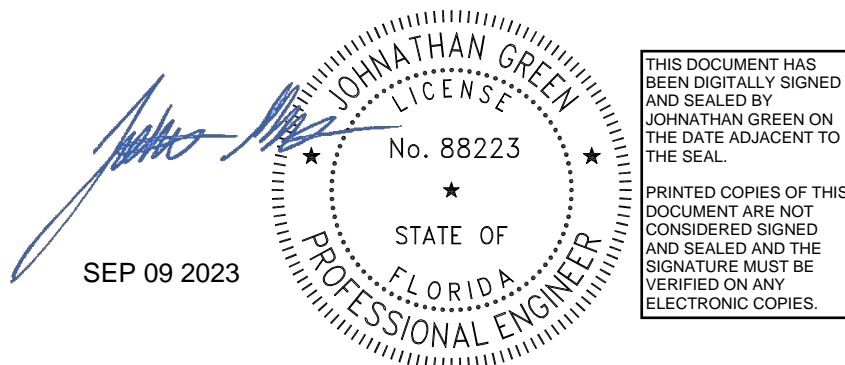



352-742-7070 • Toll Free: 866-479-8080 • Fax 352-742-7075  
www.mfmrs.com • 28328 County Road 561, Tavares, Florida 32778

- Compliance Statement:

The product as described in this report has demonstrated compliance with the Florida Building Code 2023, Sections 1504.3.2, 1504.7.
- Product Description:

MFMRs Multi-Rib 29 Ga. Steel, 36" coverage, through fastened roof panel over one layer of asphalt shingles/felt paper (optional) fastened into minimum 15/32" APA Plywood decking. Non-Structural Application.
- Panel Material/Standards:

Material: Minimum 29 Ga. Steel conforming to Florida Building Code 2023 Section 1507.4.3.  
Yield Strength: Min. 80.0 ksi  
Corrosion Resistance: Panel Material shall comply with Florida Building Code 2023, Section 1507.4.3.
- Panel Dimension(s):

Thickness: 0.0145" min.  
Width: 36" maximum coverage  
Rib Height: 3/4" major rib at 9" O.C.
- Panel Fastener:

#10 x 1 1/2" WoodZac with sealing washing or approved equal.  
Corrosion Resistance: Per Florida Building Code 2023, Section 1507.4.4.
- Substrate Description:

Min. 15/32" thick, APA Rated plywood over supports at maximum 24" O.C. One layer of asphalt shingles/felt paper over plywood (optional). Design of plywood and plywood supports are outside the scope of this evaluation. Substrate must be designed in accordance w/ Florida Building Code.
- Allowable Design Uplift Pressures:

Maximum Design Uplift Pressure:	-71.0 psf	-108.5 psf
Fastener Pattern:	Pattern A	Pattern B
Fastener Pattern Spacing:	24" O.C.	24" O.C.


\*Design Pressure includes a Safety Factor = 2.0



352-742-7070 • Toll Free: 866-479-8080 • Fax 352-742-7075  
www.mfmrs.com • 28328 County Road 561, Tavares, Florida 32778

Code Compliance:	The product described herein has demonstrated compliance with The Florida Building Code 2023, Section 1504.3.2, 1504.7.
Evaluation Report Scope:	The product evaluation is limited to compliance with the structural wind load requirements of the Florida Building Code 2023, as relates to Rule 61G20-3.
Performance Standards:	<p>The product described herein has demonstrated compliance with:</p> <ul style="list-style-type: none"><li>▪ UL 580-06 - Test for Uplift Resistance of Roof Assemblies</li><li>▪ UL 1897-2015 - Uplift Test for Roof Covering Systems</li><li>▪ FM 4471-92 - Foot Traffic Resistance Test</li></ul>
Reference Data:	<ol style="list-style-type: none"><li>1. UL 580-94 / 1897-98 Uplift Test Force Engineering &amp; Testing, Inc. Report No. 194-0135T-07C, D.</li><li>2. FM 4471-92, Section 5.4 Foot Traffic Resistance Test Force Engineering &amp; Testing, Inc. Report No. 194-0134T-11A</li><li>3. Certificate of Independence By Johnathan Green, P.E. #88223</li></ol>
Test Standard Equivalency:	The UL 580-94 test standard is equivalent to the UL 580-06 and the UL 1897-98 test standard is equivalent to the UL 1897-2015 test standard.
Quality Assurance Entity:	The manufacturer has established compliance of roof panel products in accordance with the Florida Building Code and Rule 61G20-3.005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity.
Minimum Slope Range:	Minimum Slope shall comply with Florida Building Code 2023, including Section 1507.4.2 and in accordance with Manufacturers recommendations. For slopes less than 3:12, lap sealant must be used in the panel side laps.
Installation:	Install per manufacturers recommended details.
Underlayment:	Per Florida Building Code 2023, Section 1507.1 and manufacturer's installation guidelines.
Roof Panel Fire Classification:	Fire classification is not part of this evaluation.
Shear Diaphragm:	Shear diaphragm values are outside the scope of this report.
Design Procedure:	Based on the dimensions of the structure, appropriate wind loads are determined using Chapter 16 of the Florida Building Code 2023 for roof cladding wind loads. These component wind loads for roof cladding are compared to the allowable pressure listed above. The design professional shall select the appropriate erection details to reference in his drawings for proper fastener attachment to his structure and analyze the panel fasteners for pullout and pullover. Support framing must be in compliance with Florida Building Code 2023 Chapter 22 for steel, Chapter 23 for wood and Chapter 16 for structural loading.

### PANEL FASTENER PATTERN A

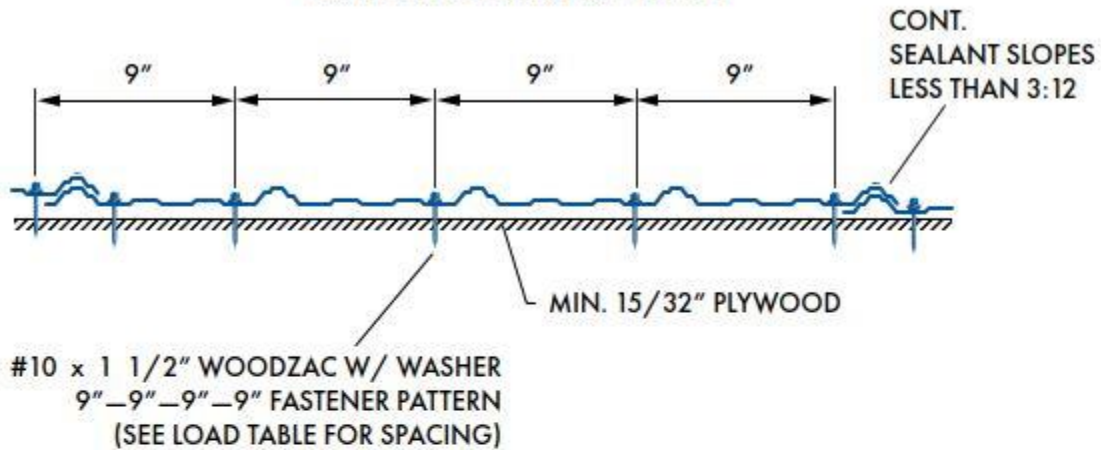

### PANEL FASTENER PATTERN B AND FASTENER PATTERN AT PANEL ENDS/END LAPS

