

UNISTAR SLCI924-EX SERIES 4.7KW - 21KW

BASIC UNIT MODEL NUMBER EXAMPLE: SCLI-EX-18.0-90
 DESCRIPTION OF EXAMPLE: (MODEL EX, 18 KW, 90 MINUTE RUN TIME)
 FAMILY - MODEL - POWER RATING (WATTS/KW) - TIME (MINUTES)
 SCLI - EX - 4.7 - 90
 5.25
 7.0
 8.0
 10.0
 12.0
 14.0
 18.0 (REQUIRES SEPARATE BATTERY CABINET)
 21.0 (REQUIRES SEPARATE BATTERY CABINET)


ALL OPTIONS ARE ORDERED AS SEPARATE LINE ITEM

VOLTAGE OPTIONS

| INPUT/OUTPUT | INPUT/OUTPUT |
|--------------|--------------|
| 120/120 | 240/480 |
| 120/277 | 240/120-240 |
| 120/480 | 240/120-277 |
| 120/120-240 | 277/120 |
| 120/120-277 | 277/277 |
| 208/120 | 277/480 |
| 208/277 | 277/120-240 |
| 208/480 | 277/120-277 |
| 208/120-240 | 480/120 |
| 208/120-277 | 480/277 |
| 240/120 | 480/480 |
| 240/277 | 480/120-240 |
| | 480/120-277 |

UNIT OPTIONS

- NOF1 - 120V NORMALLY OFF OUTPUT CIRCUIT (UP TO 7KW)
- NOF2 - 120V NORMALLY OFF OUTPUT CIRCUIT (8 TO 14KW)
- NOF3 - 120V NORMALLY OFF OUTPUT CIRCUIT (18 TO 21KW)
- NOF4 - 120/240V NORMALLY OFF OUTPUT CIRCUIT (UP TO 7KW)
- NOF5 - 120/240V NORMALLY OFF OUTPUT CIRCUIT (8 TO 14KW)
- NOF6 - 120/240V NORMALLY OFF OUTPUT CIRCUIT (18 TO 21KW)
- NOF7 - 277V NORMALLY OFF OUTPUT CIRCUIT (UP TO 7KW)
- NOF8 - 277V NORMALLY OFF OUTPUT CIRCUIT (8 TO 14KW)
- NOF9 - 277V NORMALLY OFF OUTPUT CIRCUIT (18 TO 21KW)
- NOH - 120V-277V NORMALLY OFF "HOLD ON"/VOLTAGE/QTY. (MUST USE NOF OPTION)
- OCB1 - 120V OUTPUT CIRCUIT BREAKER, 1 POLE, 20-AMP (1)
- OCB2 - 120V OUTPUT CIRCUIT BREAKER, 2 POLE, 20-AMP (1)
- OCB3 - 277V OUTPUT CIRCUIT BREAKER, 1 POLE, 20-AMP (1)
- OCB4 - 277V OUTPUT CIRCUIT BREAKER, 2 POLE, 20-AMP (1)
- OCB5 - 120/240V OUTPUT CIRCUIT BREAKER, 2 POLE, 20-AMP (1)
- EMB1 - EXTERNAL MAINTENANCE BYPASS SWITCH UP TO 8KW (VIN=VOUT)
- EMB2 - EXTERNAL MAINTENANCE BYPASS SWITCH 10 TO 14KW (VIN=VOUT)
- EMB3 - EXTERNAL MAINTENANCE BYPASS SWITCH 18 TO 21KW (VIN=VOUT)
- RMP - REMOTE SYSTEM INDICATOR PANEL
- EPO - EMERGENCY POWER OFF
- SNMP - SNMP CARD
- FCC - FORM C CONTACTS
- SRB - SEISMIC MOUNTING BRACKET (1 SET)
- CAB1 - NEMA 3R ENCLOSURE (UP TO 5.25KW)
- CAB2 - NEMA 3R ENCLOSURE (7 TO 10KW)
- CAB3 - NEMA 3R ENCLOSURE (12 TO 14KW)
- CAB4 - NEMA 3R ENCLOSURE (18 TO 21KW)

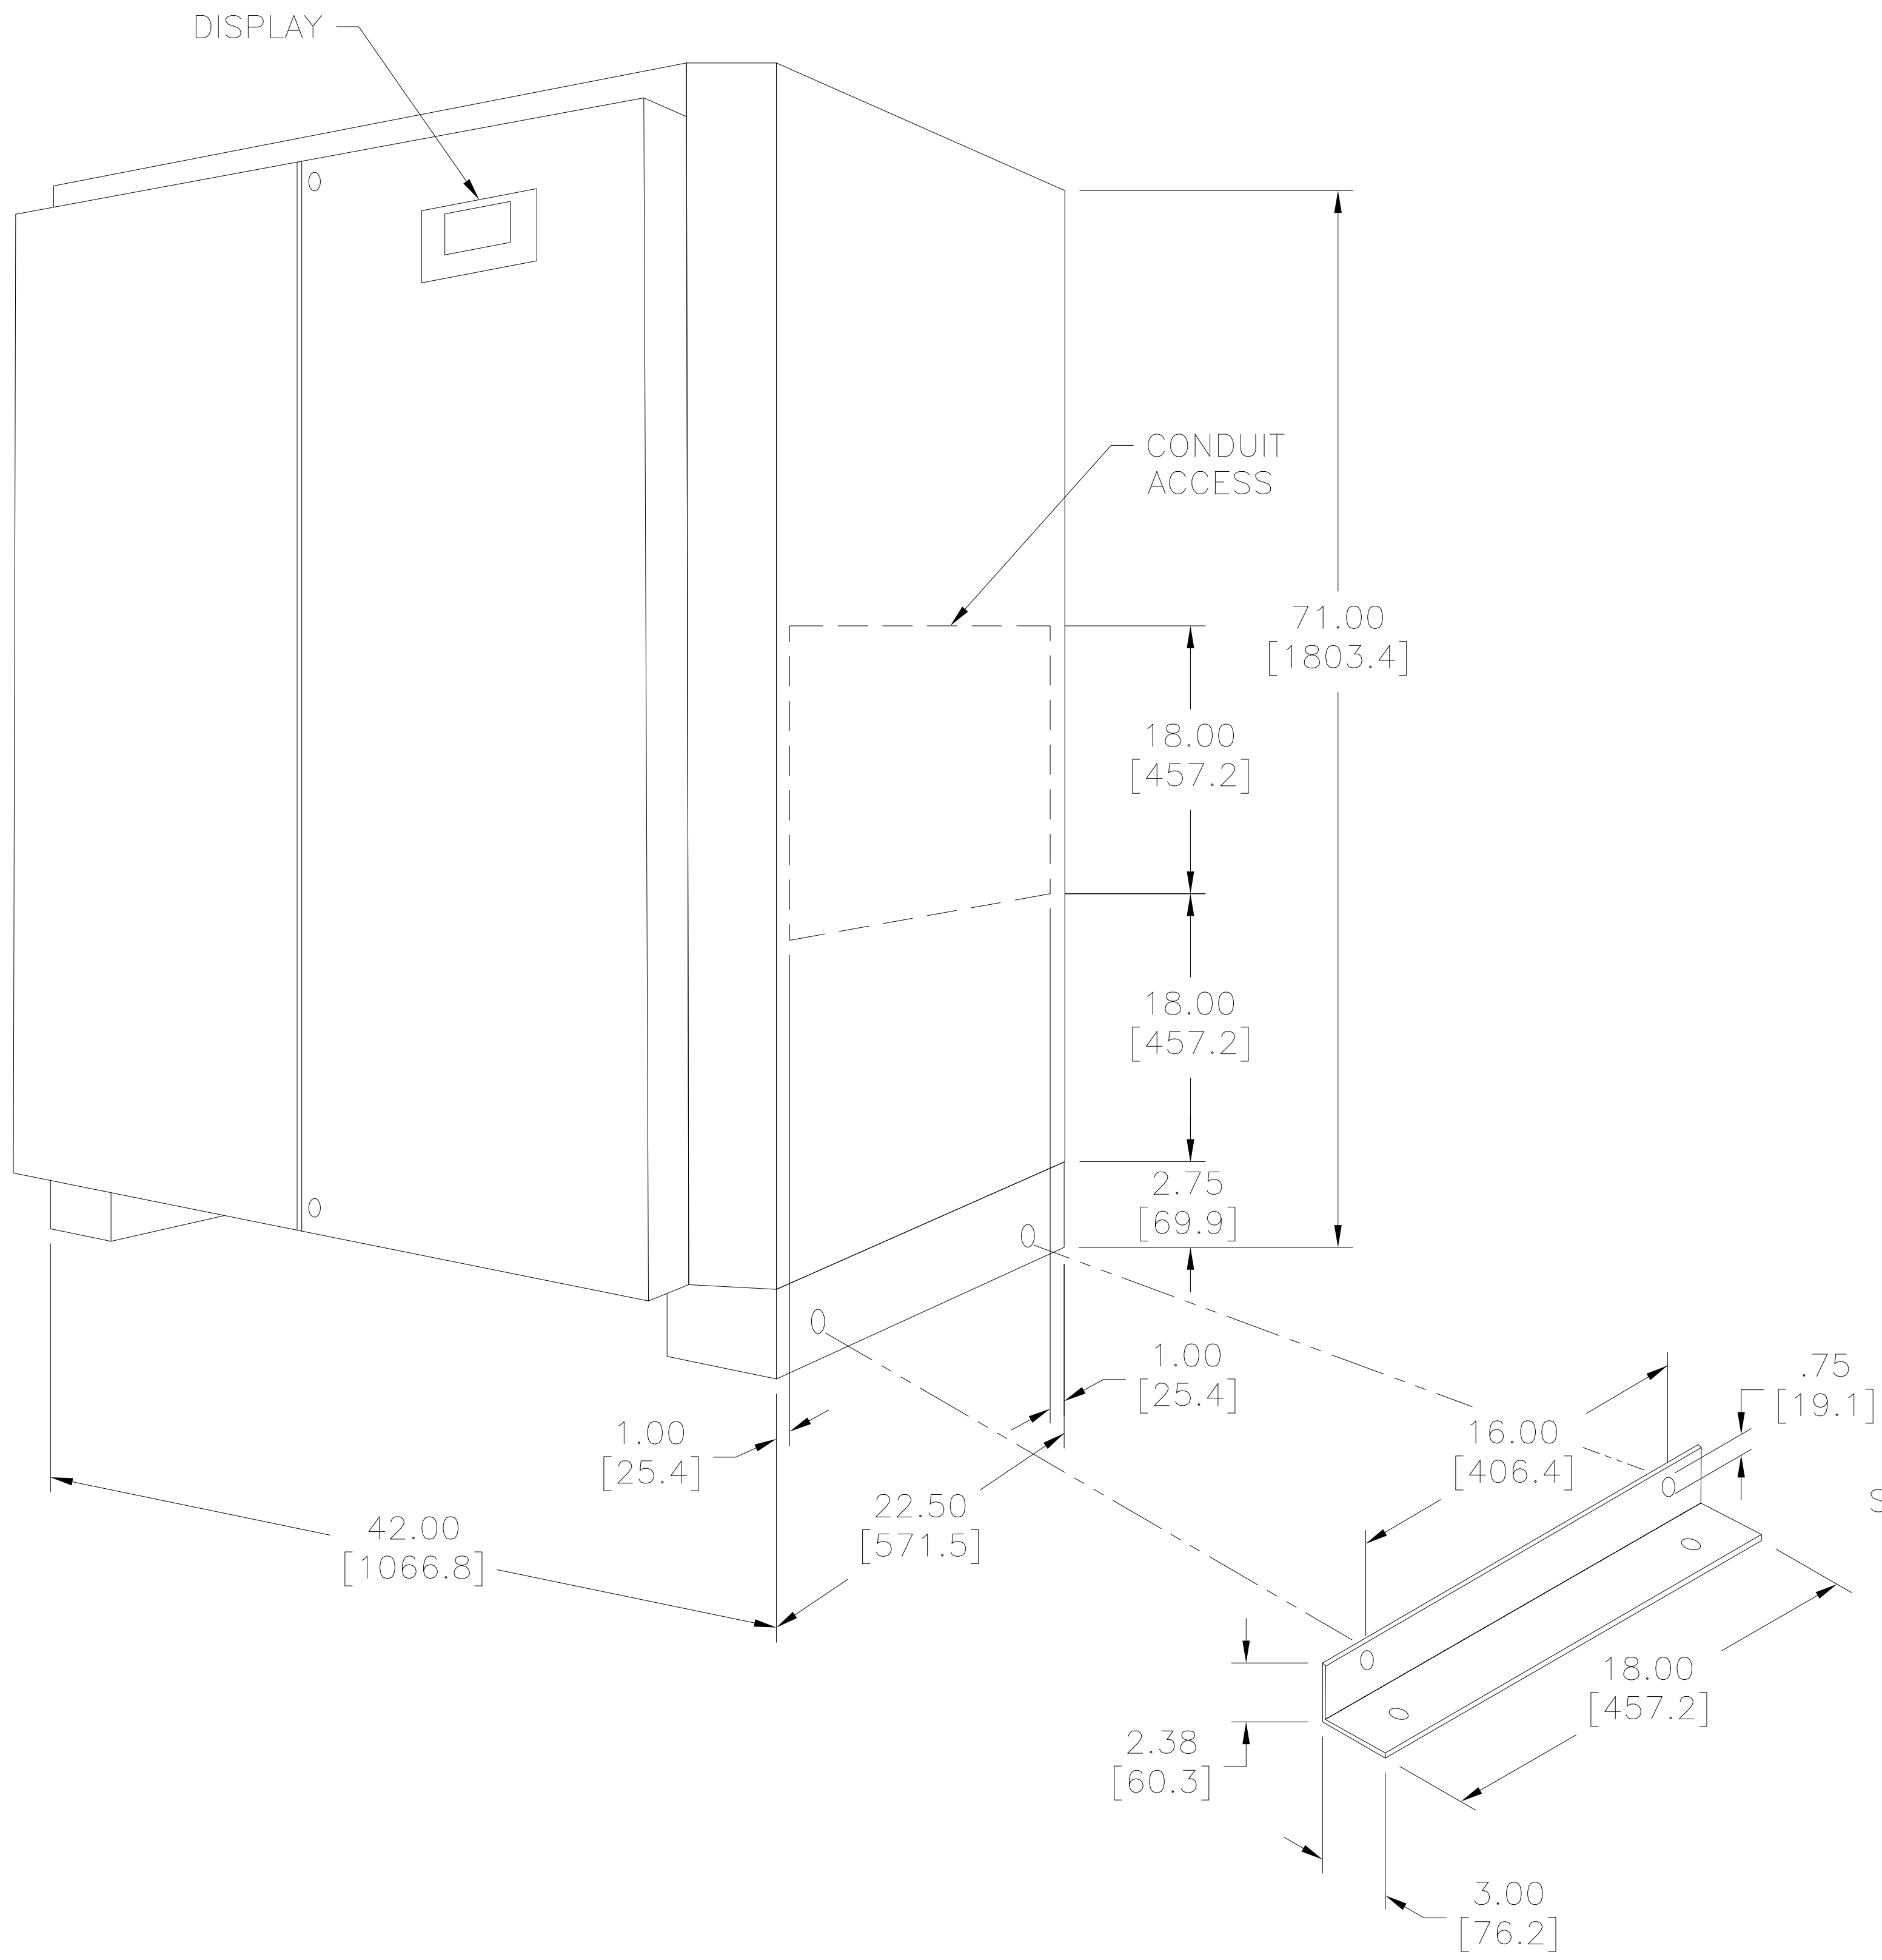

OPTIONAL SEISMIC BRACKET (2 EACH)

PER CODE REQUIREMENTS LEAVE 3.00 [76.2] CLEARANCE ON EACH SIDE OF THE CABINET INCLUDING THE BACK, AND A 36.00 [914.4] CLEARANCE IN FRONT.


NOTE:
SEPARATE BATTERY CABINET FOR 18 AND 21 KW SYSTEMS IS THE SAME SIZE AS THE UPS CABINET.



| | | | | | |
|--|-------|------------------------------------|-----------|----------------------|----------|
| UNLESS OTHERWISE SPECIFIED, TOLERANCE IS ± | | UNITS | | TITLE: | |
| DECIMALS | HOLES | ANGLES | DRAFT | SPEC. CNTROL DRAWING | |
| .XX .062 | .005 | 1° | 1-1/2° | UNISTAR SLCI924-EX | |
| .XXX .005 | | | | 1Ø UL 924 UPS | |
| MATERIAL: | | ALL DIMENSIONS APPLY AFTER PLATING | | DRAWN BY | DATE |
| | | | | S.A. SMITH | 4/12/14 |
| | | | | CHECKER | DATE |
| | | | | SAS | 8/13/14 |
| | | | | ENGINEER | DATE |
| | | | | SAS | 8/13/14 |
| | | SCALE | 1/8 | SHEET | 1 OF 2 |
| | | DO NOT SCALE DWG. | CAGE CODE | DWG. NO. | DWG. NO. |
| | | | 83008 | D | 096-4323 |

The information and design disclosed herein was originated by and is the property of STACO ENERGY PRODUCTS CO., which reserves all patent, proprietary, design, manufacturing, reproduction, use and sale rights thereto, and to any article disclosed therein except to the extent rights are expressly granted to others. The foregoing does not apply to vendor proprietary parts.

| | | | |
|-----------|----------|---------|-------------|
| DWG. NO. | 096-4323 | | |
| REVISIONS | | | |
| SYM. | E.C.O. | DATE | APVD. |
| A | 28604 | 10/3/16 | SEE SHEET 1 |

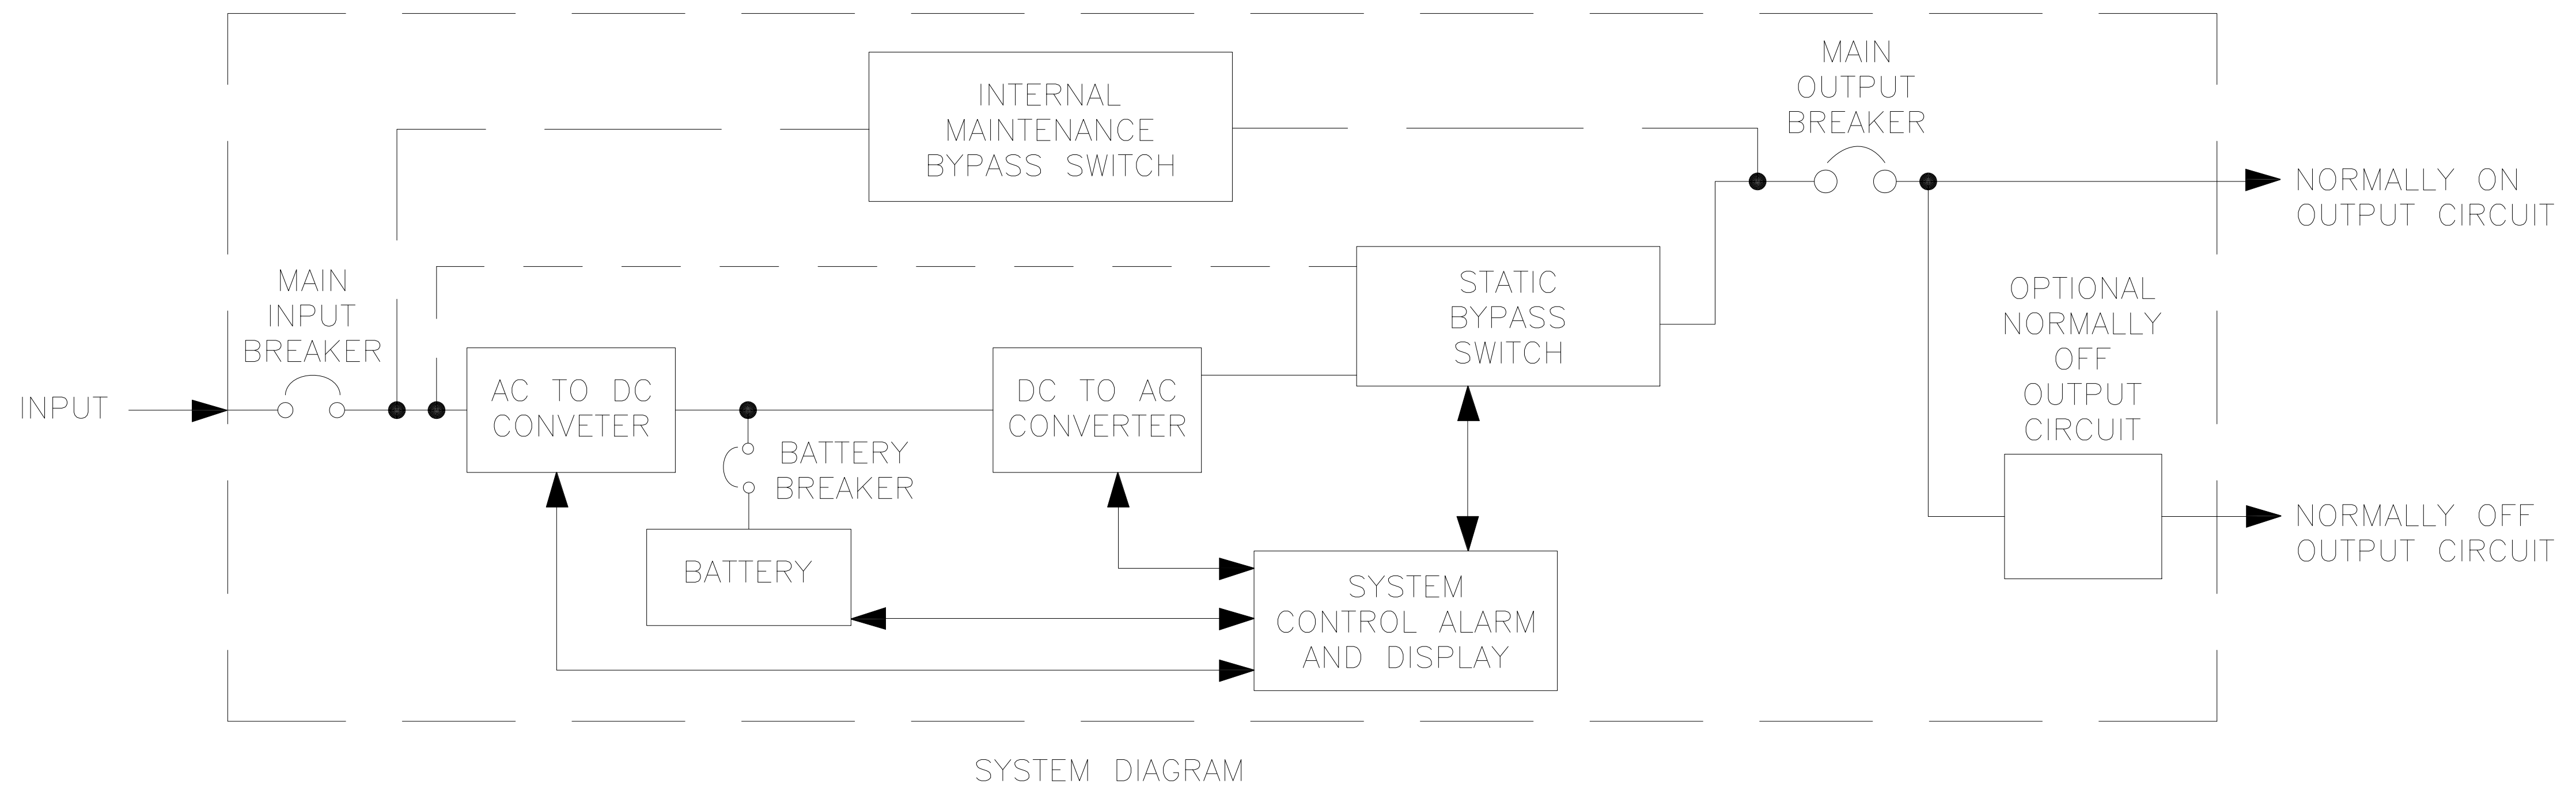

For more information and pricing contact:

Thad Everson
 (608)999-0039
teverson@facilitygateway.com

Frank Horner
 (608)692-9236
fhorner@facilitygateway.com



| | | | | | |
|--|-------|------------------------------------|--------|-----------------------|--|
| UNLESS OTHERWISE SPECIFIED, TOLERANCE IS ± | | UNITS | | TITLE: | |
| DECIMALS | HOLES | ANGLES | DRAFT | SPEC. CONTROL DRAWING | |
| .XX .062 | .005 | 1° | 1-1/2° | UNISTAR SCL1924-EX | |
| .XXX .005 | | | | 1Ø UL 924 UPS | |
| MATERIAL: | | ALL DIMENSIONS APPLY AFTER PLATING | | DRAWN BY | |
| | | | | S.A. SMITH | |
| | | | | CHECKER | |
| | | | | SAS | |
| | | | | ENGINEER | |
| | | | | SAS | |
| | | | | DATE | |
| | | | | 8/12/14 | |
| | | | | DATE | |
| | | | | 8/13/14 | |
| | | | | DATE | |
| | | | | 8/13/14 | |
| | | | | SCALE | |
| | | | | 1/1 | |
| | | | | SHEET 2 OF 2 | |
| | | | | DO NOT SCALE DWG. | |
| | | | | CAGE CODE | |
| | | | | 83008 | |
| | | | | DWG. NO. | |
| | | | | 096-4323 | |

The information and design disclosed herein was originated by and is the property of STACO ENERGY PRODUCTS CO., which reserves all patent, proprietary, design, manufacturing, reproduction, use and sale rights thereto, and to any article disclosed therein except to the extent rights are expressly granted to others. The foregoing does not apply to vendor proprietary parts.