


Engineer of Record for the Structure
Structural Systems of N. Fl, Inc.
Raul Reyes, PE 88925
1634 SE 47th Street #3
Cape Coral, FL 33904

This document has been reviewed for
conformance with the design intent of the
structure and specified design criteria.

☒ Accepted As-Is ☐ Accepted As Noted ☐ Revise and Resubmit

Truss Connector Total List		
Manuf	Product	Qty
Simpson	HUS28	11

Hatch Legend	
	13' 11" PLT HGT
	10' 4" CEILING HGT

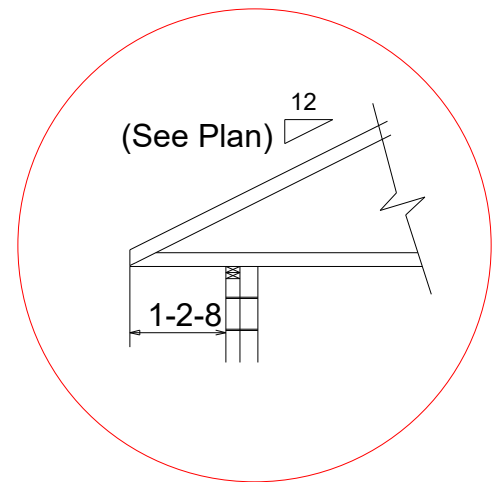


CANTILEVER DETAIL
1X

Wind Importance Factor	I
Occupancy/Risk Category	II
Lanal, Entry, Porch areas	EXPOSED TO WIND

TRUSSES DESIGNED FOR TILE OR SHINGLE APPLICATIONS

Truss List of <5000# reaction & <-1000# uplift					
Truss	Qty	Span	Reactions		
A01	3	42-05-00	1779.83 lb -1786.51 lb	4739.93 lb -3900.63 lb	699.86 lb -87.34 lb
A02	1	42-05-00	1192.53 lb -1034.32 lb	2594.73 lb -1667.87 lb	569.78 lb -115.49 lb
F1	1	25-09-00	2169.50 lb -1035.37 lb	2169.50 lb -1035.37 lb	
F4	1	25-09-00	12770.55 lb -4957.54 lb	8574.11 lb -3634.72 lb	

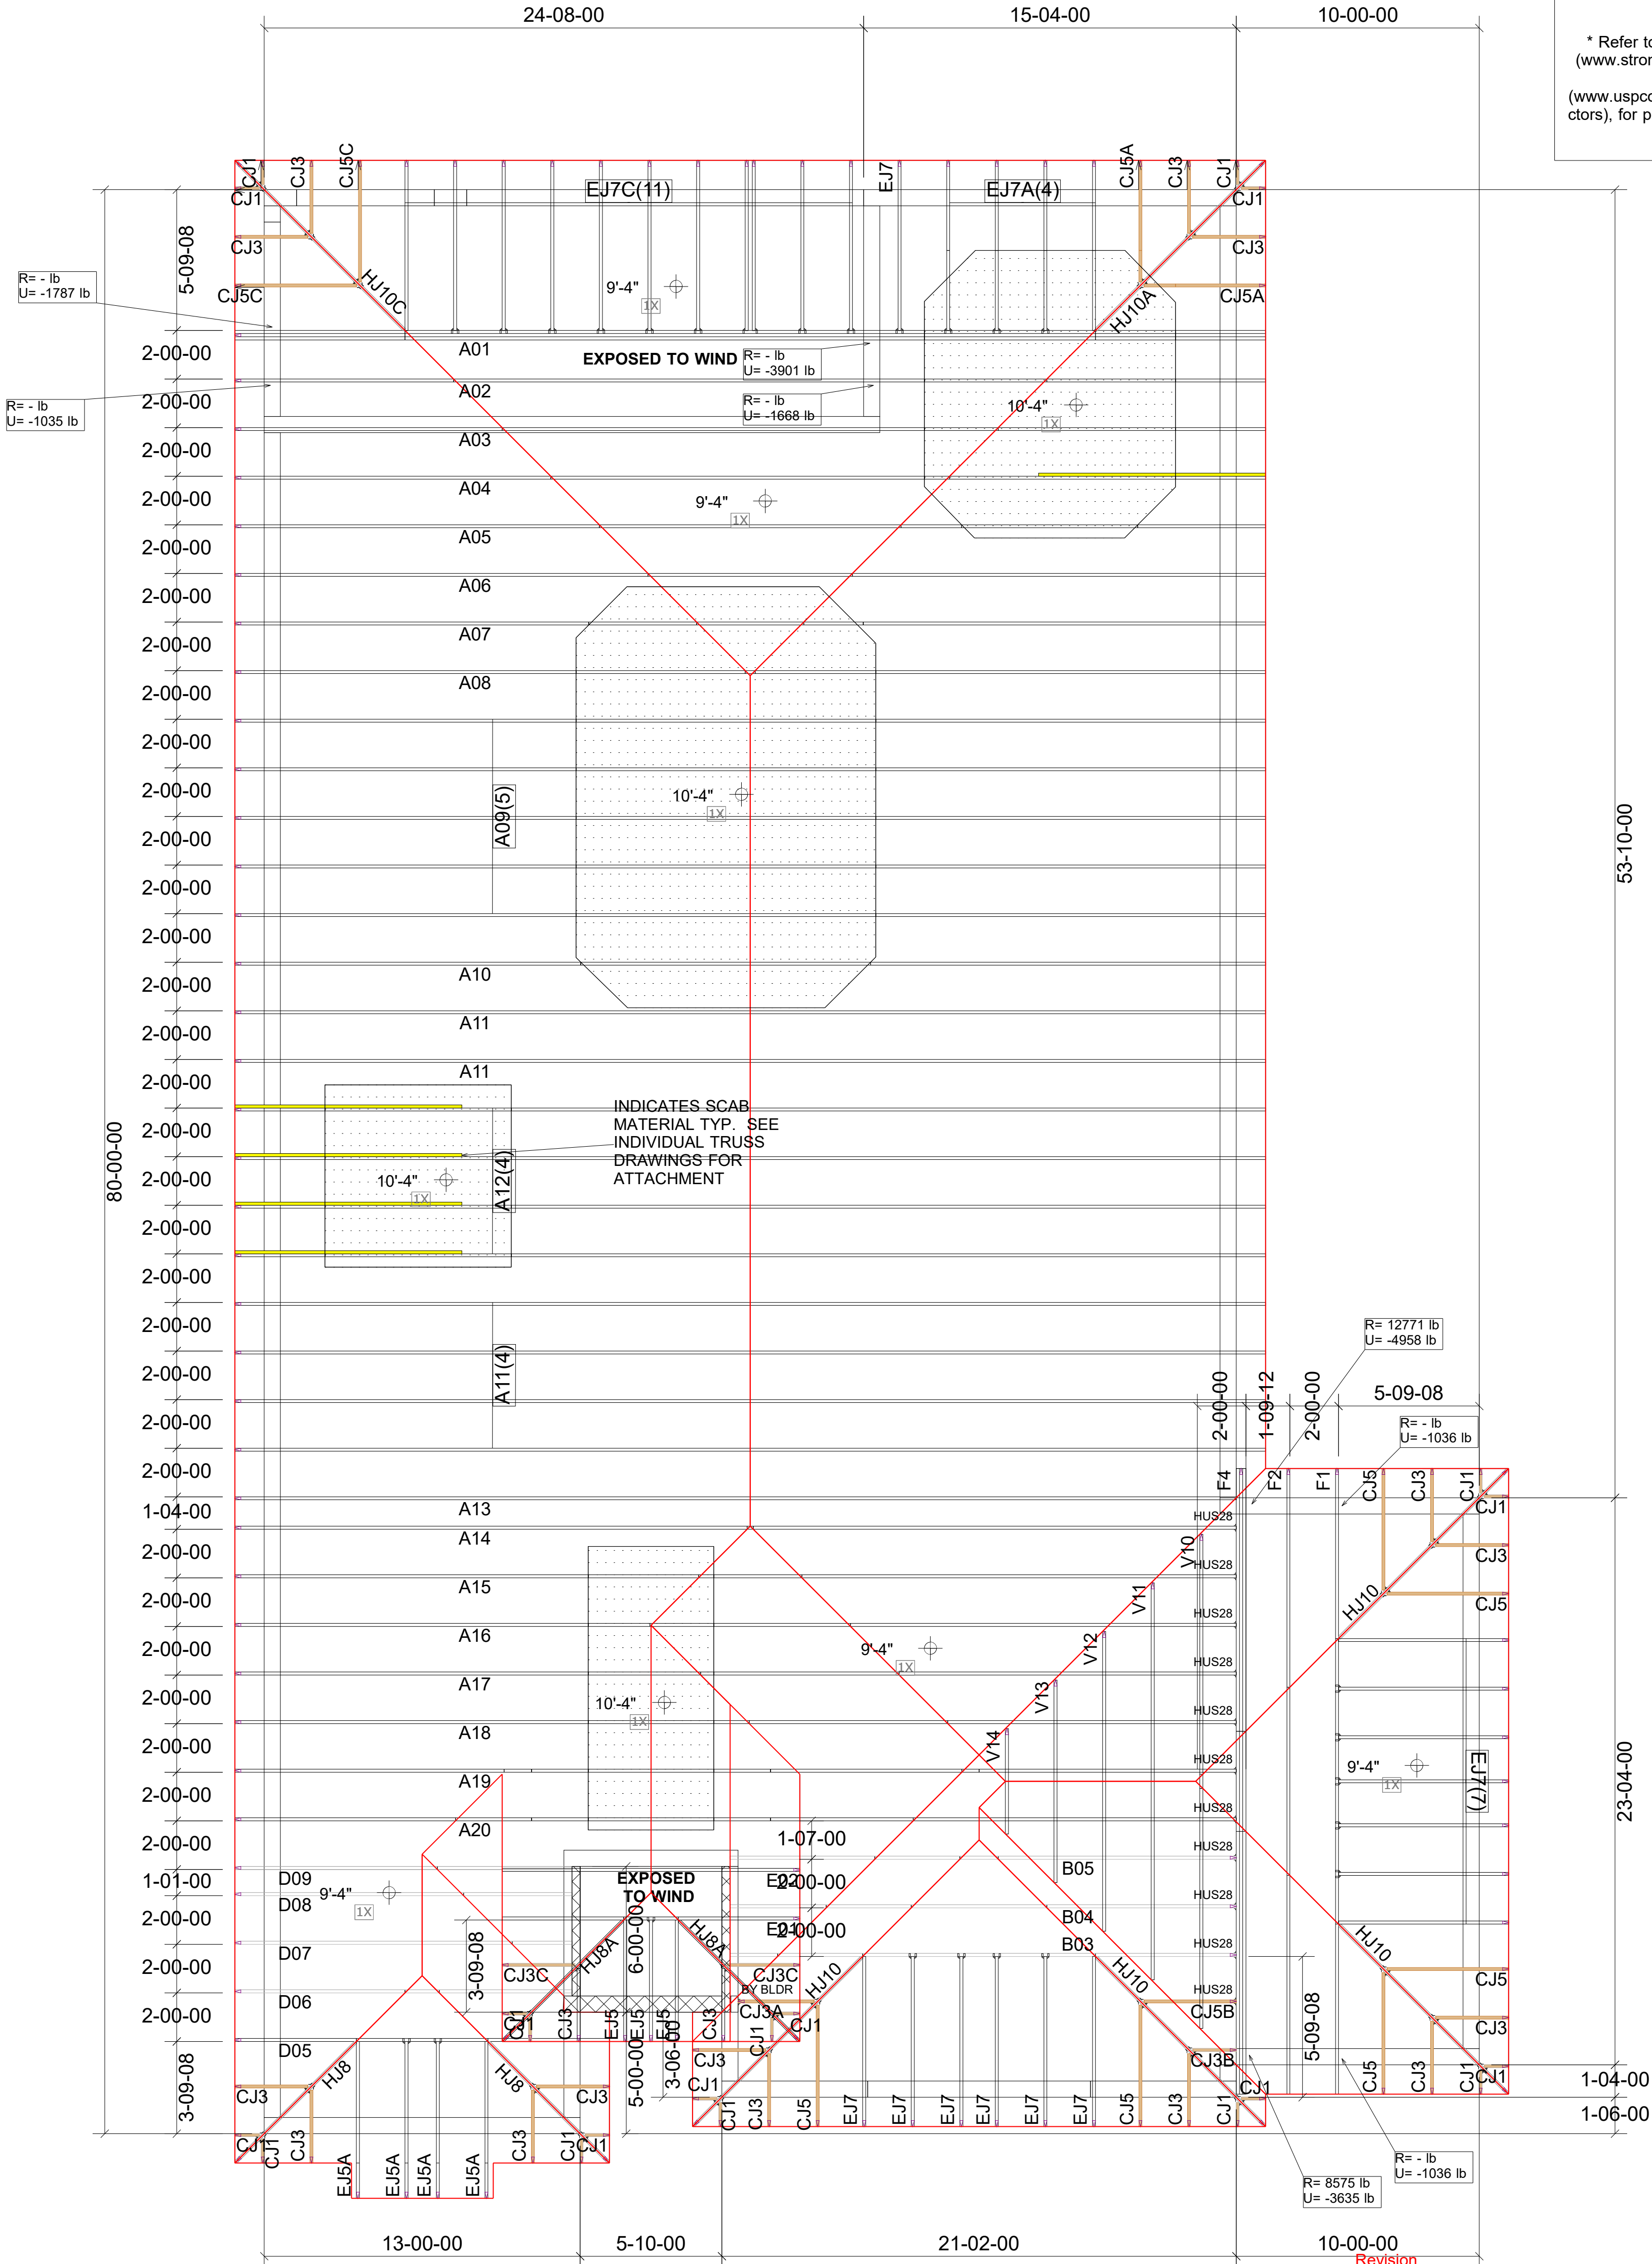

Hanger Notes

* Refer to Simpson Strong-Tie website
(www.strongtie.com/products/connectors),
or the USP website
(www.uspconnectors.com/us/products/conne-
ctors), for proper use and attachment of the
specified hangers.

General Notes

- * Required interior bearing walls shown @ heights noted
- * Trusses may not be cut or altered in any way without prior authorization from ABS, Inc.
- * Any trusses that are cut or altered without authorization will be repaired or replaced at the customers expense
- * No backcharges of any kind will be accepted without prior review and written consent from ABS, Inc.
- * For proper truss handling and bracing, refer to the "TPI" documents "BCSI-B1 through B4"
- * Any multi-ply trusses must be attached together per the engineering specifications prior to installation

* Permanent and temporary bracing is the responsibility of the truss installer. The "Engineer of Record" for the project is responsible for the design of the permanent bracing, the diaphragm system, shear walls, and structural elements to resist lateral loads from wind and or seismic activity. The "EOR" is also responsible to call out the required strapping materials to sufficiently attach the trusses to the load bearing structure below, to verify truss design specifications (pitch, span, profiles, applied loading, wind application, etc.), and for the overall design and placement plan of the truss system.

* If any job site accidents occur involving trusses, the installer must immediately stop work on the project and notify a representative of ABS, Inc.. All trusses involved in an accident must be inspected by a licensed structural engineer to determine the cause of the accident. The builder assumes all liability if trusses involved in an accident are altered or moved in any way before an inspection is completed. All decisions regarding necessary repairs or replacement of trusses will be based on the recommendation of the report submitted by the structural engineer.

MULTI-PLY ATTACHMENT

- * For 4-ply or 5-ply attachment, refer to the Detail Packet Sheet:
"STANDARD BOLT TO SCREW
TRUSS CONNECTION DETAIL" -
"T-4PLY OR 5PLY SCREW"

*** CRITICAL ***
ATTN: FRAMER

For multi-ply girder attachments, refer to engineering for specific instructions for attaching plies. Each ply must be applied in layers per the nailing specifications.

2-ply trusses may be nailed from one face.

For 3-ply trusses, the first two plies are nailed together from one face, then third ply is attached to either face of first two plies.

For 4 ply trusses, after assembling the first three plies, attach fourth ply to either face.

For 5 ply trusses, after assembling the first four plies, attach fifth ply to either face.

(Refer to engineering for additional bolts or screw rqrmts and the "STANDARD BOLT TO SCREW TRUSS CONNECTION DETAIL" for substituting screws for bolts, located in the engineering detail pkg.

NOTE: Bolts/Screws are intended to provide clamping force to aid in allowing the multi-ply assembly to act as a unit and are not included in the calculation of ply-to-ply load transfer.


Designed Per ASCE 7-16

Loading and Design Criteria


	Roof	Floor		
TC LL	20	40	Mean Hgt	15'
TC DL	20	10	Wind Speed	170
BC LL	0	0	Exposure	C
BC DL	10	5		
Duration	1.25	1.00		




Builder:	DR Horton Ft Myers
Model:	2221 M
Options:	3 Car Garage
Location:	-
Date:	12/4/2020
Sales Rep:	Carl F
Designer:	Joe D
Job Number:	142000809-20MXX

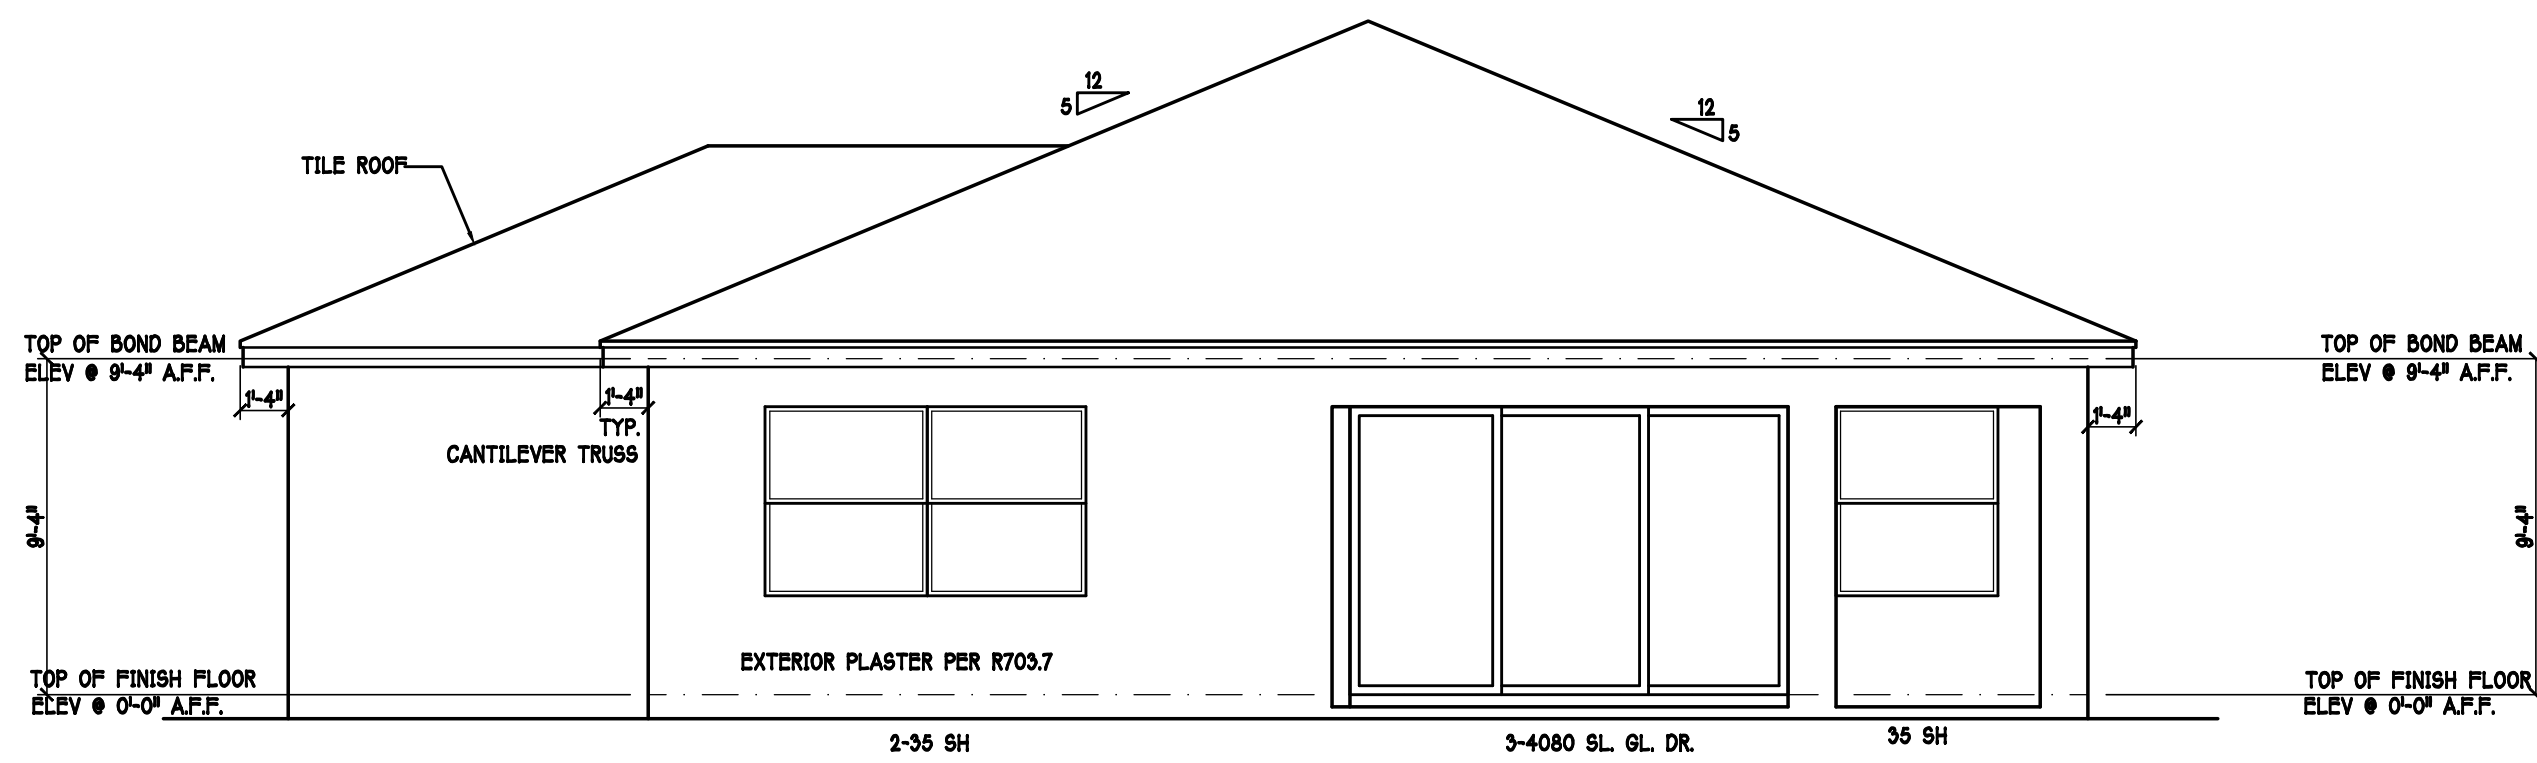


REAR ELEVATION: "M" SCALE: 3/16" = 1'-0"

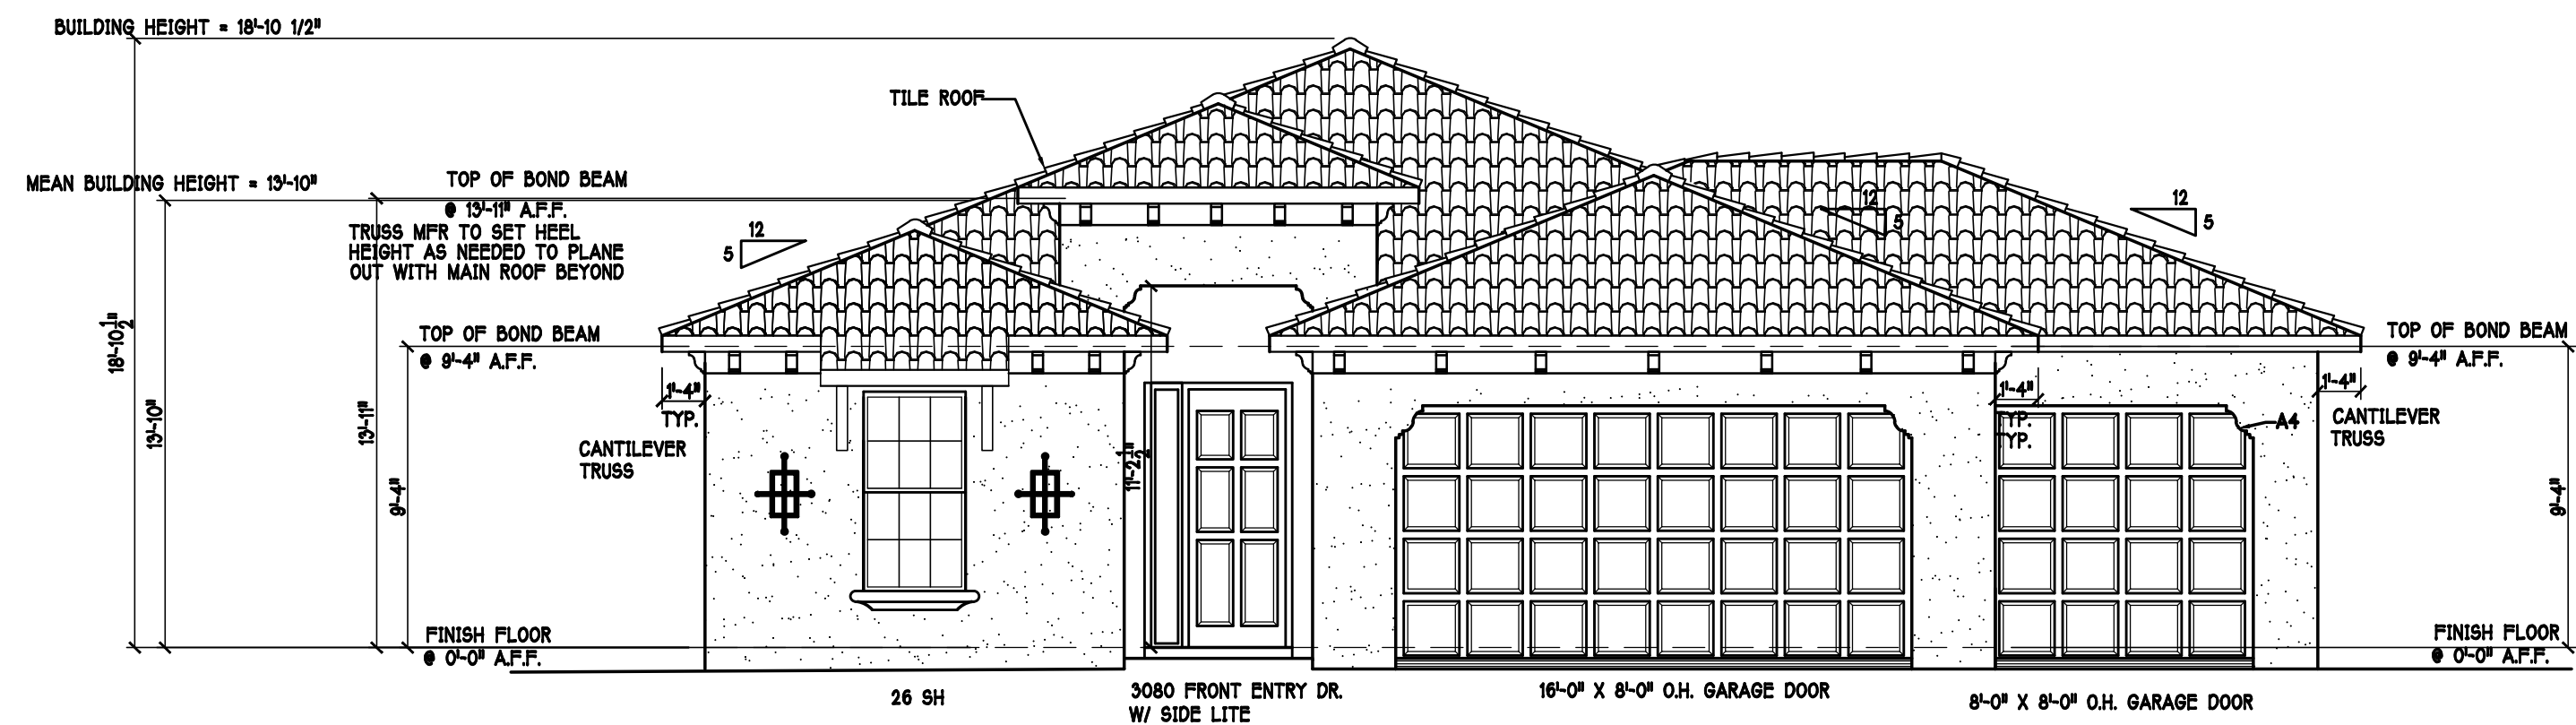


FRONT ELEVATION: "M" SCALE: 3/16" = 1'-0"

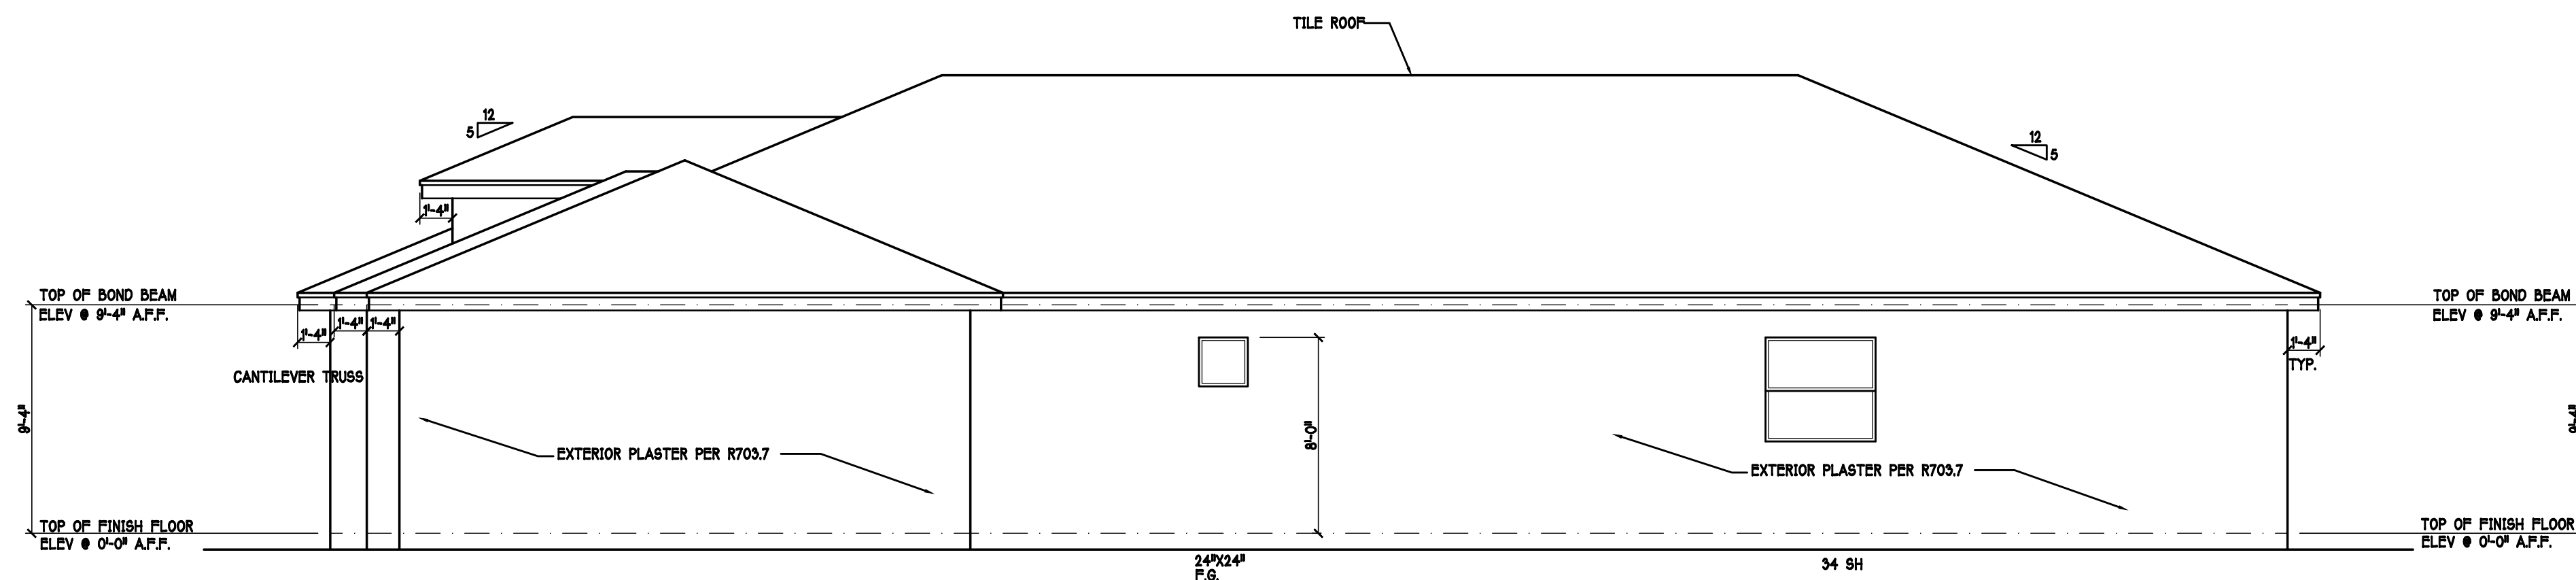

RIGHT SIDE ELEVATION: "M" SCALE: 3/16" = 1'-0"


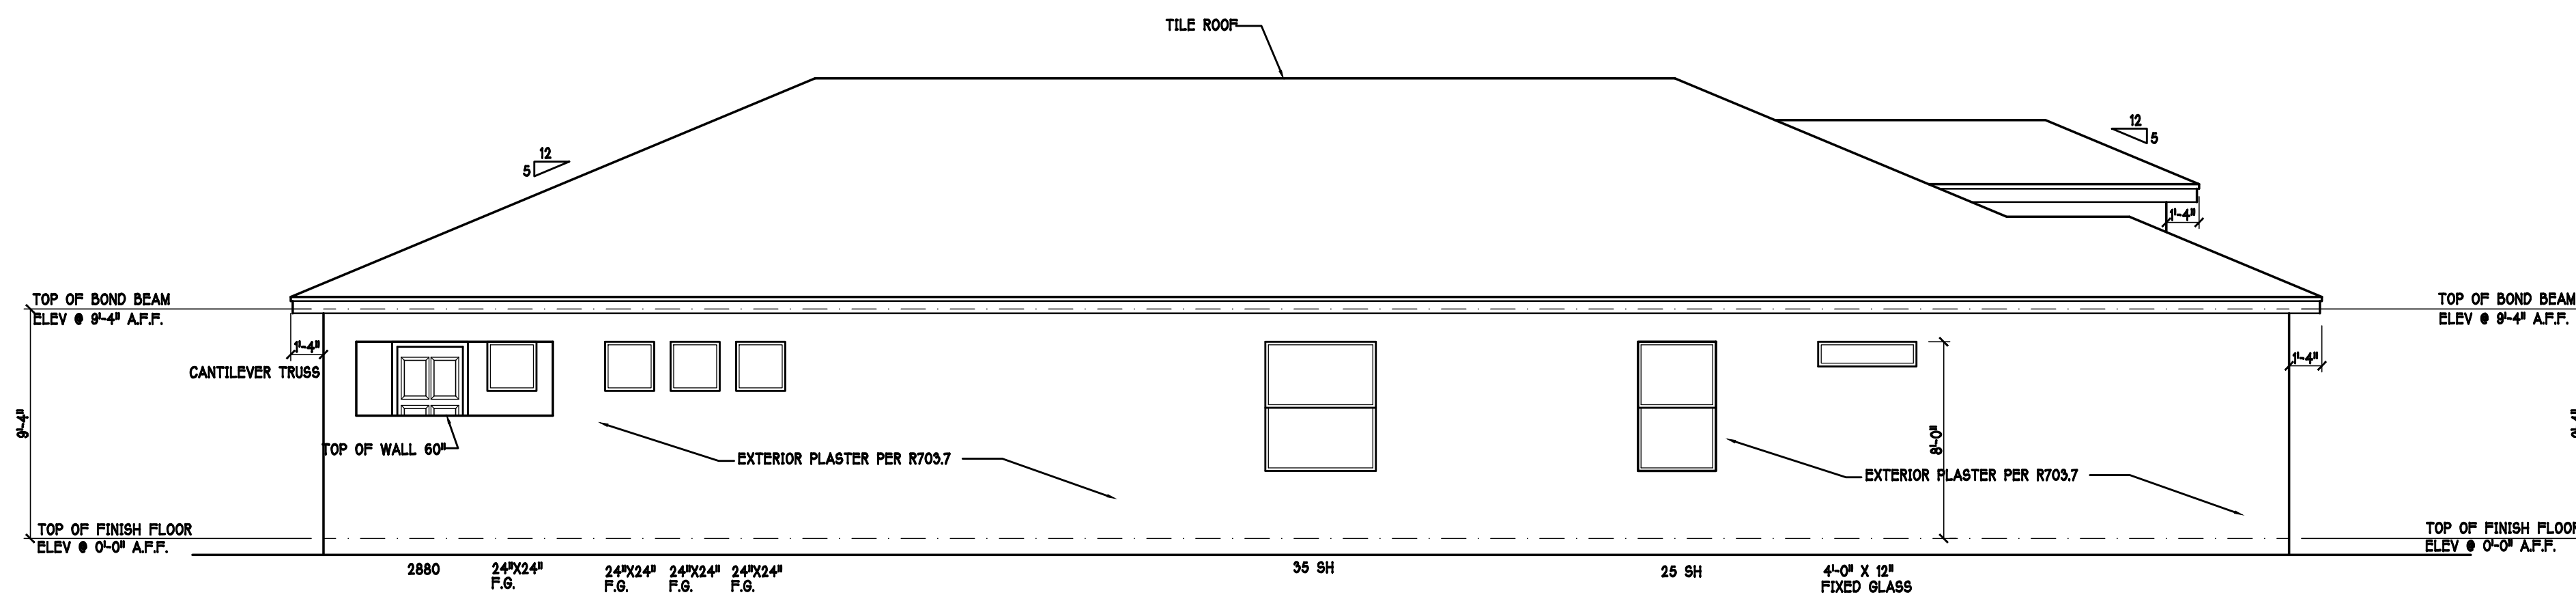


LEFT SIDE ELEVATION: "M" SCALE: 1/4" = 1'-0"

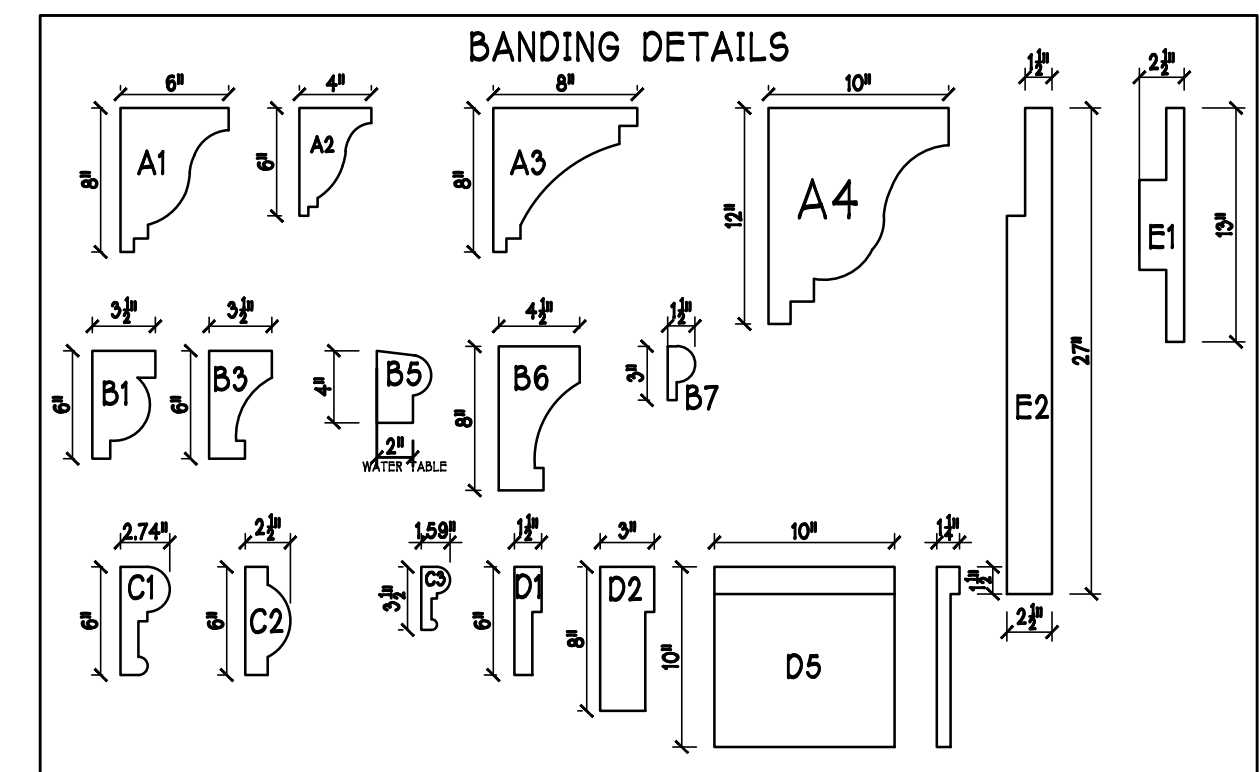

FLORIDA BUILDING CODE 7TH EDITION

OCCUPANCY: FBC 310.5 RESIDENTIAL GROUP R-3 CONSTRUCTION TYPE:
V-5 (FIRE RESISTANCE RATING 0 HOURS, NOT SPRINKLED) CODES TO BE
USED BY OTHER DESIGN PROFESSIONALS AND LICENSED CONTRACTORS:
2020 FLORIDA BUILDING CODE, 7TH EDITION: RESIDENTIAL;
ACCESSIBILITY; ENERGY CONSERVATION; PLUMBING; MECHANICAL; AND
FUEL GAS. ELECTRICAL IS CONTAINED BY REFERENCE WITHIN FBC
RESIDENTIAL CHAPTER 34: NFPA 70-17 NATIONAL ELECTRICAL CODE.

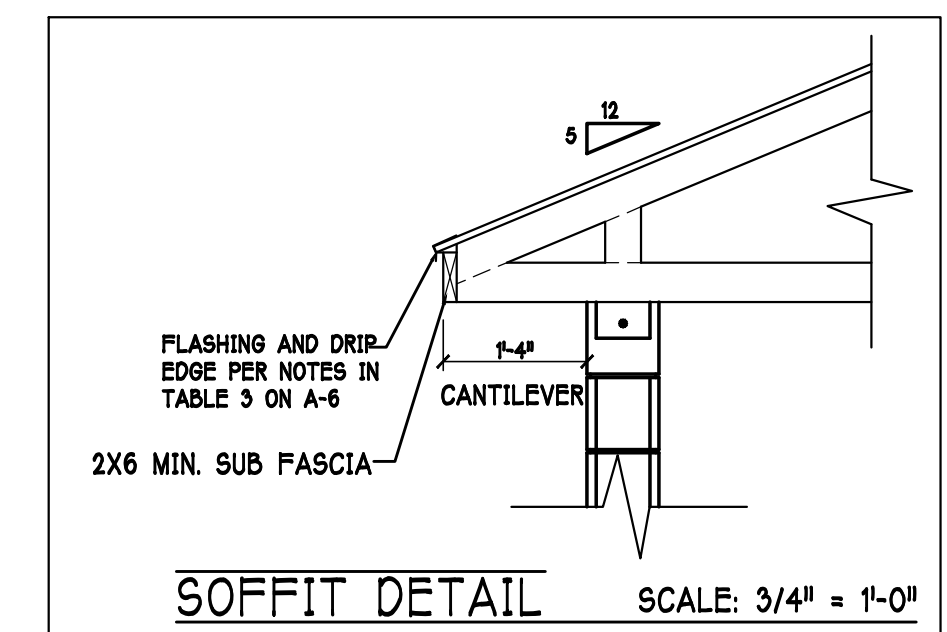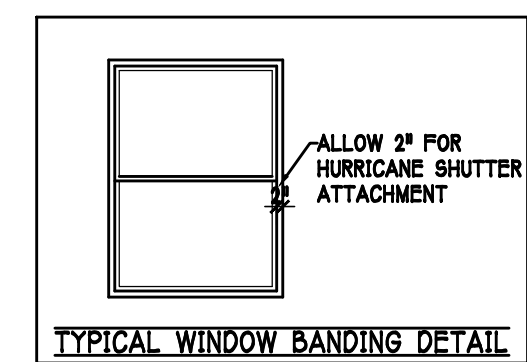

DESIGN IN ACCORDANCE W/ THE 2020 RESIDENTIAL
FLORIDA BUILDING CODE- 7TH EDITION

D.R. HORTON
America's Builder

Gulf Coast Drafting
& Design
Phone (239) 540-1822
Fax (239) 540-7759

MODEL:
UNIT 2221

LOT: 2 BLOCK :
SUBDIV: ROYAL PALM GOLF
ADDRESS: 18648 ROYAL HAMMOCK BLVD
C.C.D.# : 13136 D.R.H.# : 579930004

RESIDENCE FOR:
SPEC

DATE:
07-28-21

DRAWN BY:
JSL

CHECKED BY:
JWC




REVISED:

PLAN:
ELEVATIONS

SCALE:
3/16" = 1'-0"

SHEET#

A-1 M

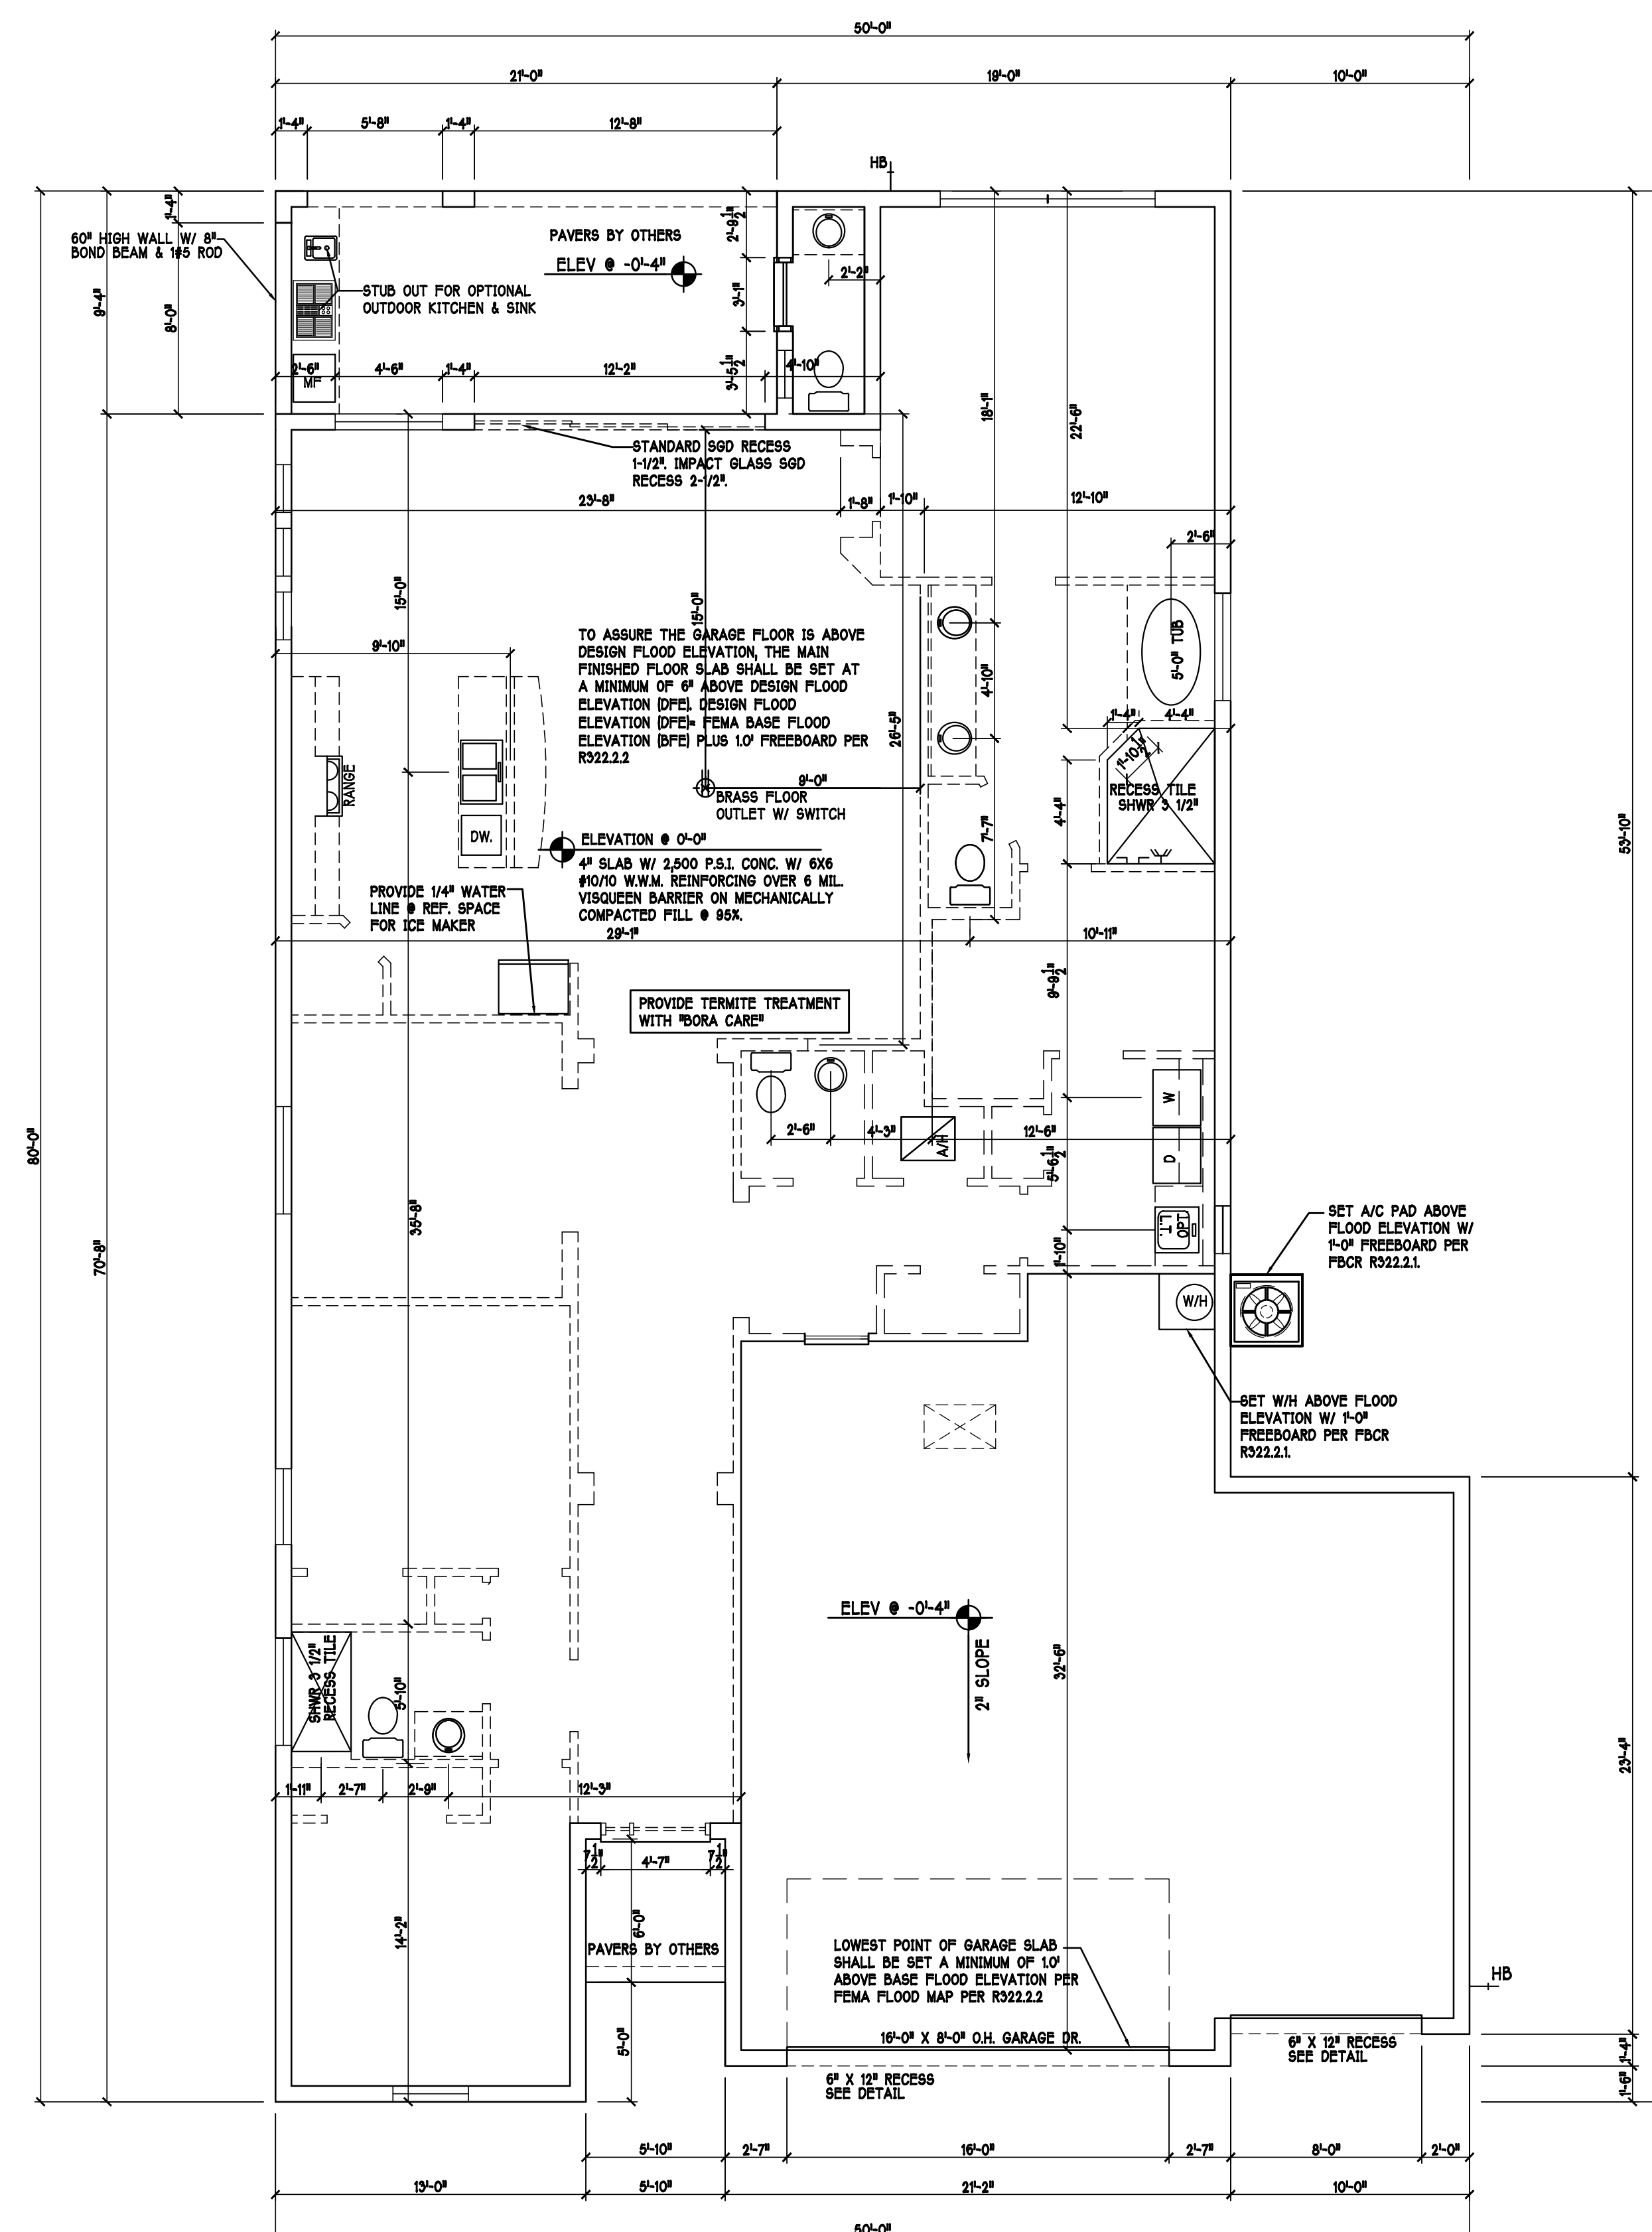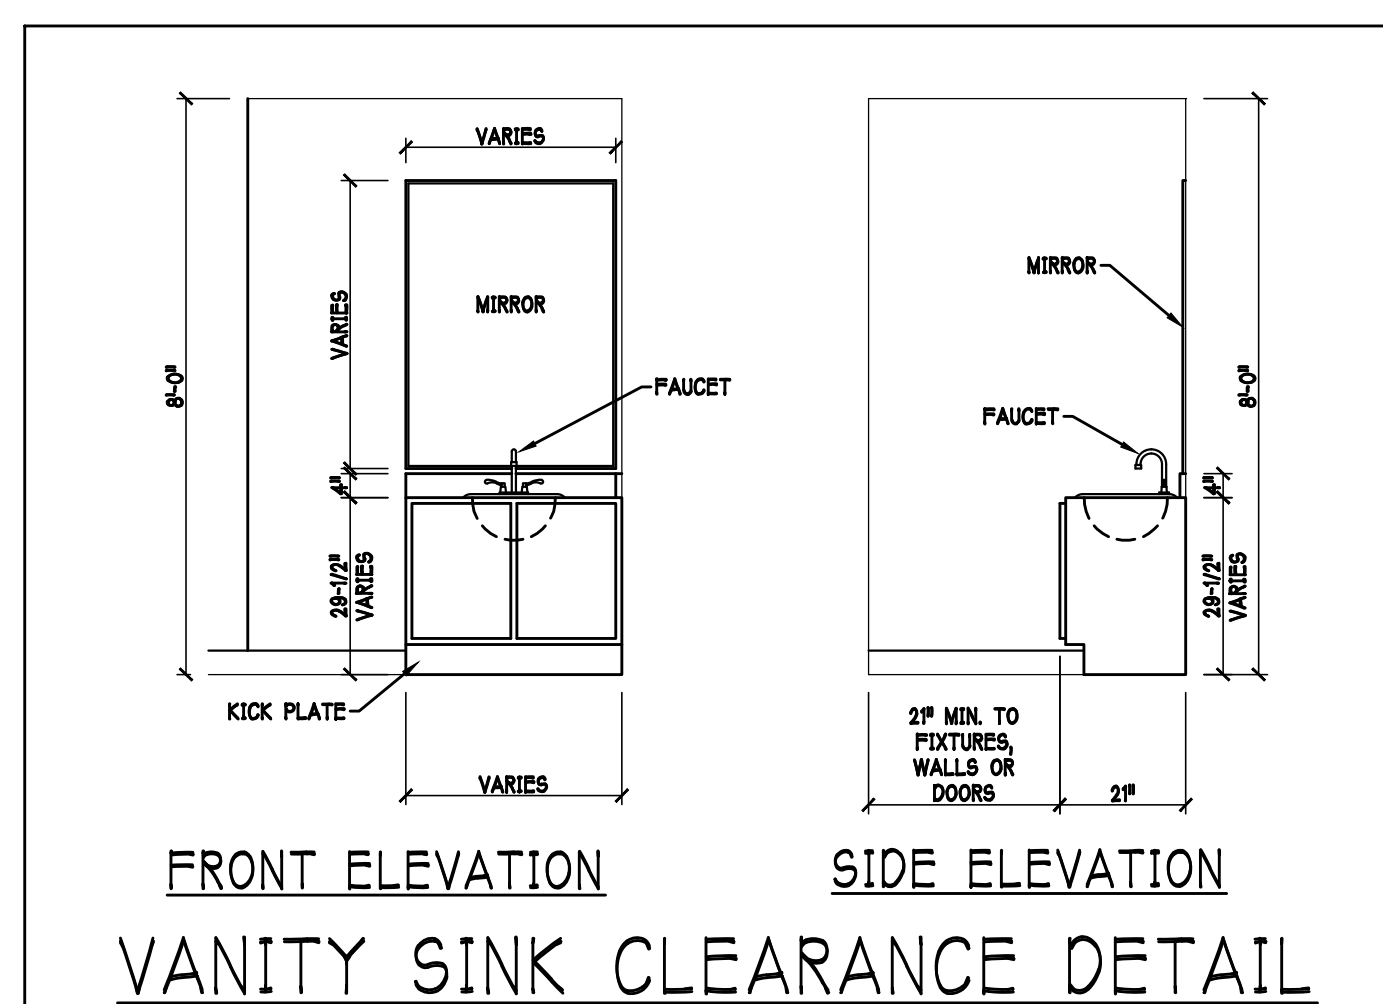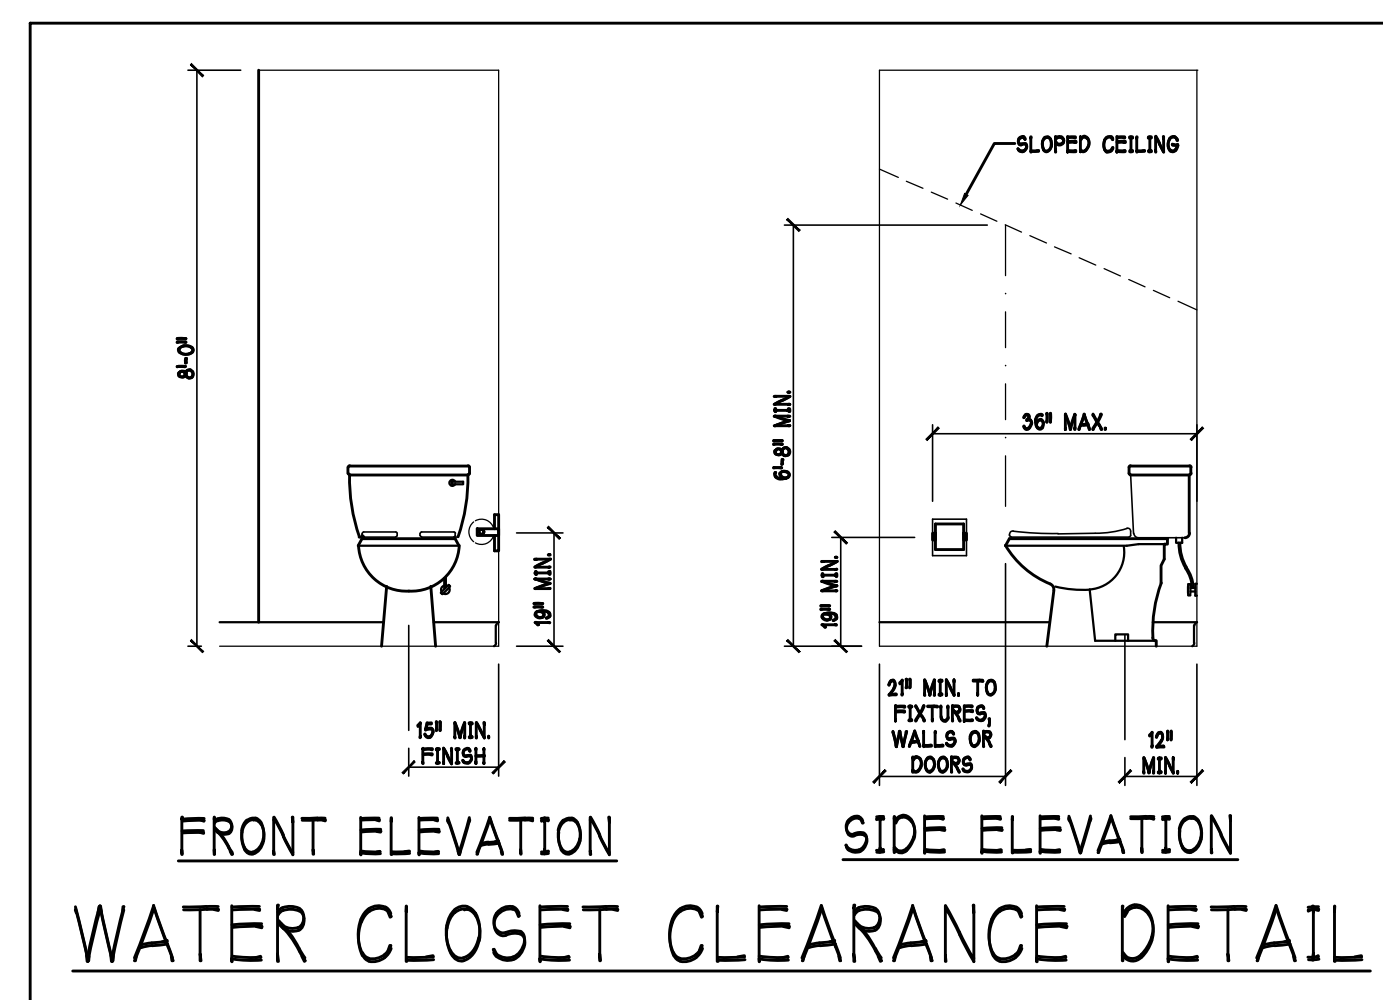

DESIGN IN ACCORDANCE W/ THE 2020 RESIDENTIAL
FLORIDA BUILDING CODE- 7TH EDITION


**D.R. HORTON • PHIL
MAYSE**
America's Builder

**Gulf Coast Drafting
& Design**
Phone (239) 540-1822
Fax (239) 540-7759


SPEC	RESIDENCE FOR:	MODEL:
	G.C.D.# : 13136	LOT:2
	D.B.H.# : 579030004	BLOCK :

DATE:	07-28-21
DRAWN BY:	JSL
CHECKED BY:	JWC
REVISED:	
PLAN:	SLAB & PLUMBING
SCALE:	3/16" = 1'-0"
SHEET#	


A-2M

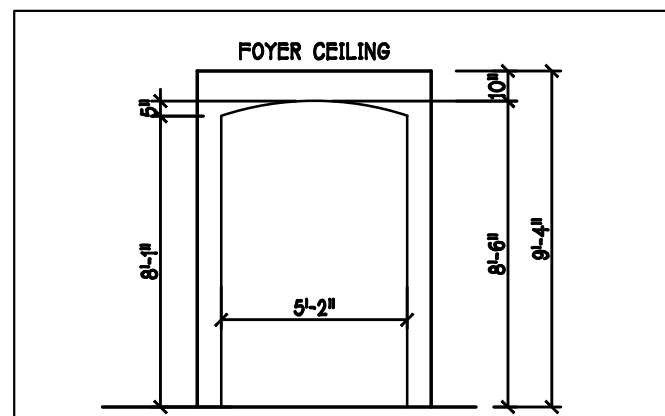


FOYER DETAIL

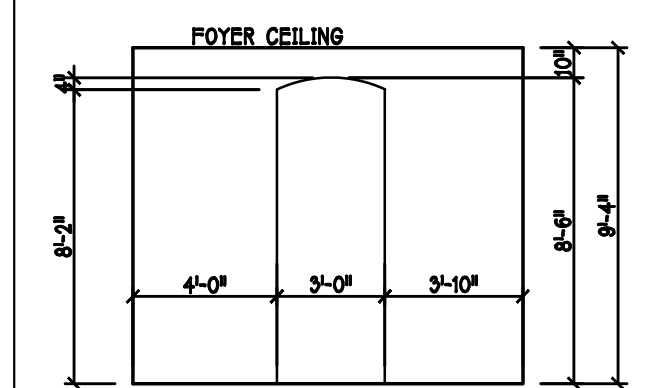


HALL/FOYER DETAIL

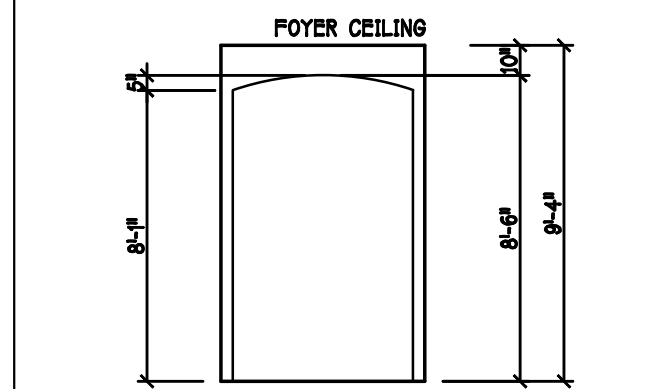

DEN/FOYER DETAIL

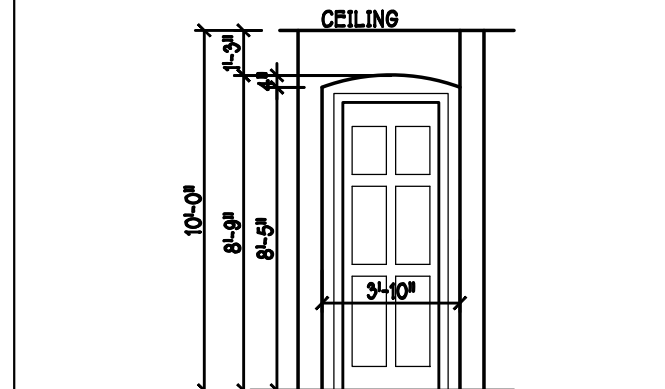

MASTER SUITE DETAIL

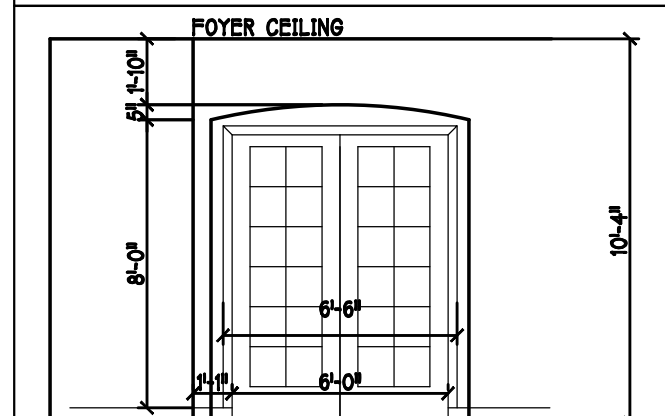


DEN/FOYER DETAIL

D R HORTON						
MARK	SIZE CODE	PRODUCT DESCRIPTION	WIDTH	HEIGHT	COMMENTS	QTY
1	OVERHEAD	GARAGE DOOR	192	86		1
2	3080 ENTRY DR.	DISTINCTION	36	86		1
3	OVERHEAD	GARAGE DOOR	86	86		1
4	2880 EXT. DOOR	DISTINCTION	30	86		1
SEE NOTE 1						4

D R HORTON					
MARK	SIZE CODE	PRODUCT DESCRIPTION	WIDTH	HEIGHT	COMMENTS
A	55 SH		54	63	IMPACT
B	25 SH		38	63	IMPACT
C	48" X 12" F.G.	FIXED GLASS	48	12	IMPACT TEMPERED
D	34 SH		54	51	IMPACT
E	2-35 SH		108	63	IMPACT
F	3-4080 SL. GL. DR.		144	86	IMPACT
G	12" X 86" SIDE LITE		12	86	IMPACT
H	2'-0" X 2'-0"	FIXED GLASS	24	24	IMPACT
I	26 SH		38	78	IMPACT
SEE NOTE 1					14


BATHROOM NOTES	
72 TOWEL BAR	ALL TUB DECKS @ 2" A.F.F.
83 TOILET PAPER	ALL BLOCKING TO BE PT IN SHOWERS
OPT IMPACT GLASS MAY BE INSTALLED IN LIEU OF SHUTTERS VERIFY W/ CONTRACT	

INTERIOR DOOR SCHEDULE		
MARK	DOOR WIDTH	NOTES
1	3'-0"	PK. = POCKET DOOR
2	2'-8"	B.F. = BI-FOLD DOOR
3	2'-6"	B.P. = BI-PASS DOOR
4	2'-4"	LV. = LOUVERED DOOR
5	2'-0"	
6	1'-8"	
7	1'-6"	

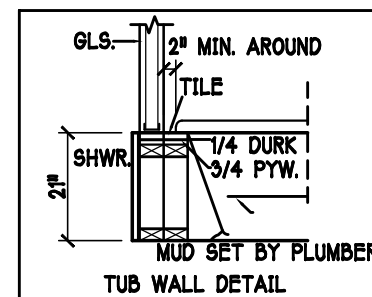


DOOR HEADERS		
6'-0" BIFOLD	HEADER HEIGHT	82" A.F.F.
6'-8" SWING	HEADER HEIGHT	82 1/2" A.F.F.
8'-0" SWING	HEADER HEIGHT	88 1/2" A.F.F.
PLAN NOTES		
1) VERIFY ALL ROUGH OPENING DIMENSIONS FOR ALL WINDOWS AND DOORS		
2) PROVIDE SAFETY GLAZING WITHIN 24" FROM EXIT PER FLORIDA BUILDING CODE R 308.4.2.		
3) PROVIDE SAFETY GLAZING AT BATH / SHOWER . PER FLORIDA BUILDING CODE R 308.4.5.		
4) NON BEARING INTERIOR FRAME WALLS SHALL BE FRAMED W/ WOOD OR METAL STUDS. SPACING SHALL NOT EXCEED 24" O.C. (NON BEARING WALLS ONLY)		
5) PROVIDE DEAD WOOD IN ATTIC FOR OVERHEAD GARAGE DOOR HARDWARE		
6) KITCHEN KNEE WALL TO BE FRAMED W/ TOP @ 41 1/2" A.F.F. W/ RAISED BAR TOP		
7) INSTALL SMOOTH WALLS IN KITCHEN AND ALL BATHROOM AREAS		
8) WHERE DRYWALL CEILING IS APPLIED TO TRUSSES AT 24" O.C. USE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. R202.5.5		
9) THE GARAGE SHALL BE SEPARATED FROM THE RESIDENCE & ATTIC BY NOT LESS THEN 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE. GARAGES BENEATH HABITABLE ROOMS SHALL BE SEPARATED WITH NOT LESS THAN 5/8" TYPE 70" GYPSUM BOARD OR EQUIVALENT. WHERE THE SEPARATION IS A FLOOR - CEILING ASSEMBLY THE STRUCTURE SUPPORTING THE SEPARATION SHALL ALSO BE PROTECTED BY NOT LESS THAN 1/2" GYPSUM BOARD OR EQUIVALENT		
10) INSTALL 1 3/8" THICK SOLID WOOD DOOR BETWEEN LIVING AND GARAGE PER FLORIDA BUILDING CODE R202.5.1		
11) ALL WINDOWS INSTALL 72" ABOVE GRADE MUST COMPLY WITH R 312.2.1 MIN 24" SILL HEIGHT OR PROVIDED WITH AN APPROVED WINDOW FALL PREVENTION DEVICE		
12) STUB OUT FOR GAS @ OUTDOOR KITCHEN, RANGE, WATER HEATER, AND DRYER. VERIFY WITH CONTRACTOR AND SUBDIV. SPECS. A SEPARATE PERMIT IS REQUIRED FOR GAS PIPING.		
13) ALL CLOSET SHELVES TO BE 12". ALL PANTRY & LINEN TO BE (4)-16" SHELVES 18" O.P.F. WITH 15" INCREMENT.		
14) ALL MECHANICAL AND ELECTRICAL EQUIPMENT TO BE INSTALLED AT OR ABOVE FLOOD PLUS 1'-0" FREEBOARD.		
CABINET BACKING		
KITCHEN	UPPER TOP @ 84"	BASE TOP @ 35"
MASTER BATH	UPPER	BASE- TOP @ 35"
GUEST BATH	UPPER	BASE- TOP @ 35"
LAUNDRY RM.	UPPER TOP @ 84"	BASE

SQUARE FOOTAGE		
LIVING AREA	2221	
GARAGE AREA	886	
LANAI AREA	196	
ENTRY AREA	35	
POOL BATH AREA	34	
TOTAL AREA	3372	

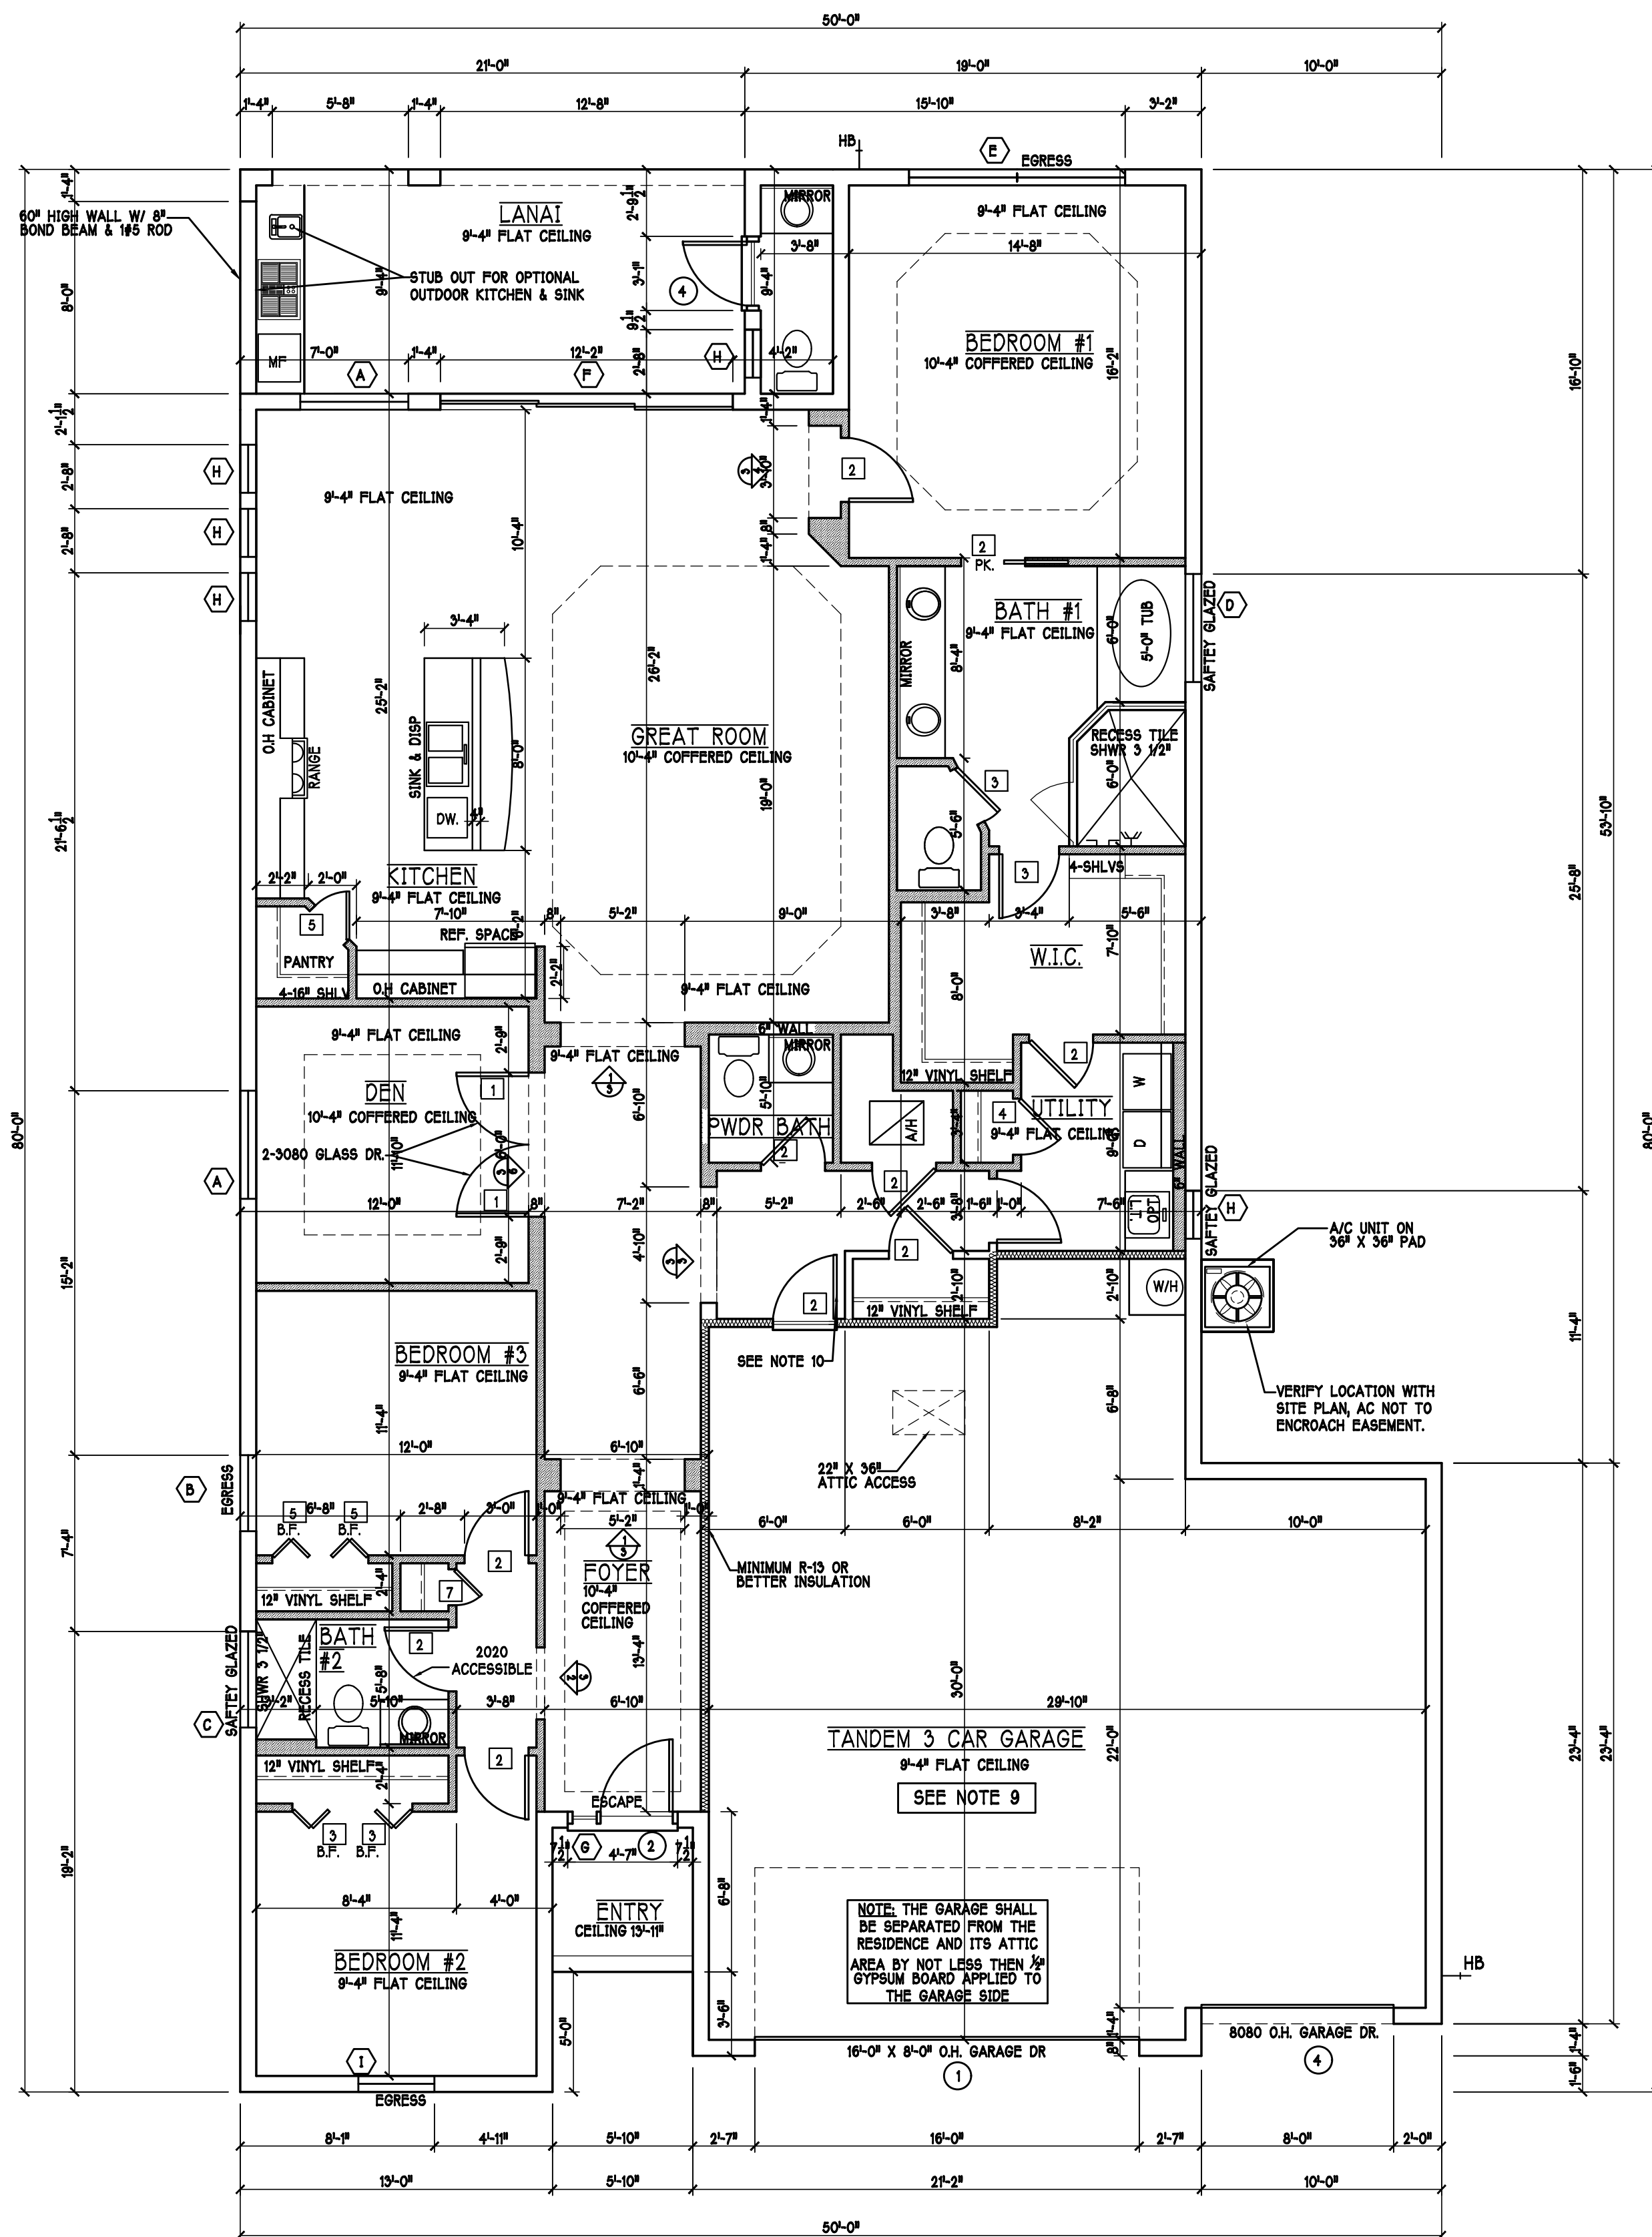


1st FLOOR PLAN: SCALE: 3/16" = 1'-0"

MODEL 2221 M: ATTIC VENTILATION FBCR R806									
COORDINATE VENTING REQUIREMENTS WITH ENERGY CALCULATIONS									
AREAS (SQ. FT.)			SOFFIT ONLY (1/150) (NO ROOF VENTS)			WITH ROOF VENTS (1/300) (R.V.)			
			ATTIC VENTILATION REQUIRED			ATTIC VENTILATION REQUIRED			
MARK	ATTIC	SOFFIT	ATTIC AREA/150	REQ'D AIR FLOW QUAD 4 OF SOFFIT	SOFFIT HAS	ATTIC AREA/300	QUANTITY OF ROOF VENTS	MIN AIR FLOW OF SOFFIT	
1st STORY	3443.4 SQ. FT.	304.3 SQ. FT.	22.96 SQ. FT.	7.55%	8.15%	--- SQ. FT.	-	---%	
			SOFFIT ONLY QUALIFIES			ROOF VENTS ARE NOT REQUIRED			
			SOFFIT MODEL			ROOF VENT MODEL			
			ACM QUAD 4, FULL VENT, NARROW PATTERN, 6.15% FREE AIR FLOW			32" BASE LOMANCO 770-D 0.87 SQ. FT. FREE AIR			

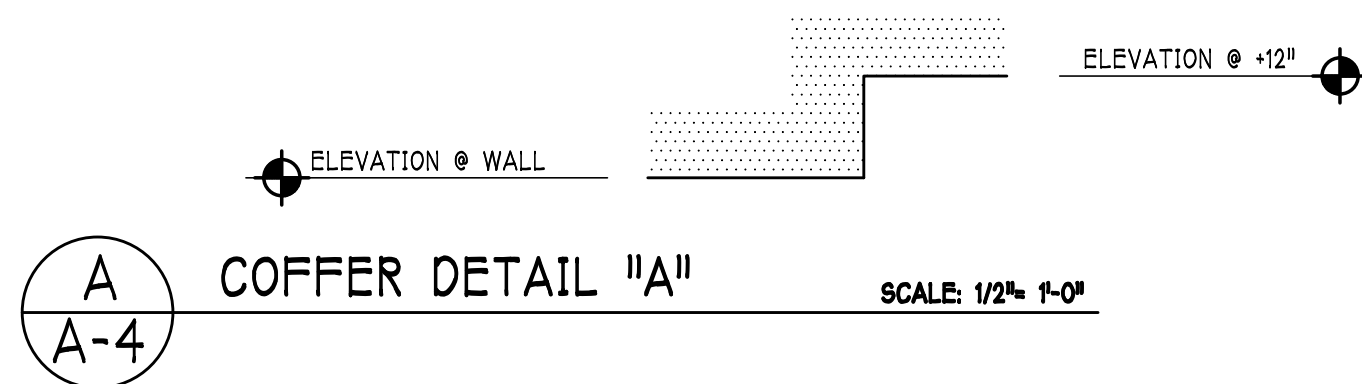

BEARING HEIGHTS	
	= BEARING @ 9'-4" A.F.F.
	= BEARING @ 13'-11"

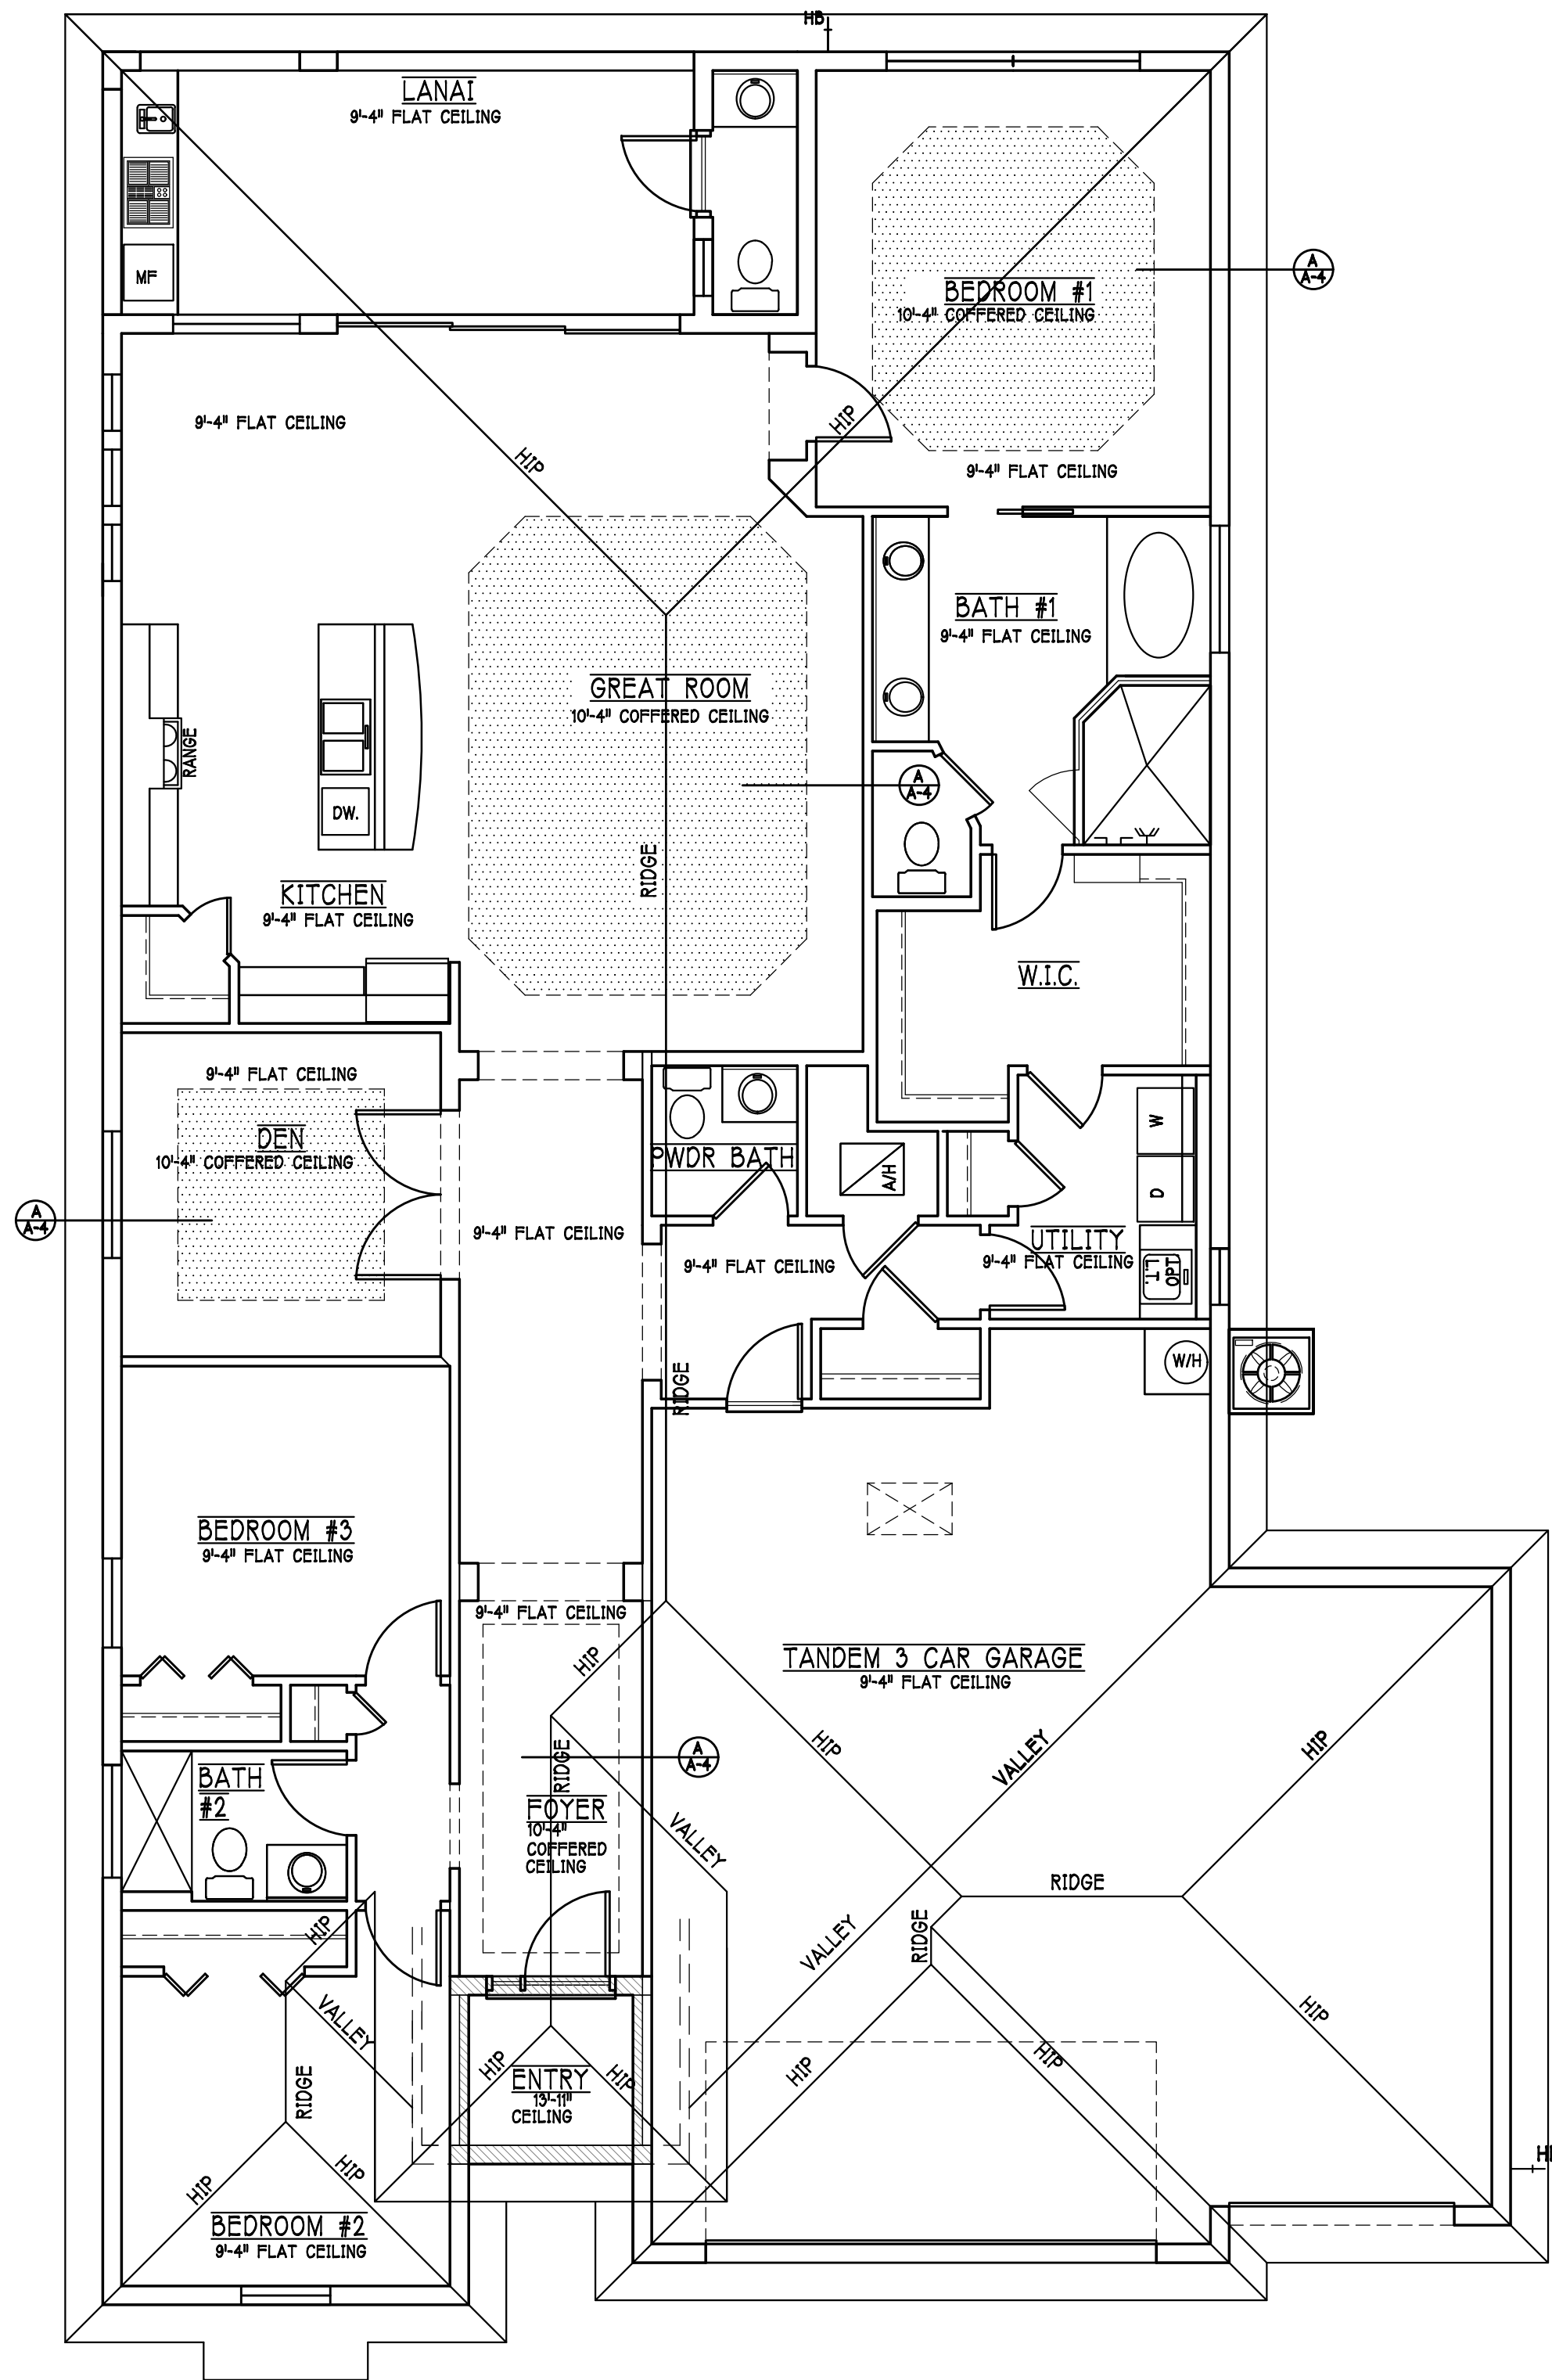

CEILING PLAN: "M"

SCALE: 3/16" = 1'-0"

Gulf Coast Drafting & Design
Phone (239) 540-1822
Fax (239) 540-7759

MODEL:
UNIT 2221

RESIDENCE FOR:
SPEC

LOT: 2

BLOCK: SUBDIV: ROYAL PALM GOLF

ADDRESS: 18648 ROYAL HAMMOCK BLVD

G.C.D.#: 13136 D.R.H.#: 579930004

DATE: 07-28-21

DRAWN BY: JSL

CHECKED BY: JWC

REVISED:

PLAN: ROOF & CEILING


SCALE: 3/16"=1'-0"

SHEET#

A-4M

ELECTRICAL PLAN 2221

200 Amp Service			
TAG	QUANTITY	PRODUCT	
A	(25)	Flush Mounted Lt	
B	(4)	Vapors	
C	(1)	Pendant/Nook	
D	(X)	10" Mushrooms	
E	(3)	24" 3 LT	
F	(2)	36" 4 LT	
G	(X)	NOT USED	
H	(3)	Coach Lights	
J	(X)	Coach Lights	
K	(X)	J BOX	
L	(4)	4' Fluorescent	
M	(3)	2' Fluorescent	
N	(X)	5lt Chandelier	
O	(1)	3 LT	
P	(3)	Pendant Light	

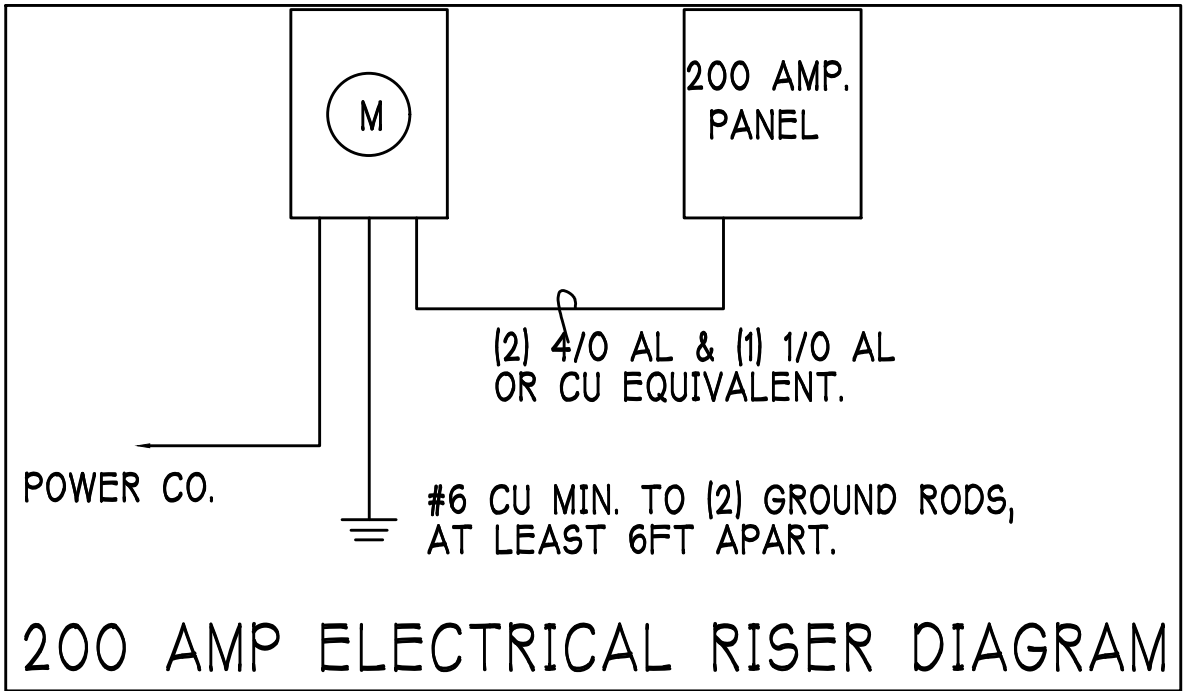

ELECTRICAL LEGEND

	ELECTRICAL METER
	ELECTRICAL PANEL
	120 V JUNCTION BOX
	SINGLE RECEPTACLE OUTLET
	220 V RECEPTACLE OUTLET
	4-PLEX RECEPTACLE OUTLET
	DUPLEX RECEPTACLE OUTLET
	1/2 SWITCHED DUPLEX OUTLET
	DUPLEX RECEPTACLE @ ELEV. A.F.F.
	TIMER SWITCH
	GFI SWITCH
	DIMMER SWITCH
	3 WAY SWITCH
	SINGLE POLE SWITCH
	AC/DC SMOKE DETECTOR TO BE INTERCONNECTED ANY RESIDENT HAVING A POSSIBLE-BURNING HEATER OR APPLIANCE, A FIREPLACE, OR AN ATTACHED GARAGE SHALL HAVE AN OPERATIONAL CARBON MONOXIDE ALARM INSTALLED WITHIN 10 FEET OF EACH ROOM USED FOR SLEEPING PURPOSES. PER RULE 6B-3.0472
	SD SMOKE DETECTOR
	SCD CARBON MONOXIDE/SMOKE DETECTOR
	TELEPHONE OUTLET
	TELEVISION RECEPTION OUTLET
	SURFACE MOUNTED CEILING LIGHT
	FLUSH MOUNTED LIGHT
	WALL MTD. BRACKET LIGHT
	DUPLEX FLOOD LIGHT
	EXHAUST FAN
	TRACK MTD. LIGHTS
	A/C DISCONNECT
	PUSH BUTTON
	DOOR BELL
	KEYPAD
	4' FLUORESCENT LIGHT
	2' UNDER COUNTER LIGHT

Electrical Notes:


Install Arc-Fault circuit-Interruption & Tamper-Resistant Receptacles shall be installed in dwelling unit. per NEC 210.12 & 406.11

All electric, electrical equipment and appliances to be set at or above base flood elevations plus 1'-0" freeboard.

All outlets in wet areas and all exterior outlets to be GFI's


Install Phone & T.V per contract .

INSTALL ALL ELECTRICAL PER NEC 2017

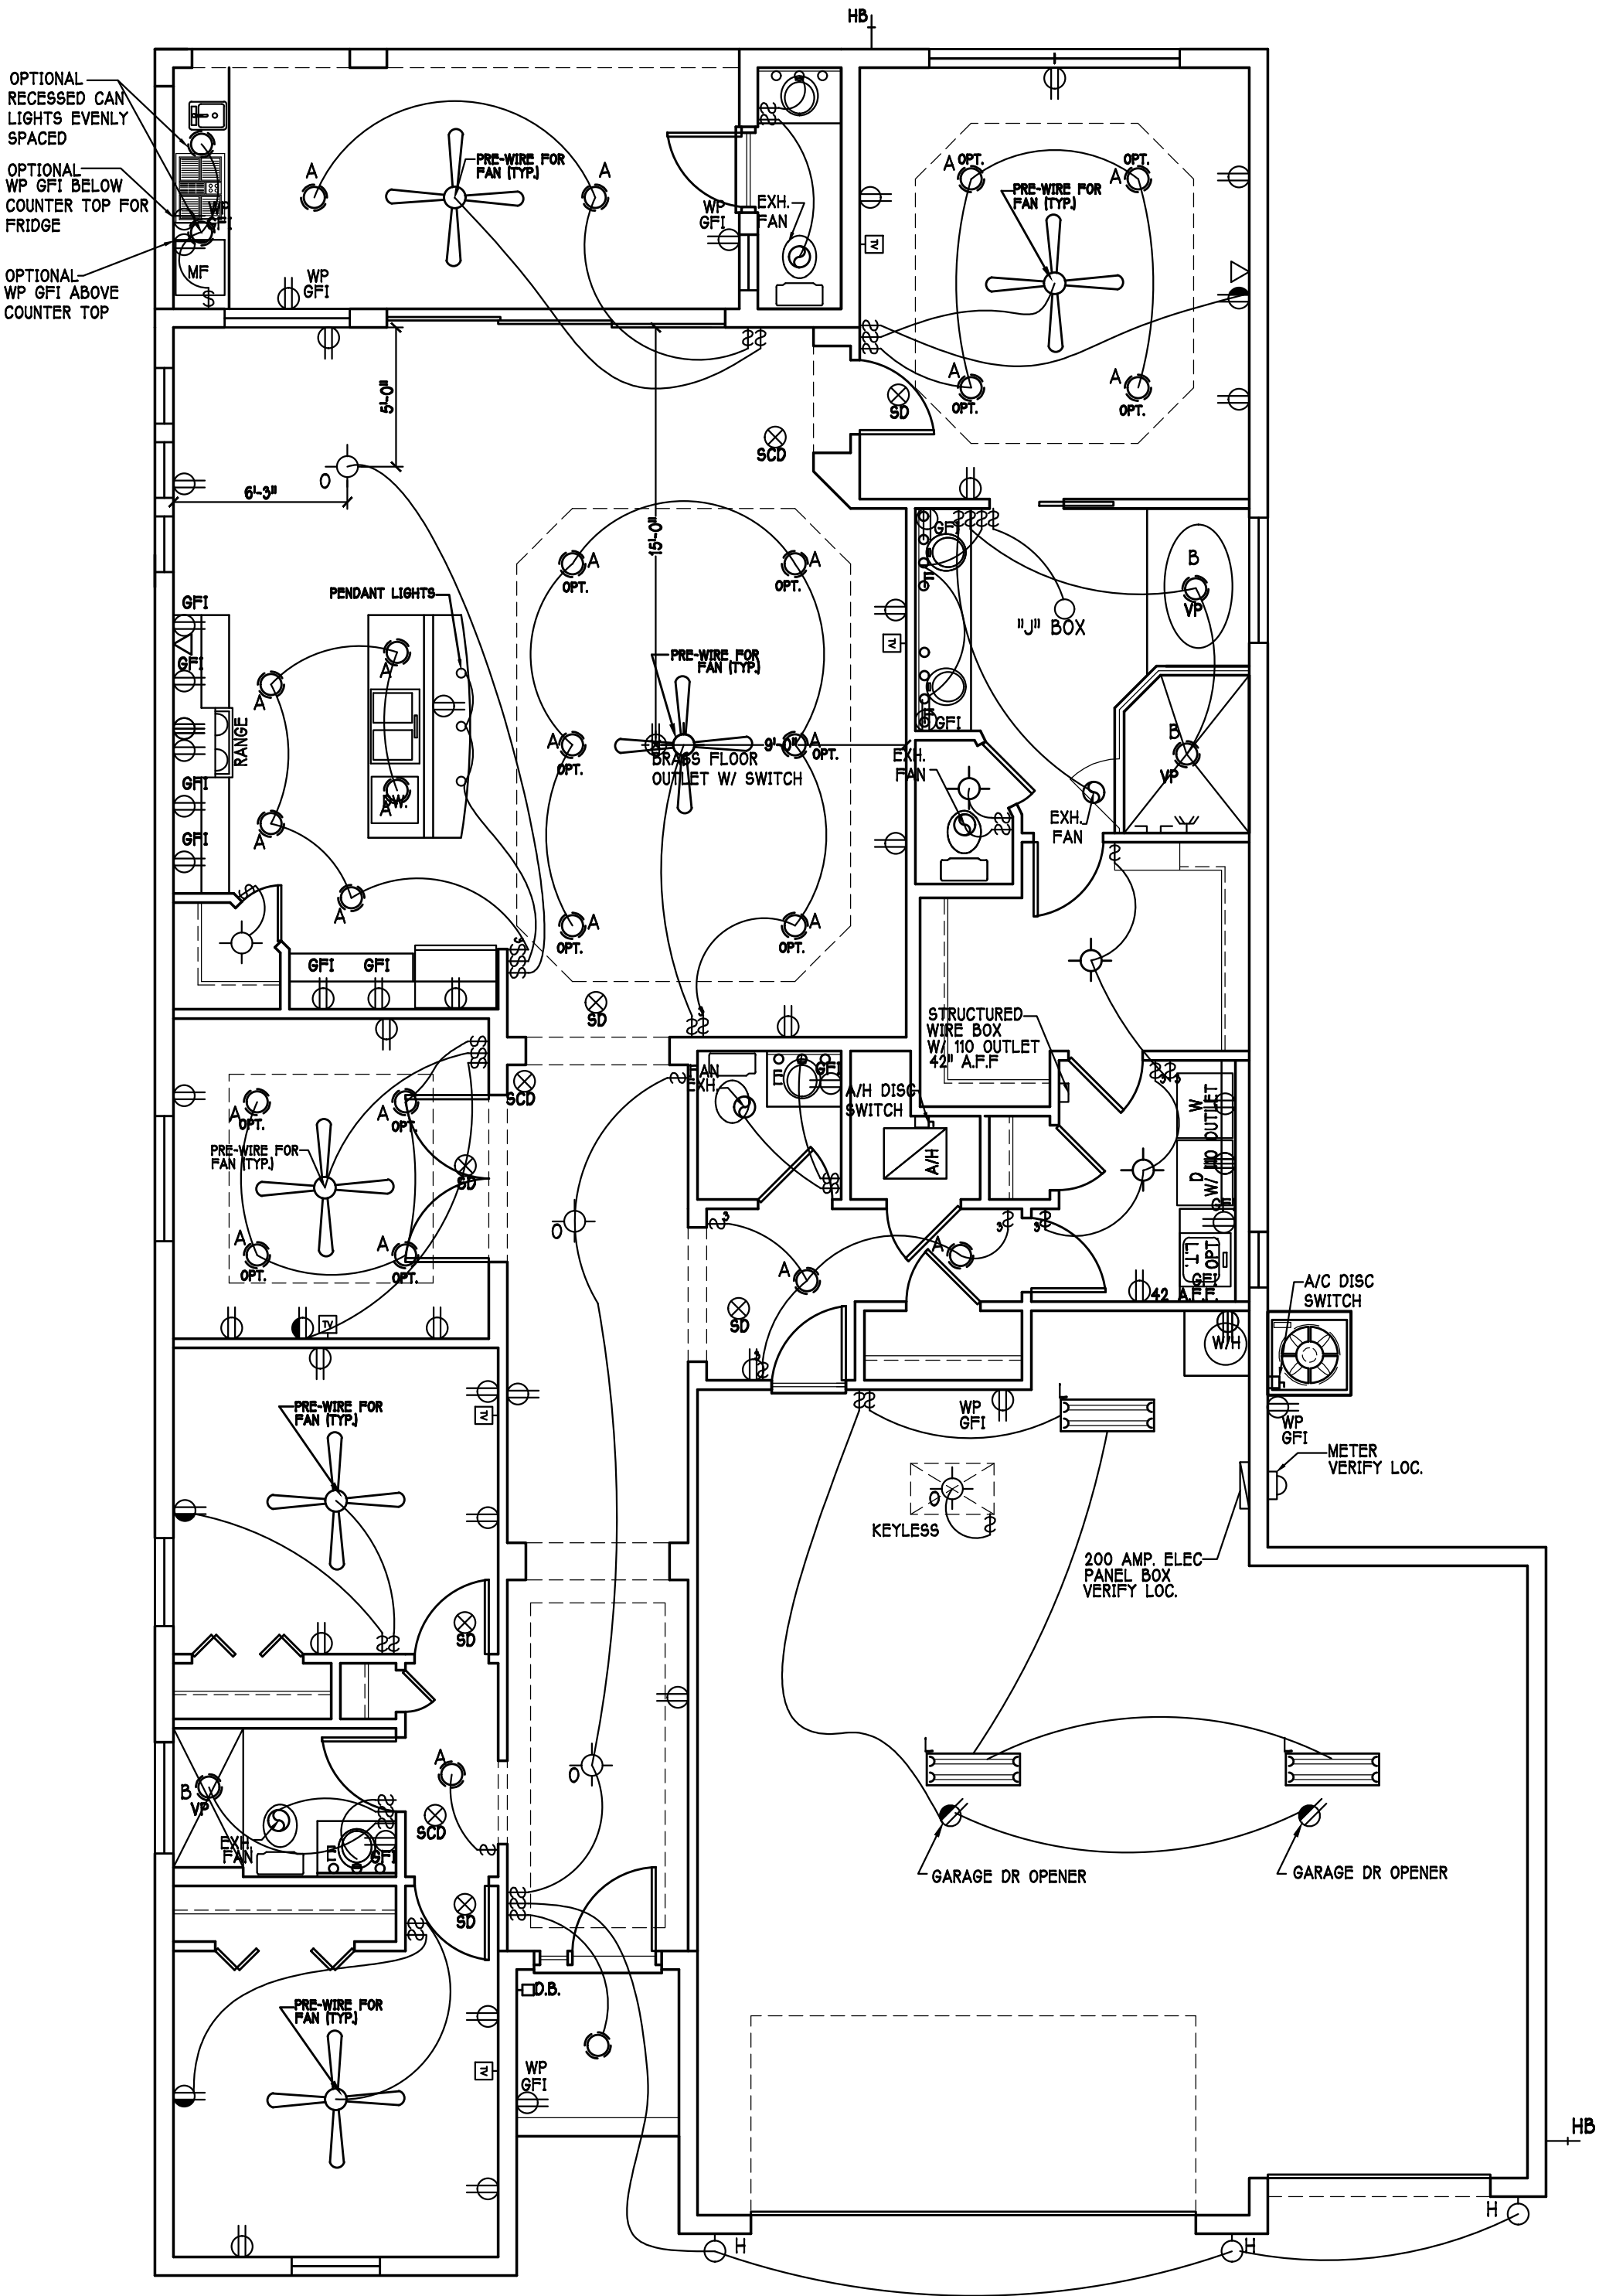


FLOOR ELECTRICAL PLAN:

SCALE: 3/16" = 1'-0"

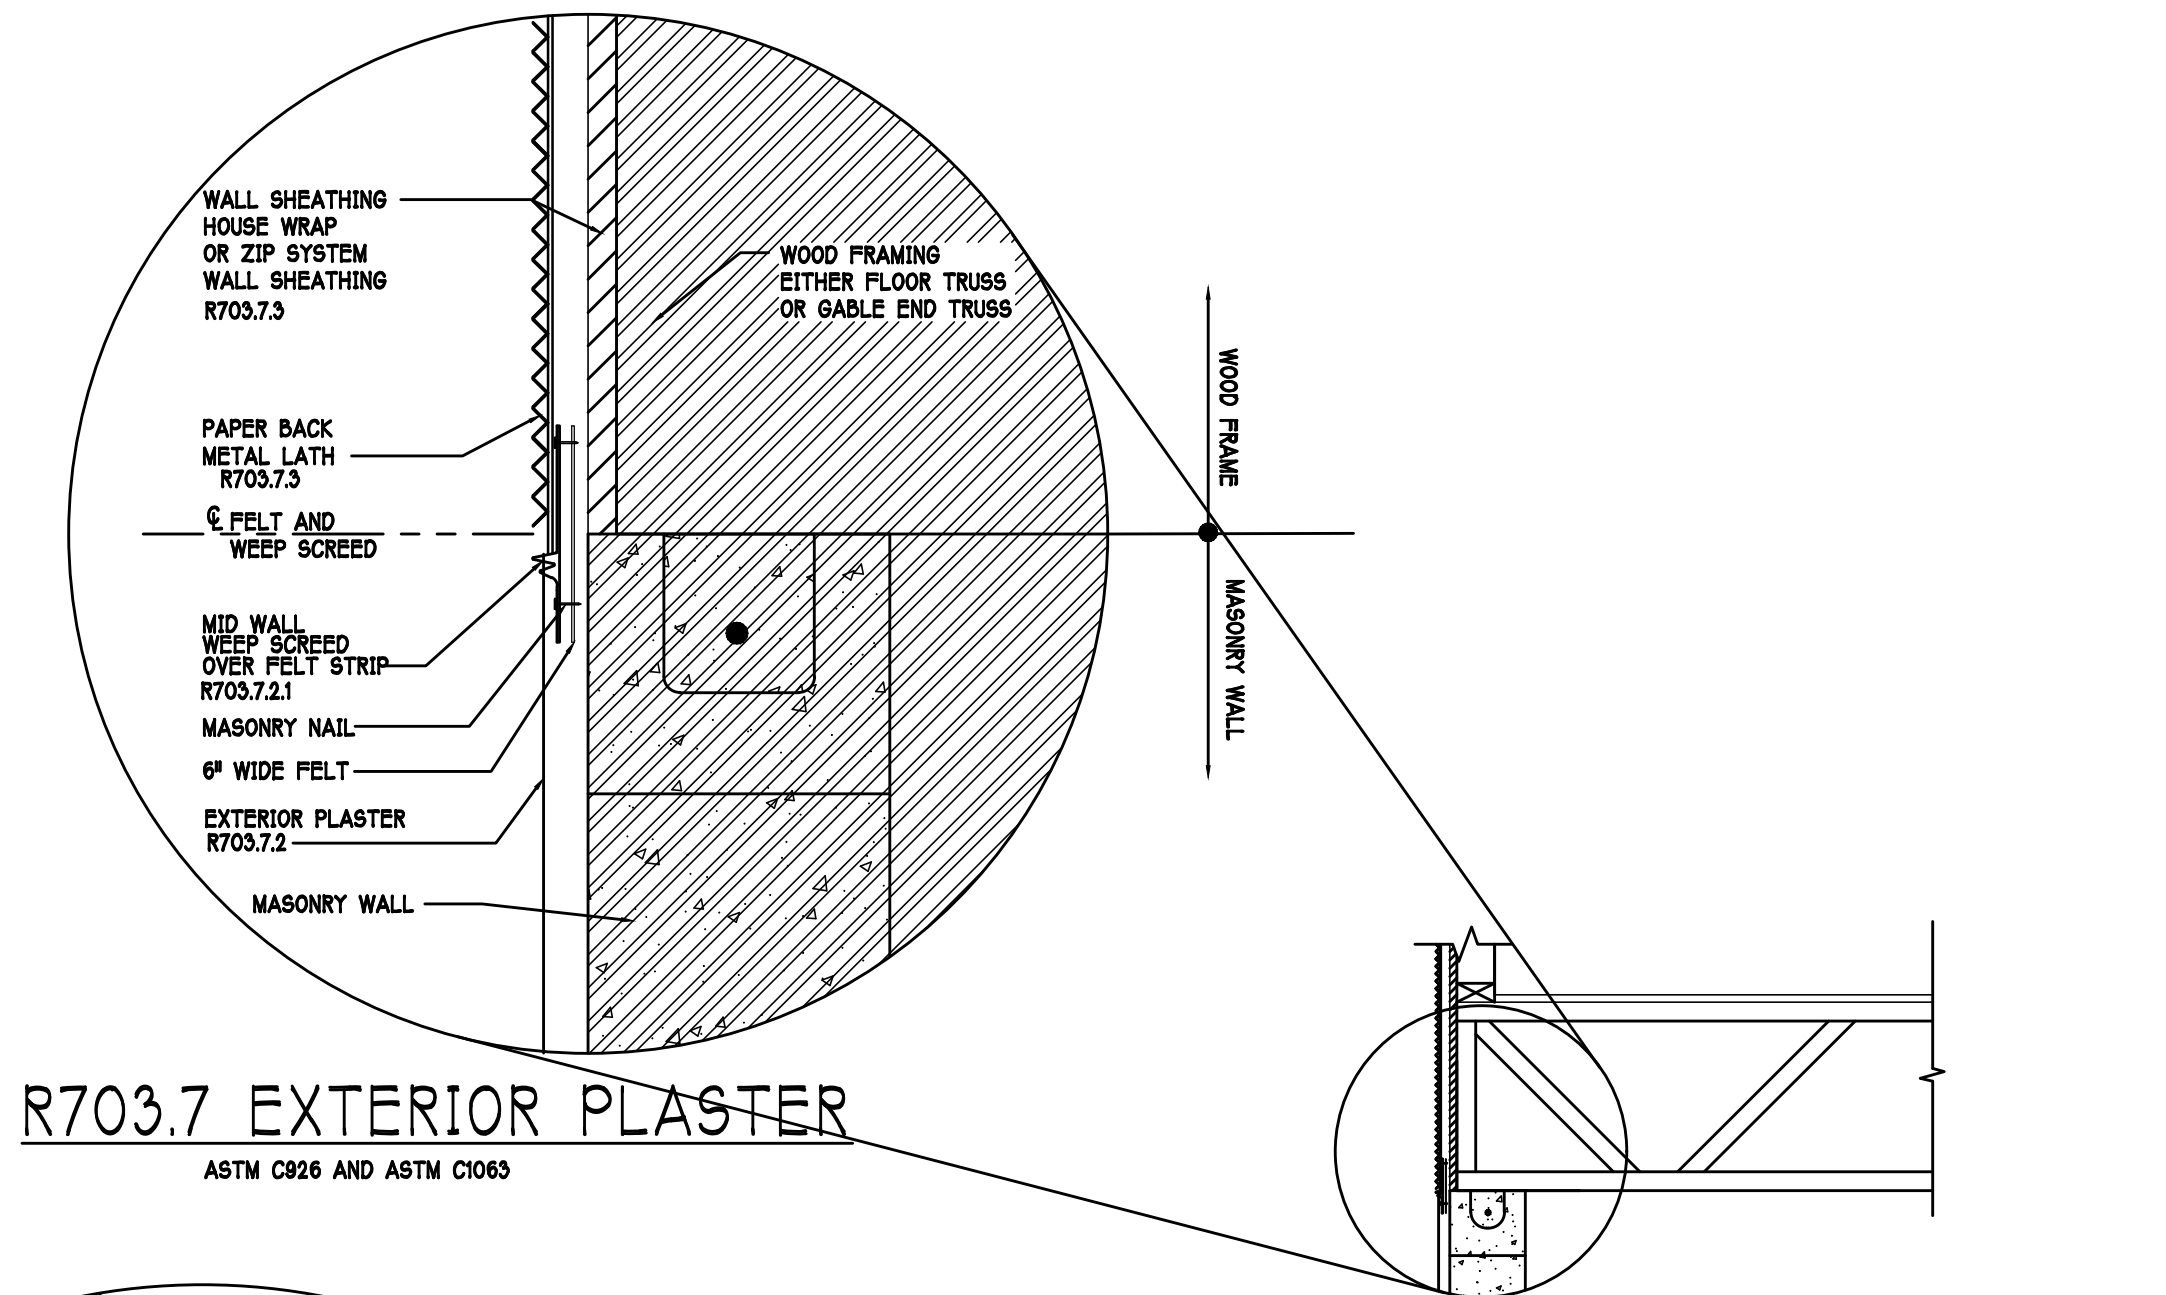


R703.7 EXTERIOR PLASTER

ASTM C926 AND ASTM C1063

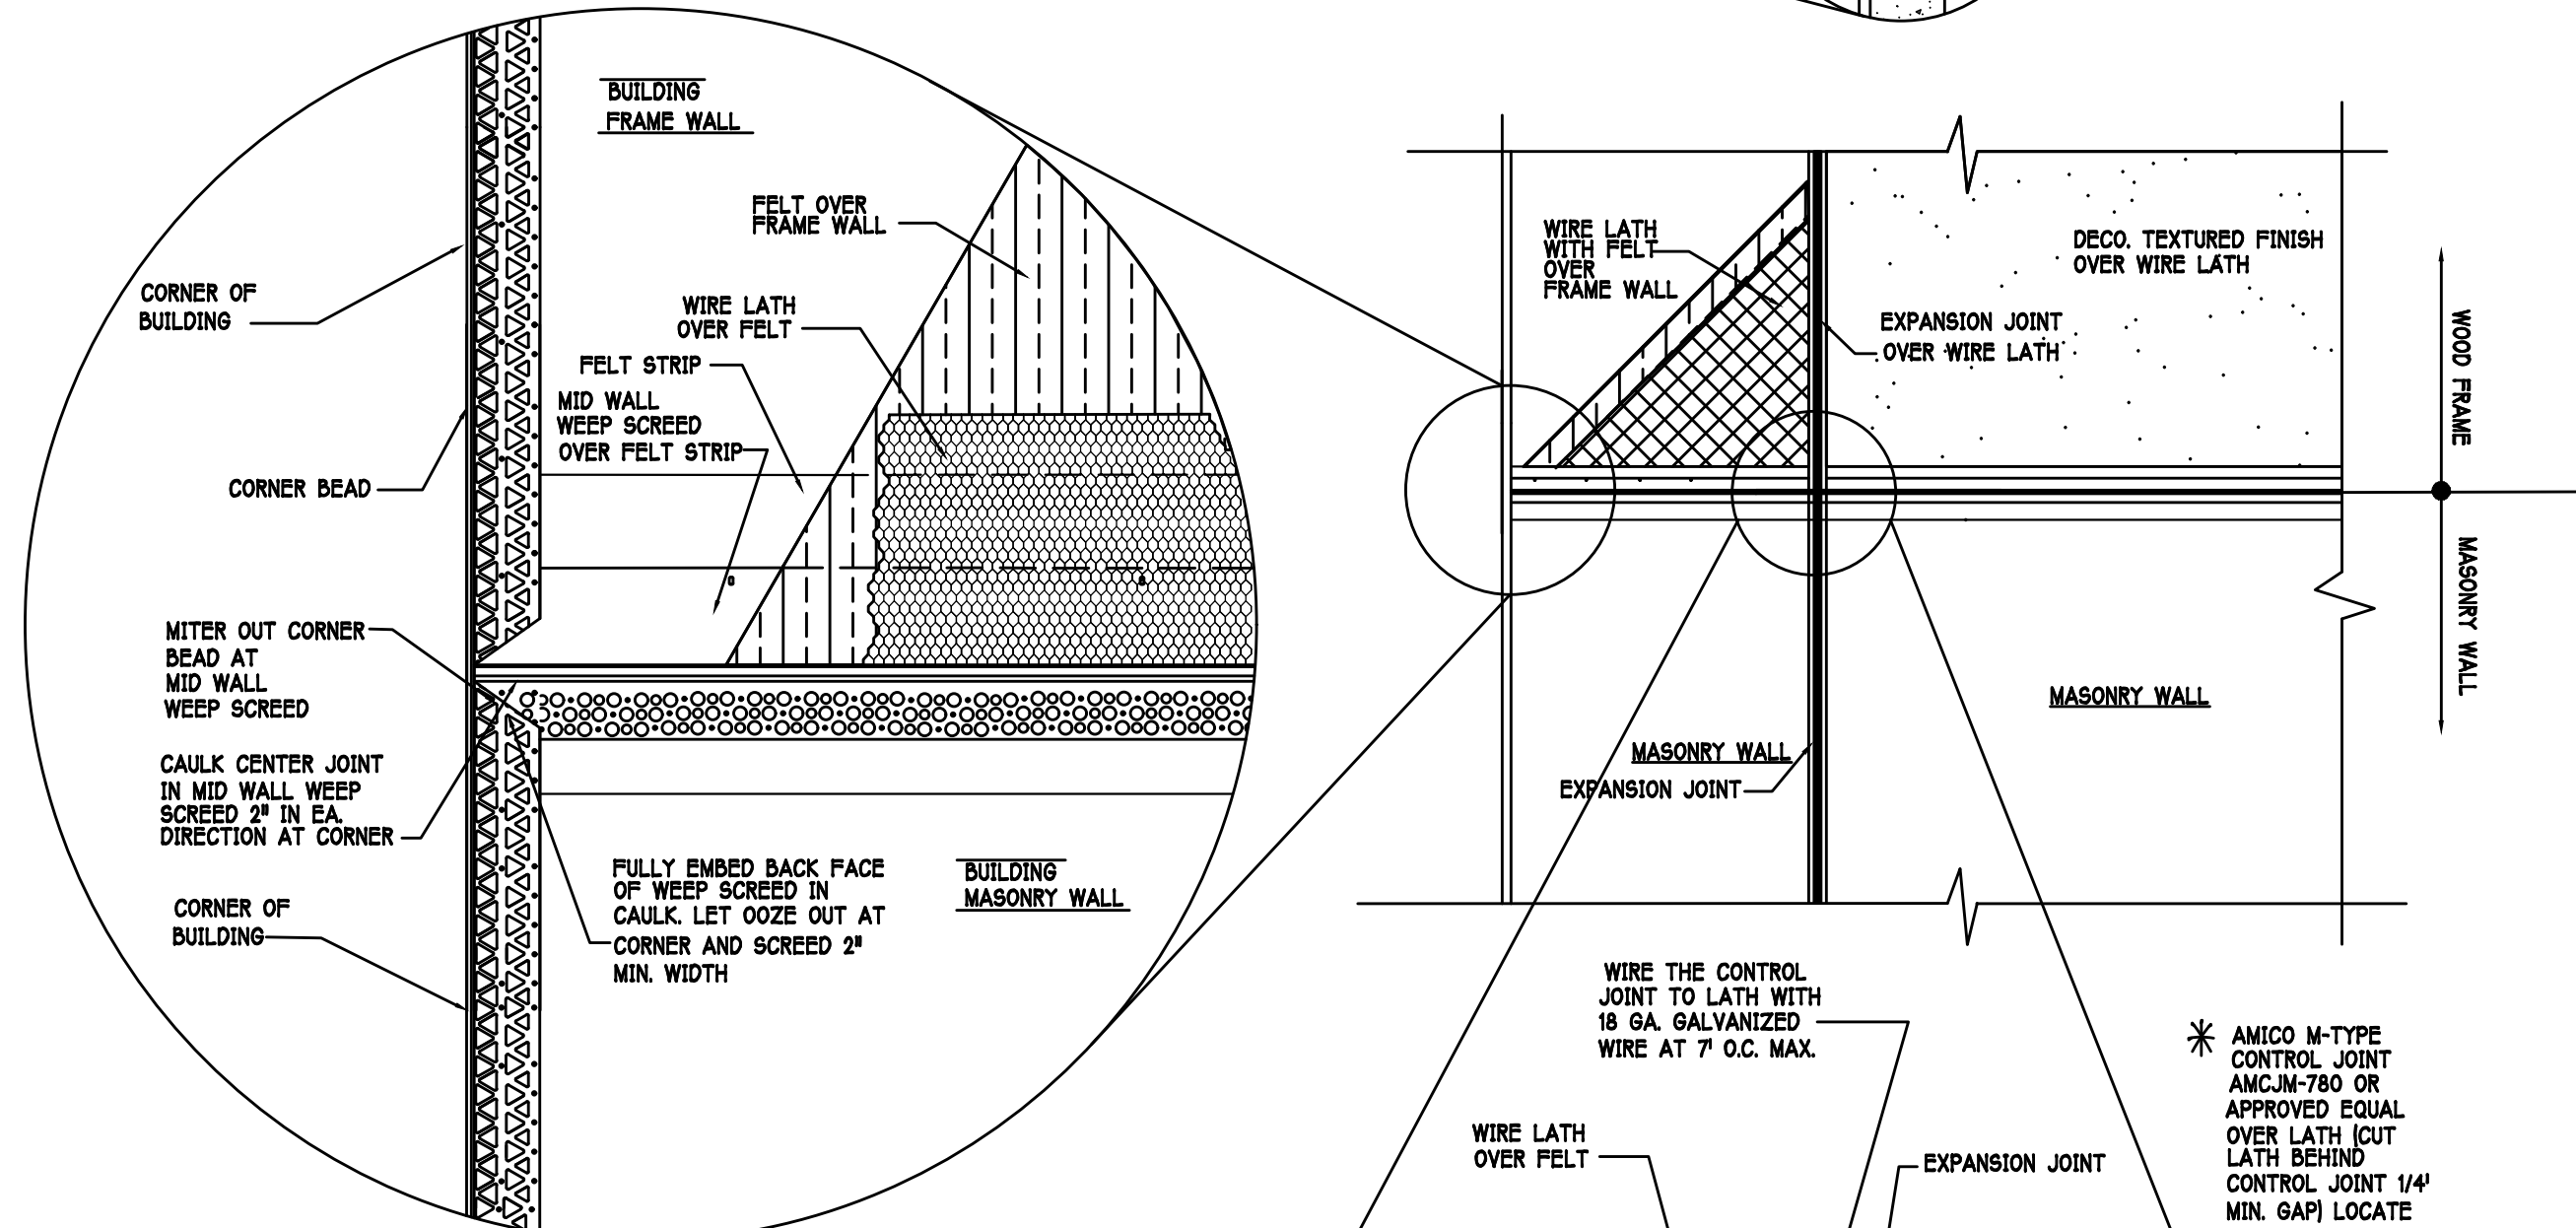

MID WALL WEEP SCREED DETAIL

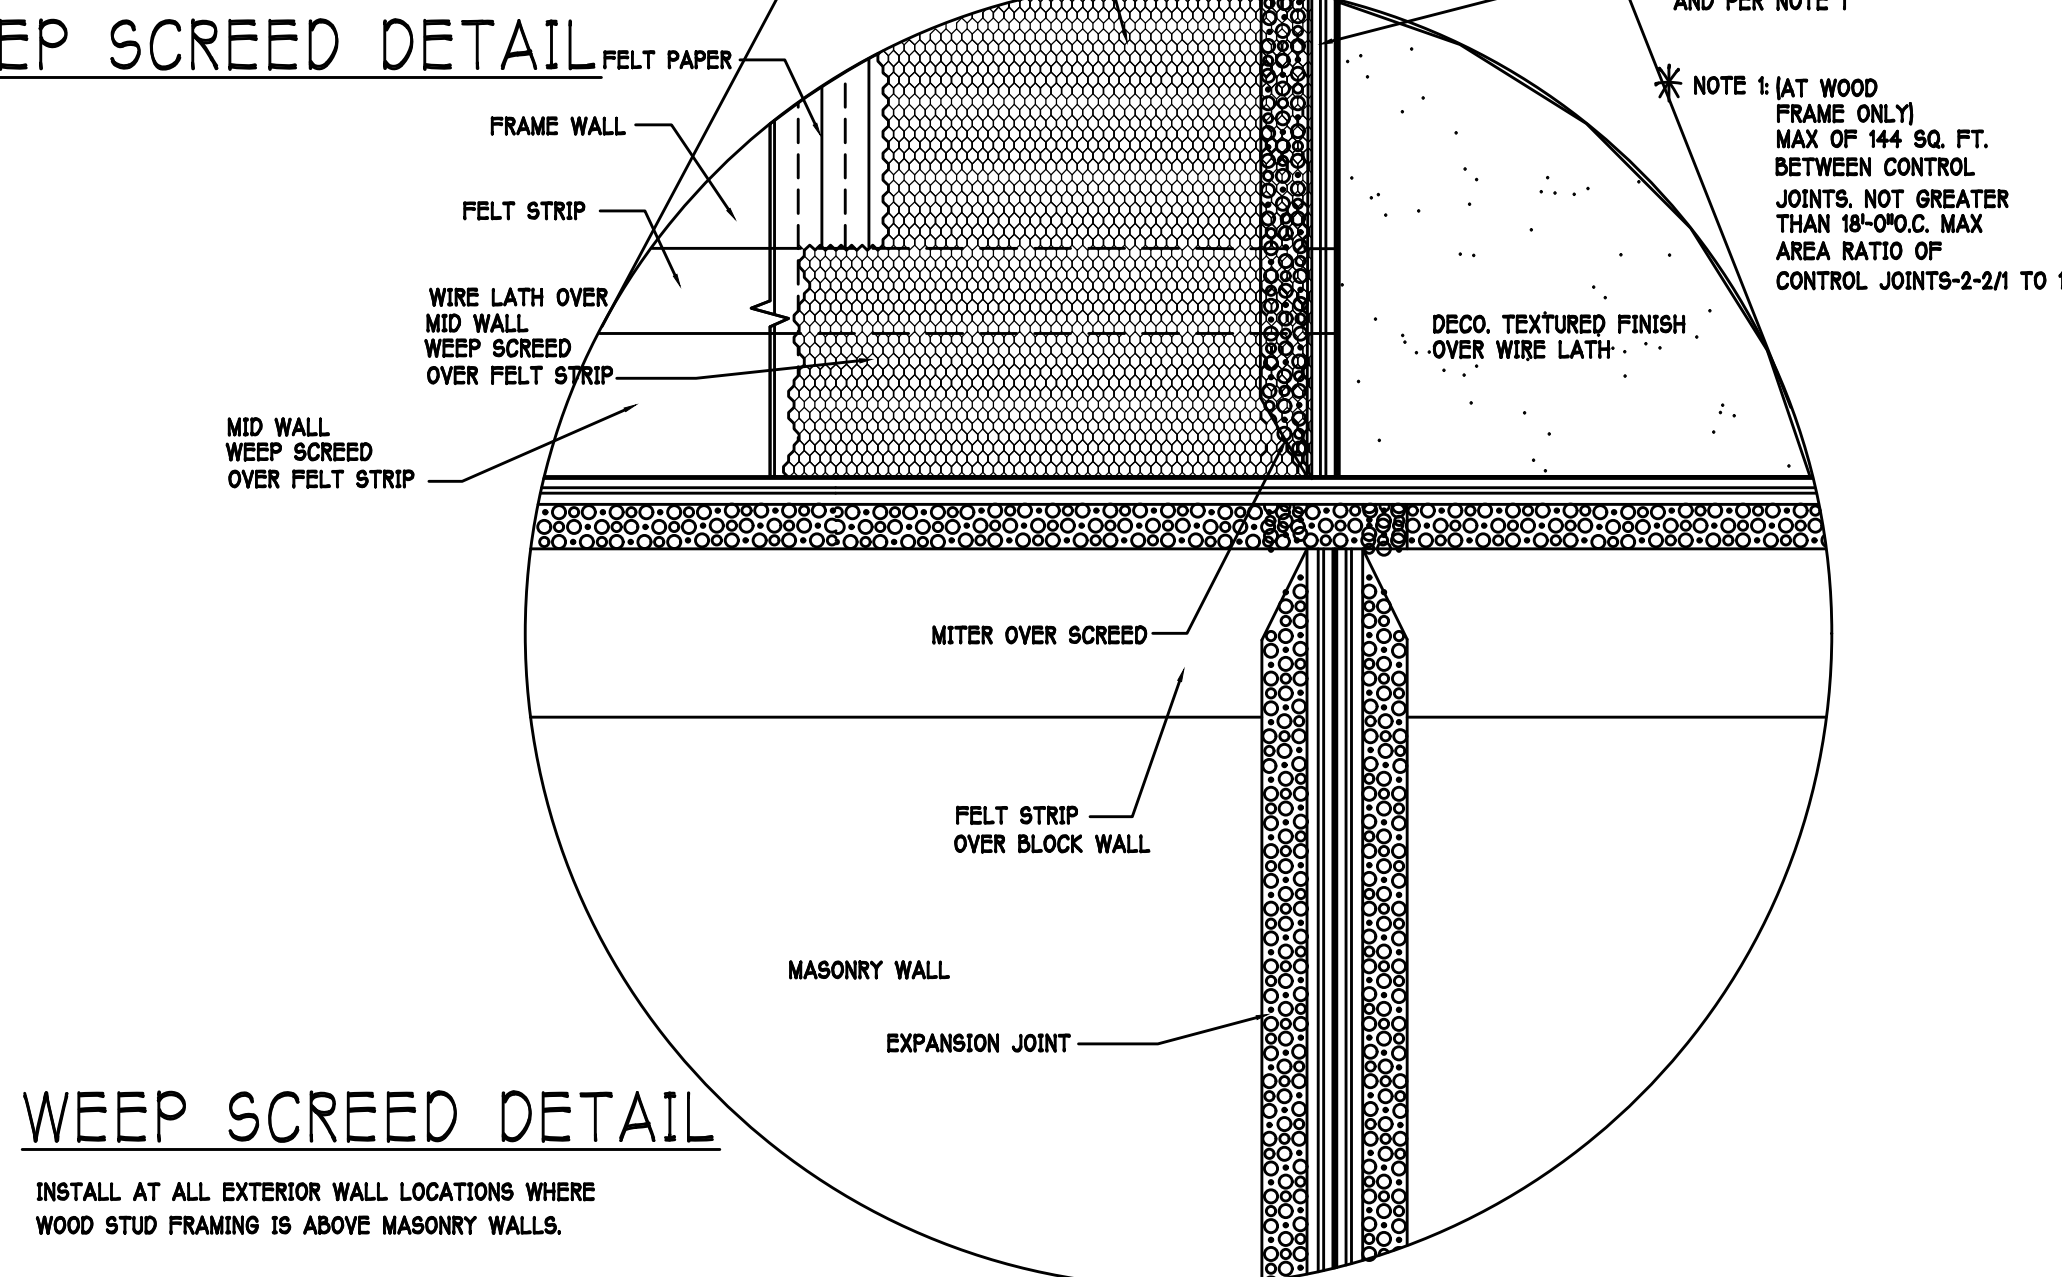

WEEP SCREED DETAIL

INSTALL AT ALL EXTERIOR WALL LOCATIONS WHERE WOOD STUD FRAMING IS ABOVE MASONRY WALLS.

RESIDENTIAL SPECIFICATIONS

GENERAL NOTES

1. THE CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE PRIOR TO COMMENCING WORK. THE CONTRACTOR SHALL REPORT ALL DISCREPANCIES BETWEEN THE DRAWINGS AND EXISTING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
2. THE CONTRACTOR SHALL SUPPLY, LOCATE AND BUILD INTO THE WORK ALL INSERTS, ANCHORS, ANGLES, PLATES, OPENINGS, SLEEVES, HANGERS, SLAB DEPRESSIONS AND PITCHES AS MAY BE REQUIRED TO ATTACH AND ACCOMMODATE OTHER WORK.
3. ALL DETAILS AND SECTIONS SHOWN ON THE DRAWINGS ARE INTENDED TO BE TYPICAL AND SHALL BE CONSTRUCTED TO APPLY TO ANY SIMILAR SITUATION ELSEWHERE IN THE WORK EXCEPT WHERE A DIFFERENT DETAIL IS SHOWN.
4. SUBSURFACE SOIL CONDITION INFORMATION IS NOT AVAILABLE. FOUNDATIONS ARE DESIGNED FOR A SOIL BEARING CAPACITY OF 2000 PSF. THE CONTRACTOR SHALL REPORT ANY DIFFERING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
5. STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH JOB SPECIFICATION AND HOUSE PLANS, MECHANICAL, ELECTRICAL, PLUMBING, AND SITE DRAWINGS. CONSULT THESE DRAWINGS FOR SLEEVES, DEPRESSIONS AND OTHER DETAILS NOT SHOWN ON STRUCTURAL DRAWINGS.
6. ALL SPECIFIED FASTENERS MAY ONLY BE SUBSTITUTED IF APPROVED BY THE ENGINEER IN WRITING. THE INSTALLATION OF THE FASTENERS SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS. SIMPSON FASTENERS SPECIFIED MAY BE SUBSTITUTED WITH THE SAME QUANTITY AND EQUIVALENT STRENGTH PRODUCT.
7. TREATED WOOD REQUIREMENTS:- ALL WOOD EXPOSED TO WEATHER SHALL BE PROTECTED, PRESSURE TREATED, OR NATURALLY RESISTANT TO DECAY. ALL WOOD TOUCHING MASONRY OR CONCRETE SHALL BE ISOLATED, OR PRESSURE TREATED.
8. THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS COMPLETE. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE ERECTION PROCEDURES AND SEQUENCES TO ENSURE SAFETY OF THE BUILDING AND ITS COMPONENTS DURING ERECTION. THIS INCLUDES THE NECESSARY SHORING, SHEETING, TEMPORARY BRACING, GUYS, OR TIE DOWNS.
9. CEILING DRYWALL INSTALLED WITHIN THE HOUSE TO TRUSSES SPACED 24\"/>
10. LAMIN CEILING & COVERED ENTRY CEILING: 1/4\"/>



2. GENERAL ROOF ASSEMBLY

ROOF SHEATHING PER TABLE R803.2.2 SHALL BE 18/32 APA RATED SHEATHING, EXPOSURE 1, SPAN RATING 40/20 OR BETTER. INSTALL PANELS WITH LONG DIMENSION PLACED PERPENDICULAR TO TRUSSES. A 1/8\"/>

FLASHING SHALL BE ALUMINUM ALUMINUM ZINC COATED STEEL .078 INCHES THICK, 26 GAGE AZ50 ALUM ZINC OR GALVANIZED STEEL .078 INCHES THICK, 26 GAGE ZINC COATED GALV. FLASHING SHALL BE INSTALLED IN ACCORDANCE WITH THE ZIP SYSTEM ROOF SHEATHING MANUFACTURER'S PUBLISHED REQUIREMENTS. ALL FLASHING AND INSTALLATION SHALL CONFORM TO SECTION R805.2.6 (1 TO 5).


FASTENERS FOR asphalt shingles shall comply with ASTM F 1667, and shall be made of galvanized steel, stainless steel or aluminum with a minimum shank size of 12 gauge (0.108 inches) with a minimum 3/8 inch diameter head and shall be of 3 length to penetrate the sheathing.

CLAY AND CONCRETE TILE ROOF SPECS
INSTALL PEEL AND STICK UNDERLAYMENT APPROVED FOR SINGLE LAYER APPLICATION UNDER TILE ROOF.
THE INSTALLATION OF CLAY AND CONCRETE TILE SHALL COMPLY WITH THE PROVISIONS OF R805.3 F.B.C. MARKINGS: EACH ROOF TILE SHALL HAVE A PERMANENT MANUFACTURER'S IDENTIFICATION MARK. APPLICATION SPECIFICATIONS: THE TILE MANUFACTURER'S WRITTEN APPLICATION SPECIFICATIONS SHALL BE AVAILABLE AND SHALL INCLUDE BUT NOT BE LIMITED TO THE FOLLOWING:
1. TILE PLACEMENT AND BRACING.
2. ATTACHMENT SYSTEM NECESSARY TO COMPLY WITH CURRENT WIND CODE.
A. AMOUNT AND PLACEMENT OF MORTAR.
B. AMOUNT AND PLACEMENT OF ADHESIVE.
C. TYPE, NUMBER, SIZE, AND LENGTH OF FASTENERS AND CLIPS.
3. UNDERLAYMENT.
4. SLOPE REQUIREMENT.

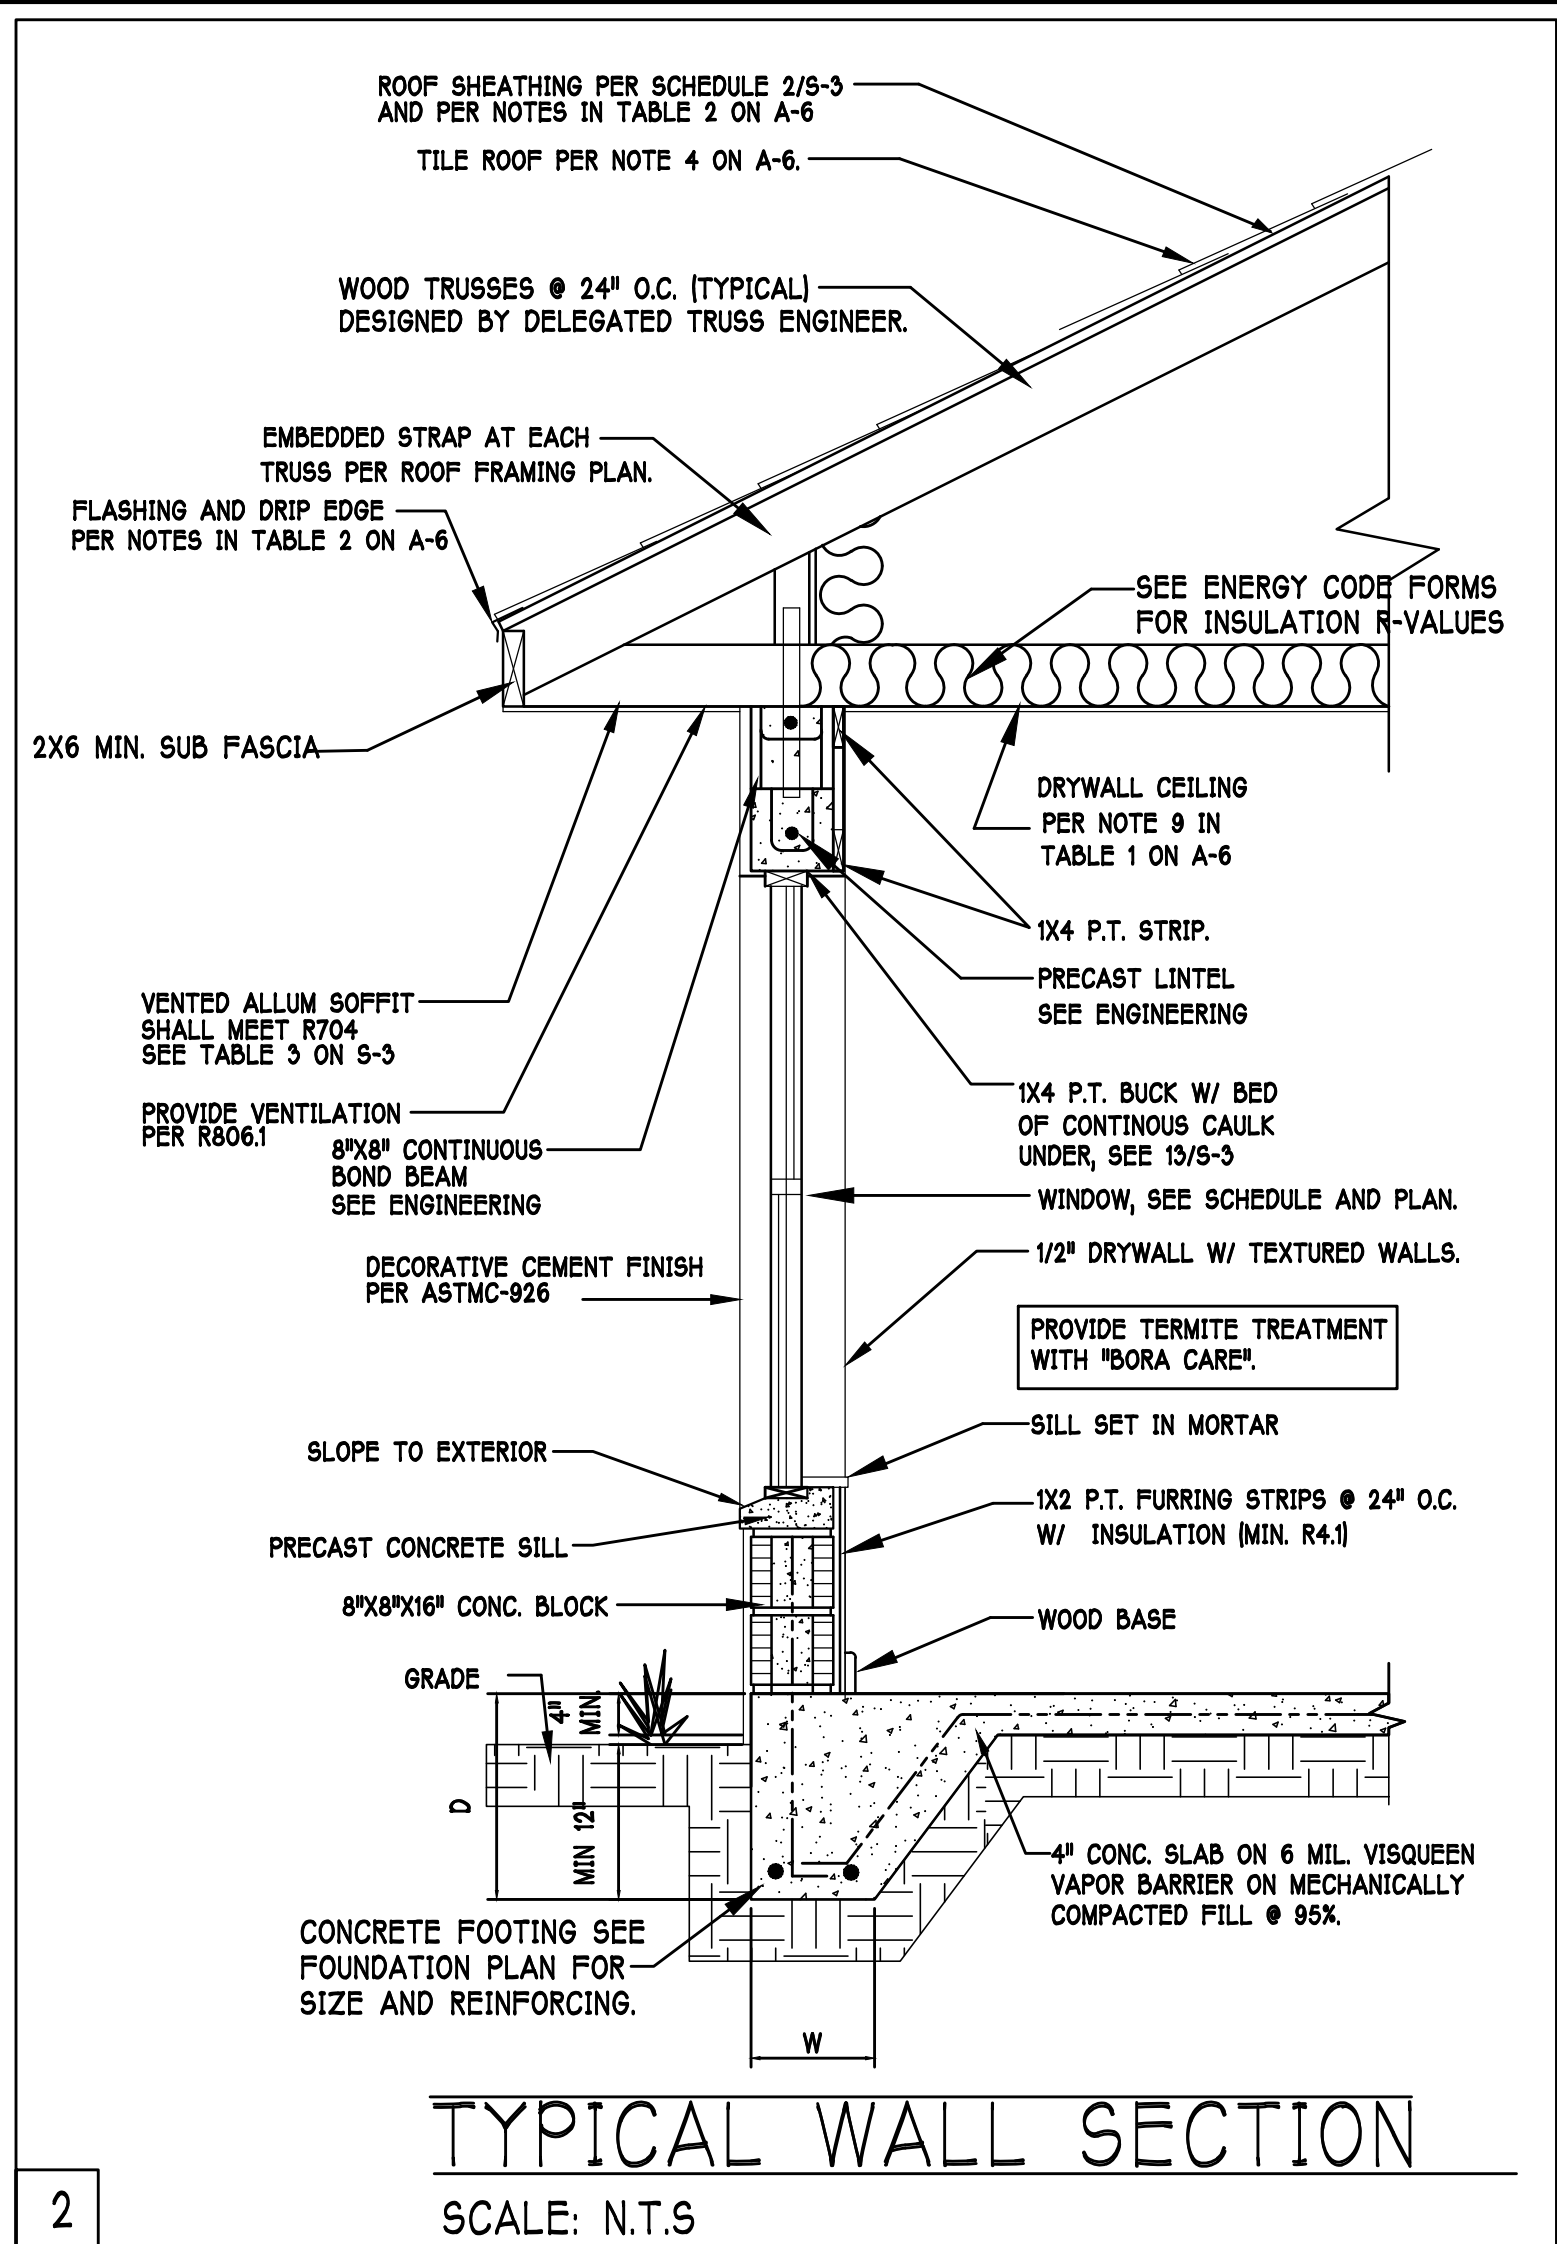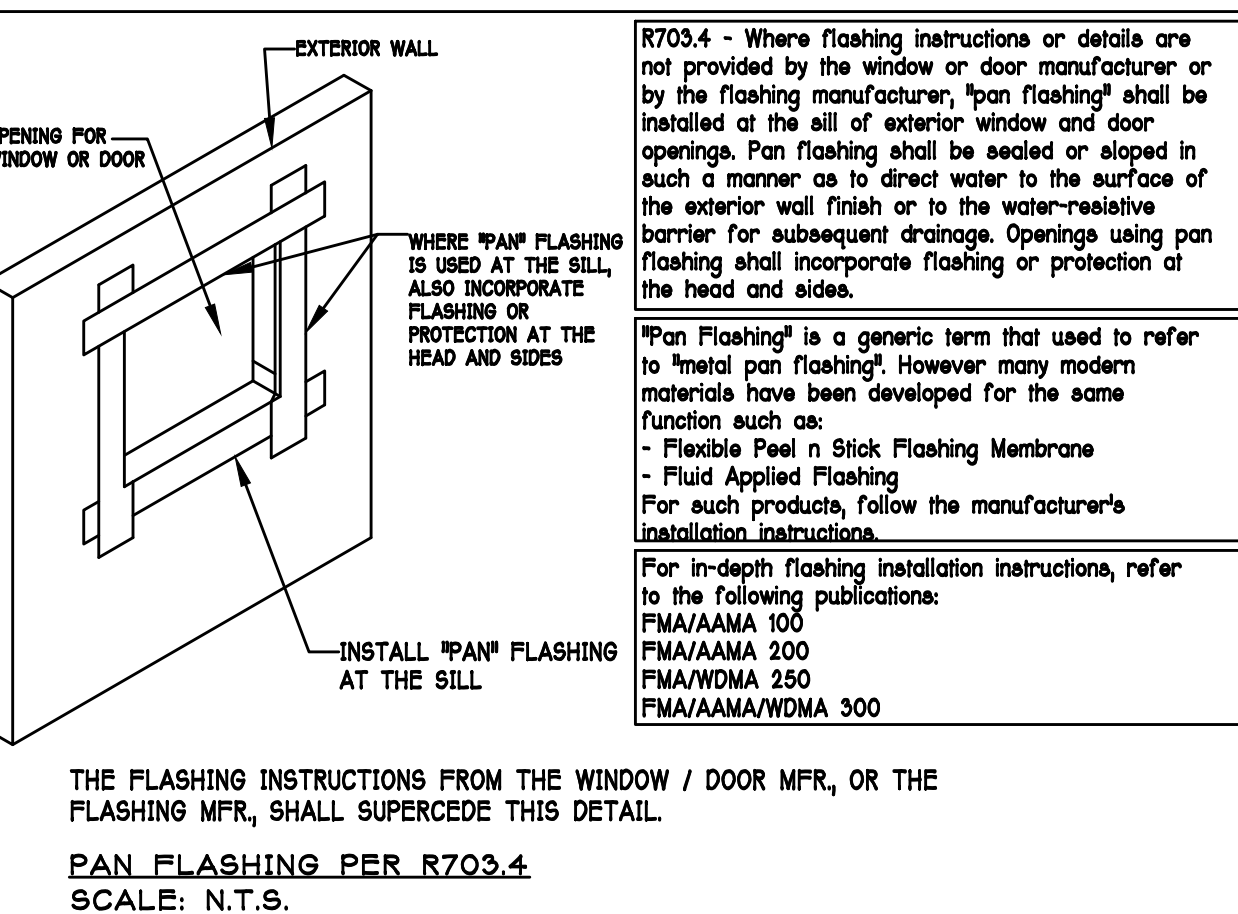

TYPICAL WALL SECTION

SCALE: N.T.S.

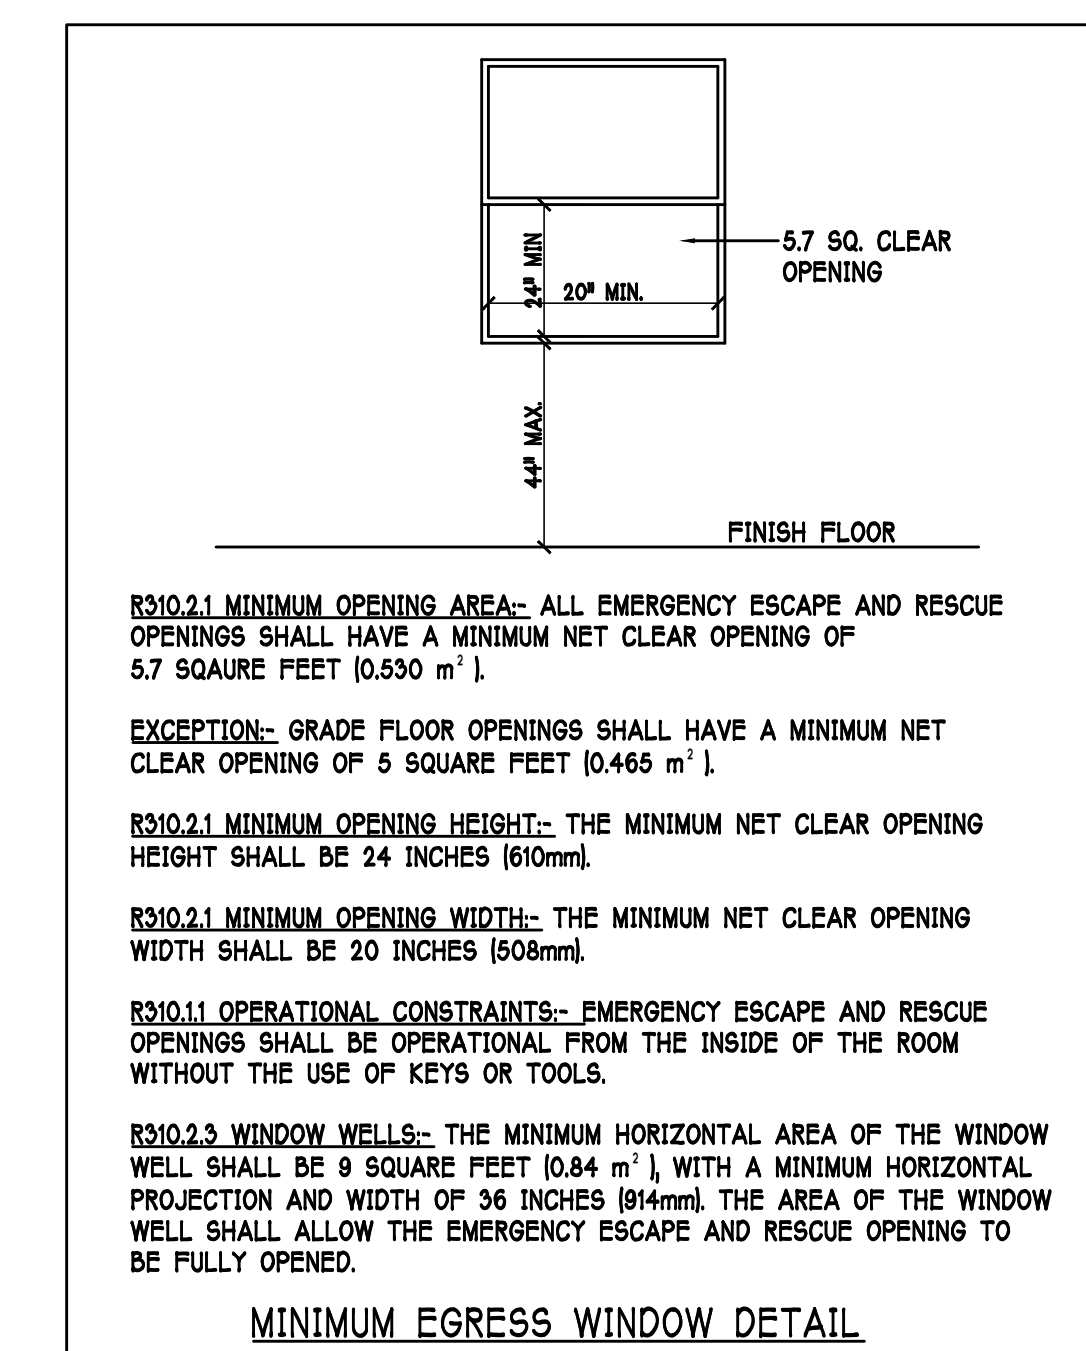

R310.2.1 MINIMUM OPENING AREA:- ALL EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5.7 SQUARE FEET (0.530 m²).

EXCEPTION:- GRADE FLOOR OPENINGS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5 SQUARE FEET (0.465 m²).

R310.2.1 MINIMUM OPENING HEIGHT:- THE MINIMUM NET CLEAR OPENING HEIGHT SHALL BE 24 INCHES (610mm).

R310.2.1 MINIMUM OPENING WIDTH:- THE MINIMUM NET CLEAR OPENING WIDTH SHALL BE 20 INCHES (508mm).

R310.1.1 OPERATIONAL CONSTRAINTS:- EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL BE OPERATIONAL FROM THE INSIDE OF THE ROOM WITHOUT THE USE OF KEYS OR TOOLS.

R310.2.3 WINDOW WELLS:- THE MINIMUM HORIZONTAL AREA OF THE WINDOW WELL SHALL BE 9 SQUARE FEET (0.84 m²), WITH A MINIMUM HORIZONTAL PROJECTION AND WIDTH OF 36 INCHES (914mm). THE AREA OF THE WINDOW WELL SHALL ALLOW THE EMERGENCY ESCAPE AND RESCUE OPENING TO BE FULLY OPENED.

MINIMUM EGRESS WINDOW DETAIL

DESIGN IN ACCORDANCE W/ THE 2020 RESIDENTIAL FLORIDA BUILDING CODE- 7TH EDITION


D.R. HOHON
America's Builder

Gulf Coast Drafting
& Design
Phone (239) 540-1822
Fax (239) 540-7759

MODEL: UNIT 2221
SUBDIV: ROYAL PALM GOLF
ADDRESS: 18648 ROYAL HAMMOCK BLVD
G.C.D.#: 13136 DR.H.#: 579930004
RESIDENCE FOR: SPEC


DATE: 07-28-21
DRAWN BY: JSL
CHECKED BY: JWC
REVISED:
PLAN: SECTION
SCALE: 3/16"=1'-0"
SHEET#

A-6M

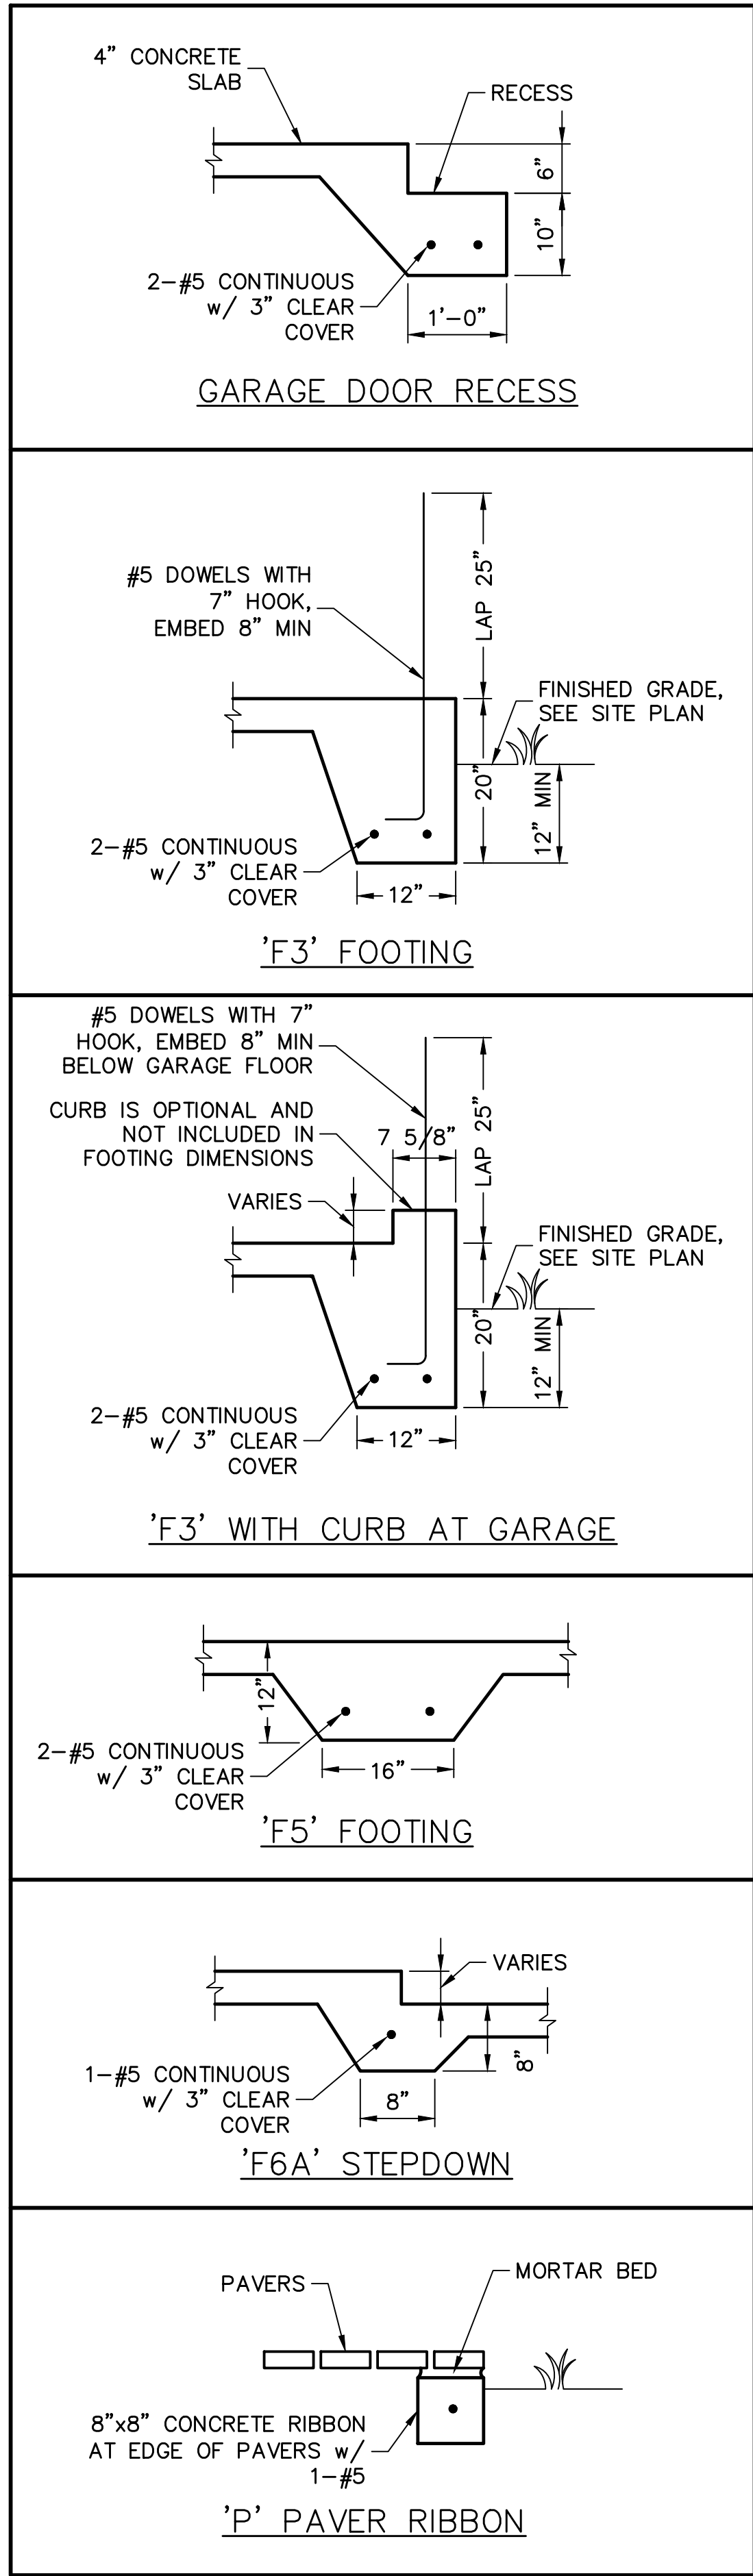

FOOTING DETAILS

SCALE: 3/4" = 1'-0"

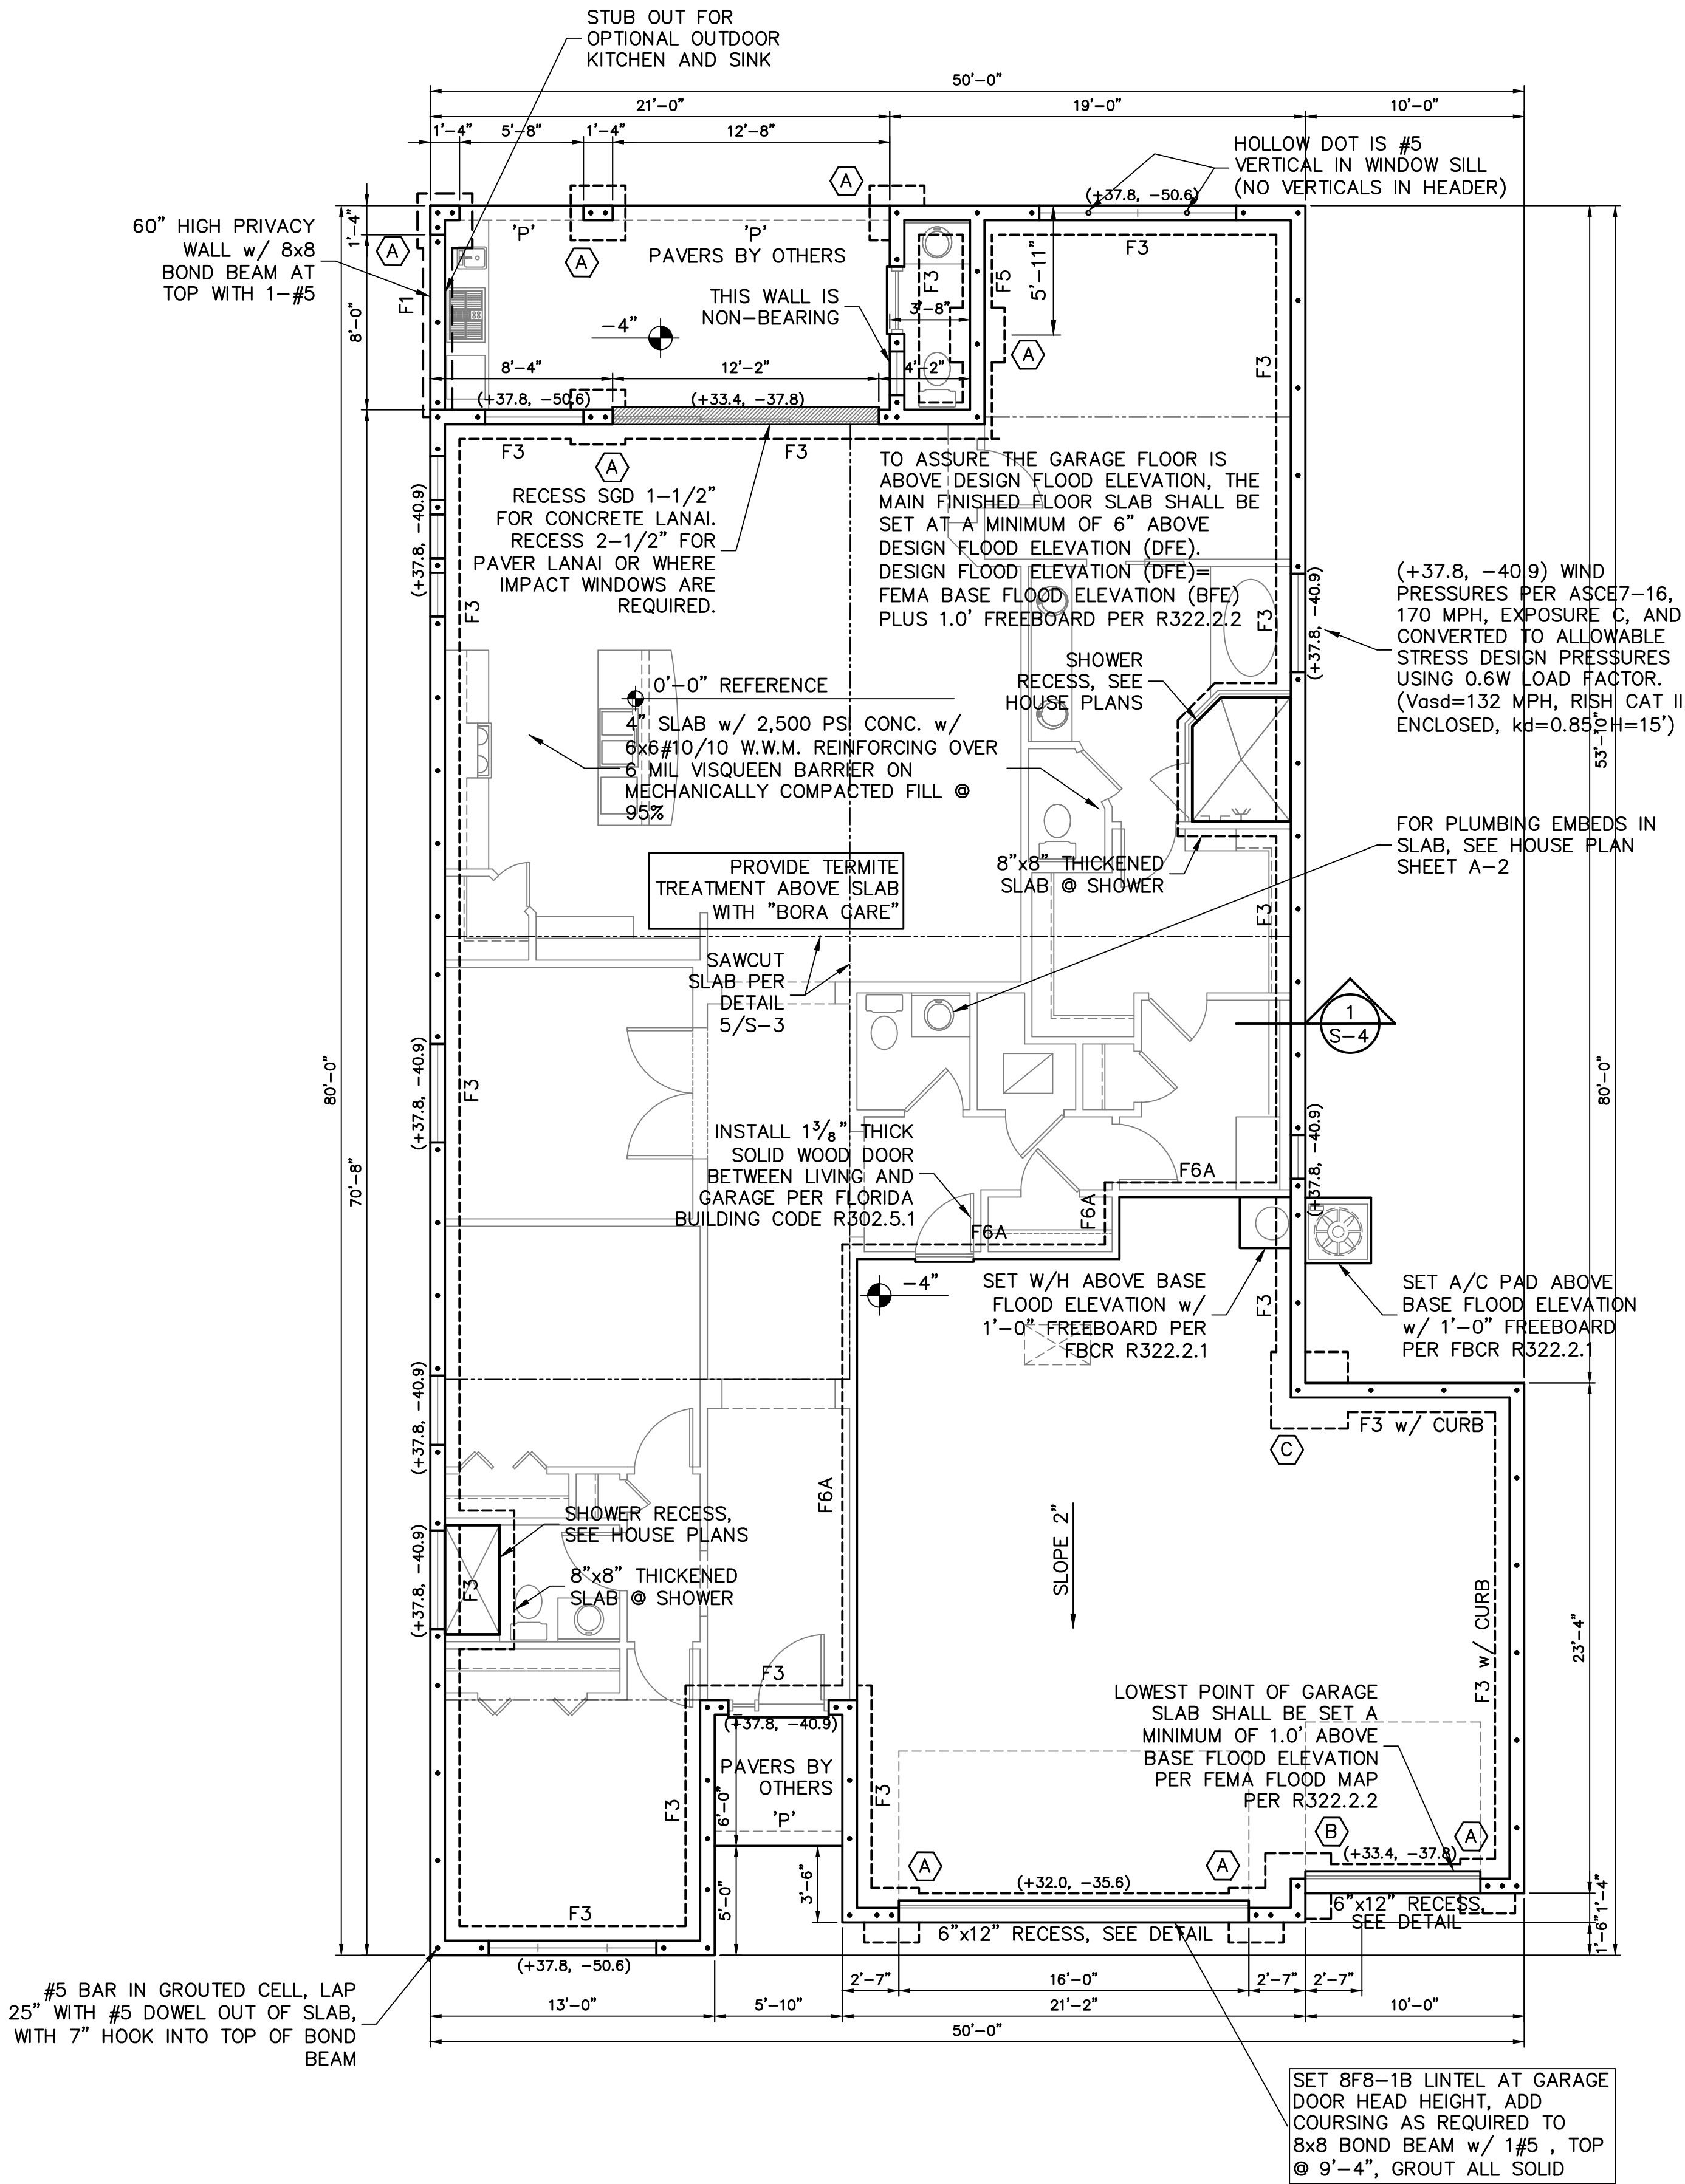

PAD FOOTING SCHEDULE							
USED	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINF.		REMARKS
					LONG WAY	SHORT WAY	
✗	A	2'-6"	2'-6"	1'-0"	3-#5	3-#5	-
✗	B	3'-0"	3'-0"	1'-0"	4-#5	4-#5	-
✗	C	3'-6"	3'-6"	1'-0"	4-#5	4-#5	-
✗	D	4'-0"	4'-0"	1'-2"	5-#5	5-#5	-
✗	E	5'-0"	5'-0"	1'-2"	6-#5	6-#5	-

WALL FOOTING SCHEDULE						
USED	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINFORCING	SHAPE
✗	F1	CONT.	1'-4"	0'-8"	2-#5	
✗	F2	CONT.	1'-8"	0'-10"	2-#5	
✗	F3	CONT.	1'-0"	1'-8"	2-#5	
✗	F4	CONT.	1'-4"	1'-8"	2-#5	
✗	F5	CONT.	1'-4"	1'-0"	2-#5	
✗	F6	CONT.	1'-4"	1'-0"	2-#5	
✗	F6A	CONT.	0'-8"	0'-8"	1-#5	

NOTE: REINFORCING IN FOOTINGS SHALL BE CONTINUOUS AT CORNERS AND INTERSECTIONS. ADD CORNER BAR 25"x25" AT EACH LONGITUDINAL BAR PER DETAIL 6/S-3.

FOUNDATION PLAN

SCALE: 3/16" = 1'-0"

PLAN NOTES:

- 1) TOP OF GROUND FLOOR SLAB DATUM ELEVATION 0'-0".
- 2) 'F#' DENOTES CONTINUOUS WALL FOOTING TYPE PER SCHEDULE THIS SHEET.
- 3) (#) DENOTES PAD FOOTING AT CONCENTRATED LOADS PER SCHEDULE THIS SHEET.
- 4) "P" DENOTES 8"x8" CONCRETE RIBBON w/ 1-#5 BAR AT EDGE OF PAVERS.
- 5) PROVIDE #5 VERTICAL REINFORCING AT DOT LOCATIONS SHOWN ON PLAN FROM FOOTING TO BOND BEAM.
- 6) ALL DIMENSIONS ARE TO OUTSIDE FACE OF MASONRY WALLS. SOME SLAB EDGES MAY EXTEND BEYOND FACE OF WALL.
- 7) FOR DIMENSIONS OF ROUGH OPENINGS IN MASONRY WALLS, COORDINATE WITH WINDOW/DOOR SUPPLIER.
- 8) PROVIDE PRESSURE TREATED BUCKS AT WINDOWS / DOORS PER DETAIL 7/S-3.

FOR AMERICAN BUILDERS SUPPLY TRUSS, 170 MPH, EXPOSURE C, MODEL 2221, ELEVATION M, 3 CAR GARAGE, JOB # M200809-20WX, DATED: 12/04/20, REVISED: NONE

DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 7th EDITION (2020) RESIDENTIAL

REVISIONS	BY

STRUCTURAL ENGINEERING:
STRUCTURAL SYSTEMS OF NORTH FLORIDA
1634 S.E. 47th STREET, SUITE #3
CAPE CORAL, FL 33904
(239) 549-4554
CA# 8829



This item has been digitally signed by Raul Reyes on the date adjacent to the seal. The digital signature and document are not considered signed and sealed and the signature must be validated on any electronic copies.

BUILDER:

D.R. HORTON
America's Builder

MODEL 2221 M
3 CAR GARAGE

18648 ROYAL HAMMOCK BLVD
NAPLES, FLORIDA
LOT: 2 SUBDIVISION: ROYAL PALM GOLF

DESIGN/DRAWN
DWB/GH
CHECKED
DWB
DATE
07/30/21
SCALE
VARIES
DR 13136
SHEET

S-1



SHEET 1 OF 4

Plaster R703.6.2: 3-coat 7/8" thick portland cement based plaster per ASTM C926.

Metal Lath R703.6.1: Self furring paper backed 2.5lb diamond mesh metal lath per ASTM C847, C60 galvanized, fastened per ASTM C1063 with 1-1/2" long, 11 gauge nails with 7/16" head (roofing nails) at 7" oc, or 1-1/2" long, 16 gauge staples at 6" oc, into the framing members (ie, the nails or staples must align with and penetrate 3/4" into the framing studs).

Water Resistive Barrier (WRB) R703.6.3: Water-resistive vapor-permeable barrier with a performance at least equivalent to 2 layers of Grade D paper. The individual layers shall be installed independently. An approved house wrap may be used for the 1st layer and metal lath with approved paper backing may be the 2nd layer (Note: ZIP wall sheathing with seam tape qualifies as the first layer).

PER FBC 2020 R302.6:
Dwelling/garage fire separation – The garage shall be separated
from the residence and attics by not less than 1/2 inch gypsum
board or equivalent applied to the garage side. Structures
supporting floor/ceiling assemblies used for separation shall have
not less than 1/2 inch gypsum board or equivalent.

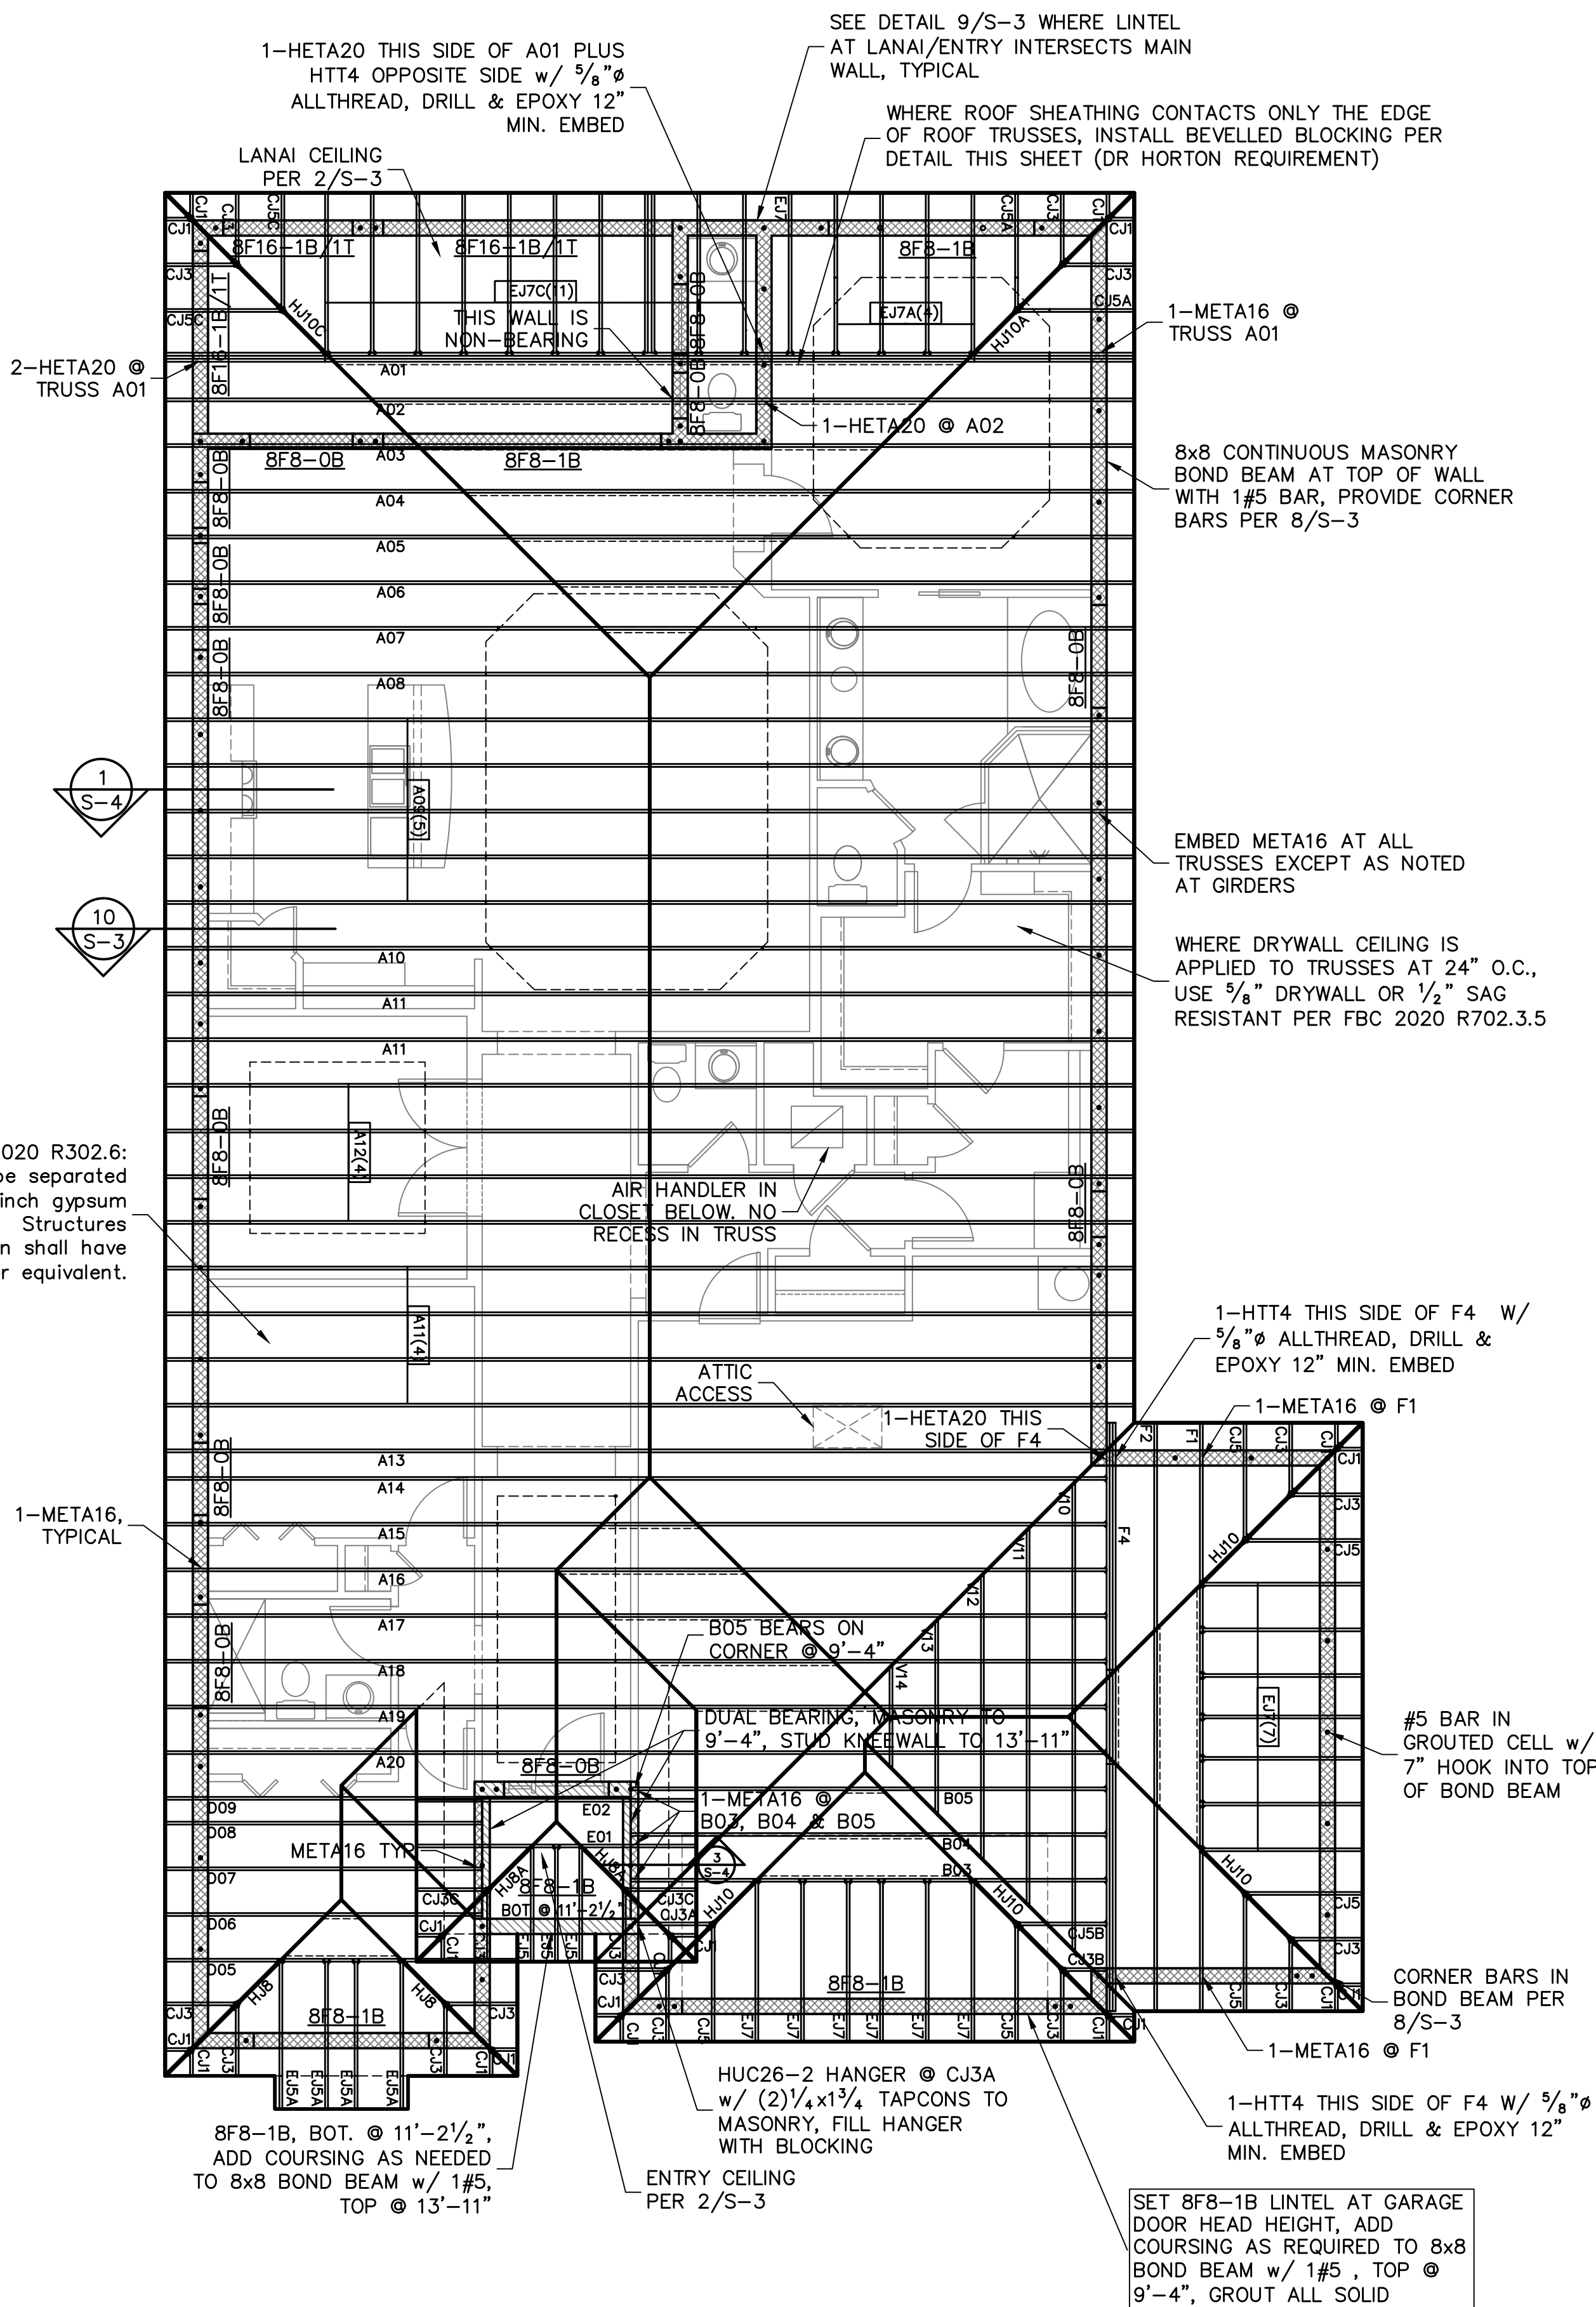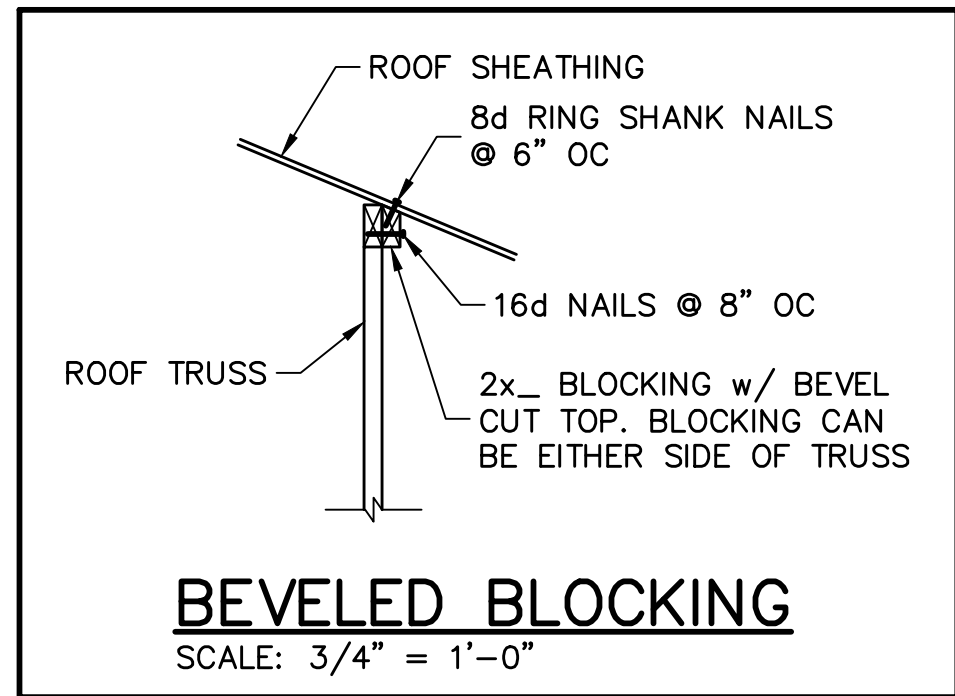


TRUSS STRAPPING TO MASONRY			
	MAX TRUSS UPLIFT (LBS)	STRAP/ANCHOR Valid lengths x/s/x/x	FASTENERS
INSTALL → MET16 AT ALL TRUSSES TO 1450 lb UPLIFT FOR HIGHER UPLIFTS, SEE NOTES ON PLAN.	1450 (1 PLY)	(1) MET16/18/20	(8) 0.148x1-1/2", EMBED 4"
	1510 (1 PLY)	(1) MET16/18/20	(9) 0.148x1-1/2", EMBED 4"
	1875 (1 PLY)	(2) MET16/18/20	(10) 0.148x1-1/2", EMBED 4"
	1920 (1 PLY)	(2) MET16/18/20	(10) 0.148x1-1/2", EMBED 4"
	2120 (1 PLY)	(1) HHETA16/20	(10) 0.148x1-1/2", EMBED 4"
	1795 (2 or 3 PLY)	(1) HHETA16/18/20	(14) 0.162x3-1/2", EMBED 4"
	2385 (2 or 3 PLY)	(2) MET16/18/20	(12) 0.162x3-1/2", EMBED 4"
	3965/DF/SP (2 PLY)	MGT	(22) 0.148x3" ATR, EPOXY 12"
	3000/DF/SP (1 PLY 2x4)	HTT4	(18) 0.148x1-1/2", 5/8" ATR, EPOXY 12"
	4455/DF/SP (1 PLY 2x6)	HTT4	(18) SD10x1-1/2", 5/8" ATR, EPOXY 12"
	4235/DF/SP (2 PLY 2x4)	HTT4	(16) 0.162x2-1/2", 5/8" ATR, EPOXY 12"
	4555/DF/SP (1 PLY 2x6)	HTT5	(26) SD10x1-1/2", 5/8" ATR, EPOXY 12"
	4670/DF/SP (2 PLY 2x4)	HTT5	(26) 0.148x3", 5/8" ATR, EPOXY 12"
	5445/DF/SP (2 PLY 2x4)	HTTSK	(26) SD10x2-1/2", 5/8" ATR, EPOXY 18"
	4690/DF/SP (2 PLY)	(1) HGT-2	(16) 0.148x3-1/2", 5/8" ATR, EPOXY 12"
	10790/SYP (3 PLY)	(1) HGT-3	(16) 0.148x3-1/2", (2) 3/4" ATR, EPOXY 12"

NOTES:

- 1) PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE AND SUITABLE FOR THE GEOMETRY. EMBED STRAP ON ϕ OF WALL.
- 2) ANY OF THE VALID LENGTHS SHOWN MAY BE USED IN PLACE OF THE LENGTH SPECIFIED ON PLAN.
- 3) CONNECTORS ARE SIMPSON STRONG TIE. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS. SUBSTITUTIONS MUST BE APPROVED IN WRITING BY THE ENGINEER OF RECORD.
WHERE EMBEDDED STRAP ARE MISSING, OR MIS-LOCATED, INSTALL RETROFIT STRAP PER 10/S-3 PER UPLIFT IN TRUSS ENGINEERING.

SIMPSON CATALOG C-C-2019

TRUSS STRAPPING TO STUD LUMBER/WOOD BEAM			
MAX TRUSS UPLIFT (LBS)	STRAP(S) Valid lengths x/x/x	FASTENERS	
850	(1)MSTS16/20/30	(14)	0.148x1"-1/2" or 3"
1700	(2)MSTS16/20/30	EACH STRAP	
2550	(3)MSTS16/20/30		
1125	(1)HSTS20/24/30	(24)	0.148x1"-1/2"
2250	(2)HSTS20/24/30	OR	
3375	(3)HSTS20/24/30	(20)	0.148x3"
4500	(4)HSTS20/24/30	EACH STRAP	

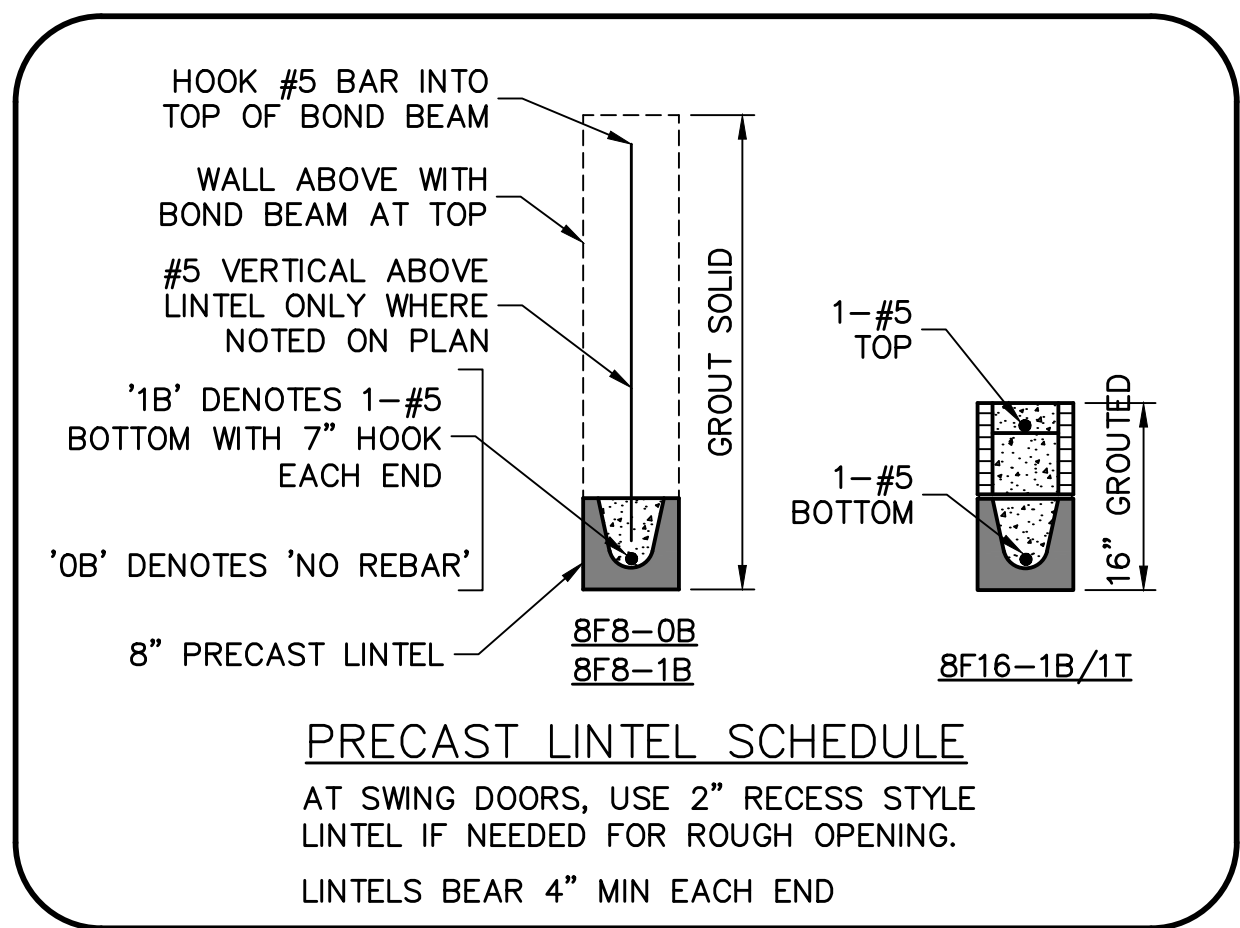

BEARING LEGEND

	BEARING @ 9'-4"
	BEARING @ 13'-11"

ROOF FRAMING PLAN

SCALE: $3/16" = 1'-0"$

PLAN NOTES:

- 1) ROOF TRUSS BEARING ELEVATION VARIES, SEE LEGEND.
- 2) ROOF FRAMING SHALL BE WOOD TRUSSES DESIGNED BY A DELEGATED TRUSS ENGINEER PER DESIGN CRITERIA ON SHEET S-3.
- 3) PROVIDE STRAPPING AT TRUSSES PER NOTES ON THIS SHEET.
- 4) FOR NAILING OF ROOF DECK, SEE 1 AND 2 ON S-3.
- 5) 8x8-18 etc, DENOTES PRECAST LINTEL ABOVE DOOR/WINDOW OPENING PER SCHEDULE THIS SHEET.
- 6) AT TRUSS BEARING, PROVIDE 8x8 MASONRY BOND BEAM w/ 1-#5 CONTINUOUS, SEE DETAIL 10/S-3.
- 7) FOR DIMENSIONS OF ROUGH OPENINGS IN MASONRY WALLS, COORDINATE WITH WINDOW/DOOR SUPPLIER.
- 8) PROVIDE PRESSURE TREATED BUCKS AT WINDOWS / DOORS PER DETAIL 7/S-3.


[illegible]

STRUCTURAL ENGINEERING:
(202) 770-0141

**STRUCTURAL
SYSTEMS
OF NORTH FLORIDA**

1634 S.E. 47th STREET, SUITE #3
CAPE CORAL, FL 33904
(239) 549-4554

CA# 8829

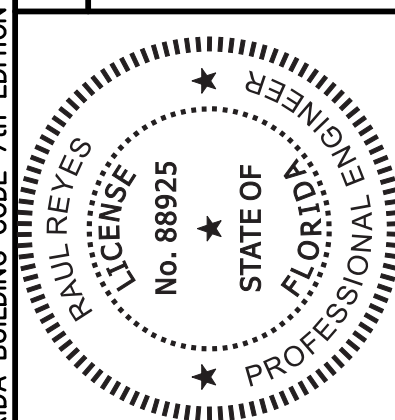

100

BUILDER:

MODEL 2221 M
3 CAR GARAGE

18648 ROYAL HAMMOCK BLVD
NAPLES, FLORIDA
LOT: 2 SUBDIVISION: ROYAL PALM GOLF

DESIGN/DRAWN DWB/GH
CHECKED DWB
DATE 07/30/21
SCALE VARIES
DR 13136
SHEET

S-2

SHEET 2 OF 4

TABLE R803.2.3.1 – NAIL SPACING BASED ON SPECIFIC GRAVITY OF RAFTER/TRUSS: ALL TRUSS TOP CHORDS AND FIELD ROOF FRAMING SHALL BE SOUTHERN PINE, SPECIFIC GRAVITY=0.55 (EXCEEDS SG=0.42 AND 0.49 OF TABLE R803.2.3.1).

ENSURE THAT ALL NAILS PENETRATE THE TOP CHORD OF THE TRUSS WITHOUT SPLITTING.

TYPICAL HOUSE PLAN

EDGE MAIL TO BLOCKING AT RIDGE VALLEY/HIP

STAGGER JOINTS AT SHEATHING PANELS

EDGE NAIL TO FACIA BOARD

NAIL SPACING (TABLE R803.2.3.1) WIND SPEED / EXPOSURE

NAIL TYPE (SECTION R803.2.3.1) 19/32 SHEATHING

160/B, 160/C, 170/B, 170/C

NAIL SPACING: 6" O.C. EDGE 6" O.C. FIELD

NAIL SPACING: 4" O.C. EDGE 4" O.C. FIELD

2 1/2" x 0.131" RING SHANK OR 3" x 0.120" RING SHANK (PER ASTM F1667 RSRs-03 & 04)

1 NAILING OF ROOF SHEATHING

SHEATHING SCHEDULE

EXTERIOR STUD WALL	FLOOR
7/16" ZIP SYSTEM WALL SHEATHING BY HUBER ENGINEERED WOODS LLC, NAILED W/ 8d COMMON WIRE @ 6" O.C. EDGE AND 6" O.C. FIELD. PROVIDE 2x4 BLOCKING AT ALL JOINTS. INSTALL SHEATHING AND SEAM TAPE IN STRICT ACCORDANCE WITH MFR. WRITTEN INSTRUCTIONS.	N/A
ROOF – PER FBCR TABLE 803.2.2	1) 1x4 STRIPPING @ 16"OC w/ 2–8d NAILS TO EACH TRUSS, 3/8" EXTERIOR GYPBOARD CEILING, FASTEN w/8d NAILS OR 1 5/8" DRYWALL SCREWS @ 6"OC EDGE & FIELD. 2) 3/8" BC PLYWOOD NAILED w/ 6d COMMON @ 6" OC EDGE & FIELD.
19/32 CLASS A.P.A. RATED SHEATHING, EXPOSURE 1, SPAN RATING 40/20. FASTEN WITH RING SHANK NAILS PER DETAIL 1/S–3	ALUMINUM PERFORATED SOFFIT INSTALLED PER MANUFACTURER INSTRUCTIONS TO MEET WIND PRESSURES PER R704.

NOTE: EXTERIOR CEILINGS SPECIFIED ABOVE MEET THE DESIGN WIND PRESSURES PER R703.1.2

2

RETROFIT STRAPS TO CONCRETE/MASONRY

TRUSS UPLIFT (LBS) @ 24" OC	CONNECTOR
TO 840	1–MTSM16 or 20
TO 1045	1–HTSM16 or 20
TO 2090	2–HTSM16 or 20
TO 4300	2–LGT2
TO 3480	HTT16
TO 10530	HGT–2/3

NOTES:

1) WHERE EMBEDDED STRAP IS MISSING OR MIS–LOCATED, PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE.

2) CONNECTORS ARE SIMPSON STRONG TIE. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS.

4 RETROFIT UPLIFT CONNECTOR SCHEDULE

BUCK FASTENING

8" CMU WALLS

2x4 or 2x6 P.T. BUCK @ FLANGED WINDOWS (SEE NOTE)

1/4"x3 3/4" TAPCON @ 24" OC, 3 SCREWS MIN. (SEE NOTE)

8" CMU, SEE PLAN FOR REINFORCING

DOOR

2x8 OR 2x6 P.T. SYP#2

2x2x1/8" WASHER

1/2" Ø EXPANSION BOLT, 4" MIN. EMBEDMENT, SPACE 24" OC AND 12" FROM TOP & BOT.

GARAGE DOOR

NOTE: THIS BUCK FASTENING DETAIL IS INTENDED FOR FLANGED WINDOW/DOOR PRODUCTS THAT FASTEN THRU THE FLANGE WITH WOOD SCREWS TO THE BUCK. FOR WINDOW/DOOR PRODUCTS THAT DO NOT HAVE A FLANGE AND FASTEN INSTEAD OUTWARD THRU THE FRAME, USE MASONRY SCREWS PER MFR. THAT ARE LONG ENOUGH TO PENETRATE 2–1 1/4" INTO THE MASONRY. IN THIS CASE, THE BUCK MATERIAL IS SIMPLY A SPACER AND MAY BE 1x4 OR 1x6 OR OMITTED ENTIRELY AND THE SPACER MAY BE TACKED IN PLACE WITH MASONRY NAILS OR PINS.

TRUSS STRAP TO BOND BEAM

SCALE: 3/4" = 1'–0"

ROOF SHEATHING, SEE SCHEDULE 2/S–3

WOOD TRUSSES @ 24" OC, DESIGNED BY DELEGATED TRUSS ENGINEER

EMBEDDED STRAP AT EACH ROOF TRUSS. SEE ROOF PLAN. BREAK OUT WEB OF BLOCK AS NEEDED TO PROPERLY LOCATE EACH STRAP.

2x SUBFASCIA w/ 2–16d TO EACH TRUSS

TRUSS BEARING

APPROVED ISOLATION PLATE

8"x8" CONTINUOUS MASONRY BOND BEAM w/ 1–#5, GROUT SOLID. PROVIDE CORNER BARS PER DETAIL 8/S–3.

#5 VERT. IN GROUTED CELL AT DOT LOCATIONS ON PLAN (48" OC MAX EXTERIOR)

ALUMINUM SOFFITS SHALL MEET WIND DESIGN PRESSURES PER R704 INSTALLED PER MFR. SPECS.

#5 VERTICAL SHALL HAVE 7" STANDARD HOOK INTO TOP OF BOND BEAM

8" MASONRY

10 TRUSS STRAP TO BOND BEAM

SLAB SAWCUT DETAIL

SCALE: NTS

3/4" DEEP SAWCUT w/ ELASTOMERIC SEALANT

SLAB ON GRADE, SEE PLAN

NOTES:

1) PROVIDE SAWCUTS TO CREATE APPROXIMATE 20' X 20' MAXIMUM SQUARES.

2) SAWCUT CONCRETE SLAB WITHIN 4 TO 12 HOURS OF CONCRETE PLACEMENT.

INTERSECTION

CORNER

CORNER BAR DETAIL IN BOND BEAMS

SCALE: 3/4" = 1'–0"

#5 CORNER BAR, 25"x25"

MASONRY BOND BEAM, TYPICAL

OUTLOOKER DETAIL AT DROP GABLE

SCALE: N.T.S.

2x4 BLOCK AT SHEATHING JOINT

3–12d TOE NAILS

2x4 OUTLOOKER

H2.5A CLIP @ EA. OUTLOOKER TO TRUSS

TRUSS TOP CHORD, DROP 3 1/2"

EXTERIOR SHEATHING PER SCHEDULE 2/S–3

MID WALL WEEP SCREED

12d NAILS AT TRUSS BOTTOM CHORD TO SILL @ 8" O.C.

MASONRY WALL, SEE PLAN

NO GABLE END BRACING REQUIRED

USED ONLY ON 'L'

11 OUTLOOKER DETAIL AT DROP GABLE

WINDOW/DOOR/SOFFIT DESIGN WIND PRESSURES

WIND PRESSURES PER ASCE7–16, 170 MPH, EXPOSURE C, AND CONVERTED TO ALLOWABLE STRESS DESIGN PRESSURES USING 0.6W LOAD FACTOR. (Vwsd=132 MPH, RISK CAT II, ENCLOSED, kd=0.85, h=15')

TYPE	INTERIOR ZONE 4	END ZONE 5
SOFFIT (10 SQ. FT.)	+37.8 –40.9	+37.8 –50.6
WINDOWS & DOORS (10 SQ. FT.)	+37.8 –40.9	+37.8 –50.6
8' OR 9' GARAGE DOORS	+33.4 –37.8	
16' OR 18' GARAGE DOORS	+32.0 –35.6	

(SEE PLAN FOR OTHER SPECIFIC PRESSURES)

1) TABLE MAY BE USED FOR ANY SIZE WINDOW OR DOOR IN EACH TYPE.

2) USE "INTERIOR ZONE 4" PRESSURES UNLESS WINDOW OR DOOR IS LOCATED WITHIN THE "END ZONE 5" (SEE DIAGRAM BELOW), THEN USE THE HIGHER PRESSURES UNDER THE "END ZONE 5" COLUMN.

3) ALL GLASS / GLAZING SHALL BE IMPACT RATED OR USE IMPACT RATED SHUTTERS.

4) SUBMIT PRODUCT APPROVALS TO THE BUILDING DEPARTMENT AS REQUIRED BY THE LOCAL JURISDICTION.

5) MANUFACTURED SOFFIT PRODUCTS SHALL BE INSTALLED PER MFR ENGINEERING SPEC SHEETS.

* ON IRREGULAR SHAPED BUILDINGS, THERE IS NO GUIDANCE IN THE CODE FOR HOW FAR A CORNER MUST PROTRUDE FROM THE MAIN BUILDING TO BE CONSIDERED 'ZONE 5'. WE HAVE CHOSEN >15'. THIS IS SUBJECT TO JUDGEMENT CALL BY THE AUTHORITY HAVING JURISDICTION.

IN ZONE 5, MANUFACTURED SOFFIT PRODUCTS MAY REQUIRE ADDITIONAL BATTENS OR FASTENING PER MFR ENGINEERING SPEC SHEETS TO MEET THE PRESSURE REQUIREMENTS.

TYPICAL HOUSE PLAN

END ZONE 5 PRESSURES OCCUR AT "PRIMARY" OUTSIDE CORNERS OF BUILDING (BOLD LINES)

INTERIOR ZONE 4 PRESSURES

END ZONE WIDTH = 4'–0" MEASURED FROM FACE OF WALL (FIG R301.2(7))

3

STEP FOOTING

SCALE: NTS

3" COVER

MAINTAIN RUN TO RISE OF 2:1 OR MORE

FOOTING REIN., SEE PLAN

LAP CORNER BARS 40 BAR DIAMETERS

CONCRETE FOOTING, SEE PLAN

PLAN VIEW

FOOTING

CORNER BARS

SCALE: NTS

STEPPED BOND BEAM & REINFORCING

SCALE: 3/4" = 1'–0"

UPPER BOND BEAM, SEE PLAN

HOOK BAR INTO TOP OF UPPER BOND BEAM

VERTICAL BOND BEAM, 8"x8" CMU w/ #5 VERTICAL

8"x8" BOND BEAM w/ 1–#5

LINTEL AT LANAI OR ENTRY, '8F16–1B/1T' (8"x16" FILLED SOLID, 1#5 BOTTOM, 1–#5 TOP)

7" STANDARD HOOK INTO TOP OF BOND BEAM (MAY USE 7"x25" BENT BAR)

HOOK OR CORNER BAR

#5 VERT. AT INTERSECTION OF BOND BEAM w/ 7" HOOK AT TOP

MASONRY WALL

#5 VERTICAL IN GROUTED CELL AT DOT LOCATIONS ON PLAN

9 STEPPED BOND BEAM & REINFORCING

DESIGN CRITERIA:

DESIGN IN ACCORDANCE WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE 7th EDITION (2020) RESIDENTIAL

1. FLOOR & ROOF UNIFORM LOADS: LIVE LOAD 40 PSF, DEAD LOAD 20 PSF
ROOF: LIVE TOP CHORD 20 PSF
LIVE BOTTOM CHORD 10 PSF (NON–CONCURRENT w/ TOLL)
CEMENT ROOF TILE DEAD LOAD 25 PSF TOTAL
SHINGLE/METAL ROOFING DEAD LOAD 15 PSF TOTAL
MINIMUM DEAD LOAD FOR WIND: TC 5 PSF, BC 5 PSF

DEFLECTION CRITERIA:
FLOOR L/480 LIVE, L/360 TOTAL
ROOF L/240 LIVE, L/180 TOTAL

2. WIND LOADS:
WIND DESIGN PER, ASCE7–16
BASIC WIND SPEED (ASCE7–16) 170 MPH
NOMINAL WIND SPEED (Vwsd TABLE R301.2.1.3) 132 MPH
BUILDING CATEGORY II
IMPORTANCE FACTOR 1.00
EXPOSURE C
MEAN ROOF HEIGHT = 15 FT
ROOF PITCH 5/12
ENCLOSURE CLASS. +/- 0.18
INTERNAL PRES. COEFF. +/- 0.18

WINDOW/DOOR DESIGN WIND PRESSURE PER TABLE R301.2(2), R301.2(3) AND R301.2(4). SEE DETAIL ON S–3.

SOFFITS – PER R704, ALL SOFFITS & THEIR ATTACHMENTS SHALL BE CAPABLE OF RESISTING THE DESIGN PRESSURES SPECIFIED IN TABLE R301.2(2) FOR WALLS USING 10 SQ. FT.

3. REINFORCED CONCRETE:
DESIGN AS PER ACI 318–14
REQUIRED COMPRESSIVE STRENGTH AT 28 DAYS:
SLAB ON GRADE f'c = 2500 PSI
3 1/2" MINIMUM THICKNESS REINFORCED WITH 6x6 w1.4xw1.4 WWF OR FIBERMESH.
CONVENTIONAL SHALLOW FOOTINGS f'c = 2500 PSI
BEAMS AND COLUMNS f'c = 3000 PSI
ALL OTHER CONCRETE (U.N.O.) f'c = 3000 PSI
UNLESS OTHERWISE SHOWN ON DRAWINGS, MINIMUM CONCRETE COVER FOR REINFORCING SHALL BE AS FOLLOWS:
FOOTINGS 3"
SLAB ON GRADE CENTERED
BEAMS 1 1/2"
COLUMNS 1 1/2"
ALL REINFORCING STEEL SHALL BE PLACED IN ACCORDANCE WITH THE TYPICAL BENDING DIAGRAMS AND PLACING DETAILS OF ACI STANDARDS AND SPECIFICATIONS. ALL REINFORCING STEEL SHALL BE HELD SECURELY IN POSITION WITH STANDARD ACCESSORIES DURING PLACING OF CONCRETE.
REINFORCING STEEL – ASTM A615 GRADE 40 FOR #3
GRADE 60 FOR #4 TO #11

WELDED WIRE FABRIC – ASTM A185

SPICES IN REINFORCING, SHALL BE 40 BAR DIAMETERS. NON–CONTACT LAP SPICES MAY BE USED PROVIDED REINFORCING IS NOT SPACED MORE THAN 5" APART FOR #5 BARS.

FORMWORK AND SHORING SHALL REMAIN IN PLACE UNTIL CONCRETE HAS REACHED AT LEAST 2/3 OF THE REQUIRED 28 DAY STRENGTH.

4. REINFORCED MASONRY:
DESIGN PER TMS 402/602–16
REQUIRED COMPRESSIVE STRENGTHS:
MASONRY WALLS f'm = 1500 PSI

REINFORCING STEEL – ASTM A615 GRADE 60.
SPICES IN REINFORCING, SHALL BE 48 BAR DIAMETERS.
ALL CONCRETE MASONRY UNITS SHALL BE COMPOSED OF ASTM C90, GRADE N–1 HOLLOW CONCRETE MASONRY UNITS WITH TYPE 'S' MORTAR. GROUT ALL CELLS CONTAINING VERTICAL REINFORCEMENT WITH 3000 PSI PEA ROCK CONCRETE GROUT. ALL CELLS BELOW FINISHED GRADE SHALL BE GROUTED SOLID. ALL EXTERIOR WALLS SHALL BE REINFORCED FULL HEIGHT AT DOT LOCATIONS ON PLAN.

5. DELEGATED–ENGINEERED WOOD ROOF TRUSSES:
ALL WOOD ROOF TRUSSES SHALL BE DESIGNED BY A DELEGATED TRUSS ENGINEER PER RULE 61G15–31.003 OF THE FLORIDA ADMINISTRATIVE CODE. ALL TRUSSES SHALL HAVE TEMPORARY BRACING PER "COMMENTARY AND RECOMMENDATIONS FOR HANDLING, INSTALLING AND BRACING METAL PLATE CONNECTED WOOD TRUSSES, HB–91" FOR OTHER BRACING REQUIREMENTS, NOTIFY ENGINEER. PROVIDE PERMANENT BRACING PER TRUSS MFR. SHOP DRAWINGS. IF PERMANENT BRACING IS NOT SPECIFIED, CONTACT ENGINEER.

6. FOUNDATION:
CONVENTIONAL SHALLOW CONCRETE FOOTINGS 2000 PSF SOIL BEARING CAPACITY
THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING THE SUITABILITY OF THE SOIL CONDITIONS FOR THE INTENDED STRUCTURE AND ASSUMED SOIL BEARING CAPACITY. IT IS RECOMMENDED THAT A GEOTECHNICAL FIRM BE HIRED TO PERFORM A SITE EVALUATION.

7. DIMENSIONS: VERIFY ALL DIMENSIONS WITH HOUSE PLANS. SEE HOUSE PLANS, MECHANICAL, ELECTRICAL AND PLUMBING DRAWINGS FOR EMBEDS, OPENINGS, SLEEVES, ETC. WHICH ARE NOT SHOWN ON STRUCTURAL DRAWINGS.

8. MEANS AND METHODS: THE STRUCTURAL ENGINEER SHALL NOT HAVE CONTROL OR BE RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, PROCEDURES, OR SEQUENCES TEMPORARY BRACING, SHORING, GUYING OR OTHER MEANS TO SUPPORT STRUCTURAL ELEMENTS IN PLACE DURING CONSTRUCTION. FOR THE ACTS OR OMISSIONS OF THE CONTRACTOR, OR ANY OTHER PERSONS PERFORMING THE WORK OR FOR THE FAILURE OF ANY OF THEM TO CONSTRUCT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

9. SHOP DRAWINGS: SHOP DRAWINGS SHALL BE PREPARED AND SUBMITTED TO THE ENGINEER FOR REVIEW FOR ALL STRUCTURAL ELEMENTS UTILIZING PREFABRICATED COMPONENTS. ONE SET OF SIGNED & SEALED TRUSS ENGINEERING SHALL BE DELIVERED TO THE ENGINEER OF RECORD FOR THE STRUCTURE PER FLORIDA ADMINISTRATIVE CODE 61G15–30.005 AND 61G15–31.003.

FBC R703.7 EXTERIOR PLASTER

ASTM C926 AND ASTM C1063

THE CODE SECTIONS REFERENCED BELOW ARE FOR SUMMARY PURPOSES. SEE THE FLORIDA BUILDING CODE AND THE ASTM STANDARDS FOR FULL DESCRIPTIONS AND REQUIREMENTS.

R703.7.1 Lath: Where required by the wall framing type, install metal lath per ASTM C1063 or non metallic lath per ASTM C1787. Use self furring lath as required by the ASTM spec. Use paper backed lath as required per Water Resistive Barrier specs.

R703.7.2 Plaster: Install portland cement based plaster and number of coats per ASTM C926 and thickness per Table R702.1(1).

R703.7.3 Water Resistive Barriers: Install water resistive barriers per R703.2 and water resistive vapor–permeable barrier over stud walls. (Note: ZIP wall sheathing with seam tape qualifies as the first layer)

R703.7.2.1 Weep Screed: Weep screed shall be installed at the bottom edge of all exterior wood stud framed walls (including gable end trusses) receiving lath and plaster.

Note: Exterior Stud Walls includes Gable End Trusses or Floor Trusses with Wall Sheathing.

STUD FRAMING OR FLOOR TRUSS OR GABLE END WITH WALL SHEATHING

MASONRY WALL

EXTERIOR WALL WITH PLASTER

THICKNESSES ARE EXAGGERATED FOR DRAWING PURPOSES

REVISIONS	BY

STRUCTURAL ENGINEERING:

STRUCTURAL SYSTEMS OF NORTH FLORIDA

1634 SE. 47th STREET, SUITE #3
CAPE CORAL, FL 33904
(239) 549–4554
CA# 8829

PROFESSIONAL ENGINEER

FLORIDA

STATE OF

No. 88925

RENEWAL

RECEIVED

DR. HORTON • BUILDERS

America's Builder

MODEL 2221 M

3 CAR GARAGE

18648 ROYAL HAMMOCK BLVD
NAPLES, FLORIDA

LOT: 2 SUBDIVISION: ROYAL PALM GOLF

DESIGN/DRAWN DWB/GH

CHECKED DWB

DATE 07/30/21

SCALE VARIES

DR 13136


SHEET

S–3


SHEET 3 OF 4

FOR AMERICAN BUILDERS SUPPLY TRUSS, 170 MPH, EXPOSURE C, MODEL 2221, ELEVATION M, 3 CAR GARAGE, JOB # M200809–20MX, DATED: 12/04/20, REVISED: NONE


DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 7th EDITION (2020) RESIDENTIAL

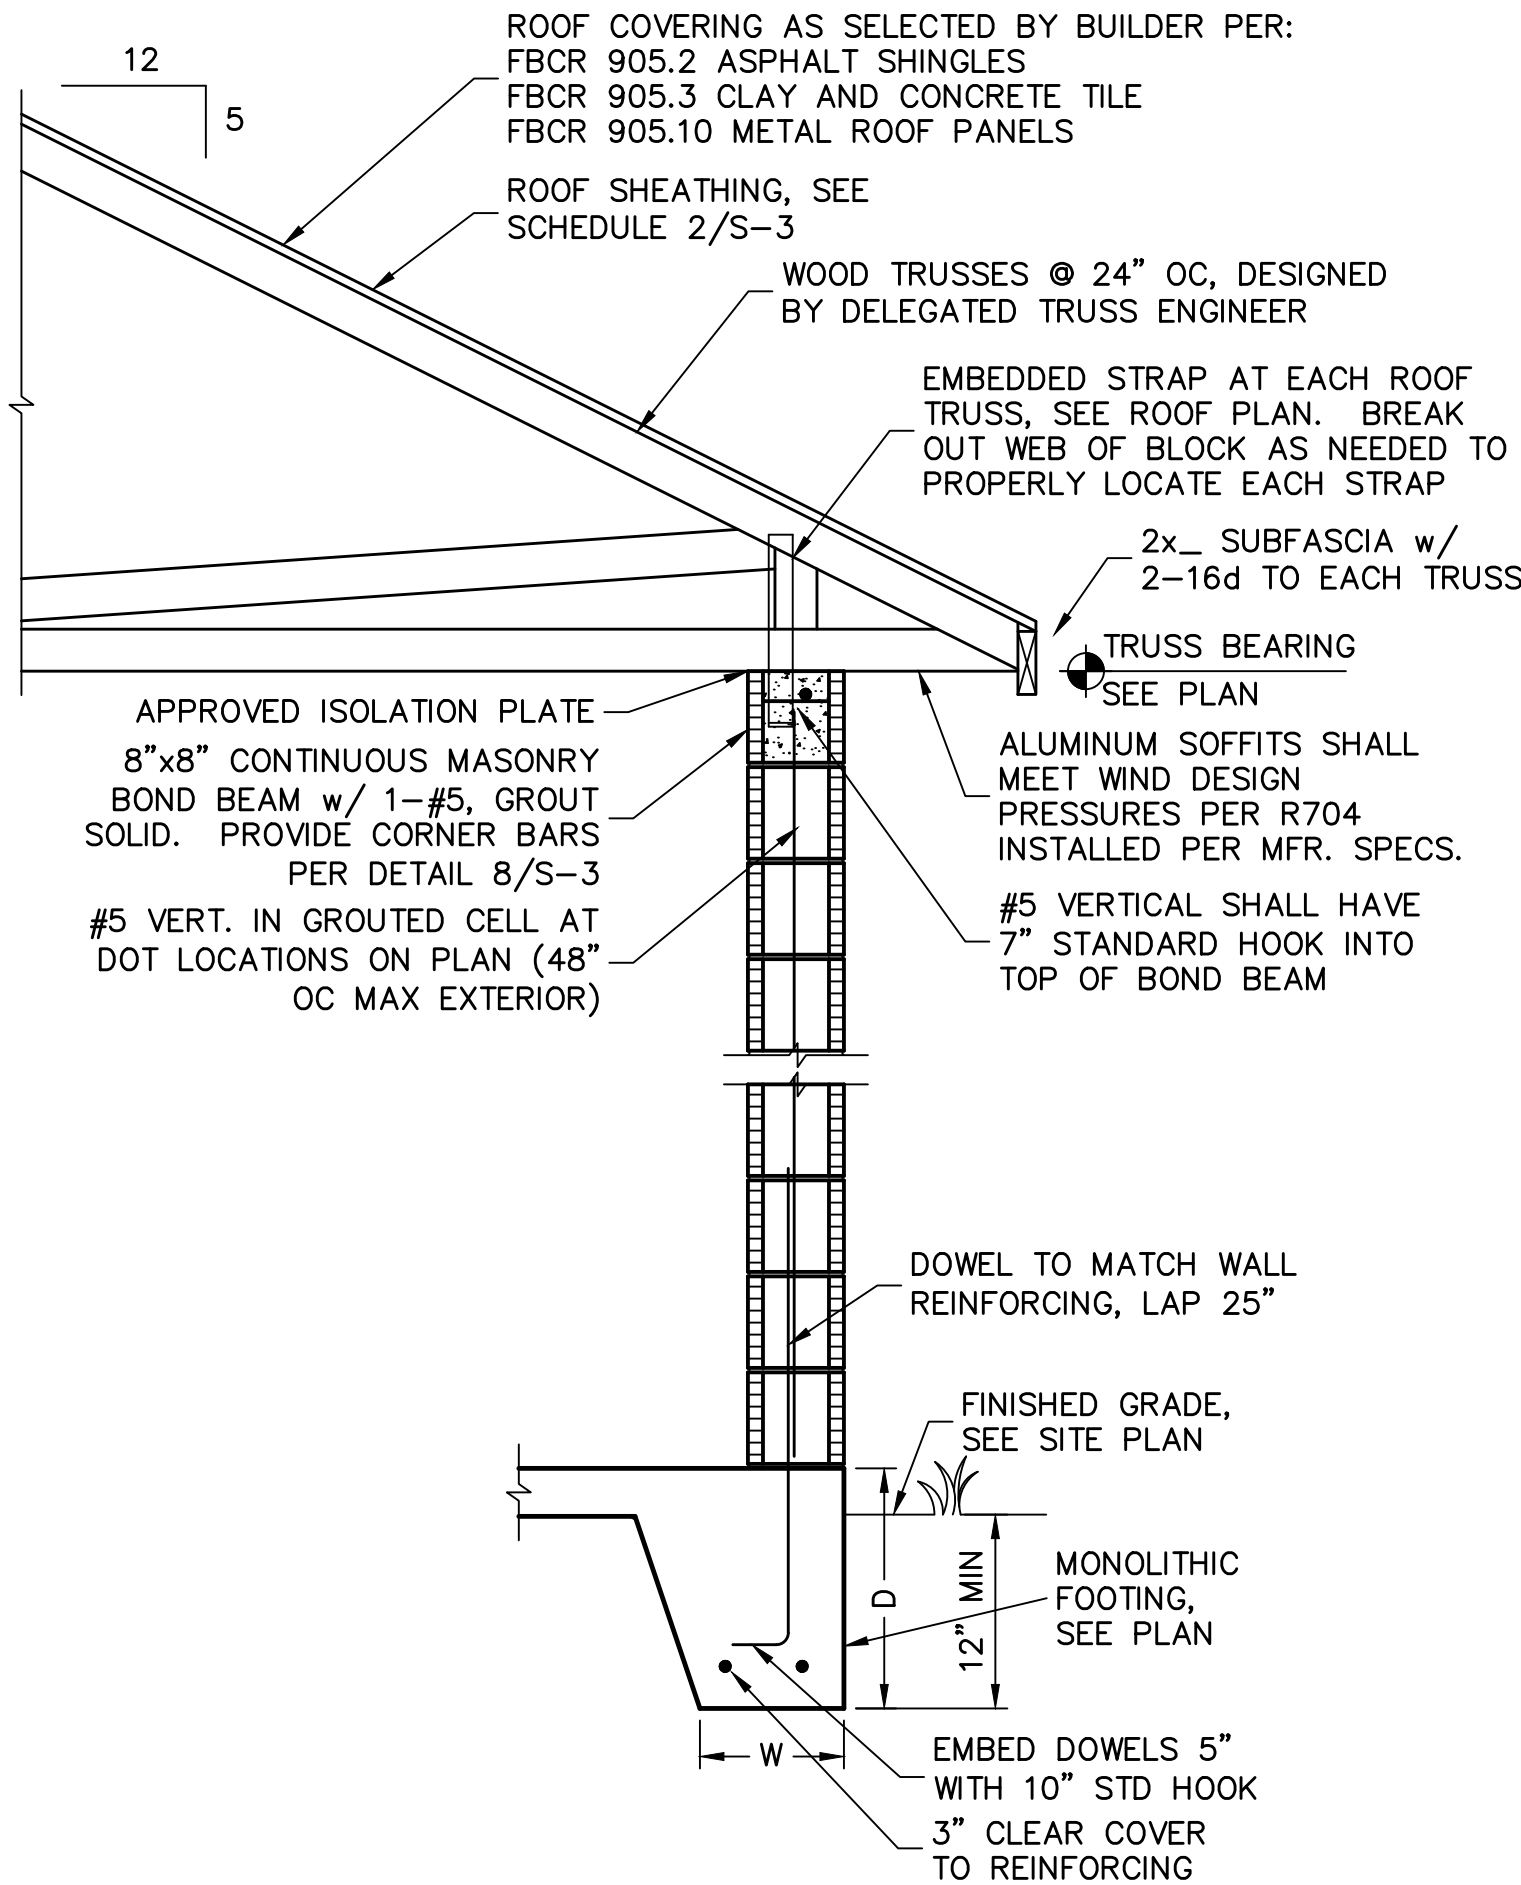

1 FULL HEIGHT WALL SECTION
SCALE: 3/4" = 1'-0"

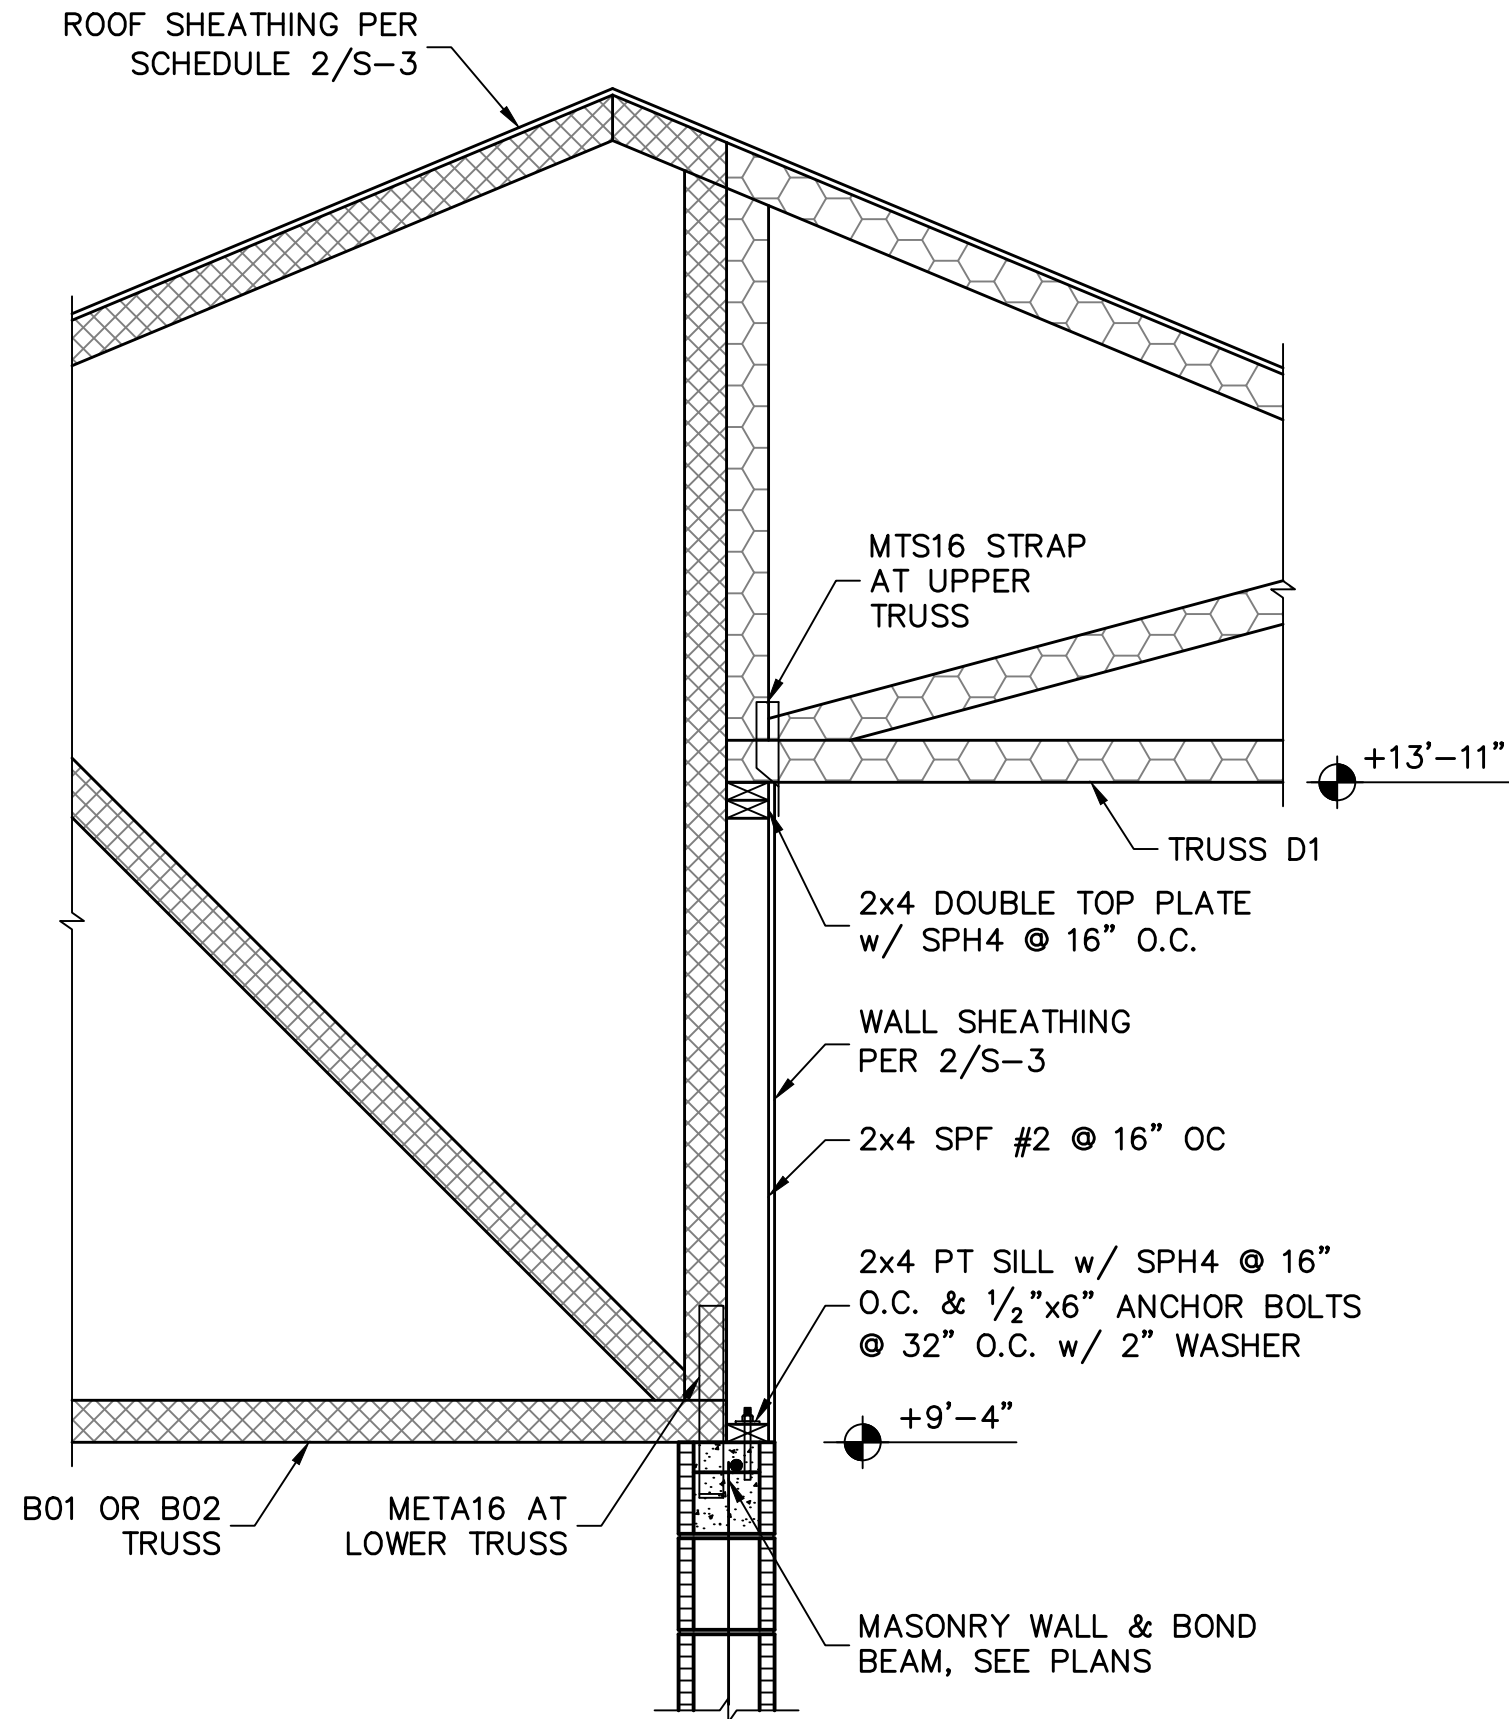

2 KNEEWALL @ ENTRY 'L'
SCALE: 3/4" = 1'-0"

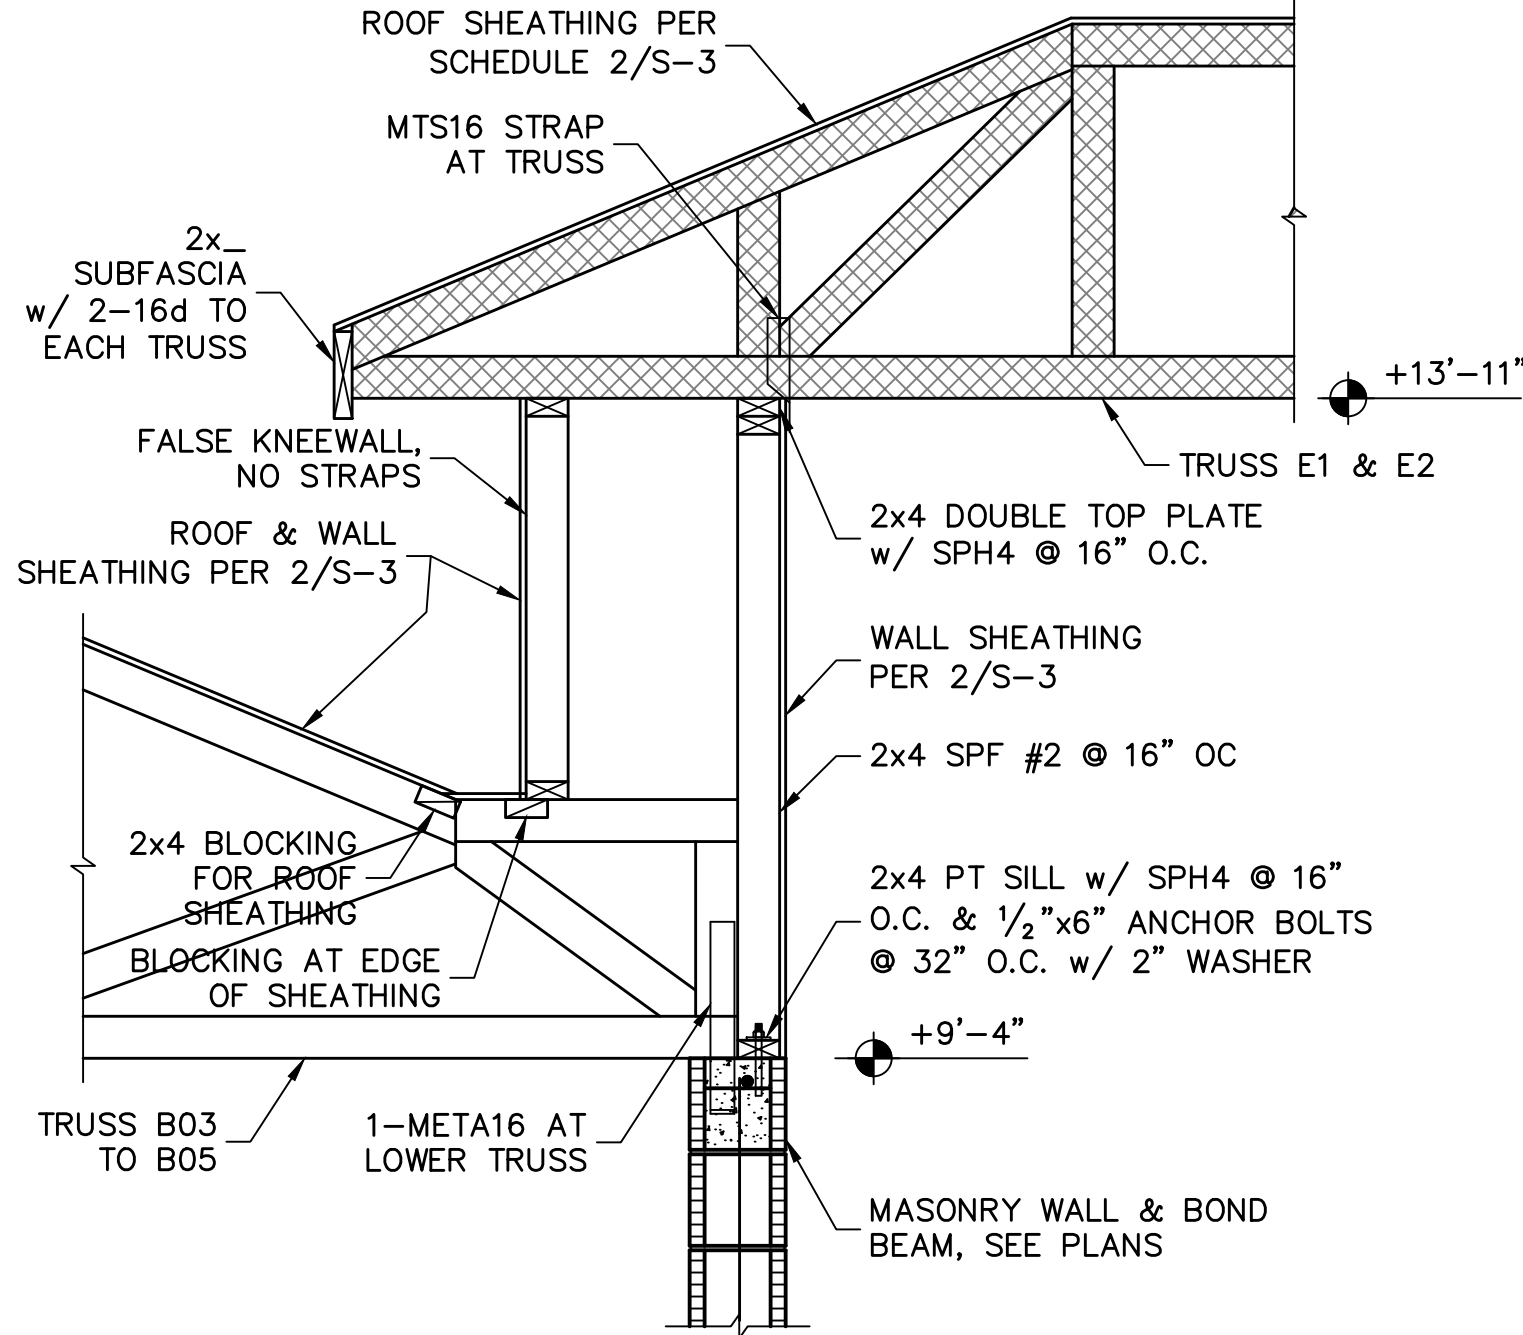

3 KNEEWALL @ ENTRY 'M'
SCALE: 3/4" = 1'-0"

FOR AMERICAN BUILDERS SUPPLY TRUSS, 170 MPH, EXPOSURE C, MODEL 2221, ELEVATION M, 3 CAR GARAGE, JOB # M2000899-20MX, DATED: 12/04/20, REVISED: NONE

DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 7th EDITION (2020) RESIDENTIAL

BUILDER:



MODEL 2221 M
3 CAR GARAGE
18648 ROYAL HAMMOCK BLVD
NAPLES, FLORIDA
LOT: 2 SUBDIVISION: ROYAL PALM GOLF

DESIGN/DRAWN
DWB/GH
CHECKED
DWB
DATE
07/30/21
SCALE
VARIES
DR 13136
SHEET

S-4
SHEET 4 OF 4

REVISIONS	BY

STRUCTURAL ENGINEERING:
PAUL REYES
LICENSE
No. 88925
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

STRUCTURAL SYSTEMS OF NORTH FLORIDA
1634 S.E. 47th STREET, SUITE #3
CAVALLO, FL 33604
(259) 594-4504
CA# 8829