


SEE SUPPORTING TRUSS & PIGGY-BACK ENGINEERING FOR ADDITIONAL INFORMATION

SCAB PIGGY-BACK DETAIL

TYPICAL JACK CUTS

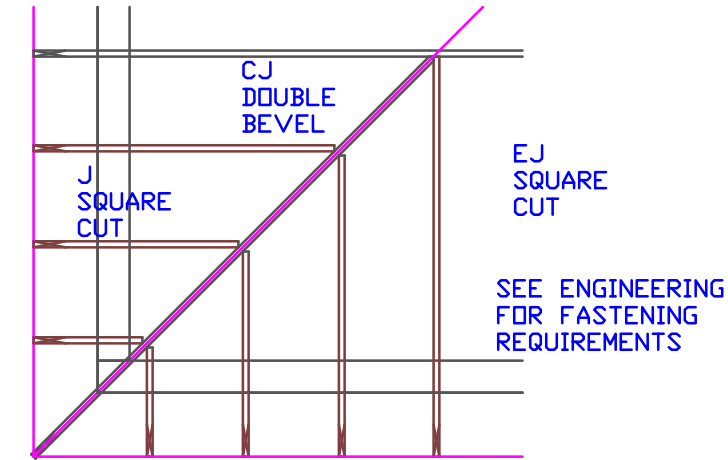

DESIGN CRITERIA

TOP CHORD LIVE LOAD	20
TOP CHORD DEAD LOAD	20
BOTTOM CHORD LIVE LOAD NON-CONCURRENT	10#
BOTTOM CHORD DEAD LOAD	10
TOTAL LOAD	50
DURATION FACTOR	1.25
WIND DESIGN SPEED (MPH)	160
ASCE 7-16 CAT II EXPOSED MVFRS	
CLOSED	FBC 2020
MAX. WALL HT FOR WIND LOAD	8'-8"

TILE

****UNLESS NOTED****

REACTION VALUES ARE UNDER 5000#

UPLIFT VALUES ARE UNDER 1000#

ALL TRUSSES 24'o.c. UNLESS NOTED OTHERWISE

*******CAUTION*******

DO NOT ATTEMPT TO ERECT TRUSSES WITHOUT REFERRING TO THE ENGINEERING DWGS.

IT IS NECESSARY TO REFER TO THE ENGINEERING DRAWINGS FOR NUMBER OF MEMBERS, BEARING LOCATION, ORIENTATION AND WEB BRACING

REFER TO WTCA/TPI BSCI-B1 SUMMARY SHEET FOR HANDLING METHODS & TEMPORARY BRACING, WHICH IS ALWAYS REQUIRED

BEARING HEIGHTS BASED ON PLANS PROVIDED TO SCOSTA CORP. +/- BEARING DIFFERENCES SHOWN ARE CRITICAL. IF ANY HEIGHTS DEVIATE - INFORM SCOSTA CORP.

BEARING WALL & BEAM HEIGHTS

8'-8" A.F.F.	0'-0" ELEV.
RAKED BEAM	ELEV.
	ELEV.
	ELEV.
	ELEV.
	ELEV.
	ELEV.

TYPICAL HANGER SCHEDULE

(C) SIMPSON HUS 26	(M) SIMPSON HGUS 28-3
(F) SIMPSON HUS 28	(N) SIMPSON HHUS 48
(H) SIMPSON HGUS 28	(P) SIMPSON LUS 24
(I) SIMPSON HGUS 28-2	(B) SIMPSON THA 422
(W) SIMPSON THJA26	(X)

HANGER VALUES HAVE BEEN BASED ON 16D COMMON NAILS EXCEPT THE FOLLOWING:
LUS24 - 10D COMMON THJA26 - 10D x 1-1/2

*******ATTENTION*******

APPROVAL OF THIS TRUSS LAYOUT IS NECESSARY BEFORE FABRICATION CAN BEGIN. VERIFY DIMENSIONS, PITCHES, OVERHANGS, ELEVATIONS, CEILING & BEARING CONDITIONS. SCOSTA CORPORATION IS RESPONSIBLE FOR ACCURACY IN ACCORDANCE WITH PLANS AND/OR INFORMATION PROVIDED BY CUSTOMER, WITH ANY DEVIATIONS NOTED HEREIN. CUSTOMER IS RESPONSIBLE TO VERIFY ACCURACY OF INFORMATION AND PLANS PROVIDED TO SCOSTA CORPORATION, AND TO VERIFY CONFORMANCE TO FIELD CONDITIONS, AND/OR OWNER CHANGES TRUSSES WILL BE BUILT IN ACCORDANCE WITH THE APPROVED LAYOUT.

APPROVED BY: _____
DATE: _____ REQUESTED DELIVERY DATE: _____
JOBSITE CONTACT NAME: _____
PHONE #: _____
E-MAIL: _____

SCOSTA CORP.

WOOD, STEEL OR TIMBER
ROOF & FLOOR TRUSSES





3670 COMMERCE CENTER DRIVE
SEBRING, FL 33870
(863) 385-8242

SCALE: 1/4"=1'-0"	DATE: 11/24/20	REVISED BY:	DRAWN BY: KD
JOB ADDRESS: 1498 TWIN VILLA		1 of 1	
CUSTOMER: D.R. HORTON		JOB #: DR1498	

Engineer of Record for the Structure
Structural Systems of N. Fl, Inc.
Raul Reyes, PE 88925
1634 SE 47th Street #3
Cape Coral, FL 33904

This document has been reviewed for conformance with the design intent of the structure and specified design criteria.

☒ Accepted As-Is ☐ Accepted As Noted ☐ Revise and Resubmit

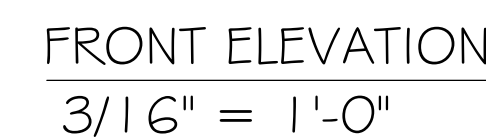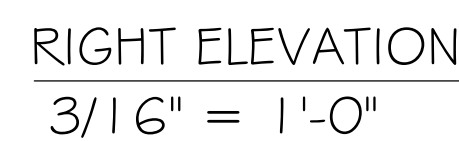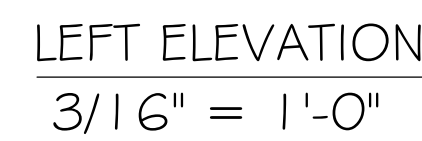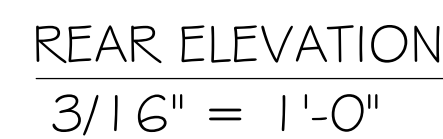

-
- Technical drawings of 12 types of door and window frames, labeled A1 through E3. Each drawing includes dimensions in inches.
- A1:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - A2:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - A3:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - A4:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - B1:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - B2:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - B3:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - B4:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - B5:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - B6:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - B7:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - C1:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - C2:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - C3:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - D1:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - D2:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - D3:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - D4:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - D5:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - E1:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - E2:** Dimensions: 6", 1 1/2", 3", 4", 8".
 - E3:** Dimensions: 6", 1 1/2", 3", 4", 8".

BANDING DETAILS







CODES TO BE USED BY OTHER DESIGN PROFESSIONALS AND LICENSED CONTRACTORS:
2020 FLORIDA BUILDING CODE, 7TH EDITION: RESIDENTIAL; ACCESSIBILITY; ENERGY CONSERVATION;
PLUMBING; MECHANICAL; AND FUEL GAS.
ELECTRICAL IS CONTAINED BY REFERENCE WITHIN FBC RESIDENTIAL CHAPTER 34: NFPA 70-17
NATIONAL ELECTRICAL CODE.

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2020 - 7TH EDITION


This is a multi-page document.
performed structural
engineering only on those
pages which contain my seal,
Raul Reyes, and company
name Structural Systems.


This item has been digitally signed by Raul Reyes on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be validated on any electronic copies.

Y:\O-New Data\1-MASTER 2019\2019-BUILDERS\DR HORTON
2019\SUBDIVISIONS\MAGNOLIA II & III TVS\13346 LOT 91 & 92 1498 EREVIT\13346-
498 E.rvt

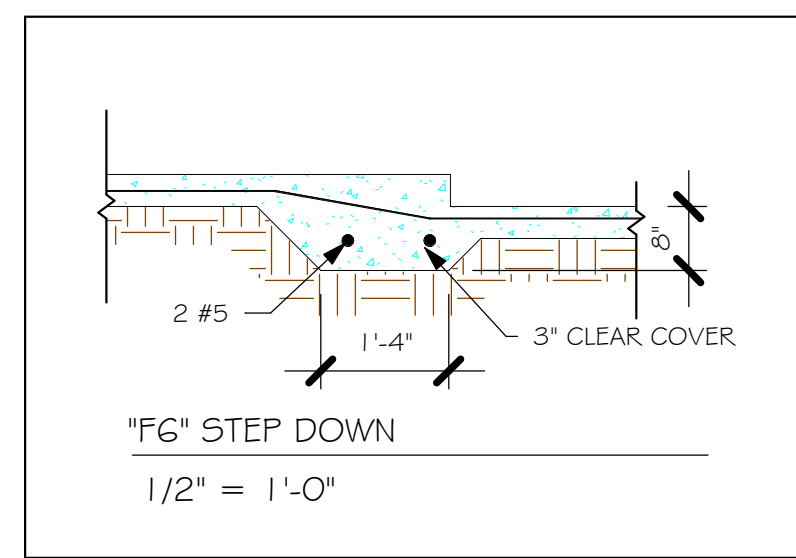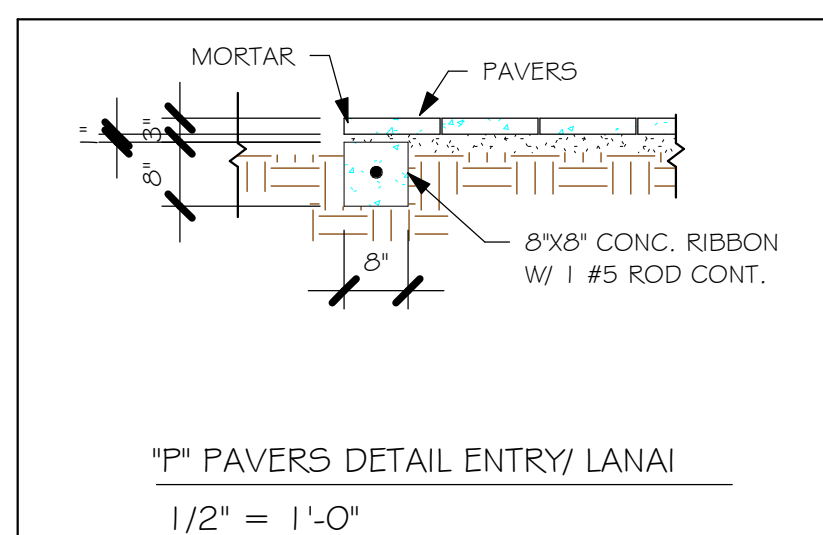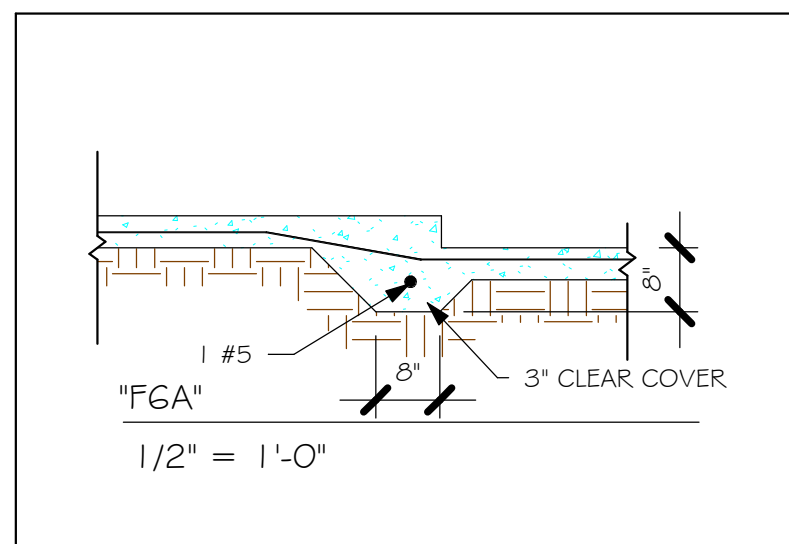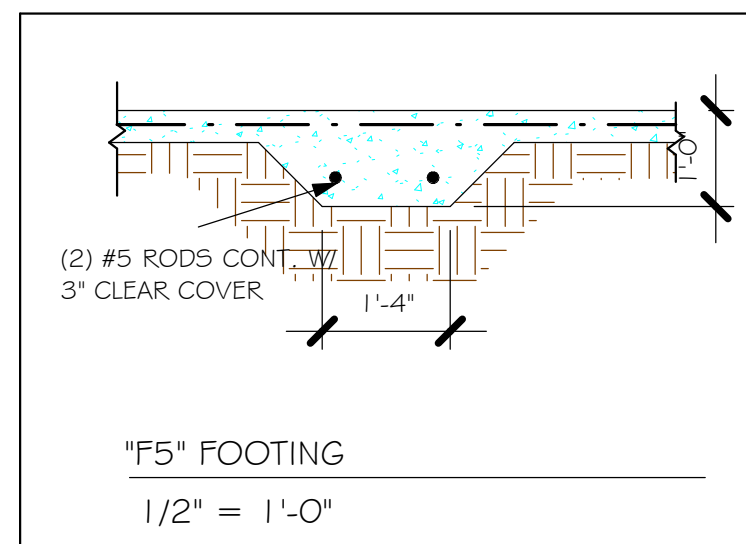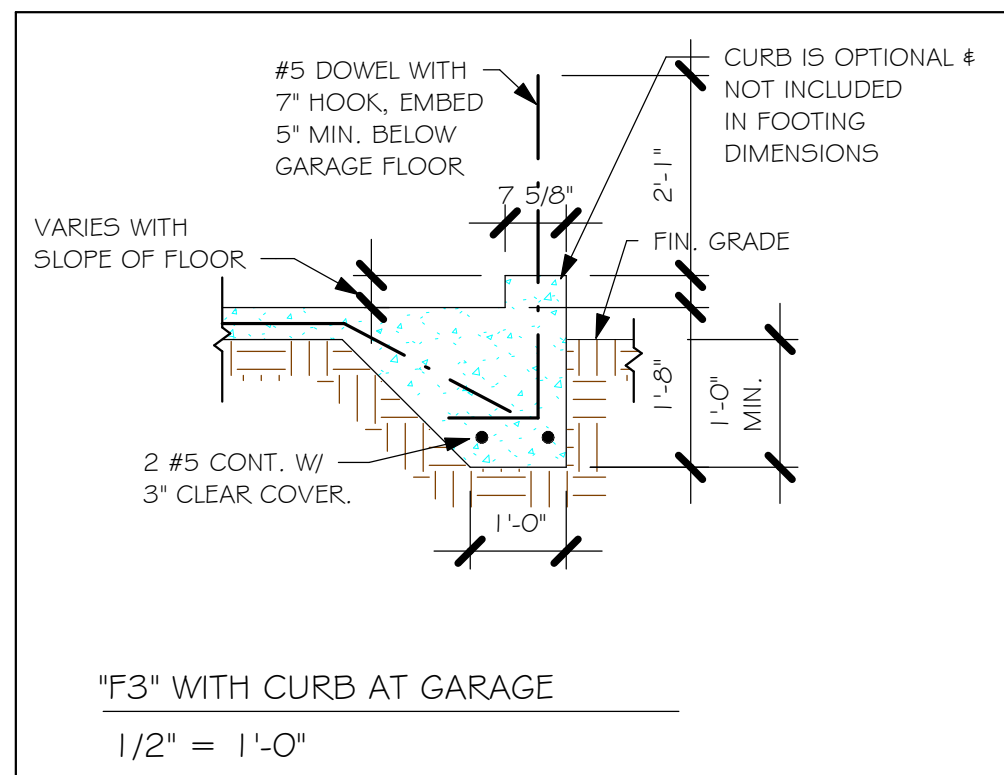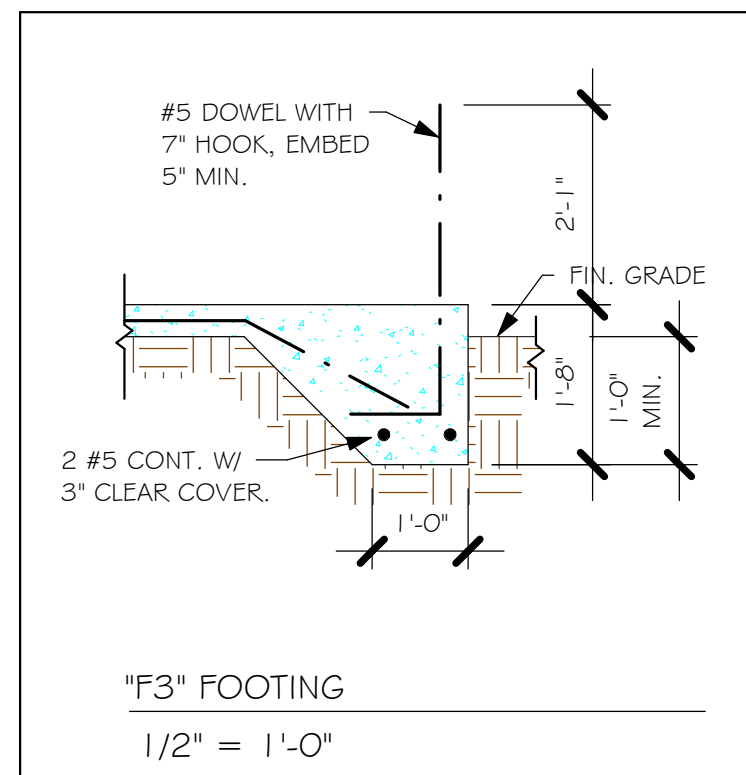

PAD FOOTING SCHEDULE							
USED	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINF.		REMARKS
					LONG WAY	SHORT WAY	
<input checked="" type="checkbox"/>	A	2'-6"	2'-6"	1'-0"	3-#5	3-#5	-
<input checked="" type="checkbox"/>	B	3'-0"	3'-0"	1'-0"	4-#5	4-#5	-
<input checked="" type="checkbox"/>	C	3'-6"	3'-6"	1'-0"	4-#5	4-#5	-
<input checked="" type="checkbox"/>	D	4'-0"	4'-0"	1'-2"	5-#5	5-#5	-
<input checked="" type="checkbox"/>	E	5'-0"	5'-0"	1'-2"	6-#5	6-#5	-

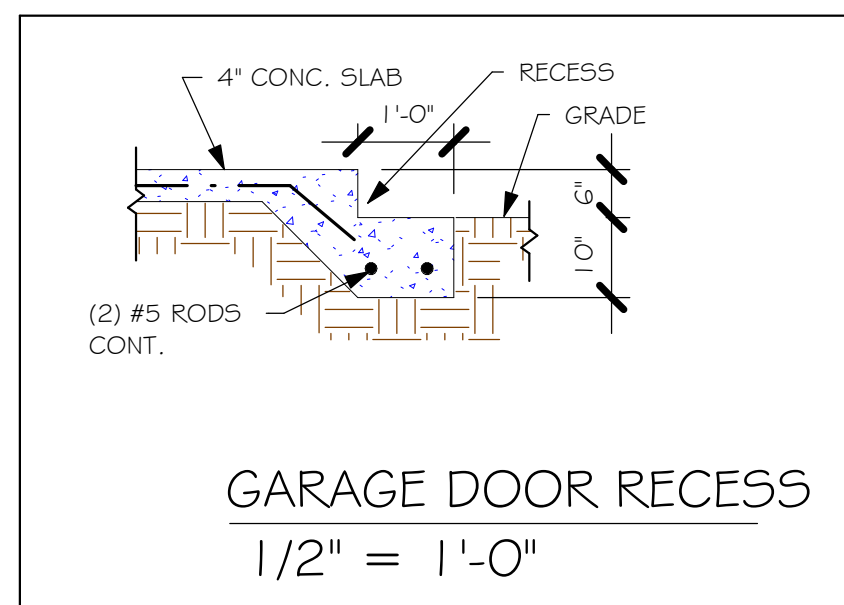

WALL FOOTING SCHEDULE						
UNIT	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINFORCING	SHAPE
	F1	CONT.	1'-4"	0'-8"	2 #5	
	F2	CONT.	1'-8"	0'-10"	2 #5	
	F3	CONT.	1'-0"	1'-8"	2 #5	
	F4	CONT.	1'-4"	1'-8"	2 #5	
	F5	CONT.	1'-4"	1'-0"	2 #5	
	F6	CONT.	1'-4"	1'-0"	2 #5	
	F6A	CONT.	0'-8"	0'-8"	1 #5	
	TE	CONT.	0'-8"	0'-8"	1 #5	


PROVIDE CORNER BARS IN FOOTING PER DETAIL G/S-1

FOUNDATION PLAN

SCALE: 3/16" = 1'-0"

PLAN NOTES:

1. TOP OF GROUND FLOOR SLAB DATUM ELEVATION 0'-0"
2. "F#" DENOTES CONTINUOUS WALL. FOOTING TYPE PER SCHEDULE THIS SHEET.
3. "V#" DENOTES PAD FOOTING AT CONCENTRATED LOADS PER SCHEDULE THIS SHEET.
4. PROVIDE VERTICAL REINFORCING AT DOT LOCATIONS SHOWN ON PLAN FROM FOOTING TO BOND BEAM.
5. ALL DIMENSIONS ARE TO OUTSIDE FACE OF MASONRY WALLS. SOME SLAB EDGES MAY EXTEND BEYOND FACE OF WALL.
6. FOR DIMENSIONS OF ROUGH OPENINGS IN MASONRY WALLS, COORDINATE WITH WINDOW/DOOR SUPPLIER.
7. PROVIDE PRESSURE TREATED BUCKS AT WINDOWS/ DOORS PER DETAIL 7/S-1.

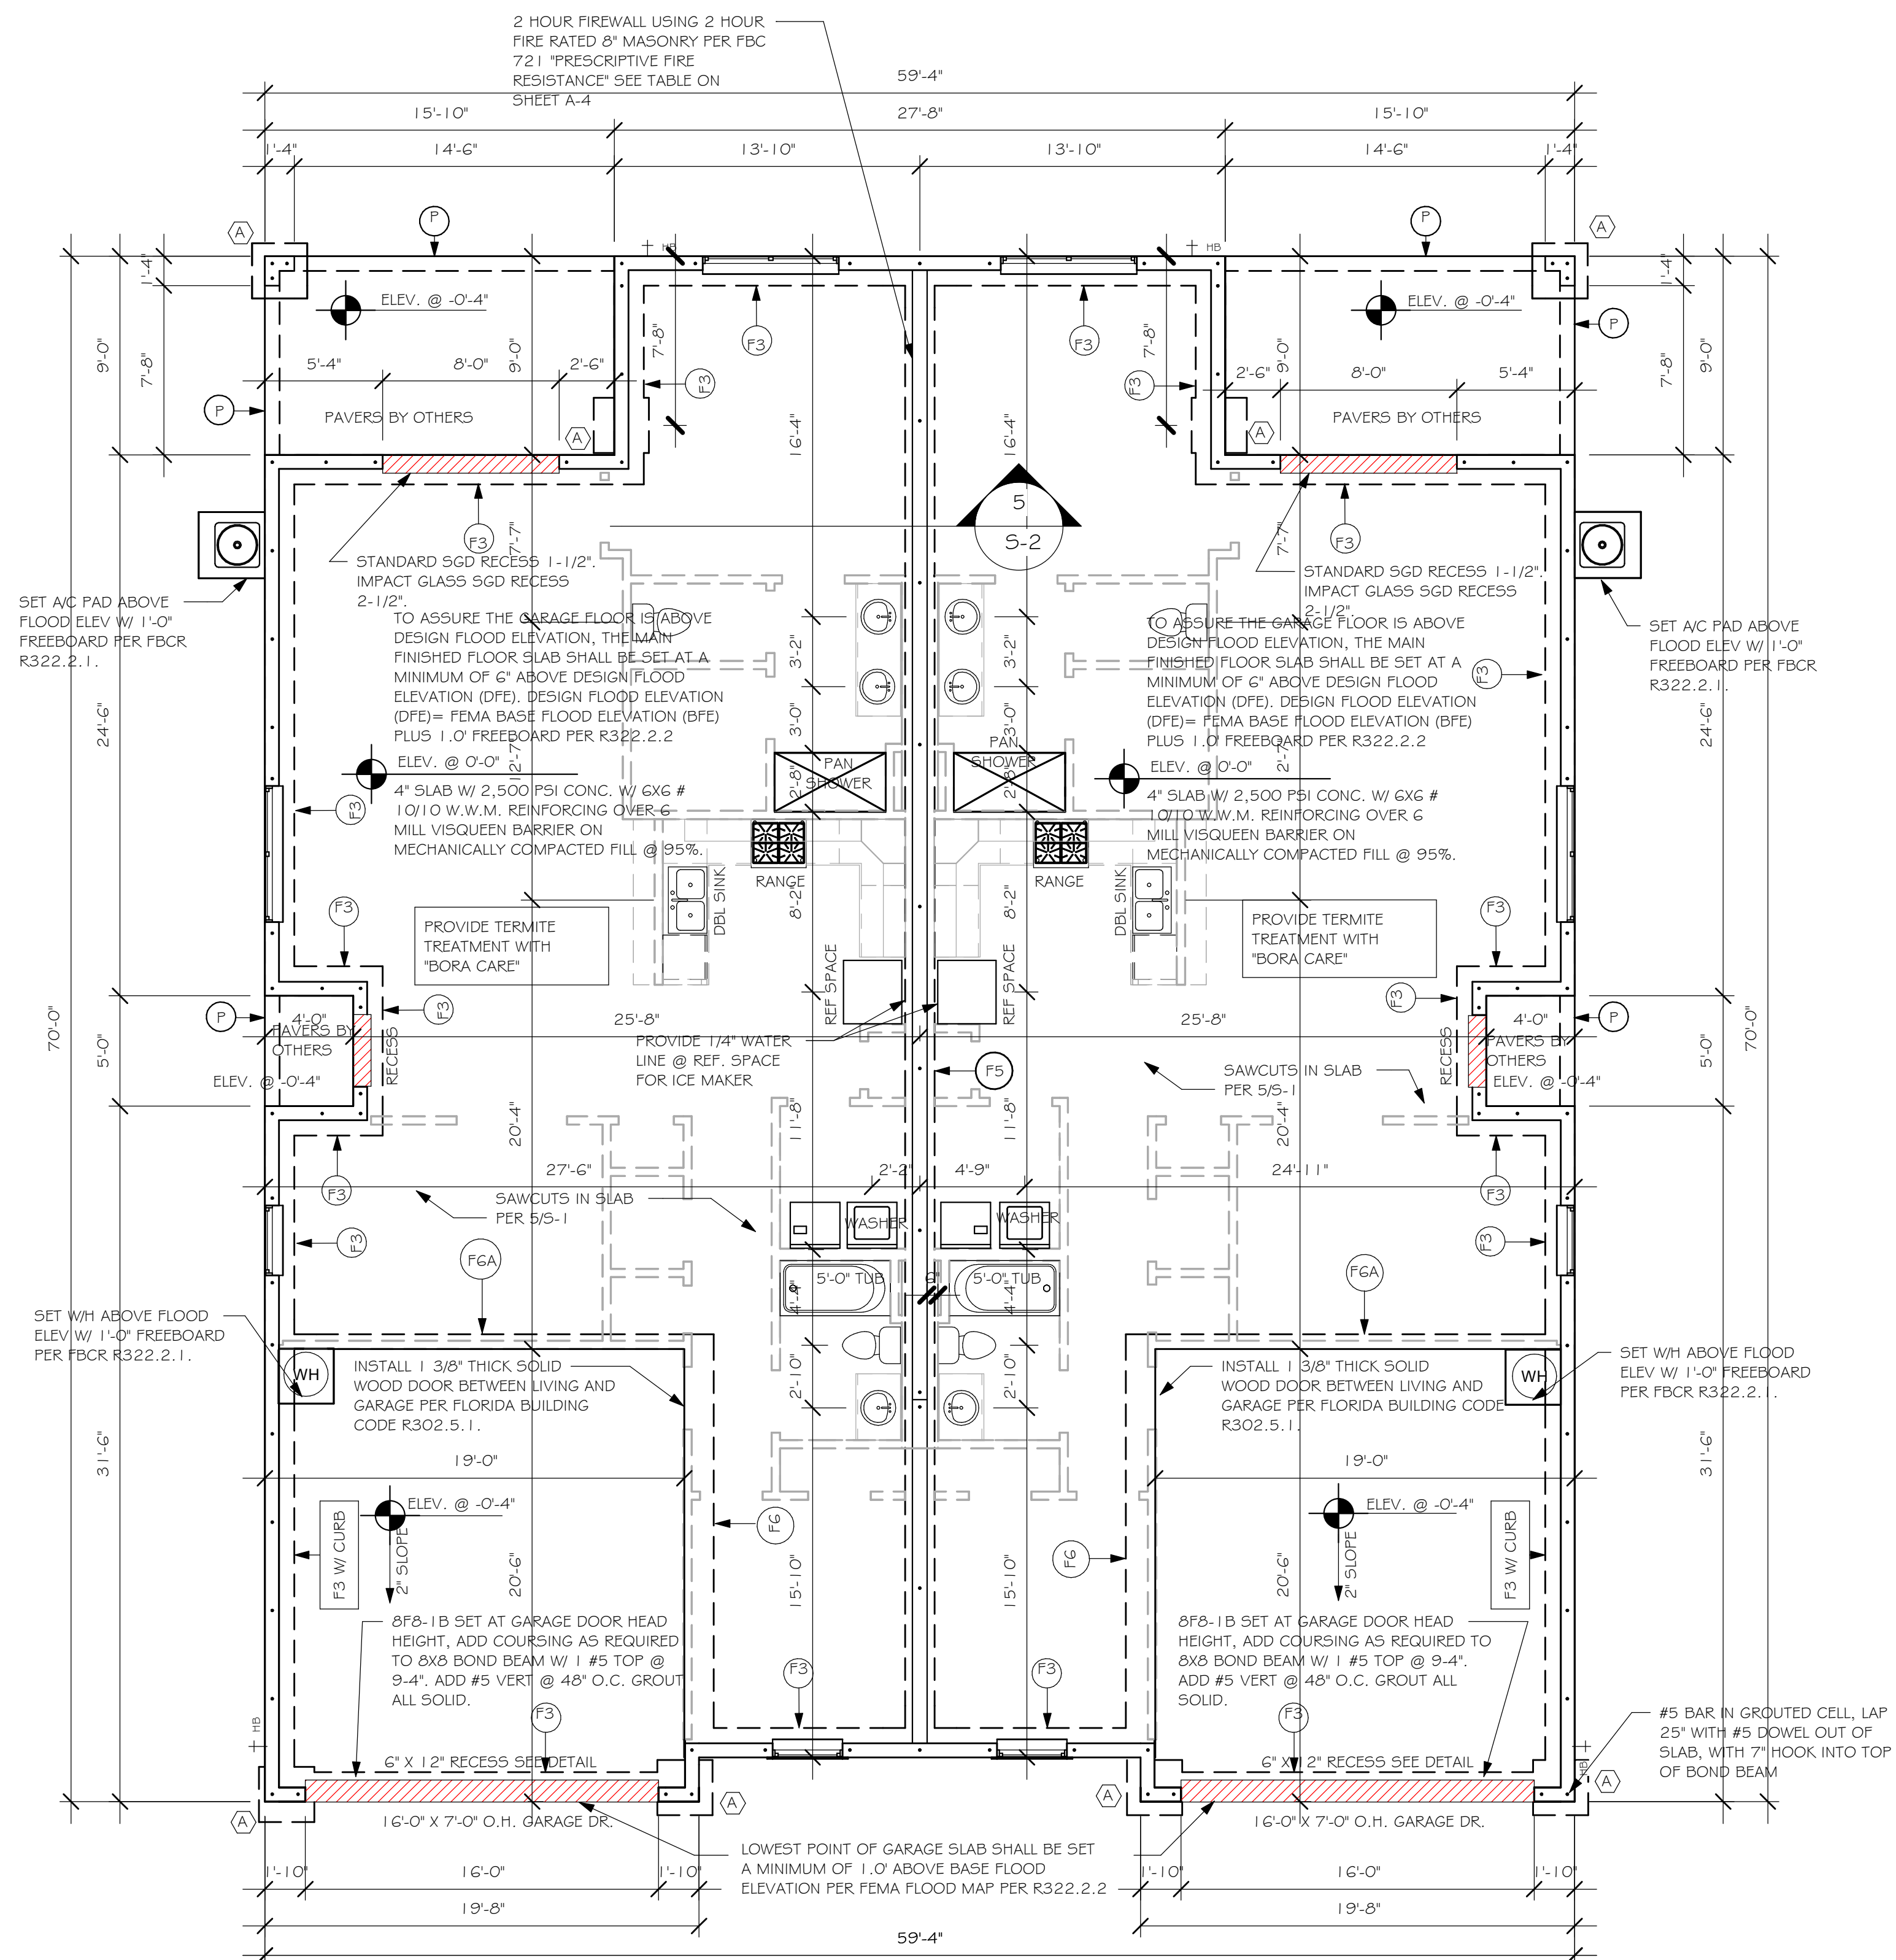

FOUNDATION PLAN

$$\overline{3/16'' = 1'-0''}$$

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2020 - 7TH EDITION

Y:\O-New Data\1 -MASTER 2019\2019-BUILDERS\DR HORTON
2019\5\DIVISIONS\MAGNOLIA II # III TV\5\13346 LOT 91 # 92 1498 E.rvt
1498 E.rvt

DOOR SCHEDULE							
TYPE MARK	DESCRIPTION	MANUFACTURER	HEIGHT	WIDTH	ZONE 4	ZONE 5	QTY
1	16070 OHGD	GARAGE DOOR	7'-0"	16'-0"	+28.2/-31.5	+28.2/-31.5	2
2	2-4080 SL. GL. DR.	DISTINCTION	8'-0"	8'-0"	+29.4/-33.3	+29.4/-33.3	2
3	3068 ENTRY	DISTINCTION	6'-8"	3'-0"	+33.5/-36.3	+33.5/-44.8	2

WINDOW SCHEDULE							
MARK	DESCRIPTION	MANUFACTURER	HEIGHT	WIDTH	ZONE 4	ZONE 5	QTY
A	25 SH		5'-5"	3'-4"	+33.5/-36.3	+33.5/-44.8	4
B	2-25 SH		5'-3"	6'-4"	+33.5/-36.3	+33.5/-44.8	4
C	36" X 12" TRANSOM		1'-0"	3'-0"	+33.5/-36.3	+33.5/-44.8	2

WIND PRESSURES PER ASCE7-16 160 MPH, EXPOSURE C AND CONVERTED TO ALLOWABLE STRESS DESIGN PRESSURES USING 0.6W LOAD FACTOR. V_{asd}= 124 MPH

DOOR HEADERS		
6'-8" BI-FOLD	HEADER HEIGHT	82" A.F.F.
6'-8" SWING	HEADER HEIGHT	82 1/2" A.F.F.
8'-0" SWING	HEADER HEIGHT	98 1/2" A.F.F.

PLAN NOTES	
1)	VERIFY ALL ROUGH OPENING DIMENSIONS FOR ALL WINDOWS AND DOORS
2)	PROVIDE SAFETY GLAZING WITHIN 24" FROM EXIT PER FLORIDA BUILDING CODE R 308.4.2.
3)	PROVIDE SAFETY GLAZING AT BATH/SHOWER PER FLORIDA BUILDING CODE R 308.4.5.
4)	NON BEARING INTERIOR FRAME WALLS SHALL BE FRAMED W/ WOOD OR METAL STUDS. SPACING SHALL NOT EXCEED 24" O.C. (NON BEARING WALLS ONLY)
5)	PROVIDE DEAD WOOD IN ATTIC FOR OVERHEAD GARAGE DOOR HARDWARE
6)	KITCHEN KNEE WALL TO BE FRAMED W/ TOP @ 34 1/2" A.F.F.
7)	INSTALL SMOOTH WALLS IN KITCHEN AND ALL BATHROOM AREAS
8)	WHERE DRYWALL CEILING IS APPLIED TO TRUSSES @ 24" O.C. USE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. R702.3.5
9)	THE GARAGE SHALL BE SEPARATED FROM THE RESIDENCE & ATTIC BY NOT LESS THAN 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE. GARAGES BENEATH HABITABLE ROOMS SHALL BE SEPARATED WITH NOT LESS THAN 5/8" TYPE "X" GYPSUM BOARD OR EQUIVALENT. WHERE THE SEPARATION IS A FLOOR - CEILING ASSEMBLY, THE STRUCTURE SUPPORTING THE SEPARATION SHALL ALSO BE PROTECTED BY NOT LESS THAN 1/2" GYPSOM BOARD OR EQUIVALENT
10)	INSTALL 1 3/8" THICK SOLID WOOD DOOR BETWEEN LIVING AND GARAGE PER FLORIDA BUILDING CODE R302.5.1.
11)	ALL WINDOWS INSTALLED 72" ABOVE GRADE MUST COMPLY WITH R312.2 MIN 24" SILL HEIGHT OR PROVIDED WITH AN APPROVED WINDOW FALL PREVENTION DEVICE
12)	ALL CLOSET SHELVES TO BE 12". ALL PANTRY & LINEN TO BE (4)-16" SHELVES 18" O.F.F. W/ 15" INCREMENT.
13)	ALL MECHANICAL AND ELECTRICAL EQUIPMENT TO BE INSTALLED AT OR ABOVE FLOOD PLUS 1'-0" FREEBOARD.




CABINET BACKING		
KITCHEN	UPPER TOP @ 84"	BASE TOP @ 35"
MASTER BATH	UPPER	BASE TOP @ 35"
GUEST BATH	UPPER	BASE TOP @ 31"
LAUNDRY ROOM	UPPER TOP @ 84"	BASE

INTERIOR DOOR SCHEDULE		
MARK	DOOR WIDTH	NOTES
1	3'-0"	P.K. = POCKET DOOR
2	2'-8"	B.F. = BI-FOLD DOOR
3	2'-6"	
4	2'-4"	B.P. = BI-PASS DOOR
5	2'-0"	
6	1'-8"	L.V. = LOUVERED DOOR
7	1'-6"	
8	2'-1 1/4"	

SQUARE FOOTAGE UNIT #1	
LIVING AREA	1,503
GARAGE AREA	391
LANAI AREA	143
FRONT PORCH/ ENTRY AREA	20
TOTAL SQUARE FOOTAGE	2,057

SQUARE FOOTAGE UNIT #2	
LIVING AREA	1,503
GARAGE AREA	391
LANAI AREA	143
FRONT PORCH/ ENTRY AREA	20
TOTAL SQUARE FOOTAGE	2,057

BATHROOM NOTES	
TB TOWEL BAR	ALL TUB DECKS @ 21" A.F.F
TP TOILET PAPER	ALL BLOCKING TO BE PT IN SHOWERS

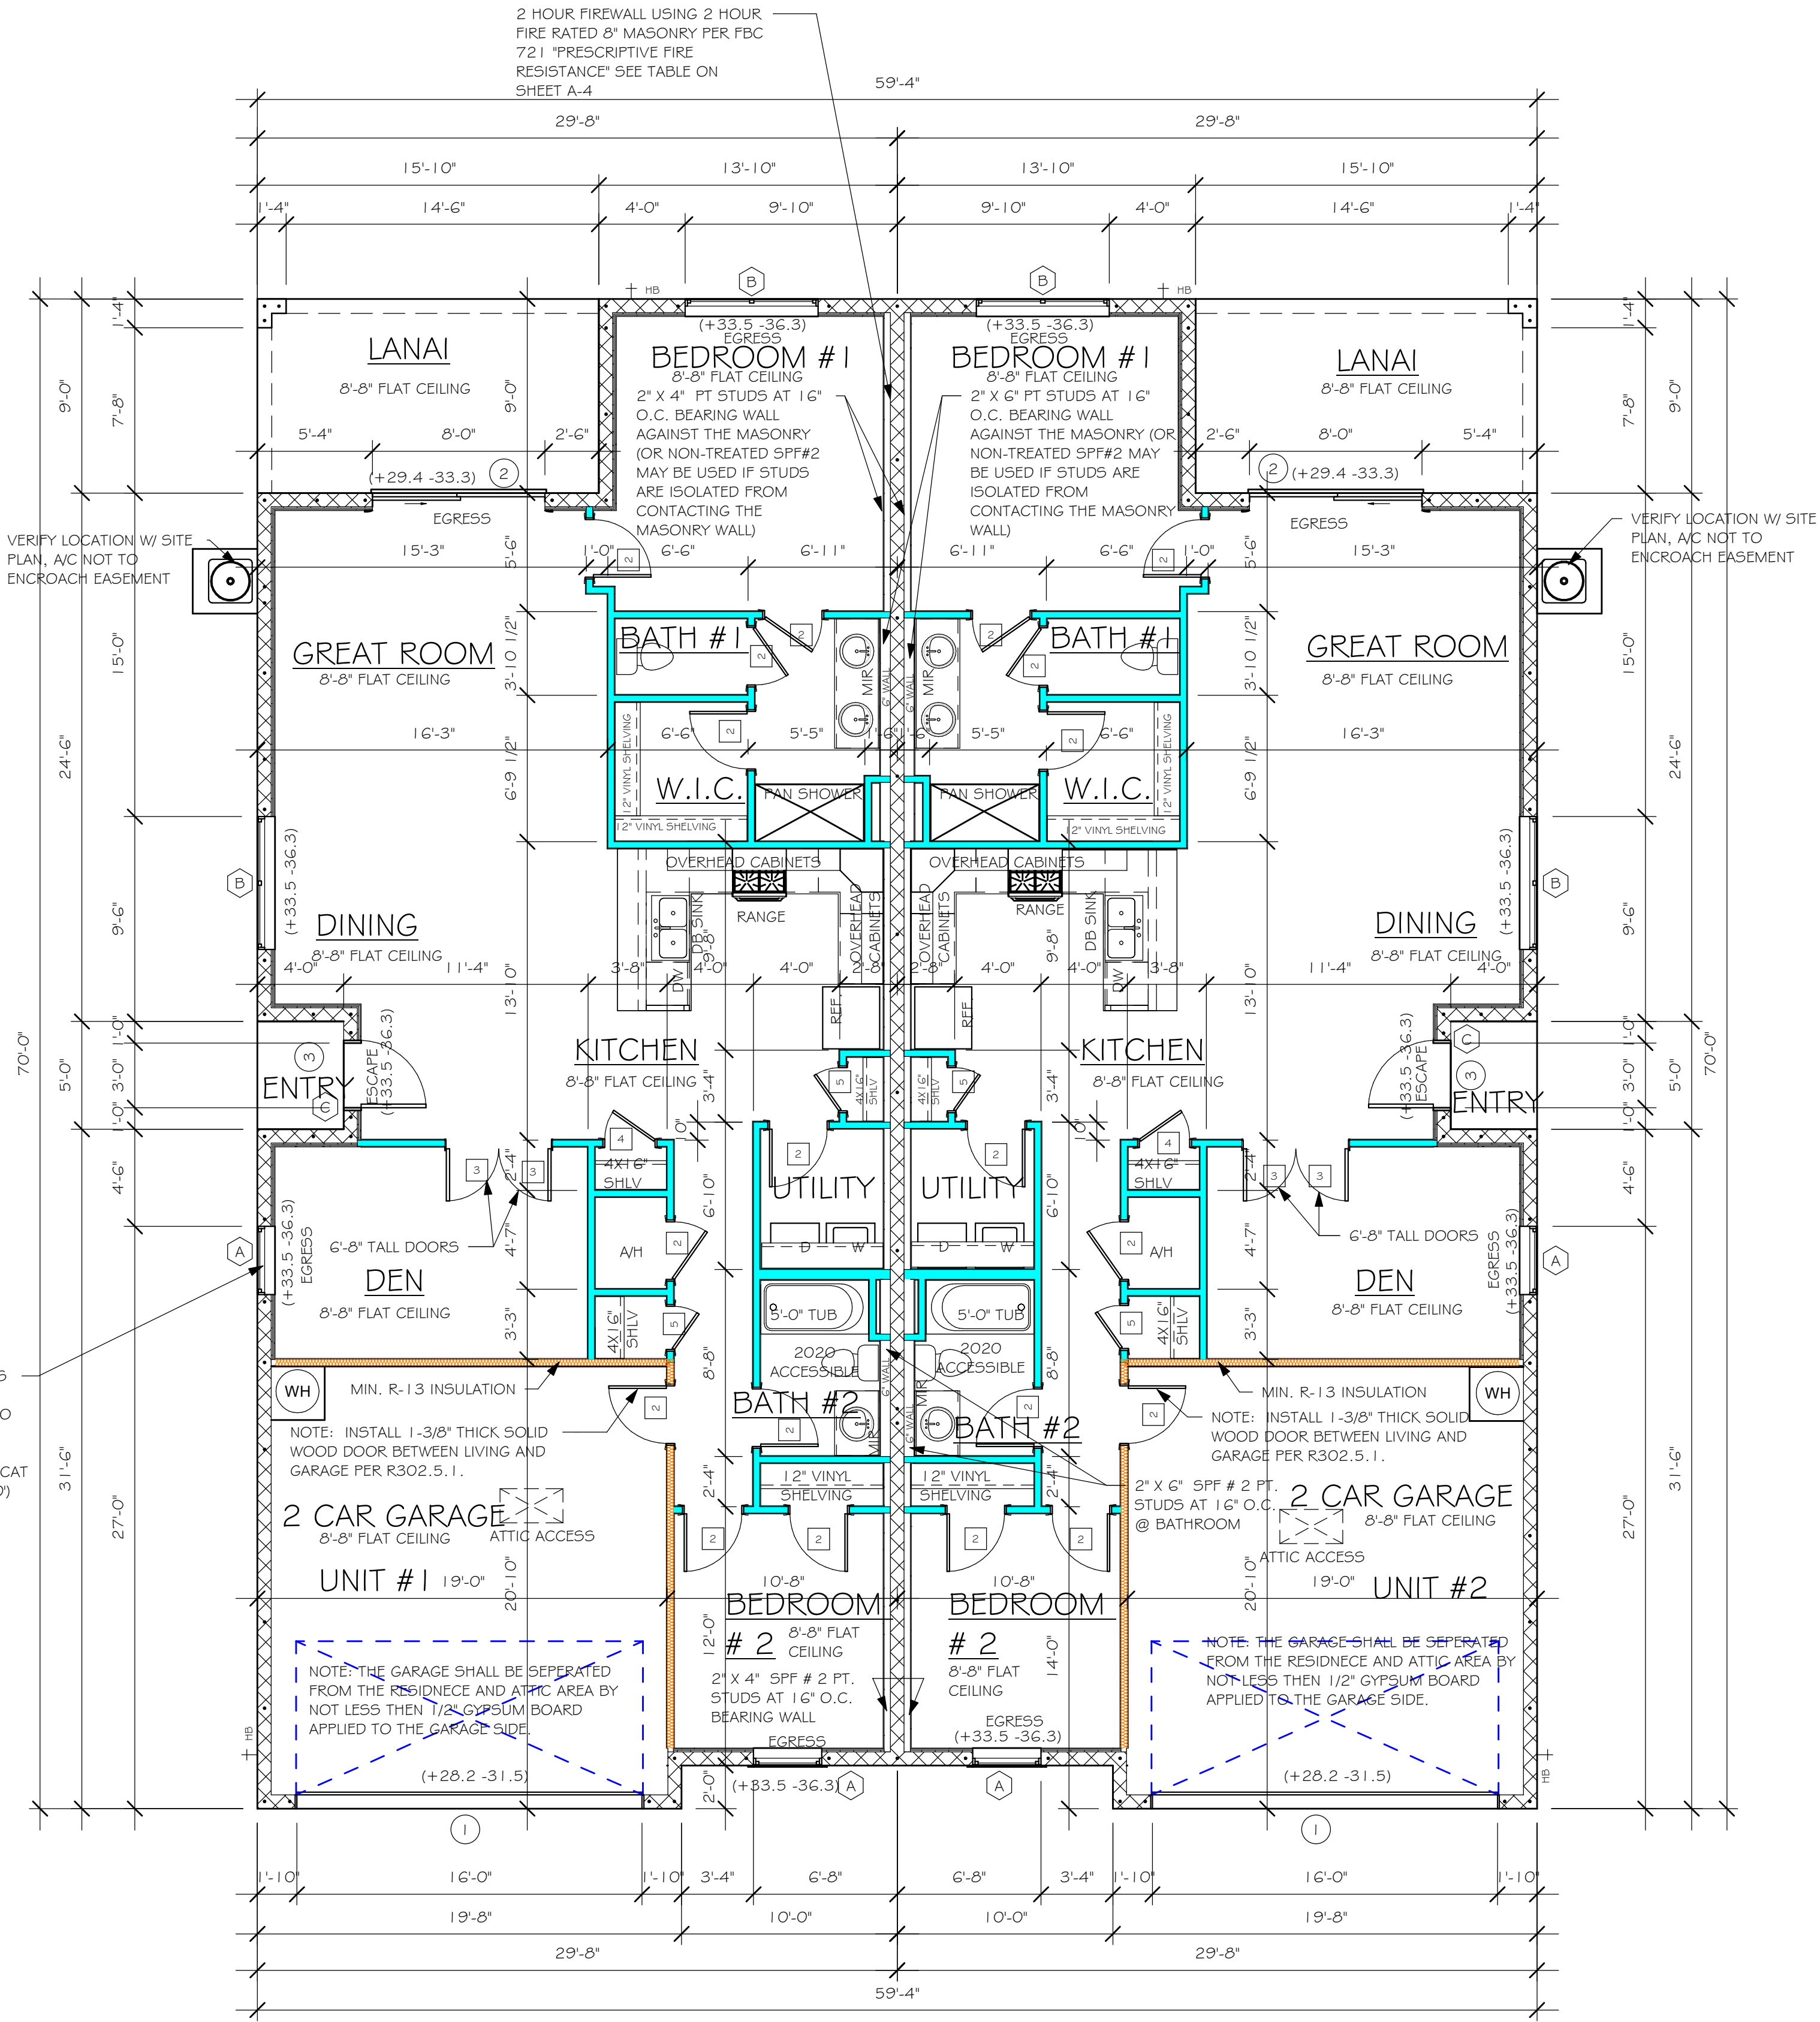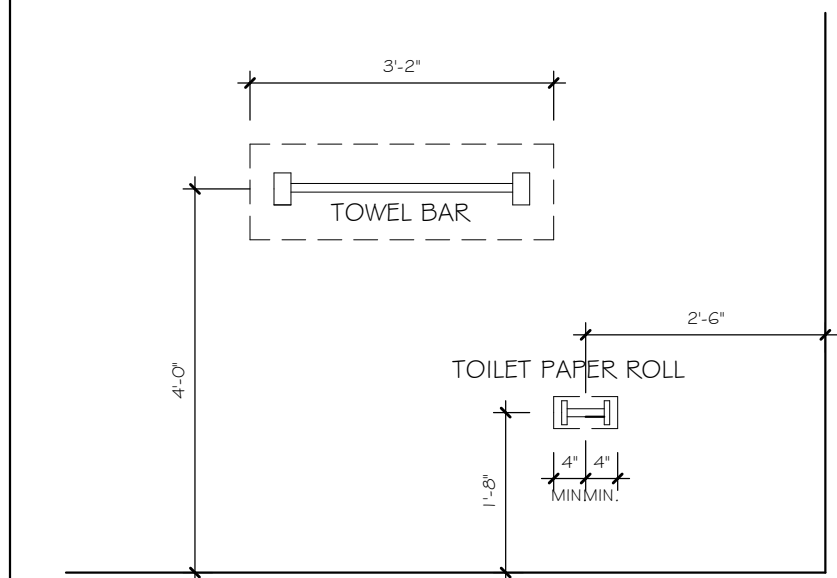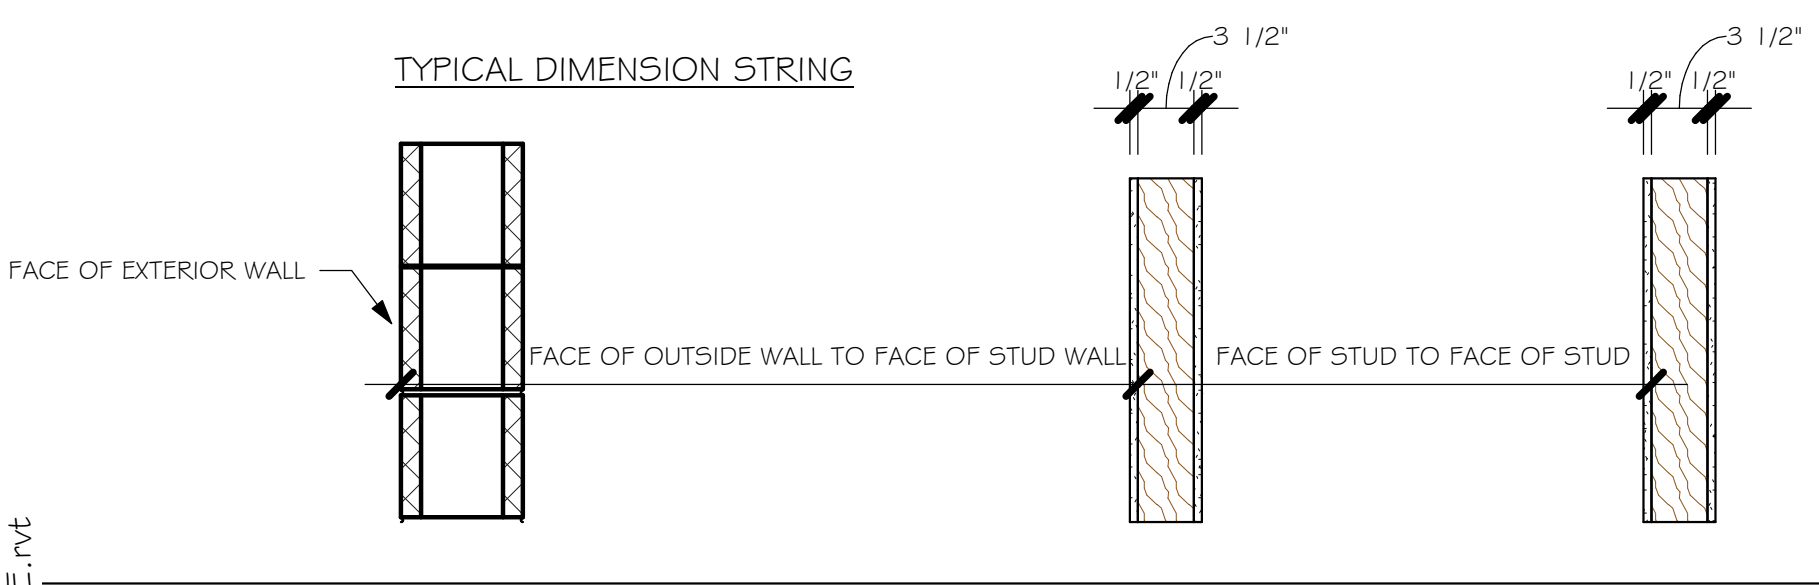

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2020 - 7TH EDITION



LOT: 91, 92
SUBDIVISION: MAGNOLIA III TV's
ADDRESS: 20571, 20567 PLUMWOOD LOOP
D.R.H. #: 579900091, 092

MODEL 1498
VILLA E

DATE: 8/26/21
DRAWN BY: CWL
CHECKED BY: JWC
REVISED:
PLAN: FLOOR
SCALE: As indicated

A-3



Y:\O-New Data\1-MASTER 2019\2019-BUILDERS\DR HORTON
2019\5\BID\VISIONS\MAGNOLIA 1 & III TV\5\13346 LOT 91 & 92 1498 EREV\13346
1498 EREV

TRUSS STRAPPING TO MASONRY		
MAX TRUSS UPLIFT (LBS)	STRAP/ANCHOR Valid lengths x/y/z	FASTENER
INSTALL META 1 G AT ALL TRUSSES TO 1450 lb UPLIFT, FOR HIGHER UPLIFTS, SEE NOTES ON PLAN.	(1) META 1 G/18/20 (1) META 1 G/20 (2) META 1 G/18/20 (2) META 1 G/20 (2) META 1 G/18/20 (2) META 1 G/20 MG HTT4 HTT4 HTT5 HTT5 HTT5KT (1) HGT - 2 (1) HGT - 3	(8) 0.148x1-1/2", EMBED 4" (9) 0.148x1-1/2", EMBED 4" (10) 0.148x1-1/2", EMBED 4" (10) 0.148x1-1/2", EMBED 4" (14) 0.162x3-1/2", EMBED 4" (12) 0.162x3-1/2", EMBED 4" (22) 0.148x3" ATR, EPOXY 12" (18) 0.148x1-1/2", 5/8" ATR, EPOXY 12" (18) 0.162x2-1/2", 5/8" ATR, EPOXY 12" (26) 5D#10x1-1/2", 5/8" ATR, EPOXY 12" (26) 0.148x3", 5/8" ATR, EPOXY 12" (26) 5D#10x2-1/2", 5/8" ATR, EPOXY 18" (16) 0.148x3", (2) 3/4" ATR, EPOXY 12" (16) 0.148x3", (2) 3/4" ATR, EPOXY 12"

NOTES:

- PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE AND SUITABLE FOR THE GEOMETRY. EMBED STRAP ON CENTERLINE OF WALL.
- ANY OF THE VALID LENGTHS SHOWN MAY BE USED IN PLACE OF THE LENGTH SPECIFIED ON PLAN. CONNECTORS ARE SIMPSON STRONG TIE. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS. SUBSTITUTIONS MUST BE APPROVED IN WRITING BY THE ENGINEER OF RECORD.
- WHERE EMBEDDED STRAPS ARE MISSING, OR MIS-LOCATED, INSTALL RETROFIT STRAP PER 10/5-3. PER UPLIFT IN TRUSS ENGINEERING.

SIMPSON CATALOG C-C- 2019

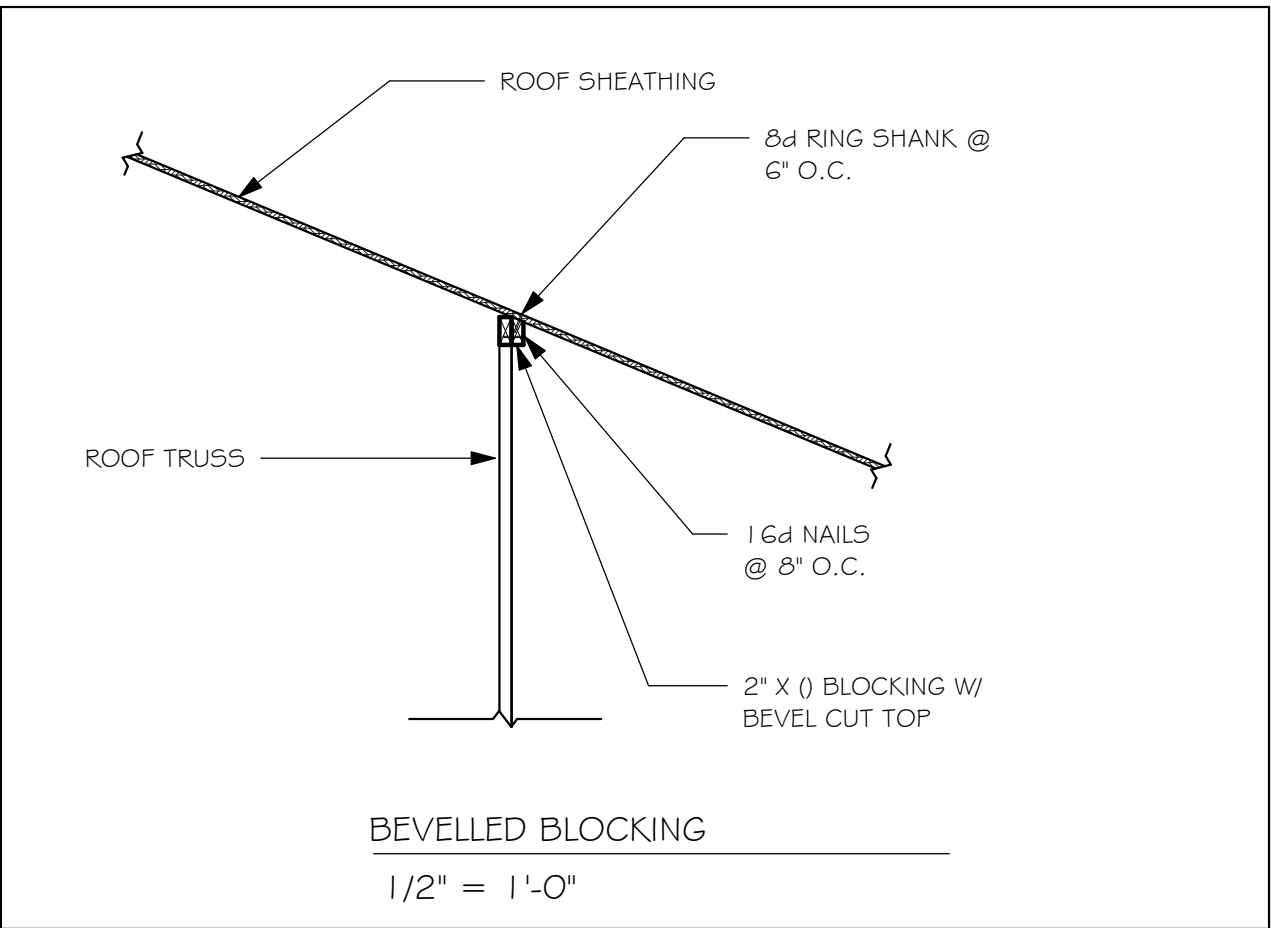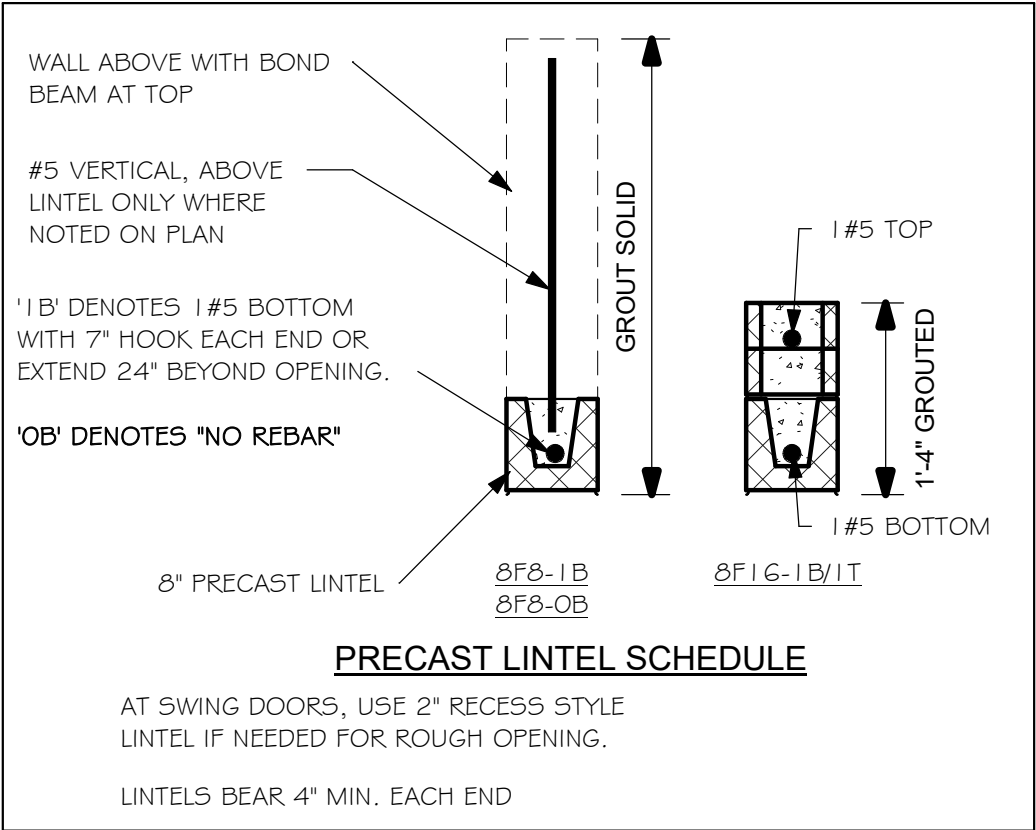

- PLAN NOTES:
- ROOF TRUSS BEARING ELEVATION VARIES, SEE LEGEND.
 - ROOF FRAMING SHALL BE WOOD TRUSSES DESIGNED BY A DELEGATED TRUSS ENGINEER PER DESIGN CRITERIA ON SHEET S-1.
 - PROVIDE STRAPPING AT TRUSSES PER NOTES ON THIS SHEET.
 - FOR NAILING OF ROOF DECK, SEE 1 AND 2 ON S-1.
 - 8F8-1B etc., DENOTES PRECAST LINTEL ABOVE DOOR/WINDOW OPENING PER SCHEDULE THIS SHEET.
 - AT TRUSS BEARING, PROVIDE 8x8 MASONRY BOND BEAM W/ 1#5 CONTINUOUS, SEE DETAIL 11/25-1.

2 HOUR FIREWALL USING 8" MASONRY PER FBC 721 "PRESCRIPTIVE FIRE RESISTANCE"		
F.B.C. TABLE 722.3.2		
MINIMUM EQUIVALENT THICKNESS' (IN) BEARING OR NON-BEARING CONCRETE MASONRY WALLS		
TYPE OF AGGREGATE	FIRE - RESISTANCE RATING (HOURS)	
1. PUMICE OR EXPANDED SLAG	3.2'	HR
2. EXPANDED SHALE, CLAY OR SLATE	3.6'	
3. LIMESTONE, CINDERS, OR UNEXPANDED SLAG	4.0'	
4. CALCREOUS OR SILICEOUS GRAVEL	4.2'	
FOR THE 2 HOUR FIREWALL, PURCHASE ONLY BLOCK WITH 2 HOUR FIRE RATED MARKING, LABEL OR DOCUMENTATION.		

TRUSS STRAPPING TO STUDWALL/ WOOD BEAM			
MAX TRUSS UPLIFT (LBS)	STRAP(S) Valid lengths x/y/z	FASTENER	
850	(1) MTS1 G/20/30	(14) 0.148x1-1/2" or 3" EACH STRAP	
1700	(2) MTS1 G/20/30		
2550	(3) MTS1 G/20/30		
1125	(1) HTS20/24/30	(24) 0.148x1-1/2" OR	
2250	(2) HTS20/24/30	(20) 0.148x3" EACH STRAP	
3375	(3) HTS20/24/30		
4500	(4) HTS20/24/30		

NOTES:



- PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE.
- ANY OF THE VALID LENGTHS SHOWN MAY BE USED IN PLACE OF THE LENGTH SPECIFIED ON PLAN.
- 1-1/2" NAIL SHALL BE USED IN 1 PLY LUMBER, 2 PLY LUMBER IS REQUIRED FOR 3" NAILS.
- CONNECTORS ARE SIMPSON STRONG TIE. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS. SIMPSON CATALOG C-C- 2019

MODEL 1498: ATTIC VENTILATION FBCR R80G

SOFFIT ONLY (1/150) (NO ROOF VENTS)		WITH ROOF VENTS (1/300) (R.V.)	
AREAS (SQ. FT.)	ATTIC VENTILATION REQUIRED (ATTIC AREA/150 = 14.55 SQ. FT.)	QUANTITY OF ROOF VENTS	MIN AIR FLOW OF SOFFIT
MARK	ATTIC	SOFFIT	REC'D AIR FLOW OF SOFFIT
(1)	2183.0 SQ. FT.	148.0 SQ. FT.	9.83%
			0.15%
"SOFFIT ONLY" DOES NOT QUALIFY		ROOF VENTS ARE REQUIRED	
SOFFIT MODEL		ROOF VENT MODEL	
ACM QUAD 4, FULL VENT, NARROW PATTERN, 8.15% FREE AIR FLOW		LOMANCO 770-D 0.97 SQ. FT. FREE AIR	

FIRE RESISTANCE RATINGS - ANSI/UL 263 (BXUV)

Design No. U301	Bearing Wall Rating 2 HR.	Finish Rating 66 Min.
1. Nailheads - Exposed or covered with joint finisher. 2. Joints - Exposed or covered with fiber tape and joint finisher. As an alternate, nominal 3/32 in. thick gypsum veneer plaster may be applied to the entire surface of classified veneer baseboard. Joints reinforced. 3. Nails - 6d cement coated nails 1-7/8 in. long, 0.0915 in. shank diam, 1/4 in. diam heads, and 8d cement coated nails 2-3/8 in. long, 0.113 in. shank diam, 9/32 in. diam heads. 4. Gypsum Board - 5/8 in. thick, two layers applied either horizontally or vertically. Inner layer attached to studs with the 1-7/8 in. nails spaced 16" o.c. Outer layer attached to studs over inner layer with the 2-3/8 in. long nails spaced 8" o.c. Vertical joints located over studs. All joints in face layers staggered with joints in base layers. Joints of each base layer offset with joints of base layer on opposite side. When used in widths other than 48 in., gypsum board to be installed horizontally. When Steel Framing Members* (Item 6) are used, base layer attached to furring channels with 1 in. long Type S bugle-head steel screws spaced max. 24 in. o.c.; face layer attached with 1-5/8 in. long Type S bugle-head steel screws spaced max. 12 in. o.c. AMERICAN GYPSUM CO - Types AG-C, AGX-11, AGX-C BELING NEW BUILDING MATERIALS CO LTD - Type DBX-1 CERTANTEED GYPSUM, INC. - Types FRPC, EGRG, ProRoC Type C or ProRoC Type X CANADIAN GYPSUM COMPANY - Types AR, C, IP-AR, IP-X1, IP-X2, IPC-AR, SCX, SHX, WRG, WRX G-P GYPSUM CORP. SUB OF GEORGIA-PACIFIC CORP - Types 5, 9, C, DAP, DD, DA, DGG, DS, GPF58, LA-FARGE NORTH AMERICA INC - Types LGFC-C, LGFC2, LGFC2A, LGFCB, LGFCBA, LGFC-CA NATIONAL GYPSUM CO - Types FSK, FSK-C, FSK-G, FSW, FSW-3, FSW-C, FSW-G PABCO GYPSUM, DIV OF PACIFIC COAST BUILDING PRODUCTS INC - Types C, PG-2, PG-3, PG-3W, PG-4, PG-5, PG-5W, PG-5WS, PG-9 or PG-C TEMPLE-INLAND FOREST PRODUCTS CORP - Type TG-C SIAM GYPSUM INDUSTRY (SARABURI) CO LTD - Type EX-1 STANDARD GYPSUM L.L.C. - Types SSC, SG-C or SG-C-2 UNITED STATES GYPSUM CO - Types AR, C, FRX-G, IP-AR, IP-X1, IP-X2, IPC-AR, SCX, SHX, WRG, WRX USG MEXICO S A DE C V - Types AR, C, IP-AR, IP-X1, IP-X2, IPC-AR, SCX, SHX, WRG, WRX 44. Gypsum Board* - (As an alternate to Item 4) - Nom. 3/4 in. thick, installed as described in Item 4 CANADIAN GYPSUM COMPANY - Types AR, IP-AR UNITED STATES GYPSUM CO - Types AR, IP-AR USG MEXICO S A DE C V - Types AR, IP-AR 48. Gypsum Board* - (As an alternate to Items 4 and 44) - 5/8 in. thick, 2 ft. wide, tongue and groove edge, applied horizontally as the outer layer to one side of the assembly. Secured as described in Item 4. Joint covering (Item 2) not required. CANADIAN GYPSUM COMPANY - Types SHX UNITED STATES GYPSUM CO - Types SHX USG MEXICO S A DE C V - Types SHX 5. Molded Plastic* - Not shown. Optional - Solid vinyl siding mechanically secured over the outer layer to framing members in accordance with manufacturer's recommended installation details. ASSOCIATED MATERIALS INC ALSID, DIV OF GENTEX BUILDING PRODUCTS LTD HEARTLAND BUILDING PRODUCTS INC VYTEC CORP. NEBRASKA PLASTICS INC 6. Steel Framing Members - (Optional, Not shown)* - Furring channels and resilient sound isolation clip as described below: A. Furring Channels - Formed of No. 25 MSG galv. steel, 2-3/8 in. wide by 7/8 in. deep, spaced 24 in. o.c. perpendicular to studs. Channels secured to studs as described in Item 8. Ends of adjoining channels are overlapped 6 in. and tied together with double strand of No. 18 SWG galv. steel wire near each end of overlap. As an alternate, ends of adjoining channels may be overlapped 6 in. and secured together with two self-lapping #6 framing screws, min. 7/16 in. long at the midpoint of the overlap, with one screw on each flange of the channel. Wallboard attached to furring channels as described in Item 4. B. Steel Framing Members* - Resilient sound isolation clip used to attach furring channels (Item 6A) to studs. Clips spaced 48 in. o.c. and secured to studs with No. 8 x 2-1/2 in. coarse drywall screw through the center grommet. Furring channels are friction fitted into clips. PAC INTERNATIONAL INC - Type RSIC-1. *Bearing the UL Classification Mark		

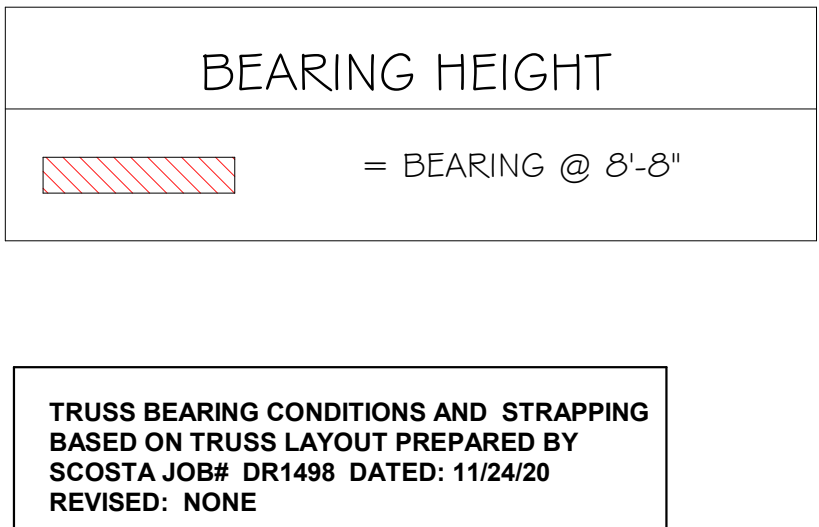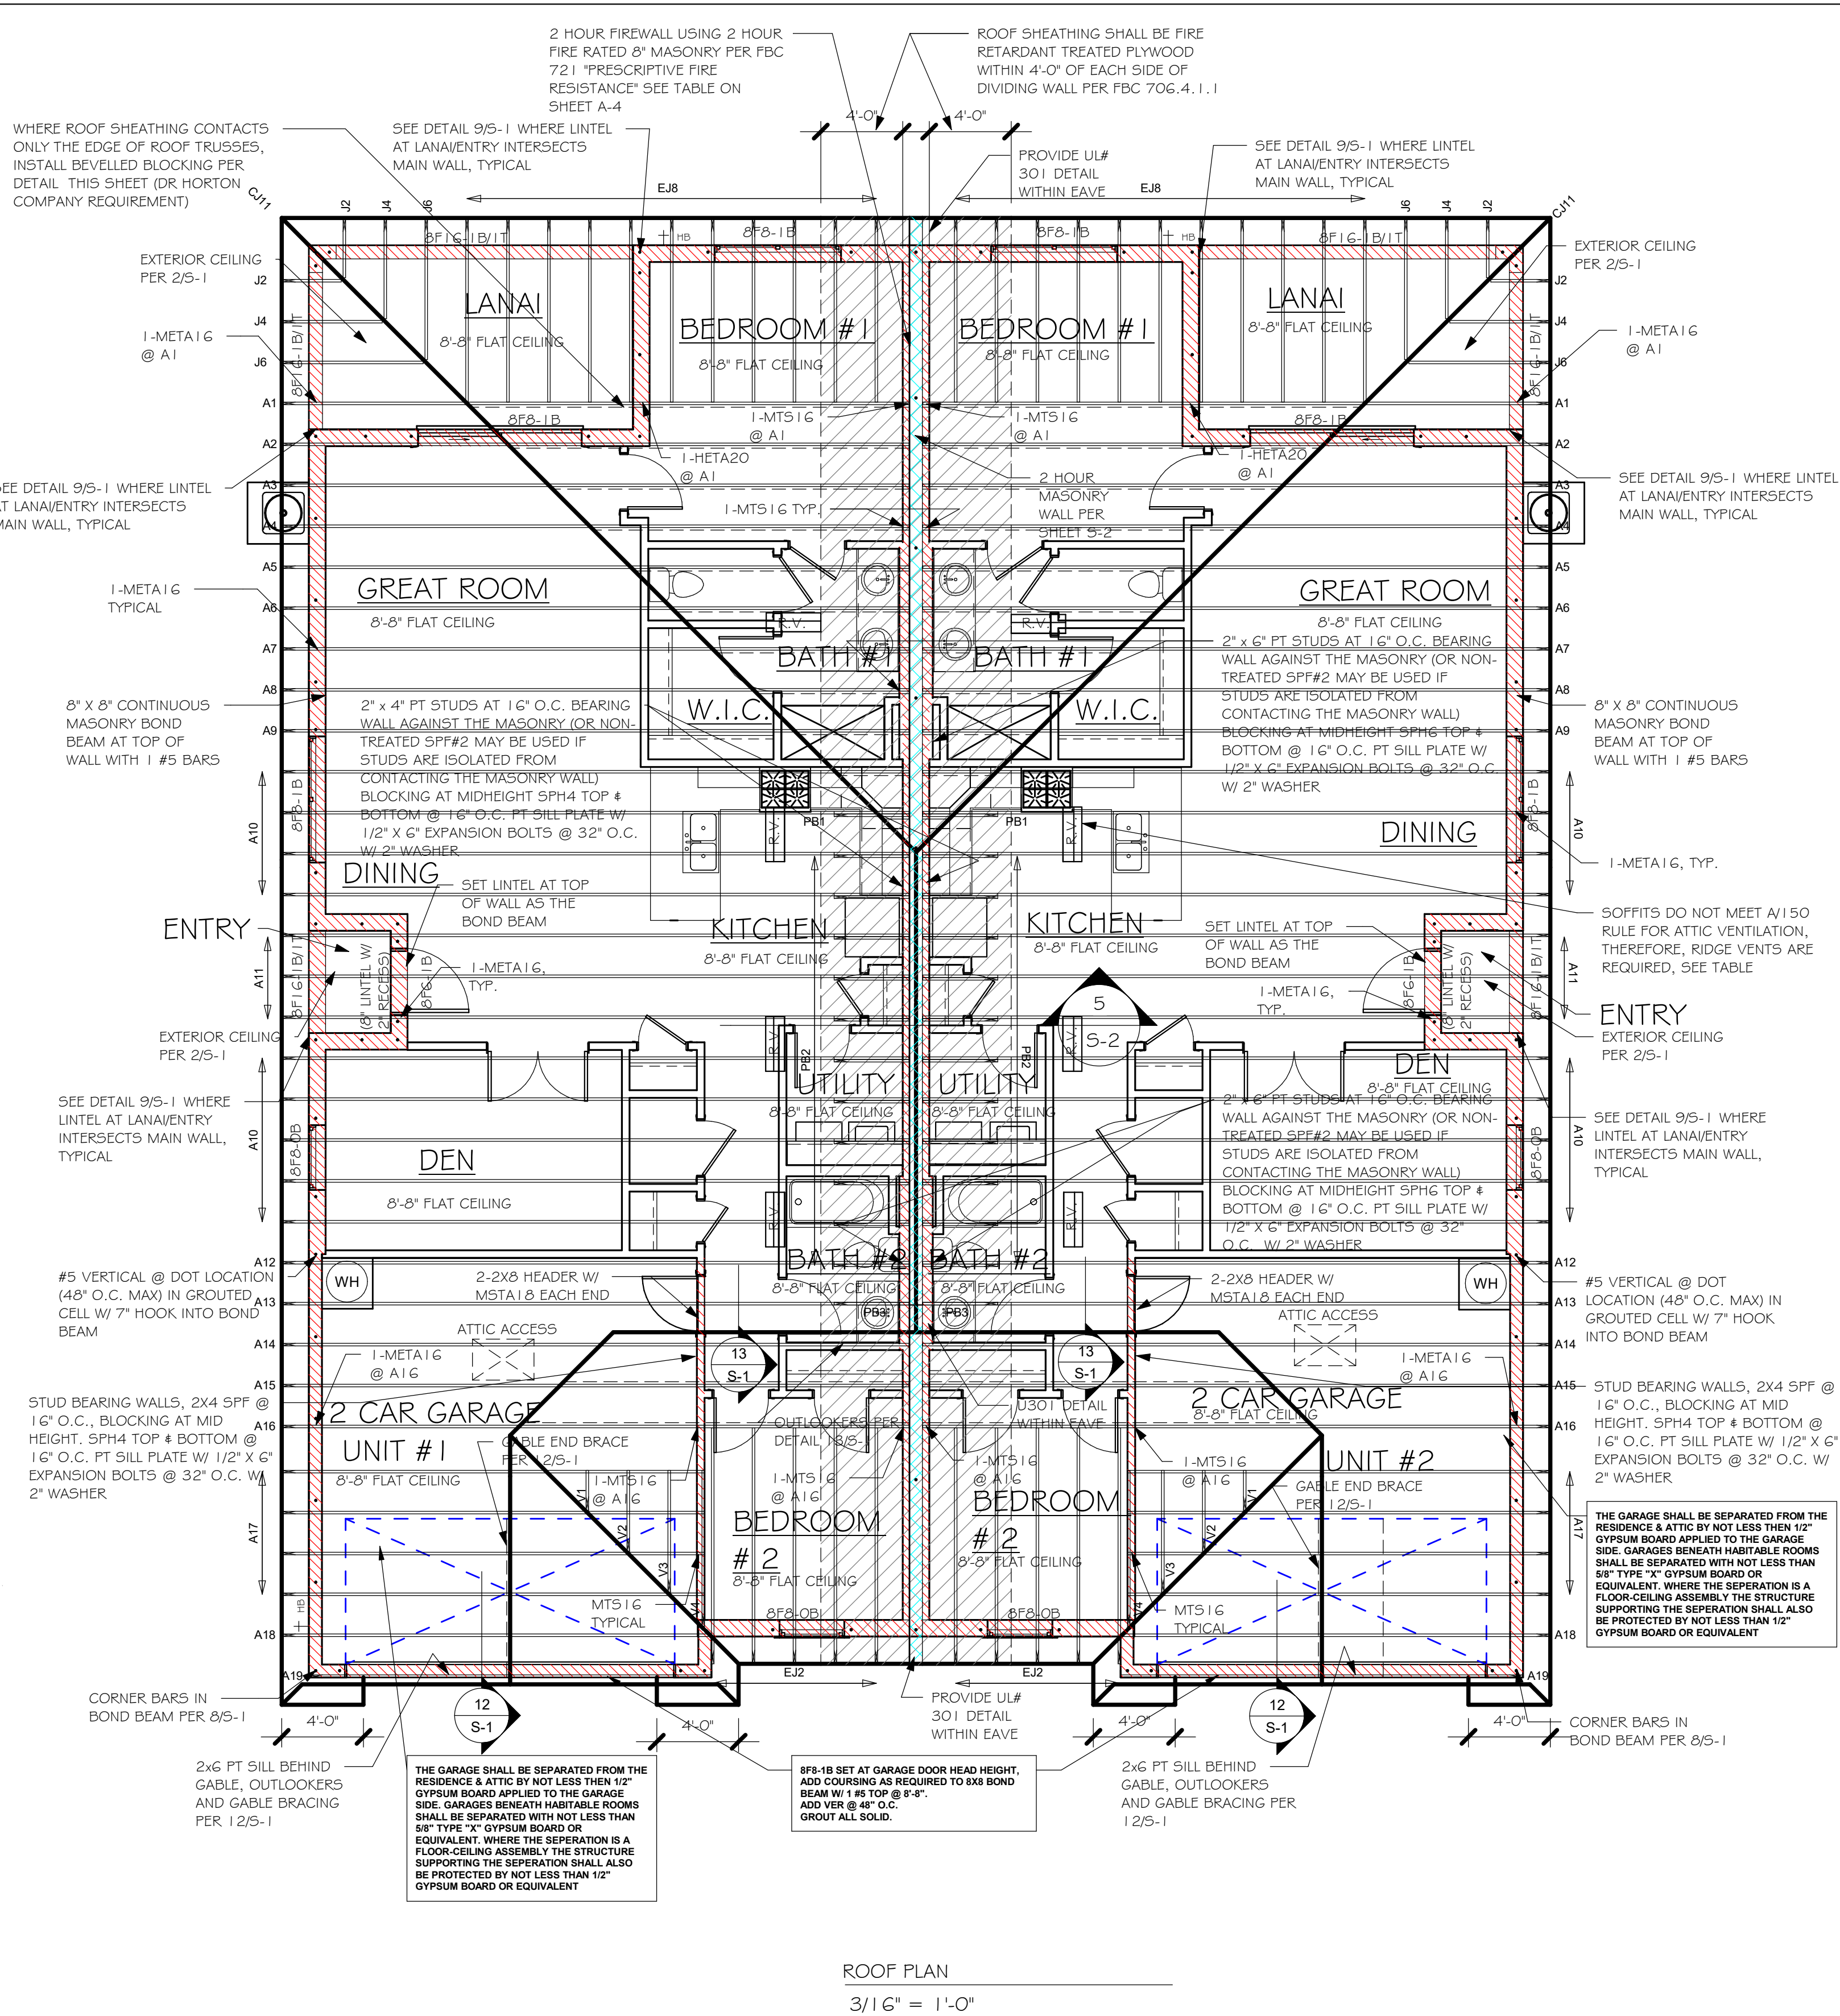

D-R HORTON
BY
NYS
America's Builder

Gulf Coast
Drafting & Design, Inc.

EMAIL: PLANS@GULFCOASTDRAFTING.COM
PHONE: 239-540-8622
1535 SE 47th ST. CAPE CORAL, FL 33904

STRUCTURAL ENGINEERING
STRUCTURAL SYSTEMS
OF NORTH FLORIDA
1000 E. GULF BLVD., SUITE 200
CAPE CORAL, FL 33909
(239) 549-4254
CEN 8867


LOT: 91.92
SUBDIVISION: MAGNOLIA III TV's
ADDRESS: 20571, 20567 PLUMWOOD LOOP
D.R.H. #: 579900091.092
GCD JOB # 13346

DATE: 8/26/21
DRAWN BY: CWL
CHECKED BY: JWC
REVISED:
PLAN: ROOF
SCALE: As indicated

MODEL 1498
VILLA E
A-4


DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2020 - 7TH EDITION

ELECTRICAL LEGEND	
	ELECTRICAL METER
	ELECTRICAL PANEL
	120 V JUNCTION BOX
	SINGLE RECEPTACLE OUTLET
	220 V RECEPTACLE OUTLET
	4-PLEX RECEPTACLE OUTLET
	DUPLEX RECEPTACLE OUTLET
	1/2 SWITCHED DUPLEX OUTLET
	DUPLEX RECEPTACLE AT ELEV. A.F.F.
	DUPLEX RECEPTACLE - ABOVE COUNTER
	SINGLE POLE SWITCH
	3 WAY SWITCH
	DIMMER SWITCH
	MOTION SENSOR SWITCH
	AC/DC SMOKE DETECTOR TO BE INTERCONNECTED ANY RESIDENT HAVING A FOSSIL-BURNING HEATER OR APPLIANCE, A FIREPLACE, OR AN ATTACHED GARAGE SHALL HAVE AN OPERATIONAL CARBON MONOXIDE ALARM INSTALLED WITHIN 10 FEET OF EACH ROOM USED FOR SLEEPING PERPOSES, PER RULE 9B-3.04.72 SD (SMOKE DETECTOR) SCD (CARBON MONOXIDE/ SMOKE DETECTOR)
	TELEPHONE OUTLET
	TELEVISION RECEPTION OUTLET
	SURFACE MOUNTED CEILING LIGHT
	FLUSH MOUNTED LIGHT
	WALL MTD. BRACKET LIGHT
	DUPLEX FLOOD LIGHT
	EXHAUST FAN
	TRACK MTD. LIGHTS
	AC DISCONNECT
	PUSH BUTTON (PB) / DOOR BELL (DB)
	INTERCOM
	KEYPAD
	4' FLUORESCENT LIGHT
	2' UNDER COUNTER LIGHT
NOTE: NOT ALL SYMBOLS ARE USED FOR THIS PROJECT.	
ELECTRICAL NOTES: ARC-FAULT CIRCUIT-INTERRUPTERS AND TAMPER RESISTANT RECEPTACLES SHALL BE INSTALLED IN DWELLING UNITS PER N.E.C 210.12 AND 406.11 ALL ELECTRIC, ELECTRICAL EQUIPMENT AND APPLIANCES TO BE SET AT OR ABOVE BASE FLOOD ELEVATIONS PLUS 1'-0" FREEBOARD. ALL OUTLETS IN WET AREAS AND ALL EXTERIOR OUTLETS TO BE GFI'S. INSTALL PHONE AND T.V PER CONTRACT. INSTALL ALL ELECTRICAL PER NEC 2017	

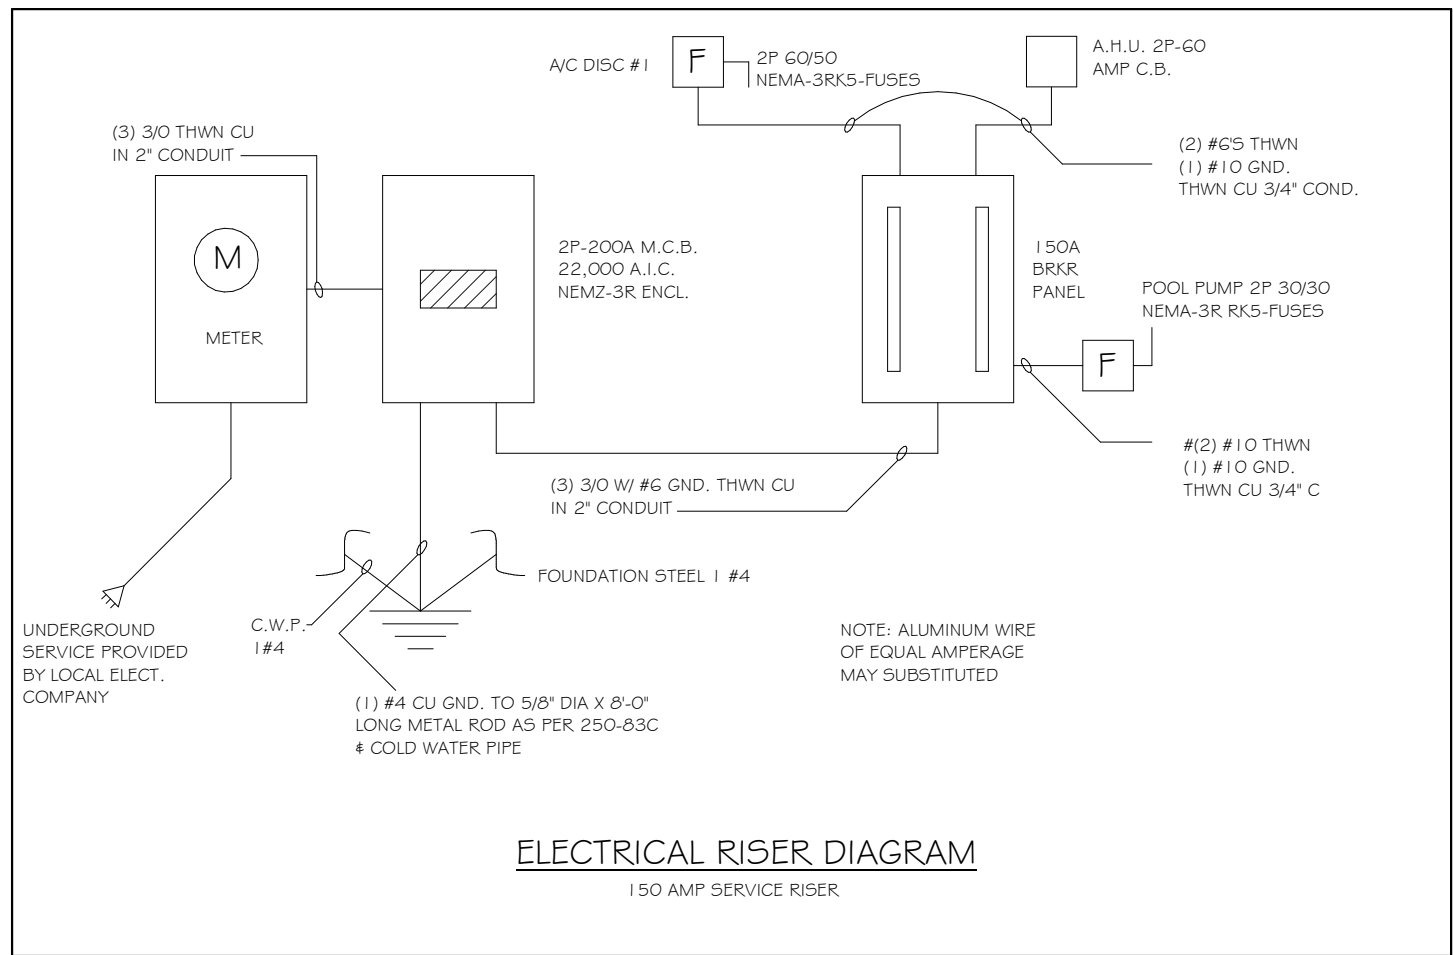

AIR CONDITIONING COORDINATION REQUIRED.
PRIOR TO ORDERING ROOF TRUSSES, THE CONTRACTOR SHALL WORK WITH THE AIR CONDITIONING SUB CONTRACTOR TO DESIGN/PLAN AND LAYOUT THE LOCATION OF AIR HANDLING EQUIPMENT, AIR DUCT SIZE AND LOCATION AND COORDINATE THAT DESIGN WITH THE TRUSSES FOR SPACE, CONNECTIVITY, AND POSITION REQUIREMENTS. THE CONTRACTOR MUST ADVISE THE TRUSS COMPANY PRIOR TO ANY CONSTRUCTION OF TRUSSES OF THE AIR CONDITIONING/HANDLING EQUIPMENT'S SIZES AND WEIGHT AND DUCT LAYOUT CONCERNS OR REQUIREMENTS THAT MAY HAVE THE POTENTIAL TO CHANGE OR MODIFY THE TRUSSES TO ACCOMMODATE THE SAME.
THE CONTRACTOR SHALL COORDINATE CONDENSATION DISCHARGE LINE LOCATION, AND ELECTRICAL SERVICE TO AIR EQUIPMENT, AND PROVIDE ANY LOCAL DISCONNECTS, LIGHTS AND SERVICE PLATFORMS THAT MAY BE REQUIRED.

ELECTRICAL NOTES FOR FIRE RATED WALLS
ELECTRICAL OUTLETS PLACED IN FIRE RATED WALLS SHALL BE IN CONFORMANCE WITH THE UNDERWRITERS LABORATORIES, INC., FIRE RESISTANCE DIRECTORY, CURRENT EDITION, THESE REQUIREMENTS INCLUDE, BUT ARE NOT LIMITED TO, THE FOLLOWING SPECIFIC ITEMS:
A) INDIVIDUAL OUTLET/SWITCH BOXES SHALL OT EXCEED (16) SQUARE INCHES IN AREA.
B) AGGREGATE AREA OF OUTLET/SWITCH BOXES SHALL NOT EXCEED (100) SQUARE INCHES WITHIN (100) SUARE FEET OF WALL AREA.
C) OUTLET/SWITCH BOXES LOCATED ON OPPOSITE SIDE OF THE SAME WALL SHALL BE SEPERATED BY A MINIMUM OF (24) INCHES.
D) ALL OUTLET/SWITCH BOXES SHALL BE SECURELY ATTACHED TO THE STUDS AND THE OPENING IN THE WALL BOARD FACING SHALL BE CUT SO THAT THE CLEARANCE BETWEEN THE BOX AND THE WALLBOARD DOES NOT EXCEED 1/8 INCH.

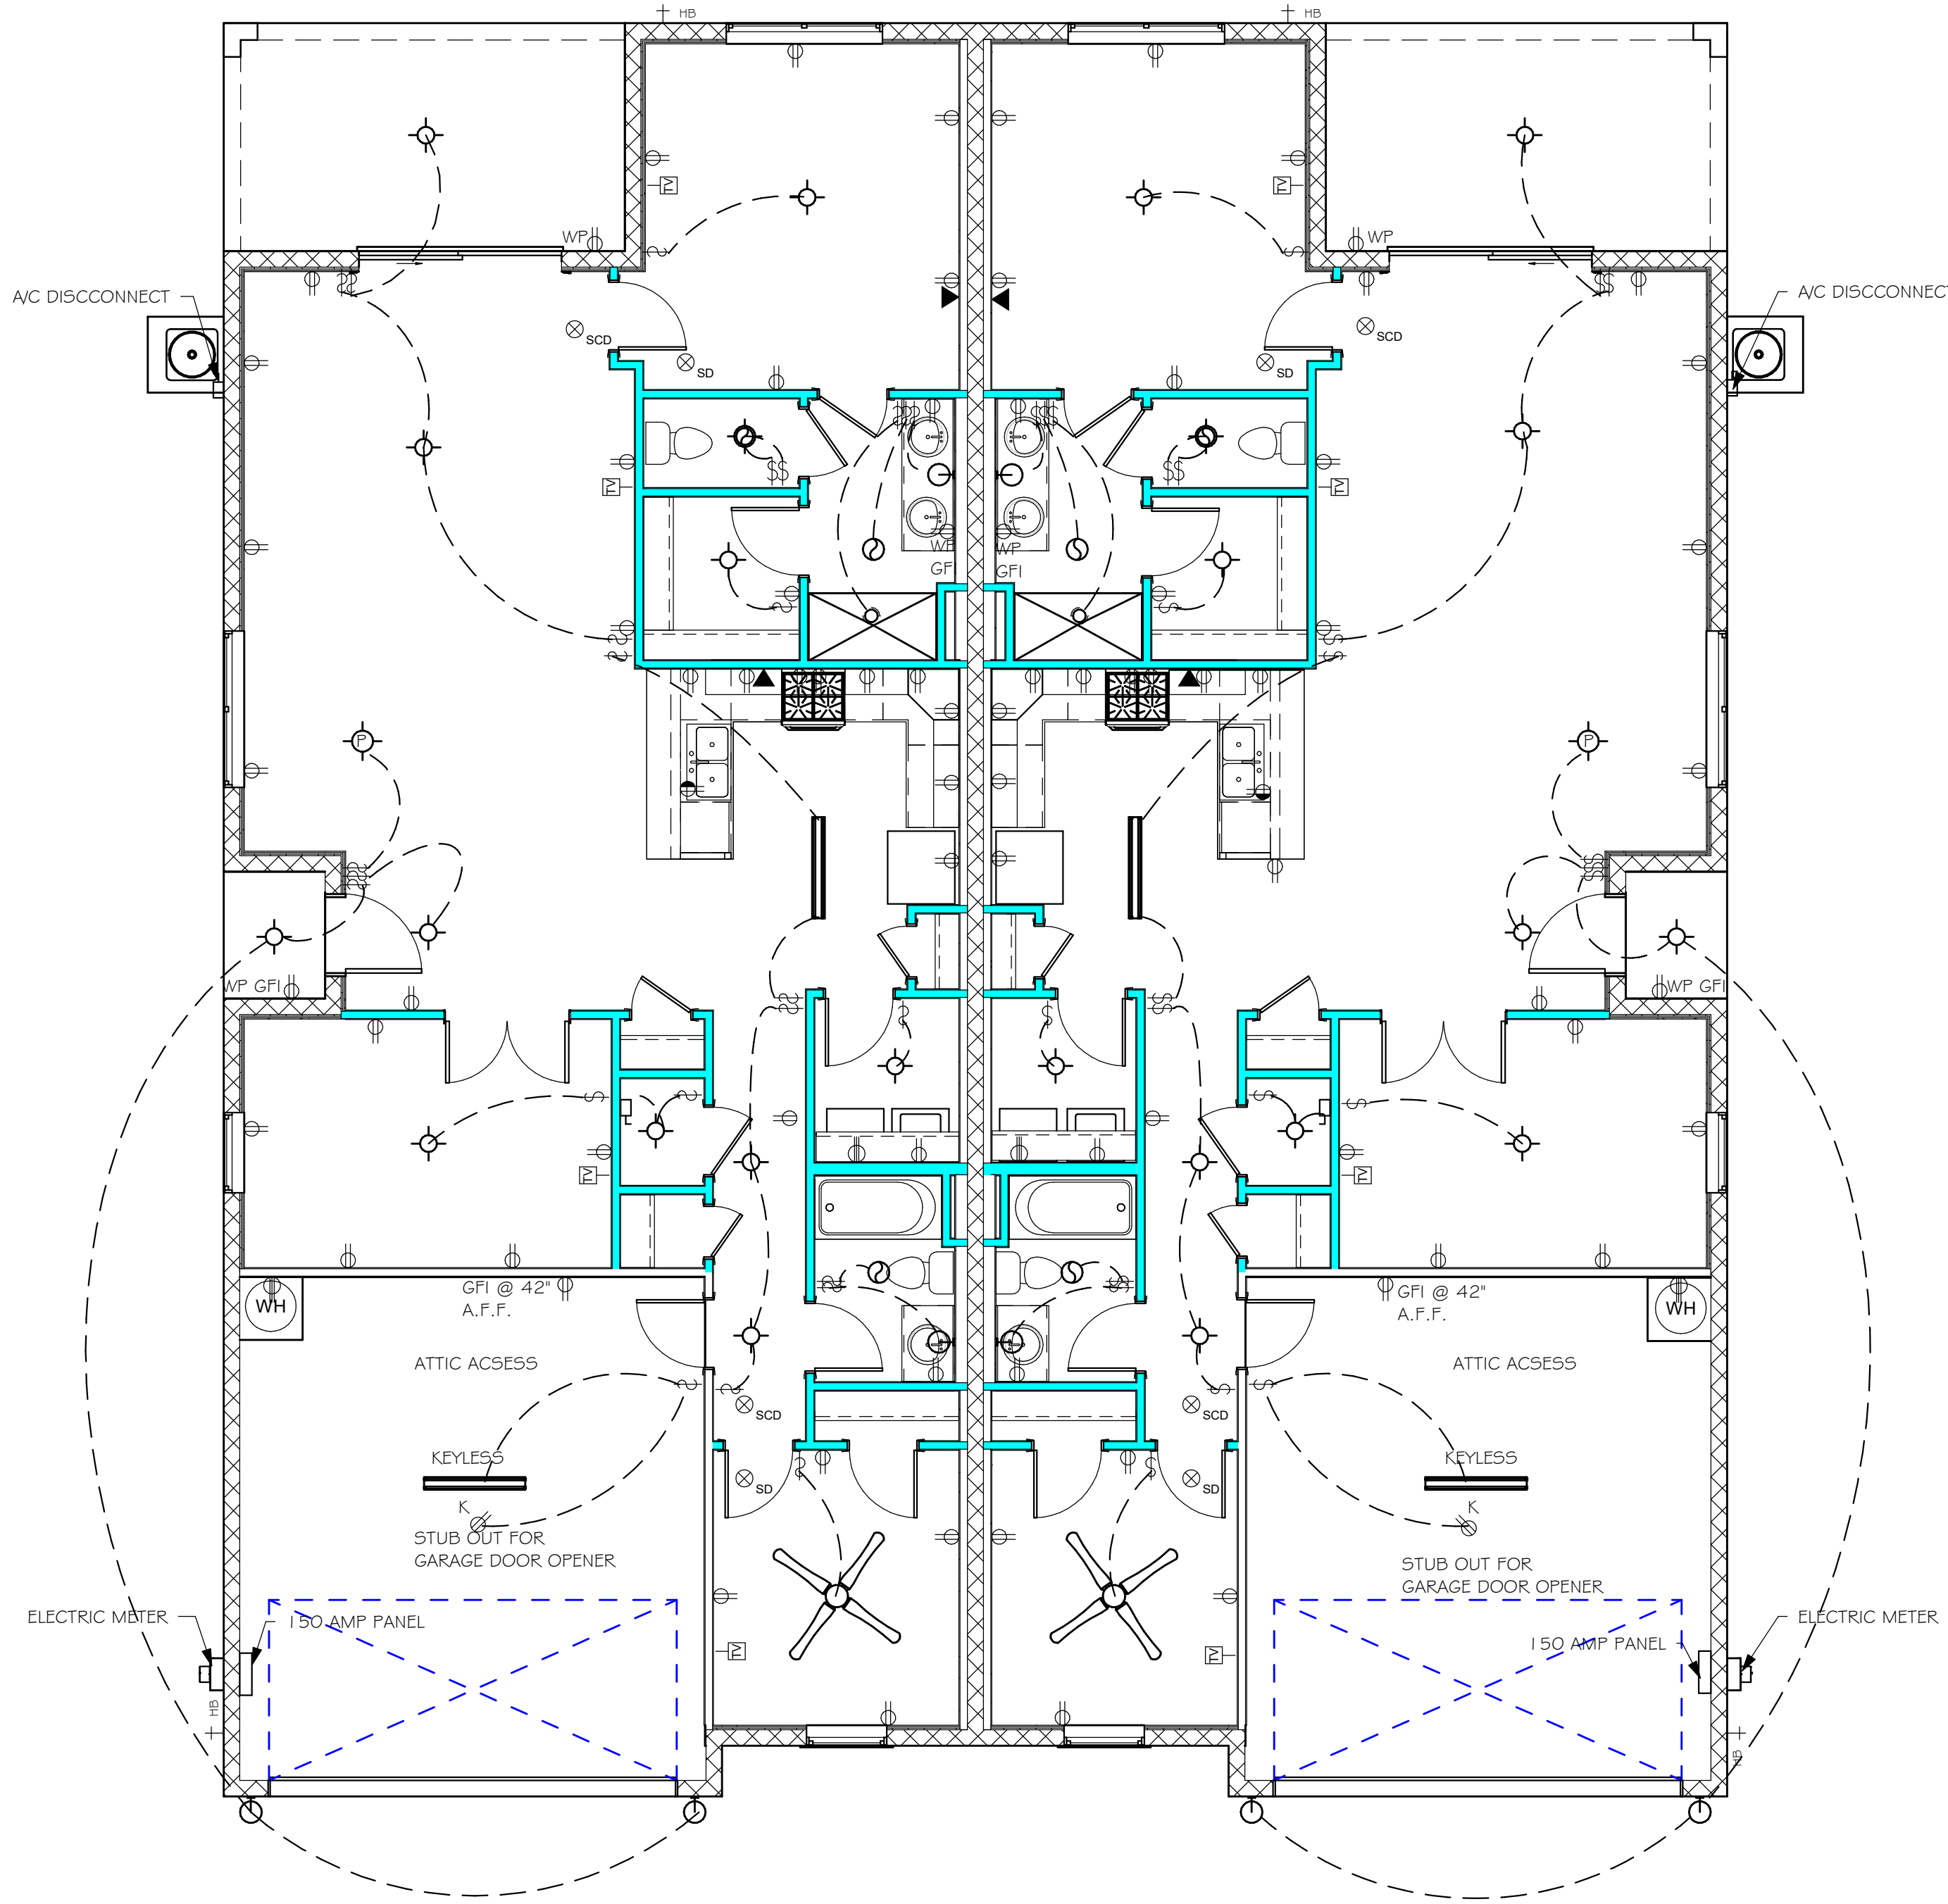

ELECTRICAL PLAN
3/16" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2020 - 7TH EDITION

Y:\O-New Data\1 -MASTER 2019\2019-BUILDERS\DR HORTON
2019\5\B\DIVISIONS\MAGNOLIA II # III TV\5\13346 LOT 91 # 92 1496 E\REVIT\13346
1496 E.rvt

1

RESIDENTIAL SPECIFICATIONS

GENERAL NOTES

1.

THE CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE PRIOR TO COMMENCING WORK. THE CONTRACTOR SHALL REPORT ALL DISCREPANCIES BETWEEN THE DRAWINGS AND EXISTING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.

2.

THE CONTRACTOR SHALL SUPPLY, LOCATE AND BUILD INTO THE WORK ALL INSERTS, ANCHORS, ANGLES, PLATES, OPENINGS, SLEEVES, HANGERS, SLAB DEPRESSIONS AND PITCHES AS MAY BE REQUIRED TO ATTACH AND ACCOMMODATE OTHER WORK.

3.

ALL DETAILS AND SECTIONS SHOWN ON THE DRAWINGS ARE INTENDED TO BE TYPICAL AND SHALL BE CONSTRUCTED TO APPLY TO ANY SIMILAR SITUATION ELSEWHERE IN THE WORK EXCEPT WHERE A DIFFERENT DETAIL IS SHOWN.

4.

FOR REQUIRED SOIL BEARING, SEE STRUCTURAL. THE CONTRACTOR SHALL REPORT ANY DIFFERING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.

5.

STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH JOB SPECIFICATION AND HOUSE PLANS, MECHANICAL, ELECTRICAL, PLUMBING, AND SITE DRAWINGS, CONSULT THESE DRAWINGS FOR SLEEVES, DEPRESSIONS AND OTHER DETAILS NOT SHOWN ON STRUCTURAL DRAWINGS.

6.

ALL SPECIFIED FASTENERS MAY ONLY BE SUBSTITUTED IF APPROVED BY THE ENGINEER IN WRITING, THE INSTALLATION OF THE FASTENERS SHALL BE IN ACCORDANCE WITH THE MANUFACTURERS SPECIFICATIONS. SIMPSON FASTENERS SPECIFIED MAY BE SUBSTITUTED WITH THE SAME QUANTITY AND EQUIVALENT STRENGTH PRODUCT.
ALL BOLTS, NUTS, WASHERS, STRAPS AND FASTENERS INCLUDING NAILS, SHALL BE HOT MOPED DIPPED GALVANIZED OR STAINLESS STEEL CONTINUOUS ANCHORAGE SHALL BE PROVIDED BETWEEN ALL TRUSSES, WALL SECTIONS, BEAMS, POSTS AND FOOTINGS WITH USE OF STRAPS AND CONNECTORS AS SPECIFIED HEREIN.

7.

TREATED WOOD REQUIREMENTS:-
ALL TREATED WOOD EXPOSED TO WEATHER SHALL BE PROTECTED, PRESSURE TREATED, OR NATURALLY RESISTANT TO DECAY.
ALL WOOD TOUCHING MASONRY OR CONCRETE SHALL BE ISOLATED, OR PRESSURE TREATED.

8.

THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS COMPLETE. IT IS THE CONTRACTORS SOLE RESPONSIBILITY TO DETERMINE ERECTION PROCEDURES AND SEQUENCES TO ENSURE SAFETY OF THE BUILDING AND ITS COMPONENTS DURING ERECTION. THIS INCLUDES THE NECESSARY SHORING, SHEETING, TEMPORARY BRACING, GUYS, OR TIE DOWNS.

9.

CEILING DRYWALL INSTALLED WITHIN THE HOUSE TO TRUSSES SPACED 24" O.C. SHALL BE 5/8" DRYWALL OR 1/2" SAC RESISTANT PER SEC. 702.3.5

10.

LANAI CEILINGS # COVERED ENTRY CEILINGS
1X4 STRIPPING @ 16" O.C. FASTENED WITH 2-8d NAILS TO EACH TRUSS. 5/8" EXTERIOR GYP. BOARD CEILING FASTENED WITH 8d NAILS OR 1-5/8" DRYWALL SCREWS @ 6" O.C. EDGE AND FIELD.

2

DOOR AND WINDOW ANCHORAGE

ANCHORAGE REQUIREMENTS- ALL PASS AND SLIDING GLASS DOORS AND ALL WINDOW ASSEMBLIES SHALL BE ANCHORED TO THE MAIN WIND FORCE RESISTING SYSTEM IN A MANNER SPECIFIED BY THE PUBLISHED MANUFACTURERS LITERATURE. THERE SHALL BE NO SUBSTITUTION OF ALTERNATE FASTENINGS UNLESS PROVIDED BY THE MANUFACTURER AND APPROVED BY THE BUILDING DESIGN ENGINEER.

MASONRY OPENING

WHERE WINDOW FRAME IS DESIGN TO FASTEN WITH SCREWS THROUGH THE FRAME AND INTO THE MASONRY, THE BUCK MATERIAL IS SIMPLY A SPACER. THE BUCK MAY BE FASTENED WITH THE T NAILS OR ANY SUITABLE FASTENER TO TACK IT INTO POSITION PRIOR TO WINDOW INSTALLATION. FASTEN WINDOW FRAME PER MFR INSTRUCTIONS. A WINDOW FASTENER SHALL PENETRATE MASONRY BY 2 1/4" MIN.

WHERE WINDOW FRAME IS DESIGNED TO FASTEN ONLY TO THE WOOD BUCK (IE, FLANGED FRAME WITH WOOD SCREWS) THE BUCKS SHALL BE 2X WOOD WITH STRUCTURAL FASTENING TO THE MASONRY WITH 1/4 X 3 3/4 MASONRY SCREWS @ 24" OC AND 6" FROM EACH END.

WOOD FRAMED OPENING- ALL DOORS AND WINDOWS SHALL BE INSTALLED ACCORDING TO THE PUBLISHED MANUFACTURERS LITERATURE OF THE ASSEMBLY BEING INSTALLED TO THE ROUGH SUBSTRATE OPENING. SHIMS SHALL BE MADE OF MATERIALS CAPABLE OF RESISTING THE APPLIED LOADS AND SHALL BE LOCATED NEAR EACH FRAME FASTENER TO MINIMIZE DISTORTION OF THE FRAME AS THE FASTENERS ARE TIGHTENED .

3

GENERAL ROOF ASSEMBLY

ROOF SHEATHING FBCR TABLE R803.2.2
SHALL BE 19/32 APA RATED SHEATHING, EXPOSURE 1, SPAN RATING 40/20 OR BETTER. INSTALL PANELS WITH LONG DIMENSION PLACED PERPENDICULAR TO TRUSSES.A 1/8" SPACE BETWEEN ADJACENT SHEETS SHALL BE MAINTAINED .
INSTALL 1" CLIPS AT UNSUPPORTED PANEL EDGES. FOR FASTENING, SEE STRUCTURAL.

FLASHING
FLASHING SHALL BE ALUMINUM, ALUMINUM ZINC COATED STEEL 0.0179" THICK, 26 GAUGE AZ50 ALUM ZINC, OR GALVANIZED STEEL 0.0179" THICK, 26 GAUGE ZINC COATED G90. FLASHING SHALL BE INSTALLED IN ACCORDANCE WITH THE ZIP SYSTEM ROOF SHEATHING MANUFACTURES PUBLISHED REQUIREMENTS. ALL FLASHING AND INSTALLATION SHALL CONFORM TO SECTION R905.2.8 (1 TO 5).

DRIP EDGE
DRIP EDGE SHALL BE PROVIDED AT ALL EAVES AND GABLES OF SHINGLES ROOFS, LAPPED A MINIMUM OF 3" @ JOINTS. THE OUTSIDE EDGE SHALL EXTEND A MINIMUM OF 1/2" BELOW SHEATHING AND THE INSIDE EDGE SHALL EXTEND BACK A MINIMUM OF 2". DRIP EDGE SHALL BE FASTENED AT NO MORE THAN 4" CENTERS. THERE SHALL BE A MINIMUM OF 4" WIDTH OF ROOF CEMENT INSTALLED OVER THE DRIP EDGE FLANGE.

4

ASPHALT SHINGLE ROOF SPECS

SHINGLES
30# FELT SHALL BE INSTALLED UNDER ASPHALT SHINGLES. ALL ASPHALT SHINGLES SHALL HAVE SELF-SEALING STRIPS OR BE INTERLOCKING AND COMPLY WITH ASTM D 225 OR D 3462. FOR FASTENING, SEE STRUCTURAL. INSTALLATION SHALL COMPLY WITH MANUFACTURES REQUIREMENTS FOR INSTALLATION IN THE GIVEN FLORIDA WIND ZONE, AS DETERMINED BY ASTM D 3161.

5


CLAY AND CONCRETE ROOF TILE SPECS

INSTALL PEEL AND STICK UNDERLAYMENT APPROVED FOR SINGLE LAYER APPLICATION UNDER TILE ROOF.
THE INSTALLATION OF CLAY AND CONCRETE TILE SHALL COMPLY WITH THE PROVISIONS OF R905.3 F.B.C.
MARKING: EACH ROOF TILE SHALL HAVE A PERMANENT MANUFACTURER'S IDENTIFICATION MARK.
APPLICATION SPECIFICATIONS: THE TILE MANUFACTURER'S WRITTEN APPLICATION SPECIFICATIONS SHALL BE AVAILABLE AND SHALL INCLUDED BUT NOT BE LIMITED TO THE FOLLOWING:
1. TILE PLACEMENT AND SPACING,
2. ATTACHMENT SYSTEM NECESSARY TO COMPLY WITH CURRENT WIND CODE.
A. AMOUNT AND PLACEMENT OF MORTAR
B. AMOUNT AND PLACEMENT OF ADHESIVE
C. TYPE, NUMBER, SIZE AND LENGTH OF FASTENERS AND CLIPS.
3. UNDERLAYMENT
4. SLOPE REQUIREMENT .

6

FLOOR SHEATHING AT 2ND FLOOR

A.P.A. RATED STURDI-FLOOR, EXPOSURE 1, TONGUE # GROOVE EDGES
SPAN RATING 48/24 OR BETTER, SEE STRUCTURAL.

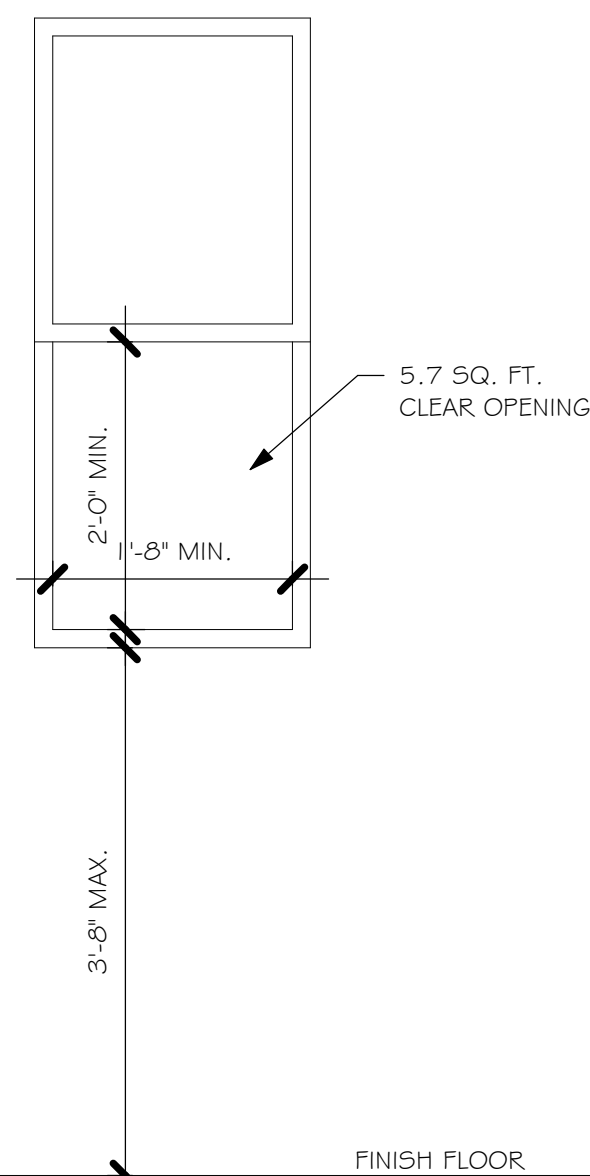

R310.2.1 MINIMUM OPENING AREA- ALL EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5.7 SQUARE FEET (0.530 m²).

EXCEPTION- GRADE FLOOR OPENINGS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5 SQUARE FEET (0.465 m²).


R310.2.1 MINIMUM OPENING HEIGHT- THE MINIMUM NET CLEAR OPENING HEIGHT SHALL BE 24 INCHES (610mm).

R310.2.1 MINIMUM OPENING WIDTH- THE MINIMUM NET CLEAR OPENING WIDTH SHALL BE 20 INCHES (508mm).


R310.1.1 OPERATIONAL CONSTRAINTS- EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL BE OPERATIONAL FROM THE INSIDE OF THE ROOM WITHOUT THE USE OF KEYS OR TOOLS.

R310.2.3 WINDOW WELLS- THE MINIMUM HORIZONTAL AREA OF THE WINDOW WELL SHALL BE 9 SQUARE FEET (0.84 m²), WITH A MINIMUM HORIZONTAL PROJECTION AND WIDTH OF 36 INCHES (914mm). THE AREA OF THE WINDOW WELL SHALL ALLOW THE EMERGENCY ESCAPE AND RESCUE OPENING TO BE FULLY OPENED.


MINIMUM EGRESS WINDOW DETAIL

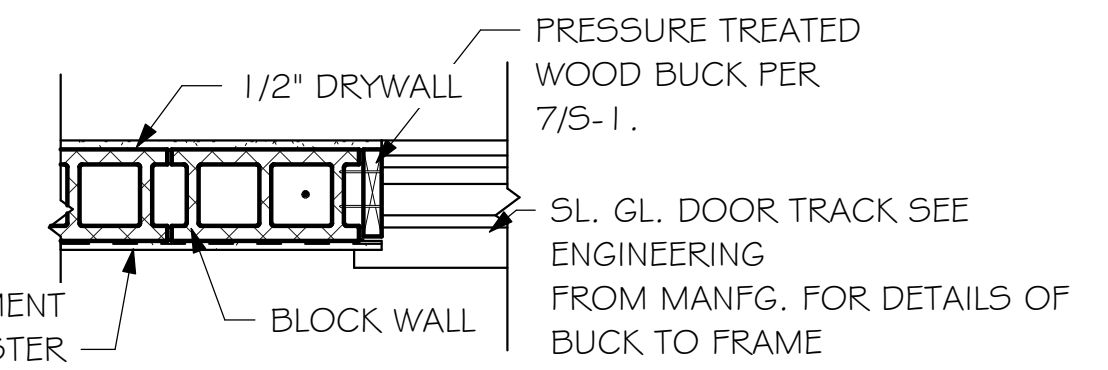


SL. GL. DR. JAM TO BLOCK DETAIL

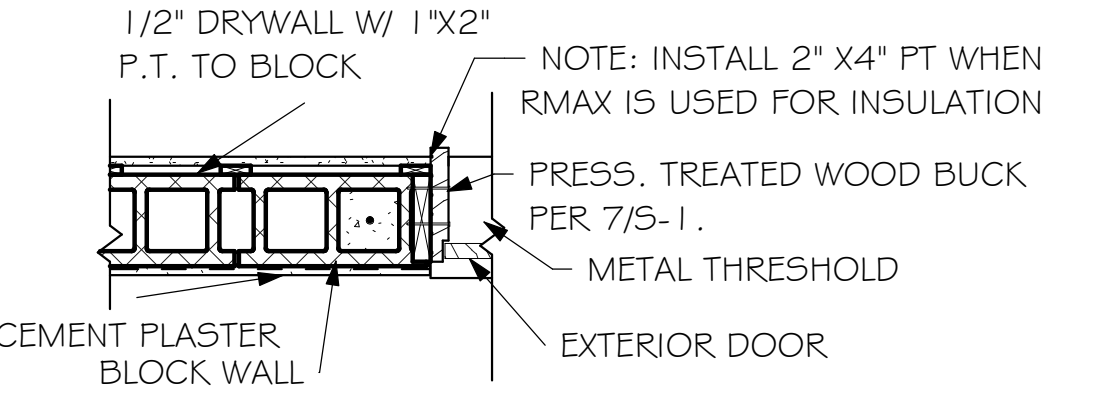


DOOR JAM TO BLOCK DETAIL

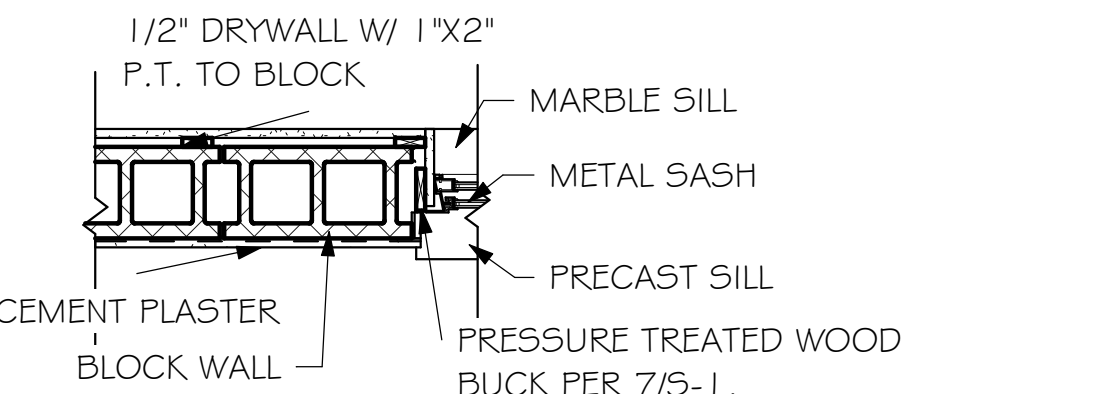

WINDOW JAM TO BLOCK DETAIL

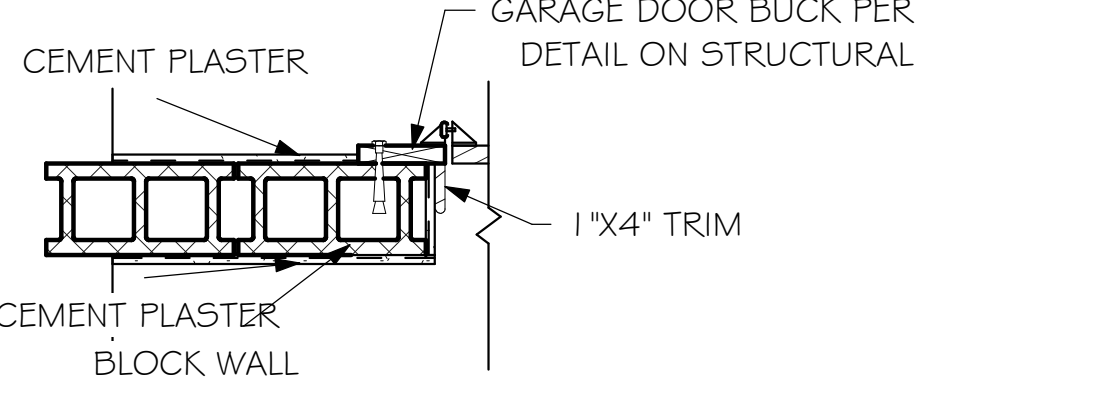


GARAGE DOOR JAM DETAIL

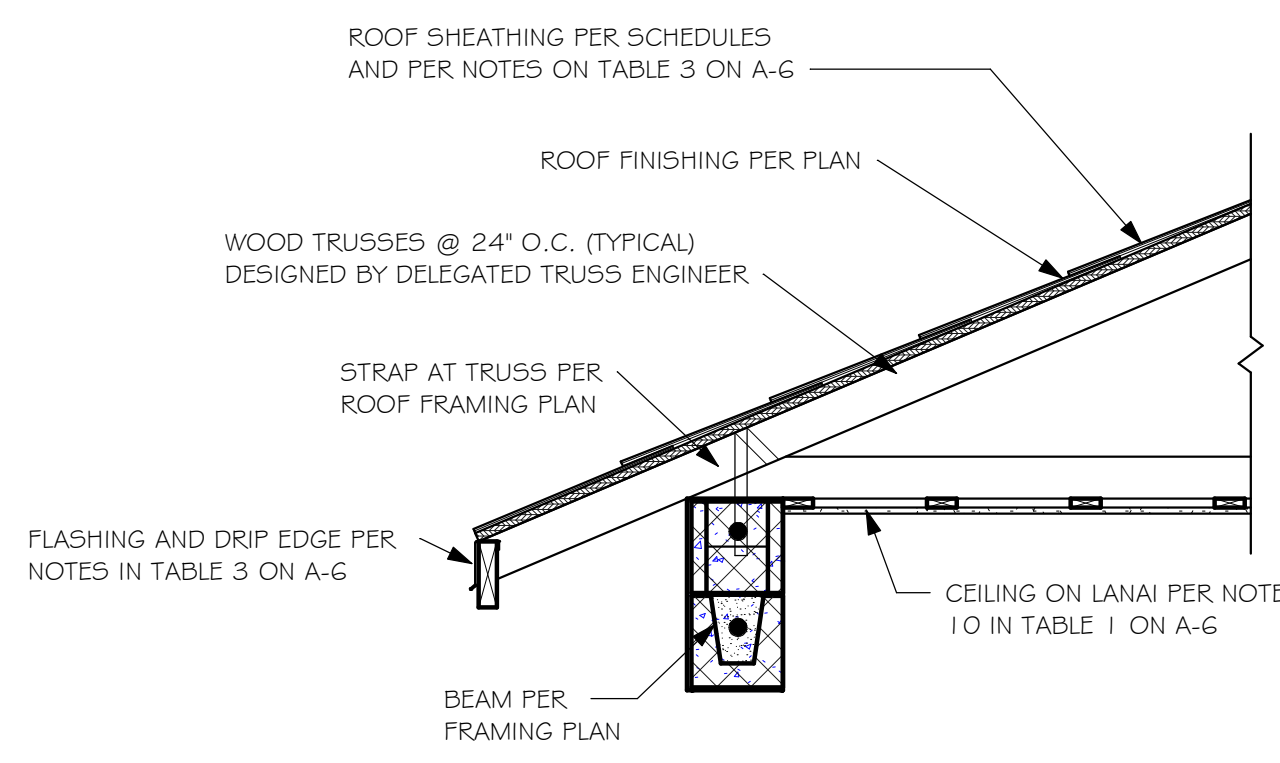

LANAI/ ENTRY ROOF ASSEMBLY

3/4" = 1'-0"

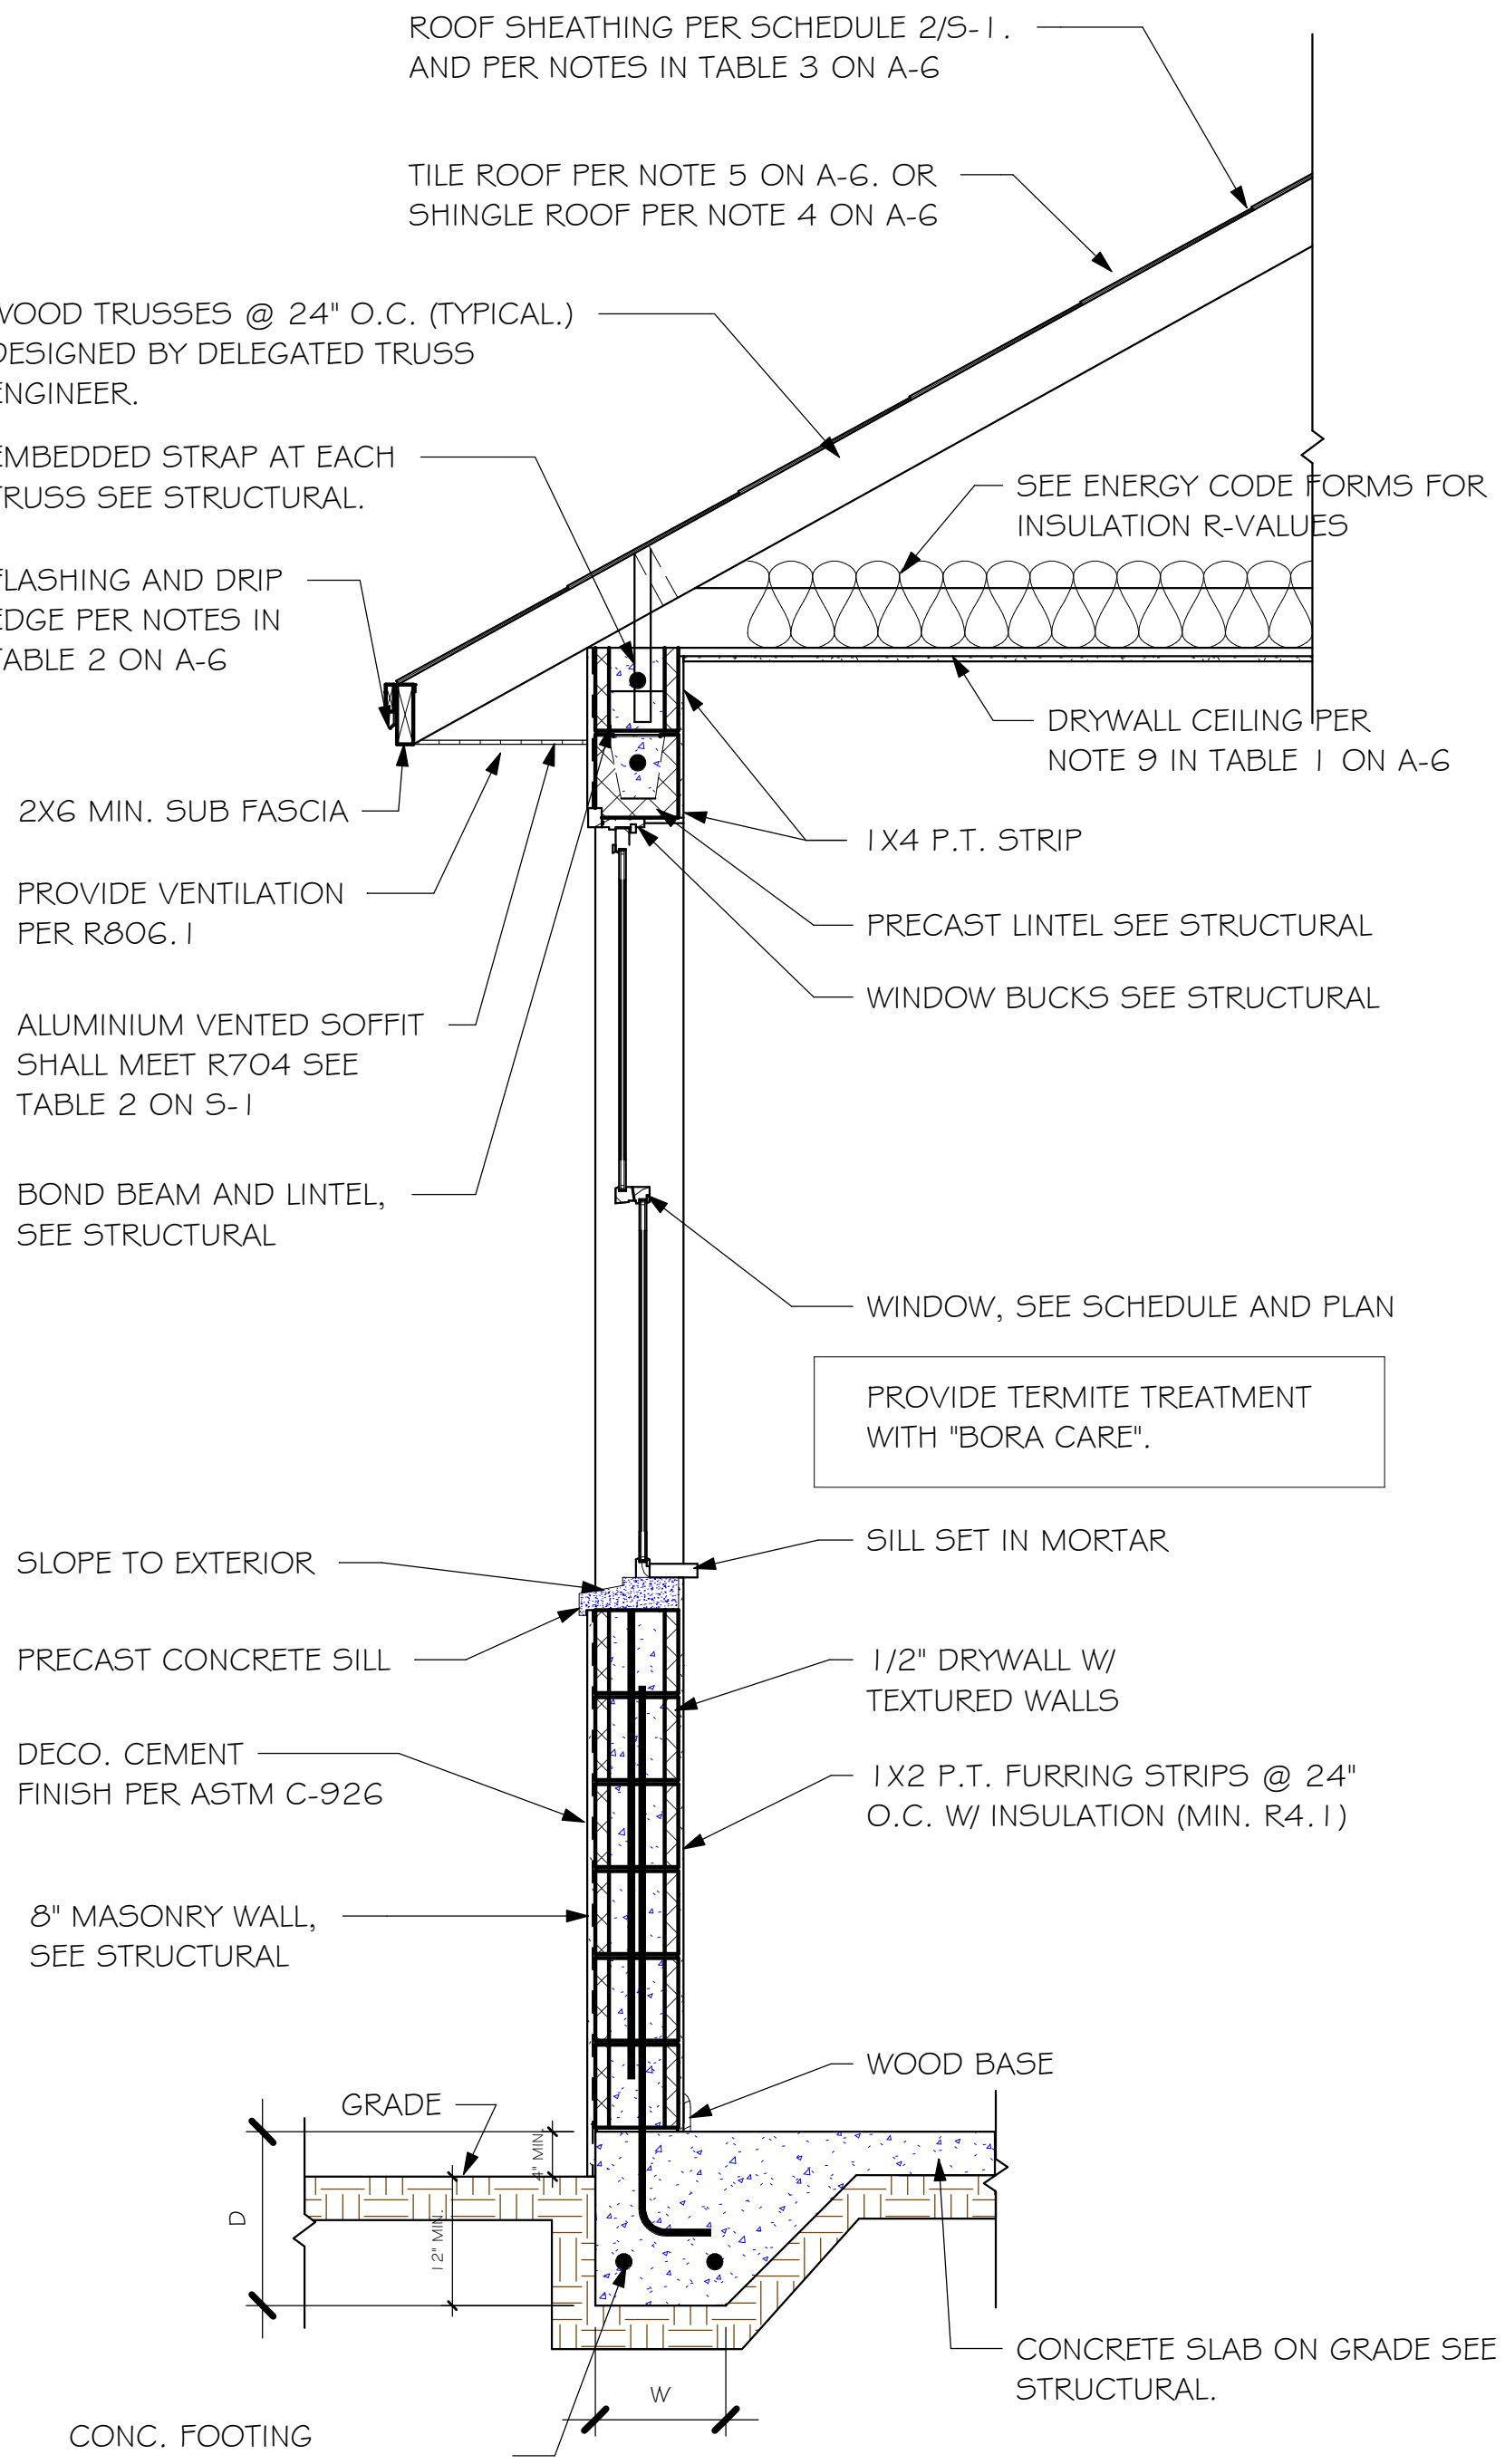

TYPICAL WALL SECTION

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2020 - 7TH EDITION

STRUCTURAL DIVISION

STRUCTURAL SYSTEMS OF NORTH FLORIDA

204 E. CORAL, FL 33904
(239) 549-4554
C# 889

THE INFORMATION ON THIS DRAWING IS THE PROPERTY OF S.O. HORTON & COMPANY, INC. (SHC). IT IS TO BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED HEREON. NO PART OF THIS DRAWING IS TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT THE WRITTEN PERMISSION OF S.O. HORTON & COMPANY, INC. ANY VIOLATION OF THIS NOTICE WILL BE PROSECUTED TO THE FULL EXTENT OF THE LAW.

ENGINEER

FLORIDA

PROFESSIONAL

ENGINEER

NO. 88925

DATE: 08/26/21

LOT: 91,92

SUBDIVISION: MAGNOLIA III TV's

ADDRESS: 20571, 20567 PLUMWOOD LOOP

D.R.H. #: 579900091,092

MODEL 1498

VILLA E

GCD JOB # 13346

DATE: 8/26/21

DRAWN BY: CWL

CHECKED BY: JWC

REVISED:

PLAN: SECTIONS

SCALE: As indicated

A-6



PAN FLASHING PER R703.4
SCALE: N.T.S.

TABLE R803.2.3.1 – NAIL SPACING BASED ON SPECIFIC GRAVITY OF RAFTER/TRUSS: ALL TRUSS TOP CHORDS AND FIELD ROOF FRAMING SHALL BE SOUTHERN PINE, SPECIFIC GRAVITY=0.55 (EXCEEDS SG=0.42 AND 0.49 OF TABLE R803.2.3.1).

ENSURE THAT ALL NAILS PENETRATE THE TOP CHORD OF THE TRUSS WITHOUT SPLITTING.

TYPICAL HOUSE PLAN

EDGE NAIL TO BLOCKING AT RIDGE/VALLEY/HIP

STAGGER JOINTS AT SHEATHING PANELS

EDGE NAIL TO FACIA BOARD

NAIL SPACING (TABLE R803.2.3.1) WIND SPEED / EXPOSURE

NAIL TYPE (SECTION R803.2.3.1) 19/32 SHEATHING

160/B, 160/C, 170/B NAIL SPACING: 6" O.C. EDGE 6" O.C. FIELD

170/C NAIL SPACING: 4" O.C. EDGE 4" O.C. FIELD

2 1/2" x 0.131" RING SHANK OR 3" x 0.120" RING SHANK (PER ASTM F1667 RSRs-03 & 04)

1 NAILING OF ROOF SHEATHING

SCALE: NTS

DOWEL TO MATCH WALL REINFORCING, LAP 25"

FINISHED GRADE, SEE SITE PLAN

MONOLITHIC FOOTING, SEE PLAN

12" MIN

W

EDGE

EMBED DOWELS 5" WITH 10" STD HOOK

3" CLEAR COVER TO REINFORCING

VARIES

W

STEPDOWN

W

INTERIOR

W

MONOLITHIC FOOTINGS

SCALE: 3/4" = 1'-0"

8" CMU WALLS

2x4 or 2x6 P.T. BUCK @ FLANGED WINDOWS (SEE NOTE)

1/4"x3 3/4" TAPCON @ 24" OC, 3 SCREWS MIN. (SEE NOTE)

WINDOW/DOOR ROUGH OPENING

8" CMU, SEE PLAN FOR REINFORCING

DOOR

2x8 OR 2x6 P.T. SYP#2

2x2x1/8" WASHER

1/2" Ø EXPANSION BOLT, 4" MIN. EMBEDMENT, SPACE 24" OC AND 12" FROM TOP & BOT.

BUCK FASTENING

GARAGE DOOR

NOTE: THIS BUCK FASTENING DETAIL IS INTENDED FOR FLANGED WINDOW/DOOR PRODUCTS THAT FASTEN THRU THE FLANGE WITH WOOD SCREWS TO THE BUCK. FOR WINDOW/DOOR PRODUCTS THAT DO NOT HAVE A FLANGE AND FASTEN INSTEAD OUTWARD THRU THE FRAME, USE MASONRY SCREWS PER MFR. THAT ARE LONG ENOUGH TO PENETRATE 2-1/4" INTO THE MASONRY. IN THIS CASE, THE BUCK MATERIAL IS SIMPLY A SPACER AND MAY BE 1x4 OR 1x6 OR OMITTED ENTIRELY AND THE SPACER MAY BE TACKED IN PLACE WITH MASONRY NAILS OR PINS.

RETROFIT STRAPS TO CONCRETE/MASONRY

TRUSS UPLIFT (LBS) @ 24" OC	CONNECTOR
TO 840	1-MTSM16 or 20
TO 1045	1-HTSM16 or 20
TO 2090	2-HTSM16 or 20
TO 4300	2-LGT2
TO 3480	HTT16
TO 10530	HGT-2/3

NOTES:

1) WHERE EMBEDDED STRAP IS MISSING OR MIS-LOCATED, PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE.

2) CONNECTORS ARE SIMPSON STRONG TIE. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS.

10 RETROFIT UPLIFT CONNECTOR SCHEDULE

SHEATHING SCHEDULE

EXTERIOR STUD WALL	FLOOR
7/16" ZIP SYSTEM WALL SHEATHING BY HUBER ENGINEERED WOODS LLC, NAILED W/ 8d COMMON WIRE @ 6" O.C. EDGE AND 6" O.C. FIELD. PROVIDE 2x4 BLOCKING AT ALL JOINTS. INSTALL SHEATHING AND SEAM TAPE IN STRICT ACCORDANCE WITH MFR. WRITTEN INSTRUCTIONS.	N/A
ROOF – PER FBCR TABLE 803.2.2	1) 1x4 STRIPPING @ 16" OC W/ 2-8d NAILS TO EACH TRUSS, 5/8" EXTERIOR GYPSUM BOARD CEILING, FASTEN W/ 8d NAILS OR 1 5/8" DRYWALL SCREWS @ 6" OC EDGE & FIELD. 2) 3/8" BC PLYWOOD NAILED W/ 6d COMMON @ 6" OC EDGE & FIELD.
19/32 CLASS A.P.A. RATED SHEATHING, EXPOSURE 1, SPAN RATING 40/20. FASTEN WITH RING SHANK NAILS PER DETAIL 1/S-3	
(WHEN ZIP BRAND ROOF SHEATHING IS USED, H-CLIPS ARE NOT REQUIRED)	
	ALUMINUM PERFORATED SOFFIT INSTALLED PER MANUFACTURER INSTRUCTIONS TO MEET WIND PRESSURES PER R704.

NOTE: EXTERIOR CEILINGS SPECIFIED ABOVE MEET THE DESIGN WIND PRESSURES PER R703.1.2

3/4" DEEP SAWCUT W/ ELASTOMERIC SEALANT

SLAB ON GRADE, SEE PLAN

NOTES:

1) PROVIDE SAWCUTS TO CREATE APPROXIMATE 20' X 20' MAXIMUM SQUARES.

2) SAWCUT CONCRETE SLAB WITHIN 4 TO 12 HOURS OF CONCRETE PLACEMENT.

SLAB SAWCUT DETAIL

SCALE: NTS

#5 CORNER BAR, 25"x25"

MASONRY BOND BEAM, TYPICAL

INTERSECTION

CORNER

CORNER BAR DETAIL IN BOND BEAMS

SCALE: 3/4" = 1'-0"

ROOF COVERING AS SELECTED BY BUILDER PER: FBCR 905.2 ASPHALT SHINGLES FBCR 905.3 CLAY AND CONCRETE TILE FBCR 905.10 METAL ROOF PANELS

ROOF SHEATHING, SEE SCHEDULE 2/S-1

WOOD TRUSSES @ 24" OC, DESIGNED BY DELEGATED TRUSS ENGINEER

EMBEDDED STRAP AT EACH ROOF TRUSS, SEE ROOF PLAN. BREAK OUT WEB OF BLOCK AS NEEDED TO PROPERLY LOCATE EACH STRAP

TRUSS BEARING

SEE PLAN

2x6 (MIN) SPF #2 W/ 3-16d TO EACH TRUSS

APPROVED ISOLATION PLATE

8"x8" CONTINUOUS MASONRY BOND BEAM W/ 1-#5, GROUT SOLID. PROVIDE CORNER BARS PER DETAIL 8/S-3

ALUMINUM SOFFITS SHALL MEET WIND DESIGN PRESSURES PER R704 INSTALLED PER MFR. SPECS.

#5 VERT. IN GROUTED CELL AT DOT LOCATIONS ON PLAN (48" OC MAX EXTERIOR)

#5 VERTICAL SHALL HAVE 7" STANDARD HOOK INTO TOP OF BOND BEAM

TRUSS STRAP TO BOND BEAM

SCALE: 3/4" = 1'-0"

WINDOW/DOOR/SOFFIT DESIGN WIND PRESSURES

WIND PRESSURES PER ASCE7-16, 160 MPH, EXPOSURE C, AND CONVERTED TO ALLOWABLE STRESS DESIGN PRESSURES USING 0.6W LOAD FACTOR. (Vwsd=124 MPH, RISK CAT II, ENCLOSED, kd=0.85, I=1.5)	INTERIOR ZONE 4	END ZONE 5
TYPE		
SOFFIT (10 SQ. FT.)	+33.5 -36.3	+33.5 -44.8
WINDOWS & DOORS (10 SQ. FT.)	+33.5 -36.3	+33.5 -44.8
8' OR 9' GARAGE DOORS	+29.4 -33.3	
16' OR 18' GARAGE DOORS	+28.2 -31.5	

(SEE PLAN FOR OTHER SPECIFIC PRESSURES)

1) TABLE MAY BE USED FOR ANY SIZE WINDOW OR DOOR IN EACH TYPE.

2) USE "INTERIOR ZONE 4" PRESSURES UNLESS WINDOW OR DOOR IS LOCATED WITHIN THE "END ZONE 5" (SEE DIAGRAM BELOW), THEN USE THE HIGHER PRESSURES UNDER THE "END ZONE 5" COLUMN.

3) ALL GLASS / GLAZING SHALL BE IMPACT RATED OR USE IMPACT RATED SHUTTERS.

4) SUBMIT PRODUCT APPROVALS TO THE BUILDING DEPARTMENT AS REQUIRED BY THE LOCAL JURISDICTION.

5) MANUFACTURED SOFFIT PRODUCTS SHALL BE INSTALLED PER MFR ENGINEERING SPEC SHEETS.

* ON IRREGULAR SHAPED BUILDINGS, THERE IS NO GUIDANCE IN THE CODE FOR HOW FAR A CORNER MUST PROTRUDE FROM THE MAIN BUILDING TO BE CONSIDERED "ZONE 5". WE HAVE CHOSEN >15'. THIS IS SUBJECT TO JUDGEMENT CALL BY THE AUTHORITY HAVING JURISDICTION.

IN ZONE 5, MANUFACTURED SOFFIT PRODUCTS MAY REQUIRE ADDITIONAL BATTENS OR FASTENING PER MFR ENGINEERING SPEC SHEETS TO MEET THE PRESSURE REQUIREMENTS.

END ZONE 5 PRESSURES OCCUR AT "PRIMARY" OUTSIDE CORNERS OF BUILDING (BOLD LINES)

INTERIOR ZONE 4 PRESSURES

FOOTING REIN., SEE PLAN

LAP CORNER BARS 40 BAR DIAMETERS

3" COVER

MAINTAIN RUN TO RISE OF 2:1 OR MORE

MAINTAIN FOOTING WIDTH & DEPTH AT ALL VERT. AND HORIZ. SEGMENTS

FOOTING REIN., SEE PLAN. LAP 40 BAR DIAMETERS

PLAN VIEW

STEP FOOTING

SCALE: NTS

FOOTING CORNER BARS

SCALE: NTS

LINTEL AT LANAI OR ENTRY. '8F16-1B/1T' (8"x16" FILLED SOLID, 1#5 BOTTOM, 1-#5 TOP)

8"x8" BOND BEAM W/ 1-#5

TRUSS BEARING

7" STANDARD HOOK INTO TOP OF BOND BEAM (MAY USE 7"x25" BENT BAR)

#5 VERT. AT INTERSECTION OF BOND BEAM W/ 7" HOOK AT TOP

MASONRY WALL

BOND BEAM REINFORCING DETAIL

SCALE: 3/4" = 1'-0"

ROOF SHEATHING, SEE SCHEDULE.

2x6 (MIN) SPF #2 W/ 3-16d TO EACH TRUSS

2x4 BLOCK AT SHEATHING JOINT

2x4 BRACE AT LOCATIONS SHOWN ON PLAN

3-12d TOE NAILS

2x4 BLOCKING

TRUSS TOP CHORD, DROP 3/2"

BRACE VERTICAL MEMBERS PER TRUSS MFR DETAILS

MID WALL WEEP SCREED

12d NAILS AT TRUSS BOTTOM CHORD TO SILL @ 8" O.C.

MASONRY WALL, SEE PLAN

DROPPED GABLE TRUSS

GABLE END BRACING

SCALE: N.T.S.

DESIGN CRITERIA:

DESIGN IN ACCORDANCE WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE 7th EDITION (2020) RESIDENTIAL

1. FLOOR & ROOF UNIFORM LOADS:
ELEVATED FLOORS: LIVE LOAD 40 PSF, DEAD LOAD 20 PSF
ROOF: LIVE TOP CHORD 20 PSF
LIVE BOTTOM CHORD 10 PSF (NON-CONCURRENT W/ TOLL)
CEMENT ROOF TILE DEAD LOAD 25 PSF TOTAL
SHINGLE/METAL ROOFING DEAD LOAD 15 PSF TOTAL
MINIMUM DEAD LOAD FOR WIND: TC 5 PSF, BC 5 PSF

DEFLECTION CRITERIA:
FLOOR L/480 LIVE, L/360 TOTAL
ROOF L/240 LIVE, L/180 TOTAL

2. WIND LOADS:
WIND DESIGN PER, ASCE7-16
BASIC WIND SPEED (ASCE7-16) 160 MPH
NOMINAL WIND SPEED (Vwsd TABLE R301.2.1.3) 124 MPH
BUILDING CATEGORY II
IMPORTANCE FACTOR 1.00
EXPOSURE C
MEAN ROOF HEIGHT = 15 FT
ROOF PITCH 5/12
ENCLOSURE CLASS ENCLOSED
INTERNAL PRES. COEFF. +/- 0.18
WINDOW/DOOR DESIGN WIND PRESSURE PER TABLE R301.2(2), R301.2(3) AND R301.2(4), SEE DETAIL ON S-3.
SOFFITS – PER R704, ALL SOFFITS & THEIR ATTACHMENTS SHALL BE CAPABLE OF RESISTING THE DESIGN PRESSURES SPECIFIED IN TABLE R301.2(2) FOR WALLS USING 10 SQ. FT.

3. REINFORCED CONCRETE:
DESIGN AS PER ACI 318-14
REQUIRED COMPRESSIVE STRENGTH AT 28 DAYS:
SLAB ON GRADE f'c = 2500 PSI
3/4" MINIMUM THICKNESS REINFORCED WITH 6x6 w1.4xw1.4 WWF OR FIBERMESH f'c = 2500 PSI
CONVENTIONAL SHALLOW FOOTINGS f'c = 3000 PSI
BEAMS AND COLUMNS f'c = 3000 PSI
ALL OTHER CONCRETE (U.N.O.) f'c = 3000 PSI
UNLESS OTHERWISE SHOWN ON DRAWINGS, MINIMUM CONCRETE COVER FOR REINFORCING SHALL BE AS FOLLOWS:
FOOTINGS 3" CENTERED
SLAB ON GRADE 1 1/2"
BEAMS 1 1/2"
COLUMNS 1 1/2"
ALL REINFORCING STEEL SHALL BE PLACED IN ACCORDANCE WITH THE TYPICAL BENDING DIAGRAMS AND PLACING DETAILS OF ACI STANDARDS AND SPECIFICATIONS. ALL REINFORCING STEEL SHALL BE HELD SECURELY IN POSITION WITH STANDARD ACCESSORIES DURING PLACING OF CONCRETE.
REINFORCING STEEL – ASTM A615 GRADE 40 FOR #3 GRADE 60 FOR #4 TO #11
WELDED WIRE FABRIC – ASTM A185
SPICES IN REINFORCING, SHALL BE 40 BAR DIAMETERS. NON-CONTACT LAP SPICES MAY BE USED PROVIDED REINFORCING IS NOT SPACED MORE THAN 5" APART FOR #5 BARS.
FORMWORK AND SHORING SHALL REMAIN IN PLACE UNTIL CONCRETE HAS REACHED AT LEAST 2/3 OF THE REQUIRED 28 DAY STRENGTH.

4. REINFORCED MASONRY:
DESIGN PER TMS 402/602-16
REQUIRED COMPRESSIVE STRENGTHS:
MASONRY WALLS f'm = 1500 PSI
REINFORCING STEEL – ASTM A615 GRADE 60.
SPICES IN REINFORCING, SHALL BE 48 BAR DIAMETERS.
ALL CONCRETE MASONRY UNITS SHALL BE COMPOSED OF ASTM C90, GRADE N-1 HOLLOW CONCRETE MASONRY UNITS WITH TYPE "S" MORTAR. GROUT ALL CELLS CONTAINING VERTICAL REINFORCEMENT WITH 3000 PSI PEA ROCK CONCRETE GROUT. ALL CELLS BELOW FINISHED GRADE SHALL BE GROUTED SOLID. ALL EXTERIOR WALLS SHALL BE REINFORCED FULL HEIGHT AT DOT LOCATIONS ON PLAN.

5. DELEGATED-ENGINEERED WOOD ROOF TRUSSES:
ALL WOOD ROOF TRUSSES SHALL BE DESIGNED BY A DELEGATED TRUSS ENGINEER PER RULE 61G15-31.003 OF THE FLORIDA ADMINISTRATIVE CODE. ALL TRUSSES SHALL HAVE TEMPORARY BRACING PER "COMMENTARY AND RECOMMENDATIONS FOR HANDLING, INSTALLING AND BRACING METAL PLATE CONNECTED WOOD TRUSSES, HIB-91." FOR OTHER BRACING REQUIREMENTS, NOTIFY ENGINEER. PROVIDE PERMANENT BRACING PER TRUSS MFR. SHOP DRAWINGS. IF PERMANENT BRACING IS NOT SPECIFIED, CONTACT ENGINEER.

6. FOUNDATION:
CONVENTIONAL SHALLOW CONCRETE FOOTINGS 2000 PSF
SOIL BEARING CAPACITY
THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING THE SUITABILITY OF THE SOIL CONDITIONS FOR THE INTENDED STRUCTURE AND ASSUMED SOIL BEARING CAPACITY. IT IS RECOMMENDED THAT A GEOTECHNICAL FIRM BE HIRED TO PERFORM A SITE EVALUATION.

7. DIMENSIONS: VERIFY ALL DIMENSIONS WITH HOUSE PLANS. SEE HOUSE PLANS, MECHANICAL, ELECTRICAL AND PLUMBING DRAWINGS FOR EMBEDS, OPENINGS, SLEEVES, ETC. WHICH ARE NOT SHOWN ON STRUCTURAL DRAWINGS.

8. MEANS AND METHODS: THE STRUCTURAL ENGINEER SHALL NOT HAVE CONTROL OR BE RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, PROCEDURES, OR SEQUENCES TEMPORARY BRACING, SHORING, GUYING OR OTHER MEANS TO SUPPORT STRUCTURAL ELEMENTS IN PLACE DURING CONSTRUCTION. FOR THE ACTS OR OMISSIONS OF THE CONTRACTOR, OR ANY OTHER PERSONS PERFORMING THE WORK OR FOR THE FAILURE OF ANY OF THEM TO CONSTRUCT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

9. SHOP DRAWINGS: SHOP DRAWINGS SHALL BE PREPARED AND SUBMITTED TO THE ENGINEER FOR REVIEW FOR ALL STRUCTURAL ELEMENTS UTILIZING PREFABRICATED COMPONENTS. ONE SET OF SIGNED & SEALED TRUSS ENGINEERING SHALL BE DELIVERED TO THE ENGINEER OF RECORD FOR THE STRUCTURE PER FLORIDA ADMINISTRATIVE CODE 61G15-30.005 AND 61G15-31.003.

At Exterior Stud Walls and Gable Ends with Wall Sheathing, apply plaster over metal lath over water resistive barrier as follows:
Plaster R703.7.2.3: 3-coat 7/8" thick portland cement based plaster per ASTM C926.
Metal Lath R703.7.1: Self furring paper backed 2.5lb diamond mesh metal lath per ASTM C947, G60 galvanized, fastened per ASTM C1063 with 1-1/2" long, 11 gage nails with 7/16" head (roofing nails) at 7" oc, or 1-1/2" long, 16 gage staples at 6" oc, into the framing members (ie, the nails or staples must align with and penetrate 3/4" into the framing studs).
Water Resistive Barrier (WRB) R703.7.3: Water-resistive vapor-permeable barrier with a performance at least equivalent to 2 layers of Grade D paper. The individual layers shall be installed independently. An approved house wrap may be used for the 1st layer and metal lath with approved paper backing may be the 2nd layer (Note: ZIP wall sheathing with seam tape qualifies as the first layer).

2x4 BLOCK AT SHEATHING JOINT

ROOF SHEATHING, SEE SCHEDULE

2x6 (MIN) SPF #2 W/ 3-16d TO EACH TRUSS

3-12d TOE NAILS

2x4 BLOCKING

2x4 OUTLOOKER

H2.5A CLIP @ EA. OUTLOOKER TO TRUSS

TRUSS TOP CHORD, DROP 3/2"

DROPPED GABLE TRUSS OUTLOOKER DETAIL

SCALE: N.T.S.

REVISIONS	BY

STRUCTURAL ENGINEERING:

STRUCTURAL SYSTEMS OF NORTH FLORIDA

1634 S.E. 47th STREET, SUITE #3
CAPE CORAL, FL 33904
(239) 549-4554
CA # 8629

DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 7th EDITION (2020) RESIDENTIAL

BUILDER:

D.R. HORTON • INC.

America's Builder

STRUCTURAL DETAILS FOR

1498 SIGNATURE VILLA

20571 – 20567 PLUMWOOD LOOP
NORTH FORT MYERS, FLORIDA
LOT: 91 – 92 SUBDIVISION: MAGNOLIA

DESIGN/DRAWN
DWB/DWB

CHECKED
DWB

DATE
09/02/21

SCALE
AS NOTED


JOB NO.
DR 13346

SHEET


S-1

SHEET 1 OF 2


FOR SCOSTA TRUSSES, JOB # DR1498, DATED 11/24/20, REVISED: NONE

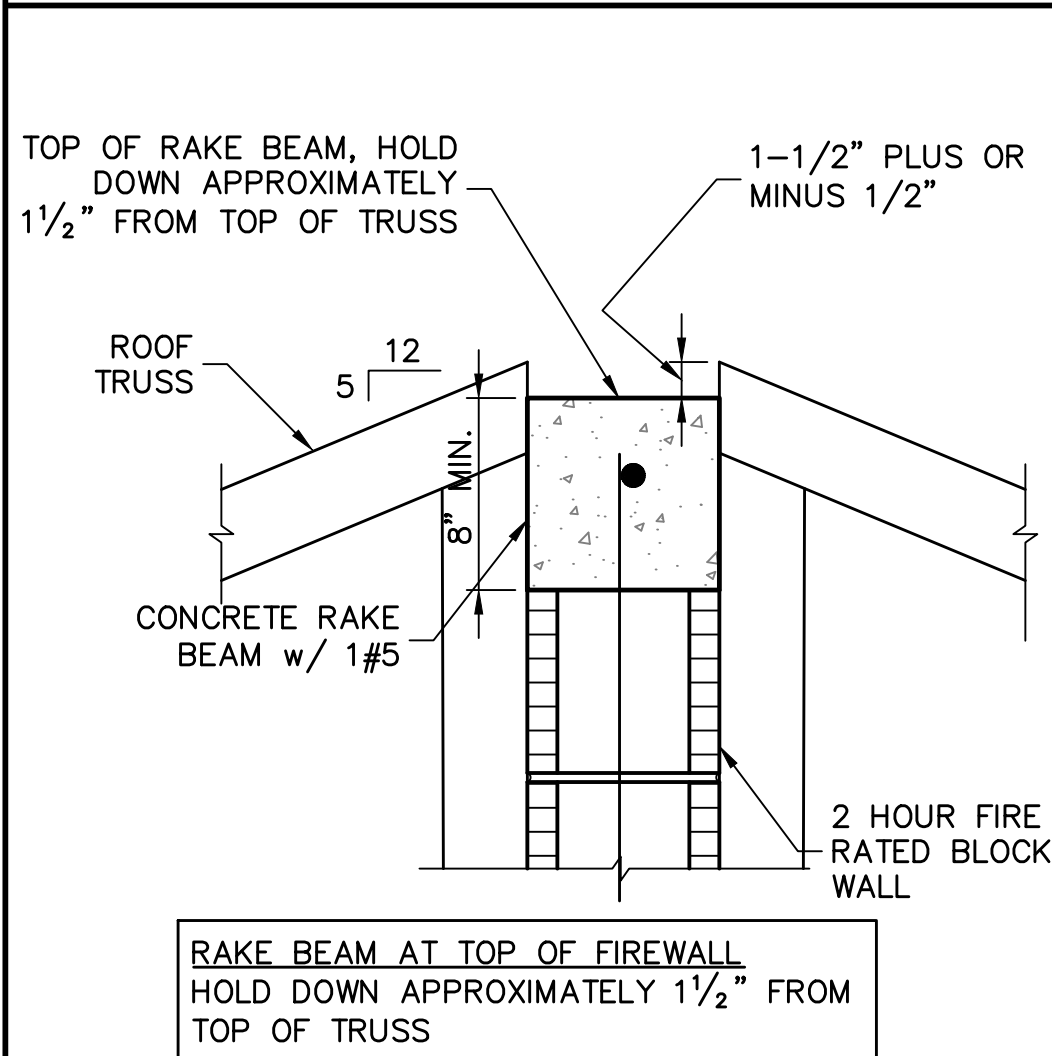


1A TOP OF FIREWALL
SCALE: 1-1/2" = 1'-0"

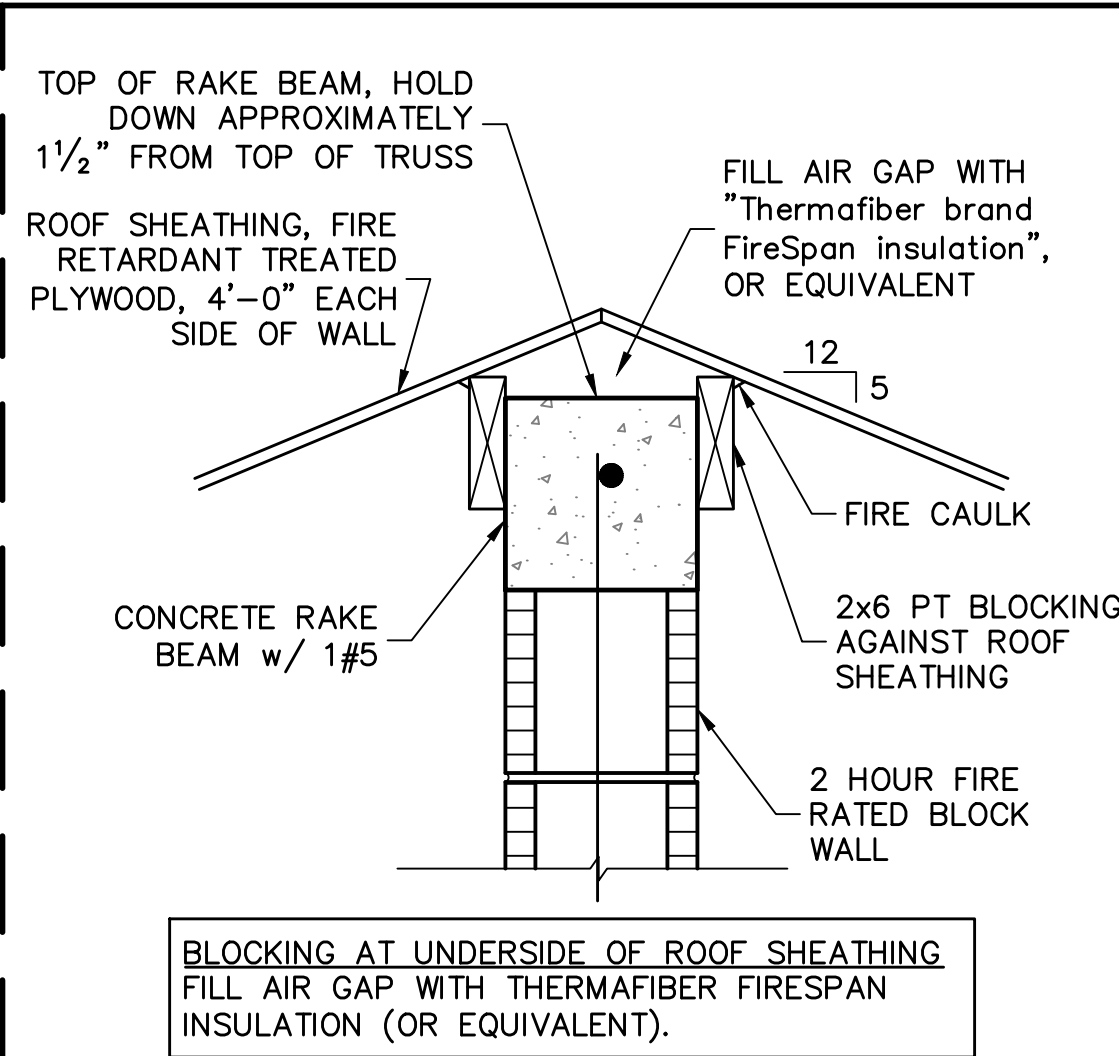


1B TOP OF FIREWALL
SCALE: 1-1/2" = 1'-0"

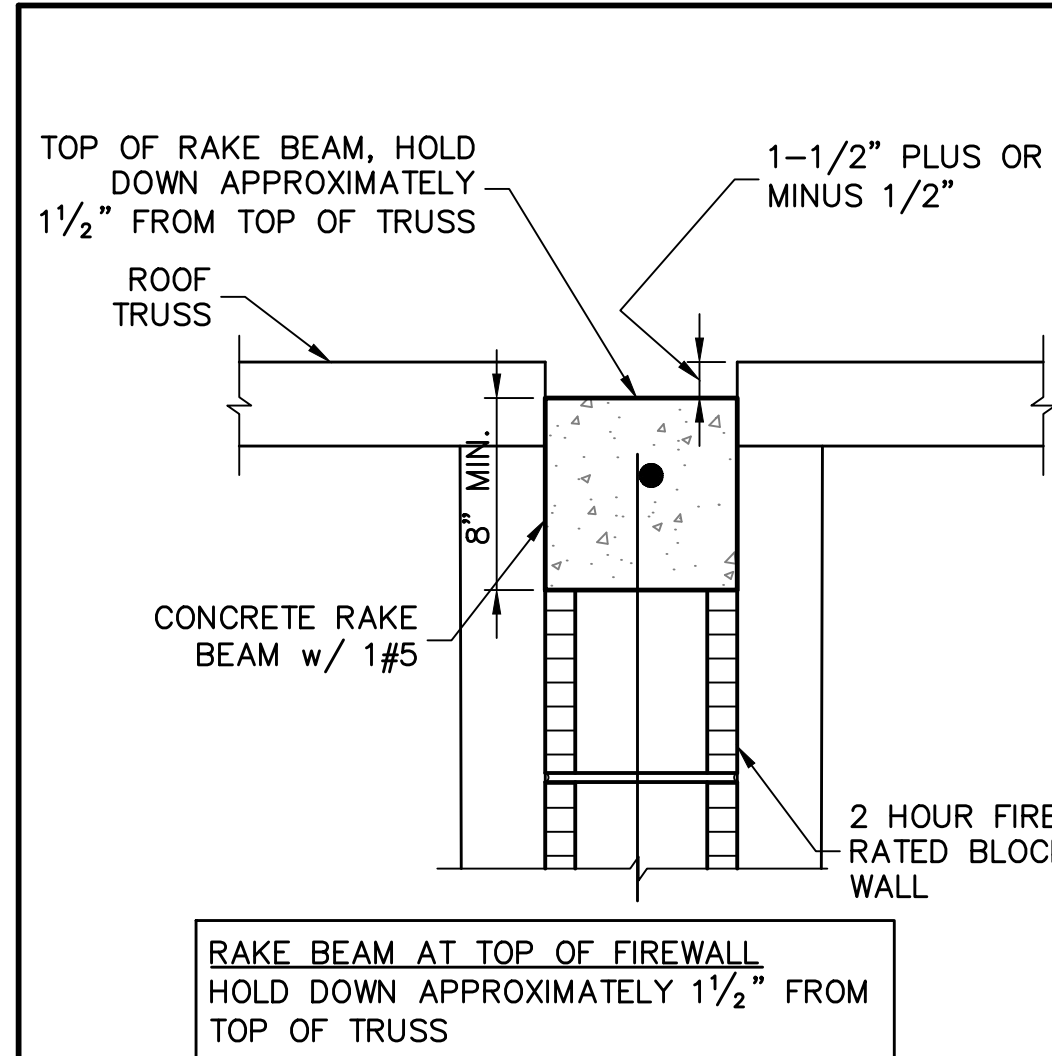


2A TOP OF FIREWALL
SCALE: 1-1/2" = 1'-0"

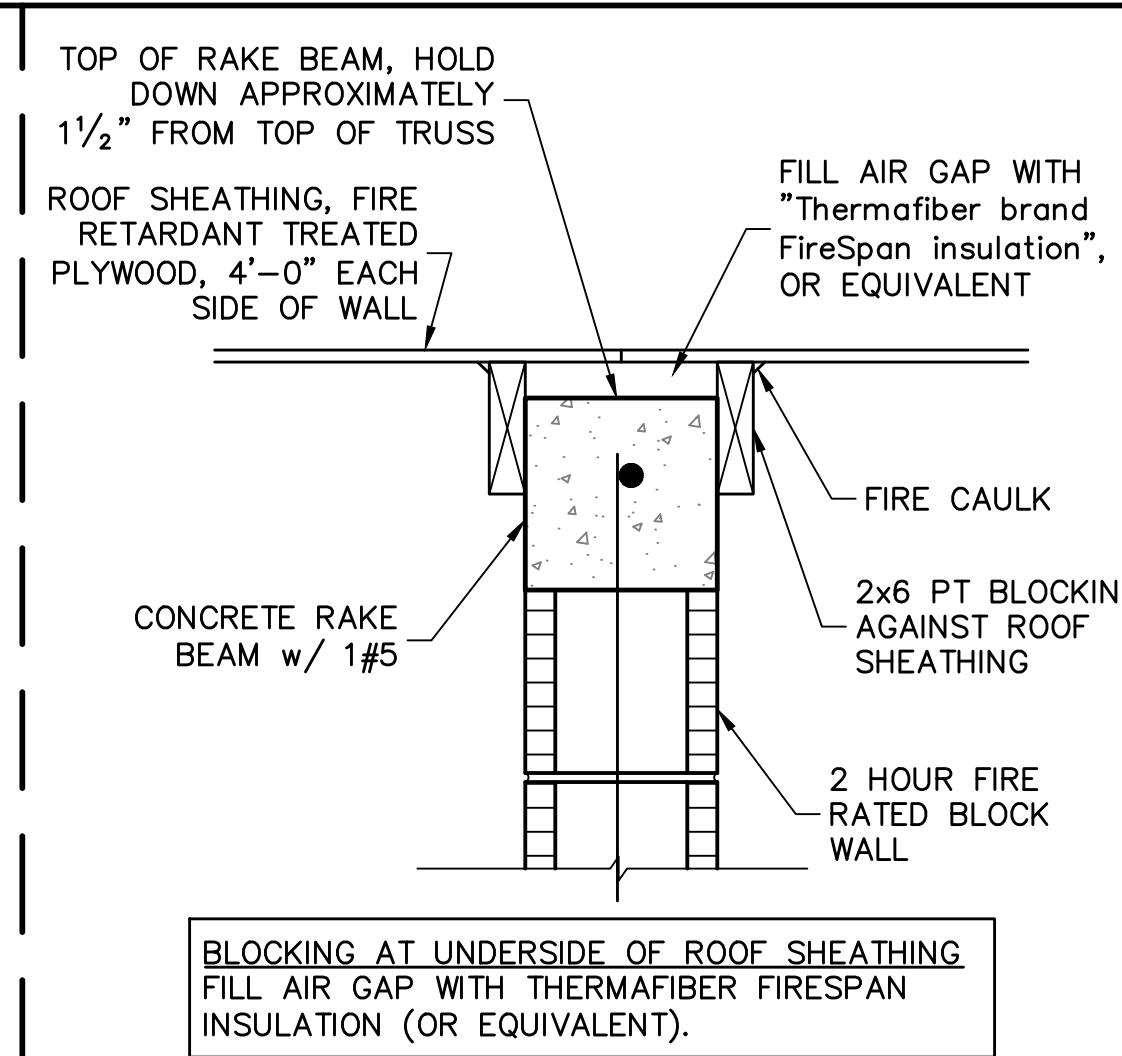


2B TOP OF FIREWALL
SCALE: 1-1/2" = 1'-0"

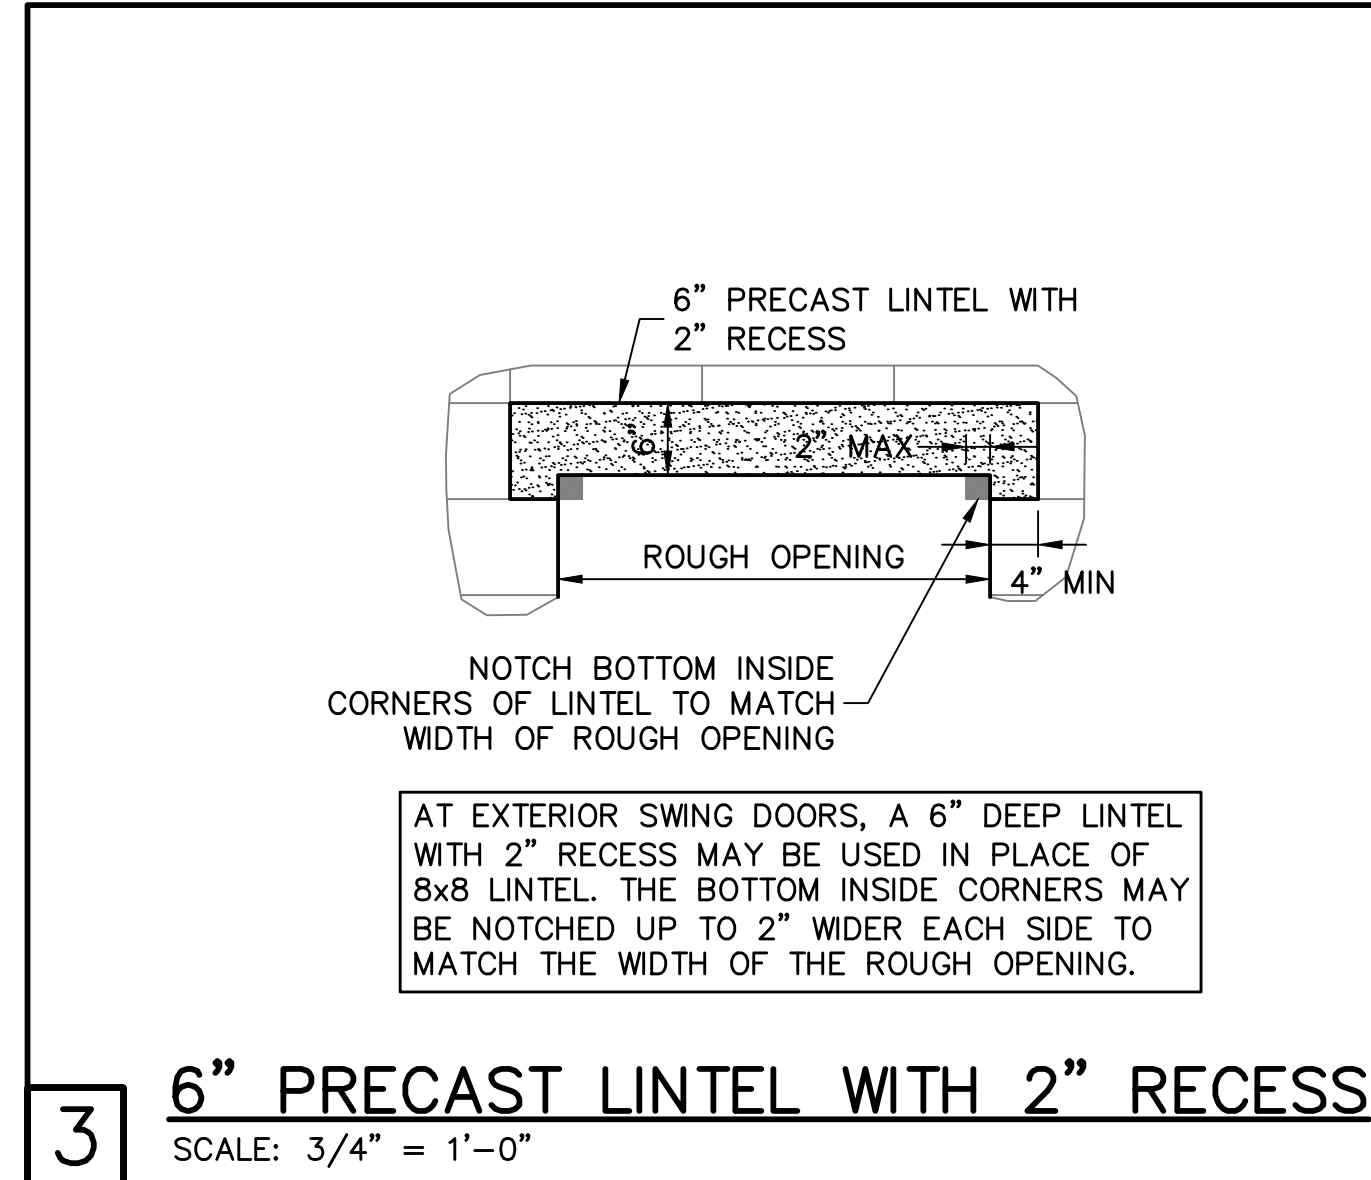

3 6" PRECAST LINTEL WITH 2" RECESS
SCALE: 3/4" = 1'-0"

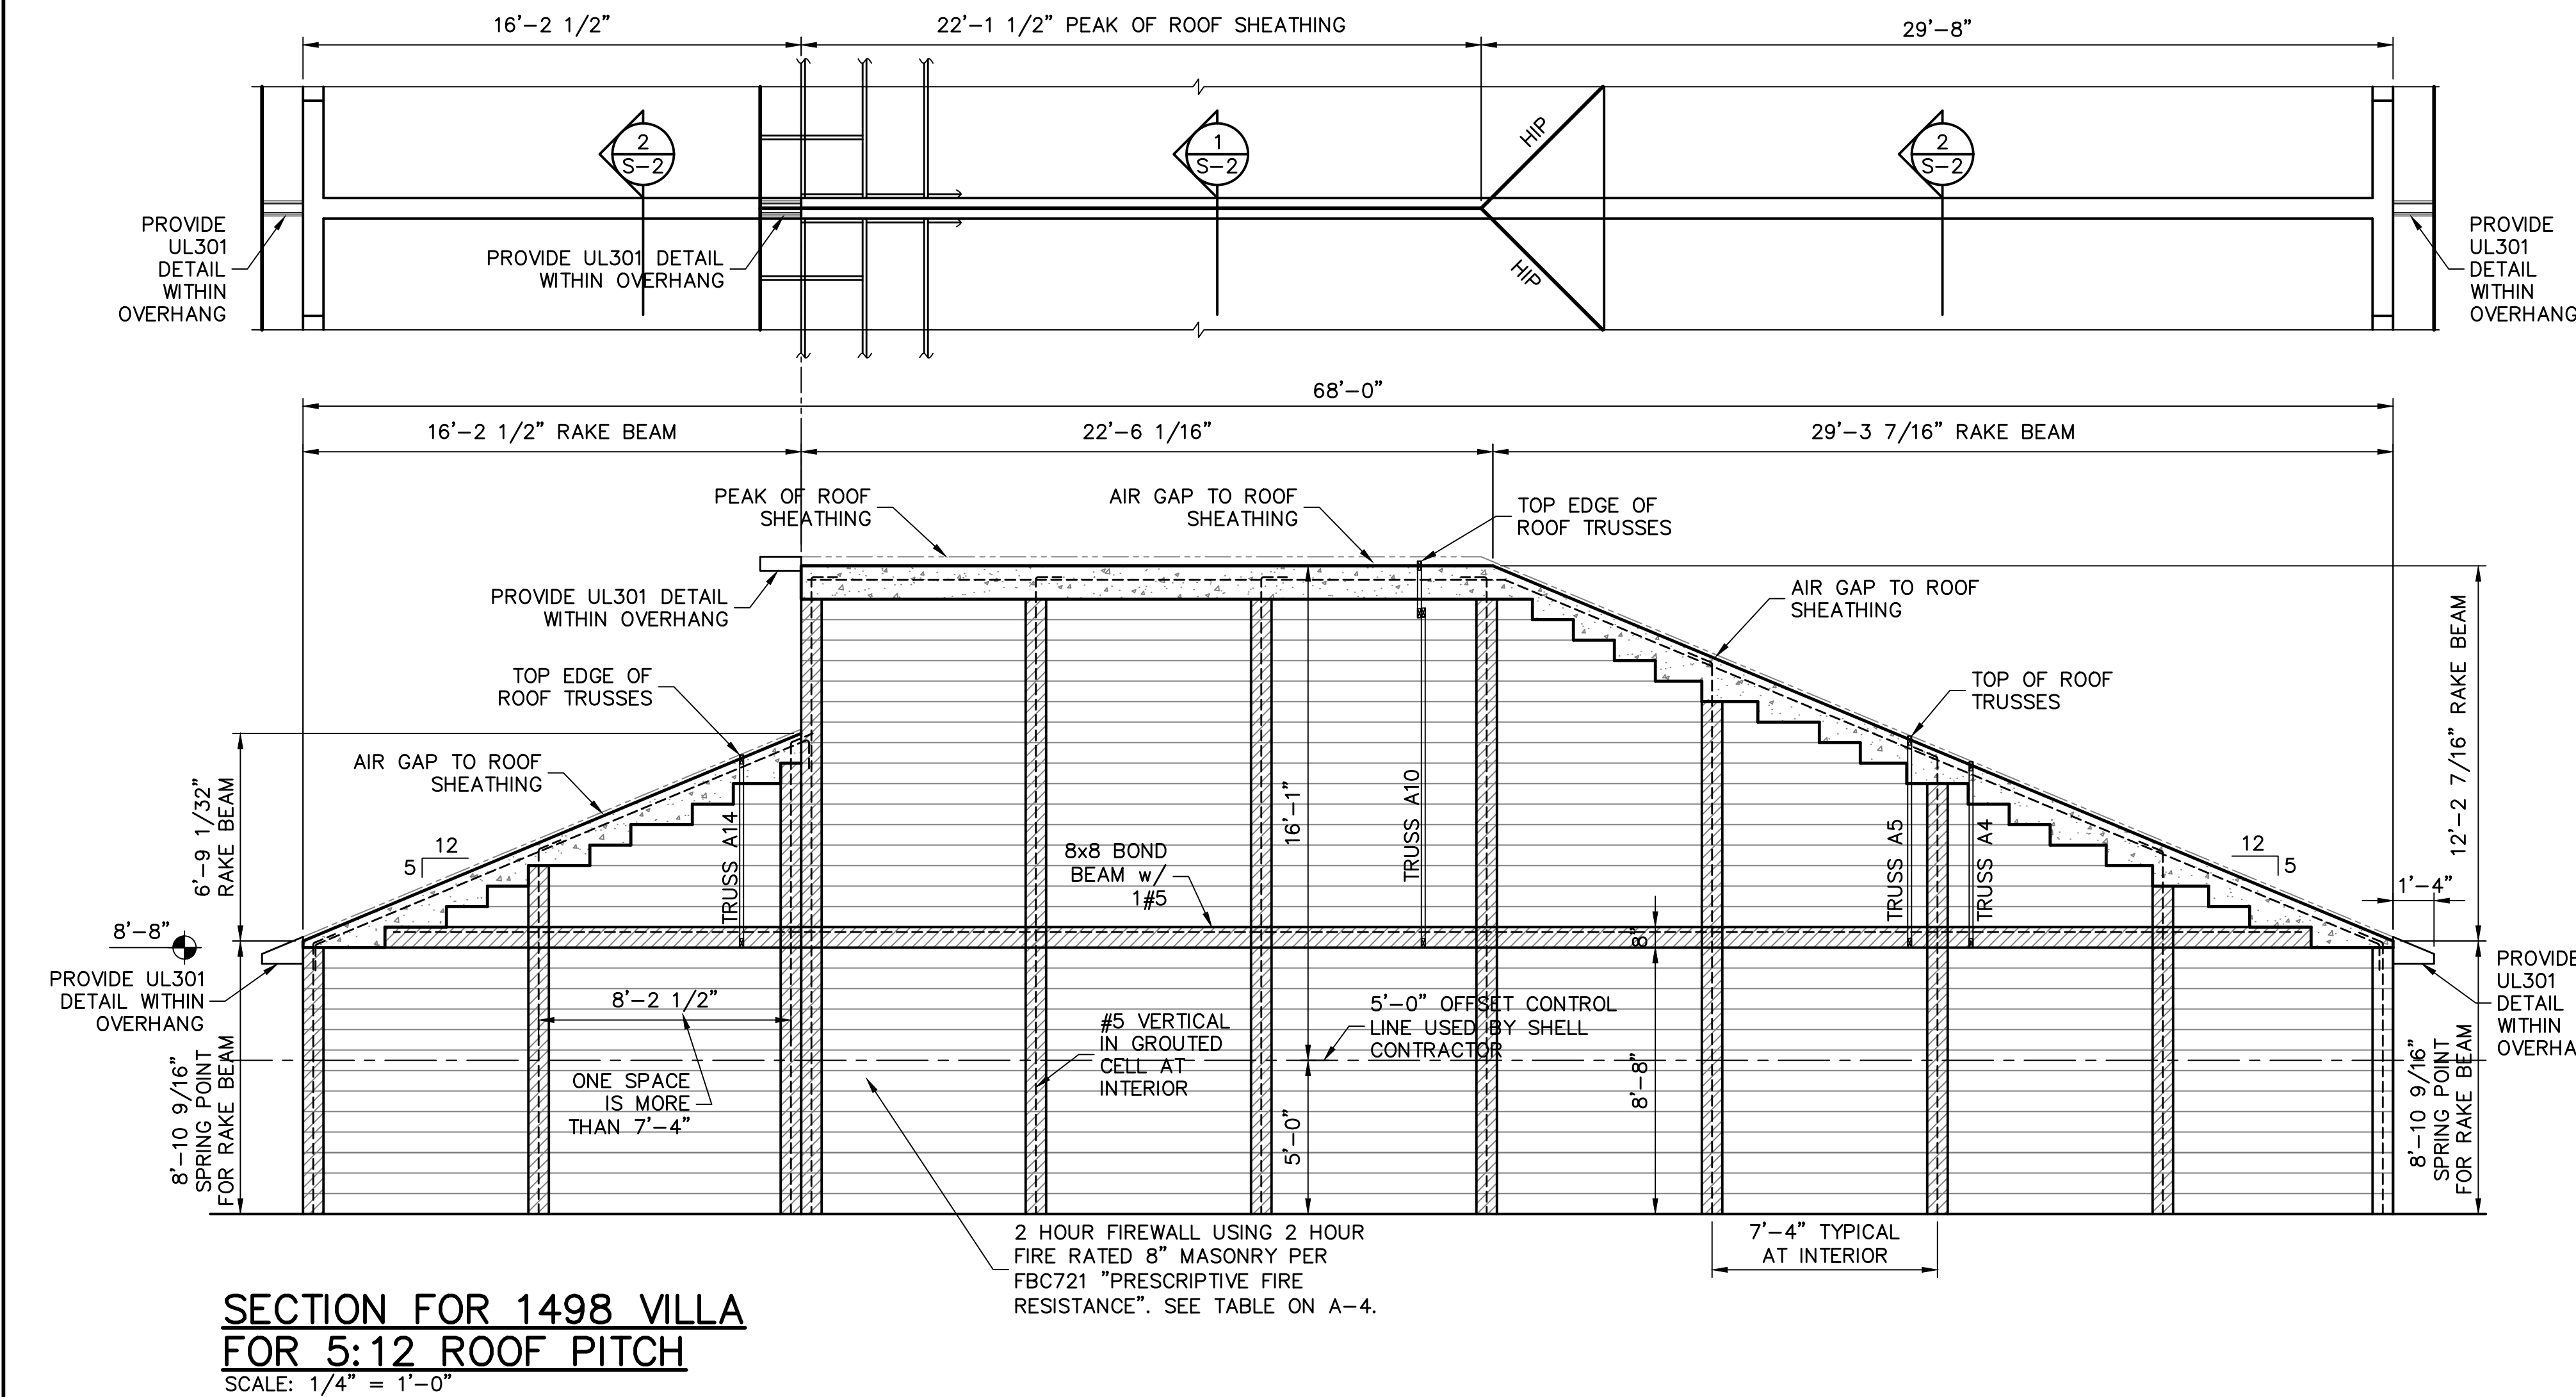


SECTION FOR 1498 VILLA FOR 5:12 ROOF PITCH
SCALE: 1/4" = 1'-0"

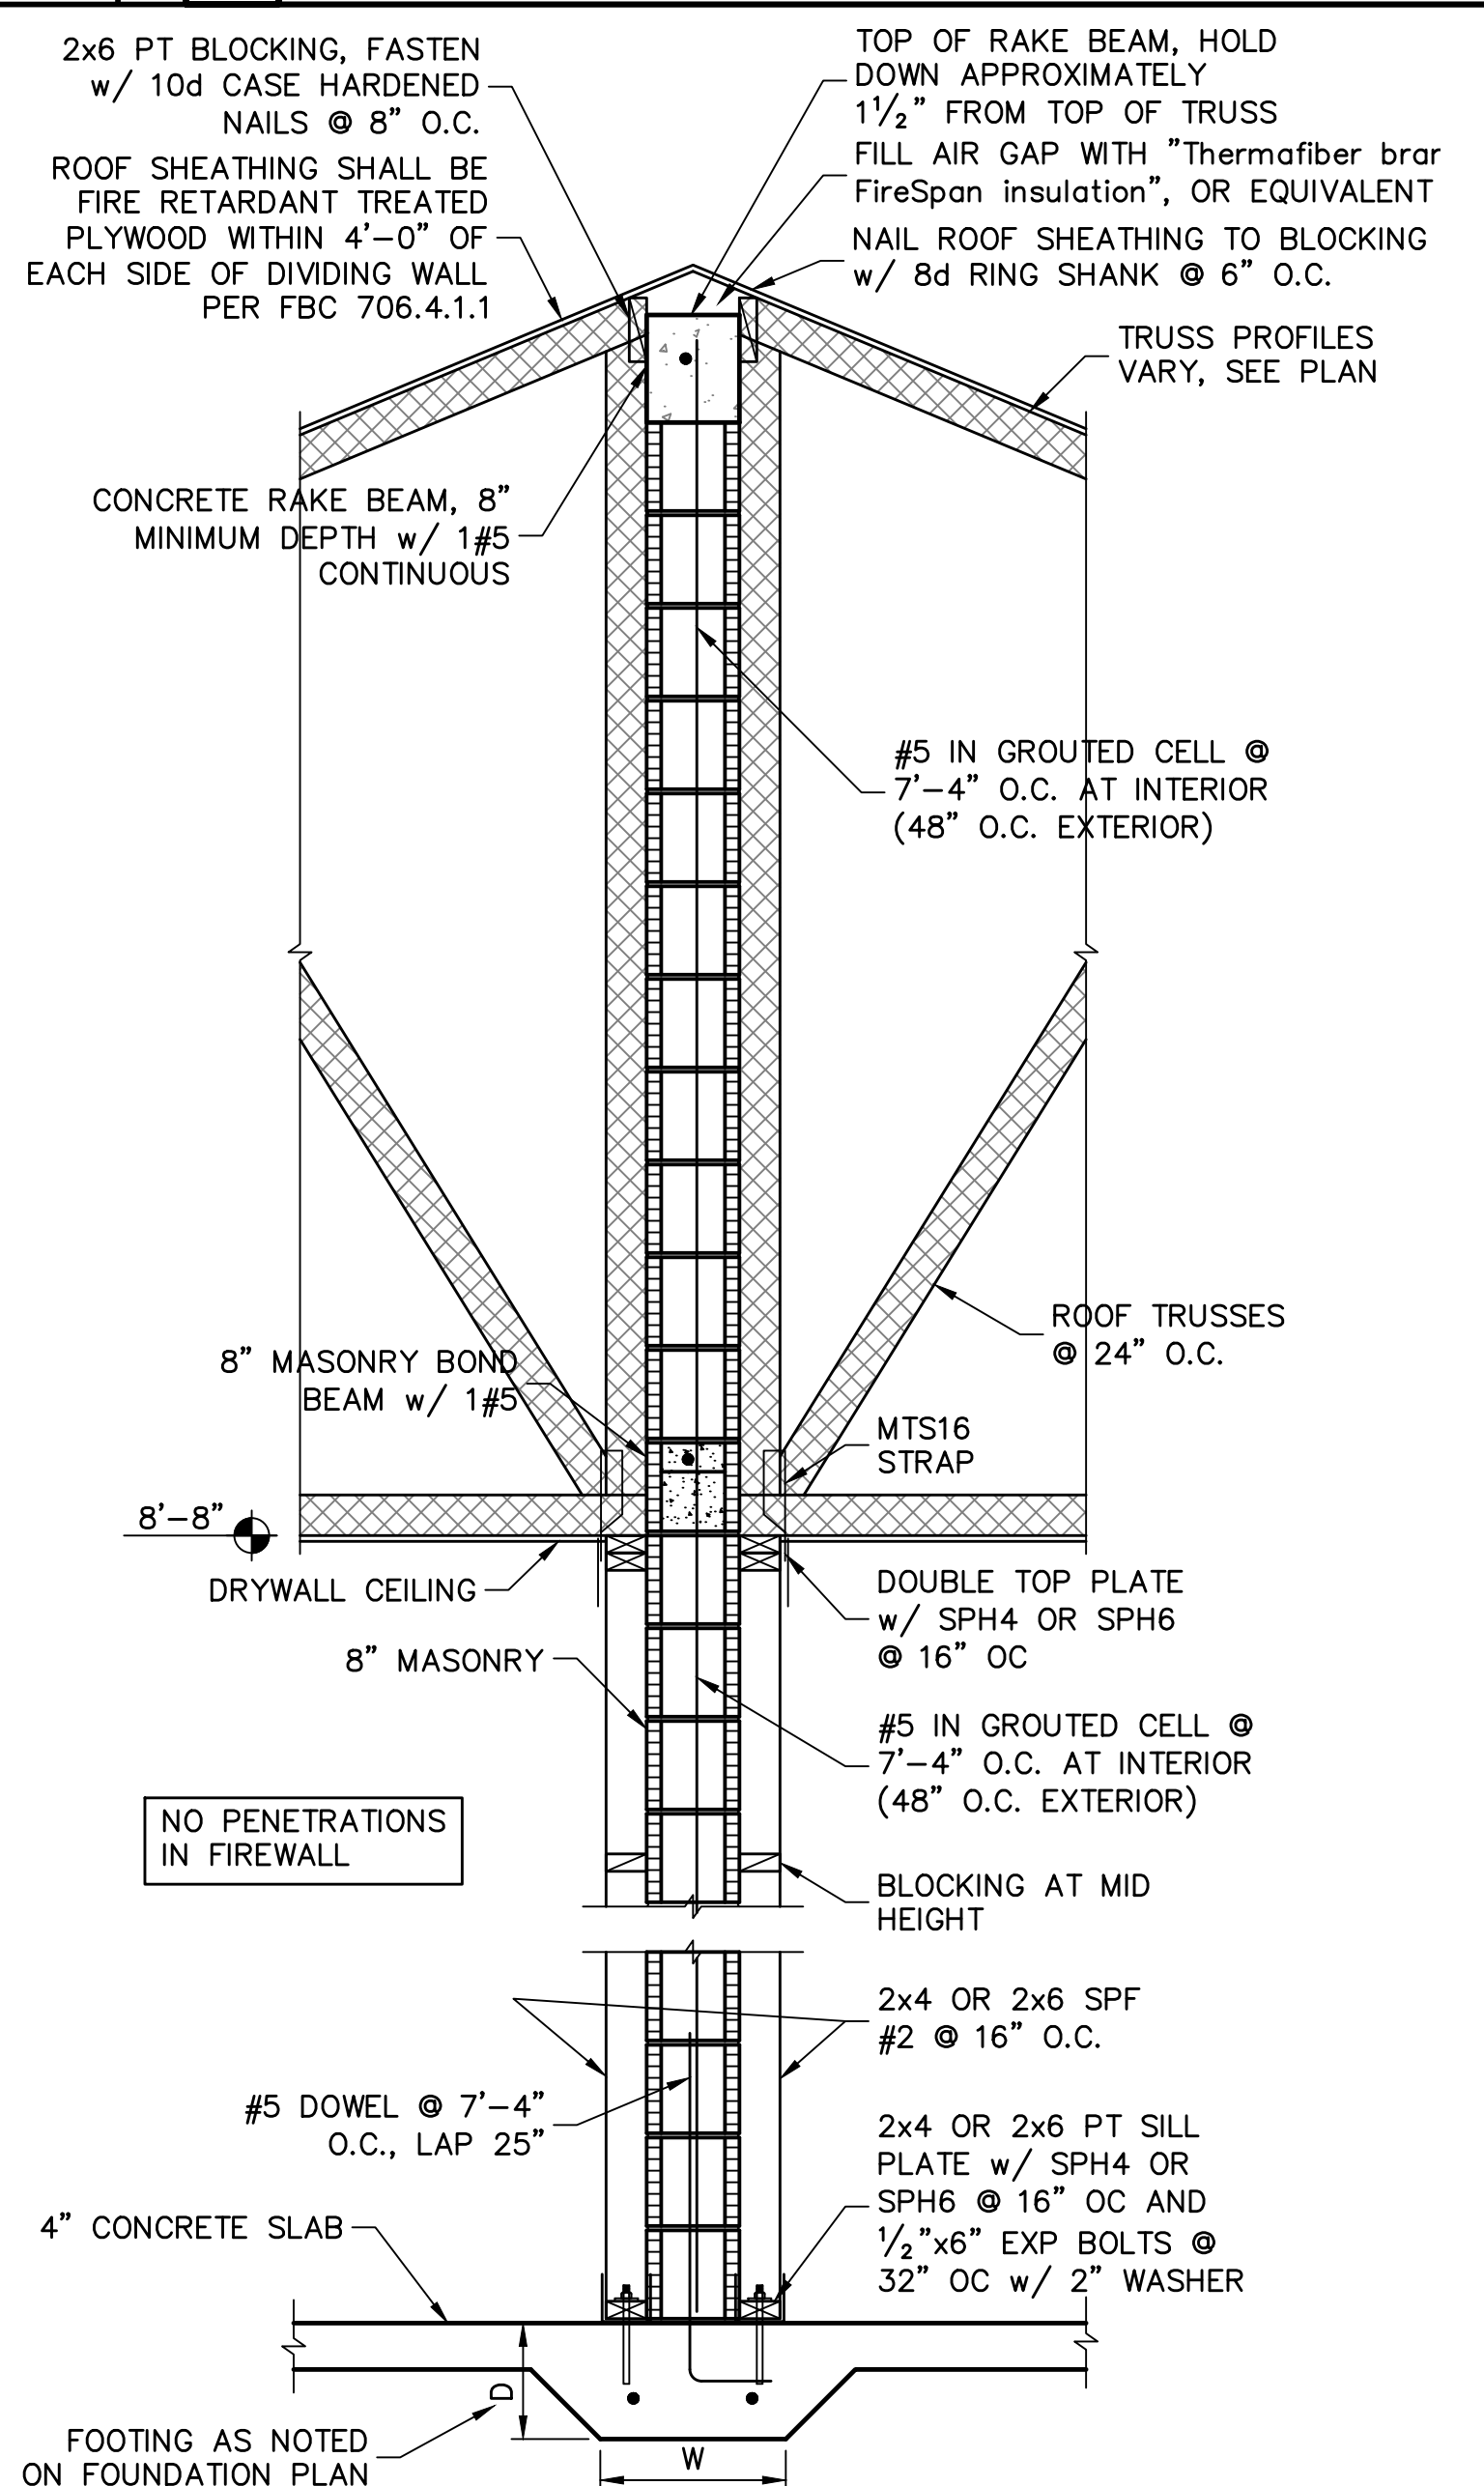

5 2 HOUR FIREWALL AT LIVING AREA
SCALE: 3/4" = 1'-0"

REVISIONS	BY

STRUCTURAL ENGINEERING:
STRUCTURAL SYSTEMS OF NORTH FLORIDA
1834 SE. 47th STREET, SUITE #3
FORT MYERS, FL 33904
(239) 541-9454
CA# 8829

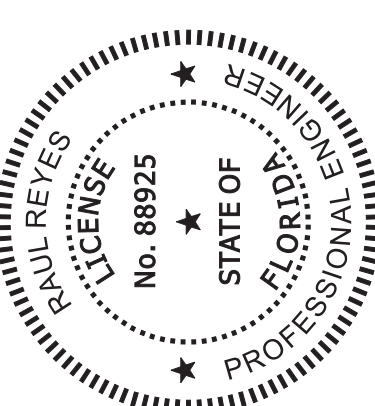

DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 7th EDITION (2020) RESIDENTIAL
BUILDER:
DR. HORTON
America's Builder

STRUCTURAL DETAILS FOR
1498 SIGNATURE VILLA
20571 - 20567 PLUMWOOD LOOP
NORTH FORT MYERS, FLORIDA
LOT: 91 - 92 SUBDIVISION: MAGNOLIA

DESIGN/DRAWN
DWB/DWB
CHECKED
DWB
DATE
09/02/21
SCALE
AS NOTED
JOB NO.
DR 13346
SHEET

S-2
SHEET 2 OF 2

FOR SCOSTA TRUSSES, JOB # DR1498, DATED 11/24/20, REVISED: NONE