


JOB No.	MASTER
DATE DRAWN	1/29/2018
DATE PRINTED	1/12/2021

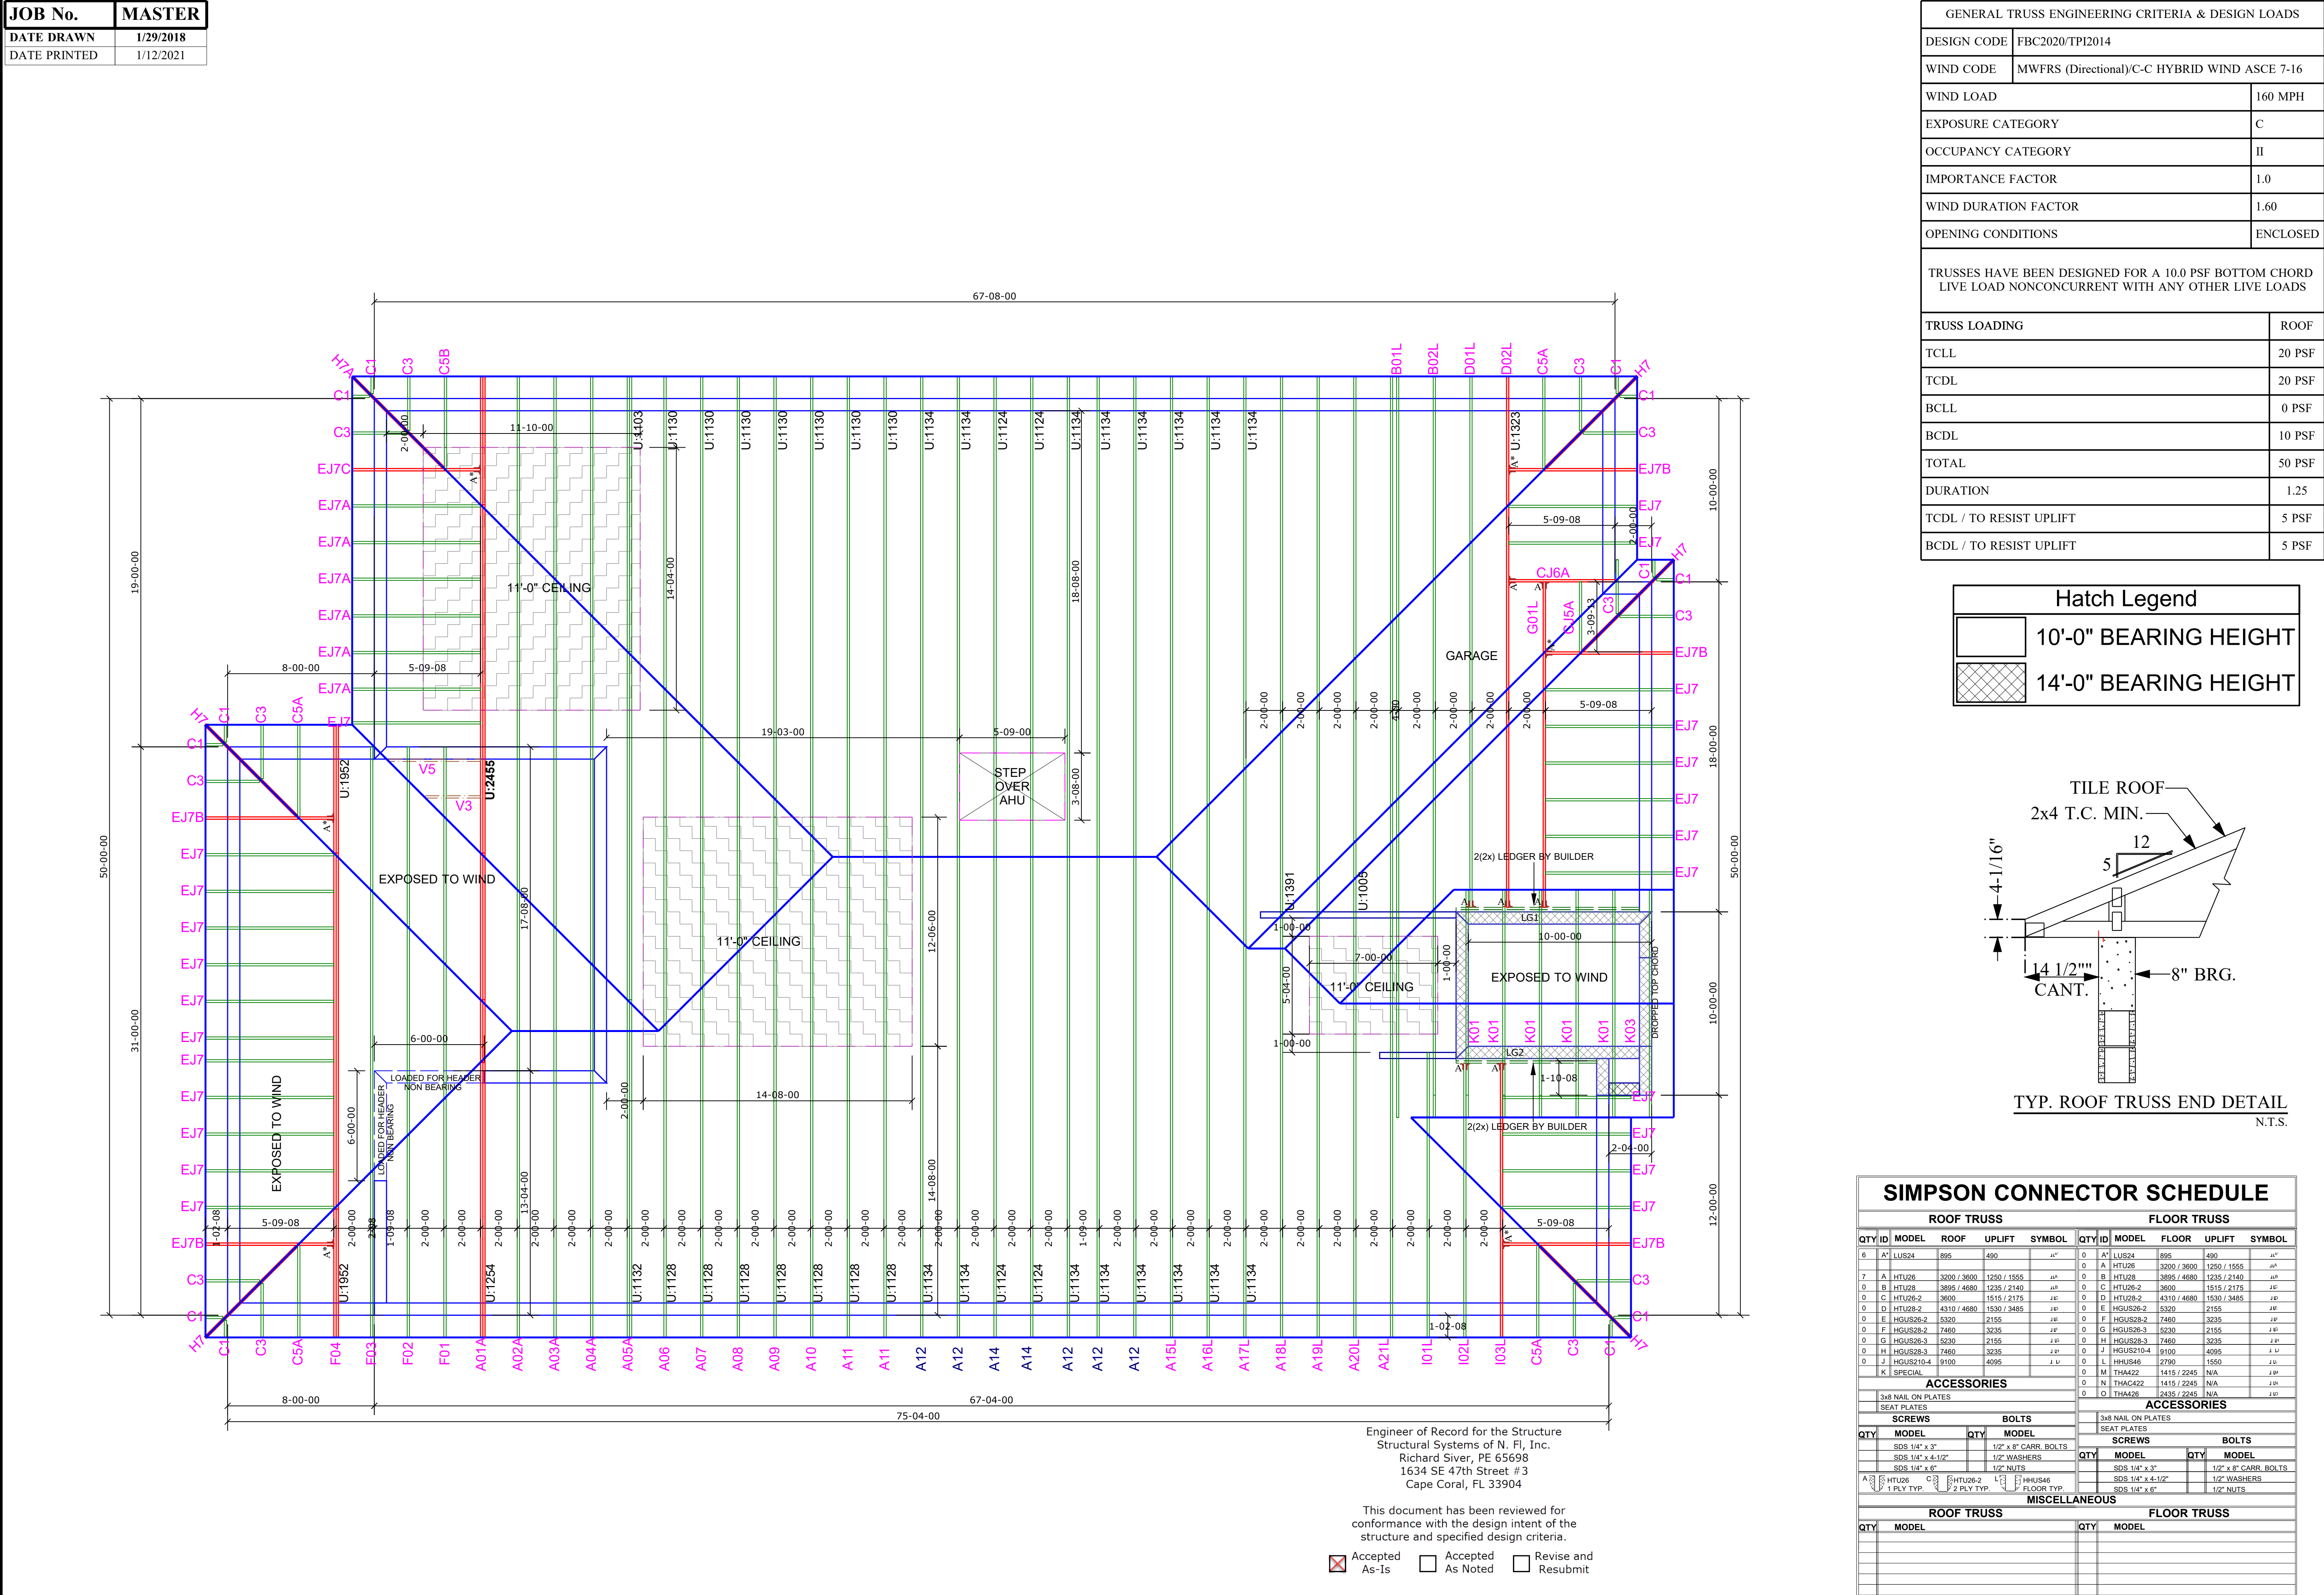

GENERAL TRUSS ENGINEERING CRITERIA & DESIGN LOADS									
DESIGN CODE		FBC2020/TP12014							
WIND CODE		MWFRS (Directional)/C-C HYBRID WIND ASCE 7-16							
WIND LOAD		160 MPH							
EXPOSURE CATEGORY		C							
OCCUPANCY CATEGORY		II							
IMPORTANCE FACTOR		1.0							
WIND DURATION FACTOR		1.60							
OPENING CONDITIONS		ENCLOSED							
TRUSSES HAVE BEEN DESIGNED FOR A 10.0 PSF BOTTOM CHORD LIVE LOAD NONCONCURRENT WITH ANY OTHER LIVE LOADS									
TRUSS LOADING		ROOF							
TCLL		20 PSF							
TCDL		20 PSF							
BCLL		0 PSF							
BCDL		10 PSF							
TOTAL		50 PSF							
DURATION		1.25							
TCDL / TO RESIST UPLIFT		5 PSF							
BCDL / TO RESIST UPLIFT		5 PSF							

DO NOT ATTEMPT TO ERECT TRUSSES WITHOUT REFERRING TO THE ENGINEERING DRAWINGS AND BSCI-B1 SUMMARY SHEETS.	
ALL PERMANENT BRACING MUST BE IN PLACE PRIOR TO LOADING TRUSSES. (ie. SHEATHING, SHINGLES, ETC.)	
ALL INTERIOR BEARING WALLS MUST BE IN PLACE PRIOR TO INSTALLING TRUSSES.	
REFER TO FINAL ENGINEERING SHEETS FOR THE FOLLOWING.	
1) NUMBER OF GIRDER PLIES AND NAILING SCHEDULE.	
2) BEARING BLOCK REQUIREMENTS.	
3) SCAB DETAILS (IF REQUIRED)	
4) UPLIFT AND GRAVITY REACTIONS.	

WARNING	
BACK CHARGES WILL NOT BE ACCEPTED REGARDLESS OF FAULT WITHOUT PRIOR NOTIFICATION BY CUSTOMER WITHIN 48 HOURS AND INVESTIGATION BY Builders FirstSource. NO EXCEPTIONS.	

THE GENERAL CONTRACTOR IS RESPONSIBLE FOR ALL CONNECTIONS OTHER THAN TRUSS TO TRUSS, GABLE SHEAR WALL, AND CONNECTIONS. TEMPORARY AND PERMANENT BRACING, AND CEILING AND ROOF DIAPHRAM CONNECTIONS.	
---	--

ROOF PITCH	5/12
CEILING PITCH	FLAT
TOP CHORD SIZE	2 x 4 MIN.
BOTTOM CHORD SIZE	2 x 4 MIN.
OVERHANG LENGTH	N/A
CANTILEVER	14 1/2"
END CUT	PLUMB
FLOOR TRUSS SPACING	N/A
ROOF TRUSS SPACING	24"

BUILDER	DR Horton
PROJECT	2540 L 160 C EXT LANAI RH
MODEL	2540
ADDRESS	--
CITY, STATE	--
LOT	--
COUNTY	--
DRAWN BY	D.W.
ENG. BY	D.W.

REVISIONS			
No.	DATE	NOTES	BY

IMPORTANT			
This Drawing Must Be Approved And Returned Before Fabrication Will Begin. For Your Protection Check All Dimensions And Conditions Prior To Approval Of Plan.			
SIGNATURE BELOW INDICATES ALL NOTES AND DIMENSIONS HAVE BEEN ACCEPTED.			
By		Date	

6850 Taylor Road Punta Gorda, FL 33950 Phone: 941-575-2250 / Fax:941-575-0319			
--	--	--	--

Builder's FirstSource			
-----------------------	--	--	--

SIMPSON CONNECTOR SCHEDULE			
ROOF TRUSS			
QTY	ID	MODEL	SYMBOL
6	A	LUS24	895
7	A	HTU28	3200 / 3600
0	B	HTU28-2	3895 / 4680
0	C	HTU28-2	4310 / 4680
0	D	HTU28-2	4310 / 4680
0	E	HGUS28-2	5320
0	F	HGUS28-2	5320
0	G	HGUS28-2	5320
0	H	HGUS28-2	5320
0	I	HGUS28-2	5320
0	J	HGUS28-2	5320
0	K	HGUS28-2	5320
ACCESSORIES			
3x8 NAIL ON PLATES			
SEAT PLATES			
SCREWS			
QTY	MODEL	QTY	MODEL
	SDS 1/4" x 3"		1/2" x 8" CARR. BOLTS
	SDS 1/4" x 4-1/2"		1/2" WASHERS
	SDS 1/4" x 6"		1/2" NUTS
FLOOR TRUSS			
QTY	ID	MODEL	SYMBOL
0	A	LUS24	895
0	B	HTU28	3200 / 3600
0	C	HTU28-2	3895 / 4680
0	D	HTU28-2	4310 / 4680
0	E	HGUS28-2	5320
0	F	HGUS28-2	5320
0	G	HGUS28-2	5320
0	H	HGUS28-2	5320
0	I	HGUS28-2	5320
0	J	HGUS28-2	5320
0	K	HGUS28-2	5320
ACCESSORIES			
3x8 NAIL ON PLATES			
SEAT PLATES			
SCREWS			
QTY	MODEL	QTY	MODEL
	SDS 1/4" x 3"		1/2" x 8" CARR. BOLTS
	SDS 1/4" x 4-1/2"		1/2" WASHERS
	SDS 1/4" x 6"		1/2" NUTS
MISCELLANEOUS			
FLOOR TRUSS			
QTY	MODEL	QTY	MODEL


NOTES:

- ALL DIMENSIONS ARE FEET-INCHES-SIXTEENTHS.
- DO NOT CUT OR ALTER TRUSSES IN ANY WAY.
- ALL REACTIONS ARE UNDER 5000 LBS. UNLESS NOTE OTHERWISE.
- ALL UPLIFTS ARE UNDER 1000 LBS. UNLESS NOTED OTHERWISE.
- FRAMING REQUIRED BELOW TRUSSES TO GET DESIRED CEILING CONDITIONS.
- ONLY TRUSS TO TRUSS CONNECTIONS SUPPLIED W/ TRUSS PACKAGE.


Engineer of Record for the Structure
Structural Systems of N. Fl. Inc.
Richard Siver, PE 65698
1634 SE 47th Street #3
Cape Coral, FL 33904

This document has been reviewed for
conformance with the design intent of the
structure and specified design criteria.


Accepted As-Is Accepted As Noted Revise and Resubmit

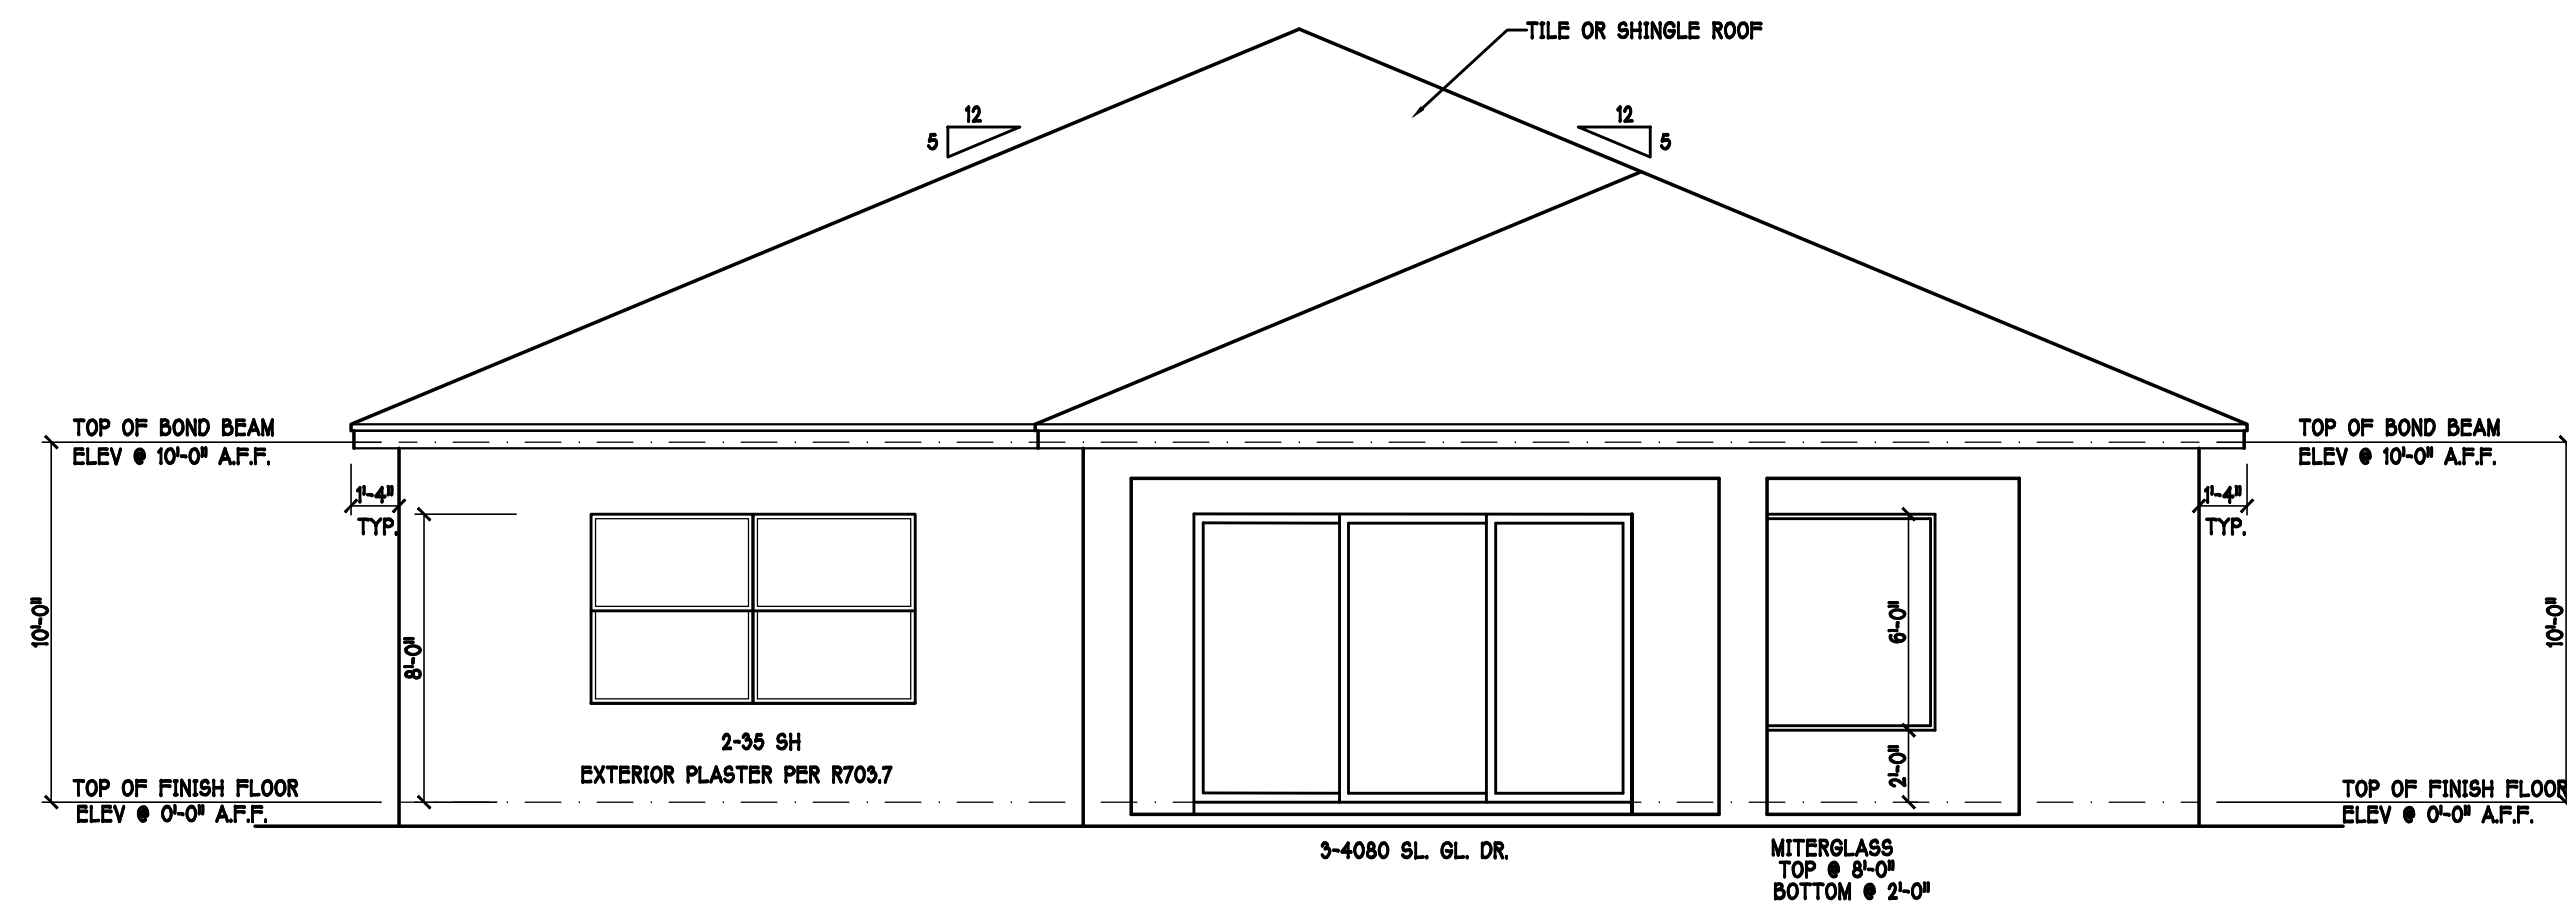


REAR ELEVATION: "L" SCALE: 3/16" = 1'-0"

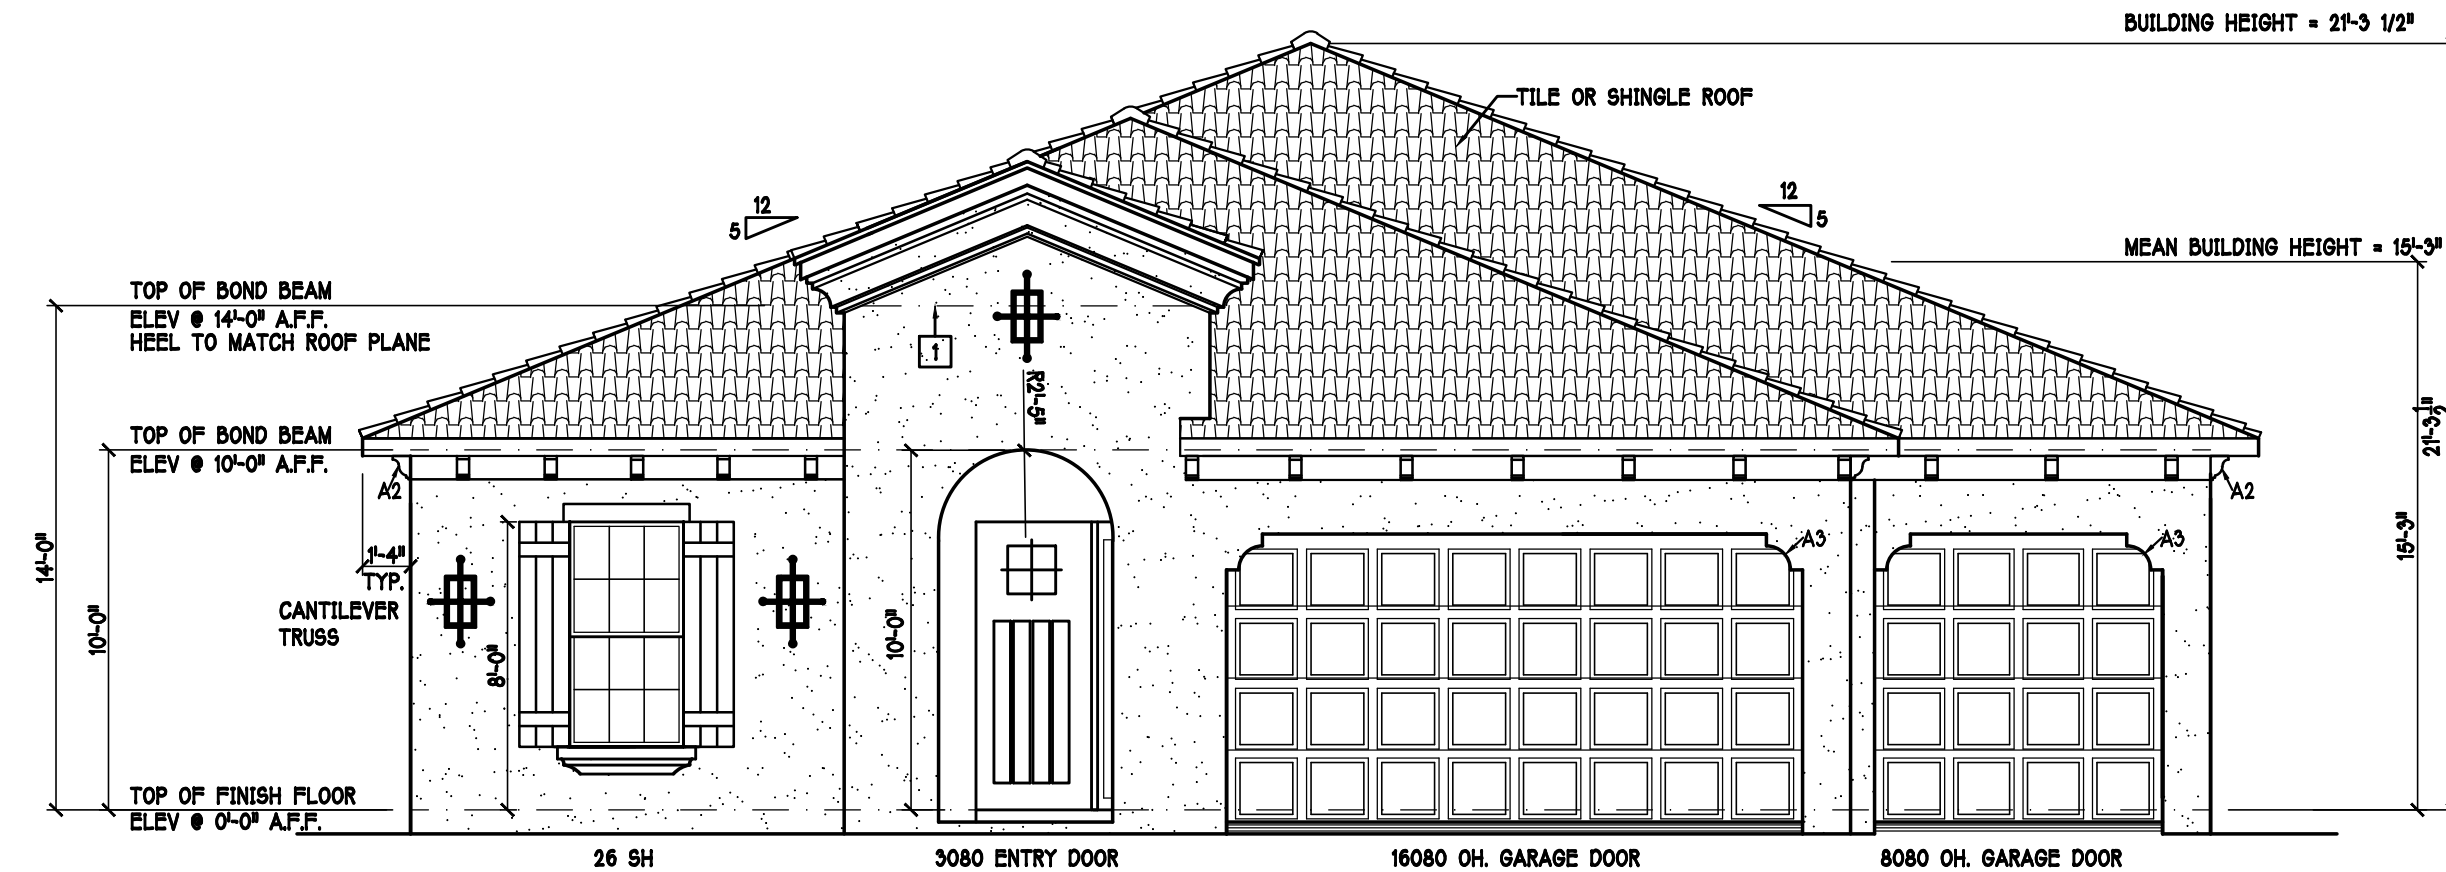

FRONT ELEVATION: "L" SCALE: 3/16" = 1'-0"

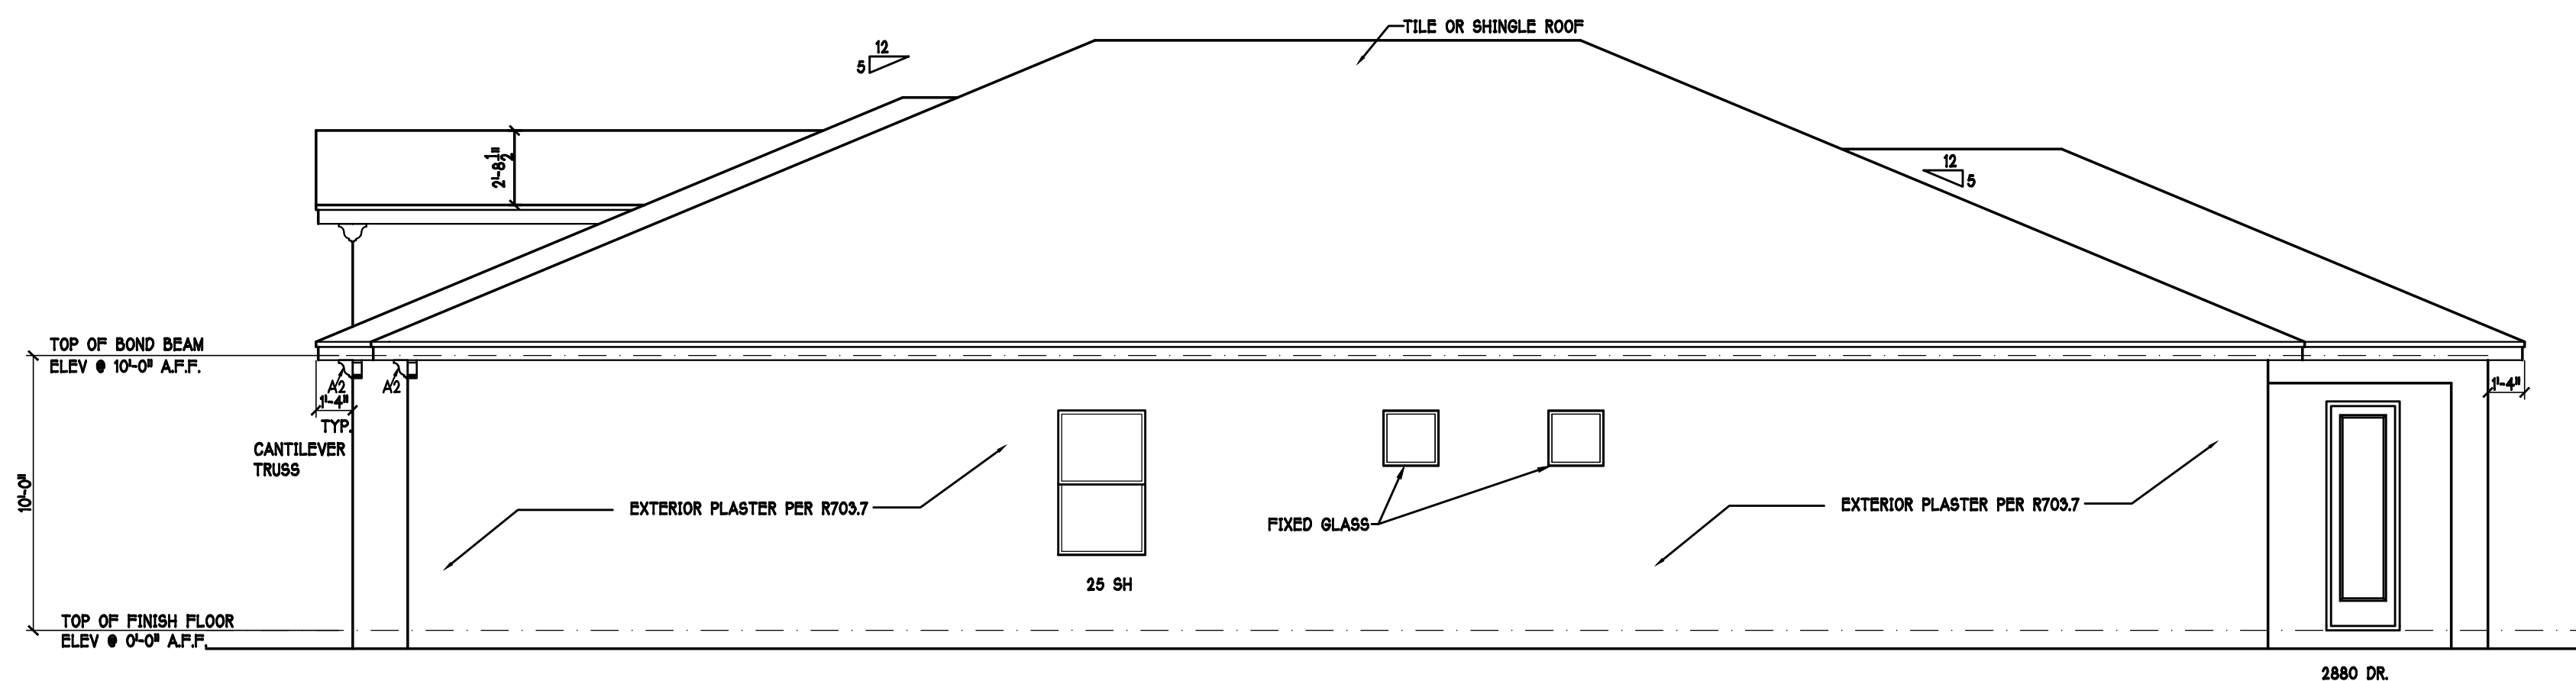

RIGHT ELEVATION: "L" SCALE: 3/16" = 1'-0"



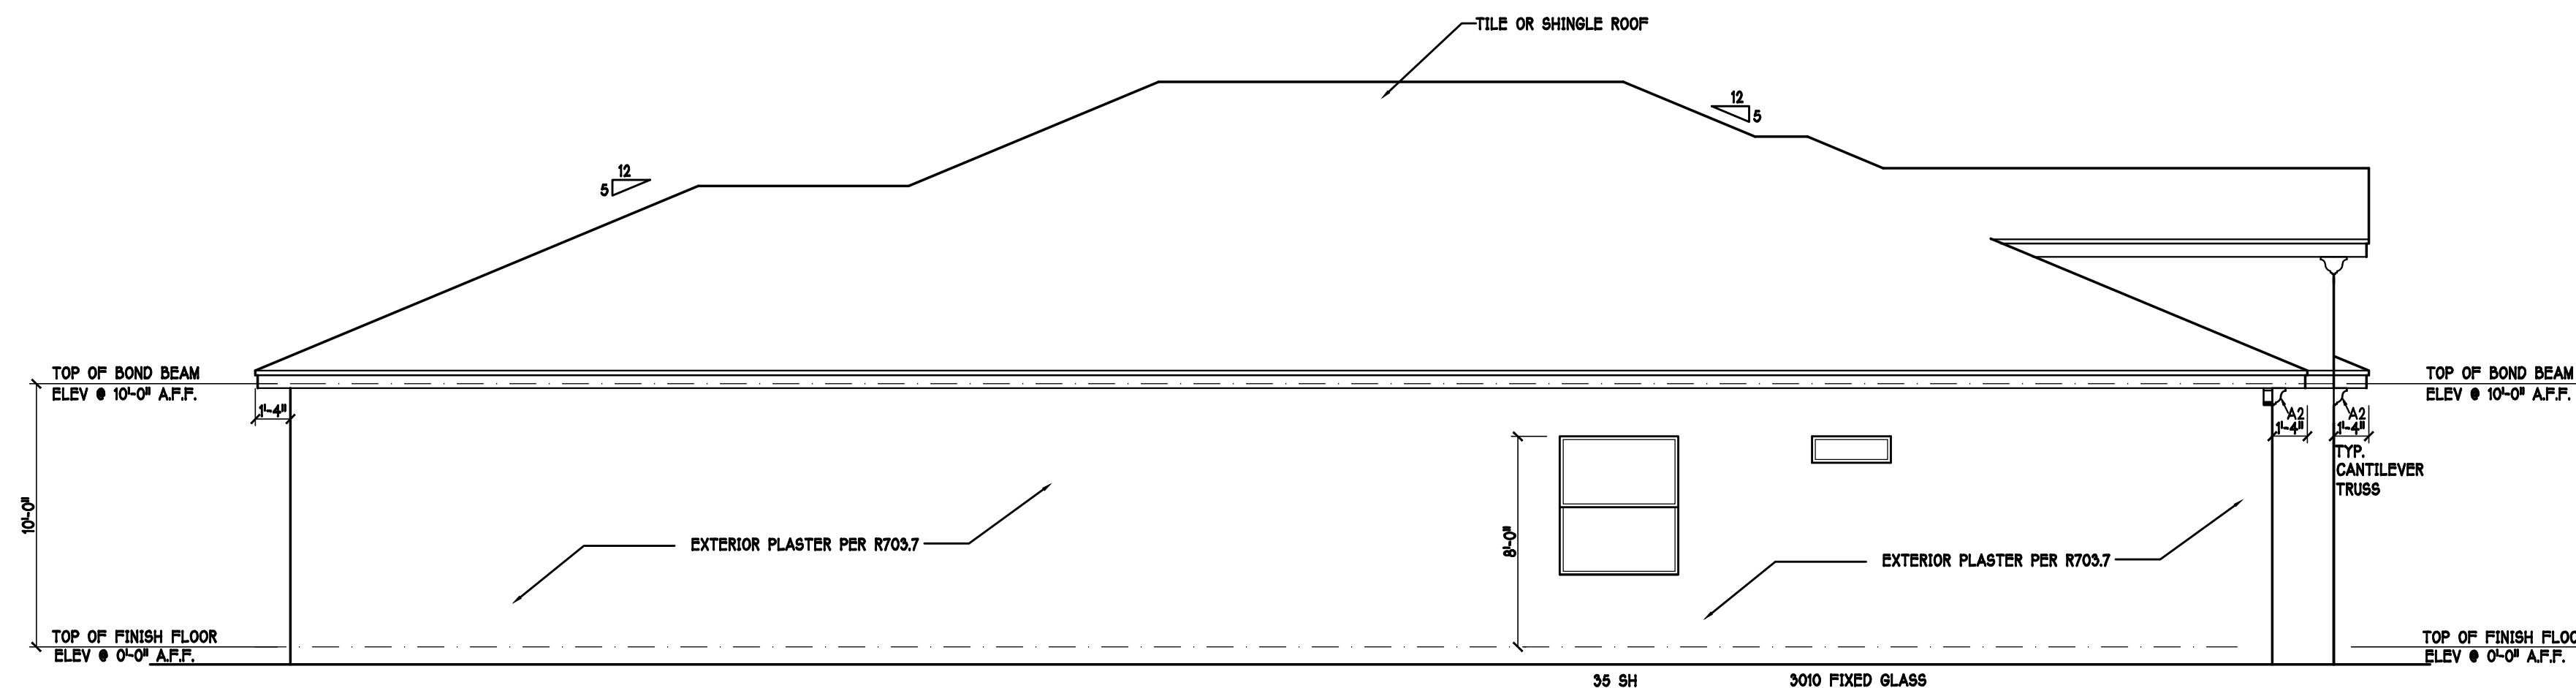



LEFT ELEVATION: "L" SCALE: 3/16" = 1'-0"

FLORIDA BUILDING CODE 7TH EDITION

OCCUPANCY: FBC 310.5 RESIDENTIAL GROUP R-3 CONSTRUCTION TYPE: V-5 (FIRE RESISTANCE RATING 0 HOURS, NOT SPRINKLED) CODES TO BE USED BY OTHER DESIGN PROFESSIONALS AND LICENSED CONTRACTORS: 2020 FLORIDA BUILDING CODE, 7TH EDITION: RESIDENTIAL; ACCESSIBILITY; ENERGY CONSERVATION; PLUMBING; MECHANICAL; AND FUEL GAS, ELECTRICAL IS CONTAINED BY REFERENCE WITHIN FBC RESIDENTIAL CHAPTER 34: NFPA 70-17 NATIONAL ELECTRICAL CODE.

- 1 MID-WALL WEEP SCREED AT WOOD-MASONRY INTERFACE. INSTALL STRICTLY PER MFG. INSTRUCTIONS
- 2 ROOF / WALL WEEP SCREED. INSTALL STRICTLY PER MFG. INSTRUCTIONS

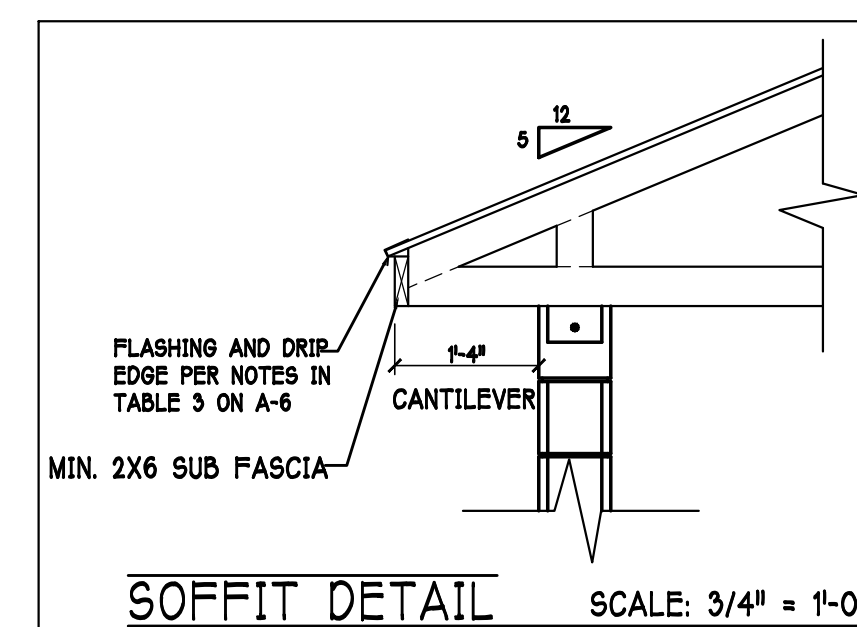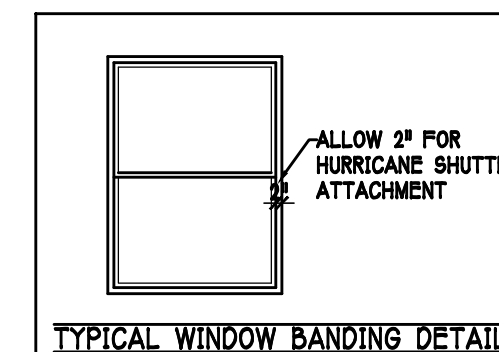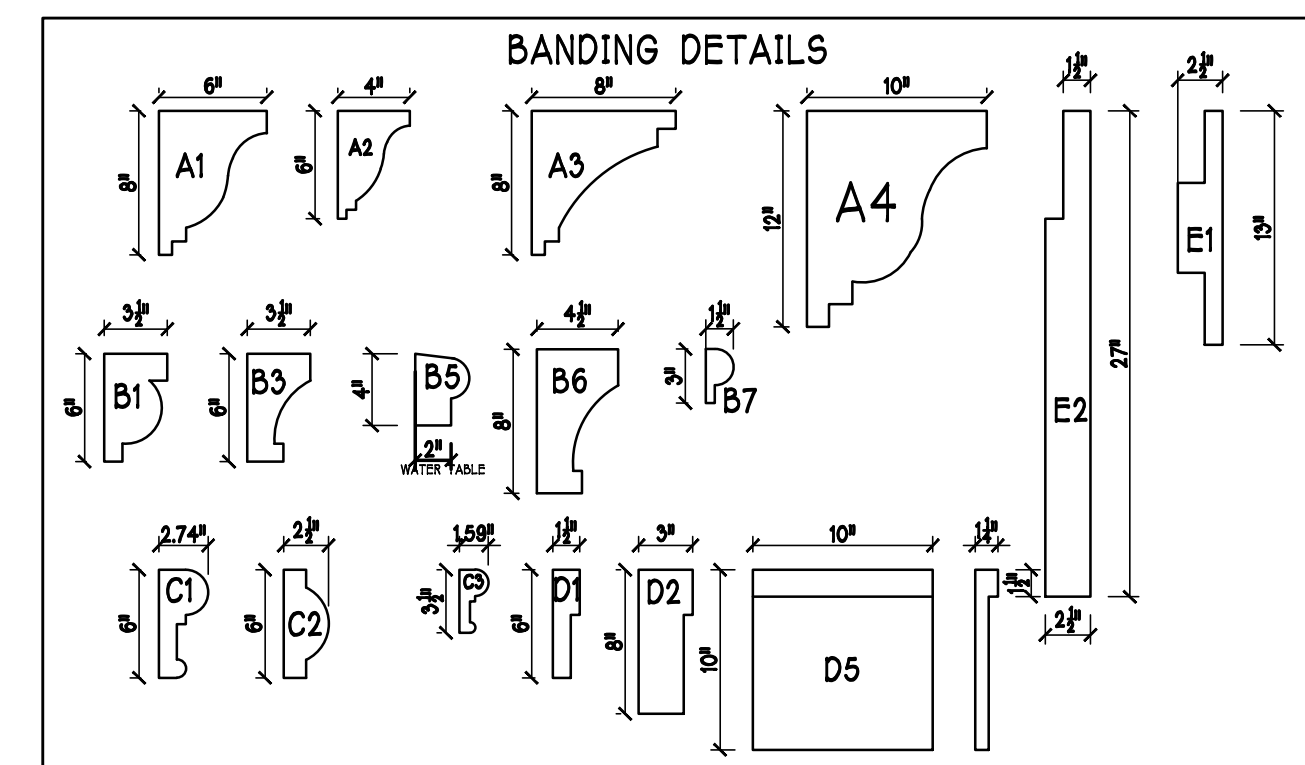


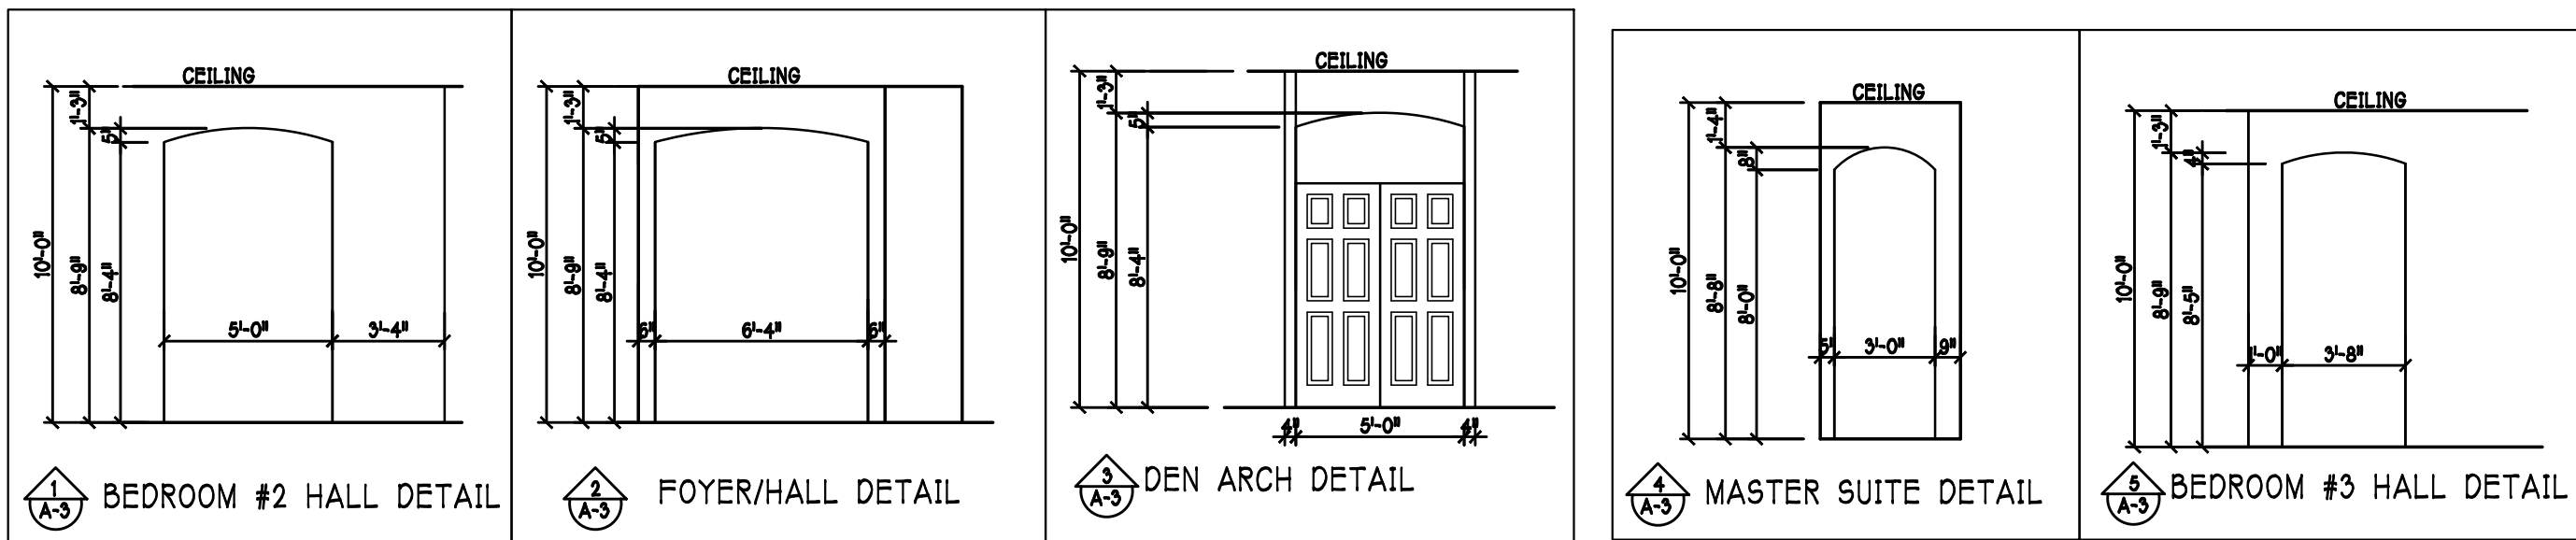

DOOR HEADERS		
6'-0" BIFOLD	HEADER HEIGHT	82" A.F.F.
6'-0" SWING	HEADER HEIGHT	82 1/2" A.F.F.
8'-0" SWING	HEADER HEIGHT	98 1/2" A.F.F.
PLAN NOTES		

- VERIFY ALL ROUGH OPENING DIMENSIONS FOR ALL WINDOWS AND DOORS
- PROVIDE SAFETY GLAZING WITHIN 24" FROM EXIT PER FLORIDA BUILDING CODE R 308.4.2.
- PROVIDE SAFETY GLAZING AT BATH / SHOWER PER FLORIDA BUILDING CODE R 308.4.5.
- NON BEARING INTERIOR FRAME WALLS SHALL BE FRAMED W/ WOOD OR METAL STUDS. SPACING SHALL NOT EXCEED 24" O.C. (NON BEARING WALLS ONLY)
- PROVIDE DEAD WOOD IN ATTIC FOR OVERHEAD GARAGE DOOR HARDWARE
- KITCHEN KNEE WALL TO BE FRAMED W/ TOP @ 34 1/4" 42 1/2" A.F.F. W/ RAISED BAR TOP VERIFY W/ BUILDER
- INSTALL SMOOTH WALLS IN KITCHEN AND ALL BATHROOM AREAS
- WHERE DRYWALL CEILING IS APPLIED TO TRUSSES AT 24" O.C. USE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. R702.3.5
- THE GARAGE SHALL BE SEPARATED FROM THE RESIDENCE & ATTIC BY NOT LESS THEN 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE. GARAGES BENEATH HABITABLE ROOMS SHALL BE SEPARATED WITH NOT LESS THAN 5/8" TYPE "X" GYPSUM BOARD OR EQUIVALENT. WHERE THE SEPARATION IS A FLOOR - CEILING ASSEMBLY THE STRUCTURE SUPPORTING THE SEPARATION SHALL ALSO BE PROTECTED BY NOT LESS THAN 1/2" GYPSUM BOARD OR EQUIVALENT
- INSTALL 1 3/8" THICK SOLID WOOD DOOR BETWEEN LIVING AND GARAGE PER FLORIDA BUILDING CODE R302.5.1
- ALL WINDOWS INSTALL 72" ABOVE GRADE MUST COMPLY WITH R 302.2.1 MIN 24" SILL HEIGHT OR PROVIDED WITH AN APPROVED WINDOW FALL PREVENTION DEVICE
- STUB OUT FOR GAS @ OUTDOOR KITCHEN, RANGE, WATER HEATER, AND DRYER. VERIFY WITH CONTRACTOR AND SUBDIV. SPECS. A SEPARATE PERMIT IS REQUIRED FOR GAS PIPING.
- ALL CLOSET SHELVES TO BE 12". ALL PANTRY & LINEN TO BE 14-16" SHELVES 18" O.F.F. WITH 15" INCREMENT.
- ALL MECHANICAL AND ELECTRICAL EQUIPMENT TO BE INSTALLED AT 0" ABOVE FLOOD PLUS 1'-0" FREEBOARD.



CABINET BACKING			
KITCHEN	UPPER TOP @ 84"	BASE TOP @ 35"	
MASTER BATH	UPPER	BASE TOP @ 35"	
GUEST BATH	UPPER	BASE TOP @ 35"	
LAUNDRY RM.	UPPER TOP @ 84"	BASE	

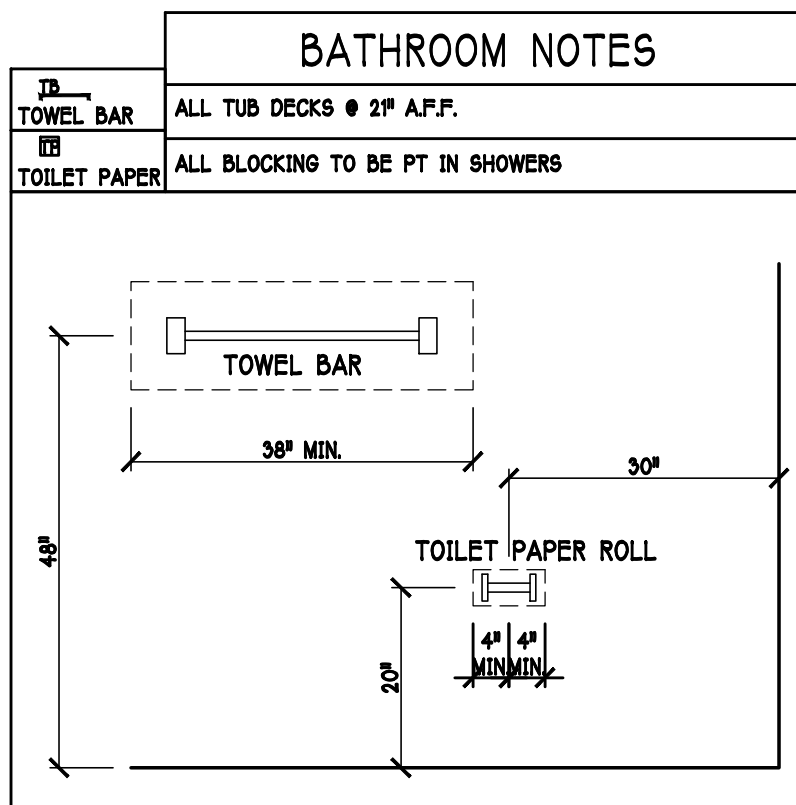

VINYL SHELF NOTES:

- ALL CLOSET SHELVES TO BE 12"
- ALL PANTRY & LINEN TO BE (4) 16" SHELVES 18" O.F.F. WITH 15" INCREMENT.

**** NOTE: ****
STUB OUT FOR GAS @ OUTDOOR KITCHEN, RANGE, WATER HEATER, AND DRYER. VERIFY WITH CONTRACT AND SUBDIV. SPECS.

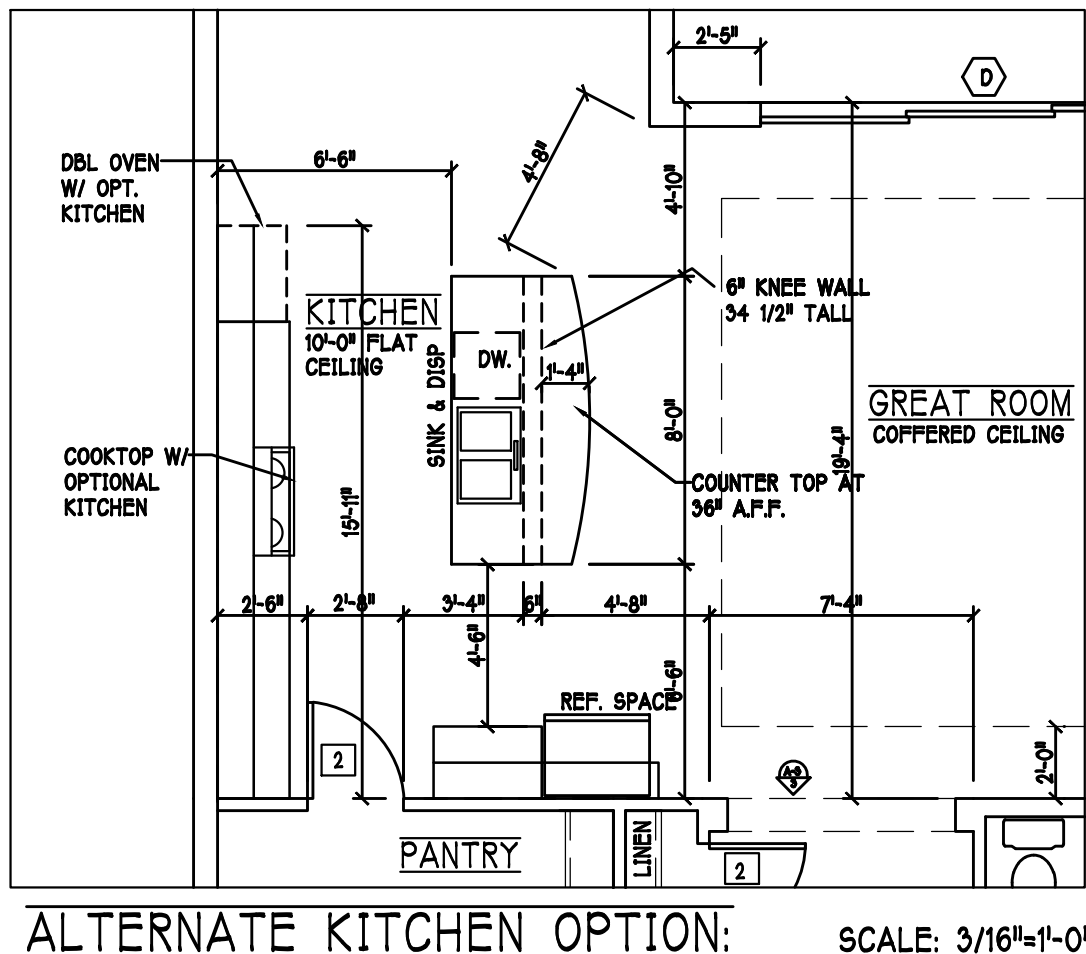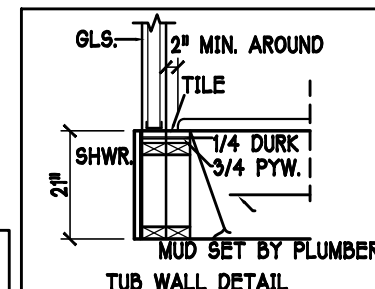

ALTERNATE KITCHEN OPTION: SCALE: 3/16"=1'-0"


D R HORTON					
MARK	SIZE CODE	PRODUCT DESCRIPTION	WIDTH	HEIGHT	COMMENTS
1	OVERHEAD	GARAGE DOOR	192	96	
2	OVERHEAD	GARAGE DOOR	96	96	
3	3080	ENTRY DR.	36	96	
4	2880	ENTRY DR.	32	96	
SEE NOTE 1					4

D R HORTON					
MARK	SIZE CODE	PRODUCT DESCRIPTION	WIDTH	HEIGHT	COMMENTS
A	35	SH	54	63	
B	25	SH	38	63	
C	36" X 12"	F.S.	36	12	
D	5'-080	SL. GL. DR.	146	96	
E	24" X 24"	F.S.	24	24	FIXED GLASS
F	26	SH	38	75	
G	2-35	SH	108	63	
H	72" X 72"	MITERED GLASS	72	72	TOP @ 8'-0" BOTTOM @ 2'-0"
I	12" X 86"	SIDE LITE	12	86	
SEE NOTE 1					11

OPT IMPACT GLASS MAY BE INSTALLED IN LIEU OF SHUTTERS VERIFY W/ CONTRACT

SQUARE FOOTAGE	
LIVING AREA	2565
GARAGE AREA	594
LANAI AREA	412
ENTRY AREA	73
POOL BATH AREA	40
TOTAL AREA	3684

INTERIOR DOOR SCHEDULE		
MARK	DOOR WIDTH	
1	3'-0"	P.K. = POCKET DOOR
2	2'-8"	B.F. = BI-FOLD DOOR
3	2'-6"	B.P. = BI-PASS DOOR
4	2'-4"	
5	2'-0"	
6	1'-8"	
7	1'-6"	

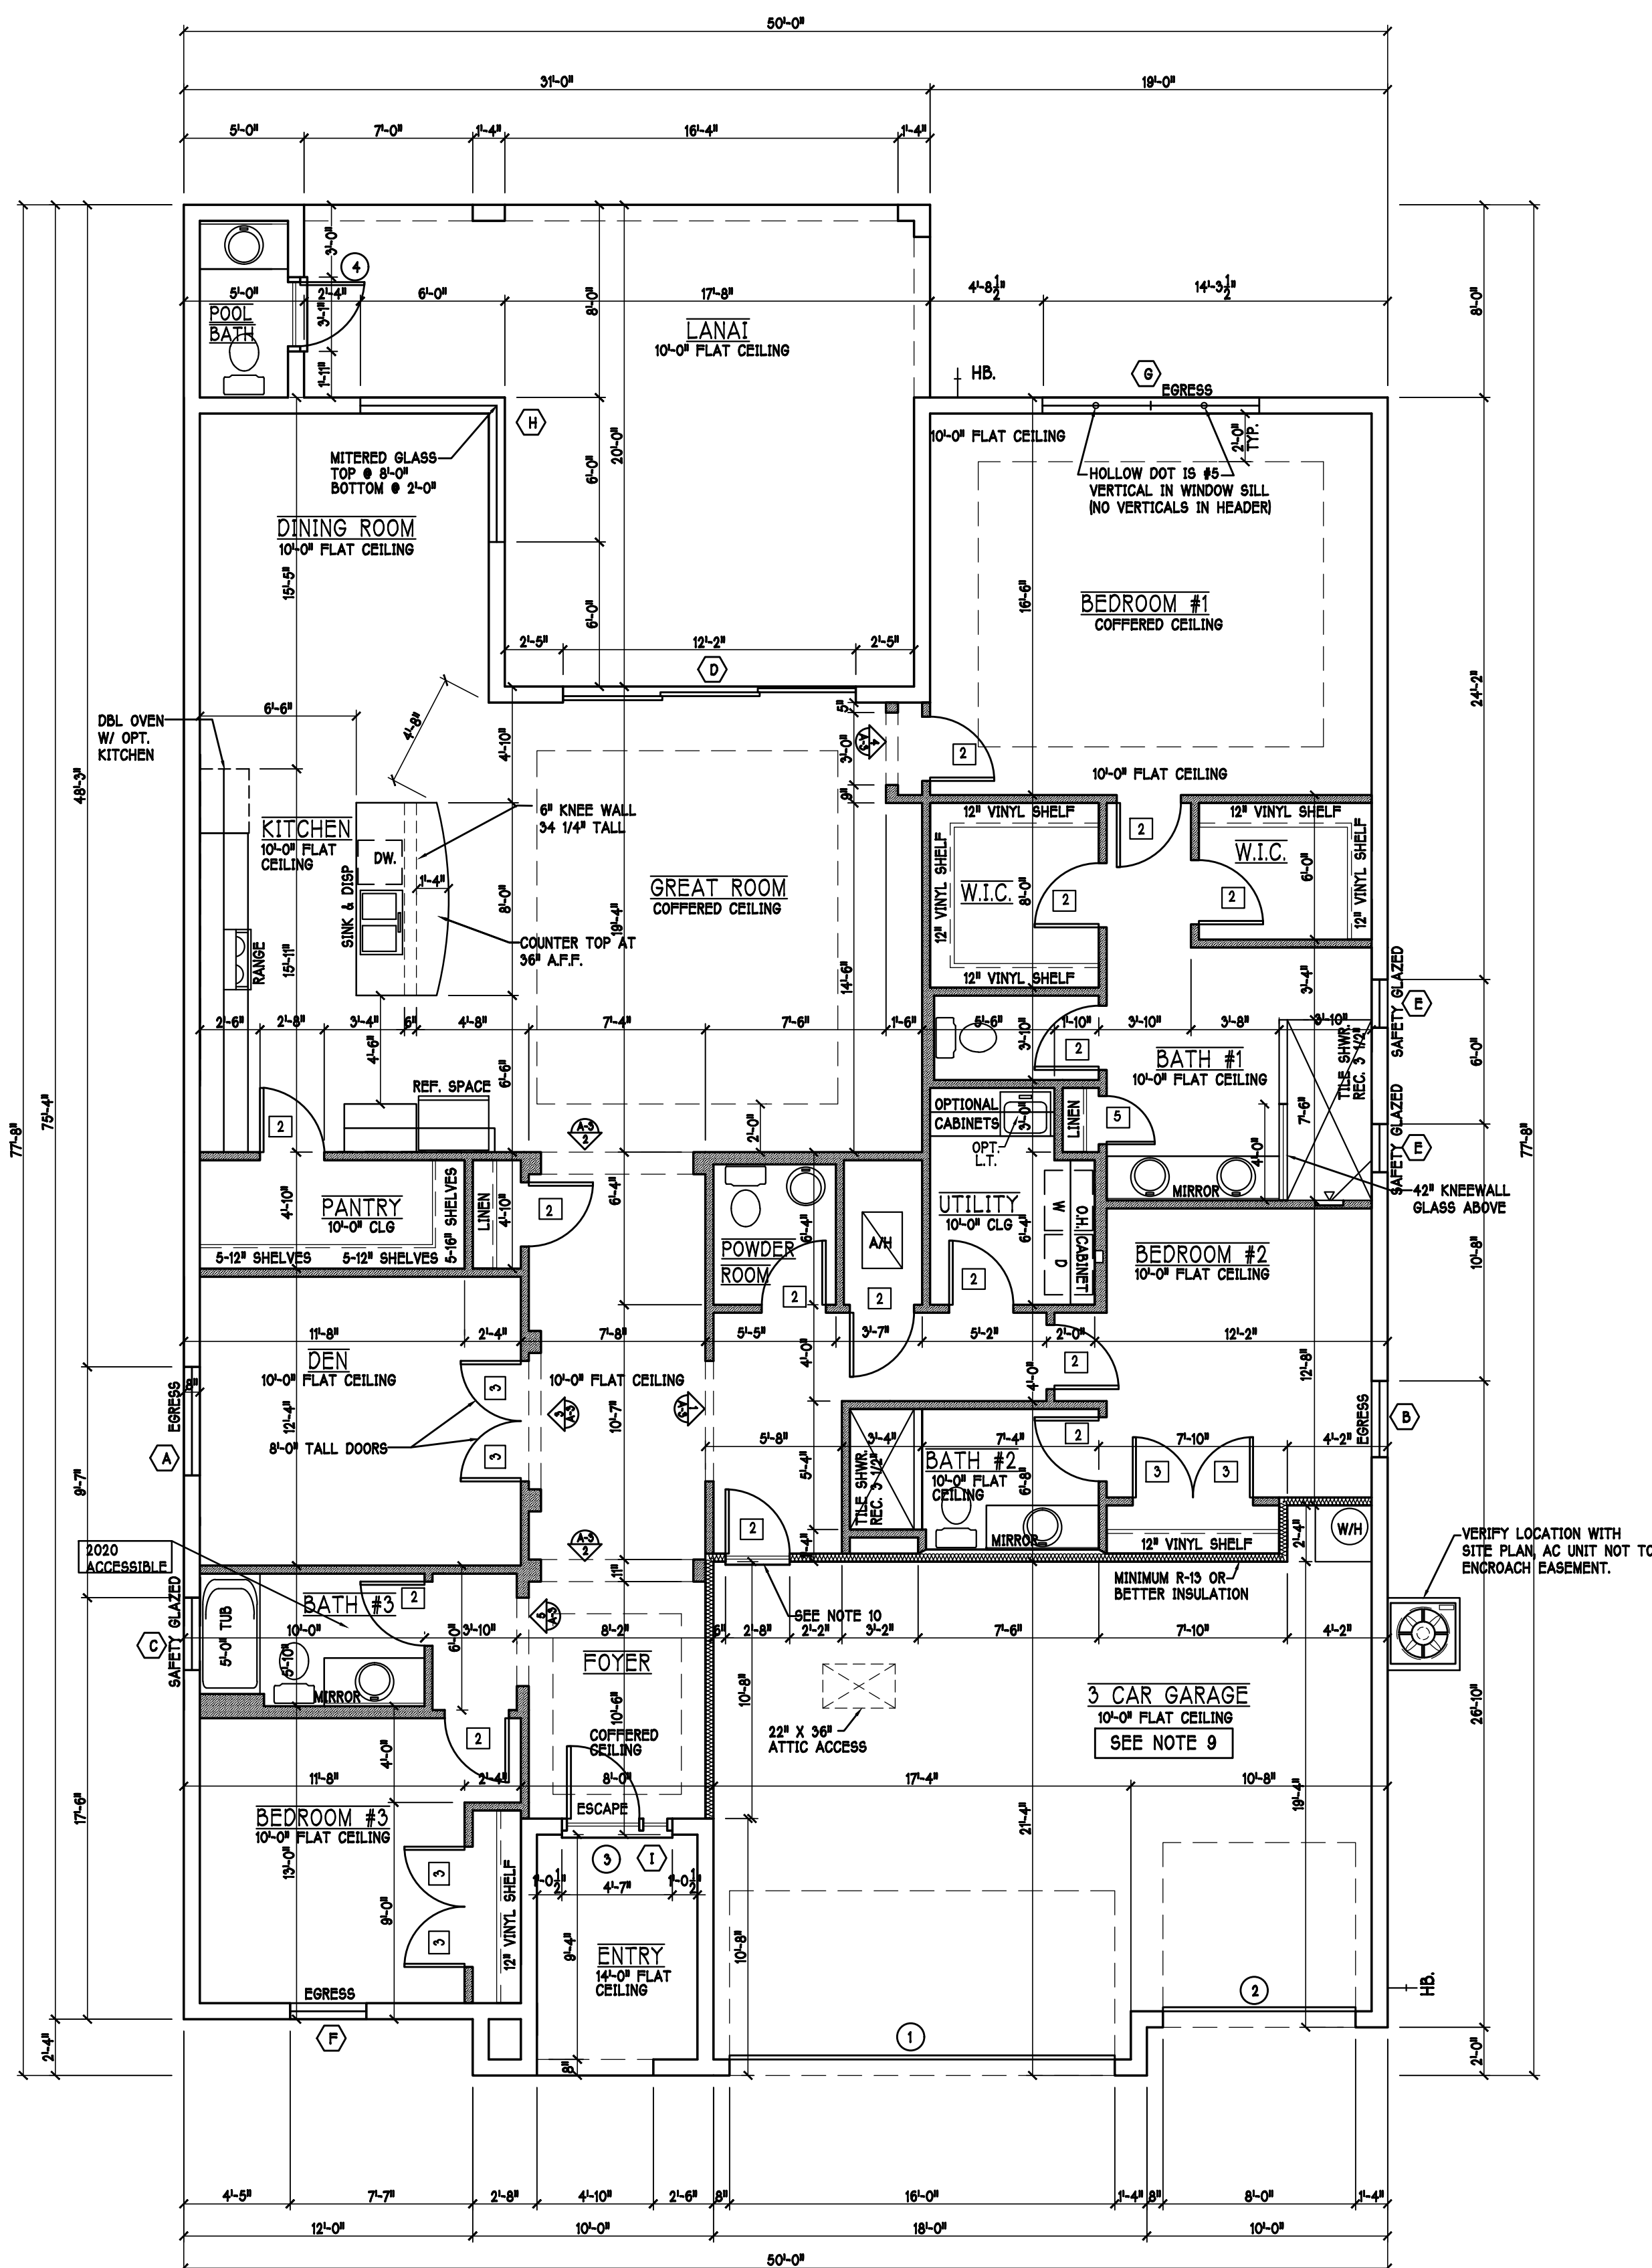

FLOOR PLAN "1" SCALE: 3/16"=1'-0"

DESIGN IN ACCORDANCE W/ THE 2020 FLORIDA BUILDING CODE- 7TH EDITION

D.R.HORTON
America's Builder

Gulf Coast Drafting
& Design
Phone (239) 540-1822
Fax (239) 540-7759

MODEL:
2540 L W/ EXT LANAI
RESIDENCE FOR:
SPEC

LOT: 297 BLOCK:
SUBDIV: WEST PORT 60s
ADDRESS: 16080 CROFTON SPRINGS WAY
G.C.D.#: 13984 D.R.H.#: 547720017

DATE:
02-10-22

DRAWN BY:
JSL

CHECKED BY:
JWC

REVISED:


PLAN:
FLOOR


SCALE:
3/16" = 1'-0"


SHEET#

A-3 L

MODEL 2540 L: ATTIC VENTILATION FBCR R806								
COORDINATE VENTING REQUIREMENTS WITH ENERGY CALCULATIONS								
AREAS (SQ. FT.)		SOFFIT ONLY (1/150) (NO ROOF VENTS)			WITH ROOF VENTS (1/300) (R.V.)			
		ATTIC VENTILATION REQUIRED			ATTIC VENTILATION REQUIRED			
MARK	ATTIC	SOFFIT	ATTIC AREA/150	REQ'D AIR FLOW QUAD 4 OF SOFFIT	SOFFIT HAS	ATTIC AREA/300	QUANTITY OF ROOF VENTS	MIN AIR FLOW OF SOFFIT
1st STORY	4030.9 SQ. FT.	347.6 SQ. FT.	26.87 SQ. FT.	7.73%	8.15%	--- SQ. FT.	-	---%
			"SOFFIT ONLY" QUALIFIES			ROOF VENTS ARE NOT REQUIRED		
			SOFFIT MODEL ACM QUAD 4, FULL VENT, NARROW PATTERN, 8.15% FREE AIR FLOW THE ACM QUAD 4 IS ONLY AN EXAMPLE OF WHAT CAN WORK. CONTRACTOR MAY INSTALL ANY BRAND OF VENTED SOFFIT THAT PROVIDES AT LEAST THE REQ'D AIR FLOW SHOWN ABOVE, AND MEETS WIND PRESSURES PER FBC R704.			ROOF VENT MODEL 32" BASE 22" BASE 22" BASE LOMANCO 770-2 0.87 SQ. FT. FREE AIR		

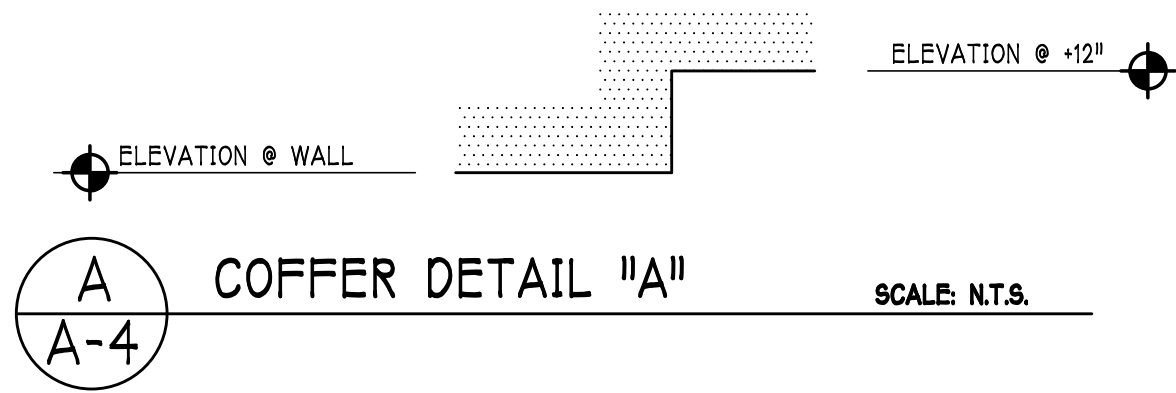

BEARING HEIGHT	
	• BEARING @ 10'-0" A.F.F.
	• INTERIOR BEARING @ 10'-0" A.F.F.
	• BEARING @ 14'-0" A.F.F.

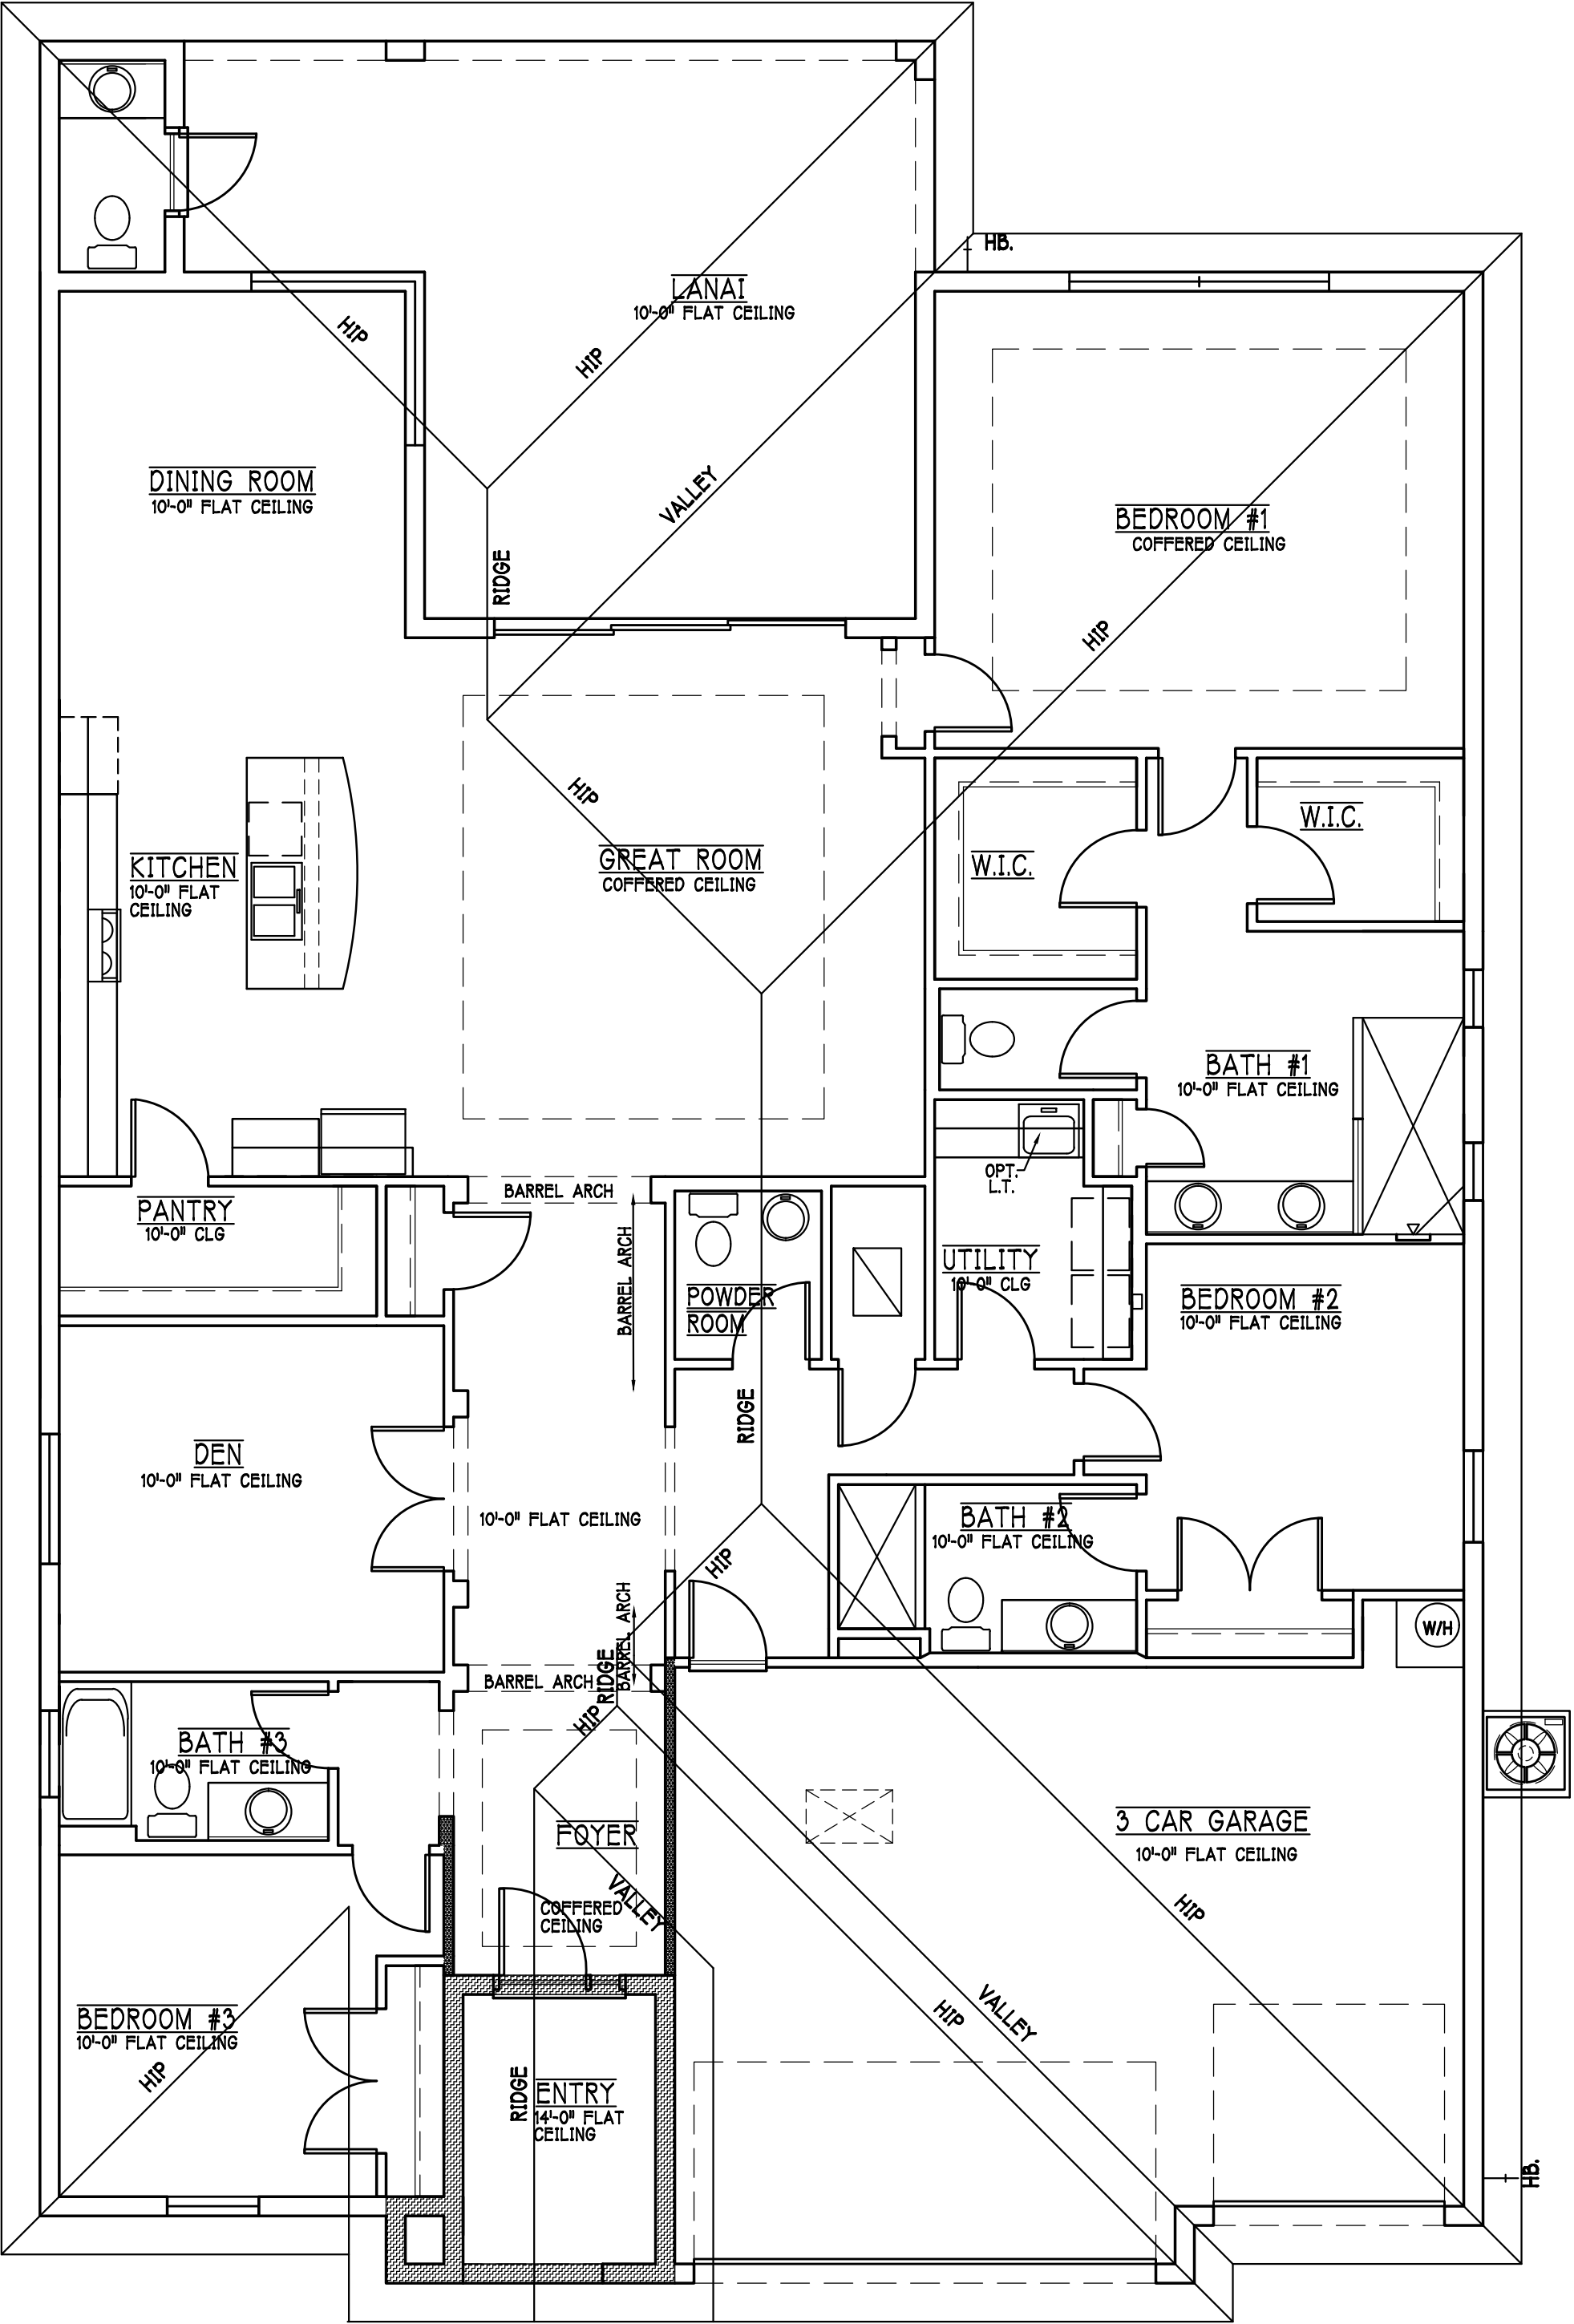

ROOF & CEILING PLAN: "L" SCALE: 3/16" = 1'-0"



D-R. HORTON
America's Builder

Gulf Coast Drafting
& Design
Phone (239) 540-1822
Fax (239) 540-7759

MODEL:
2540 L W/ EXT LANAI

RESIDENCE FOR:
SPEC

LOT: 297 BLOCK:

SUBDIV: WEST PORT 60s

ADDRESS: 16080 CROFTON SPRINGS WAY

G.C.D.#: 13984 D.R.H.#: 547720017

DATE:
02-10-22

DRAWN BY:
JSL

CHECKED BY:
JWC

REVISED:

PLAN:
CEILING PLAN


SCALE:
3/16"=1'-0"

SHEET#
A-4L


ELECTRICAL LEGEND	
	ELECTRICAL METER
	ELECTRICAL PANEL
	120 V JUNCTION BOX
	SINGLE RECEPTACLE OUTLET
	220 V RECEPTACLE OUTLET
	4-PLEX RECEPTACLE OUTLET
	DUPLEX RECEPTACLE OUTLET
	1/2 SWITCHED DUPLEX OUTLET
	DUPLEX RECEPTACLE @ ELEV. A.P.F.
	TIMER SWITCH
	GFI SWITCH
	DIMMER SWITCH
	3 WAY SWITCH
	SINGLE POLE SWITCH
	AC/DC SMOKE DETECTOR TO BE INTERCONNECTED TO BE INTERCONNECTED ANY RESIDENT HAVING A POSSIBLE-BURNING HEATER OR APPLIANCE, A FIREPLACE, OR AN ATTACHED GARAGE SHALL HAVE AN OPERATIONAL CARBON MONOXIDE ALARM INSTALLED WITHIN 10 FEET OF EACH ROOM USED FOR SLEEPING PURPOSES. PER RULE 88-3.04.72
	SD SMOKE DETECTOR
	SD CARBON MONOXIDE/SMOKE DETECTOR
	TELEPHONE OUTLET
	TELEVISION RECEPTION OUTLET
	SURFACE MOUNTED CEILING LIGHT
	FLUSH MOUNTED LIGHT
	WALL MTD. BRACKET LIGHT
	DUPLEX FLOOD LIGHT
	EXHAUST FAN
	TRACK MTD. LIGHTS
	A/C DISCONNECT
	PUSH BUTTON
	DB- DOOR BELL
	KEYPAD
	4' FLUORESCENT LIGHT
	2' UNDER COUNTER LIGHT

Electrical Notes:

Install Arc-Fault circuit-Interruption & Tamper-Resistant Receptacles shall be installed in dwelling unit. per NEC 210.12 & 406.11
All electric, electrical equipment and appliances to be set at or above base flood elevations plus 1'-0" freeboard.
All outlets in wet areas and all exterior outlets to be GFI's
Install Phone & T.V per contract
INSTALL ALL ELECTRICAL PER NEC 2017

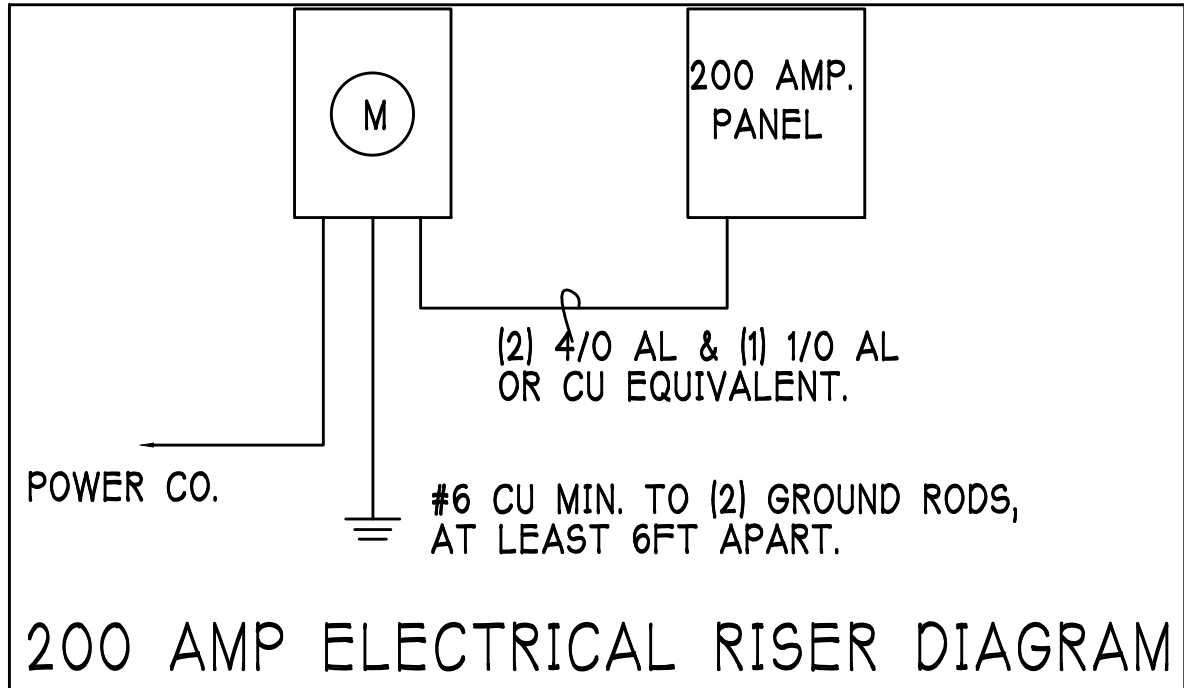

200 Amp Service			
TAG	QUANTITY	PRODUCT	PRODUCT #
A	(31)	Flush Mounted Lt	
B	(3)	Vapors	
C	(1)	Pendant/Nook	
D	(X)	10" Mushrooms	
E	(2)	24" 3 Lt	
F	(2)	36" 4 Lt	
G	(X)	NOT USED	
H	(2)	Coach Lights	
J	(X)	Coach Lights	
K	(1)	J BOX	
L	(2)	4' Fluorescent	
M	(2)	2' Fluorescent	
N	(1)	5lt Chandelier	
O	(X)	3 Lt	
P	(3)	Pendant Light	

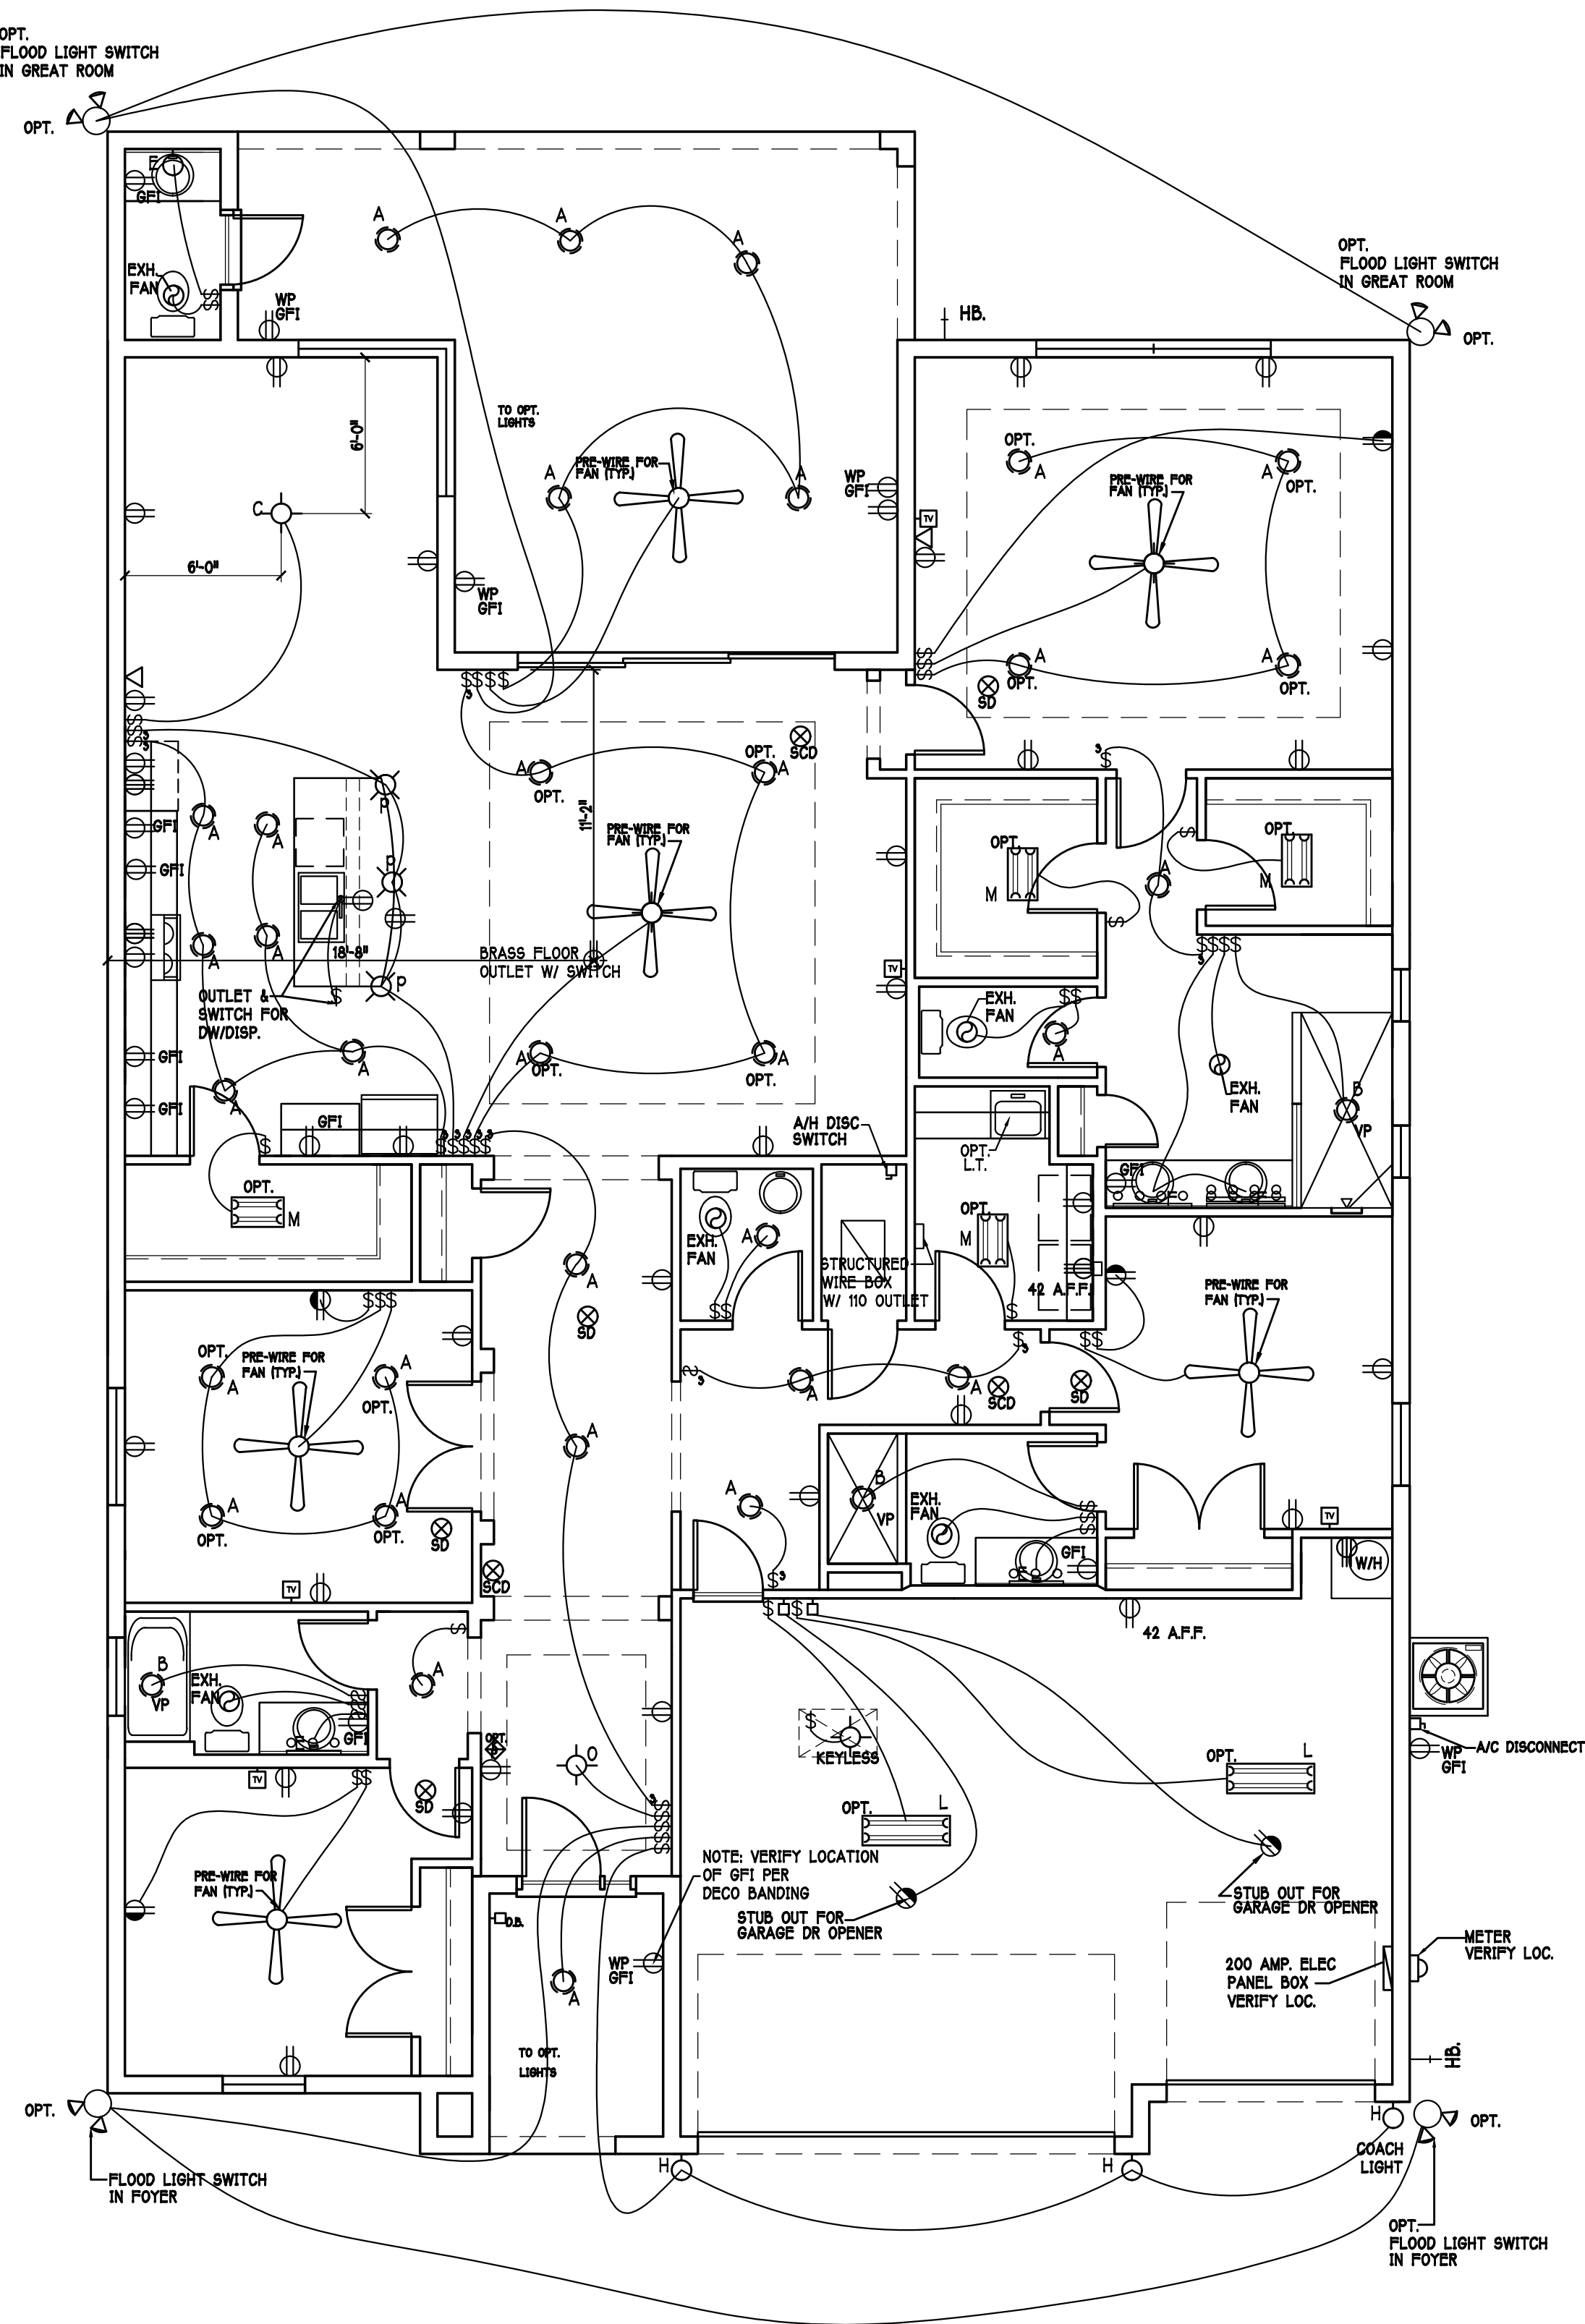

Gulf Coast Drafting & Design
Phone (239) 540-1822
Fax (239) 540-7759

MODEL: 2540 L W/EXT LANAI

RESIDENCE FOR: SPEC

LOT: 297 BLOCK: SUBDIV: WEST PORT 60s

ADDRESS: 16080 CROFTON SPRINGS WAY

DATE: 02-10-22

DRAWN BY: JSL

CHECKED BY: JWC


REVISED:

PLAN: ELECTRICAL

SCALE: 3/16" = 1'-0"

SHEET# A-5 L

G.C.D.#: 13984 D.R.H.#: 547720017

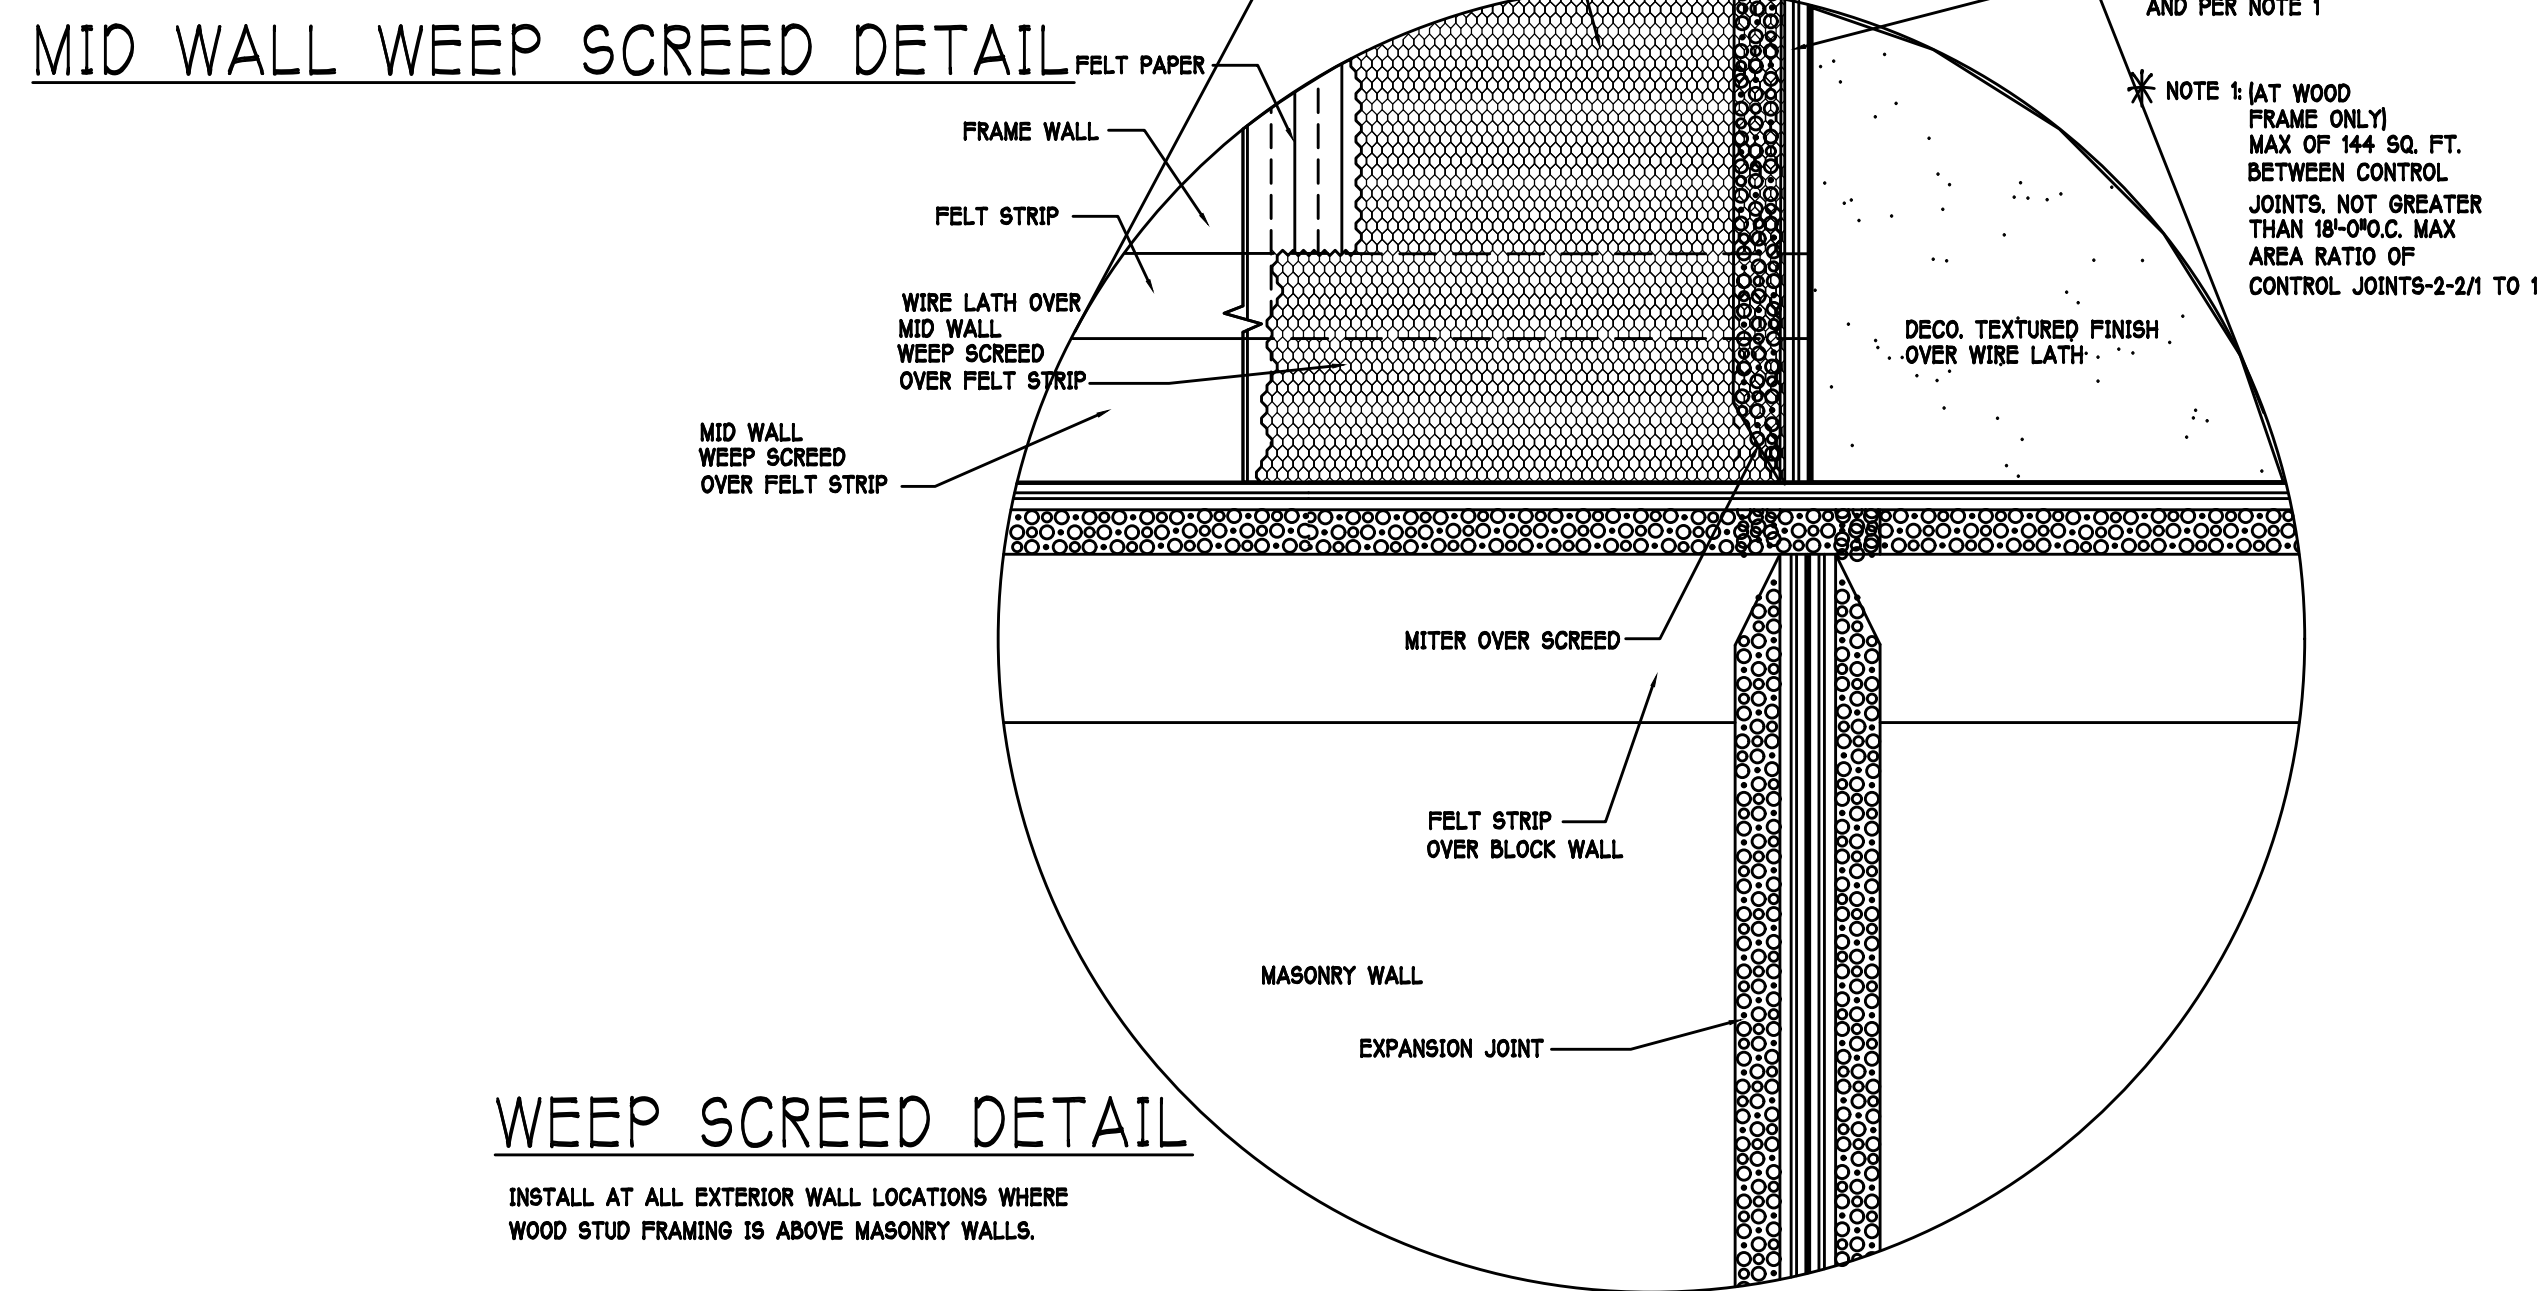

EXTERIOR WALL

OPENING FOR WINDOW OR DOOR

WHERE PAN FLASHING IS USED AT THE SILL, ALSO INCORPORATE FLASHING OR PROTECTION AT THE HEAD AND SIDES

INSTALL PAN FLASHING AT THE SILL

R703.4 - Where flashing instructions or details are not provided by the window or door manufacturer or by the flashing manufacturer, "pan flashing" shall be installed at the sill of exterior window and door openings. Pan flashing shall be sealed or sloped in such a manner as to direct water to the surface of the exterior wall finish or to the water-repellent barrier for subsequent drainage. Openings using pan flashing shall incorporate flashing or protection at the head and sides.

"Pan Flashing" is a generic term that used to refer to "metal pan flashing". However, many modern materials have been developed for the same function such as:

- Fiebolt Peel n Stick Flashing Membrane
- Fluid Applied Flashing

For such products, follow the manufacturer's installation instructions.


For in-depth flashing installation instructions, refer to the following publications:

- FMA/AMA 100
- FMA/AMA 200
- FMA/AMA 250
- FMA/AMA/OMA 300

THE FLASHING INSTRUCTIONS FROM THE WINDOW / DOOR MFR, OR THE FLASHING MFR, SHALL SUPERCEDE THIS DETAIL.

PAN FLASHING PER R703.4

SCALE: N.T.S.

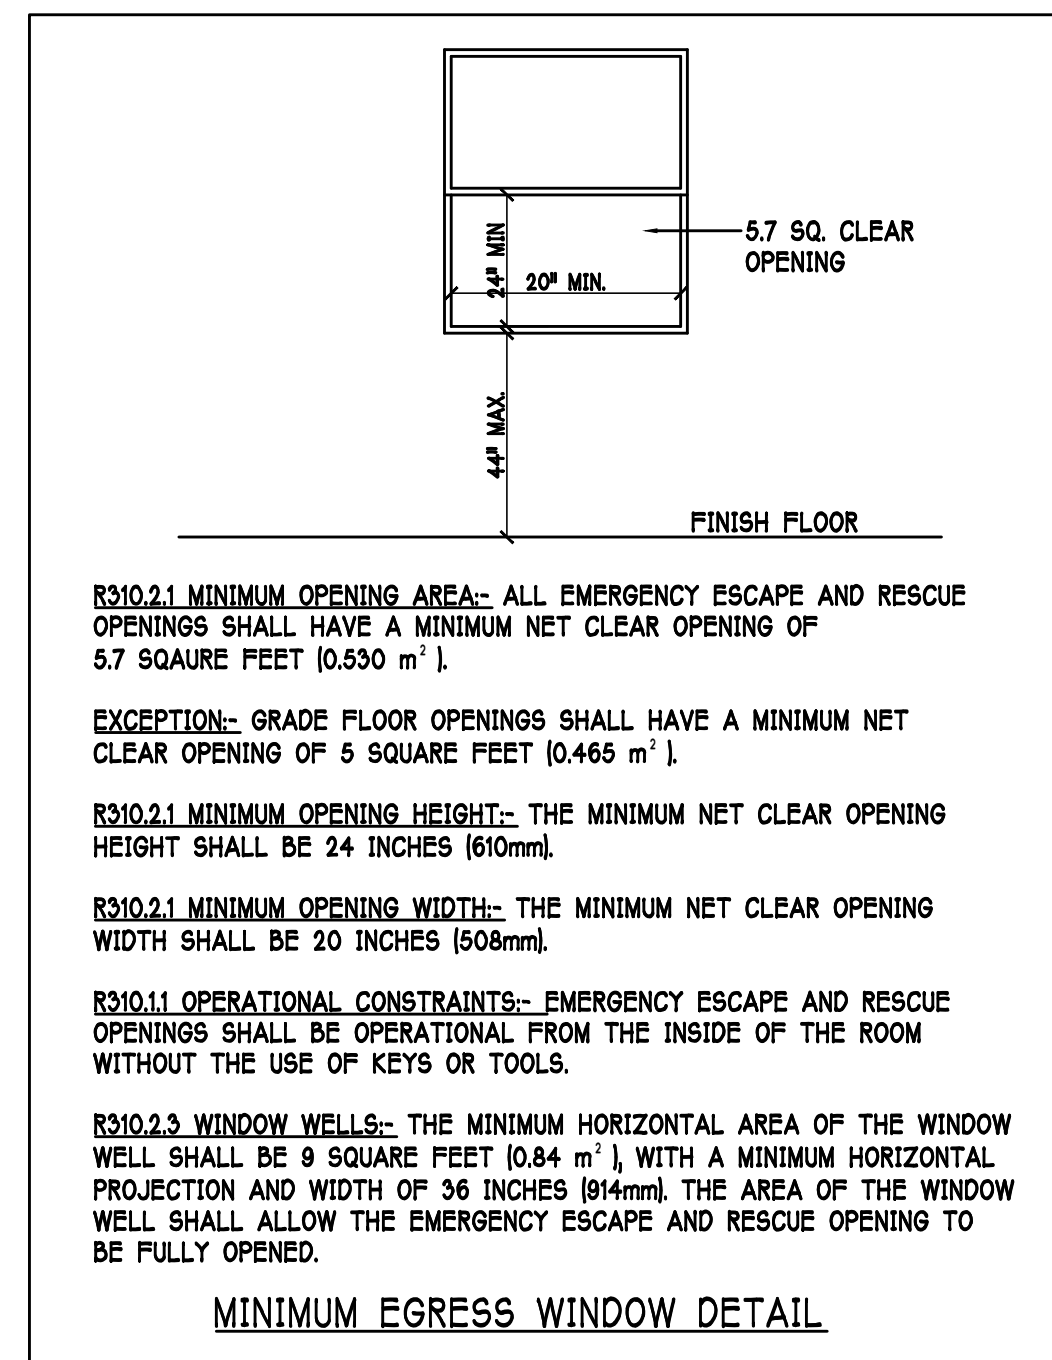

DESIGN IN ACCORDANCE W/ THE 2020
FLORIDA BUILDING CODE- 7TH EDITION

A-6 L

FOUNDATION PLAN

SCALE: 3/16" = 1'-0"










PLAN NOTES:

- 1) TOP OF GROUND FLOOR SLAB DATUM ELEVATION 0'-0".
- 2) "F#" DENOTES CONTINUOUS WALL FOOTING TYPE PER SCHEDULE THIS SHEET.
- 3) "P" DENOTES PAD FOOTING AT CONCENTRATED LOADS PER SCHEDULE THIS SHEET.
- 4) PROVIDE #5 VERTICAL REINFORCING AT DOT LOCATIONS SHOWN ON PLAN FROM FOOTING TO BOND BEAM.
- 5) ALL DIMENSIONS ARE TO OUTSIDE FACE OF MASONRY WALLS. SOME SLAB EDGES MAY EXTEND BEYOND FACE OF WALL.
- 6) FOR DIMENSIONS OF ROUGH OPENINGS IN MASONRY WALLS, COORDINATE WITH WINDOW/DOOR SUPPLIER.
- 7) PROVIDE PRESSURE TREATED BUCKS AT WINDOWS / DOORS PER DETAIL 7/S-3.

WALL FOOTING SCHEDULE					
TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINFORCING	SHAPE
F1	CONT.	1'-4"	0'-8"	2-#5	
F2	CONT.	1'-8"	0'-10"	2-#5	
F3	CONT.	1'-0"	1'-8"	2-#5	
F4	CONT.	1'-4"	1'-8"	2-#5	
F5	CONT.	1'-4"	1'-0"	2-#5	
F6	CONT.	1'-4"	1'-0"	2-#5	
F6A	CONT.	0'-8"	0'-8"	1-#5	
TE	CONT.	0'-8"	0'-8"	1-#5	

NOTE: REINFORCING IN FOOTINGS SHALL BE CONTINUOUS AT CORNERS AND INTERSECTIONS. ADD CORNER BAR 25"x25" AT EACH LONGITUDINAL BAR, SEE 6/S-3.

PAD FOOTING SCHEDULE						
TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINF.		REMARKS
				LONG WAY	SHORT WAY	
A	2'-6"	2'-6"	1'-0"	3-#5	3-#5	-
B	3'-0"	3'-0"	1'-0"	4-#5	4-#5	-
C	3'-6"	3'-6"	1'-0"	4-#5	4-#5	-
D	4'-0"	4'-0"	1'-0"	5-#5	5-#5	-
E	2'-6"	5'-0"	1'-0"	3-#5	6-#5	-

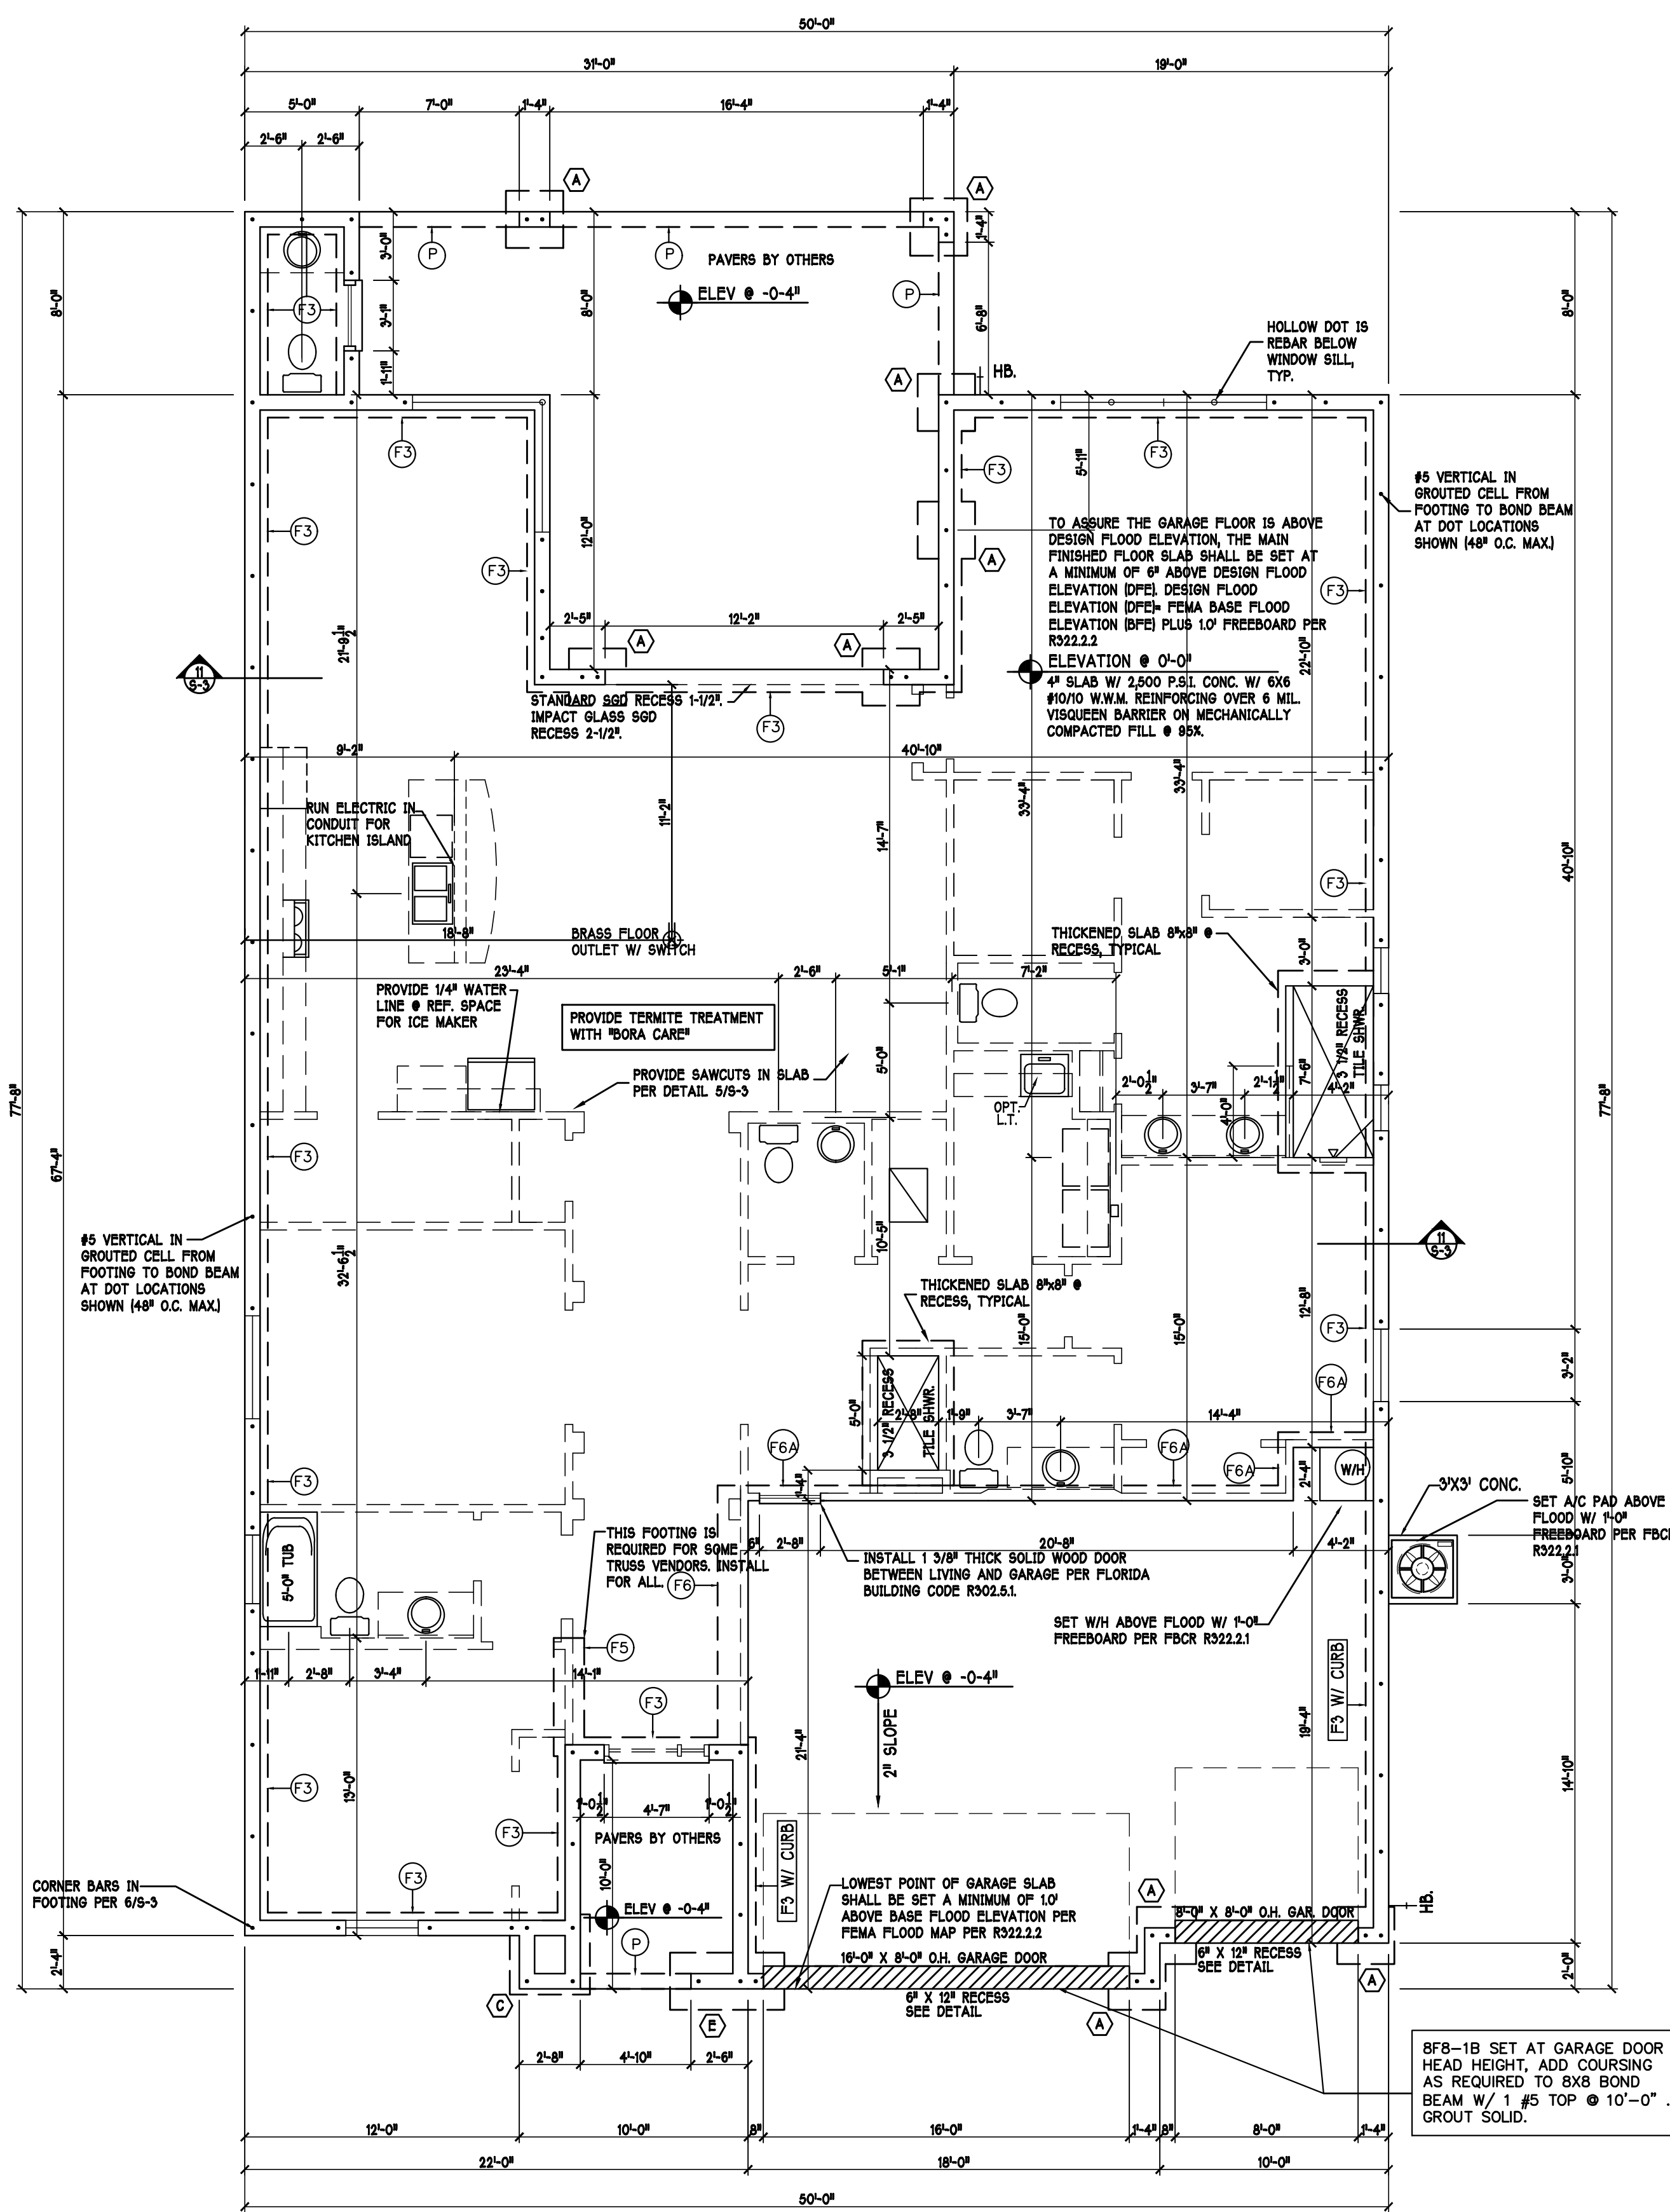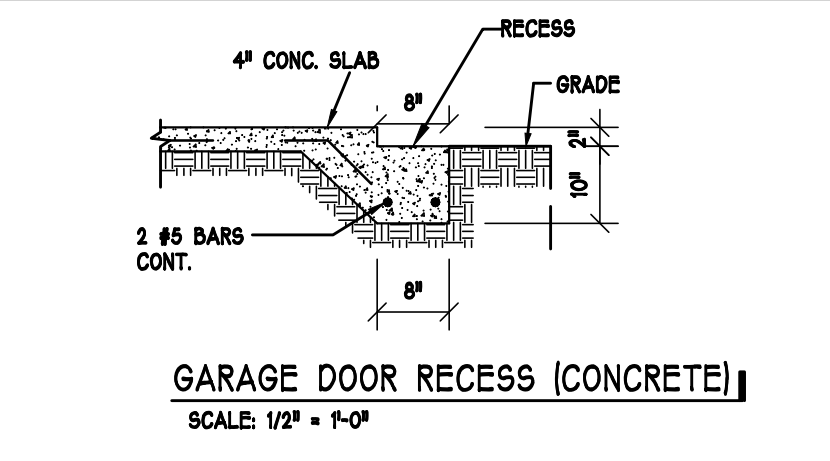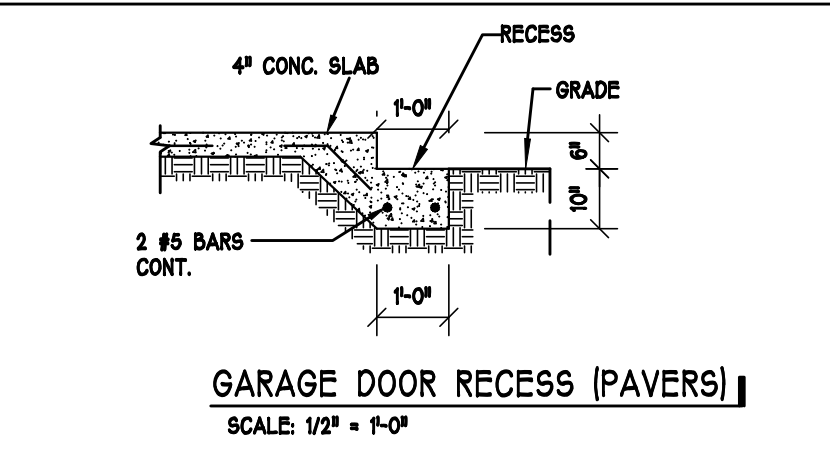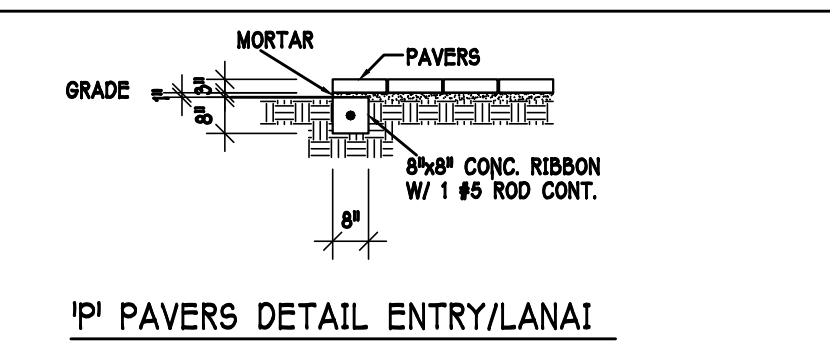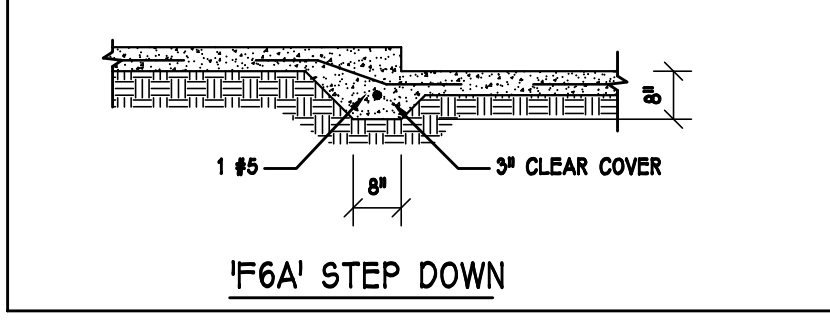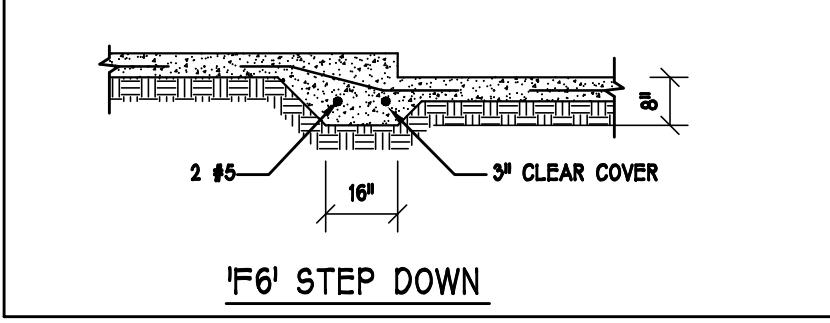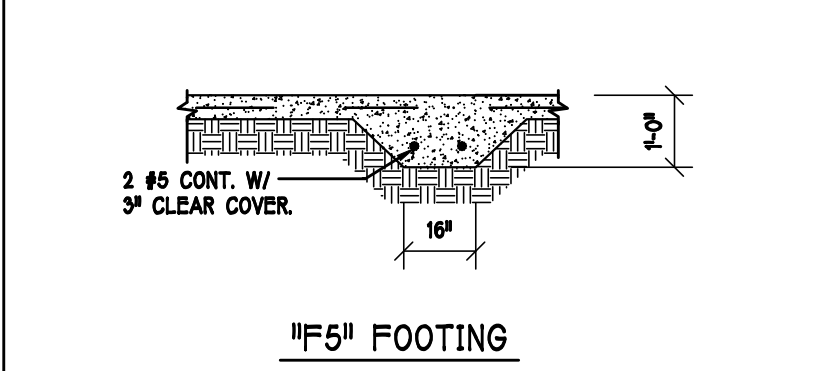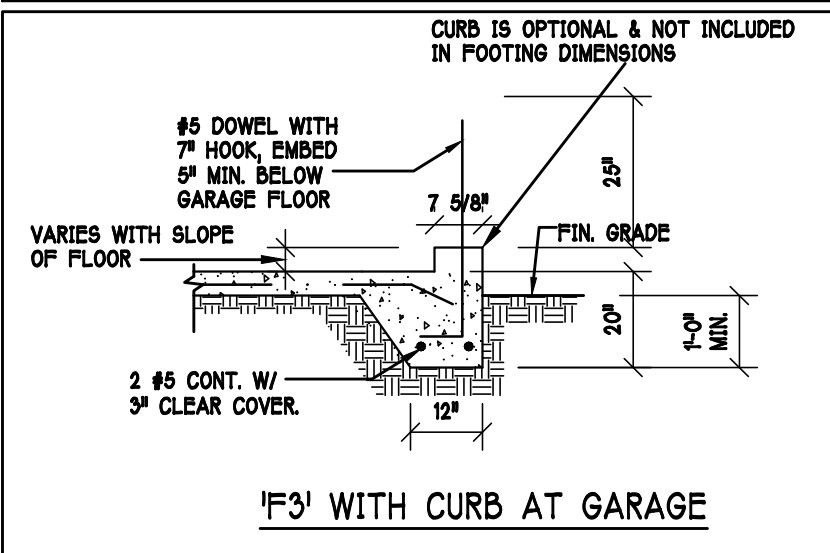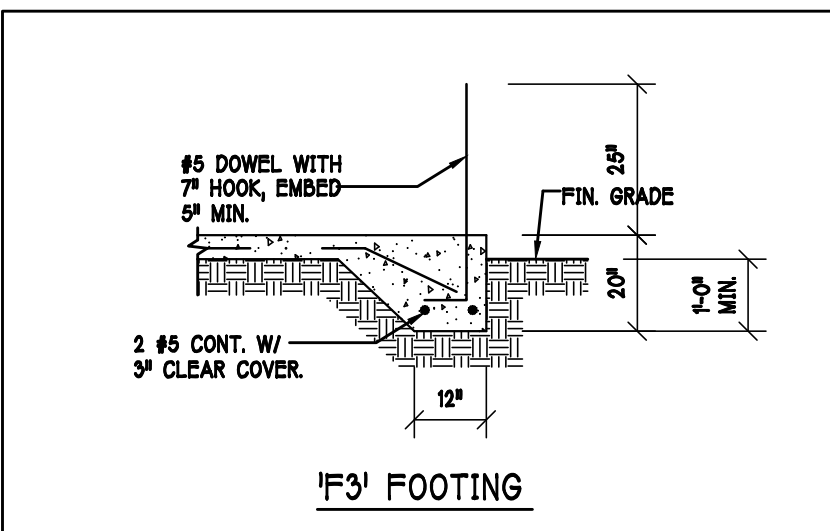

FOUNDATION PLAN: "L"

SCALE: 3/16"=1'-0"

DESIGN IN ACCORDANCE W/ THE 2020 FLORIDA BUILDING CODE- 7TH EDITION

D.R. HORTON
America's Builder

Gulf Coast Drafting
& Design
Phone (239) 540-1822
Fax (239) 540-7759

STRUCTURAL ENGINEERING
SYSTEMS
OF NORTH FLORIDA
1604 SE 47th ST SUITE 605
FORT MYERS, FL 33905
CE 3955 5-9-2014
CA# 8829

RICHARD A. SILVER
P.E.
NO. 66988
STATE OF FLORIDA
PROFESSIONAL ENGINEER

MODEL:
2540 L W/EXT LANAI
RESIDENCE FOR: SPEC

LOT: 297 BLOCK:
SUBDIV: WEST PORT 60s
ADDRESS: 16080 CROFTON SPRINGS WAY
G.C.D.#: 13984 D.R.H.#: 547720017

DATE:
02-10-22

DRAWN BY:
JSL

CHECKED BY:
JWC

REVISED:


PLAN:
FOUNDATION

SCALE:
3/16" = 1'-0"

SHEET#


S-1 L

TRUSS STRAPPING TO MASONRY			
MAX TRUSS UPLIFT (LBS)	STRAP/ANCHOR Valid lengths x/x/x	FASTENERS	
1450 (1 PLY)	(1) META16/18/20	(8) 0.148x1-1/2", EMBED 4"	
1810 (1 PLY)	(1) META16/20	(9) 0.148x1-1/2", EMBED 4"	
1875 (1 PLY)	(2) META16/18/20	(10) 0.148x1-1/2", EMBED 4"	
1920 (1 PLY)	(2) META16/20	(10) 0.148x1-1/2", EMBED 4"	
2120 (1 PLY)	(1) META16/20	(10) 0.148x1-1/2", EMBED 4"	
1795 (2 or 3 PLY)	(2) META16/18/20	(14) 0.162x3-1/2", EMBED 4"	
2365 (2 or 3 PLY)	(2) META16/20	(12) 0.162x3-1/2", EMBED 4"	
3965/DF/SP (2 PLY)	MGT	(22) 0.148x3" ATR, EPOXY 12"	
3000/DF/SP (1 PLY 2x4)	HTT4	(18) 0.148x1-1/2", 5/8" ATR, EPOXY 12"	
4455/DF/SP (1 PLY 2x6)	HTT4	(18) SD#10x1-1/2", 5/8" ATR, EPOXY 12"	
4235/DF/SP (2 PLY 2x4)	HTT4	(18) 0.162x2-1/2", 5/8" ATR, EPOXY 12"	
4555/DF/SP (1 PLY 2x6)	HTT5	(26) SD#10x1-1/2", 5/8" ATR, EPOXY 12"	
4670/DF/SP (2 PLY 2x4)	HTT5	(26) 0.148x3", 5/8" ATR, EPOXY 12"	
5445/DF/SP (2 PLY 2x4)	HTT5KT	(28) SD#10x2-1/2", 5/8" ATR, EPOXY 18"	
10690/DF/SP (2 PLY)	(1) HGT-2	(16) 0.148x3", (2) 3/4" ATR, EPOXY 12"	
10790/SYP (3 PLY)	(1) HGT-3	(16) 0.148x3", (2) 3/4" ATR, EPOXY 12"	
NOTES: 1) PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE AND SUITABLE FOR THE GEOMETRY. EMBED STRAP ON ϕ OF WALL. 2) ANY OF THE VALID LENGTHS SHOWN MAY BE USED IN PLACE OF THE LENGTH SPECIFIED ON PLAN. 3) CONNECTORS ARE SIMPSON STRONG TIE. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS. SUBSTITUTIONS MUST BE APPROVED IN WRITING BY THE ENGINEER OF RECORD. 4) WHERE EMBEDDED STRAPS ARE MISSING, OR MIS-LOCATED, INSTALL RETROFIT STRAP PER 10/S-3 PER UPLIFT IN TRUSS ENGINEERING.			


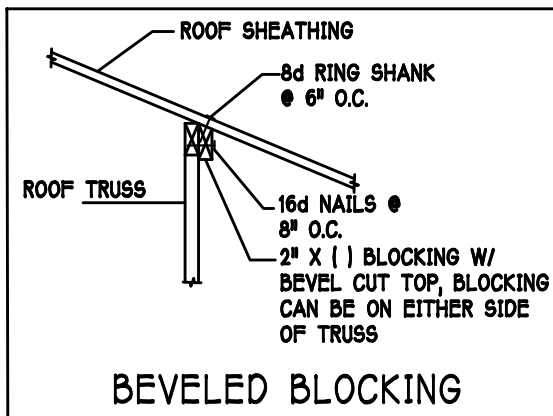


TRUSS STRAPPING TO STUD WALL/WOOD BEAM			
MAX TRUSS UPLIFT (LBS)	STRAP(S) Valid lengths x/x/x	FASTENERS	
850	(1) MTS16/20/30	(14) 0.148x1-1/2" or 3"	
1700	(2) MTS16/20/30	EACH STRAP	
2550	(3) MTS16/20/30		
1125	(1) HTS20/24/30	(24) 0.148x1-1/2"	
2250	(2) HTS20/24/30	OR	
3375	(3) HTS20/24/30	(20) 0.148x3"	
4500	(4) HTS20/24/30	EACH STRAP	
NOTES: 1) PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE. 2) ANY OF THE VALID LENGTHS SHOWN MAY BE USED IN PLACE OF THE LENGTH SPECIFIED ON PLAN. 3) 1-1/2" NAIL SHALL BE USED IN 1 PLY LUMBER, 2 PLY LUMBER IS REQUIRED FOR 3" NAILS. 4) CONNECTORS ARE SIMPSON STRONG TIE. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS.			

- PLAN NOTES:
- 1) ROOF TRUSS BEARING ELEVATION VARIES, SEE LEGEND.
 - 2) ROOF FRAMING SHALL BE WOOD TRUSSES DESIGNED BY A DELEGATED TRUSS ENGINEER PER DESIGN CRITERIA ON SHEET 9-3.
 - 3) PROVIDE STRAPPING AT TRUSSES PER NOTES ON THIS SHEET.
 - 4) FOR NAILING OF ROOF DECK, SEE 1 AND 2 ON 9-3.
 - 5) [8F8-B] etc., DENOTES PRECAST LINTEL ABOVE DOOR/WINDOW OPENING PER SCHEDULE THIS SHEET.
 - 6) AT TRUSS BEARING, PROVIDE 8x8 MASONRY BOND BEAM W/ 1 #5 CONTINUOUS, SEE DETAIL 13/9-3.

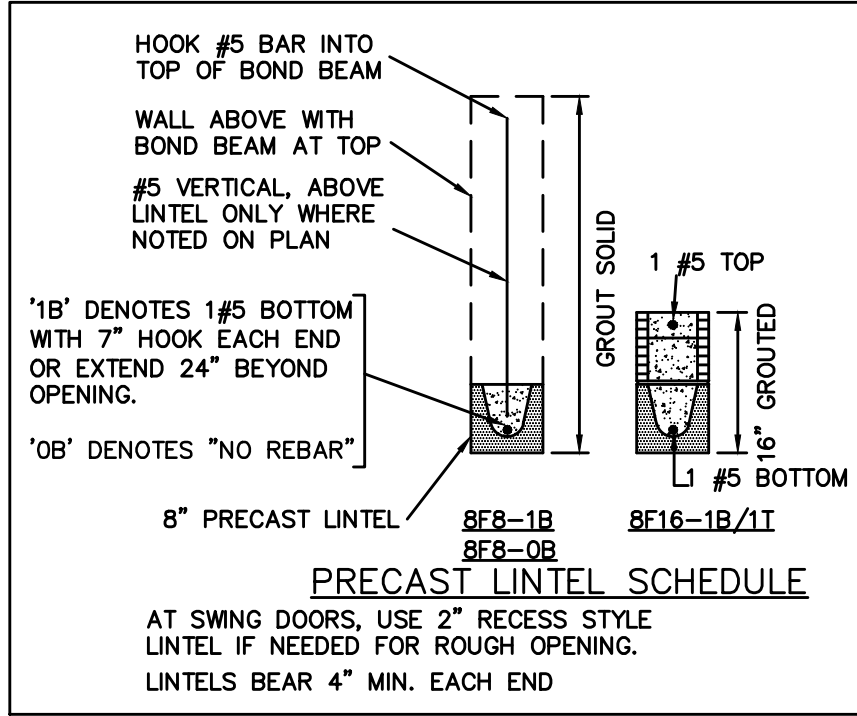

TRUSS BEARING CONDITIONS AND STRAPPING IS BASED ON TRUSS LAYOUT PREPARED BY BUILDERS FIRST SOURCE, JOB #: MASTER, DATED: 01/28/16, REVISION: 01/12/21

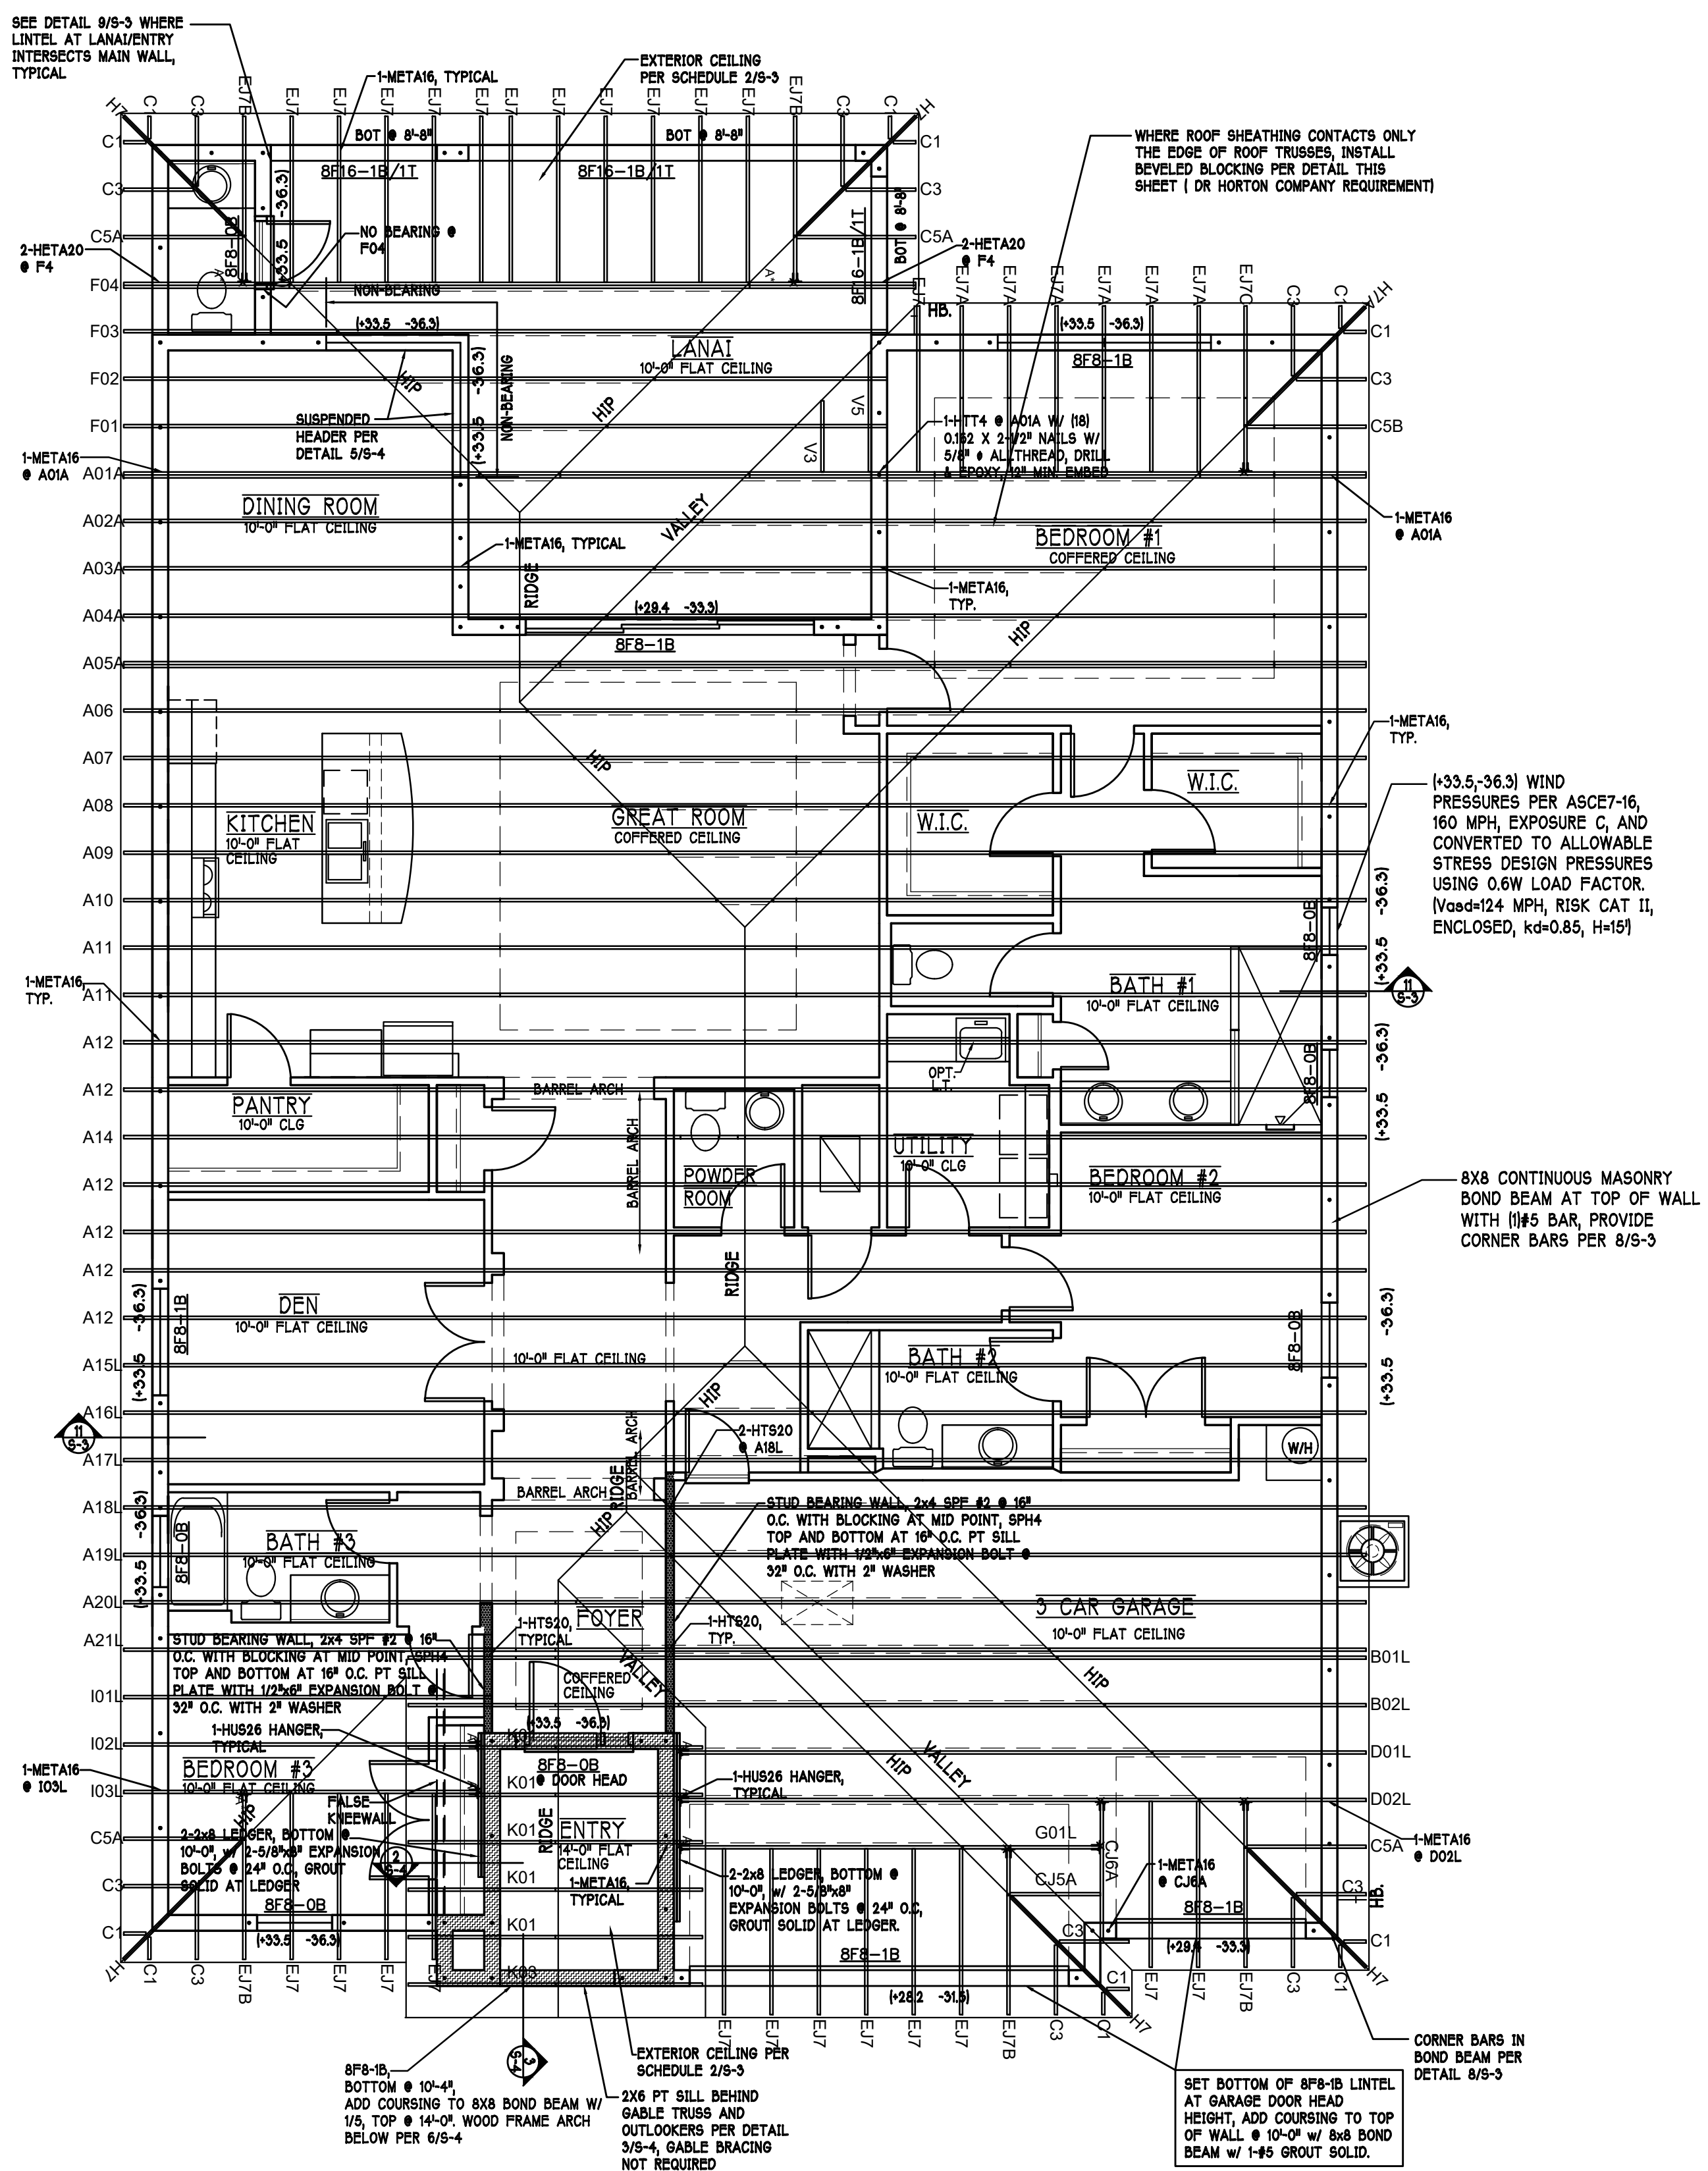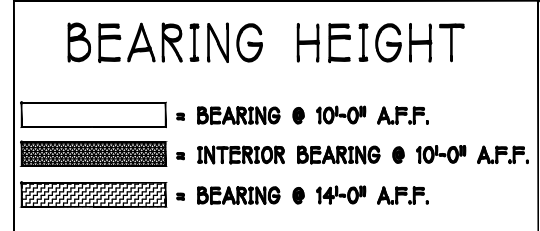

ROOF FRAMING PLAN: "L" SCALE: 3/16" = 1'-0"

DESIGN IN ACCORDANCE W/ THE 2020 FLORIDA BUILDING CODE- 7TH EDITION

Gulf Coast Drafting & Design
Phone (239) 540-1822
Fax (239) 540-7759

STRUCTURAL ENGINEERING
STRUCTURAL SYSTEMS
1634 SE 47TH ST SUITE #1
CAPE CORAL, FL 33904
(239) 540-7759 FAX 8889

MODEL: 2540 L W/EXT LANAI

BLOCK: SUBDIV: WEST PORT 60s

LOT: 297

RESIDENCE FOR: SPEC

ADDRESS: 16080 CROFTON SPRINGS WAY

G.C.D.#: 13984 D.R.H.#: 547720017

DATE: 02-10-22

DRAWN BY: JSL


CHECKED BY: JWC

REVISED:


PLAN: ROOF

SCALE: 3/16" = 1'-0"


SHEET# S-2 L

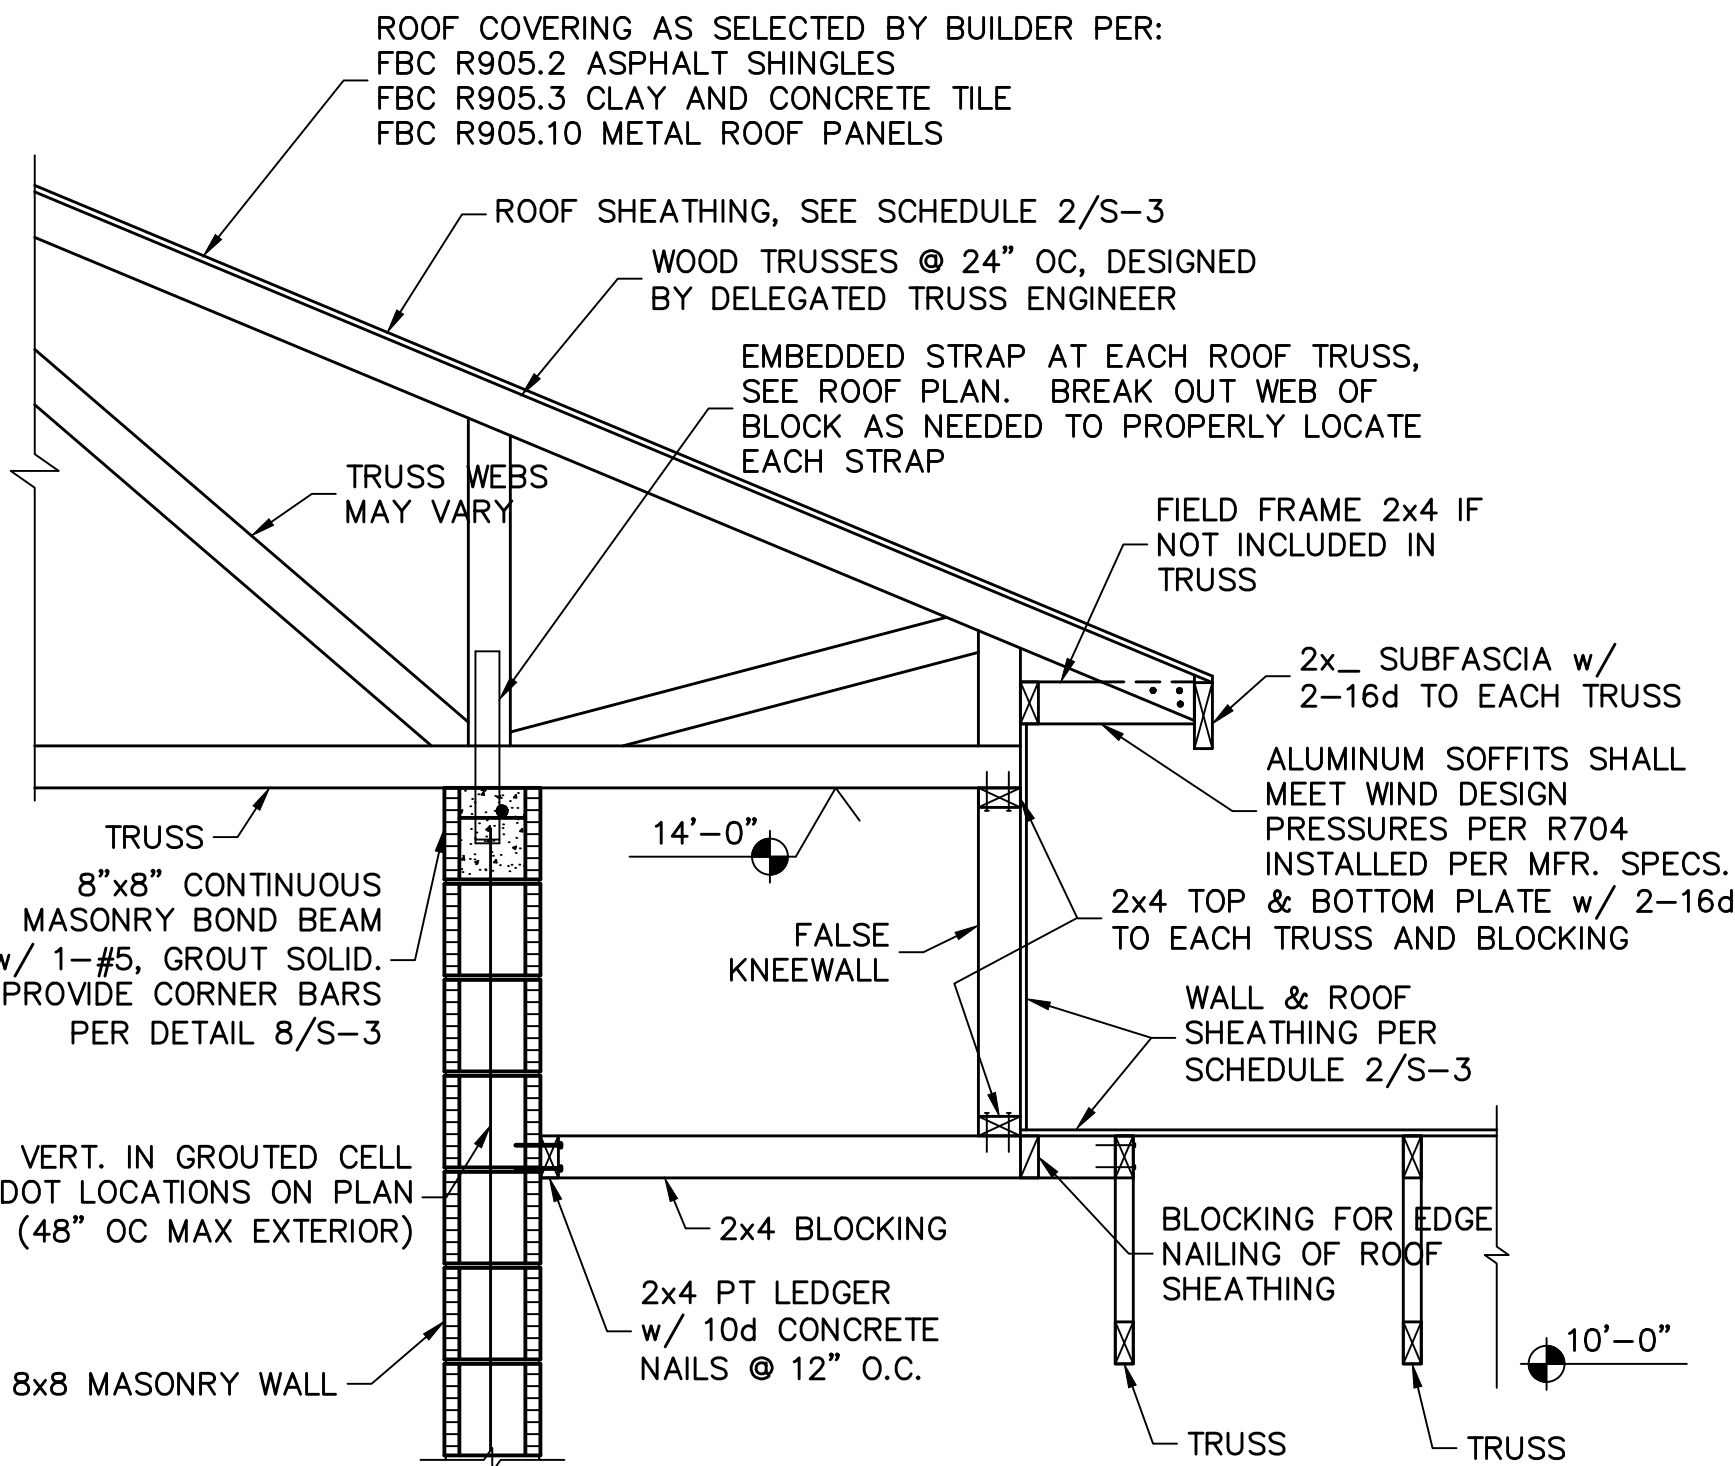


1 FALSE KNEEWALL AT ENTRY
SCALE: 3/4" = 1'-0"
ONLY USED FOR ELEVATIONS F & M

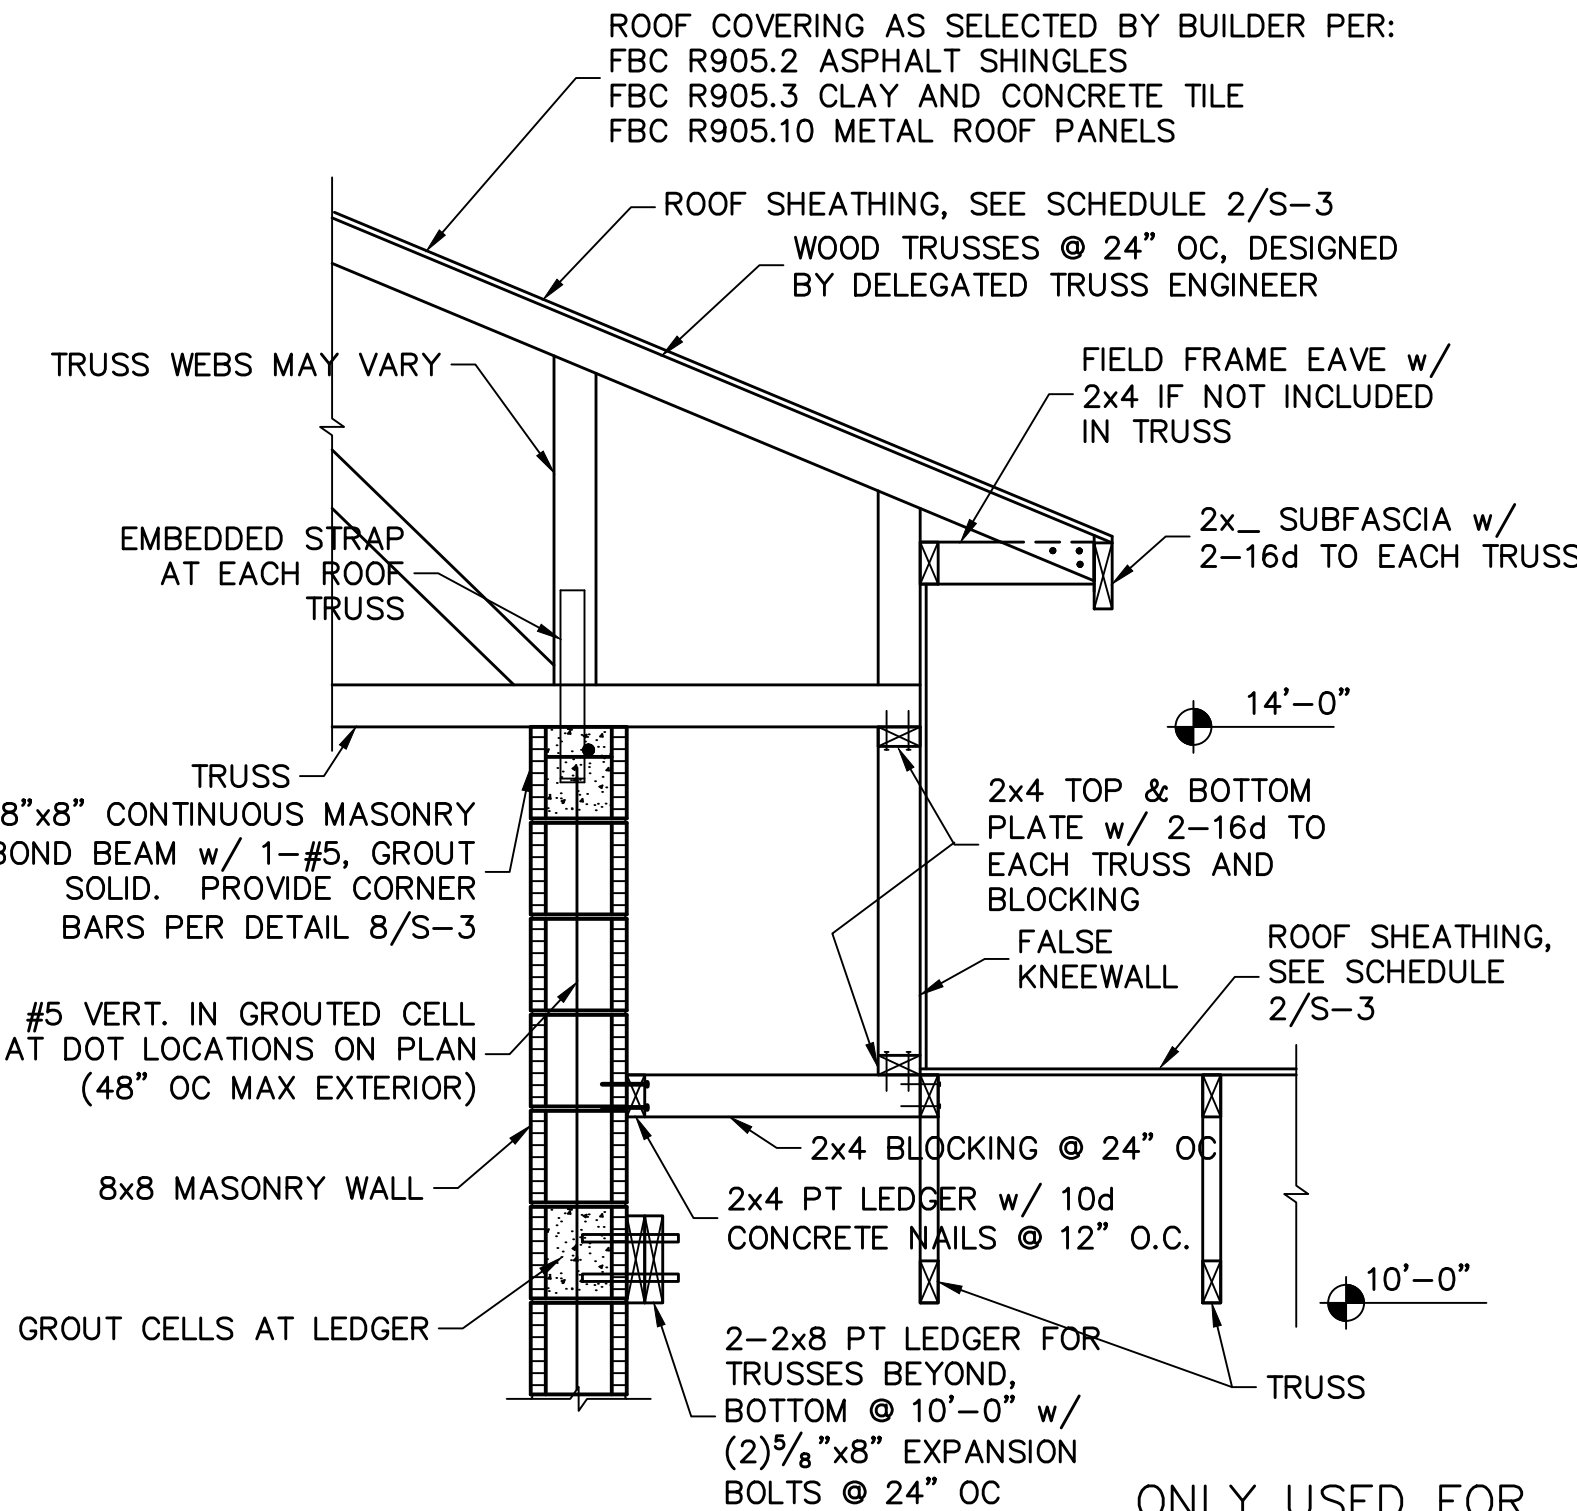


2 FALSE KNEEWALL AT ENTRY
SCALE: 3/4" = 1'-0"
ONLY USED FOR ELEVATION E & L

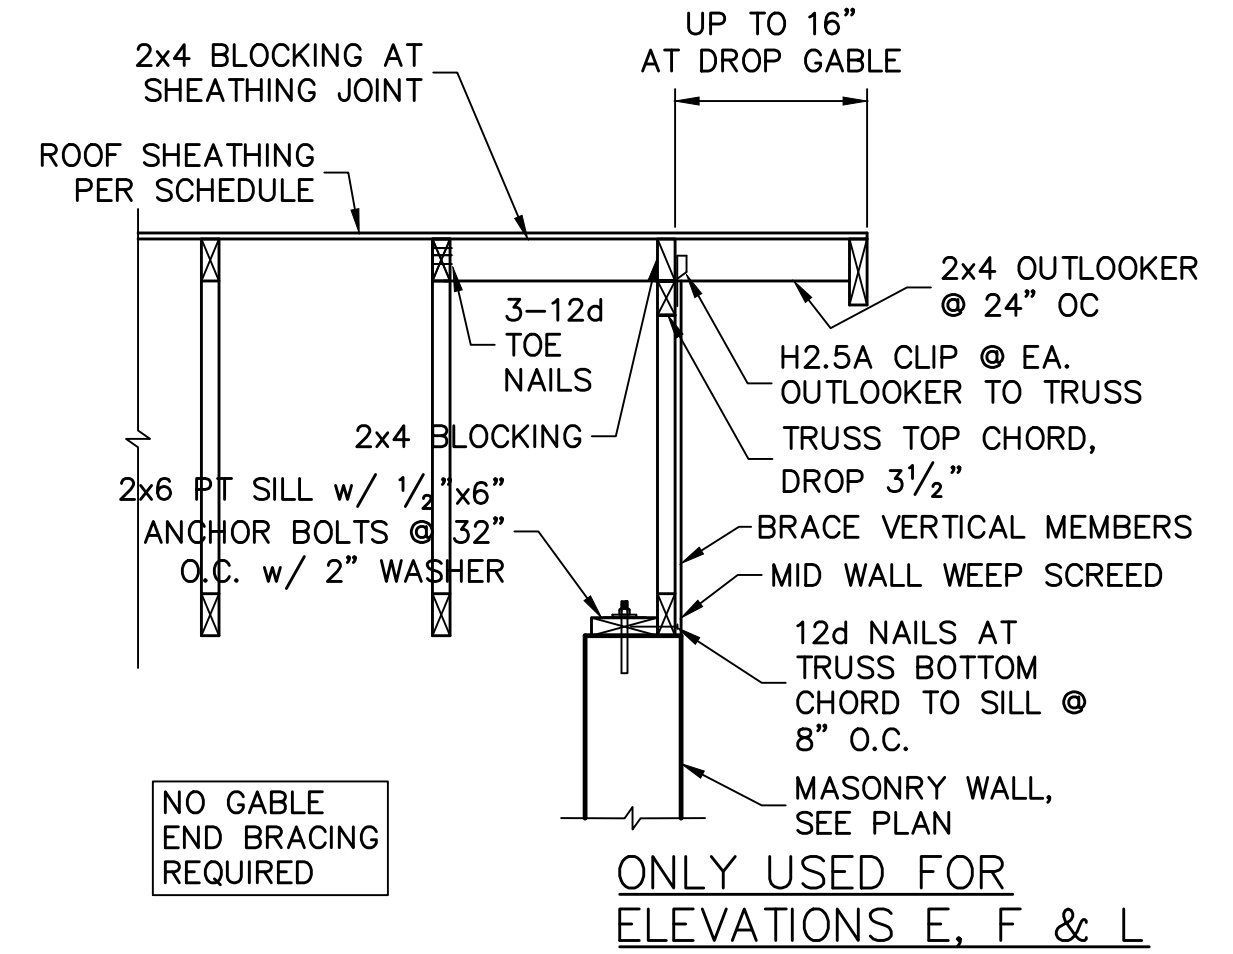


3 OUTLOOKER DETAIL AT DROP GABLE
SCALE: N.T.S.

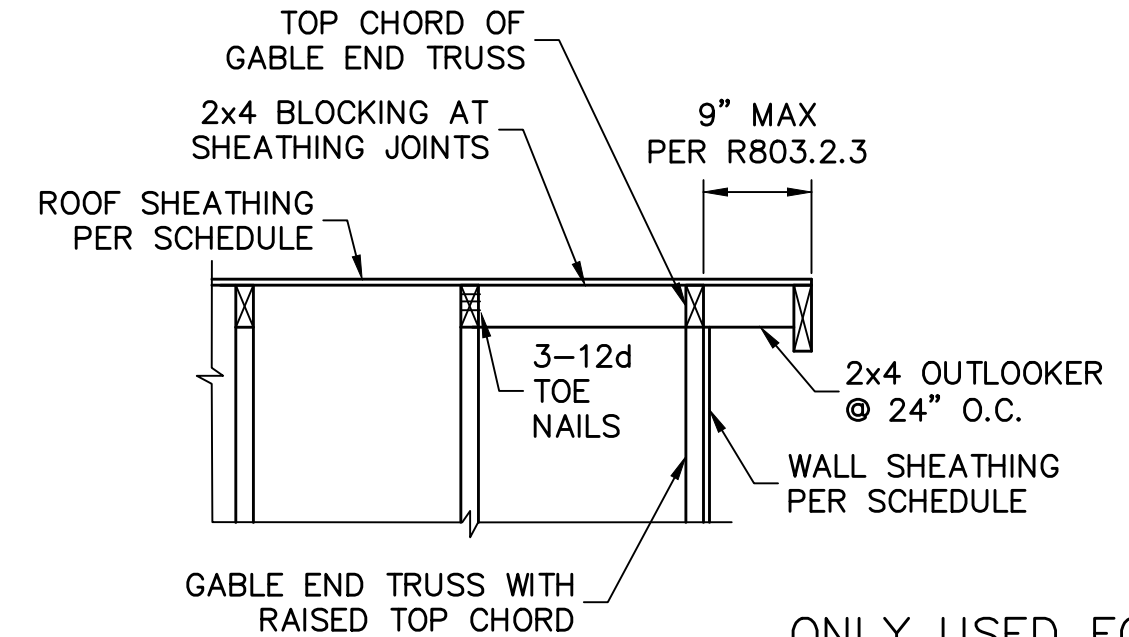


4 OUTLOOKER DETAIL AT RAISED GABLE
SCALE: N.T.S.

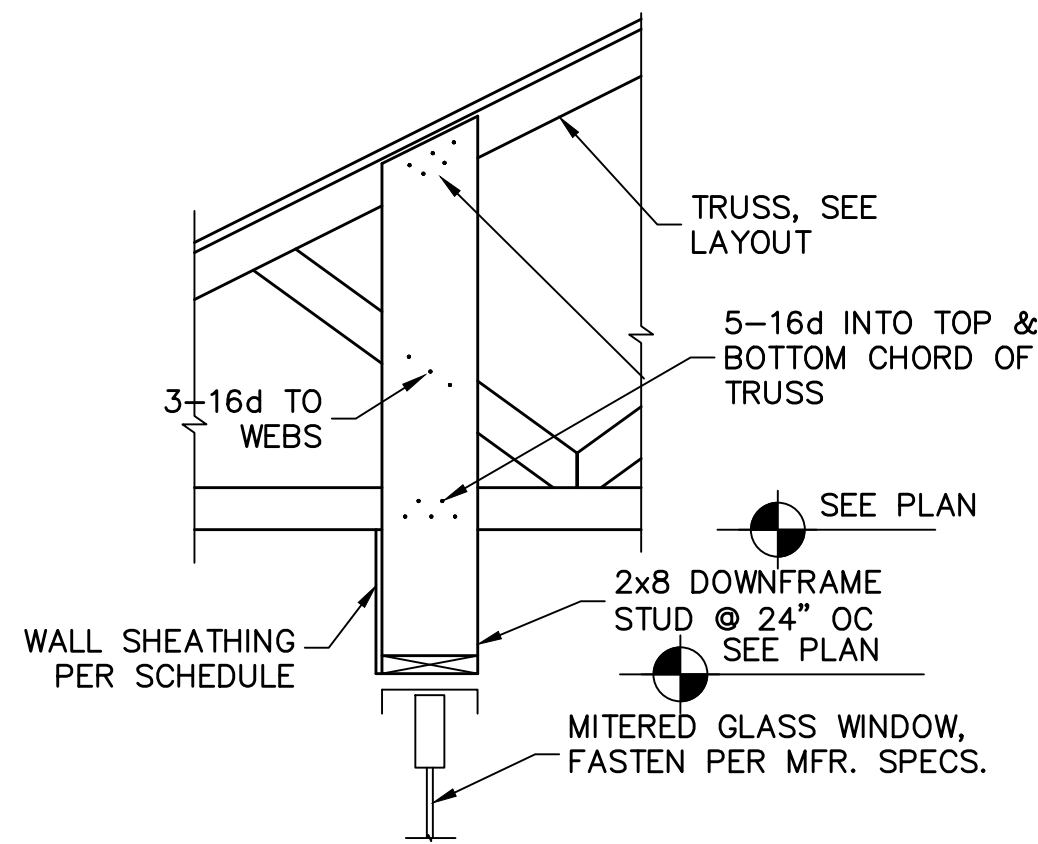


5A SUSPENDED HEADER AT MITERED GLASS
SCALE: 3/4" = 1'-0"

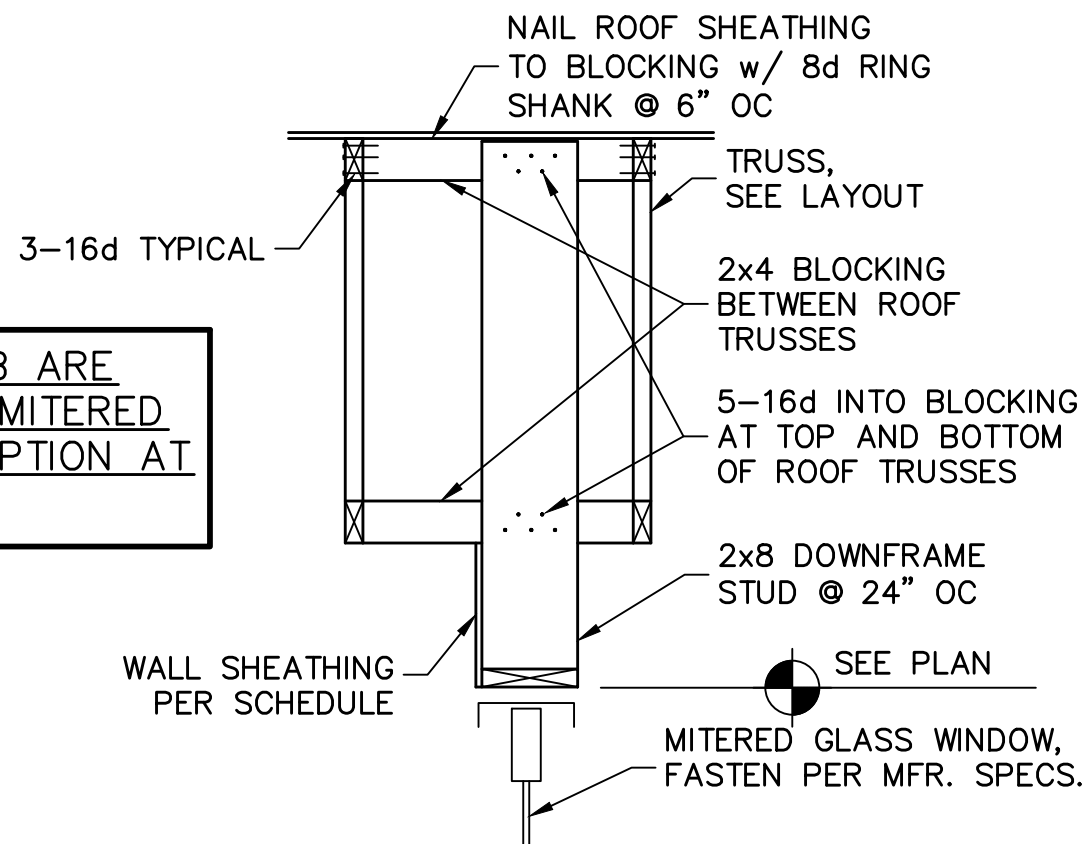


5B SUSPENDED HEADER AT MITERED GLASS
SCALE: 3/4" = 1'-0"

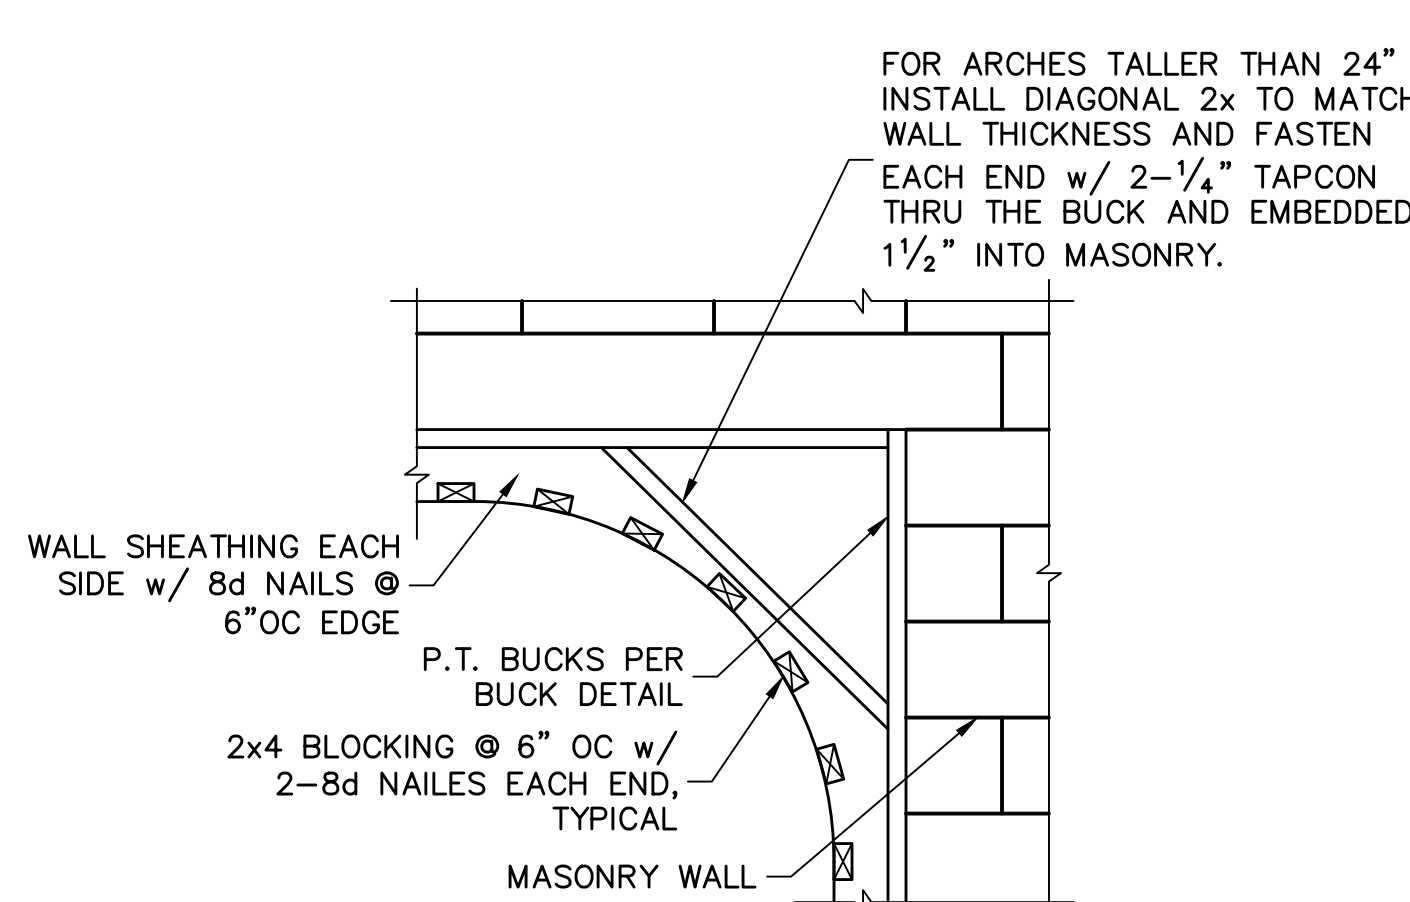


6 WOOD FRAMED ARCH
SCALE: 3/4" = 1'-0"

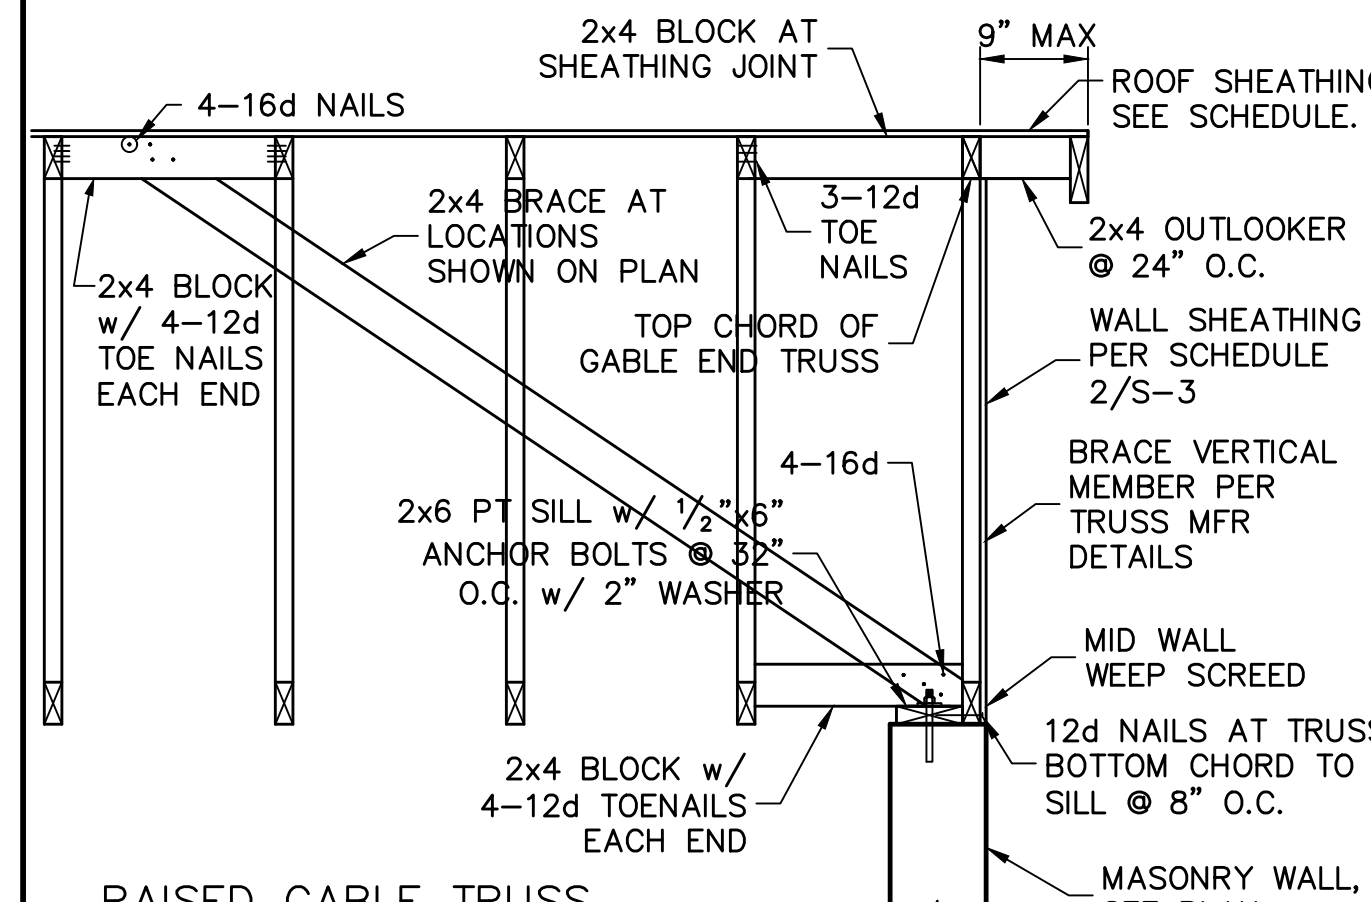

7 GABLE END BRACING
SCALE: N.T.S.
ONLY USED FOR ELEVATION F

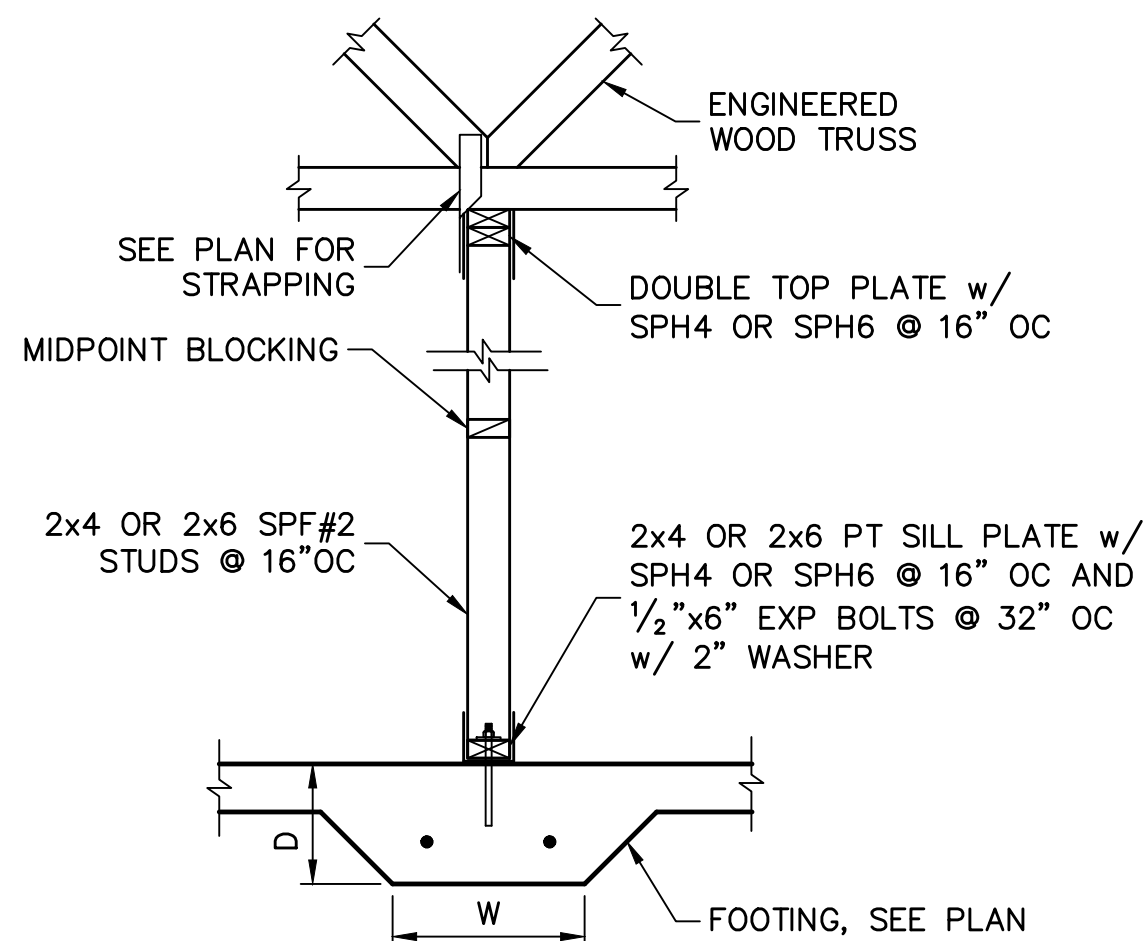

8 INTERIOR STUD BEARING WALL
SCALE: 3/4" = 1'-0"

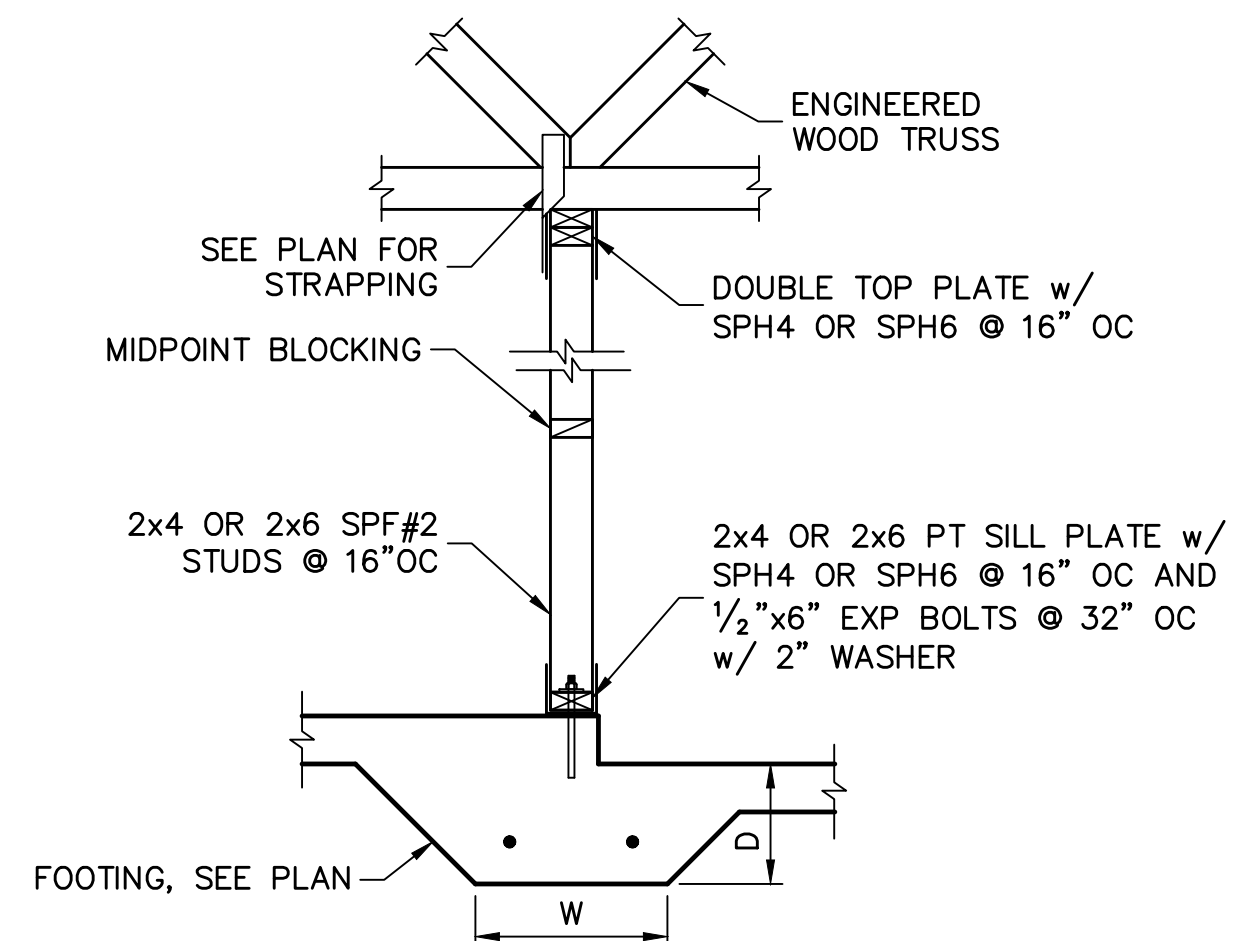

INTERIOR STUD BEARING WALL @ GARAGE
SCALE: 3/4" = 1'-0"

REVISIONS	BY

STRUCTURAL ENGINEERING:
STRUCTURAL SYSTEMS OF NORTH FLORIDA
1634 SE. 47th STREET, SUITE #3
CAPE CORAL, FL 33904
(239) 549-4554
CA# 8829

DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 7th EDITION (2020) RESIDENTIAL

BUILDER:
D.R. HORTON, INC.
America's Builder

STRUCTURAL DETAILS
MODEL 2540 L
EXT LANAI

16080 CROFTON SPRINGS WAY
PORT CHARLOTTE, FLORIDA 33953
LOT: 297 SUBDIVISION: WEST PORT 60S

DESIGN/DRAWN
DWB/GH
CHECKED
DWB
DATE
2/15/22
SCALE
VARIES
JOB NO.
DR 13984
SHEET

S-4
SHEET 4 OF 4