
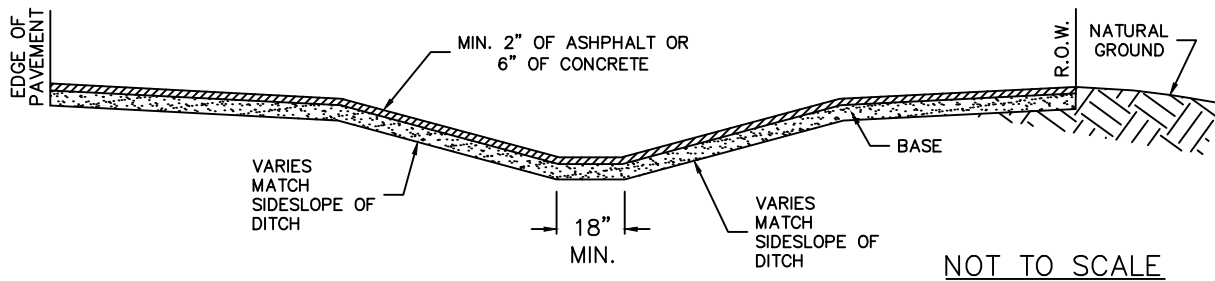


# HAYS COUNTY DRIVEWAY STANDARD

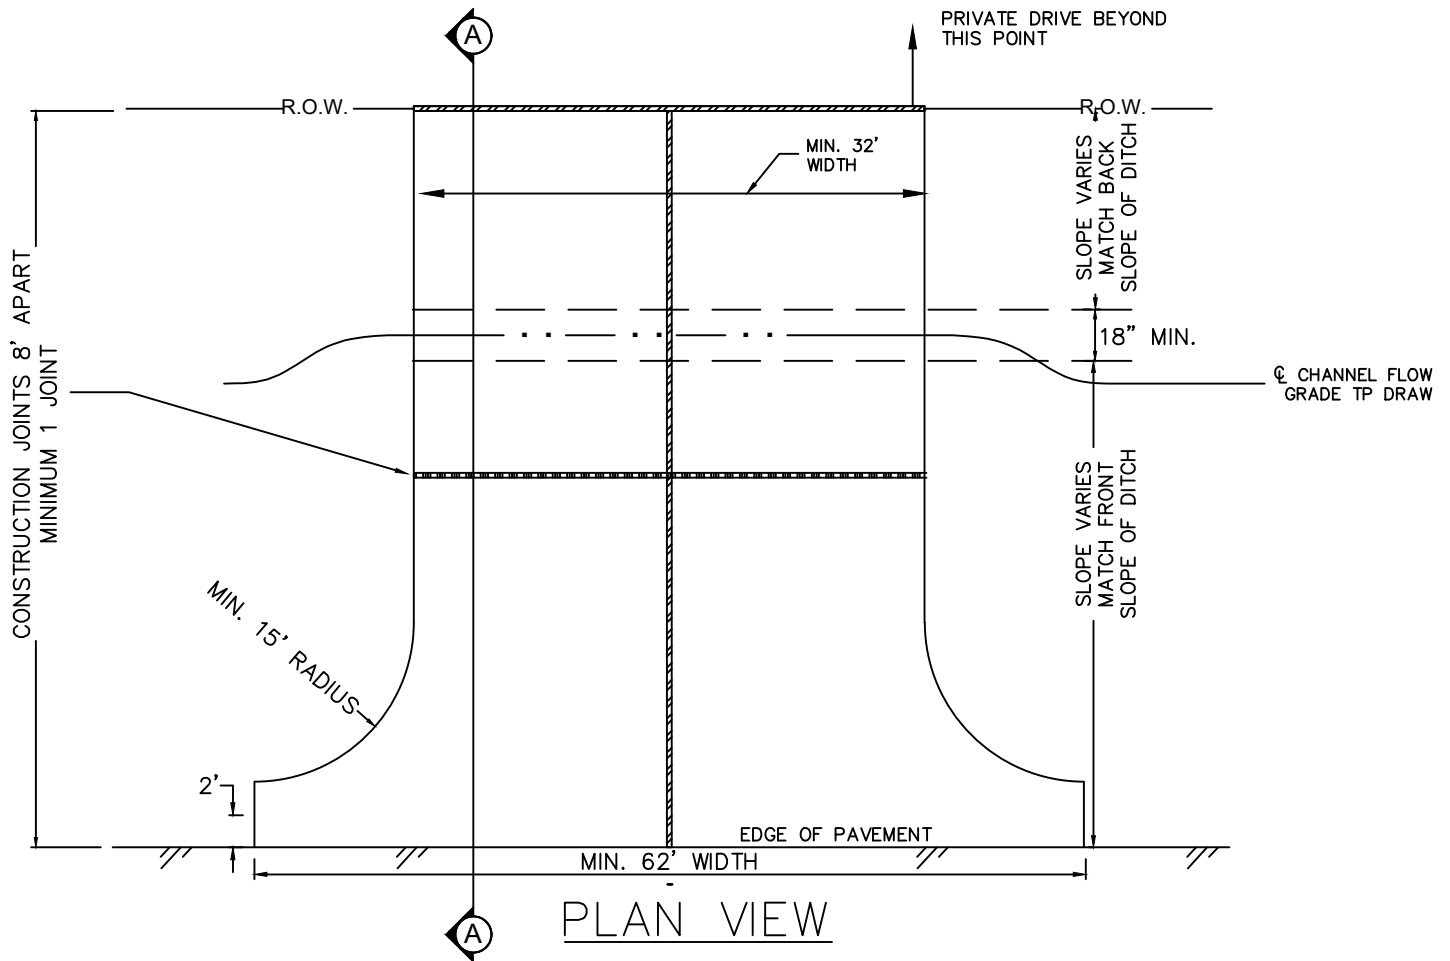

NOTES:

- Engineered drawings shall be submitted with commercial driveway permit applications.
- Driveways shall be constructed of either 6" of class "A" concrete reinforced with #3 bars at 18" OC both ways over 2" of compacted base or 2" of asphalt over 8" of compacted base.
- The top of the dip section shall match the flowline of the ditch.
- An expansion joint shall be placed at the ROW line and at the midpoint of the driveway from ROW line to the edge of pavement, with #4 smooth bars placed at mid depth 12" OC.
- Place an expansion joint down the center of driveway, all driveways.

HAYS COUNTY, TEXAS  
COMMERCIAL DRIVEWAY  
DIP-STYLE