



HAYS COUNTY DRIVEWAY STANDARD

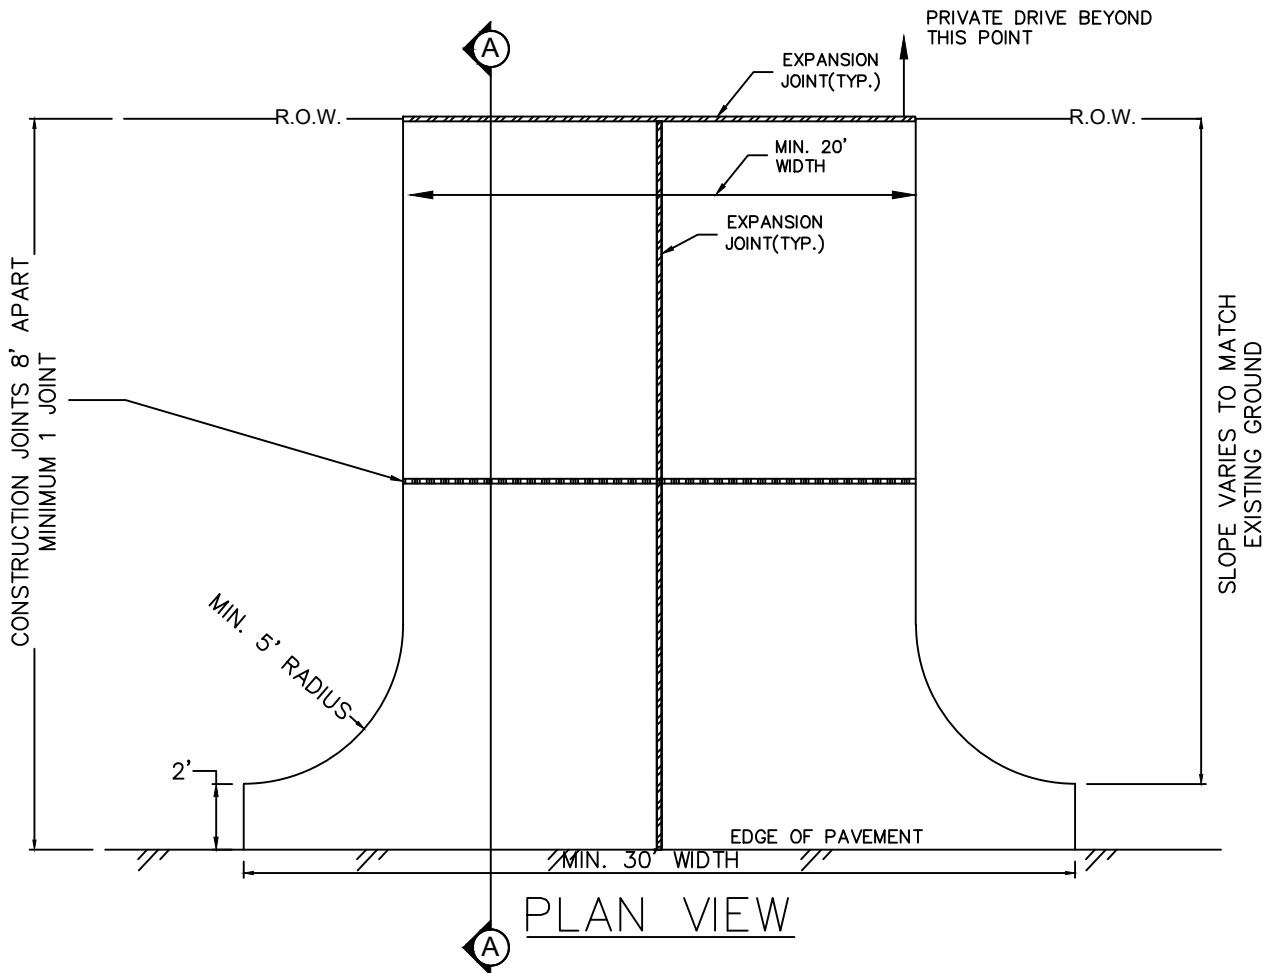

PLAN VIEW

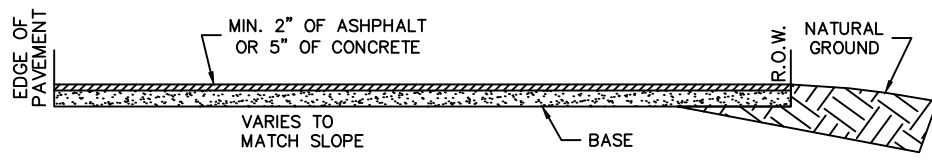

SECTION A-A

NOT TO SCALE

NOTES:

- Driveways shall be constructed of either 5" of class "A" concrete reinforced with 6ga welded wire mesh over 2" of compacted base or 1.5" of asphalt over 6" of compacted base.
- The slope of the driveway shall match the slope of the existing ground.
- An expansion joint shall be placed at the ROW line and at the midpoint of the driveway from ROW line to the edge of pavement, with #4 smooth bars placed at mid depth 12" OC.
- Place an expansion joint down the center of driveway, all driveways.

HAYS COUNTY, TEXAS
RESIDENTIAL DRIVEWAY
SHEET FLOW